


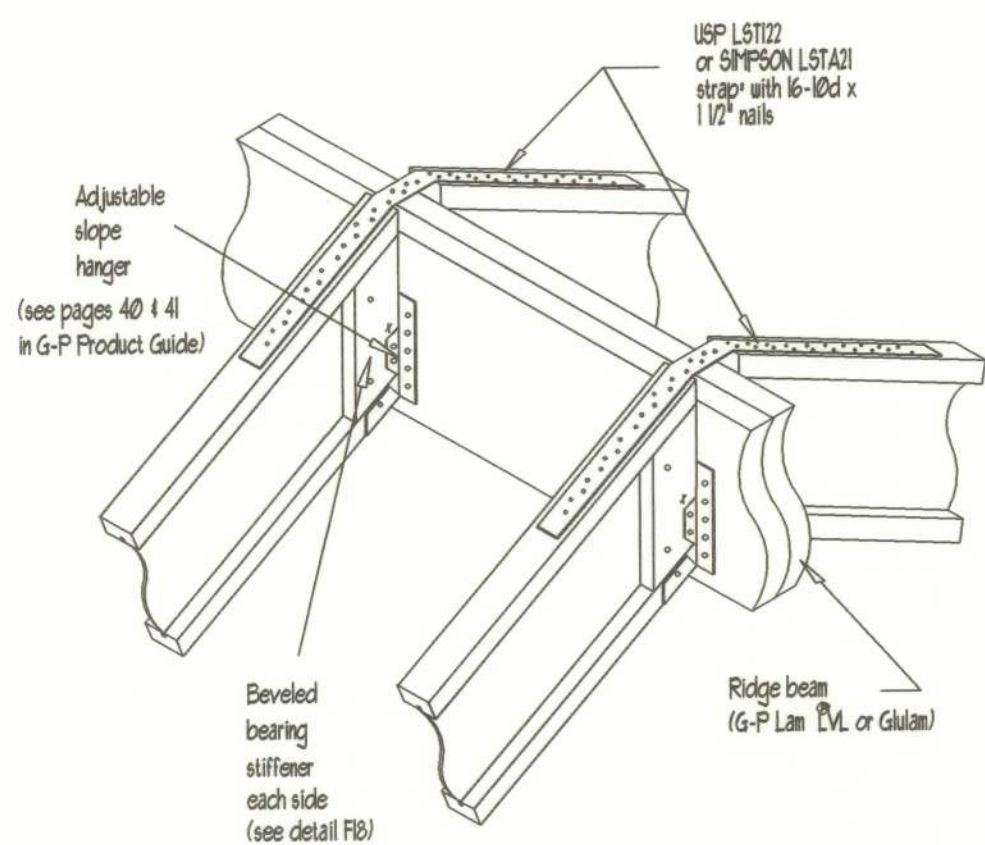


*Strap required for joist depths exceeding 14" or members with slope of 1/2 or greater.

Uplift connections may be required.


RIDGE-RAFTER CONNECTION

1/2 maximum slope

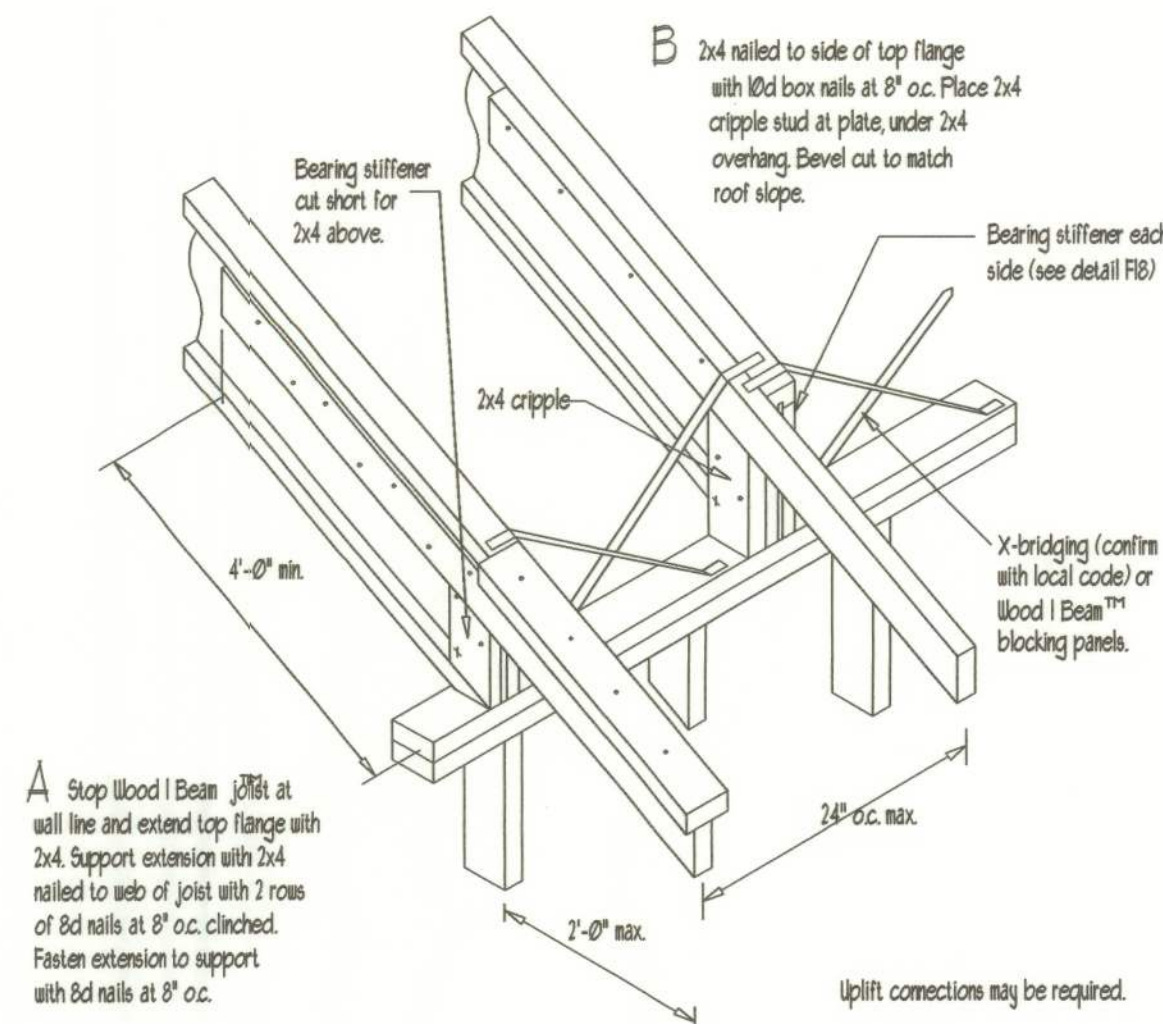


OPTIONAL OVERHANG EXTENSIONS

May be used with detail F4, F5 and F6. Low end of joist only.

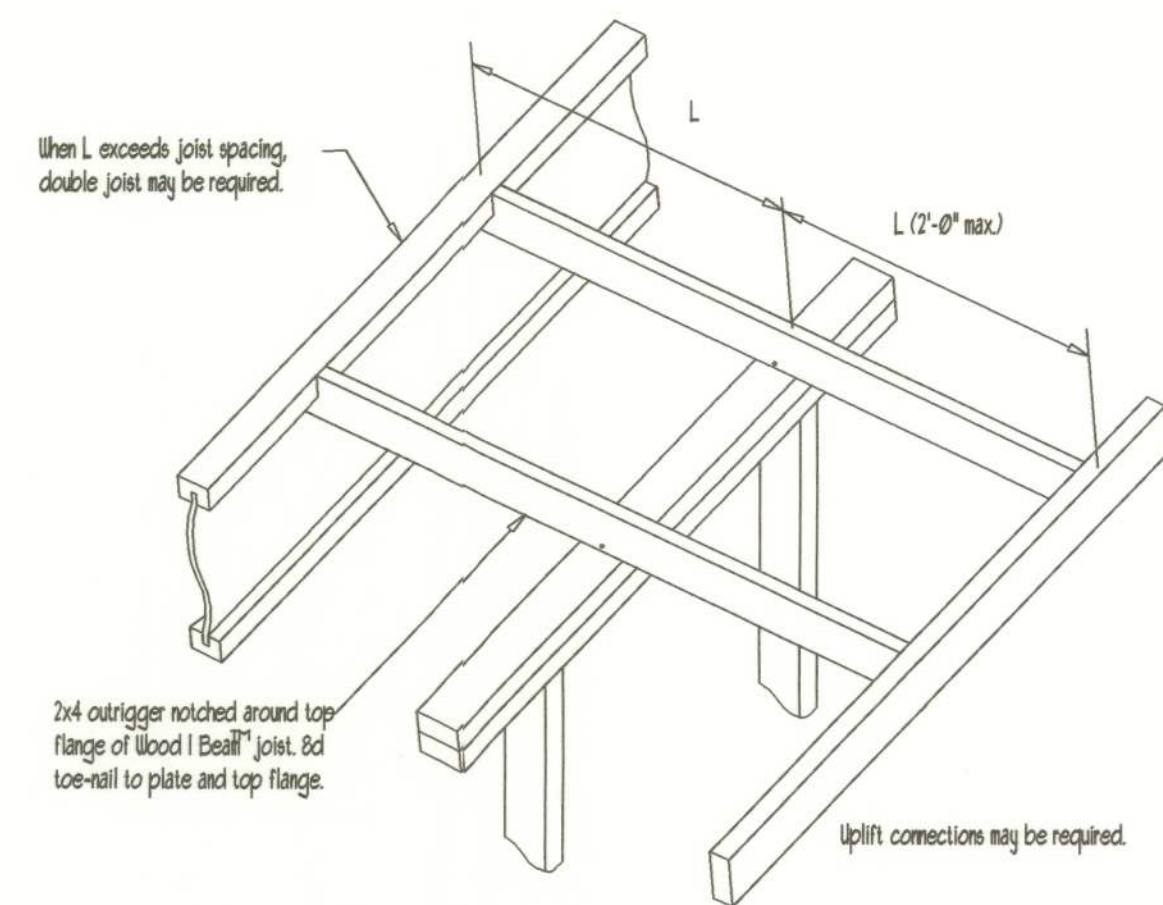

OVERHANG PARALLEL TO JOIST

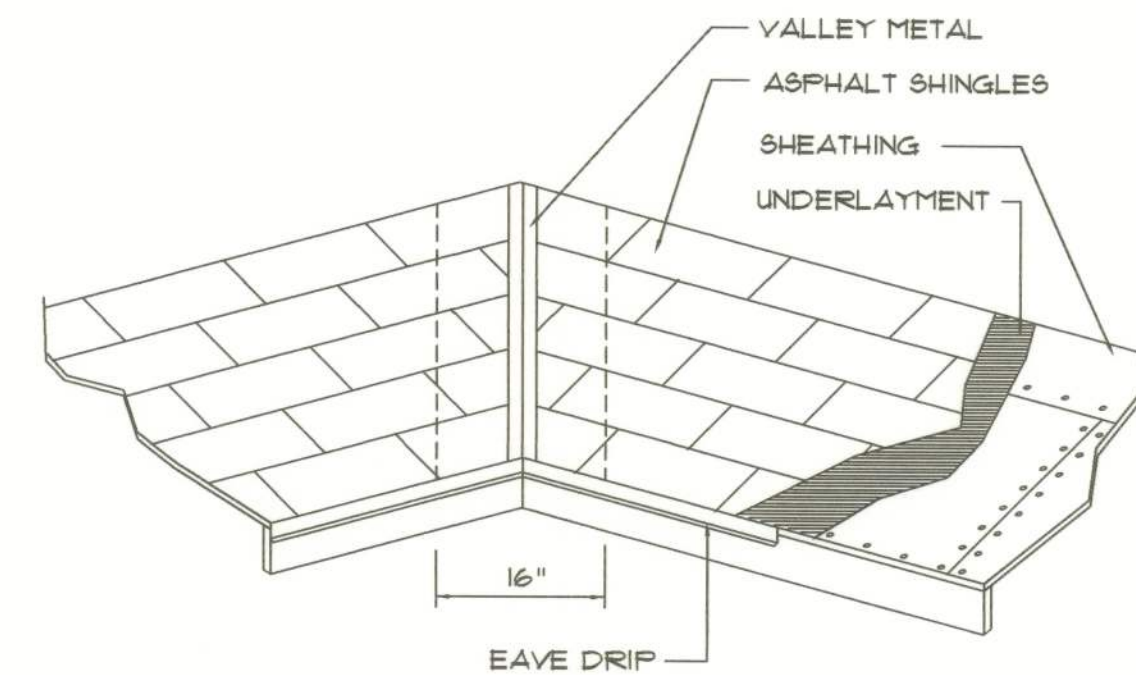


VALLEY FLASHING

ROOFING METALS for FLASHING/ROOFING MINIMUM THICKNESS REQUIREMENTS			
MATERIAL	MINIMUM THICKNESS (in)	GAGE	WEIGHT (OZ.)
COPPER			16
ALUMINUM	0.024		
STAINLESS STEEL		28	
GALVANIZED STEEL	0.0175	26 (ZINC COATED G90)	
ZINC ALLOY LEAD PAINTED TERNE	0.021		40 20

Roofing/Flashing DETS.

SCALE: NONE


C

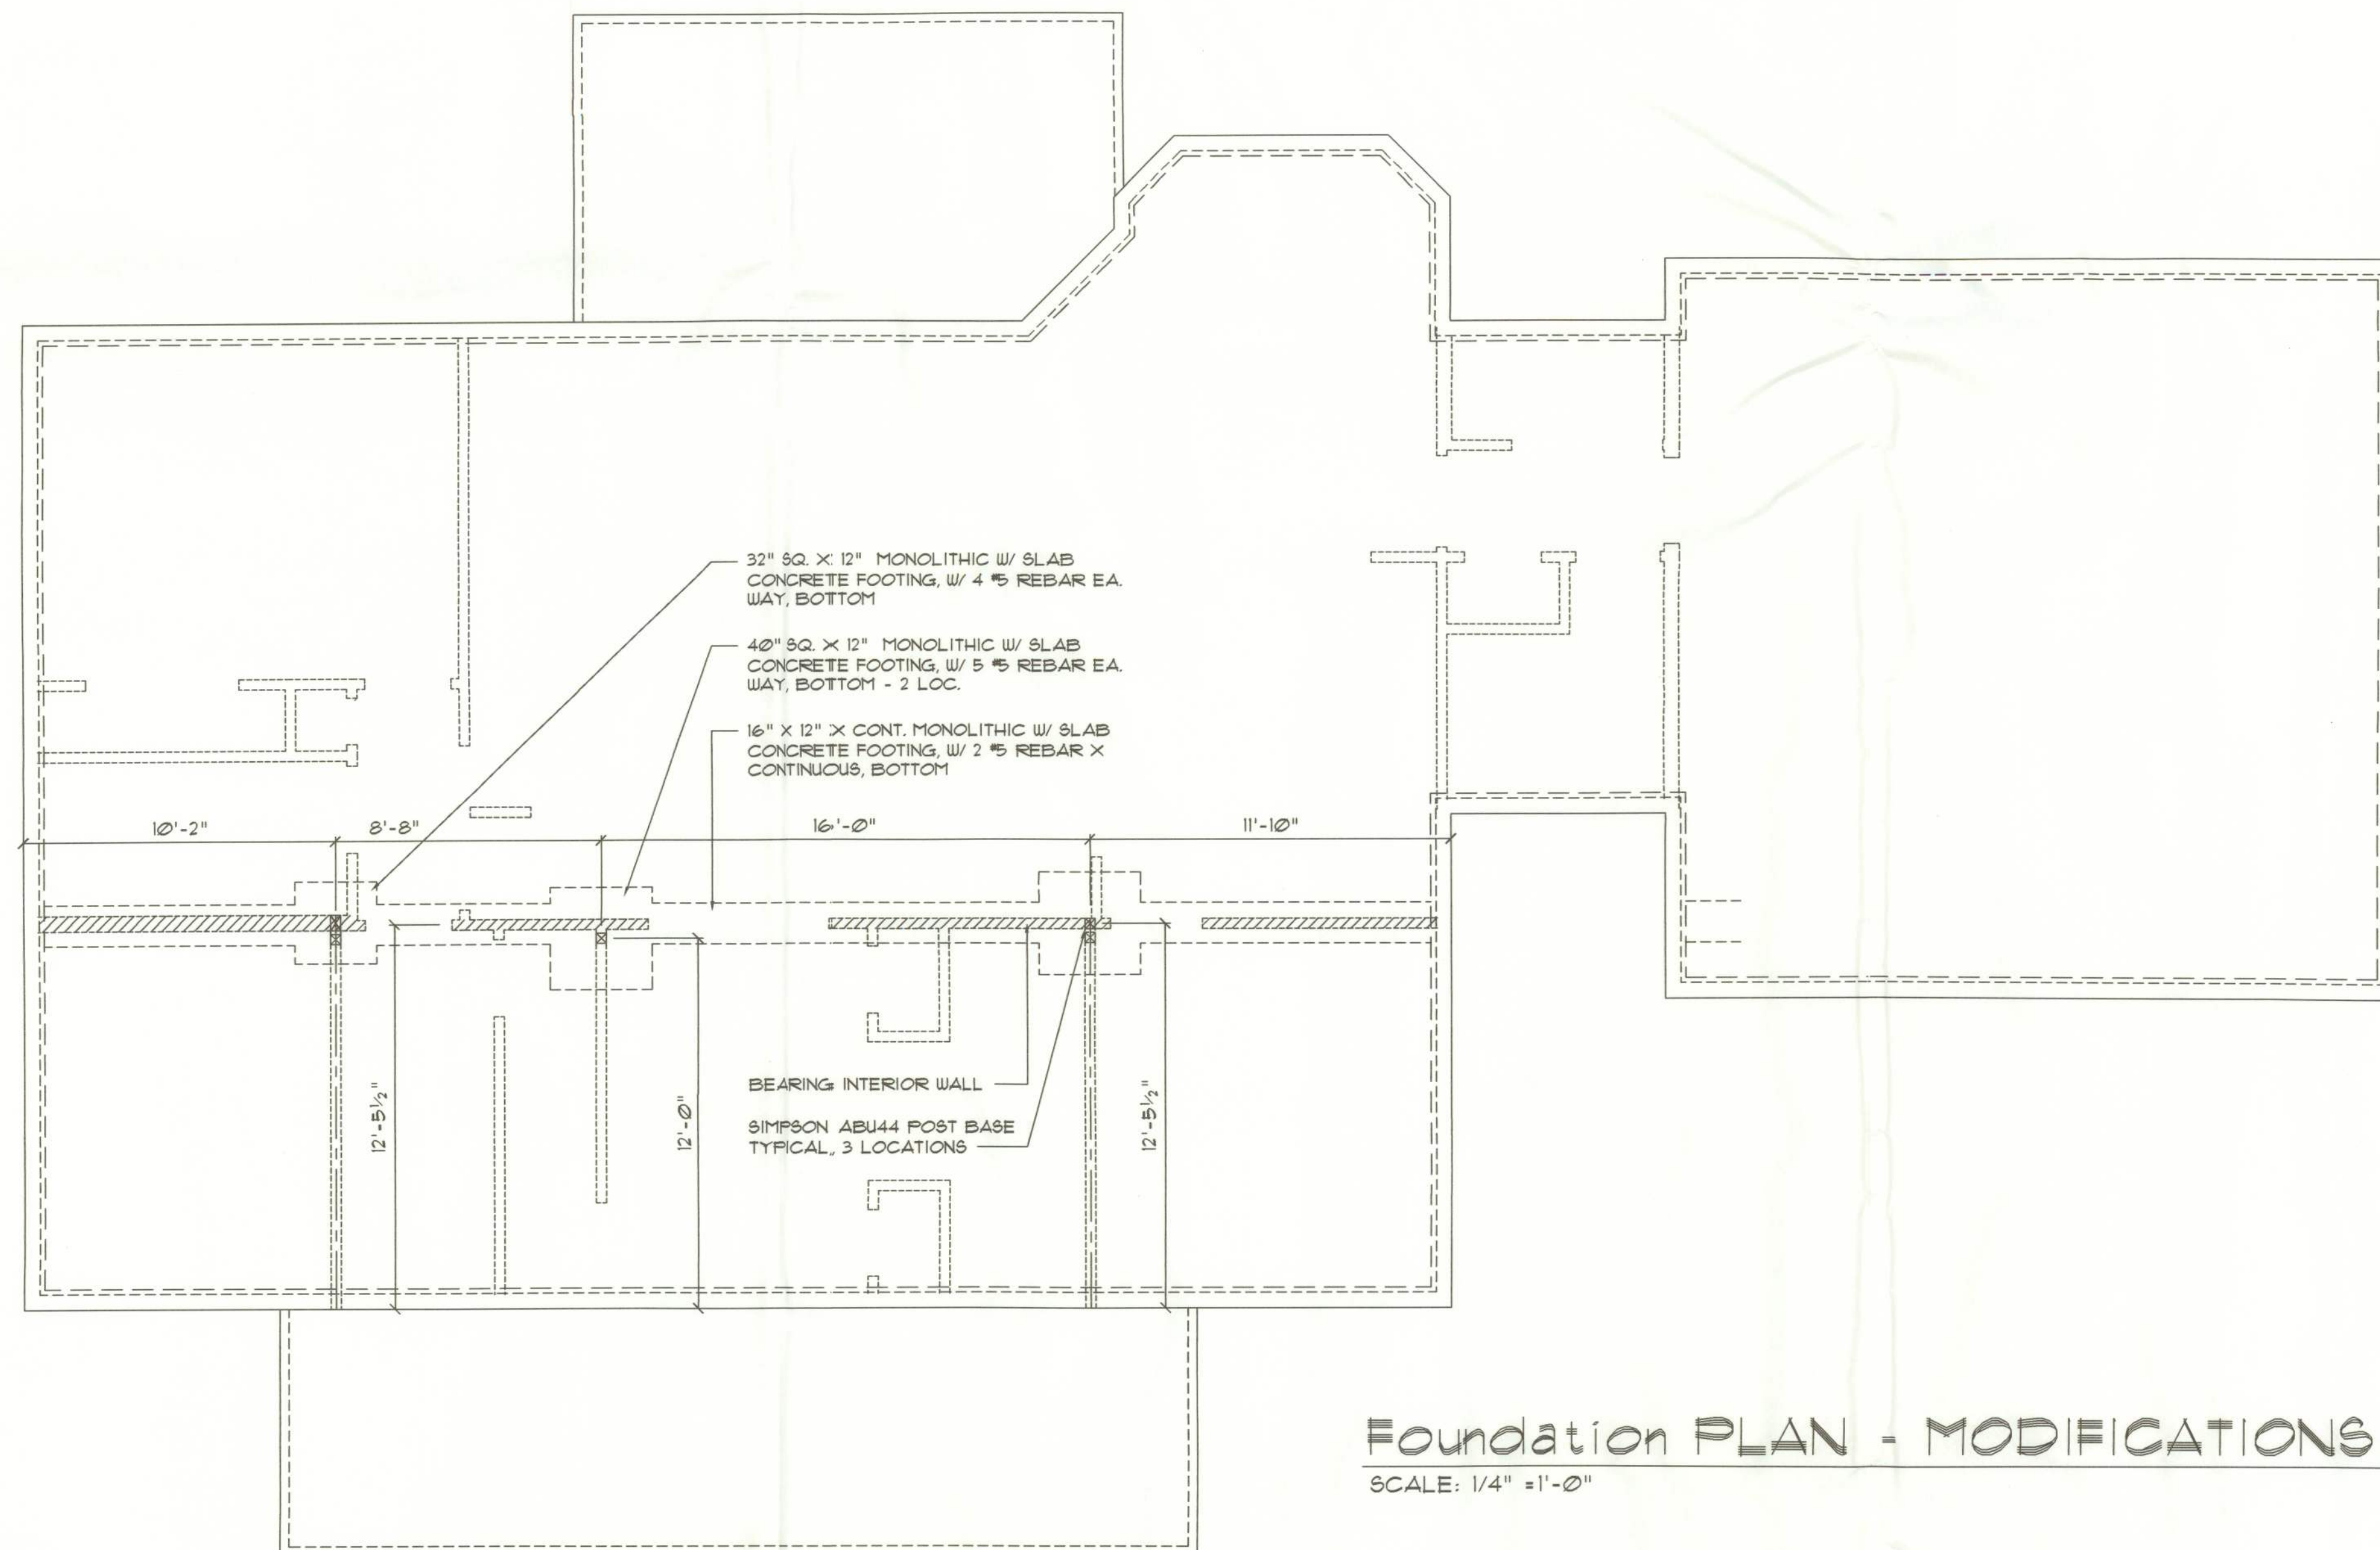

Foundation PLAN - MODIFICATIONS

SCALE: 1/4" = 1'-0"

AREA OF ATTIC	REQ'D L.F. OF VENT	NET FREE AREA OF INTAKE
1600 SF	20 LF	410 SQ.IN.
1800 SF	24 LF	490 SQ.IN.
2200 SF	28 LF	570 SQ.IN.
2500 SF	32 LF	650 SQ.IN.
2800 SF	36 LF	730 SQ.IN.
3100 SF	40 LF	810 SQ.IN.
3600 SF	44 LF	920 SQ.IN.

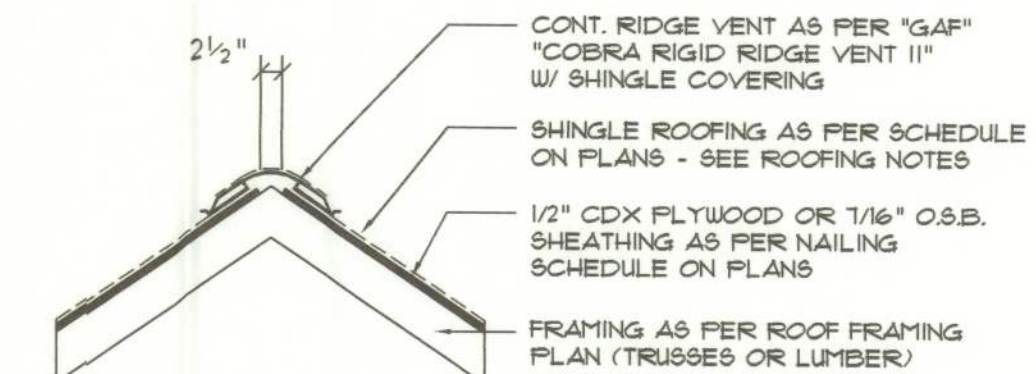

MIAMI/DADE PRODUCT APPROVAL REPORT: #28-0113.05

Ridge Vent DETAIL

SCALE: 3/4" = 1'-0"

B

REVISIONS


SOFTWARE
ARCHITECTURAL DESIGN SOFTWARE

Wm C. My

ALTERNATE CONVENTIONAL ROOF FRAMING OF RESIDENCE for:

ED & JUDY FOSTER


PROJECT ADDRESS: 410 SE MYRTIS DORTCH TERRACE, LAKE CITY, FLORIDA 33025

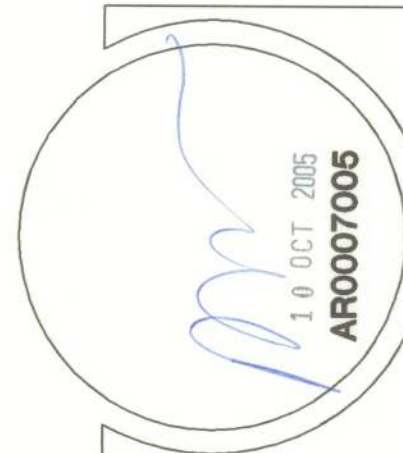

NICHOLAS GEISLER PAUL ARCHITECT
N.C.A.R.B. Certified

JOINT VENTURED WITH

© WILLIAM MYERS DESIGN
P.O. BOX 1918
LAKE CITY, FL 33006
(386) 758-8406
will@willmyers.net

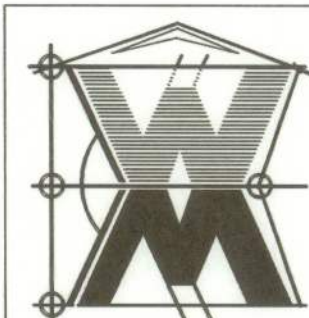

JOB NUMBER
2K547

DATE
26 SEP 2005

SHEET NUMBER
SD.3
OF 4 SHEETS