

SYSTEM INFORMATION	
MODULE	HANWHA Q.PEAK DUO BLK-G10+ 365
INVERTER	ENPHASE IQ8PLUS-72-2-US
RACKING	ROOFTECH RT-MINI II W/ ECOFASTEN CLICKFIT 2-RAIL RACKING SYSTEM
SYSTEM SIZE (DC)	7.3 KW
LOCATION	30.1285371,-82.6336360

CLIMATIC & GEOGRAPHIC DESIGN CRITERIA TABLE R301.2(1)	
SPEED (MPH)	120
TOPOGRAPHIC EFFECTS	B
SPECIAL WIND REGION	NO
WIND BORNE DEBRIS ZONE	2
SEISMIC DESIGN CATEGORY	C
CLIMATE ZONE	2A
WIND EXPOSURE CATETORY	B

PLAN KEY	
PV-1	COVER PAGE
PV-1.1	ATTACHMENT DETAIL
PV-1.2	ATTACHMENT DETAIL
PV-2	ROOF LAYOUT
PV-3	ELECTRICAL
PV-3.1	ELECTRICAL CONT.
PV-3.2	EQUIPMENT LABELS



GENERAL NOTES:

THIS PV SYSTEM HAS BEEN DESIGNED TO MEET THE MINIMUM DESIGN STANDARDS FOR BUILDING AND OTHER STRUCTURES OF THE ASCE 7-16, 7TH EDITION 2020 FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 FLORIDA BUILDING CODE, 7TH EDITION 2020 FLORIDA FIRE PREVENTION CODE, NEC 2017 AND ALL LOCAL CODES & ORDINANCES.

ROOF SHALL HAVE NO MORE THAN TWO LAYERS OF COVERING IN ADDITION TO THE SOLAR EQUIPMENT.

INSTALLATION OF SOLAR EQUIPMENT SHALL BE FLUSH MOUNTED, PARALLEL TO AND NO MORE THAN 6-INCHES ABOVE THE SURFACE OF THE ROOF.

ANY PLUMBING VENTS ARE NOT TO BE CUT OR COVERED FOR SOLAR EQUIPMENT INSTALLATION. ANY RELOCATION OR MODIFICATION OF THE VENT REQUIRES A PLUMBING PERMIT AND INSPECTION.

ALL DESIGN, CALCULATIONS ARE PERFORMED BY DANIEL DUNZIK REGISTERED ARCHITECT. FLORIDA STATE STATUTE 471.003(3) PROVIDES THAT LICENSED ARCHITECTS ARE EXEMPTED FROM THE PROVISIONS OF CHAPTER 471 ENGINEERING AND NOT PRECLUDED FROM PERFORMING ENGINEERING SERVICES FOR INTEGRATED SYSTEMS AND SERVICES THAT ARE INCIDENTAL TO BUILDINGS AND STRUCTURES.

INVERTER PLACEMENT:

SYSTEM UTILIZES "ENPHASE" MICRO-INVERTERS WITH RAPID SHUTDOWN CONTROL LOCATED ON THE BACK SIDE OF EACH MODULE.

STRUCTURAL STATEMENT:

THE EXISTING STRUCTURE IS ADEQUATE TO SUPPORT THE NEW LOADS IMPOSED BY THE PHOTOVOLTAIC MODULE SYSTEM INCLUDING UPLIFT & SHEAR.EXISTING RAFTER SIZES & DIMENSIONS CONFORM TO 7TH EDITION 2020 FLORIDA RESIDENTIAL CODE

MOUNTING BRACKETS AND HARDWARE MEET OR EXCEED FLORIDA CODE REQUIREMENTS FOR THE DESIGN CRITERIA OF THE TOWN.

FSEC CERTIFICATION STATEMENT:

PER FL. STATUE 377.705 , I, MINA A. MAKAR PE# 86753, CERTIFICATE OF AUTHORIZATION #33404, AN ENGINEER LICENSED PURSUANT TO CHAPTER 471,CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 2020

FBC, RESIDENTIAL 2020

TABLE R301.2.1.3											
WIND SPEED CONVERSIONS ^a											
V _{ult}	110	115	120	130	140	150	160	170	180	190	200
V _{asd}	85	89	93	101	108	116	124	132	139	147	155

For SI: 1 mile per hour = 0.447 m/s.

- a. Linear interpolation is permitted.


HANWHA Q.PEAK DUO BLK-G10+ 365
365 WATT MODULE
67.6" X 41.1" X 1.26"
(SEE DATASHEET)

BILL OF MATERIALS	
MODULES	20
INVERTERS	20
L-FOOT ATTACHMENT W/ RT-MINI	42
171" RAILS	8
SKIRTS	8
ENPHASE COMBINER BOX	1
EATON 60A FUSIBLE AC DISCONNECT	1
35A FUSES	2
125A LINE TAPS	2



PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

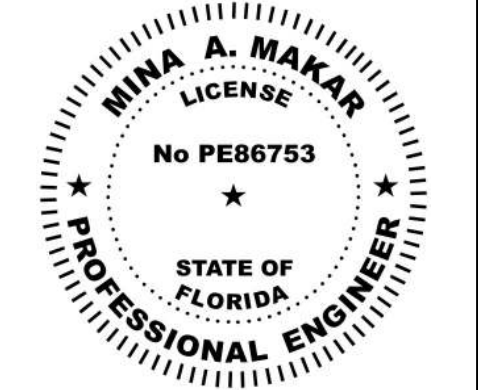

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2023.02.23 10:02:34 -05:00

SOLAR CONTRACTOR
CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819



CUSTOMER INFORMATION
LAQUASHA DIXON - MS119910
797 SOUTHWEST TUSTENUGGEE AVENUE
LAKE CITY, FL 32055
3866234912

PV SYSTEM INFORMATION
SYSTEM SIZE (DC): 7.3 KW
20 MODULES: HANWHA Q.PEAK DUO BLK-G10+ 365
20 INVERTERS: ENPHASE IQ8PLUS-72-2-US

PROJECT INFORMATION		
INITIAL	DATE: 2/23/2023	DESIGNER: AKL
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

COVER PAGE

PV-1

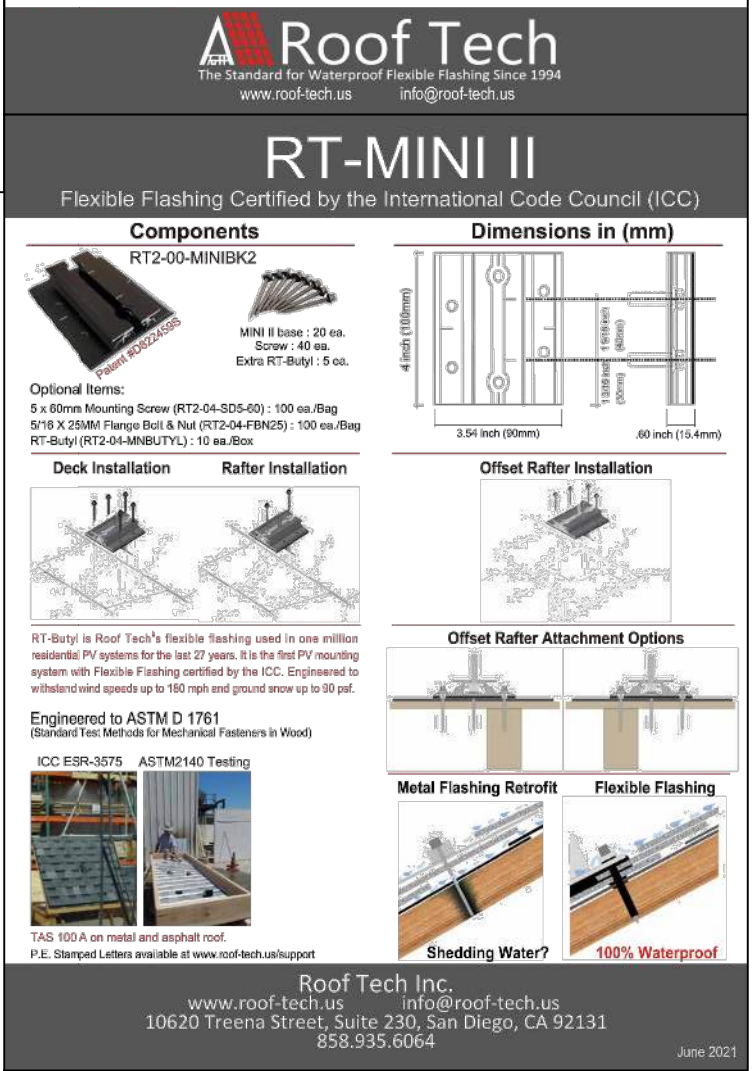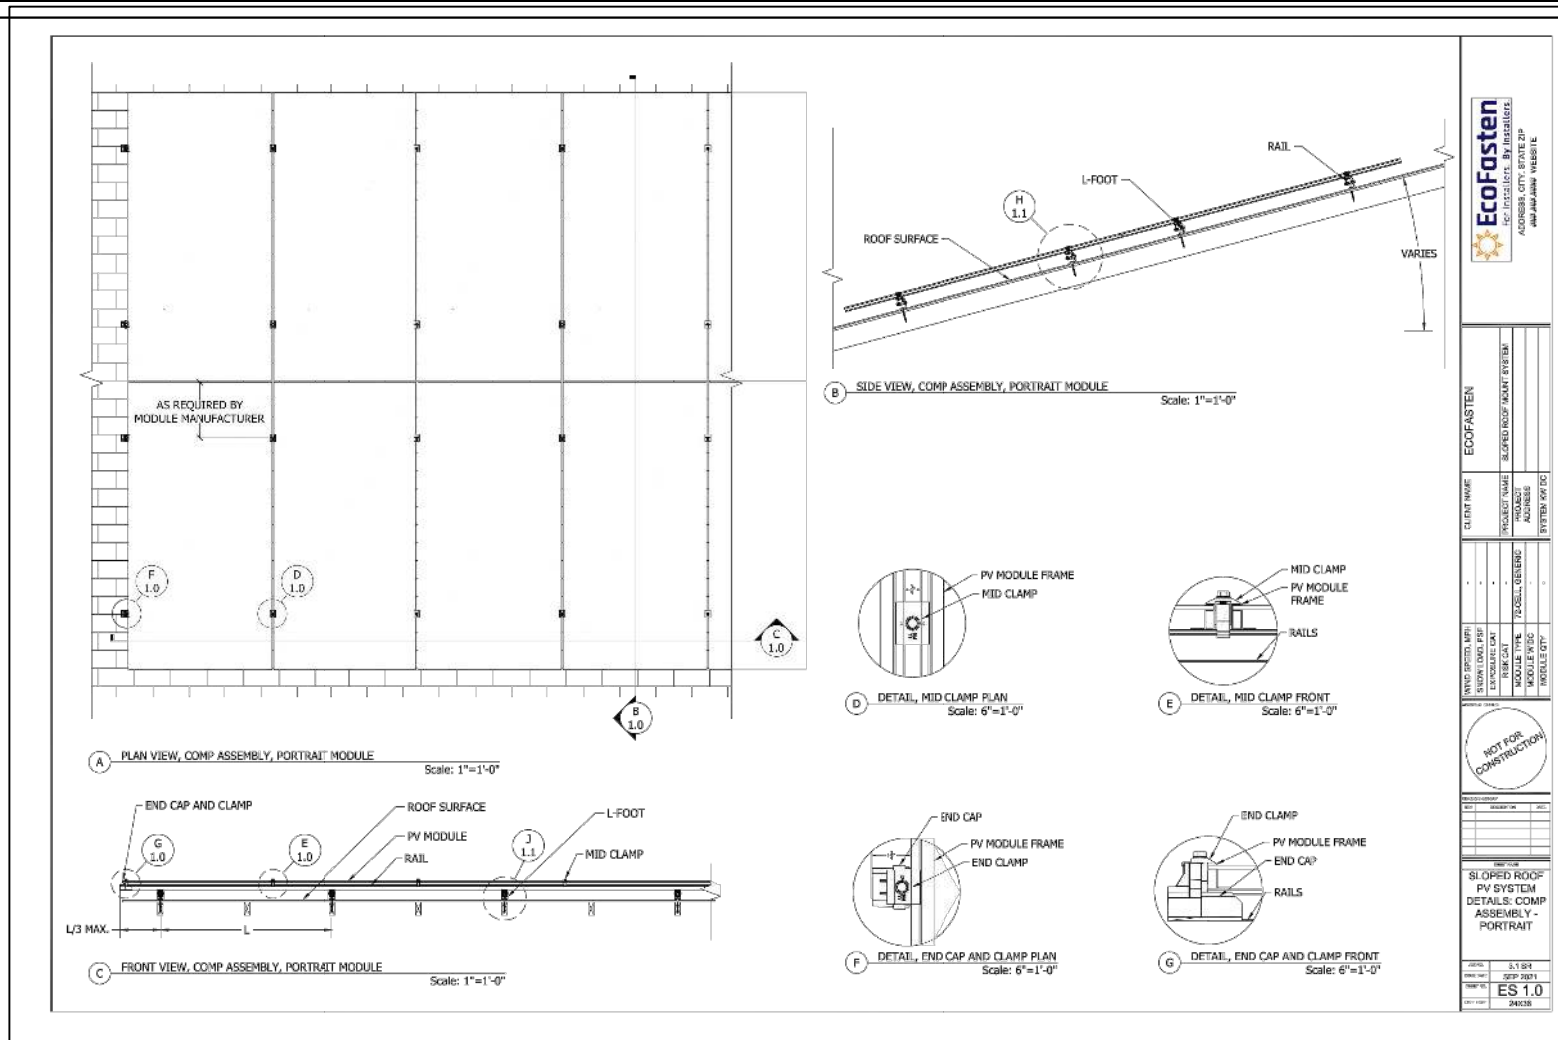




momentum
SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL
ENGINEERING

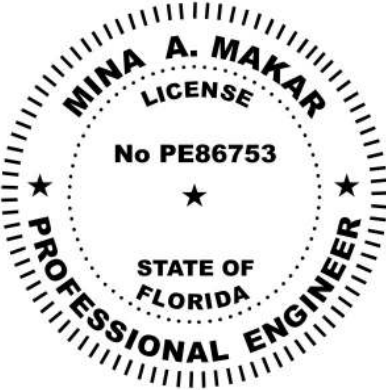

MINA A. MAKAR
LICENSE
No PE86753
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2023.02.23 10:02:34 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

LAQUASHA DIXON - MS119910
797 SOUTHWEST TUSTENUGGEE AVENUE
LAKE CITY, FL 32055
3866234912

PV SYSTEM INFORMATION

SYSTEM SIZE (DC) : 7.3 KW
20 MODULES: HANWHA Q.PEAK DUO BLK-G10+ 365
20 INVERTERS: ENPHASE IQ8PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 2/23/2023	DESIGNER: AKL
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

ATTACHMENT DETAIL

PV-1.1

SCALE: 3/32" = 1'-0"




SOUTHWEST TUSTENUGGEE AVENUE
FRONT OF RESIDENCE

ROOF	PANEL COUNT	TILT	AZIMUTH	SHADING	LANDSCAPE MAX SPAN (ROOF AREA 1/2/3)	PORTRAIT MAX SPAN (ROOF AREA 1/2/3)	LANDSCAPE MAX CANTILEVER	PORTRAIT MAX CANTILEVER
R1	15	15°	270°	96%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10
R2	5	14°	180°	83%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10



PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL
ENGINEERING

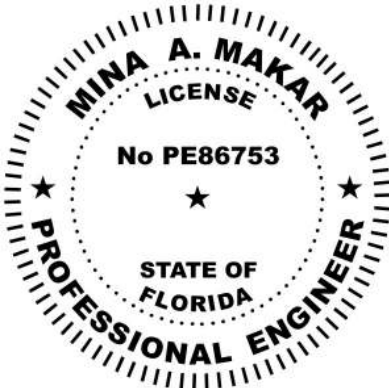

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2023.02.23 10:02:34 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

LAQUASHA DIXON - MS119910
797 SOUTHWEST TUSTENUGGEE AVENUE
LAKE CITY, FL 32055
3866234912

PV SYSTEM INFORMATION

SYSTEM SIZE (DC): 7.3 KW
20 MODULES: HANWHA Q.PEAK DUO
BLK-G10+ 365
20 INVERTERS: ENPHASE
IQ8PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 2/23/2023	DESIGNER: AKL
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:


ROOF LAYOUT

PV-2

SOLAR INSTALLER NOTES:
INSTALL NEW EXTERIOR MOUNTED TAP BOX

TOTAL SQUARE FOOTAGE OF ROOF: 4400 SQFT
SQUARE FOOTAGE OF SOLAR ARRAY:385.89 SQFT
PERCENTAGE OF SOLAR ROOF COVERAGE: 8.78%
18" RIDGE SETBACK SHALL BE REQUIRED

SYMBOL LEGEND			
MSP	MAIN SERVICE PANEL		CHIMNEY
SP	SUB-PANEL		SKYLIGHT
M	UTILITY METER		VENT
AC DISC	AC DISCONNECT		PIPE VENT
UDC	UTILITY DISCONNECT		FAN
LC	LOAD CENTER		SATELLITE DISH
N3R	NEMA 3R BOX W/ ENVOY-S		FIRE SETBACKS
CB	COMBINER BOX		MIN 3'x3' GROUND ACCESS POINT
	MODULE		PITCH DIRECTION
		WIND PRESSURE ZONE LINES. REFER TO PV-2.2 FOR ADDITIONAL INFO	

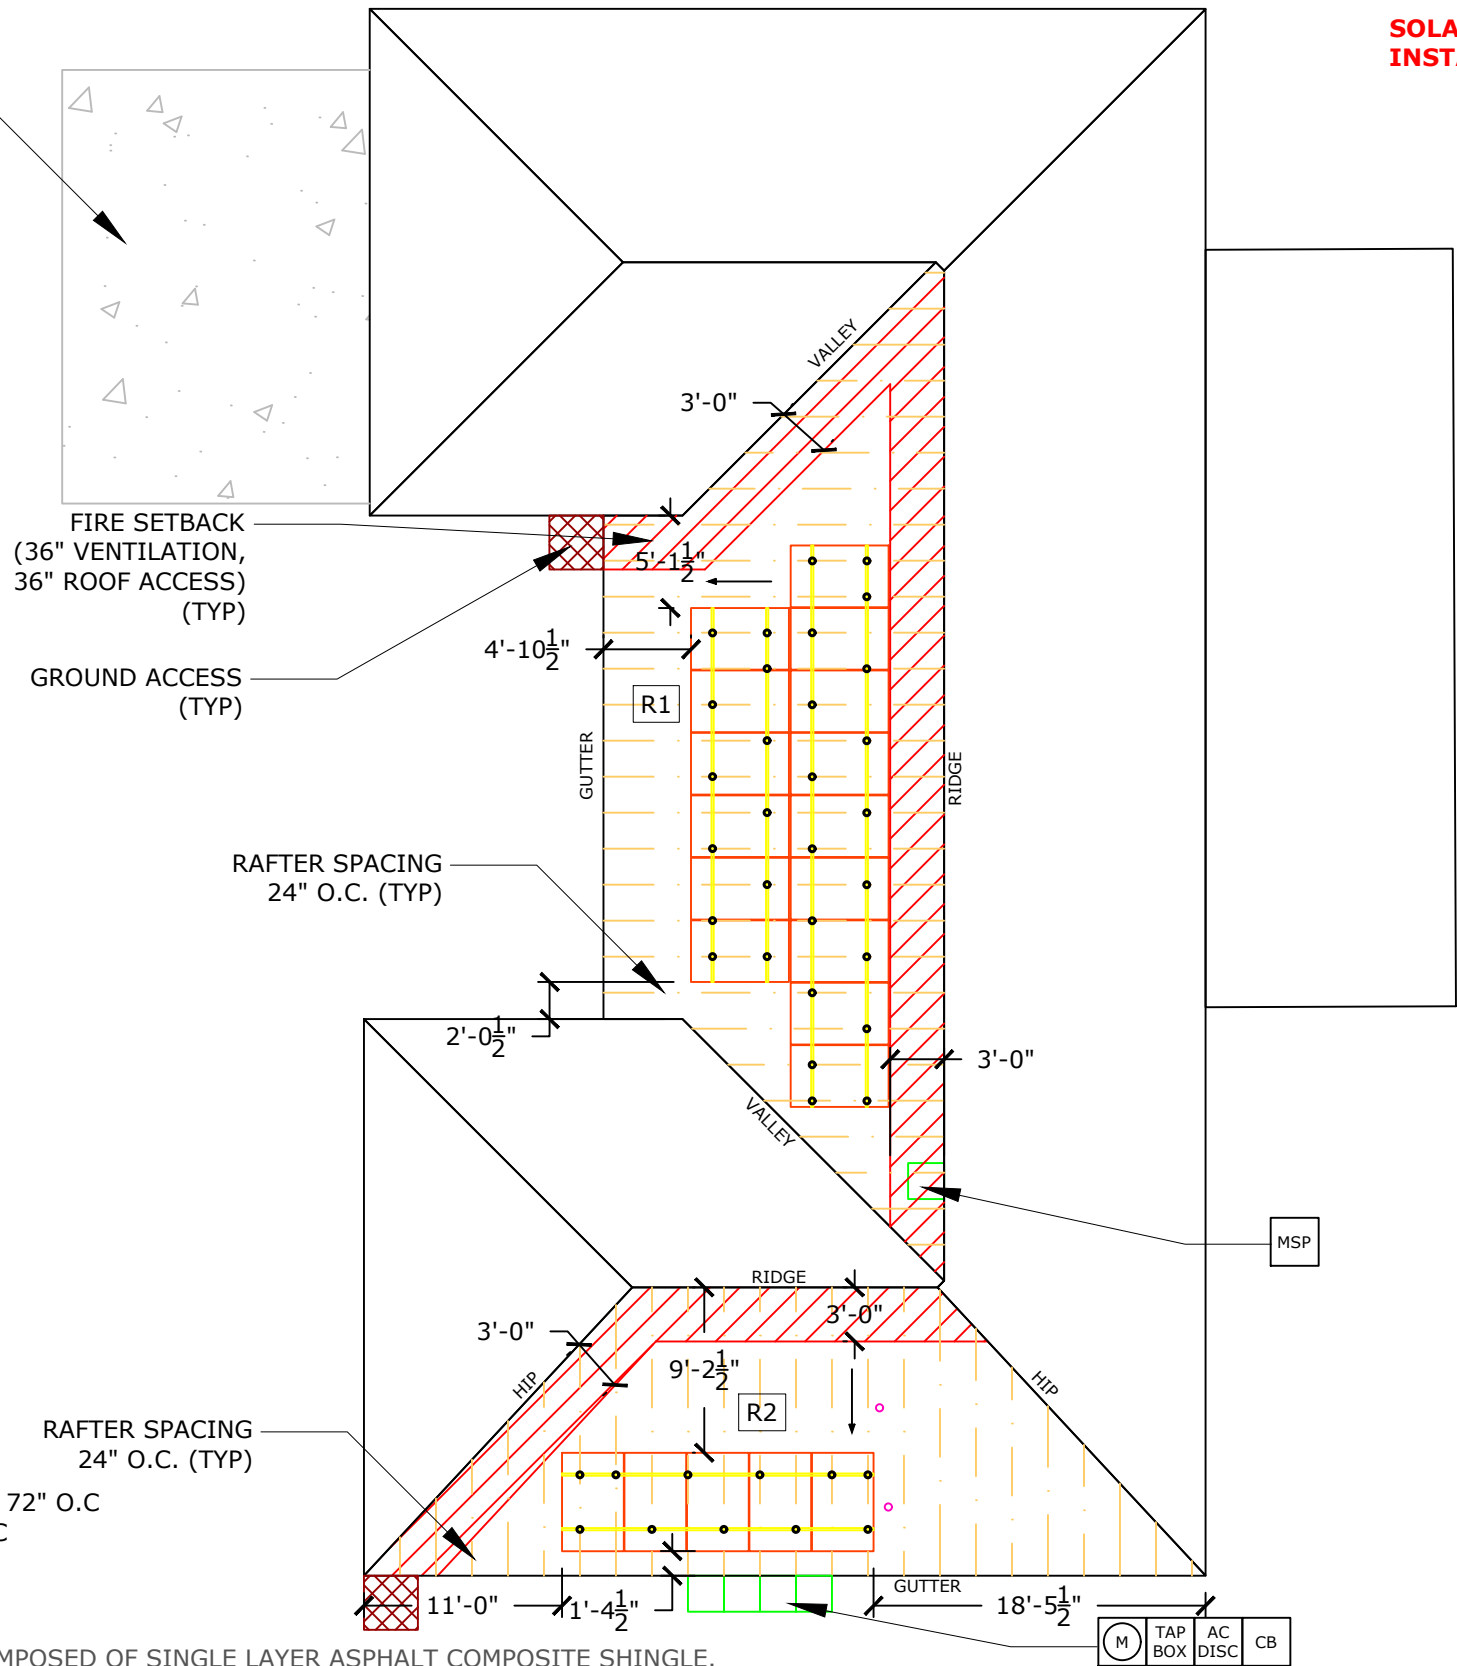

CLAMPING MAX SPACING IN ZONE 1 72" O.C
AND IN ZONE 2 AND ZONE 3 48" O.C

NOTE:
1. ROOF COVERING MATERIAL IS COMPOSED OF SINGLE LAYER ASPHALT COMPOSITE SHINGLE.
2. REFER TO LAYOUT DETAIL DRAWING PV-3 FOR ALL ROOFTOP DIMENSIONS.


ELECTRICAL EQUIPMENT

PV MODULE RATINGS		INVERTER RATINGS		VOLTAGE DROP CALCULATIONS							
MODULE MAKE	HANWHA	INVERTER MAKE	ENPHASE	FORMULA USED PER NEC HANDBOOK 215.2(A)(4) WHERE APPLICABLE							
MODEL	Q.PEAK DUO BLK-G10+ 365	MODEL	IQ8PLUS-72-2-US	WIRE RUN	V _{mp}	I _{mp}	R	L (FT)	V _o	% V _o	WIRE SIZE
MAX POWER	365W	MAX OUTPUT POWER	290W	BRANCH TO J-BOX	240.00	12.1	1.98	65.83	3.154	1.31%	12 AWG
OPEN CIRCUIT VOLTAGE	41.21V	OPEN DC VOLTAGE	60V	J-BOX TO LOAD CENTER	240.00	24.2	1.24	50.00	3.001	1.25%	10 AWG
MPP VOLTAGE	34.58V	NOMINAL AC VOLTAGE	240V	LOAD CENTER TO AC DISCONNECT	240.00	30.25	0.778	3.00	0.141	0.06%	08 AWG
SHORT CIRCUIT CURRENT	11.07A	MAX AC CURRENT	1.21A	AC DISCONNECT TO INTERCONNECTION	240.00	30.25	0.491	10.00	0.297	0.12%	06 AWG
MPP CURRENT	10.56A	CEC INVERTER EFFICIENCY	97%								
NUMBER OF MODULES	20	NUMBER OF INVERTERS	20								
UL1703 COMPLIANT	YES	UL1703 COMPLIANT	YES								

SUB PANEL BREAKER SIZE	# OF MODULES	PV BREAKER PER BRANCH	THIS SOLAR PHOTOVOLTAIC SYSTEM COMPLIES WITH THE 2020 FLORIDA BUILDING CODE AND THE 2017 NATIONAL ELECTRICAL CODE
	UP TO 16	20A	

20 HANWHA Q.PEAK DUO BLK-G10+ 365 365W MODULES PAIRED WITH
20 ENPHASE IQ8PLUS-72-2-US MICRO-INVERTERS

BRANCH CIRCUIT A
10 MICRO-INVERTERS
BRANCH CIRCUIT B
10 MICRO-INVERTERS

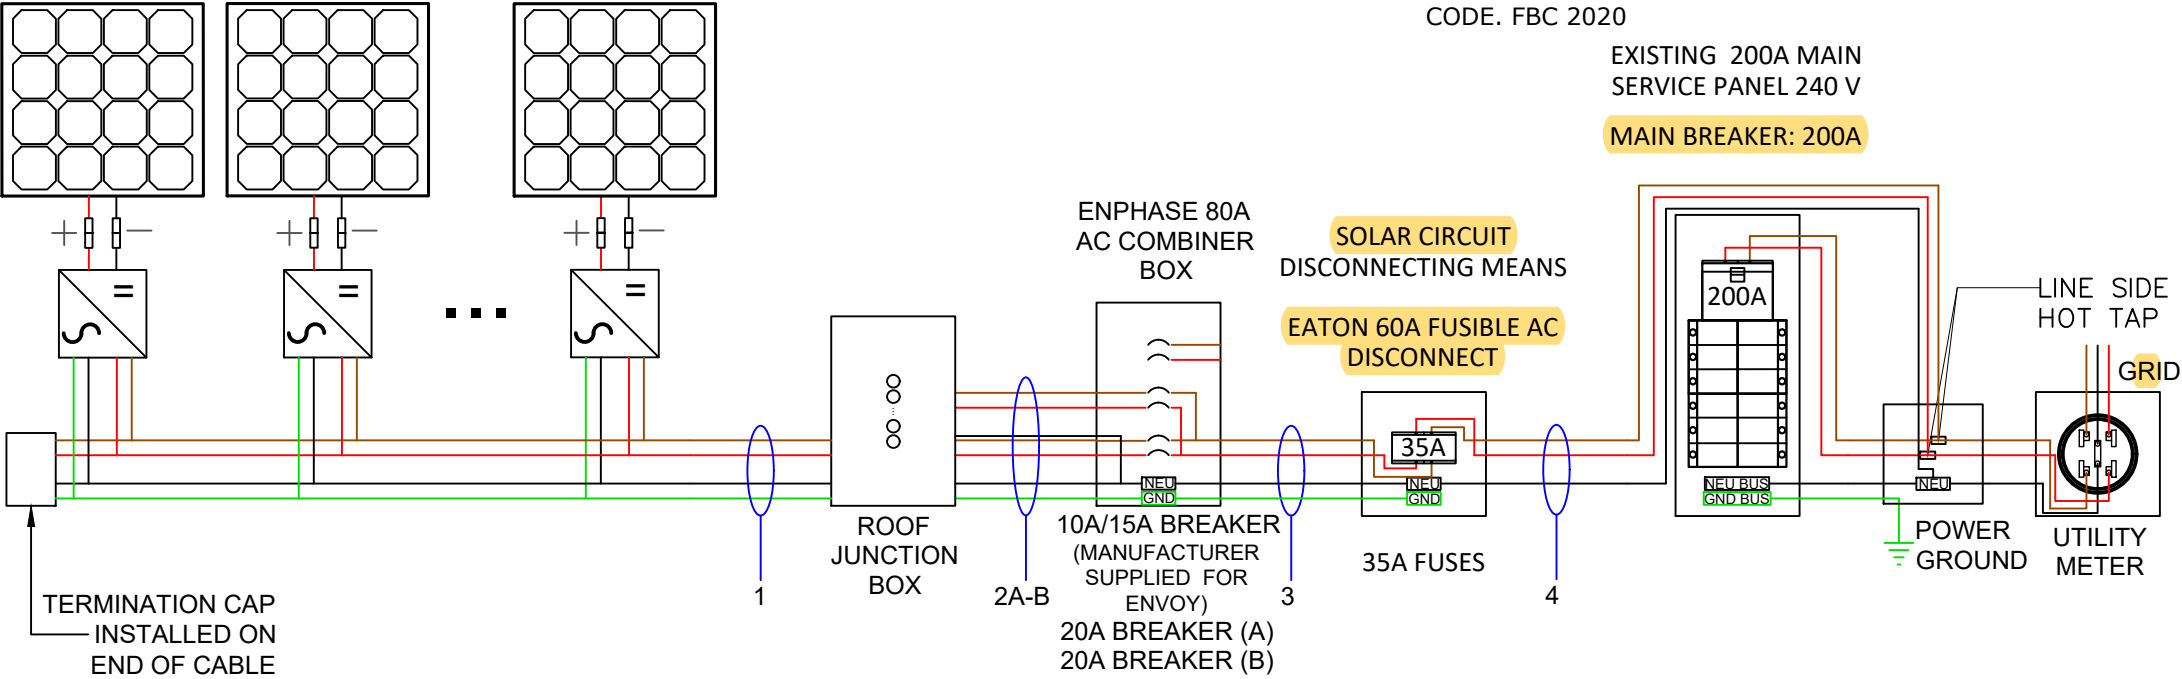

SOLAR INSTALLER NOTES:
INSTALL NEW EXTERIOR MOUNTED TAP BOX


Wire Tag	Conduit	Wire Qty	Wire Gauge	Wire Type	Temp. Rating	Wire Ampacity (A)	Temp. Derate	Conduit Fill Derate	Derated Ampacity (A)	Inverter Qty	NOC (A)	NEC Correction	Design Current (A)	Ground Size	Ground Wire Type
1	OPEN AIR	2	12 AWG	Trunk Cable	90°C	30	0.96	1	28.80	10	1.21	1.25	15.13	12 AWG	Trunk Cable
2A	3/4" PVC	4	10 AWG	THWN-2	75°C	35	0.96	0.8	26.88	10	1.21	1.25	15.13	08 AWG	THWN-2
2B			10 AWG	THWN-2	75°C	35	0.96		26.88	10	1.21	1.25	15.13		
3	3/4" PVC	3 + G	08 AWG	THWN-2	75°C	50	0.96	1	48.00	20	1.21	1.25	30.25	08 AWG	THWN-2
4	3/4" PVC	3	06 AWG	THWN-2	75°C	65	0.96	1	62.40	20	1.21	1.25	30.25		THWN-2

NOTE: LETTER "G" IN WIRE QTY TAB STANDS FOR GROUNDING CONDUCTOR.



PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

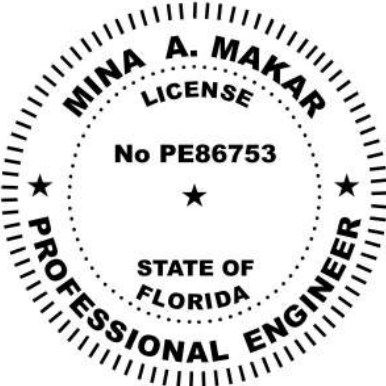

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2023.02.23 10:02:34 -05:00

SOLAR CONTRACTOR
CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION
LAQUASHA DIXON - M5119910
797 SOUTHWEST TUSTENUGEE AVENUE
LAKE CITY, FL 32055
3866234912

PV SYSTEM INFORMATION
SYSTEM SIZE (DC): 7.3 KW
20 MODULES: HANWHA Q.PEAK DUO BLK-G10+ 365
20 INVERTERS: ENPHASE IQ8PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 2/23/2023	DESIGNER: AKL
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

THREE LINE DIAGRAM

PV-3

1. ALL CALCULATIONS FOR VOC, VMAX, IMP AND ISC HAVE BEEN CALCULATED USING THE MANUFACTURED STRING CALCULATOR BASED ON ASHRAE 2% HIGH AND EXTREME MINIMUM TEMPERATURE COEFFICIENTS.
2. THE ENTIRE ARRAY IS BONDED ACCORDING TO (NEC 690.46 - 250.120 PARAGRAPH C). THE GROUND IS CARRIED AWAY FROM THE GROUNDING LUG USING #6 BARE COPPER WIRE OR #8 THWN-2 COPPER WIRE.
3. THIS SYSTEM COMPLIES WITH NEC 2017
4. BRANCH CIRCUIT CALCULATION FOR WIRE TAG 1 DISPLAYS THE LARGEST BRANCH CIRCUIT IN SYSTEM. OTHER BRANCH CIRCUITS SHALL HAVE LOWER DESIGN CURRENT THAN THE ONE SHOWN. IN ADDITION, VOLTAGE DROP CALCULATIONS FROM PANELS TO THE COMBINER BOX SHALL BE SHOWN IN A SIMILAR FASHION
5. ALL CONDUCTORS ARE SIZED BASED ON NEC 2017 ARTICLE 310
6. ALL EQUIPMENT INSTALLED IS RATED AT 75°C
7. INVERTER NOC (NOMINAL OPEN CURRENT) OBTAINED FROM EQUIPMENT DATASHEET
8. CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH ALL LOCAL AND NATIONAL CODE REQUIREMENTS.
9. EACH MODULE MUST BE GROUNDED ACCORDING TO USER INSTRUCTIONS
10. ALL EQUIPMENT SHALL BE LISTED PER NEC 690.4(B)
11. PER NEC 690.13, 690.15, PROVIDE A WARNING SIGN AT ALL LOCATIONS WHERE TERMINALS OF THE DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION> SIGN SHALL READ *WARNING - ELECTRIC SHOCK HAZARD - DO NOT TOUCH TERMINALS - OR EQUIVALENT.
12. PER NEC 705.10, PROVIDE A PERMANENT PLAQUE OR DIRECTORY SHOWING ALL ELECTRIC POWER SOURCES ON THE PREMISES AT SERVICE ENTRANCE.
13. INTERCONNECTION METHOD SHALL COMPLY WITH NEC 705.12
14. AND OPTION FOR A SINGLE CIRCUIT BRANCH TO BE SPLIT INTO TWO SUB-CIRCUIT BRANCHES IS ACCEPTABLE.
15. ALL CONDUCTORS MUST BE COPPER.
16. NEUTRAL AND EQUIPMENT GROUNDING CONDUCTOR BONDED AS PER NEC 250.24(C).
17. EQUIPMENT GROUNDING CONDUCTOR IS CONNECTED TO A GROUNDING ELECTRODE SYSTEM PER 250.54(D).
18. FUSES FOR PV DISCONNECT HAVE AIC RATINGS OF 200KA AC AND 20KA DC.
19. SUPPLY SIDE CONNECTION SHALL BE MADE USING ILSKO INSULATION PIERCING CONNECTORS (IPC). MAKE, MODEL, AND RATING OF INTERCONNECTION CAN BE SEEN ON TABLE 1 BELOW.
20. METHOD OF INTERCONNECTION CAN BE SEEN IN FIGURE 1.
21. UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.

- TABLE 1:**

MAKE	MODEL	VOLTAGE RATING	CONDUCTOR RANGE MAIN	CONDUCTOR RANGE TAP
ILSCO	IPC 4006	600 V	4/0-4 AWG	6-14 AWG
ILSCO	IPC 4020	600 V	4/0-2 AWG	2/0-6 AWG

INSTRUCTIONS FOR LINE TAPS


FIGURE 1:

1. ADJUST THE CONNECTOR NUT TO SUITABLE LOCATION
2. PUT THE BRANCH WIRE INTO THE CAP SHEATH FULLY
3. INSERT THE MAIN WIRE, IF THERE ARE TWO LAYS OF INSULATED LAY IN THE MAIN CABLE, SHOULD STRIP A CERTAIN LENGTH OF THE FIRST INSULATED LAY FROM INSERTED END
4. TURN THE NUT BY HAND, AND FIX THE CONNECTOR IN SUITABLE LOCATION.
5. SCREW THE NUT WITH THE SLEEVE SPANNER.
6. SCREW THE NUT CONTINUALLY UNTIL THE TOP PART IS CRACKED AND DROPPED DOWN



PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

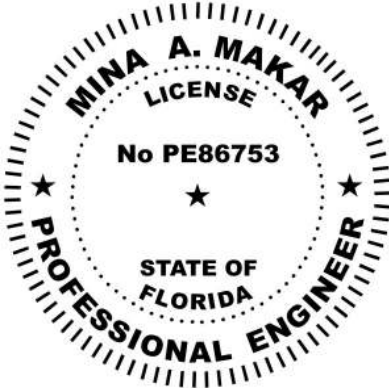

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2023.02.23 10:02:34 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

LAQUASHA DIXON - MS119910
797 SOUTHWEST TUSTENUGGEE AVENUE
LAKE CITY, FL 32055
3866234912

PV SYSTEM INFORMATION



SYSTEM SIZE (DC): 7.3 KW
20 MODULES: HANWHA Q.PEAK DUO
BLK-G10+ 365
20 INVERTERS: ENPHASE
IQ8PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 2/23/2023	DESIGNER: AKL
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

ELECTRICAL CONT.

PV-3.1

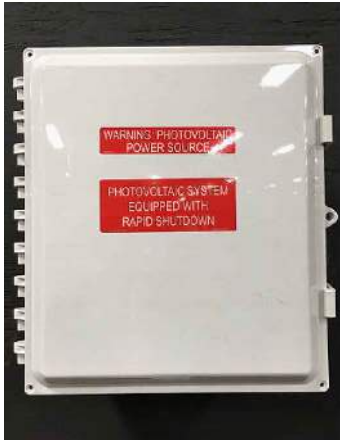ALL WARNING SIGN(S) OR LABEL(S) SHALL COMPLY WITH NEC ARTICLE 110.21(B). LABEL WARNINGS SHALL ADEQUATELY WARN OF THE HAZARD. LABELS SHALL BE PERMANENTLY AFFIXED TO THE EQUIPMENT, AND LABELS REQUIRED SHALL BE SUITABLE FOR THE ENVIRONMENT.						
TAG	LABEL	QUANTITY	LOCATION	NOTE	EXAMPLES	
Ⓐ	⚠CAUTION AC SOLAR VOLTAGE	12	AC CONDUITS	1 AT EVERY SEPARATION BY ENCLOSURES / WALLS / PARTITIONS / CEILINGS / FLOORS <u>OR</u> NO MORE THAN 10'	SOLAR INSTALLER NOTES: INSTALL NEW EXTERIOR MOUNTED TAP BOX  Ⓐ  Ⓑ  Ⓒ  Ⓓ  Ⓕ  Ⓖ BACKFEED	
Ⓑ	WARNING: PHOTOVOLTAIC POWER SOURCE PHOTOVOLTAIC SYSTEM EQUIPPED WITH RAPID SHUTDOWN	1	COMBINER BOX	1 AT ANY COMBINER BOX		
Ⓒ	⚠WARNING ELECTRICAL SHOCK HAZARD TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION	1	JUNCTION BOX	1 AT ANY JUNCTION BOX		
Ⓓ	PHOTOVOLTAIC SYSTEM ⚠ AC DISCONNECT ⚠ RATED AC OUTPUT CURRENT A NOMINAL OPERATING AC VOLTAGE 240 V ⚠CAUTION POWER TO THIS SERVICE IS ALSO SUPPLIED FROM ON-SITE SOLAR GENERATION AC SYSTEM DISCONNECT	1	AC DISCONNECT (RSD SWITCH)	1 OF EACH AT FUSED AC DISCONNECT COMPLETE VOLTAGE AND CURRENT VALUES ON DISCONNECT LABEL		
	⚠WARNING ELECTRICAL SHOCK HAZARD TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM PHOTOVOLTAIC SYSTEM INSTALLED BY MOMENTUM SOLAR 3096 B HAMILTON BLVD S. PLAINFIELD, NJ 07080 PHONE NUMBER: 732-902-6224					
Ⓔ	⚠WARNING DUAL POWER SUPPLY SECOND SOURCE IS PHOTOVOLTAIC SYSTEM	1	UTILITY METER	1 AT UTILITY METER AND ONE DIRECTORY PLACARD		
Ⓖ	EMERGENCY RESPONDER THIS SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN ENTIRE PV SYSTEM SECTIONS OF THE PV SYSTEM THAT ARE SHUT DOWN WHEN THE RAPID SHUTDOWN SWITCH IS OPERATED SECTIONS OF THE PV SYSTEM THAT ARE NOT SHUT DOWN WHEN THE RAPID SHUTDOWN SWITCH IS OPERATED 	1	INTERCONNECTION POINT	1 OF EACH AT BUILDING INTERCONNECTION POINT AND ONE DIRECTORY PLACARD		
	⚠WARNING POWER SOURCE OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE	1	BACKFEED PANEL			
Ⓕ	NOMINAL OPERATING AC VOLTAGE : 240V NOMINAL OPERATING AC FREQUENCY : 60HZ MAXIMUM AC POWER : VA MAXIMUM AC CURRENT : A MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION : 20A	1	AC CURRENT PV MODULES			



PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

MINA A. MAKAR

LICENSE

No PE86753

STATE OF FLORIDA

PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2023.02.23 10:02:34 -05:00

SOLAR CONTRACTOR
CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION
LAQUASHA DIXON - MS119910
797 SOUTHWEST TUSTENUGGEE AVENUE
LAKE CITY, FL 32055
3866234912

PV SYSTEM INFORMATION
SYSTEM SIZE (DC): 7.3 KW
20 MODULES: HANWHA Q.PEAK DUO
BLK-G10+ 365
20 INVERTERS: ENPHASE
IQ8PLUS-72-2-US

PROJECT INFORMATION		
INITIAL	DATE: 2/23/2023	DESIGNER: AKL
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

EQUIPMENT LABELS

PV-3.2