

General Notes

A. CONCRETE & FOUNDATION DESIGN:

- 1. ALL CONCRETE GRADE BEAMS AND FOOTINGS SHALL BE 3000 PSI MINIMUM.
- 2. ALL CONCRETE FILLED SUPPORTED SLABS SHALL BE 2500 PSI MINIMUM, 3 1/2" NOMINAL THICKNESS.
- 3. FIBERMESH (3/4" PER CUBIC YARD MIN.) MEETING APPROPRIATE ACI AND ASTM REQUIREMENTS MAY BE USED IN LIEU OF WELDED WIRE MESH
- 4. ALL SLABS ON GRADE SHALL BE 4" THICK WITH FIBERMESH.
- 5. ALL REINFORCING SHALL CONFORM TO ASTM A615, BE GRADE 60 (60 KSI MIN.), DEFORMED BARS. #3 BARS MAY BE GRADE 40
- 6. ALL OVER POUR CONCRETE FILLED SUPPORTED SLABS SHALL BE 3000 PSI MIN., 2" MINIMUM THICKNESS.
- 7. SOIL BEARING PRESSURE SHALL BE A MINIMUM OF 1500 PSF.
- 8. THE CONCRETE SHALL CONFORM TO ASTM C94 FOR THE FOLLOWING:
OPC (PORTLAND CEMENT TYPE 1, - ASTM C 150)
AGGREGATES - #6 STONE, ASTM C 33 SIZE NO. 67 LESS THAN 3/4".
AIR ENTRAINING +/- 1% - ASTM C 260.
WATER REDUCING AGENT - ASTM C 494.
CLEAN POTABLE WATER.
- 9. OTHER ADMIXTURES SHALL NOT BE PERMITTED.
- 10. PREPARE & PLACE CONCRETE ACCORDING TO AMERICAN CONCRETE INSTITUTE MANUAL STANDARD PRACTICE, PART 1, 2, & 3 ALONG WITH HOT WEATHER CONDITIONS RECOMMENDATIONS.
- 11. IF UTILIZING EXISTING CONCRETE FOR FOUNDATION, CONCRETE SHALL BE A MINIMUM OF 4" IN THICKNESS, VISIBLY FREE OF ANY STRUCTURAL EXCESSIVE CRACKING, SPALLING OR OTHER DETEIORATION.

B. MASONRY:

- 1. CONCRETE MASONRY UNITS (CMU) SHALL BE STANDARD HOLLOW UNITS AND SHALL BE 1900 PSI MINIMUM BASED ON TYPE M OR S MORTAR.
- 2. ALL MORTAR SHALL BE OF TYPE M OR S.
- 3. ALL GROUT SHALL BE 2000 PSI MINIMUM AND HAVE MAXIMUM COARSE AGGREGATE SIZE OF 3/8".
- 4. PROVIDE CLEAN-OUTS FOR REINFORCED CELLS CONTAINING REINFORCEMENT WHEN GROUT POUR EXCEEDS 5'-0" IN HEIGHT.

C. ALUMINUM:

- 1. ALL STRUCTURAL ALUMINIUM SHALL CONFORM TO THE MINIMUM REQUIREMENTS OF 6005-T5 FOR ALLOY WITH A MINIMUM THICKNESS OF 0.040" FOR SUPPORTING MEMBERS.
- 2. WHERE KICK PLATES ARE USED A MINIMUM THICKNESS OF 0.024" SHALL APPLY.
- 3. STRUCTURAL ALUMINIUM DESIGN CONFORMS TO "PART 1-A - SPECIFICATIONS FOR ALUMINIUM STRUCTURES - ALLOWABLE STRESS DESIGN" OR "PART 1-B - SPECIFICATIONS FOR ALUMINIUM STRUCTURES - BUILDING LOAD AND RESISTANCE FACTOR DESIGN" OF THE ALUMINIUM DESIGN MANUAL PREPARED BY THE ALUMINIUM ASSOCIATION, INC. WASHINGTON D.C. THE FLORIDA BUILDING CODE 6TH EDITION (CHAPTER 16 STRUCTURAL DESIGN & CHAPTER 20 ALUMINIUM).
- 4. WHERE ALUMINIUM COMES INTO CONTACT WITH STEEL, OR PRESSURE TREATED LUMBER PROVIDE DIELECTRIC SEPARATION.
- 5. ALUMINIUM MEMBERS SHALL BE STITCHED WITH NO LESS THAN #10 SMS 6" FROM THE ENDS AND 12" ON CENTER, IF USING #12 SPACING MAY BE 24" ON CENTER.
- 6. VINYL/ACRYLIC/GLASS PANELS SHALL BE REMOVABLE. THEY SHALL BE IDENTIFIED WITH A DECAL ESSENTIALLY STATING "REMOVABLE PANEL. SHALL BE REMOVED WHEN WIND SPEEDS EXCEED 75 MPH". DECAL SHALL BE PLACED SO IT IS VISIBLE WHEN PANEL IS INSTALLED.

D. FASTENERS:

- 1. ALL LAG BOLTS SHALL CONFORM TO STAINLESS STEEL, TYPE 300 18-8, WITH STANDARD FLAT WASHER UNLESS MANUFACTURER GALVANIZES BOLTS SPECIFIES FOR USE WITH ACO PRESSURE TREATED WOOD.
- 2. HEX BOLTS HAS TO BE ASTM A 325, PLATED WITH STANDARD FLAT WASHERS AND NUTS.
- 3. ALL CONCRETE SCREWS SHALL BE: SIMPSON, HIT TL, RAWL, TAPCON, REDHEAD, DYNABOLT, OR APPROVED EQUAL.
- 4. ALL METAL TIES AND ASSOCIATED ACCESSORIES SHALL BE

HOT DIPPED GALVANIZED.

- 5. ALL LAG BOLTS SHALL HAVE A MINIMUM EMBEDMENT OF 8X BOLT DIAMETER INTO STRUCTURAL FRAMING (G=42 MIN.). LAG BOLTS AND SCREWS INTO WOOD FRAMING SHALL BE PROVIDED WITH PILOT HOLES HAVING A DIAMETER NOT GREATER THAN 70 PERCENT OF THE THREAD DIAMETER OF THE BOLT OR SCREW. ALL LAG BOLTS AND SCREWS SHALL BE INSERTED IN PILOT HOLES BY TURNING AND UNDER NO CIRCUMSTANCES BY DRIVING WITH A HAMMER.
- 7. ALL EXPANSION ANCHORS SHALL BE DESIGNED IN ACCORDANCE WITH THE SPECIFIC MANUFACTURER'S REQUIREMENTS AND ALLOWABLE LOADS AND SHALL ONLY BE APPLIED IN CONDITIONS ACCEPTABLE TO MANUFACTURER. FASTENERS SHALL BE A MINIMUM OF SAE GRADE #5 OR BETTER ZINC PLATED.
- 8. ALL FASTENERS CONNECTING ALUMINIUM COMPONENTS OR PRESSURE TREATED LUMBER ARE STAINLESS STEEL, TYPE 300 18-8, UNLESS MANUFACTURER GALVANIZED BOLTS SPECIFIES FOR USE WITH ACO PRESSURE TREATED WOOD, OR OTHERWISE NOTED ON PLANS.
- 9. ALL FASTENERS SHALL COMPLY WITH ASTM A153.
- 10. ALL CONNECTORS SHALL COMPLY WITH ASTM A653 CLASS G-185.
- 11. FOR SMS, THE MINIMUM CENTER-TO-CENTER SPACING SHALL BE 3/4" AND MINIMUM CENTER-TO-EDGE SHALL BE 1/2" UNLESS NOTED OTHER WISE.

E. REFERENCE STANDARDS:

- ASTM E 119
- ASTM E 1300
- ASCE 7 -10
- AA ASM35, AND SPEC. FOR ALUMINIUM PART 1-A, & 1-B
- ASTM C94
- ASTM C150
- ASTM C33
- ASTM C260
- ASTM C494
- ASTM A615
- ASTM A185
- FLORIDA BUILDING CODE (CHAPTERS 16, 20 AND 23) 6TH EDITION
- CURRENT ALUMINIUM DESIGN MANUAL

F. ABBREVIATIONS:

THE FOLLOWING LIST OF ABBREVIATIONS IS NOT INTENDED TO REPRESENT ALL THOSE USED ON THESE DRAWINGS, BUT TO SUPPLEMENT THE MORE COMMON ABBREVIATIONS.

- 1. TYP -- TYPICAL
- 2. SIM -- SIMILAR
- 3. UON -- UNLESS OTHERWISE NOTED
- 4. CONT -- CONTINUOUS
- 5. VIF -- VERIFY IN FIELD

G. RESPONSIBILITY:

- 1. ALL SITE WORK SHALL BE PERFORMED BY A LICENSED CONTRACTOR IN ACCORDANCE WITH APPLICABLE BUILDING CODES, LOCAL ORDINANCES, ETC.
- 2. CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND DETAILS, NOTIFYING ENGINEER OF ANY DISCREPANCIES BETWEEN DRAWINGS, FABRICATED ITEMS, OR ACTUAL FIELD CONDITIONS.
- 3. THESE DRAWINGS REPRESENT THE ACCEPTABILITY OF THE "SUNROOM" ROOM ADDITION ELEMENTS AS PROVIDED BY THE CONTRACTOR.
- 4. ALL DETAILS ON THESE DRAWINGS ARE ENGINEERED BASED ON INFORMATION PROVIDED BY THE CONTRACTOR AND MANUFACTURER.
- 5. ANY DETAILS NOT SHOWN ARE TO BE ENGINEERED BY A LICENSED P.E. IN ACCORDANCE WITH STANDARD ENGINEERING PRACTICES.

H. MISCELLANEOUS:

- 1. ALUMINIUM ADDITIONS ARE NOT TO BE INSTALLED ON A MANUFACTURED HOME, TRAILER HOME, OR PRE-FAB HOME. IF THE EXISTING STRUCTURE IS ONE OF THESE, A SEPARATE 4TH WALL SUPPORT SYSTEM MUST BE ENGINEERED SO THAT NO ADDITIONAL LOADING IS PLACED ON THE MANUFACTURED HOME.
- 2. IF ENCLOSURE CONTAINS A SWIMMING POOL, OR SPA, THE ENCLOSURE SHALL COMPLY WITH RESIDENTIAL SWIMMING BARRIER REQUIREMENTS OF THE FBC 6TH EDITION R 4501.17.1 IN ITS ENTIRETY.
- 3. EMERGENCY ESCAPE & RESCUE OPENING PER FBC R310.1 SHALL BE VERIFIED BY CONTRACTOR & BUILDING OFFICIAL

- 4. DOOR LOCATIONS MAY BE DETERMINED IN THE FIELD BY CONTRACTOR.
- 5. IF PAVERS ARE UNDER ALUMINIUM MEMBERS THEY SHALL HAVE EPOXY ADHESIVE TO CONCRETE OR IF USING GROUT, ENSURE BONDING AGENT IS USED FIRST.
- 6. SCREENING MATERIAL SHALL BE 18X14X0.013 OR EQUIVALENT DENSITY SCREEN MESH ONLY UNLESS NOTED ON DRAWING S-2.
- 7. 1"x2"x.045 NON-STRUCTURAL MEMBERS SHALL BE ATTACHED TO HOST WITH 1/4" DIAMETER X 1-3/4" EMBEDMENT & 24" O.C. MASONRY SCREW FOR CONCRETE & EQUIVALENT SIZE WOOD SCREW WHEN IN WOOD & #10 X 1/2" EMBEDMENT SMS OR TEK SCREWS IN ALUMINIUM MEMBERS TYPICAL.

JOB DESCRIPTION - SCREEN ROOM - SCREEN ENCLOSURE

DESIGN DATA:

- 1. ULTIMATE DESIGN WIND SPEED Vult (3 SECOND GUST): 130 MPH 110 MPH
- 2. RISK CATEGORY : 1
- 3. WIND EXPOSURE : C
- 4. WIND LOADS:
SCREEN ROOF: 9 PSF
SCREEN WALLS: 32 PSF
SOLID ROOF (MWFRS): 27 PSF

- 5. FACTOR APPLIED TO SCREEN WIND LOADS FOR 18X14X0.013 OR EQUIVALENT DENSITY SCREEN MESH: 0.88
- 6. FACTOR APPLIED TO SCREEN WIND LOADS FOR ALLOWABLE STRESS DESIGN: 0.6
- 7. LIVE LOAD:
300 lb. VERTICAL DOWNLOAD ON PRIMARY SCREEN ENCLOSURE MEMBERS.
200 lb. VERTICAL DOWNLOAD ON SCREEN ENCLOSURE PURLINS.
- 8. EXISTING CONCRETE SLAB AND OR FOOTING SHALL BE ADEQUATE TO RESIST THE UPLOADS FOR THE PROPOSED STRUCTURE.
- 9. SCREEN ROOF TYPE: HIP
- 10. SOLID ROOF TYPE: 3"x12"x.030" RISER PAN ROOF FL 22840.2 OR EQUIV.

ALUMINIUM STRUCTURAL MEMBERS

HOLLOW SECTIONS

- 2 x 2: ----- 2" x 2" x 0.046"
- 3 x 2: ----- 3" x 2" x 0.050"
- 2 x 3: ----- 2" x 3" x 0.050"
- 2 x 3: ----- 2" x 3" x 0.070"
- 2 x 4: ----- 2" x 4" x 0.050"
- 2 x 5: ----- 2" x 5" x 0.050"

OPEN BACK SECTIONS

- 1 x 2: ----- 1" x 2" x 0.040"
- 1 x 3: ----- 1" x 3" x 0.045"

SNAP SECTIONS

- 2 x 2 Snap: ----- 2" x 2" x 0.045"
- 2 x 3 Snap: ----- 2" x 3" x 0.050"
- 2 x 4 Snap: ----- 2" x 4" x 0.045"

SELF MATING (SMB)

- 2 x 4 SMB: ----- 2" x 4" x 0.044" x 0.100"
- 2 x 5 SMB: ----- 2" x 5" x 0.050" x 0.118"
- 2 x 6 SMB: ----- 2" x 6" x 0.050" x 0.120"
- 2 x 7 SMB: ----- 2" x 7" x 0.057" x 0.120"
- 2 x 8 SMB: ----- 2" x 8" x 0.072" x 0.224"
- 2 x 9 SMB: ----- 2" x 9" x 0.072" x 0.224"
- 2 x 10 SMB: ----- 2" x 10" x 0.092" x 0.374"



PROFESSIONAL ENGINEER SEAL

ENGINEER OF RECORD

David W. Smith P.E.

FLORIDA LICENSE NUMBER: 53608

Thomas L. Hanson P.E.

FLORIDA LICENSE NUMBER: 38654

Myron Max Neal P.E.

FLORIDA LICENSE NUMBER: 86663

Joel Falardeau P.E.

FLORIDA LICENSE NUMBER: 70667

Erik Stuart P.E.

FLORIDA LICENSE NUMBER: 77605

FBC Plans & Engineering

Services, Inc.

6272 Abbott Station Drive Unit 101

Zephyrhills, FL 33542

Phone: (813)788-5314

Fax: 1-(866)-824-7894

Email: erb@fbcpplans.com

Website: www.fbcpplans.com

C.O.A. - #29054

DATE: 07-09-2020

DRAWN BY: DRAYTON

REVISION: DATE:

RO 1

RO 2

RO 3

JOB #: 20 0624 453

PROJECT ADDRESS:

OSTEEN

2768 SW KING ST

LAKE CITY, FL 32024

CONTRACTOR:

LAKEVIEW ALUMINUM, INC.

NOTES

S-1

I HEREBY CERTIFY THAT I HAVE REVIEWED THIS PLAN AND FOUND IT TO BE IN COMPLIANCE WITH ASCE 7-10, & FBC 6TH EDITION



PROFESSIONAL ENGINEER SEAL



FLORIDA LICENSE NUMBER: 53608

FLORIDA LICENSE NUMBER: 38654

Myron Max Neal P.E.

FLORIDA LICENSE NUMBER: 866663

Joel Falardeau P.E.

FLORIDA LICENSE NUMBER: 70667

Erik Stuart P.E.

FLORIDA LICENSE NUMBER: 77605

FBC Plans & Engineering Services, Inc.

6272 Abbott Station Drive Unit 101

Zephyrhills, Fl. 33542

Phone: (813) 788-5314
Fax: 1 (866) 874 7904

Fax: 1-(800)-824-7894
Email: erb@fbclans.com

Website: www.fbcplans.com

C.O.A. - #29054

DATE: 07-09-2020

DRAWN BY: DRAYTON

REVISION:	DATE:
-----------	-------

RO 1	
------	--

K02	
-----	--

R03

JOB #:20_0624_453

PROJECT ADDRESS:

OSTEEN

2768 SW KING ST




LAKE CITY, FL 32024

CONTRACTOR:

LAKESIDE ALUMINUM, INC.

ELEVATIONS

S-2

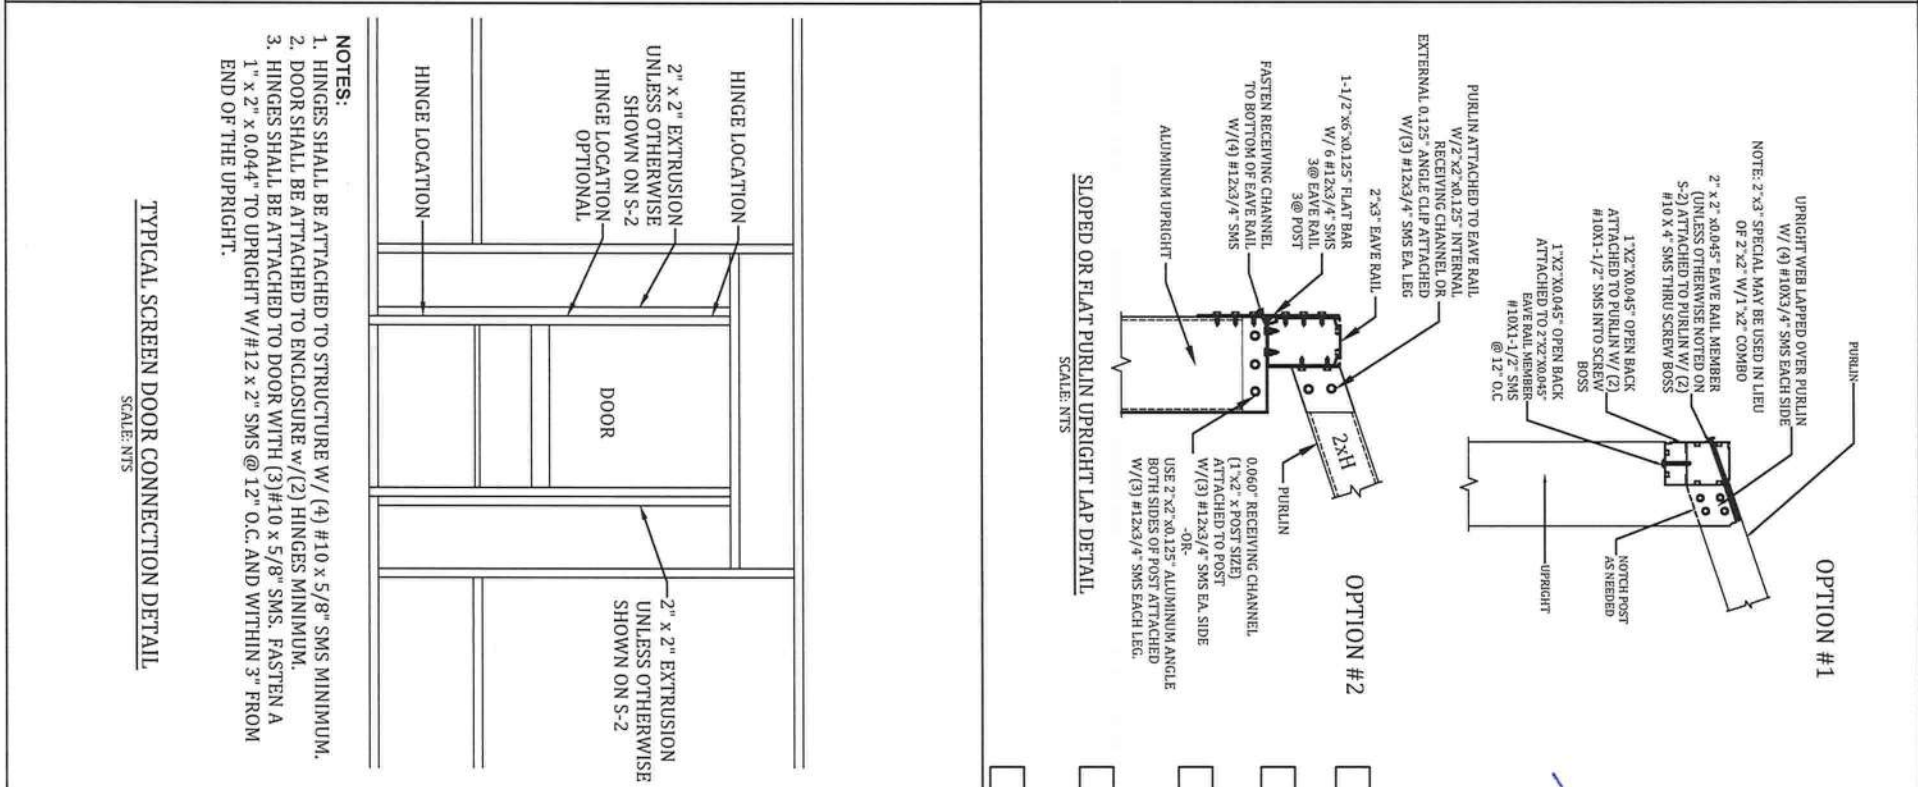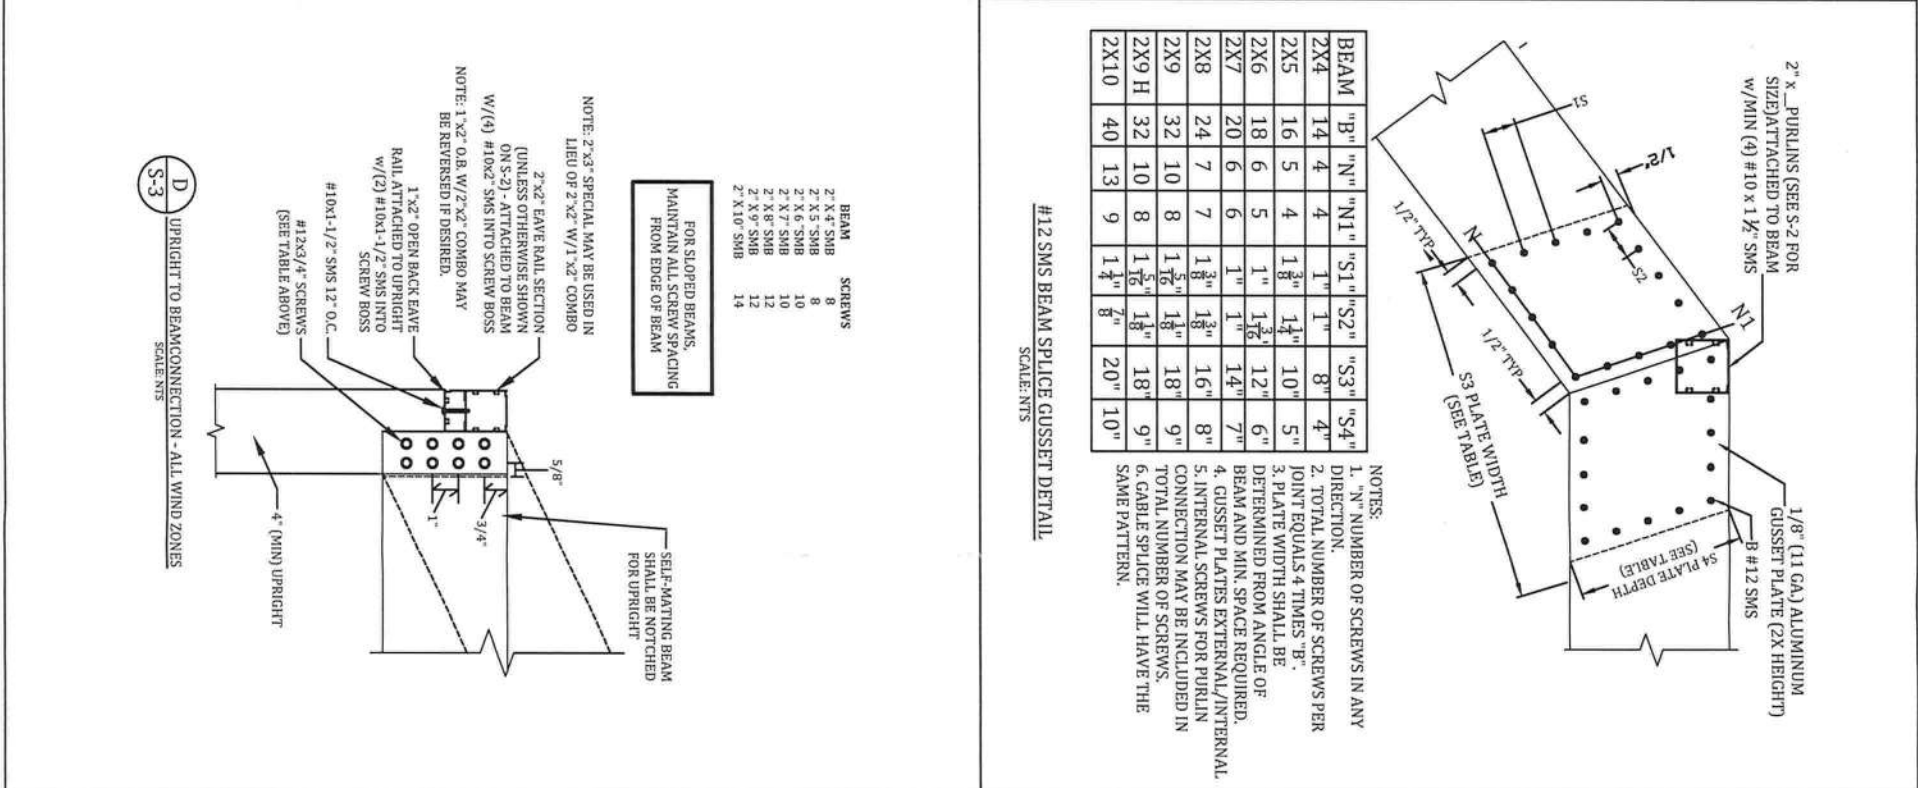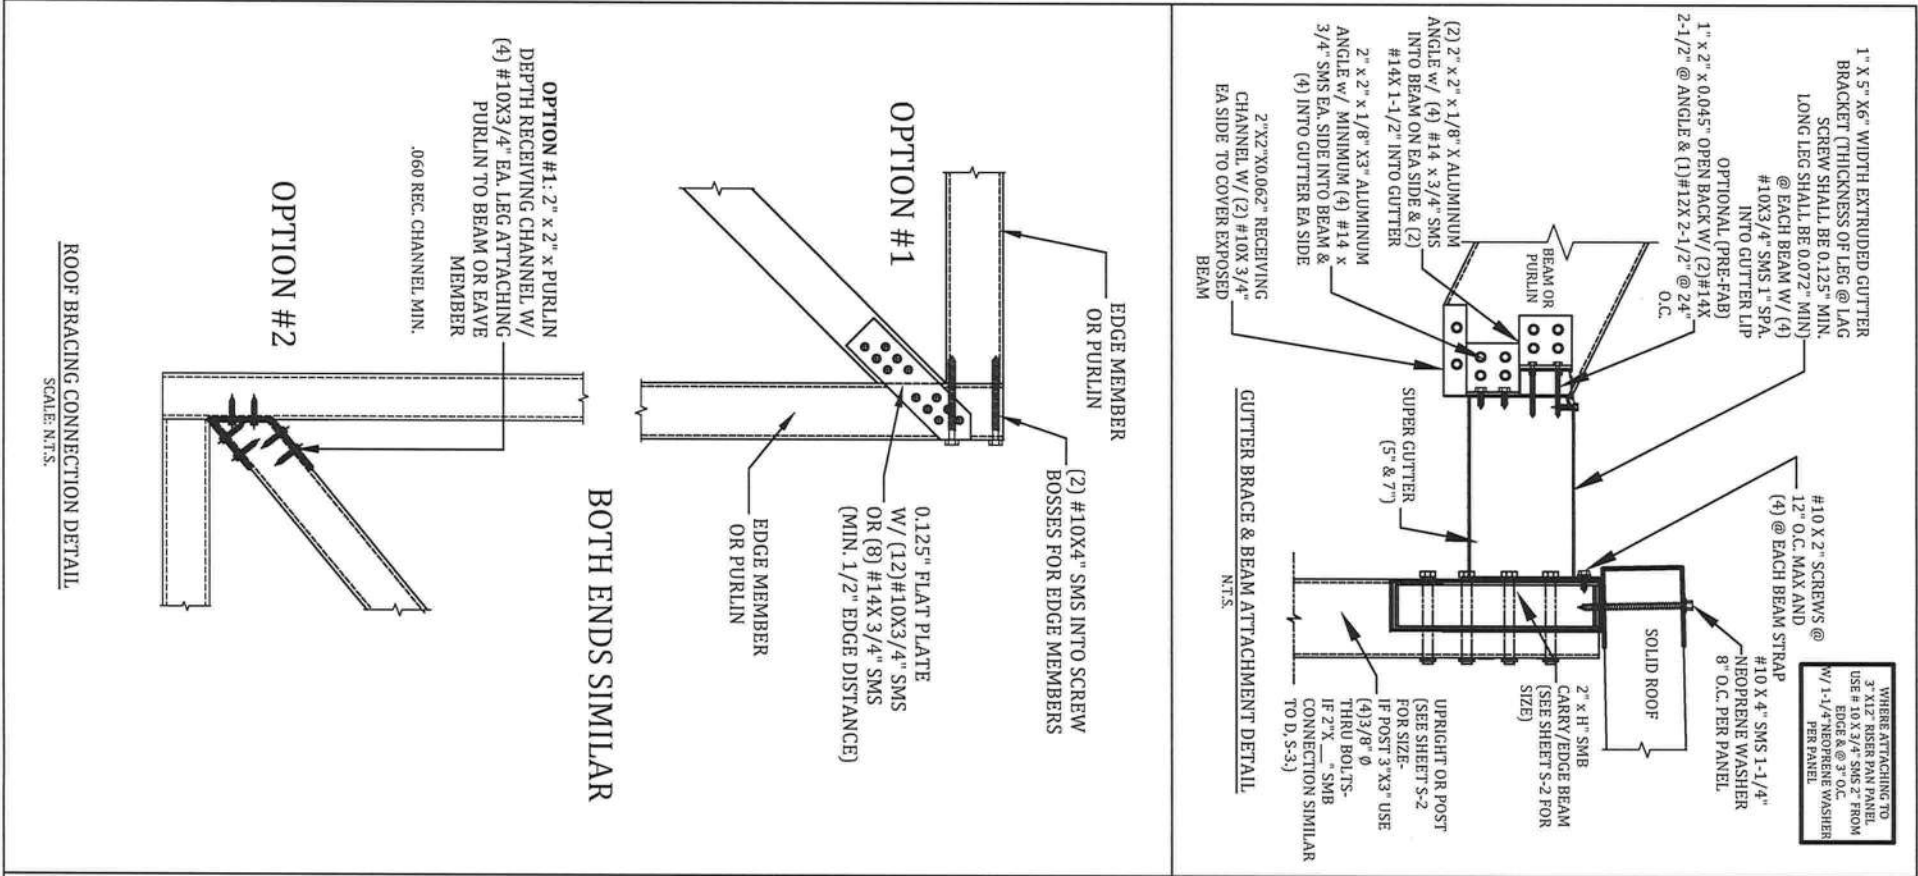

I HEREBY CERTIFY THAT I HAVE REVIEWED THIS PLAN AND FOUND IT TO BE IN COMPLIANCE WITH ASCE 7-10, & FBC 6TH EDITION.



ENGINEER OF RECORD

David W. Smith P.E.

FLORIDA LICENSE NUMBER: 53608

Thomas L. Hanson P.E.

FLORIDA LICENSE NUMBER: 38654

Myron Max Neal P.E.

FLORIDA LICENSE NUMBER: 86663

Joel Falardeau P.E.

FLORIDA LICENSE NUMBER: 70667

Erik Stuart P.E.

FLORIDA LICENSE NUMBER: 77605

FBC Plans & Engineering Services, Inc.

6272 Abbott Station Drive Unit 101

Zephyrhills, FL 33542

Phone: (813)788-5314

Fax: 1-(866)-824-7894

Email: erb@fbcpplans.com

Website: www.fbcpplans.com

C.O.A. - #29054

DATE: 07-09-2020

DRAWN BY: DRAYTON

REVISION: DATE:

RO 1

RO 2

RO 3

JOB #: 20_0624_453

PROJECT ADDRESS:

OSTEEN

2768 SW KING ST

LAKE CITY, FL 32024

CONTRACTOR:

LAKEVIEW ALUMINUM, INC.

DETAILS

S-3

I HEREBY CERTIFY THAT I HAVE REVIEWED THIS PLAN AND FOUND IT TO BE IN COMPLIANCE WITH ASCE 7-10, & FBC 6TH EDITION

PROFESSIONAL ENGINEER SEAL



ENGINEER OF RECORD
David W. Smith P.E.

FLORIDA LICENSE NUMBER: 53608

Thomas L. Hanson P.E.

FLORIDA LICENSE NUMBER: 38654

Myron Max Neal P.E.

FLORIDA LICENSE NUMBER: 86663

Joel Falardeau P.E.

FLORIDA LICENSE NUMBER: 70667

Erik Stuart P.E.

FLORIDA LICENSE NUMBER: 77605

FBC Plans & Engineering
Services, Inc.

6272 Abbott Station Drive Unit 101

Zephyrhills, FL 33542

Phone: (813)788-5314

Fax: 1-(866)-824-7894

Email: ert@fbcplans.com

Website: www.fbcplans.com

C.O.A. - #29054

DATE: 07-09-2020

DRAWN BY: DRAYTON

REVISION: DATE:

RO 1

RO 2

RO 3

JOB #: 20_0624_453
PROJECT ADDRESS:

OSTEEN

2768 SW KING ST

LAKE CITY, FL 32024

CONTRACTOR:

LAKESSIDE ALUMINUM, INC.

DETAILS

S-4

WHERE ATTACHING TO
3" X12" RISER PAN PANEL.
USE # 10 X 3/4" SMS 2" FROM
EDGE & @ 3" O.C.
W/ 1-1/4" NEOPRENE WASHER
PER PANEL TO REC. CHANNEL.

OPTION #3 MOUNT RECEIVING CHANNEL
DIRECTLY TO FASCIA WITH (2) 1/4" LAGS @
24" O.C.

3" RECEIVING CHANNEL
W/ (2) #12 X 1/2" SMS

1 1/4" NEOPRENE WASHER @
12" O.C. FASTENING CHANNEL
TO GUTTER & (1) #10 X 1/2" SMS @
O.C. TOP & BOTTOM TYP.

OPTION #1 ROOF GUTTER FACE

(2) 1/4" X 2 1/2" MIN.
LAG SCREWS PER
BRACKET & (1) 12" O.C.

(4) #14 X 7" SMS 1-1/4" NEOPRENE
WASHER PER PANEL

1" X 5" OR 7" X 3" WIDTH EXTRUDED
GUTTER BRACKET THICKNESS OF LEG @
LAG SCREW SHALL BE 0.125" MIN. LONG
LEG SHALL BE 0.072" MIN) @ EACH BEAM
W/ (4) #10 X 3/4" SMS 1" SPACING INTO
GUTTER LIP & (4) INTO FRONT OF GUTTER

SUPER GUTTER

OPTION #2 ROOF ON GUTTER LIP

THE HOST STRUCTURE
SHALL HAVE AT LEAST A
2" X 4" FASCIA AND ROOF
TRUSS SYSTEM.
CONTRACTOR SHALL VERIFY
THIS AND IF SMALLER
STRUCTURE UP TO A 2" X 4"
FASCIA AND ENSURE LESS
THAN A 2'-0" OVERHANG.





OPTION#1, #2 & #3 COMPOSITE ROOF TO GUTTER DETAIL

SCALE: NTS

B
S-4

PURLIN OR GIRT TO BEAM OR POST DETAIL


SCALE: NTS

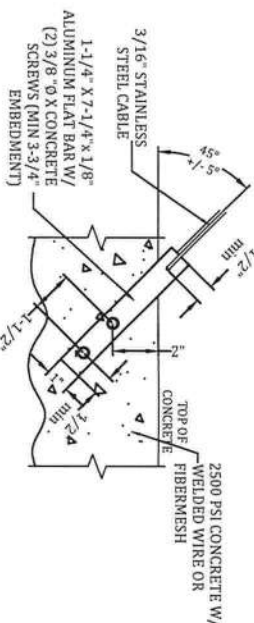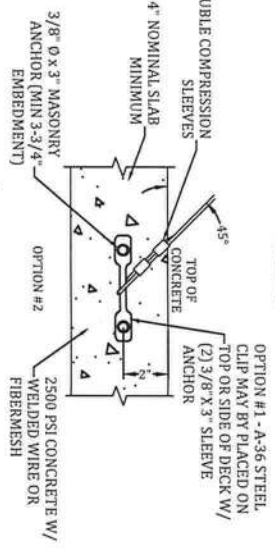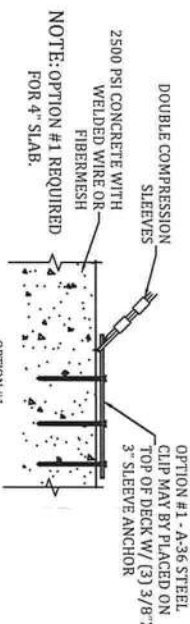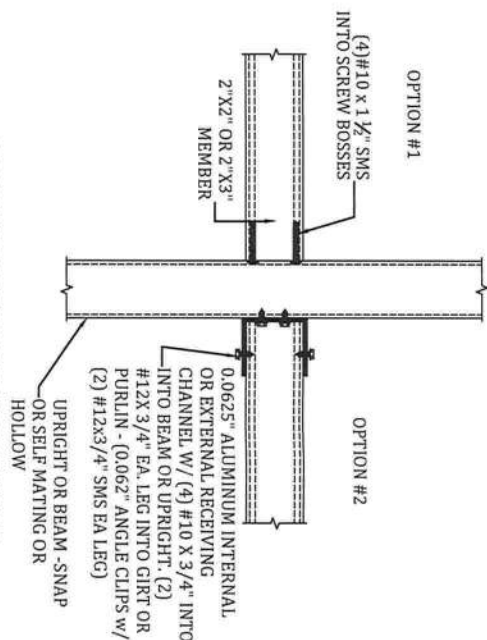

NOTE: CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON TITEN
HD 3/8" Ø SCREW ANCHORS WITH AN ALLOWABLE SHEAR CAPACITY
OF 880 LBS. W/ EDGE DISTANCE AND SPACING SHOWN.

J2
S-4

SCALE: NTS


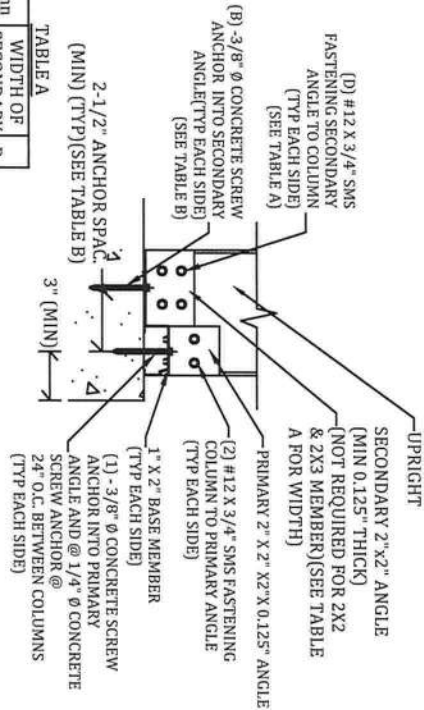


Column Size	Secondary D	Width of 2" x 2" Angle
2x2	NONE	0
2x3	NONE	0
2x4	2"	2
2x5	3"	3
2x6	4"	4
2x7	5"	5
2x8	6"	6
2x9	7"	7
2x10	8"	8


Column Size	Concrete Screw Anchor B	Min. Spa	Column Size	Concrete Screw Anchor B	Min. Spa
2x2	0"	0"	2x5	1"	3"
2x3	0"	0"	2x6	1"	4"
2x4	0"	0"	2x7	2"	5"
2x5	0"	0"	2x8	2"	6"
2x6	0"	0"	2x9	2"	7"
2x7	0"	0"	2x10	2"	8"

NOTES:
1. NUMBER OF ANCHORS "B" IS EACH SIDE INTO THE SECONDARY ANGLE AND DOES NOT INCLUDE THE ANCHOR INTO THE 1X2.
2. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL UPRIGHT LOCATIONS. ALL SCREW LENGTHS AT UPRIGHT CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVES DECK IS PRESENT.
3. CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON FASTENERS APPROVED ON THE S-1 NOTES PAGE.
4. 2X3W/1X2 CORNER POST SHALL REQUIRE SAME BASE CONNECTIONS AS 2X4 SHOWN IN TABLE.

2" x 2" OR LARGER UPRIGHT TO CONCRETE W/ W/O PAVES DETAILS
SCALE: NTS

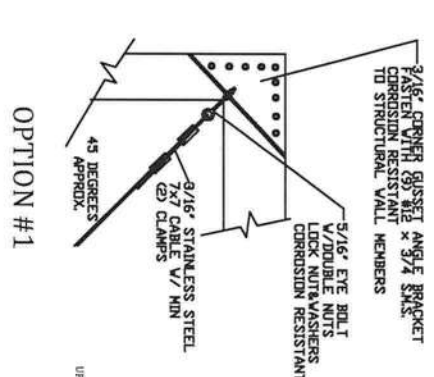


NOTE: WHEN USING OPTION #2 CONNECTION CABLE MUST BE WITHIN 6" OF CORNER OR PRIMARY MEMBER.

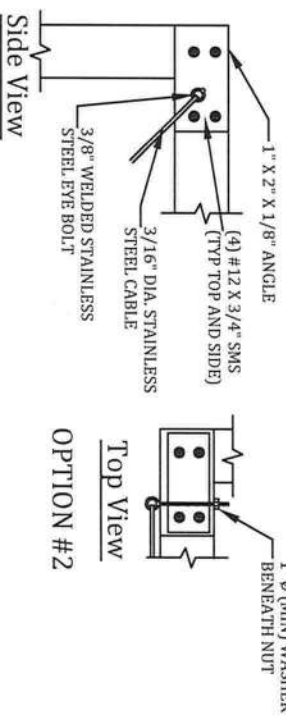

J1
S-4

SCALE: NTS

I HEREBY CERTIFY THAT I HAVE REVIEWED
THIS PLAN AND FOUND IT TO BE IN
COMPLIANCE WITH ASCE 7-10,
& FBC 6TH EDITION

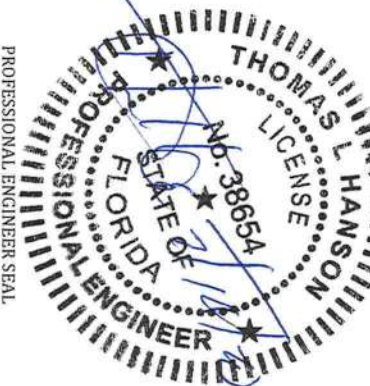

PROFESSIONAL ENGINEER SEAL

ENGINEER OF RECORD

David W. Smith P.E.

FLORIDA LICENSE NUMBER: 53608

Thomas L. Hanson P.E.

FLORIDA LICENSE NUMBER: 38654

Myron Max Neal P.E.

FLORIDA LICENSE NUMBER: 86663

Joel Falardeau P.E.

FLORIDA LICENSE NUMBER: 70667

Erik Stuart P.E.

FLORIDA LICENSE NUMBER: 77605

FBC Plans & Engineering
Services, Inc.

6272 Abbott Station Drive Unit 101

Zephyrhills, FL 33542

Phone: (813)788-5314

Fax: 1-(866)-824-7894

Email: erb@fbcplans.com

Website: www.fbcplans.com

C.O.A. - #29054

DATE: 07-09-2020

DRAWN BY: DRAYTON

REVISION: DATE:

RO 1

RO 2

RO 3

JOB #: 20_0624_453
PROJECT ADDRESS:

OSTEEN

2768 SW KING ST

LAKE CITY, FL 32024

CONTRACTOR:

LAKEIDE ALUMINUM, INC.

DETAILS

S-5

