


NTS



3,500 PSI (MIN.) CONCRETE

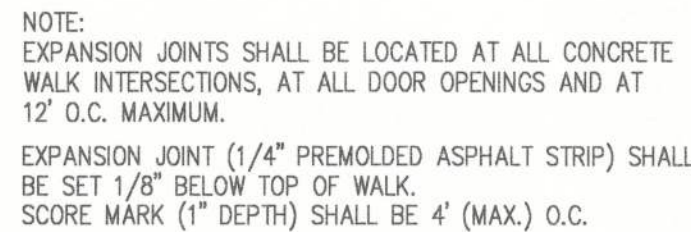

NTS



DUMPSTER PAD/WALL



NTS



NGS



NTS



NTS



1. COST OF 2-#4 BARS (CONT.) SHALL BE INCLUDED.
2. PROVIDE 2-#6 SMOOTH BARS W/ EXPANSION CAPS AT EACH EXPANSION JOINT, 20'-0" O.C. MAX.
3. CONTRACTION JOINTS - CONTRACTION JOINTS SHALL BE PLACED AT EQUAL SPACES (10' MAX.) BETWEEN NORMAL EXPANSION JOINTS. CONTRACTION JOINTS SHALL BE SAW CUT IN THE UPPER 1/3 OF CURB AND GUTTER WITHIN 24 HOURS OF PLACEMENT.
4. ENDS OF VERTICAL CURB SHALL TRANSITION FROM FULL TO ZERO HEIGHTS IN 3 FEET.

NTS




NTS



MONOLITH
(3,500 PSI (MIN))



3000 PSI (MIN.) CONCRETE

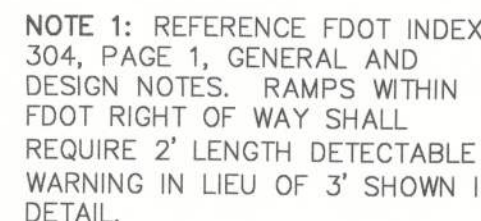

NTS



NTS



NTS



NTS