



### RIGHT ELEVATION

SCALE: 1/4 IN. = 1 FT.

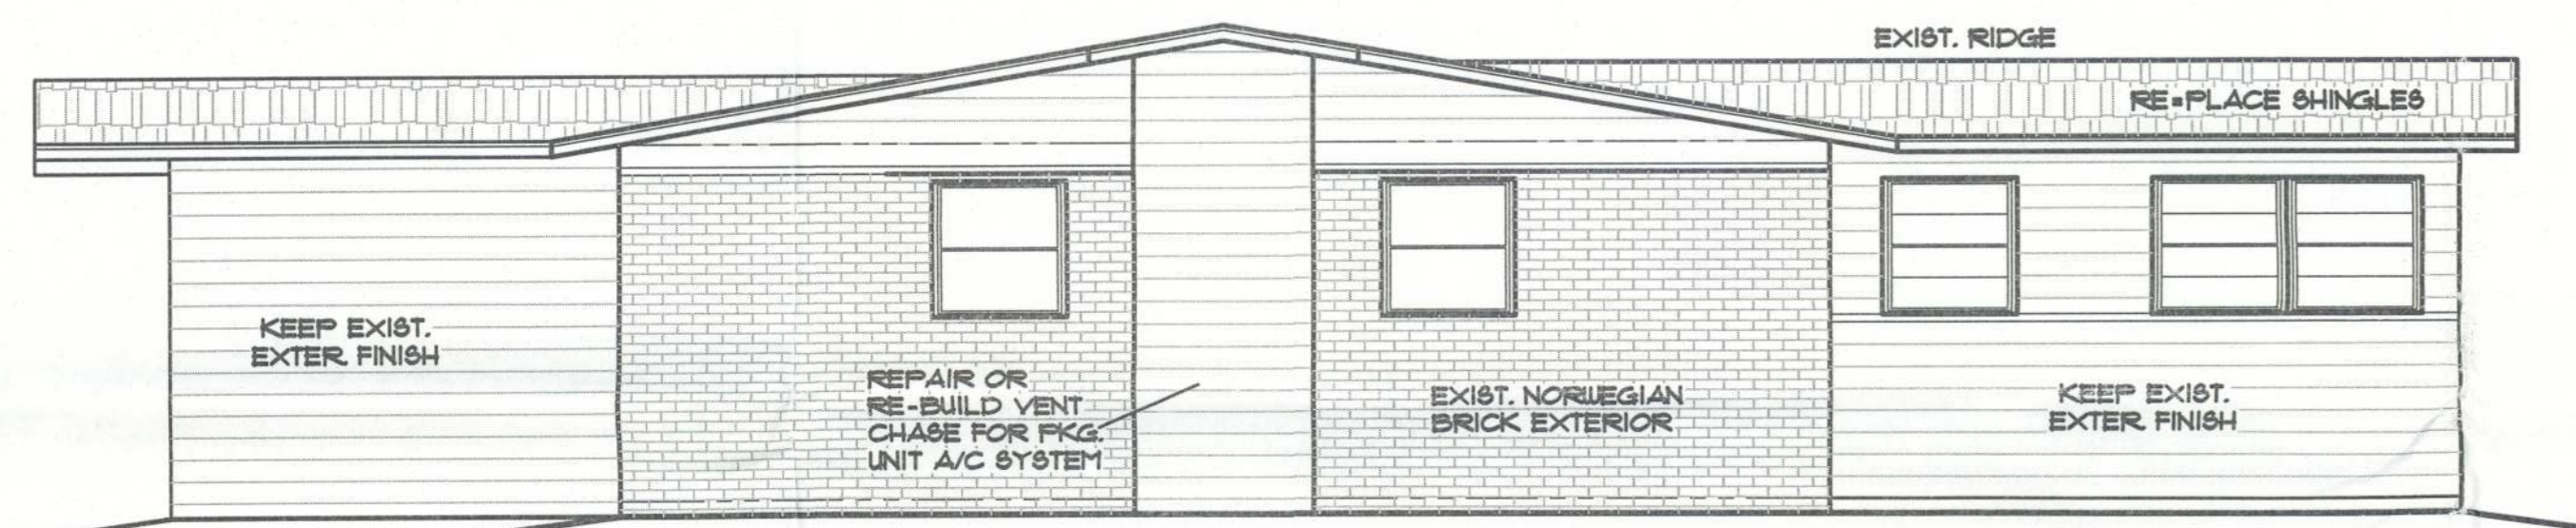


### LEFT ELEVATION

SCALE: 1/4 IN. = 1 FT.

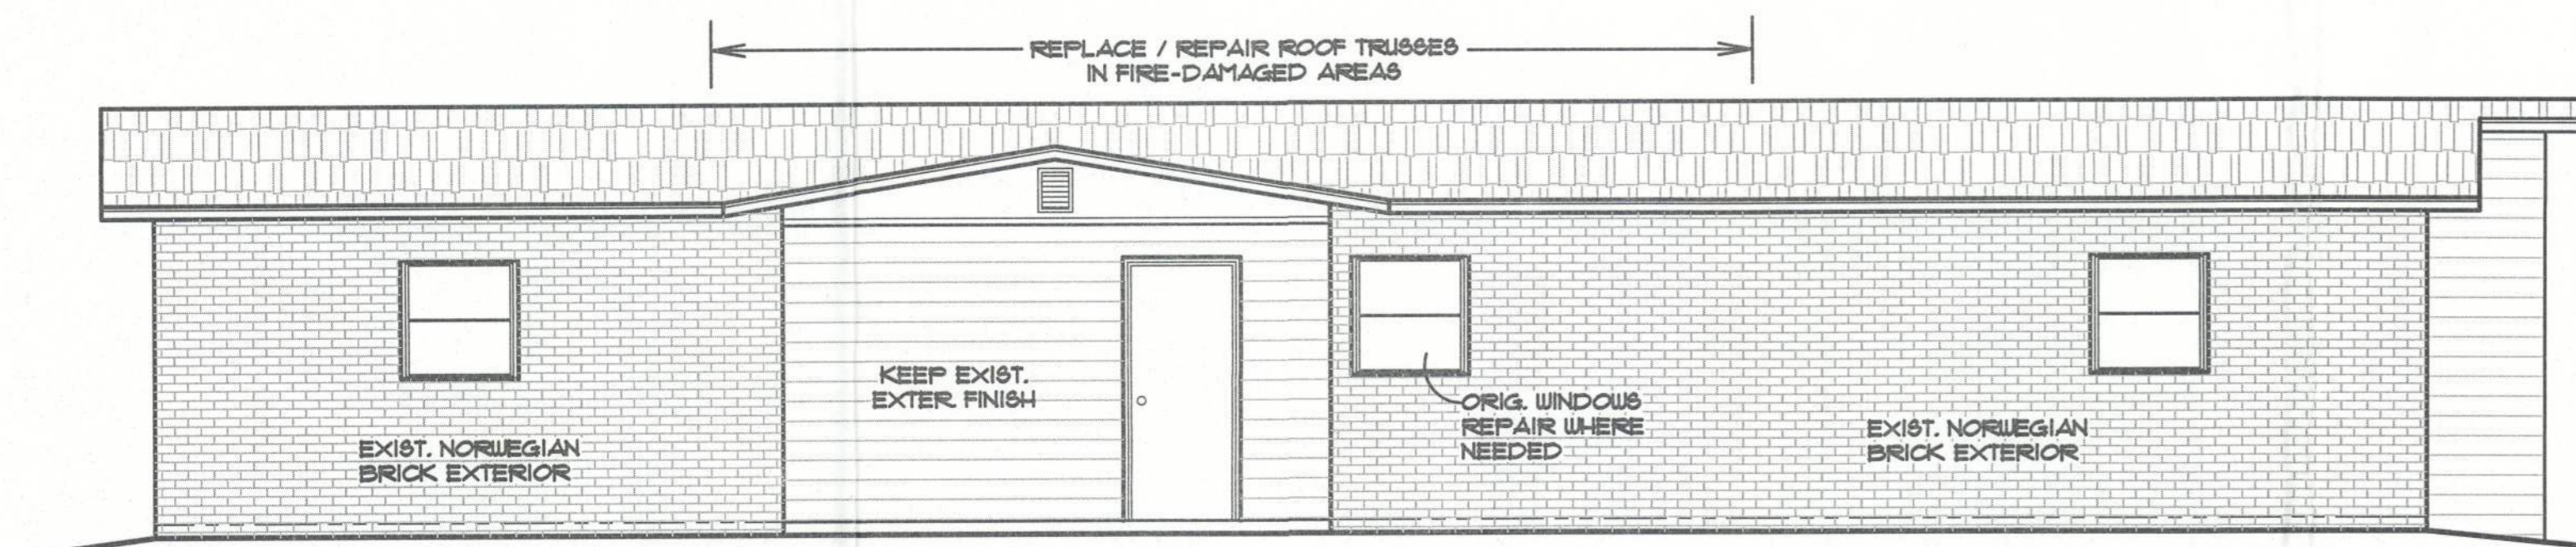

### REAR ELEVATION

SCALE: 1/4 IN. = 1 FT.

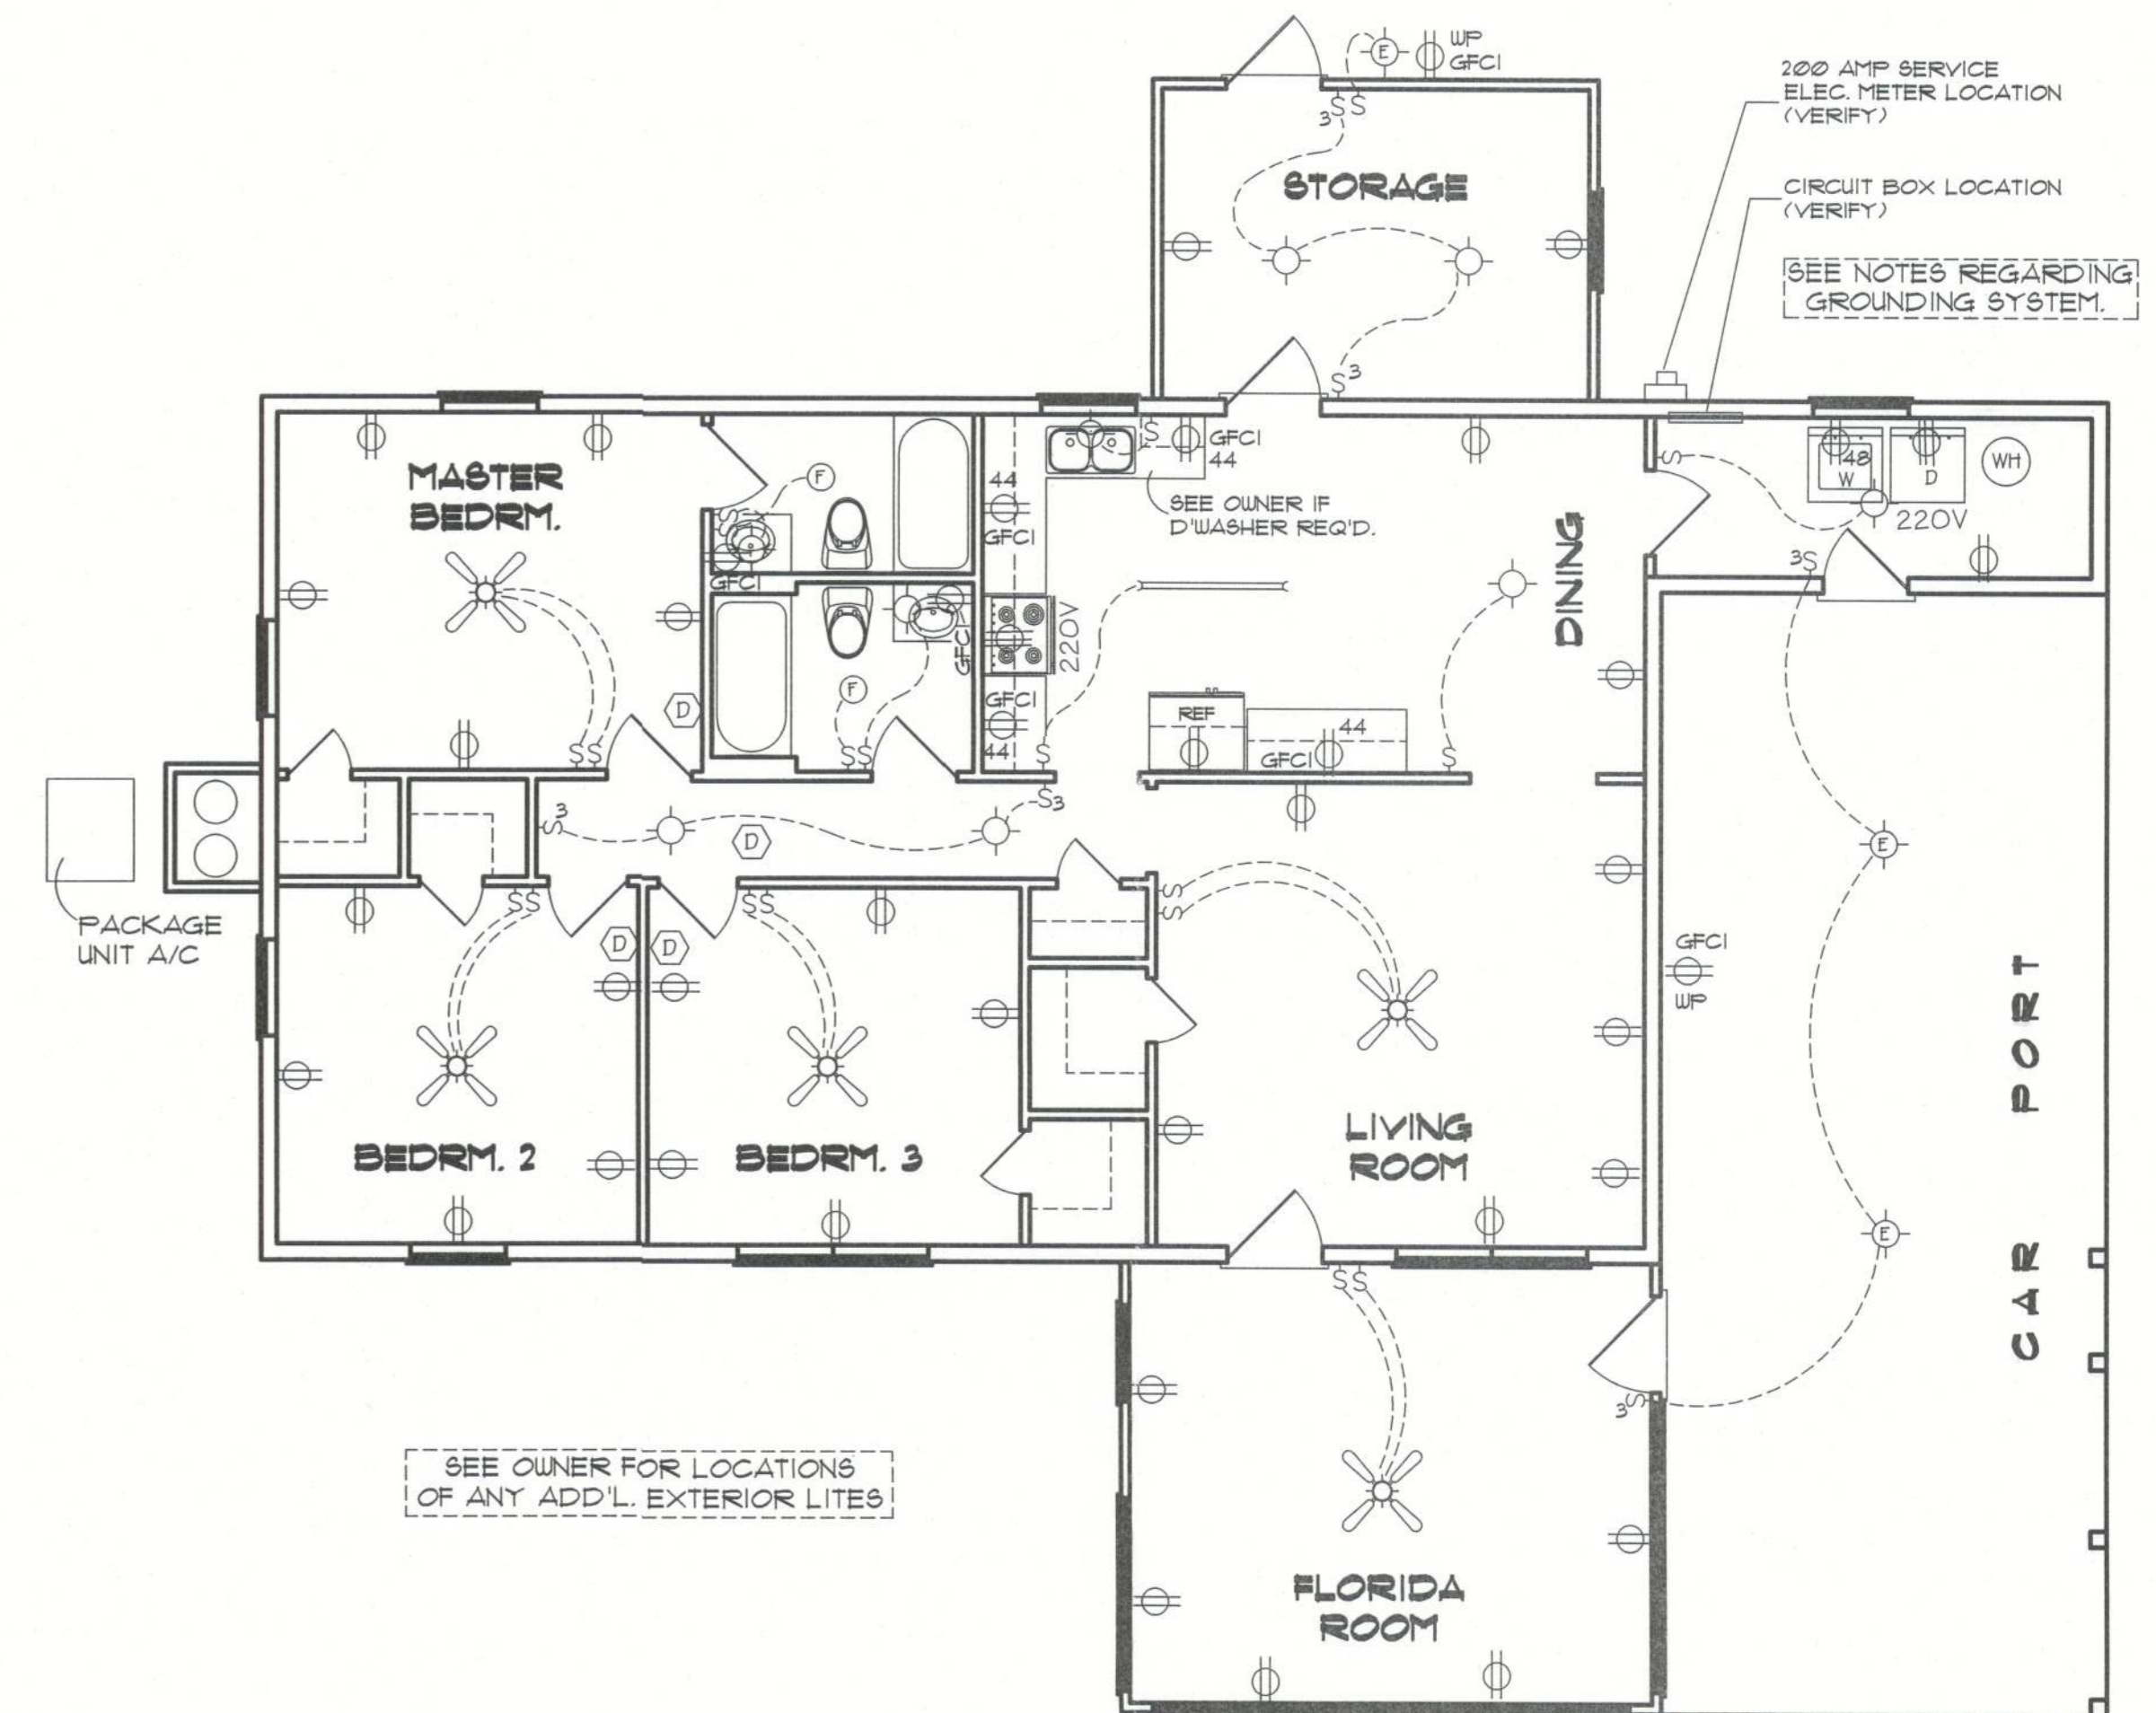

#### ELECTRICAL SYMBOL LEGEND

	• 48" FLOURESCENT LIGHTING FIXTURE		• 110V DUPLEX OUTLET GROUND FAULT CIRCUIT INTERRUPTER TYPE
	• STANDARD CEILING LIGHTING FIXTURE OR CHANDELIER		• 220 VOLT OUTLET ( 4 WIRE )
	• EXTERIOR LIGHTING FIXTURE - WEATHERPROOF		• FAN LOCATION ( CEILING )
	• SGL. POLE LIGHT SWITCH.		• FAN LOCATION ( EXHAUST )
	• 110V DUPLEX OUTLET AFCI, UNLESS NOTED		• SMOKE & CARBON MONOXIDE DETECTOR (SEE NOTES)
	• 110V DUPLEX OUTLET AFCI, UNLESS NOTED (SPECIAL HEIGHT NOTED)		• WEATHER PROOF

#### ELECTRICAL PLAN NOTES

- ALL INSTALLATIONS ARE PER NAT'L. ELECTRIC CODE (NEC) 2008.
- ALL RECEPTACLES, UNLESS NOTED OTHERWISE, SHALL BE ARC FAULT CIRCUIT INTERRUPTER (AFCI) TYPE. ALSO, RECEPTACLES, UNLESS NOTED, SHALL BE TAMPER RESISTANT.
- GROUNDING OF ELECTRICAL SYSTEM SHALL BE DETERMINED BY ELEC. CONTRACTOR. EXISTING FOUNDATION REINFORCING CANNOT BE UTILIZED FOR GROUNDING.
- ELECTRICAL CONTR. SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- ENTRY OF SERVICE ( UNDERGROUND OR OVERHEAD ) TO BE DETERMINED BY POWER COMPANY.
- LOW VOLTAGE ITEMS (TELEPHONE, CATV, DATA CABLES) IS SHOWN IF REQUESTED BY OWNER / BUILDER. CONSULT OWNER FOR REQUIREMENTS IF NOT SHOWN ON ELECTRICAL PLAN.
- ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS. THEY SHALL ALSO PROVIDE CARBON MONOXIDE DETECTION.

### ELECTRICAL PLAN

NOT TO SCALE

2

FILE: 13-007	<b>FIRE DAMAGE RESTORATION &amp; REMODEL</b> By Bryan Zacher Construction	SHEET: 2 OF 2
DATE: 4-3-13	PREPARED BY: TIM DELBENE Drafting + Technical Services	CAD FILE: 13-007
DRAWN: T A D	CHECK: T A D	REV:

192 SW Sagewood Gln. Lake City, FL 32024  
Phone ( 386 ) 755-5891