

RE: 6243113
2508-CR-2 Car

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer: Adams Homes-Gainesville Project Name: 6243113
Lot/Block: 096 Model: 2508-CR-2 Car
Address: 715 SW Rosemary Dr Subdivision: The Preserve at Laurel Lake
City: Lake City State: fl

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014
Wind Code: ASCE 7-22
Roof Load: 40.0 psf


Design Program: MiTek 20/20 8.7
Wind Speed: 130 mph
Floor Load: N/A psf

This package includes 41 individual, dated Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T34534201	A01	7/25/2024	21	T34534221	B01	7/25/2024
2	T34534202	A02	7/25/2024	22	T34534222	B01X	7/25/2024
3	T34534203	A03	7/25/2024	23	T34534223	B02	7/25/2024
4	T34534204	A04	7/25/2024	24	T34534224	C1	7/25/2024
5	T34534205	A05	7/25/2024	25	T34534225	C3	7/25/2024
6	T34534206	A06	7/25/2024	26	T34534226	C5	7/25/2024
7	T34534207	A07	7/25/2024	27	T34534227	E01	7/25/2024
8	T34534208	A08	7/25/2024	28	T34534228	E01X	7/25/2024
9	T34534209	A09	7/25/2024	29	T34534229	E02	7/25/2024
10	T34534210	A10	7/25/2024	30	T34534230	E02X	7/25/2024
11	T34534211	A11	7/25/2024	31	T34534231	E7	7/25/2024
12	T34534212	A11A	7/25/2024	32	T34534232	E7B	7/25/2024
13	T34534213	A12	7/25/2024	33	T34534233	E7V	7/25/2024
14	T34534214	A13	7/25/2024	34	T34534234	E7VA	7/25/2024
15	T34534215	A14	7/25/2024	35	T34534235	E7VB	7/25/2024
16	T34534216	A15	7/25/2024	36	T34534236	E7VC	7/25/2024
17	T34534217	A16	7/25/2024	37	T34534237	H7	7/25/2024
18	T34534218	A17	7/25/2024	38	T34534238	PB1	7/25/2024
19	T34534219	A18	7/25/2024	39	T34534239	PB2	7/25/2024
20	T34534220	A19	7/25/2024	40	T34534240	PB3	7/25/2024

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Tibbetts Lumber Co., LLC.
Truss Design Engineer's Name: Velez, Joaquin
My license renewal date for the state of Florida is February 28, 2025.
Florida COA: 6634

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

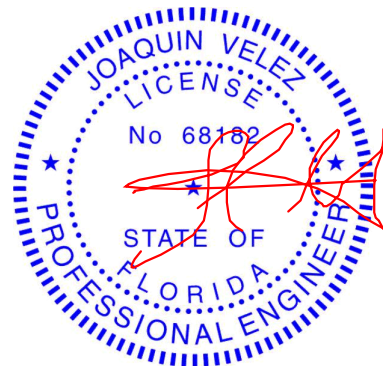

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25, 2024

Velez, Joaquin



RE: 6243113 - 2508-CR-2 Car

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Project Customer: Adams Homes-Gainesville Project Name: 6243113
Lot/Block: 096 Subdivision: The Preserve at Laurel Lake
Address: 715 SW Rosemary Dr
City, County: Lake City State: fl


No.	Seal#	Truss Name	Date
41	T34534241	PB4	7/25/2024

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534201
6243113	A01	Half Hip Girder	1	2	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:43 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-f2cEOvzVzUm0zLfa7K3HvNytQ2NHsjkV9c2TSYyusww



Scale = 1:77.1

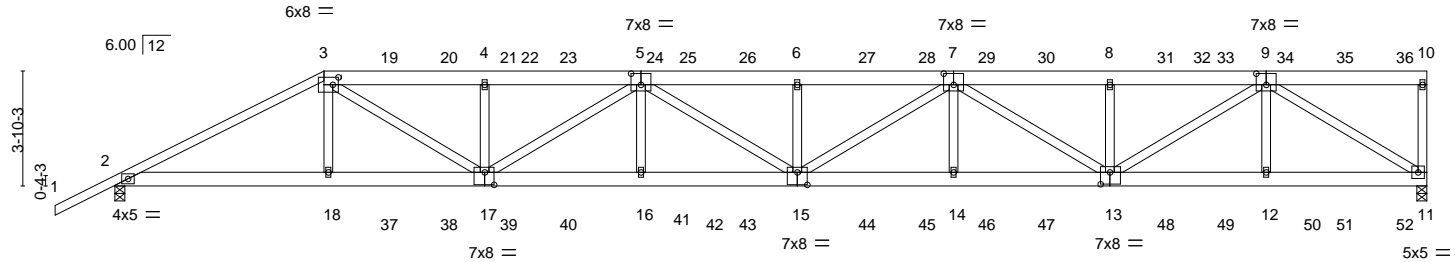

	7-0-0	12-4-9	17-7-5	22-10-2	28-0-14	33-3-11	38-6-7	43-11-0
	7-0-0	5-4-9	5-2-13	5-2-13	5-2-13	5-2-13	5-2-13	5-4-9
Plate Offsets (X,Y)--	[3:0-2-4,0-3-0],	[5:0-4-0,0-4-8],	[7:0-4-0,0-4-8],	[9:0-4-0,0-4-8],	[13:0-3-12,0-4-12],	[15:0-4-0,0-5-0],	[17:0-3-12,0-5-0]	

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.77	Vert(LL)	-0.40	15	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.98	Vert(CT)	-0.82	15	>641		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.84	Horz(CT)	0.17	11	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.27	15	>999	Weight: 597 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 1-3: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-10-14 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2 *Except* 15-17: 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 11=0-4-0, 2=0-4-0
Max Horz 2=119(LC 27)
Max Uplift 11=261(LC 8), 2=229(LC 8)
Max Grav 11=3631(LC 1), 2=3443(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-6883/334, 3-4=-9345/592, 4-5=-9343/591, 5-6=-11550/791, 6-7=-11550/791,
7-8=-8477/597, 8-9=-8477/597, 10-11=-310/94
BOT CHORD 2-18=-324/6066, 17-18=-316/6086, 16-17=-744/11142, 15-16=-744/11142,
14-15=-747/10682, 13-14=-747/10682, 12-13=-356/4974, 11-12=-356/4974
WEBS 3-18=0/661, 3-17=-326/3928, 4-17=-715/217, 5-17=-2163/182, 5-16=0/464,
5-15=-65/519, 6-15=-612/200, 7-15=-52/1033, 7-14=0/453, 7-13=-2628/178,
8-13=-612/194, 9-13=-287/4173, 9-12=0/491, 9-11=-5865/420

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=261, 2=229.

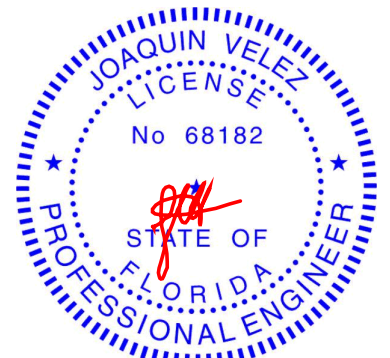

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534201
6243113	A01	Half Hip Girder	1	2	Job Reference (optional)	

NOTES-

11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 141 lb down and 86 lb up at 7-0-0, 122 lb down and 83 lb up at 9-0-12, 122 lb down and 83 lb up at 11-0-12, 122 lb down and 83 lb up at 13-0-12, 122 lb down and 83 lb up at 15-0-12, 122 lb down and 83 lb up at 17-0-12, 122 lb down and 83 lb up at 19-0-12, 122 lb down and 83 lb up at 21-0-12, 122 lb down and 83 lb up at 23-0-12, 122 lb down and 83 lb up at 25-0-12, 122 lb down and 83 lb up at 27-0-12, 122 lb down and 83 lb up at 29-0-12, 122 lb down and 83 lb up at 31-0-12, 122 lb down and 83 lb up at 33-0-12, 122 lb down and 83 lb up at 35-0-12, 122 lb down and 83 lb up at 37-0-12, 122 lb down and 83 lb up at 39-0-12, and 122 lb down and 83 lb up at 41-0-12, and 131 lb down and 80 lb up at 43-0-12 on top chord, and 310 lb down at 7-0-0, 95 lb down at 9-0-12, 95 lb down at 11-0-12, 95 lb down at 13-0-12, 95 lb down at 15-0-12, 95 lb down at 17-0-12, 95 lb down at 19-0-12, 95 lb down at 21-0-12, 95 lb down at 23-0-12, 95 lb down at 25-0-12, 95 lb down at 27-0-12, 95 lb down at 29-0-12, 95 lb down at 31-0-12, 95 lb down at 33-0-12, 95 lb down at 35-0-12, 95 lb down at 37-0-12, 95 lb down at 39-0-12, and 95 lb down at 41-0-12, and 101 lb down at 43-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-60, 3-10=-60, 2-11=-20

Concentrated Loads (lb)

Vert: 3=-122(F) 18=-262(F) 15=-48(F) 6=-122(F) 13=-48(F) 8=-122(F) 19=-122(F) 20=-122(F) 21=-122(F) 23=-122(F) 24=-122(F) 25=-122(F) 26=-122(F) 27=-122(F) 28=-122(F) 29=-122(F) 30=-122(F) 31=-122(F) 33=-122(F) 34=-122(F) 35=-122(F) 36=-131(F) 37=-48(F) 38=-48(F) 39=-48(F) 40=-48(F) 41=-48(F) 42=-48(F) 43=-48(F) 44=-48(F) 45=-48(F) 46=-48(F) 47=-48(F) 48=-48(F) 49=-48(F) 50=-48(F) 51=-48(F) 52=-51(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534202
6243113	A02	Half Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:44 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-7FAdbFz7knutbVEmg1bWRaV3kSm4bAYeNGn0_?yuswv



Scale = 1:77.4

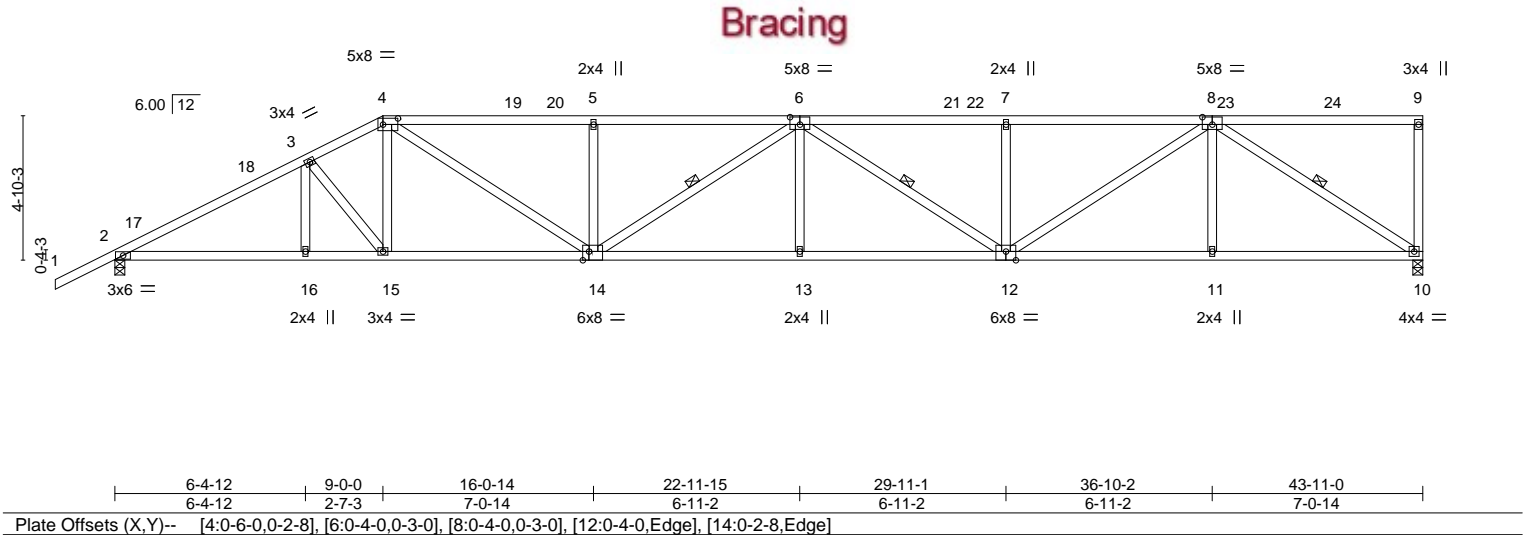

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.74	Vert(LL) -0.34 13 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.82	Vert(CT) -0.69 13-14 >761 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.86	Horz(CT) 0.20 10 n/a n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-S	Wind(LL) 0.20 13 >999 240	Weight: 243 lb	FT = 20%

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534203
6243113	A03	Half Hip	1	1		
Job Reference (optional)						

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,


8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:44 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-7FAdbFz7knutbVEmg1bWRaV3dSkkbBPnGn0_?yuswv

2-0-0	6-4-11	10-2-8	17-0-7	23-8-10	30-4-14	37-1-1	43-11-0
2-0-0	6-4-11	3-9-13	6-9-15	6-8-3	6-8-3	6-8-3	6-9-15

Scale = 1:77.4

Bracing

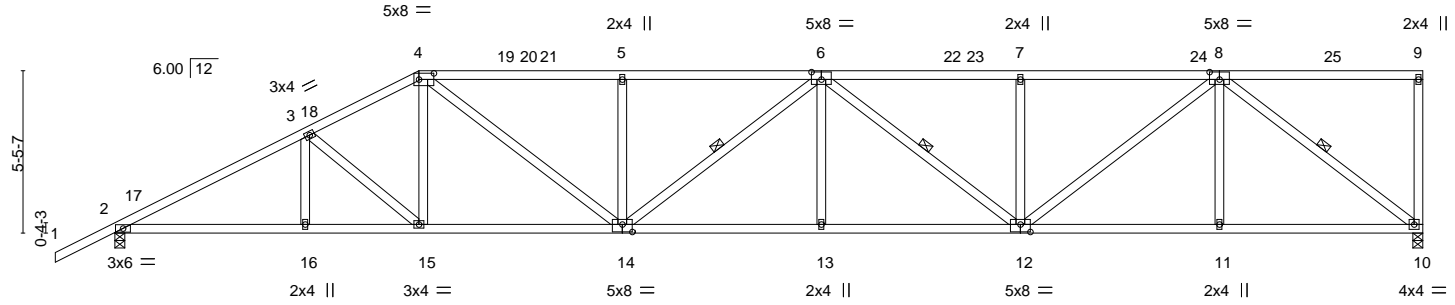

<div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div>											
Plate Offsets (X,Y)-- [4:0-6-0,0-2-8], [6:0-4-0,0-3-0], [8:0-4-0,0-3-0], [12:0-4-0,0-3-0], [14:0-4-0,0-3-0]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.74	Vert(LL)	-0.29 13-14	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.90	Vert(CT)	-0.61 13-14	>860	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.81	Horz(CT)	0.20 10	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.18 13-14	>999	240	Weight: 251 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
4-6: 2x4 SP M 31 or 2x4 SP SS
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-14, 6-12, 8-10

REACTIONS.


(size) 10=0-4-0, 2=0-4-0
Max Horz 2=158(LC 12)
Max Uplift 10=82(LC 12), 2=132(LC 12)
Max Grav 10=1741(LC 1), 2=1877(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3343/209, 3-4=-2982/223, 4-5=-3543/257, 5-6=-3542/257, 6-7=-3177/207, 7-8=-3177/207
BOT CHORD 2-16=-273/2889, 15-16=-273/2889, 14-15=-218/2624, 13-14=-251/3700, 12-13=-251/3700, 11-12=-128/1973, 10-11=-128/1973
WEBS 3-15=-356/71, 4-15=0/381, 4-14=-61/1151, 5-14=-433/128, 6-13=0/265, 6-12=-661/55, 7-12=-393/107, 8-12=-102/1521, 8-11=0/289, 8-10=-2464/159

NOTES-

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 10-2-8, Zone2 10-2-8 to 14-5-7, Zone1 14-5-7 to 43-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 2=132.

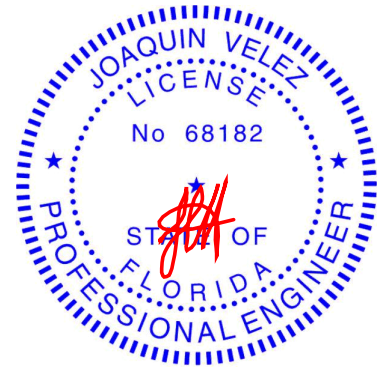

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534204
6243113	A04	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:45 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAwZSLZ-bRk?pb_IV50kCfpzEI6l_o2DMS6WKfxcwXZWRYuswu



Bracing

Scale = 1:81.4


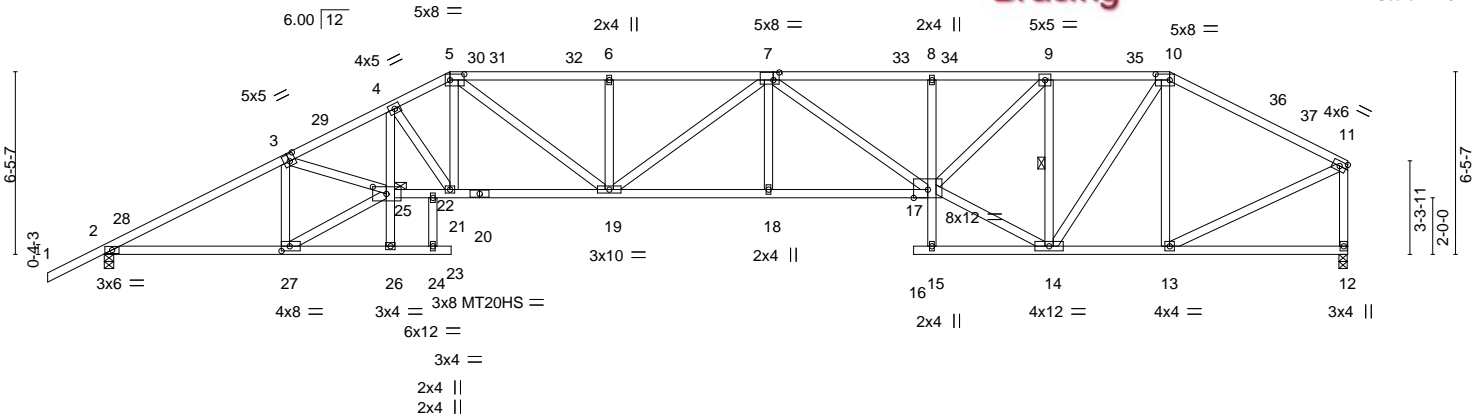


Plate Offsets (X,Y)--		[3:0-2-8,0-3-0], [5:0-6-0,0-2-8], [7:0-2-8,0-3-4], [10:0-6-0,0-2-8], [25:0-5-12,0-3-0], [27:0-3-8,0-2-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.81	Vert(LL)	-0.43 18-19	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.80	Vert(CT)	-0.87 18-19	>599	240	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.40 12	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.26 18-19	>999	240	Weight: 284 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
20-25,17-20: 2x4 SP M 31 or 2x4 SP SS
WEBS 2x4 SP No.2

REACTIONS.


(size) 2=0-4-0, 12=0-3-8
Max Horz 2=108(LC 12)
Max Uplift 2=-128(LC 12), 12=-70(LC 12)
Max Grav 2=1891(LC 1), 12=1753(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3382/208, 3-4=-4945/360, 4-5=-4112/312, 5-6=-4470/336, 6-7=-4469/336,
7-8=-4124/310, 8-9=-4093/309, 9-10=-2271/211, 10-11=-1814/153, 11-12=-1692/161
BOT CHORD 2-27=-212/2924, 4-25=-80/1222, 22-25=-285/4370, 21-22=-285/4369, 19-21=-211/3708,
18-19=-254/4624, 17-18=-254/4624, 8-17=-297/85, 13-14=-80/1534
WEBS 3-27=-1464/186, 25-27=-237/3224, 3-25=-71/1470, 4-21=-1185/127, 5-21=-39/1008,
5-19=-63/1058, 6-19=-347/107, 7-19=-300/4, 7-17=-646/36, 14-17=-135/2444,
9-17=-139/2584, 9-14=-2067/170, 10-14=-82/1336, 10-13=-615/109, 11-13=-82/1671

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 12-2-8, Zone2 12-2-8 to 16-5-7, Zone1 16-5-7 to 37-7-8, Zone2 37-7-8 to 41-10-7, Zone1 41-10-7 to 43-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12 except (jt=lb) 2=128.

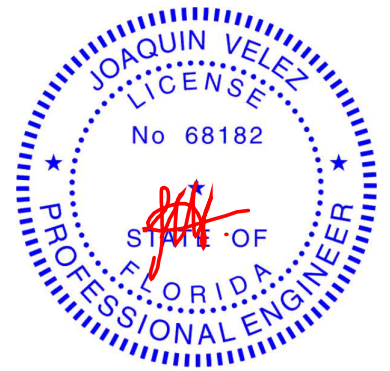

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:46 2024 Page 1

ID:T53RJ0261 Xu2fYqSyBHAWzZSLZ-3dIN0x?NGP8bqpO9pSd W?aPvGSI36xxraG73tvuswt



Scale = 1:80.1

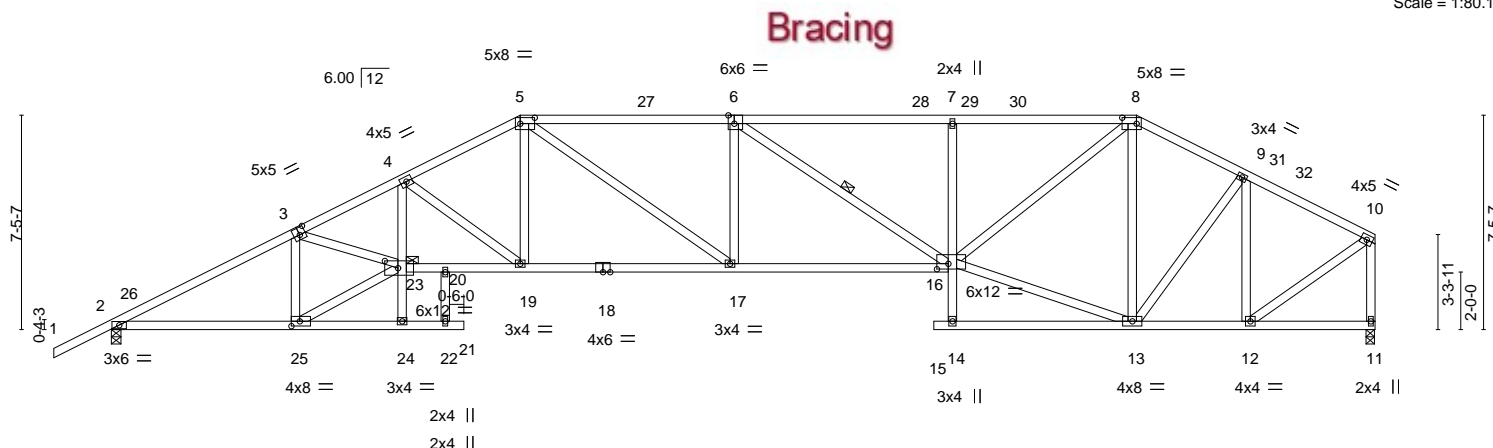

6-4-13 10-3-0 11-9-0 14-2-8 21-7-12 29-1-0 35-7-8 39-5-4 43-10-12 43-11-0
6-4-13 3-10-4 1-6-0 2-5-8 7-5-4 7-5-4 6-6-8 3-9-12 4-5-8 0-0-4

Plate Offsets (X,Y)--		[3:0-2-8,0-3-0], [5:0-6-0,0-2-8], [6:0-2-8,Edge], [8:0-6-0,0-2-8], [16:0-4-12,0-2-4], [23:0-5-8,0-3-0], [25:0-3-8,0-2-0]									
LOADING	(psf)	SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.76	Vert(LL)	-0.32 17-19	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.80	Vert(CT)	-0.68 17-19	>767	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.74	Horz(CT)	0.33 11	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.20 17-19	>999	240	Weight: 284 lb	FT = 20%

LUMBER-

TOP CHORD	2x4 SP No.2 *Except*
	5-6: 2x4 SP M 31 or 2x4 SP SS
BOT CHORD	2x4 SP No.2 *Except*
	18-23,16-18: 2x4 SP M 31 or 2x4 SP SS
WEBS	2x4 SP No.2

REACTIONS.

(size) 2=0-4-0, 11=0-3-8
 Max Horz 2=108(LC 12)
 Max Uplift 2=-128(LC 12), 11=-70(LC 12)
 Max Grav 2=1891(LC 1), 11=1753(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=3381/206, 3-4=4941/357, 4-5=3663/288, 5-6=3784/308, 6-7=3356/287,
7-8=3340/290, 8-9=1901/191, 9-10=1538/132, 10-11=1708/151

BOT CHORD 2-25=209/2923, 4-23=52/1210, 20-23=288/4383, 19-20=289/4381, 17-19=173/3270,
16-17=199/3784, 7-16=437/129, 12-13=81/1328

WEBS 3-25=1454/179, 23-25=227/3209, 3-23=74/1743, 4-19=1407/144, 5-19=8/925,
5-17=42/785, 6-17=280/122, 6-16=570/303, 13-16=82/1659, 8-16=134/2189,
8-13=825/88, 9-13=0/595, 9-12=853/104, 10-12=96/1600

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 14-2-8, Zone2 14-2-8 to 18-5-7, Zone1 18-5-7 to 35-7-8, Zone2 35-7-8 to 39-10-7, Zone1 39-10-7 to 43-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11 except (jt=lb) 2=128.

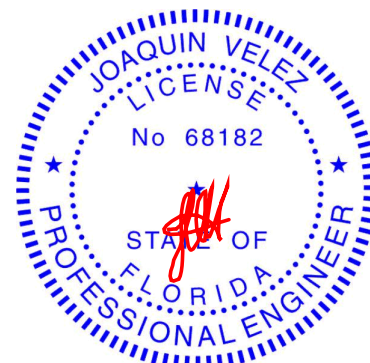

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25, 2024

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534206
6243113	A06	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,


8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:47 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-XqslEH0?1iGSSyzLMA8D3D7WpglLoY144E0gbKyusws

-2-0-0	6-4-13	10-3-0	16-2-8	22-7-12	29-1-0	33-7-8	39-5-3	43-11-0
2-0-0	6-4-13	3-10-4	5-11-8	6-5-4	6-5-4	4-6-8	5-9-11	4-5-13

Bracing

Scale = 1:80.1

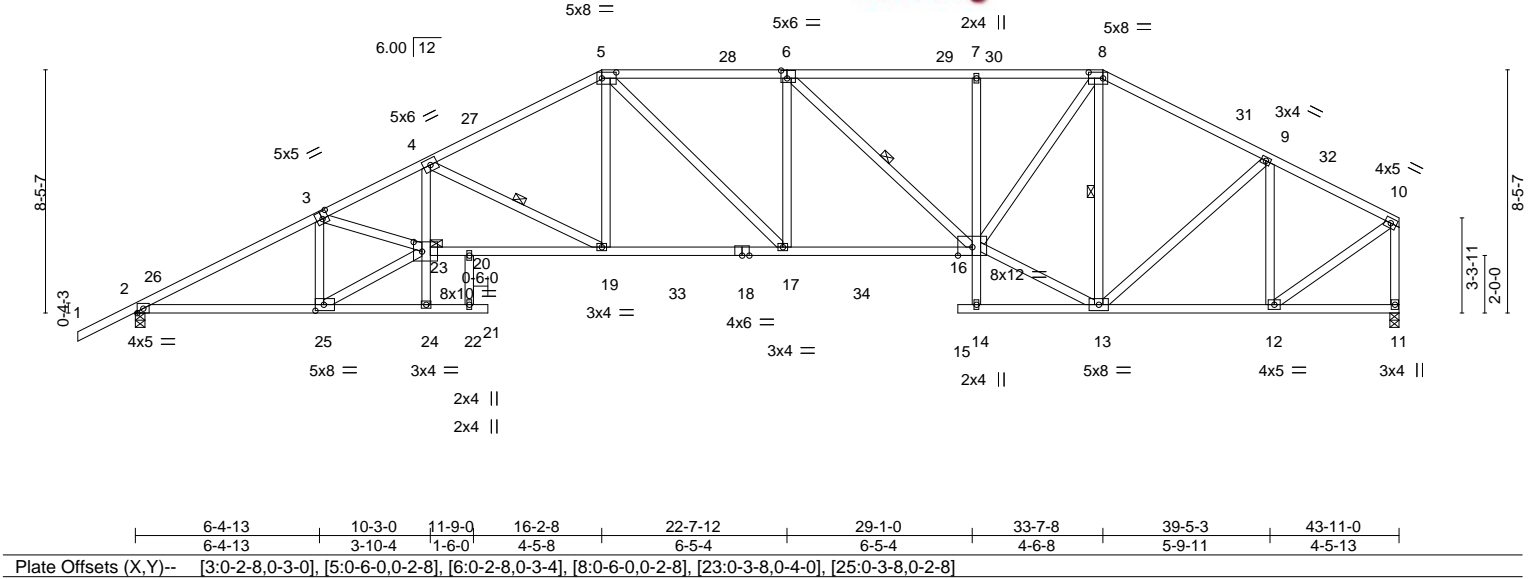

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 1.00	Vert(LL)	-0.37 17-19	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.97	Vert(CT)	-0.67 17-19	>778	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.80	Horz(CT)	0.35 11	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.18 19	>999	240	Weight: 291 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
18-23,16-18: 2x4 SP M 31 or 2x4 SP SS
WEBS 2x4 SP No.2

REACTIONS.


(size) 2=0-4-0, 11=0-3-13
Max Horz 2=122(LC 11)
Max Uplift 2=-128(LC 12), 11=-70(LC 12)
Max Grav 2=2117(LC 17), 11=1944(LC 38)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3832/206, 3-4=-5700/351, 4-5=-3769/275, 5-6=-3560/289, 6-7=-3104/269,
7-8=-3088/268, 8-9=-2177/205, 9-10=-1709/132, 10-11=-1881/147
BOT CHORD 2-25=-210/3408, 4-23=-19/1507, 20-23=-295/5168, 19-20=-296/5162, 17-19=-144/3374,
16-17=-155/3591, 7-16=-338/103, 12-13=-84/1491
WEBS 3-25=-1621/167, 23-25=-208/3731, 3-23=-75/1765, 4-19=-2024/169, 5-19=0/1130,
5-17=-27/505, 6-16=-624/33, 13-16=-69/2032, 8-16=-109/2156, 8-13=-1044/87,
9-13=0/574, 9-12=-851/128, 10-12=-101/1805

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 16-2-8, Zone2 16-2-8 to 20-5-7, Zone1 20-5-7 to 33-7-8, Zone2 33-7-8 to 37-10-7, Zone1 37-10-7 to 43-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11 except (jt=lb) 2=128.

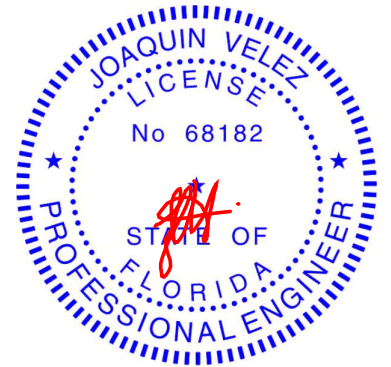

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534207
6243113	A07	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:48 2024 Page 1

ID:Ts3RJ0261_Xu2fygSyBHAwZSLZ-70Q7Rd0do0I36YXvtfScQgIB35UXzIElulE7myuswr



Scale = 1:79.8

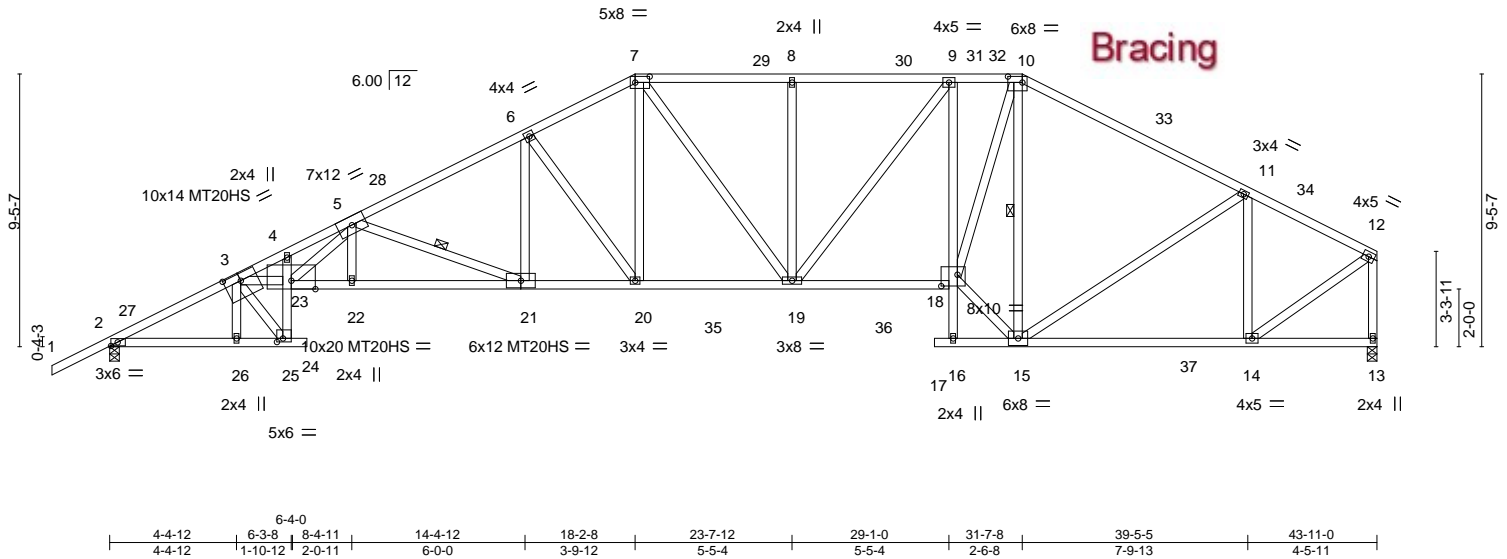



Plate Offsets (X,Y)--		[2:0-2-12,0-1-8], [3:0-7-0,0-3-0], [7:0-6-0,0-2-8], [10:0-6-0,0-2-8], [18:0-6-12,0-4-12], [25:0-2-8,0-1-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.84
TCDL 10.0	Lumber DOL	1.25	BC 0.91
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.92
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S
		DEFL.	in (loc)
		Vert(LL)	-0.54 24
		Vert(CT)	-1.01 21-22
		Horz(CT)	0.62 13
		Wind(LL)	0.27 24
		PLATES	GRIP
		MT20	244/190
		MT20HS	187/143
		Weight: 307 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD	2x4 SP M 31 or 2x4 SP SS *Except* 7-10, 1-3: 2x4 SP No.2
BOT CHORD	2x4 SP M 31 or 2x4 SP SS *Except* 9-16, 13-17, 18-21: 2x4 SP No.2
WEBS	2x4 SP No.2 *Except* 3-23: 2x4 SP M 31 or 2x4 SP SS

REACTIONS.	(size) 2=0-4-0, 13=0-4-0
Max Horz	2=138(LC 11)
Max Uplift	2=127(LC 12), 13=70(LC 12)
Max Grav	2=2108(LC 17), 13=1978(LC 18)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3798/191, 3-4=-9571/571, 4-5=-9640/584, 5-6=-4176/299, 6-7=-3336/288, 7-8=-3033/278, 8-9=-3033/279, 9-10=-2780/261, 10-11=-2242/213, 11-12=-1754/132, 12-13=-1934/142
BOT CHORD	2-26=-211/3393, 25-26=-213/3398, 23-25=-260/4325, 22-23=-368/6146, 21-22=-368/6146, 20-21=-194/3732, 19-20=-118/3003, 18-19=-106/2840, 9-18=-546/83, 14-15=-89/1553
WEBS	3-25=-5056/318, 3-23=-489/8238, 5-23=-219/3696, 5-22=0/326, 5-21=-2576/185, 6-21=-3/1069, 6-20=-1248/128, 7-20=-53/1174, 7-19=-22/328, 8-19=-370/112, 9-19=-29/418, 15-18=-70/2682, 10-18=-122/2765, 10-15=-1919/123, 11-15=0/513, 11-14=-839/150, 12-14=-110/1895

NOTES-
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 18-2-8, Zone2 18-2-8 to 22-5-7, Zone1 22-5-7 to 31-7-8, Zone2 31-7-8 to 35-10-7, Zone1 35-10-7 to 43-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
4) Provide adequate drainage to prevent water ponding.
5) All plates are MT20 plates unless otherwise indicated.
6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13 except (jt=lb) 2=127.

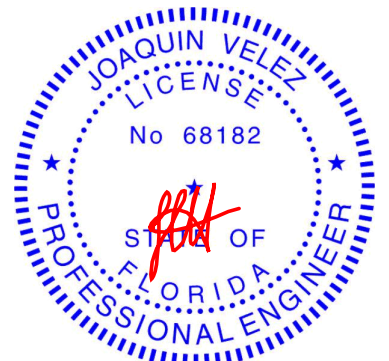

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:48 2024 Page 1
ID:Ts3R.l0261 X1u2fyqSvBHAwzZSI Z-20Q7Rd0d0QI36YXvtfScQqoV37dX4iEluE7mviu5w

-2-0-0	6-4-0	12-4-13	20-2-8	24-11-0	29-1-0	29-7-8	33-5-3	39-5-5	43-11-0
2-0-0	6-4-0	6-0-12	7-9-11	4-8-8	4-2-0	0-6-8	3-9-11	6-0-2	4-5-12

Scale = 1:79.6

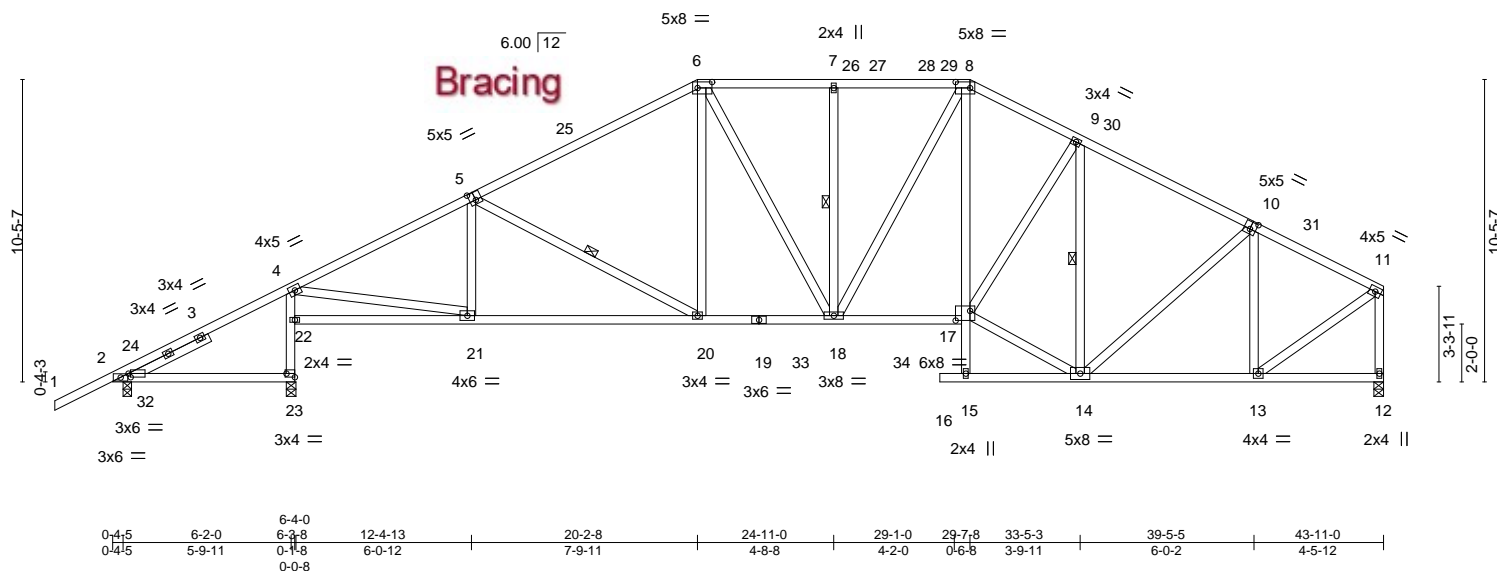


Plate Offsets (X,Y)-- [2:0-0,15,0,1-8], [5:0-2,8,0,3-4], [6:0-6,0,0,2-8], [8:0-6,0,0,2-8], [10:0-2,8,0,3-0], [17:0-6,0,0,4-0], [23:Edge,0,1-8]															
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.				in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL		1.25		TC	0.56	Vert(LL)	-0.17	20-21	>999	360	MT20	244/190	
TCDL	10.0	Lumber DOL		1.25		BC	0.78	Vert(CT)	-0.33	20-21	>999	240			
BCLL	0.0 *	Rep Stress Incr		YES		WB	0.47	Horz(CT)	0.11	12	n/a	n/a			
BCDL	10.0	Code FBC2023/TPI2014				Matrix-S		Wind(LL)	0.06	16	>999	240	Weight: 302 lb	FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 *Except* 5-6: 2x4 SP M 31 or 2x4 SP SS	TOP CHORD	Structural wood sheathing directly applied or 3-4-7 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.2		4-2-9 oc bracing: 22-23.
SLIDER	Left 2x4 SP No.2 3-0-14	WEBS	1 Row at midpt 5-20, 7-18, 9-14

REACTIONS. (size) 2=0-3-8, 23=0-4-0, 12=0-4-0
 Max Horiz 2=155(LC 11)
 Max Uplift 2=-110(LC 12), 23=-137(LC 12), 12=-58(LC 12)
 Max Grav 2=357(LC 23), 23=2007(LC 17), 12=1704(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 4-5=-2432/167, 5-6=-2152/206, 6-7=-1971/227, 7-8=-1971/227, 8-9=-2187/226,
9-10=-1842/180, 10-11=-1484/113, 11-12=-1642/128

BOT CHORD 22-23=-1939/173, 4-22=-1842/203, 20-21=-107/2195, 18-20=-37/1902, 17-18=-34/1917,
13-14=-68/1298

WEBS 4-21=-111/2187, 5-20=-343/79, 6-20=0/427, 6-18=-23/353, 7-18=-312/87, 8-18=-23/265,
8-17=-19/694, 9-17=0/647, 9-14=-939/88, 10-14=0/404, 10-13=-706/115,
11-13=-78/1556, 14-17=-64/1786

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 20-2-8, Zone2 20-2-8 to 24-5-7, Zone1 24-5-7 to Zone2 29-7-8 to Zone2 29-7-8 to 33-10-7, Zone1 33-10-7 to 43-9-4 zone; cantilever left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12 except (jt=lb) =110. 23=137.

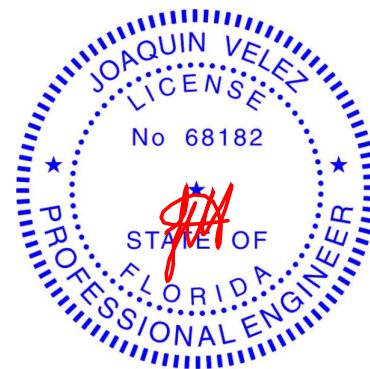

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25, 2024

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534209
6243113	A09	Hip	1	1		
Job Reference (optional)						

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:49 2024 Page 1

ID:Ts3RJ0261_Xu2fygSyBHAWzZSLZ-TC_Wfz1GZKW9hG7kTbAh8eCzFTTsGWzNXYVnfCysuwq



Scale = 1:79.6

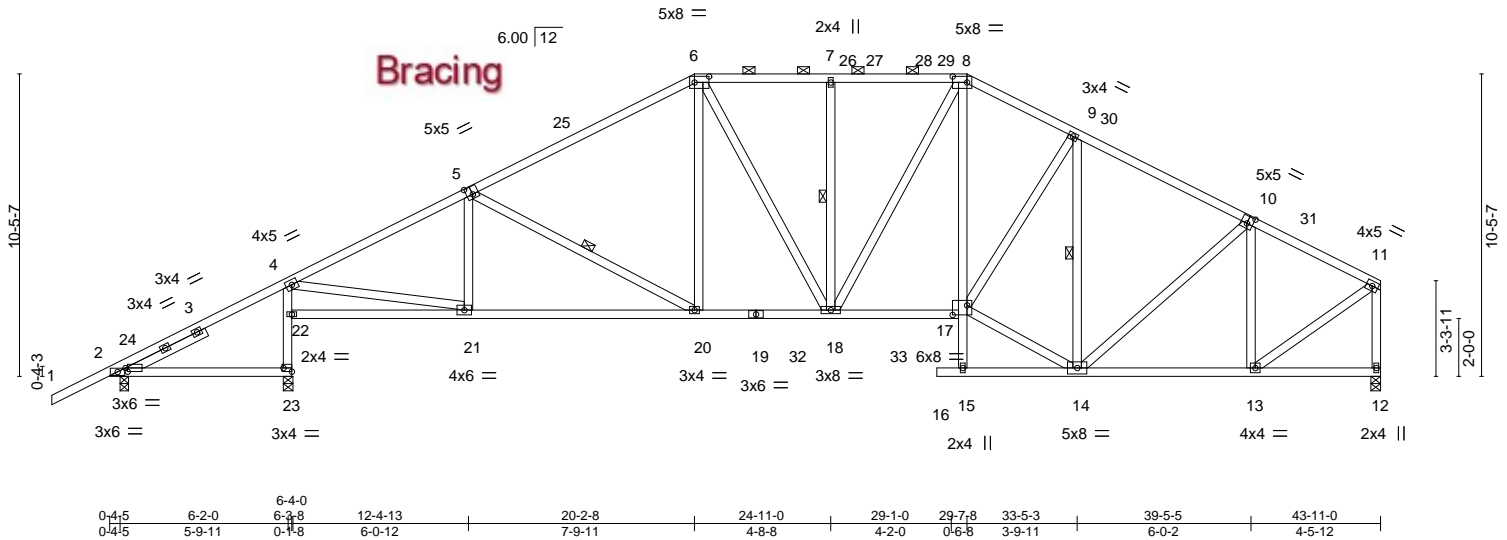



Plate Offsets (X,Y)-- [2:0-0-15,0-1-8], [5:0-2-8,0-3-4], [6:0-6-0,0-2-8], [8:0-6-0,0-2-8], [10:0-2-8,0-3-0], [17:0-6-0,0-4-0], [23:Edge,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.56	Vert(LL)	-0.17 20-21 >999	360	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.78	Vert(CT)	-0.33 20-21 >999	240	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.11 12 n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.06 16 >999	240	Weight: 302 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD	TOP CHORD
2x4 SP No.2 *Except*	Structural wood sheathing directly applied or 3-4-7 oc purlins, except end verticals, and 2-0-0 oc purlins (4-0-1 max.): 6-8.
5-6: 2x4 SP M 31 or 2x4 SP SS	
BOT CHORD	BOT CHORD
2x4 SP No.2	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	4-2-2 oc bracing: 22-23.
SLIDER	1 Row at midpt
Left 2x4 SP No.2 3-0-14	5-20, 7-18, 9-14

REACTIONS.	(size) 2=0-3-8, 23=0-4-0, 12=0-4-0
	Max Horz 2=155(LC 11)
	Max Uplift 2=-56(LC 12), 23=-88(LC 12), 12=-58(LC 12)
	Max Grav 2=357(LC 23), 23=2044(LC 17), 12=1704(LC 18)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	4-5=-2434/162, 5-6=-2153/204, 6-7=-1971/226, 7-8=-1971/226, 8-9=-2187/225, 9-10=-1843/179, 10-11=-1484/113, 11-12=-1643/127
BOT CHORD	22-23=-1938/176, 4-22=-1841/205, 20-21=-103/2197, 18-20=-35/1903, 17-18=-33/1917, 13-14=-68/1298
WEBS	4-21=-128/2178, 5-20=-344/76, 6-20=0/428, 6-18=-24/353, 7-18=-312/88, 8-18=-22/265, 8-17=-19/694, 9-17=0/647, 9-14=-939/87, 10-14=0/404, 10-13=-706/115, 11-13=-77/1557, 14-17=-63/1786

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 20-2-8, Zone2 20-2-8 to 24-5-7, Zone1 24-5-7 to 29-7-8, Zone2 29-7-8 to 33-10-7, Zone1 33-10-7 to 43-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 23, 12.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

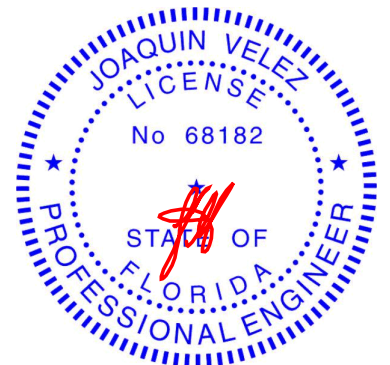

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534210
6243113	A10	Piggyback Base	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:50 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-xPXusJ2uKde0JQiw1Ihwhrl7etoO?vNXmCEKCEyuswp

1-2-0-0	7-3-3	10-4-12	14-4-13	20-2-8	24-11-0	29-7-8	35-5-3	39-5-4	45-10-0	47-10-0
2-0-0	7-3-3	3-1-10	4-0-0	5-9-11	4-8-8	4-8-8	5-9-11	4-0-1	6-4-12	2-0-0

Scale = 1:85.3

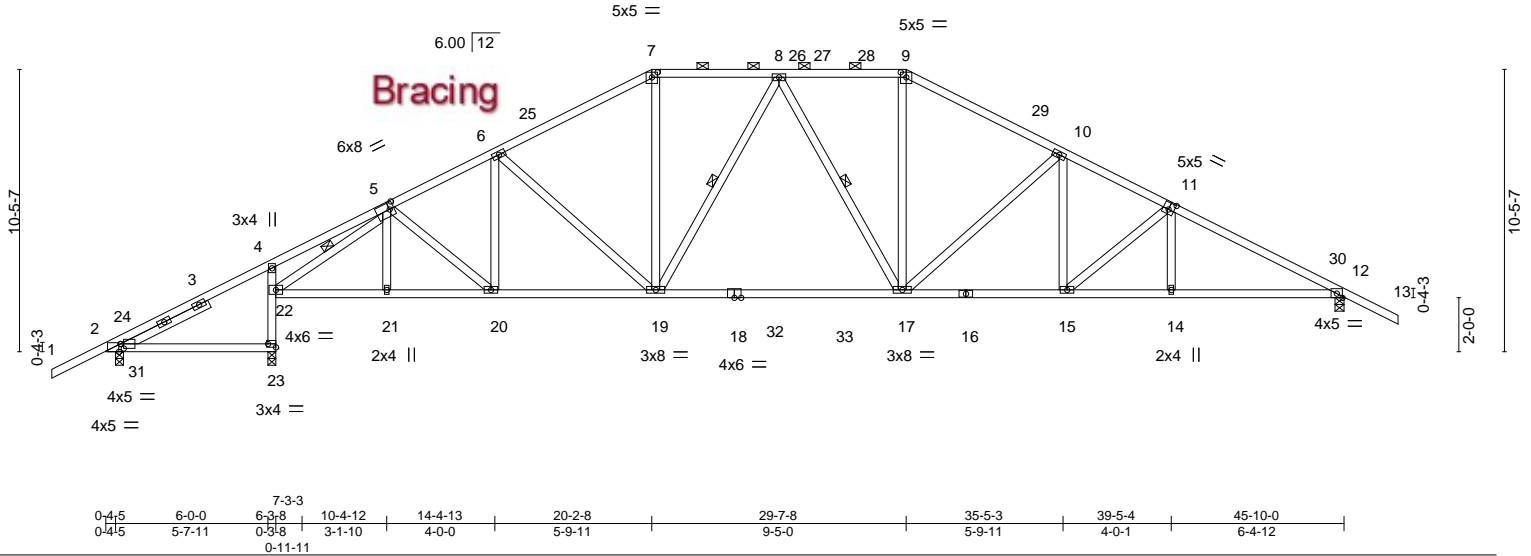


Plate Offsets (X,Y)--		[2:0-1-7,0-2-0], [2:0-0-12,Edge], [5:0-2-0,0-3-0], [7:0-2-8,0-2-4], [9:0-2-8,0-2-4], [11:0-2-8,0-3-0], [23:Edge,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL 1.25		TC 0.58		Vert(LL)	-0.31 17-19	>999	360	MT20	244/190
TCDL 10.0		Lumber DOL 1.25		BC 0.89		Vert(CT)	-0.55 17-19	>857	240		
BCLL 0.0 *		Rep Stress Incr YES		WB 0.72		Horz(CT)	0.12 12	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.08 17	>999	240	Weight: 277 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-9-6 oc purlins, except
BOT CHORD 2x4 SP No.2 *Except*	2-0-0 oc purlins (3-11-12 max.): 7-9.
18-22,16-18: 2x4 SP M 31 or 2x4 SP SS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.2	6-0-0 oc bracing: 2-23
SLIDER Left 2x4 SP No.2 3-7-5	4-1-2 oc bracing: 22-23.
	WEBS 1 Row at midpt 8-19, 8-17, 5-22

REACTIONS. (size) 2=0-3-8, 23=0-3-8, 12=0-4-0
Max Horz 2=167(LC 11)
Max Uplift 2=140(LC 12), 23=112(LC 12), 12=132(LC 12)
Max Grav 2=353(LC 23), 23=2080(LC 17), 12=1880(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 5-6=-2436/215, 6-7=-2252/228, 7-8=-1966/231, 8-9=-2093/239, 9-10=-2384/232,
10-11=-2898/241, 11-12=-3315/211
BOT CHORD 22-23=-2014/149, 4-22=-378/118, 21-22=-59/2061, 20-21=-59/2060, 19-20=-54/2246,
17-19=-26/2119, 15-17=-86/2524, 14-15=-116/2864, 12-14=-115/2866
WEBS 6-19=-310/89, 7-19=-4/736, 8-19=-384/60, 9-17=-3/769, 10-17=-662/105, 10-15=0/393,
11-15=-439/39, 5-22=-2552/90

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 20-2-8, Zone2 20-2-8 to 24-5-7, Zone1 24-5-7 to 29-7-8, Zone2 29-7-8 to 33-10-7, Zone1 33-10-7 to 47-10-0 zone; cantilever left and right exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=140, 23=112, 12=132.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

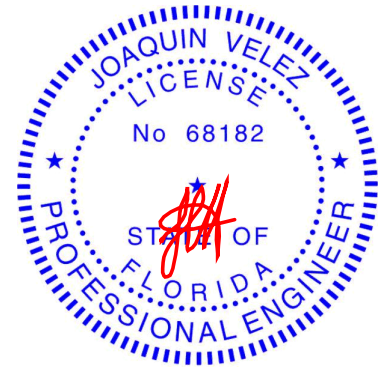

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-LLS.com

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:53 2024 Page 1
ID:Ts3RJ0261_Xu2fYqSvBHAwzZSLZ-M_D0UK4mdY0bAtQVlQFdJUNeF4tbBKtZSAT_ozvuswn

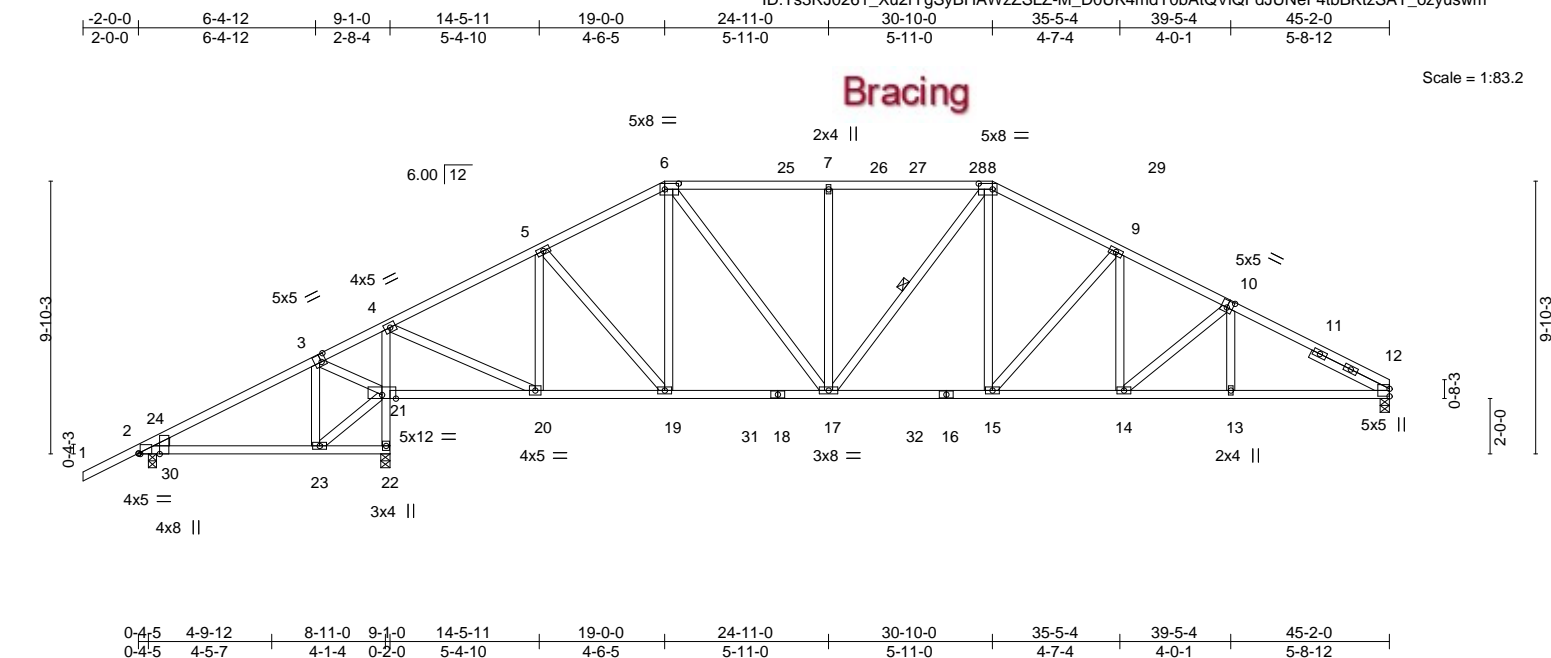


Plate Offsets (X,Y)-- [2:0-0-12,Edge], [2:0-0-4,Edge], [3:0-2-0,0-3-4], [6:0-6-0,0-2-8], [8:0-6-0,0-2-8], [10:0-2-8,0-3-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.56	Vert(LL)	-0.14	15-17	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.66	Vert(CT)	-0.26	15-17	>999	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.08	12	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.06	15	>999	240	Weight: 283 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 2-10-15 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 3-10-12 oc bracing.
WEBS	2x4 SP No.2	WEBS	1 Row at midpt 8-17
WEDGE			
Left: 2x4 SP No.2			
SLIDER	Right 2x4 SP No.2 3-1-12		

REACTIONS. (size) 2=0-3-8, 22=0-4-0, 12=0-4-0
 Max Horz 2=153(LC 11)
 Max Uplift 2=-144(LC 12), 22=-164(LC 12), 12=-61(LC 12)
 Max Grav 2=336(LC 23), 22=2242(LC 17), 12=1585(LC 18)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-27/313, 3-4=-54/850, 4-5=-1369/190, 5-6=-1628/190, 6-7=-1827/219, 7-8=-1827/219, 8-9=-2067/215, 9-10=-2432/212, 10-12=-2769/190

BOT CHORD 21-22=-2249/256, 4-21=-1986/169, 20-21=-708/89, 19-20=-15/1233, 17-19=0/1450, 15-17=19/1775, 14-15=-77/2132, 13-14=-110/2336, 12-13=-109/2340

WEBS 3-23=-32/336, 3-21=-654/173, 4-20=-112/2037, 5-20=-660/1141, 5-19=0/420, 6-17=52/709, 7-17=405/117, 8-15=0/638, 9-15=-557/87, 9-14=0/304, 10-14=-265/53

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 19-0-0, Zone2 19-0-0 to 23-2-15, Zone1 23-2-15 to 30-10-0, Zone2 30-10-0 to 35-0-15, Zone1 35-0-15 to 45-2-0 zone; cantilever left and right exposed ; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are 3x6 MT20 unless otherwise indicated.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12 except (jt=lb) 2=144, 22=164.

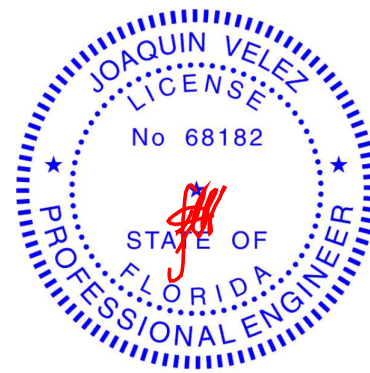

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25, 2024

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcscomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534215
6243113	A14	Hip	1	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:54 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-qAnPig5ONs8Sn1?hG8msrhvkoUAtwnM6hpCYLQyuswl

-2-0-0	6-4-12	9-1-0	17-0-0	24-11-0	32-10-0	39-5-4	45-2-0
2-0-0	6-4-12	2-8-4	7-11-0	7-11-0	7-11-0	6-7-5	5-8-12

Scale = 1:83.6

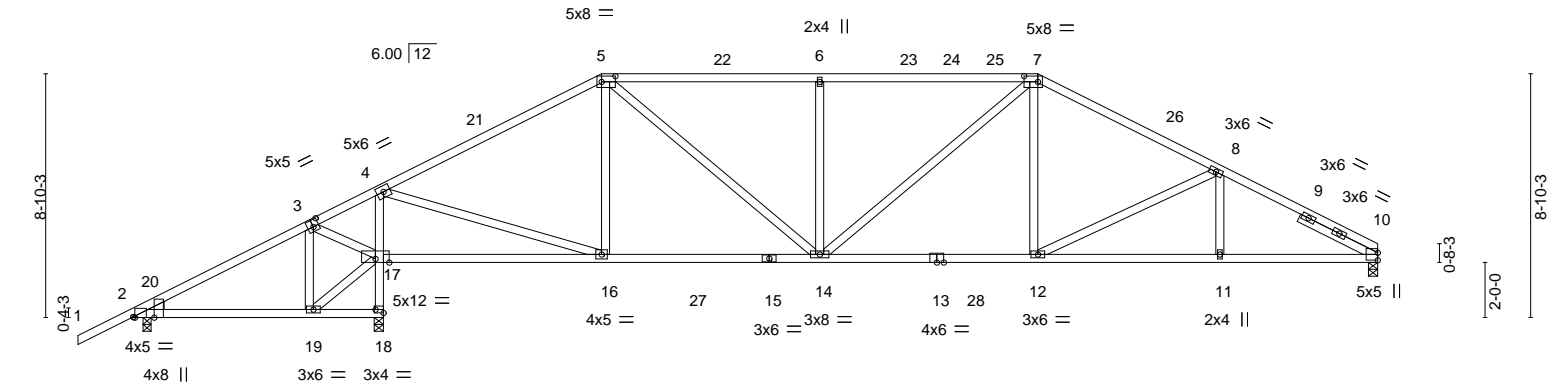

0-4-5	4-9-12	8-11-0	9-1-0	17-0-0	24-11-0	32-10-0	38-10-4	45-2-0
0-4-5	4-5-7	4-1-4	0-2-0	7-11-0	7-11-0	7-11-0	6-0-4	6-3-12

Plate Offsets (X,Y)-- [2:0-0-4,Edge], [2:0-0-12,Edge], [3:0-2-8,0-3-0], [5:0-6-0,0-2-8], [7:0-6-0,0-2-8], [18:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.89	Vert(LL)	-0.20 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.85	Vert(CT)	-0.38 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.46	Horz(CT)	0.08 10	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.07 14	>999	240	Weight: 252 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2
SLIDER Right 2x4 SP No.2 3-1-12

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 3-11-0 oc bracing.

REACTIONS.


(size) 10=0-4-0, 2=0-3-8, 18=0-4-0
Max Horz 2=137(LC 11)
Max Uplift 10=61(LC 12), 2=70(LC 12), 18=86(LC 12)
Max Grav 10=1597(LC 18), 2=360(LC 23), 18=2258(LC 17)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-31/675, 4-5=-1705/157, 5-6=-2163/225, 6-7=-2163/225, 7-8=-2311/202, 8-10=-2830/196
BOT CHORD 17-18=-2266/145, 4-17=-1906/197, 16-17=-493/46, 14-16=-1/1473, 12-14=-39/1985, 11-12=-123/2404, 10-11=-123/2404
WEBS 3-19=0/281, 3-17=-536/51, 4-16=-48/1968, 5-16=-337/116, 5-14=-71/969, 6-14=-538/148, 7-14=-20/357, 7-12=0/515, 8-12=-477/92

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 17-0-0, Zone2 17-0-0 to 21-2-15, Zone1 21-2-15 to 32-10-0, Zone2 32-10-0 to 37-0-15, Zone1 37-0-15 to 45-2-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 2, 18.

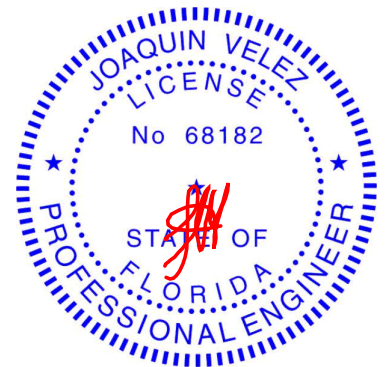

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534216
6243113	A15	Hip	1	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:54 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-qAnPig5ONs8Sn1?hG8msrhvTUETwoZ6hpCYLQyuswl

-2-0-0	6-4-12	9-1-0	15-0-0	21-7-15	28-2-1	34-10-0	39-10-4	45-2-0
2-0-0	6-4-12	2-8-4	5-11-0	6-7-15	6-6-3	6-7-15	5-0-4	5-3-12

Scale = 1:83.6

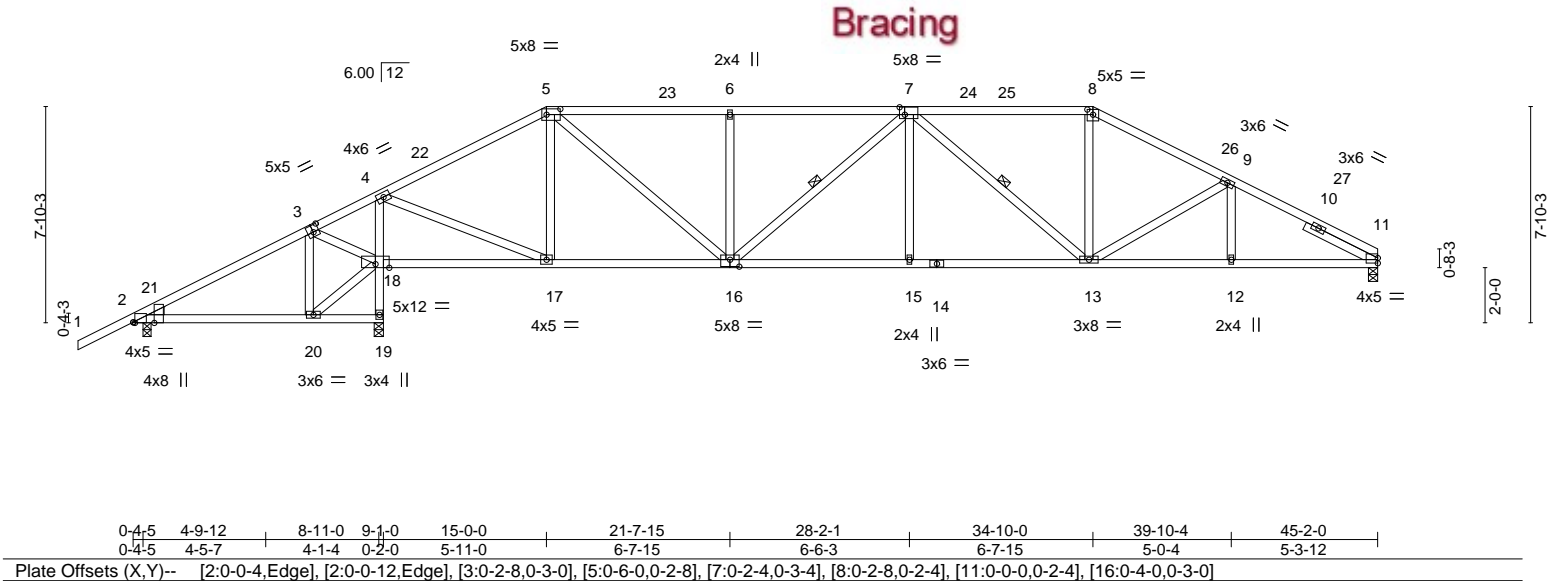

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.59	Vert(LL)	-0.14 15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.62	Vert(CT)	-0.30 15-16	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.08 11	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.08 15	>999	240	Weight: 256 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-1-8 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 4-0-10 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 7-16, 7-13
WEDGE	
Left: 2x4 SP No.2	
SLIDER Right 2x4 SP No.2 2-11-0	

REACTIONS.	(size) 11=0-4-0, 2=0-3-8, 19=0-4-0
Max Horz	2=120(LC 11)
Max Uplift	11=61(LC 12), 2=70(LC 12), 19=87(LC 12)
Max Grav	11=1390(LC 1), 2=272(LC 23), 19=2090(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-46/364, 3-4=-42/958, 4-5=-1256/137, 5-6=-1954/212, 6-7=-1954/212, 7-8=-1861/205, 8-9=-2110/204, 9-11=-2463/193
BOT CHORD	2-20=-295/33, 18-19=-2097/148, 4-18=-1923/176, 17-18=-788/74, 16-17=0/1029, 15-16=-83/2224, 13-15=-83/2224, 12-13=-120/2075, 11-12=-120/2075
WEBS	3-20=0/360, 18-20=-362/55, 3-18=-681/69, 4-17=-79/1976, 5-17=-600/110, 5-16=-86/1237, 6-16=-419/120, 7-16=-375/31, 7-15=0/265, 7-13=-584/35, 8-13=0/571, 9-13=-276/73

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 15-0-0, Zone2 15-0-0 to 19-2-15, Zone1 19-2-15 to 34-10-0, Zone2 34-10-0 to 39-0-15, Zone1 39-0-15 to 45-2-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 2, 19.



Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534217
6243113	A16	Roof Special	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:55 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-IMLnV0618AGJPBauqrH5OvSw1uWPf8TGvTy5tsyuswk

-2-0-0	6-4-11	13-0-0	20-11-15	28-10-1	36-10-0	37-7-8	41-6-0	45-6-4	49-10-0
2-0-0	6-4-11	6-7-4	7-11-15	7-10-3	7-11-15	0-9-8	3-10-8	4-0-4	4-3-12

Scale = 1:90.4

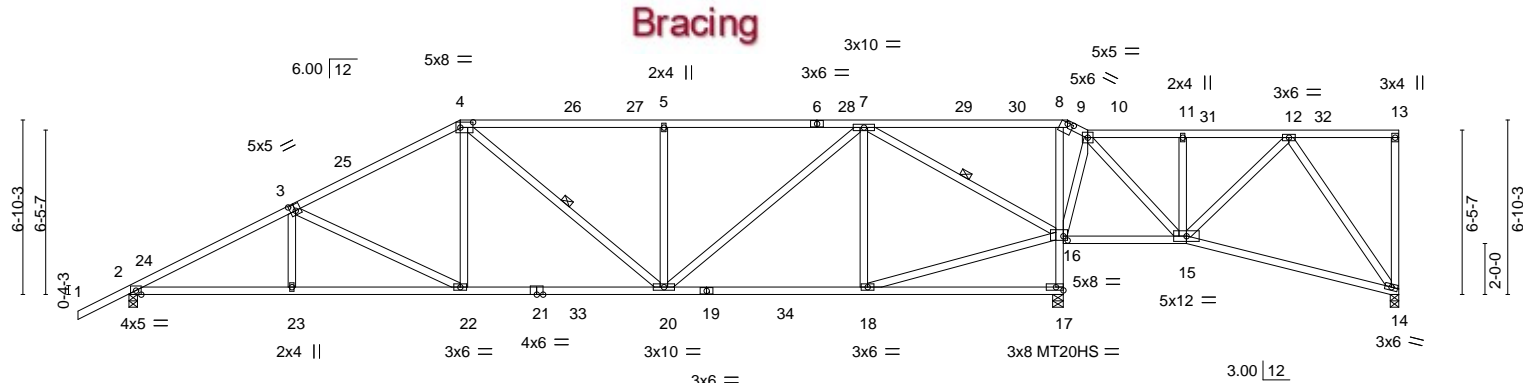

	6-4-11	13-0-0	20-11-15	28-10-1	36-5-8	36-8-0	41-6-0	49-10-0
	6-4-11	6-7-4	7-11-15	7-10-3	7-7-7	0-2-8	4-10-0	8-4-0
Plate Offsets (X,Y)--	[3:0-2-8,0-3-0], [4:0-6-0,0-2-8], [9:0-3-0,0-0-7], [16:0-2-0,0-2-0]							


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.80	Vert(LL)	-0.20 20-22	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.83	Vert(CT)	-0.37 20-22	>999	240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.85	Horz(CT)	0.08 17	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.07 22	>999	240	Weight: 308 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 3-5-15 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 4-20, 7-16

REACTIONS. (size) 14=0-4-0, 2=0-4-0, 17=0-5-0
Max Horz 2=182(LC 12)
Max Uplift 14=-41(LC 9), 2=-105(LC 12), 17=-133(LC 12)
Max Grav 14=197(LC 24), 2=1616(LC 17), 17=2766(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2770/162, 3-4=-2123/160, 4-5=-1816/150, 5-7=-1816/150, 7-8=-90/1159,
8-9=-97/1165, 9-10=-139/1314, 10-11=-63/390, 11-12=-63/389
BOT CHORD 2-23=-270/2428, 22-23=-272/2423, 20-22=-174/1848, 18-20=-51/916, 16-17=-2650/280,
8-16=-831/211, 15-16=-1087/111
WEBS 3-23=0/269, 3-22=-655/109, 4-22=0/591, 5-20=-515/152, 7-20=-115/1169,
16-18=-69/925, 7-16=-2416/176, 10-16=-312/14, 10-15=-73/1045, 12-15=-475/106

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 13-0-0, Zone2 13-0-0 to 17-2-15, Zone1 17-2-15 to 36-10-0, Zone3 36-10-0 to 37-7-8, Zone1 37-7-8 to 49-8-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14 except (jt=lb) 2=105, 17=133.

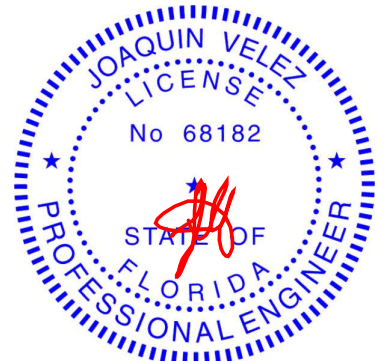

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534218
6243113	A17	Half Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:56 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAwZSLZ-mZv97M7fvTPA1L94NZoKw6?7DIubOeGP87hfPlyuswj

-2-0-0	6-4-12	11-0-0	17-5-0	23-10-0	30-3-0	36-8-0	41-6-0	45-6-4	49-10-0
2-0-0	6-4-12	4-7-4	6-5-0	6-5-0	6-5-0	6-5-0	4-10-0	4-0-4	4-3-12

Scale = 1:88.9

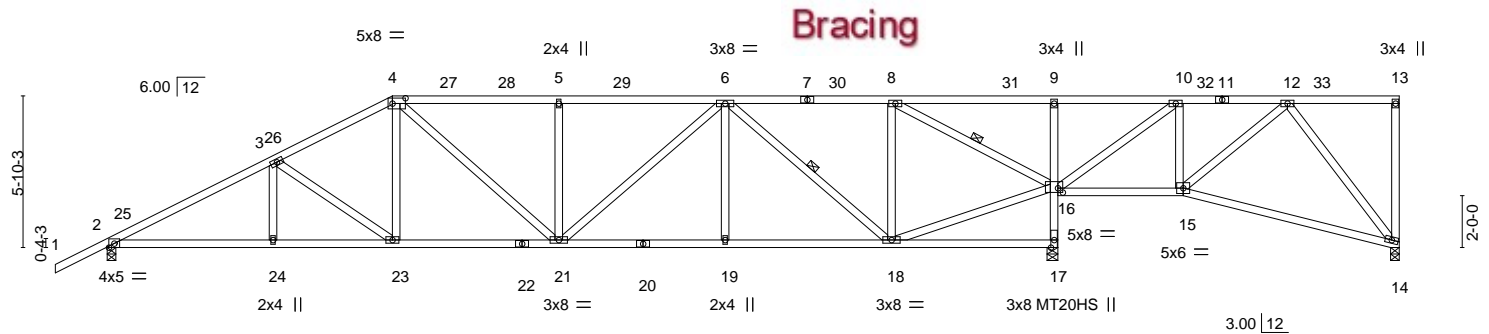


Plate Offsets (X,Y)--	[4:0-6-0,0-2-8], [16:0-2-4,0-2-0]
-----------------------	-----------------------------------


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.64	Vert(LL)	-0.17 14-15	>931	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.64	Vert(CT)	-0.34 14-15	>464	240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.69	Horz(CT)	0.09 17	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.08 21	>999	240	Weight: 300 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-1-9 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 3-8-8 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 6-18, 8-16

REACTIONS.	(size) 14=0-4-0, 2=0-4-0, 17=0-5-0
Max Horz	2=168(LC 12)
Max Uplift	14=-45(LC 9), 2=-109(LC 12), 17=-124(LC 12)
Max Grav	14=172(LC 1), 2=1459(LC 1), 17=2461(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2448/142, 3-4=-2016/154, 4-5=-2013/156, 5-6=-2013/156, 6-8=-707/38, 8-9=-96/1247, 9-10=-100/1257, 10-12=-46/323
BOT CHORD	2-24=-224/2096, 23-24=-224/2096, 21-23=-160/1750, 19-21=-112/1651, 18-19=-112/1651, 16-17=-2405/199, 9-16=-352/94, 15-16=-341/45
WEBS	3-23=-431/77, 4-23=0/398, 4-21=-6/348, 5-21=-411/121, 6-21=-58/479, 6-19=0/250, 6-18=-1248/100, 8-18=0/725, 16-18=-48/749, 8-16=-2246/151, 10-16=-1137/68, 10-15=0/436, 12-15=-434/84

- NOTES-**
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 2-0-0 to 1-0-0, Zone1 1-0-0 to 11-0-0, Zone2 11-0-0 to 15-2-15, Zone1 15-2-15 to 49-8-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 3x6 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14 except (jt=lb) 2=109, 17=124.

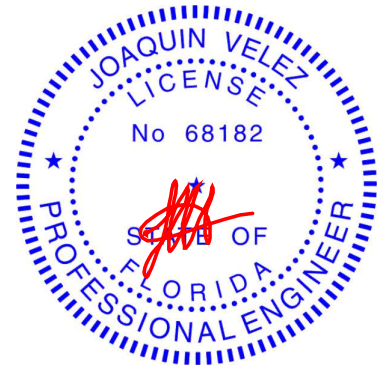

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534219
6243113	A18	Half Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,


8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:56 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-mZv97M7fvTPA1L94NZoKw6?6FlujOeeP87hfPlyuswj

-2-0-0	6-4-12	9-0-0	15-11-0	22-10-0	29-9-0	36-8-0	41-6-0	45-6-4	49-10-0
2-0-0	6-4-12	2-7-4	6-11-0	6-11-0	6-11-0	6-11-0	4-10-0	4-0-4	4-3-12

Scale = 1:88.9

Bracing

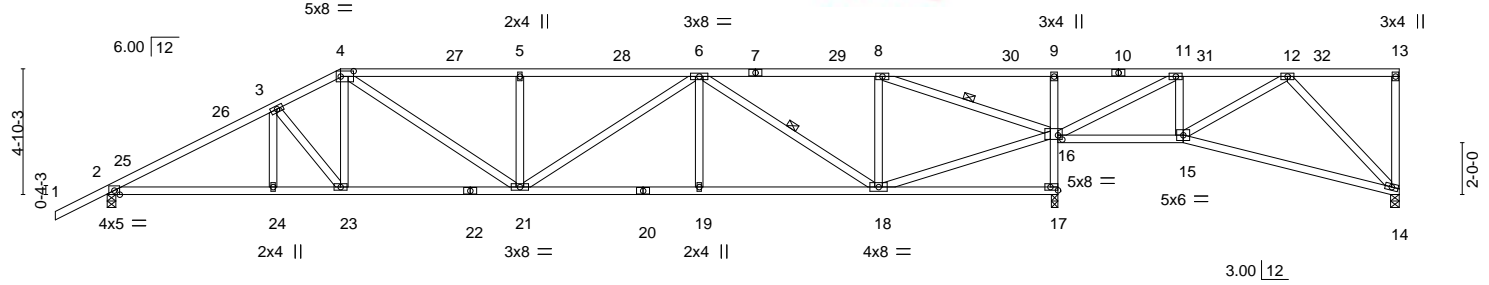

6-4-12	9-0-0	15-11-0	22-10-0	29-9-0	36-6-8	36-8-0	41-6-0	49-10-0
6-4-12	2-7-4	6-11-0	6-11-0	6-11-0	6-9-8	0-1-8	4-10-0	8-4-0

Plate Offsets (X,Y)-- [4:0-6-0,0-2-8], [16:0-2-0,0-2-0], [17:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.77	Vert(LL)	-0.18 19-21	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.70	Vert(CT)	-0.38 19-21	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.67	Horz(CT)	0.10 17	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.11 19-21	>999	240	Weight: 284 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 3-8-14 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 6-18, 8-16

REACTIONS. (size) 14=0-4-0, 2=0-4-0, 17=0-3-0
Max Horz 2=144(LC 12)
Max Uplift 14=-43(LC 9), 2=-114(LC 12), 17=-114(LC 12)
Max Grav 14=238(LC 1), 2=1484(LC 1), 17=2370(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2492/156, 3-4=-2207/174, 4-5=-2545/184, 5-6=-2545/184, 6-8=-1143/63, 8-9=-93/1368, 9-11=-103/1396
BOT CHORD 2-24=-210/2134, 23-24=-210/2134, 21-23=-165/1945, 19-21=-145/2256, 18-19=-145/2256, 16-17=-2309/187, 9-16=-375/99, 15-16=-261/41
WEBS 3-23=-312/69, 4-23=0/366, 4-21=-33/719, 5-21=-444/130, 6-21=-46/346, 6-19=0/269, 6-18=-1333/100, 8-18=0/587, 16-18=-77/1204, 8-16=-2684/165, 11-16=-1284/70, 11-15=0/387, 12-15=-380/84

NOTES-

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 49-8-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14 except (jt=lb) 2=114, 17=114.

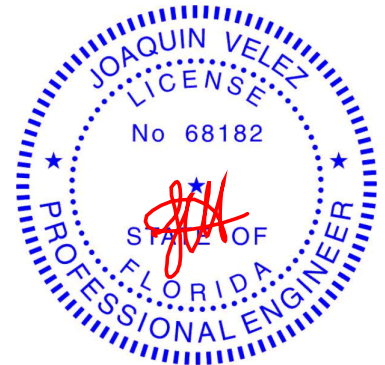

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:26:59 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-B7aHIO9XCOnluof3hM1YkdfhVvEbZ7qg5wJ0dyuswg
|-2-0-0| 7-0-0 | 12-11-3 | 18-10-6 | 24-9-10 | 30-8-13 | 36-8-0 | 42-7-0 | 46-0-12 | 49-10-0 |
|2-0-0| 7-0-0 | 5-11-3 | 5-11-3 | 5-11-3 | 5-11-3 | 5-11-3 | 5-11-0 | 3-5-12 | 3-9-4 |
Scale = 1:88

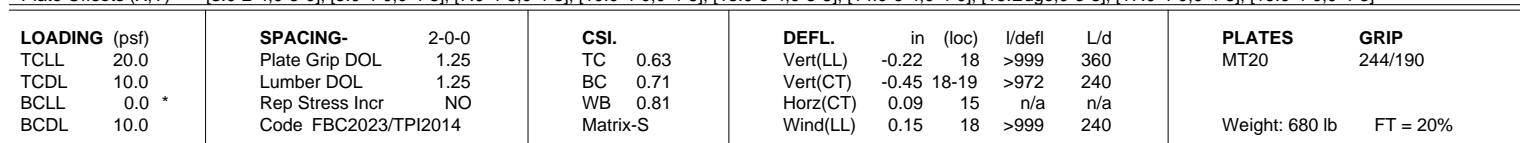

REACTIONS. (size) 12=0-4-0, 2=0-4-0, 15=0-3-0
 Max Horz 2=119(LC 27)
 Max Uplift 12=-34(LC 5), 2=-181(LC 8), 15=-318(LC 8)
 Max Grav 12=901(LC 20), 2=2758(LC 1), 15=4624(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-5363/226, 3-4=-7071/436, 4-5=-7069/435, 5-6=-6462/441, 6-7=-6602/441,
7-8=-144/2472, 8-9=-749/25, 9-10=-714/11, 11-12=-358/54


BOT CHORD 2-20=-227/4708, 19-20=-219/4728, 18-19=-500/7605, 17-18=-500/7605, 16-17=-217/3294,
14-15=-4496/383, 8-14=-1847/287, 13-14=-2442/167, 12-13=-77/640

WEBS 3-20=0/681, 3-19=-250/2780, 4-19=-809/247, 5-19=-651/74, 5-18=0/517, 5-17=-1316/67,
6-17=-838/264, 7-17=-257/3628, 7-16=-909/252, 14-16=-246/3611, 7-14=-5973/382,
8-13=-155/3281, 9-13=-398/162, 10-12=-757/91

NOTES-

- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - 3) Unbalanced roof live loads have been considered for this design.
 - 4) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 6) Provide adequate drainage to prevent water ponding.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12 except (jt=lb) 2=181, 1=318.

Continued on page 2

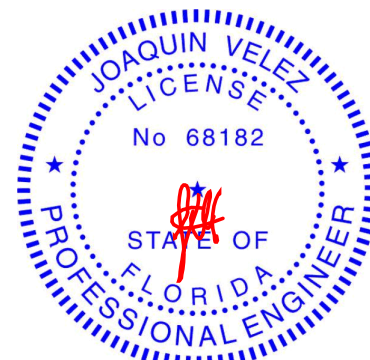

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25, 2024



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534220
6243113	A19	Half Hip Girder	1	2	Job Reference (optional)	

NOTES-

11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 141 lb down and 86 lb up at 7-0-0, 122 lb down and 83 lb up at 9-0-12, 122 lb down and 83 lb up at 11-0-12, 122 lb down and 83 lb up at 13-0-12, 122 lb down and 83 lb up at 15-0-12, 122 lb down and 83 lb up at 17-0-12, 122 lb down and 83 lb up at 19-0-12, 122 lb down and 83 lb up at 21-0-12, 122 lb down and 83 lb up at 23-0-12, 122 lb down and 83 lb up at 25-0-12, 122 lb down and 83 lb up at 27-9-9, 122 lb down and 83 lb up at 29-9-9, 122 lb down and 83 lb up at 31-9-9, 122 lb down and 83 lb up at 33-9-9, 122 lb down and 83 lb up at 35-9-9, 122 lb down and 83 lb up at 37-9-9, 122 lb down and 83 lb up at 39-9-9, 122 lb down and 83 lb up at 41-9-9, 182 lb down and 48 lb up at 43-9-9, 49 lb down and 35 lb up at 45-9-4, and 142 lb down and 71 lb up at 47-9-4, and 220 lb down and 30 lb up at 49-8-4 on top chord, and 310 lb down at 7-0-0, 95 lb down at 9-0-12, 95 lb down at 11-0-12, 95 lb down at 13-0-12, 95 lb down at 15-0-12, 95 lb down at 17-0-12, 95 lb down at 19-0-12, 95 lb down at 21-0-12, 95 lb down at 23-0-12, 95 lb down at 25-0-12, 95 lb down at 25-9-0, 95 lb down at 27-9-9, 95 lb down at 29-9-9, 95 lb down at 31-9-9, 95 lb down at 33-9-9, 95 lb down at 35-9-9, 95 lb down at 37-9-9, 95 lb down at 39-9-9, 95 lb down at 41-9-9, at 43-9-9, and 165 lb down at 45-9-4, and 56 lb down at 47-9-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-60, 3-11=-60, 2-15=-20, 13-14=-20, 12-13=-20

Concentrated Loads (lb)

Vert: 3=-122(B) 11=-220 20=-262(B) 19=-48(B) 4=-122(B) 5=-122(B) 18=-48(B) 17=-48(B) 6=-122(B) 10=-5(B) 21=-122(B) 22=-122(B) 23=-122(B) 24=-122(B) 26=-122(B) 27=-122(B) 28=-122(B) 29=-122(B) 30=-122(B) 31=-122(B) 32=-122(B) 34=-122(B) 35=-122(B) 36=-122(B) 37=-122(B) 38=-182(B) 39=-142(B) 40=-48(B) 41=-48(B) 42=-48(B) 43=-48(B) 44=-48(B) 45=-48(B) 46=-48(B) 47=-48(B) 48=-48(B) 49=-48(B) 50=-48(B) 51=-48(B) 52=-48(B) 53=-48(B) 54=-48(B) 56=-165(B) 57=-28(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534221
6243113	B01	Common	9	1		

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:00 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-fK8gyjA9zivbVyTrcPtG5y9ujvJFKa3?3lfsY3yuswf
15-5-4 18-9-8 23-10-0 25-10-0
3-6-3 3-4-4 5-0-8 2-0-0
Scale = 1:44.6

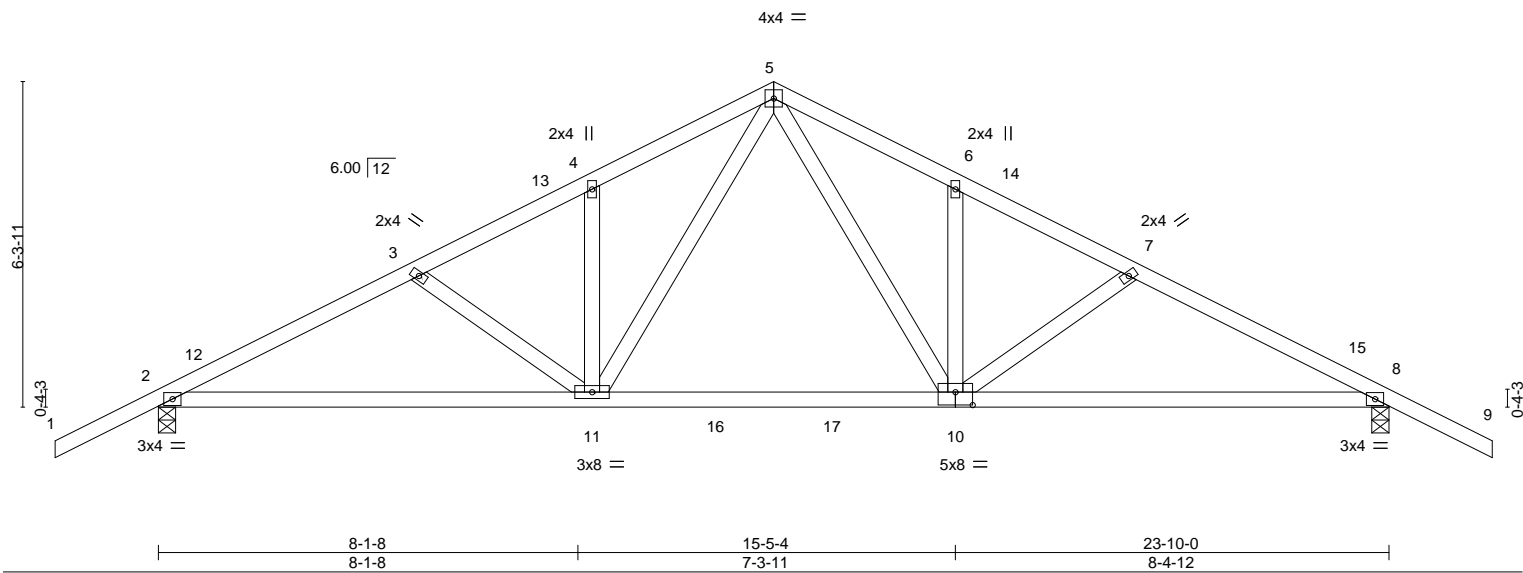


Plate Offsets (X,Y)--		[10:0-4-0,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.35	Vert(LL)	-0.11 2-11	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.47	Vert(CT)	-0.29 10-11	>981	240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.19	Horz(CT)	0.05 8	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.04 10-11	>999	240	Weight: 126 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-11-2 oc purlins.
BOT CHORD 2x4 SP M 31 or 2x4 SP SS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 2=0-4-0, 8=0-4-0
Max Horz 2=-114(LC 10)
Max Grav 2=1298(LC 17), 8=1298(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2069/0, 3-4=-1864/0, 4-5=-1870/0, 5-6=-1870/0, 6-7=-1864/0, 7-8=-2070/0
BOT CHORD 2-11=0/1859, 10-11=0/1242, 8-10=0/1774
WEBS 5-10=0/885, 5-11=0/885

NOTES-
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 11-11-0, Zone2 11-11-0 to 16-1-15, Zone1 16-1-15 to 25-10-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
6) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified.
Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 5-9=-60, 2-11=-20, 10-11=-60, 8-10=-20
2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-50, 5-9=-50, 2-11=-35, 11-16=-75, 16-17=-90, 10-17=-75, 8-10=-35
3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-9=-20, 2-11=-40, 10-11=-80, 8-10=-40
4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60

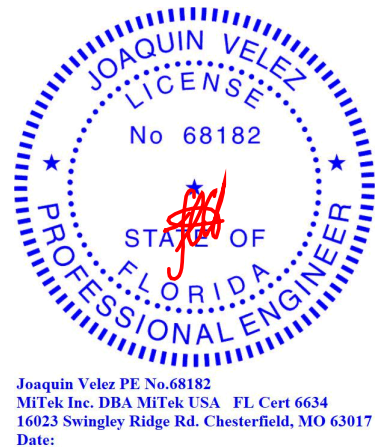

July 25,2024

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534221
6243113	B01	Common	9	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:00 2024 Page 2
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-fK8gyjA9zivbVyTrcPtG5y9ujvJFKa3?3lfsY3yuswf

LOAD CASE(S) Standard

- Uniform Loads (plf)
- Vert: 1-2=47, 2-12=32, 5-12=17, 5-14=26, 8-14=17, 8-9=12, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-55, 2-12=-40, 5-12=-25, 5-14=35, 8-14=25, 8-9=21
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=12, 2-13=17, 5-13=26, 5-15=17, 8-15=32, 8-9=47, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-21, 2-13=-25, 5-13=-35, 5-15=25, 8-15=40, 8-9=55
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-8, 2-5=-32, 5-8=-32, 8-9=-28, 2-11=-20, 10-11=-60, 8-10=-20
- Horz: 1-2=-12, 2-5=12, 5-8=-12, 8-9=-8
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-28, 2-5=-32, 5-8=-32, 8-9=-8, 2-11=-20, 10-11=-60, 8-10=-20
- Horz: 1-2=8, 2-5=12, 5-8=-12, 8-9=12
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=15, 2-5=3, 5-8=9, 8-9=4, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-24, 2-5=-11, 5-8=17, 8-9=13
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=4, 2-5=9, 5-8=3, 8-9=15, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-13, 2-5=-17, 5-8=11, 8-9=24
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-24, 2-5=-28, 5-8=-12, 8-9=-7, 2-11=-20, 10-11=-60, 8-10=-20
- Horz: 1-2=4, 2-5=8, 5-8=8, 8-9=13
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-7, 2-5=-12, 5-8=-28, 8-9=-24, 2-11=-20, 10-11=-60, 8-10=-20
- Horz: 1-2=-13, 2-5=-8, 5-8=-8, 8-9=-4
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=28, 2-5=15, 5-8=15, 8-9=28, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-37, 2-5=-24, 5-8=24, 8-9=37
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=15, 2-5=3, 5-8=3, 8-9=15, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-24, 2-5=-11, 5-8=11, 8-9=24
- 14) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-16, 2-5=-21, 5-8=-21, 8-9=-16, 2-11=-20, 10-11=-60, 8-10=-20
- Horz: 1-2=-4, 2-5=1, 5-8=-1, 8-9=4
- 15) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-16, 2-5=-21, 5-8=-21, 8-9=-16, 2-11=-20, 10-11=-60, 8-10=-20
- Horz: 1-2=-4, 2-5=1, 5-8=-1, 8-9=4
- 16) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-5=-20, 5-9=-20, 2-11=-40, 11-16=-80, 16-17=-100, 10-17=-80, 8-10=-40
- 17) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-53, 2-5=-56, 5-8=-44, 8-9=-40, 2-11=-35, 11-16=-75, 16-17=90, 10-17=-75, 8-10=35
- Horz: 1-2=3, 2-5=6, 5-8=6, 8-9=10
- 18) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-40, 2-5=-44, 5-8=-56, 8-9=-53, 2-11=-35, 11-16=-75, 16-17=90, 10-17=-75, 8-10=35
- Horz: 1-2=-10, 2-5=-6, 5-8=-6, 8-9=3
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-47, 2-5=-51, 5-8=-51, 8-9=-47, 2-11=-35, 11-16=-75, 16-17=90, 10-17=-75, 8-10=35
- Horz: 1-2=-3, 2-5=1, 5-8=-1, 8-9=3
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-47, 2-5=-51, 5-8=-51, 8-9=-47, 2-11=-35, 11-16=-75, 16-17=90, 10-17=-75, 8-10=35
- Horz: 1-2=-3, 2-5=1, 5-8=-1, 8-9=3
- 21) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=8, 2-5=-25, 5-9=-25, 2-11=-12, 10-11=-52, 8-10=-12
- Horz: 1-2=-16, 2-5=16, 5-9=-16
- 22) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534221
6243113	B01	Common	9	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:00 2024 Page 3
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-fK8gyjA9zivbVyTrcPtG5y9ujvJFKa3?3lfsY3yuswf

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-5=8, 5-9=8, 2-11=-12, 10-11=-52, 8-10=-12
Horz: 1-5=-16, 5-9=16
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 5-9=-20, 2-11=-20, 10-11=-60, 8-10=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-9=-60, 2-11=-20, 10-11=-60, 8-10=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-50, 5-9=-20, 2-11=-35, 11-16=-75, 16-17=-90, 10-17=-75, 8-10=-35
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-9=-50, 2-11=-35, 11-16=-75, 16-17=-90, 10-17=-75, 8-10=-35

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534222
6243113	B01X	Common Supported Gable	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:00 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-fK8gyjA9zivbVyTrcPtG5y9v9vP0Kbz?3lfsY3yuswf



Scale = 1:44.6

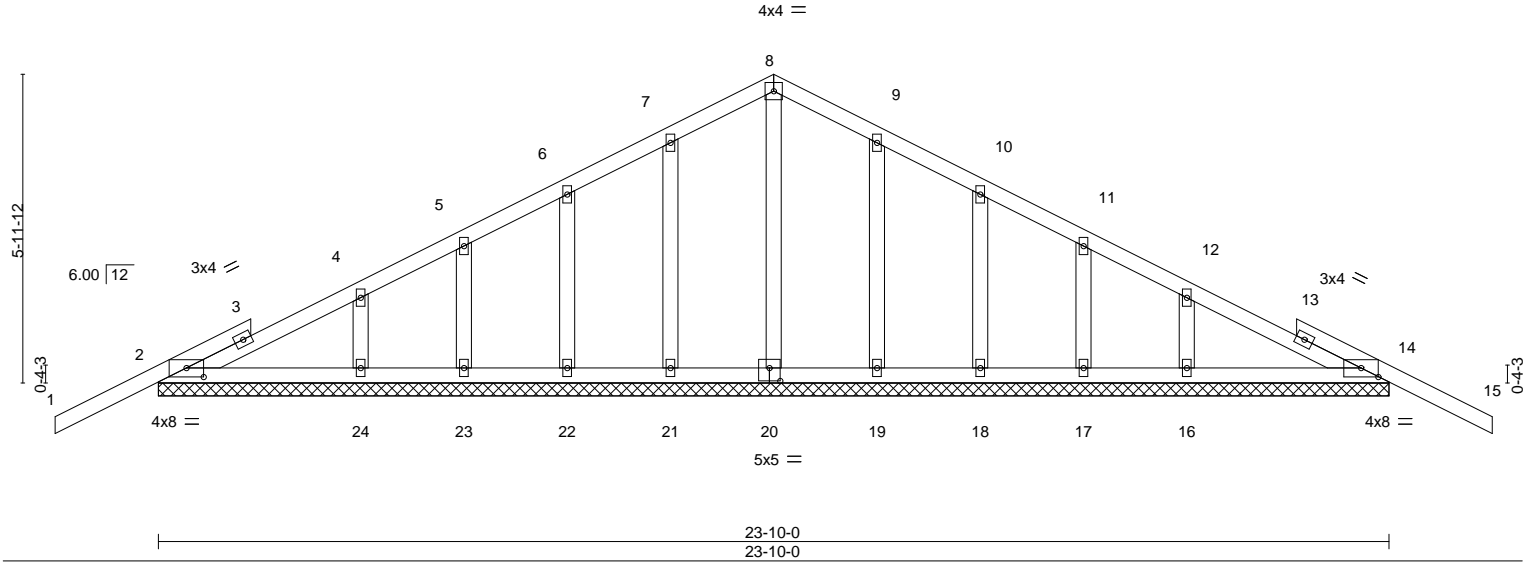


Plate Offsets (X,Y)--		[2:0-4-0,0-2-1], [14:0-4-0,0-2-1], [20:0-2-8,0-3-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.26	Vert(LL)	-0.01	15	n/r	120	MT20	244/190	
TCDL 10.0	Lumber DOL	1.25	BC 0.10	Vert(CT)	-0.02	15	n/r	120			
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	14	n/a	n/a			
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S						Weight: 129 lb	FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS	2x4 SP No.2		

REACTIONS. All bearings 23-10-0.
(lb) - Max Horz 2=109(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 21, 22, 23, 19, 18, 17
Max Grav All reactions 250 lb or less at joint(s) 20, 21, 22, 23, 19, 18, 17 except 2=285(LC 23), 14=286(LC 24), 24=250(LC 23), 16=250(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 21, 22, 23, 19, 18, 17.

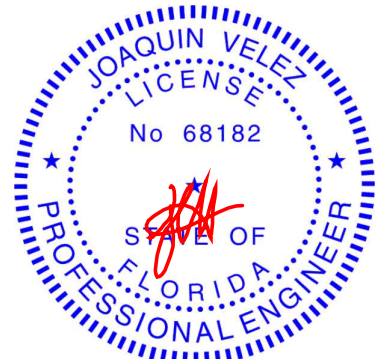

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534223
6243113	B02	Roof Special	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:01 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-7Wl2A3Ank01S7611A6OVd9i?rJeH3zq8lPPQ5WYuswe

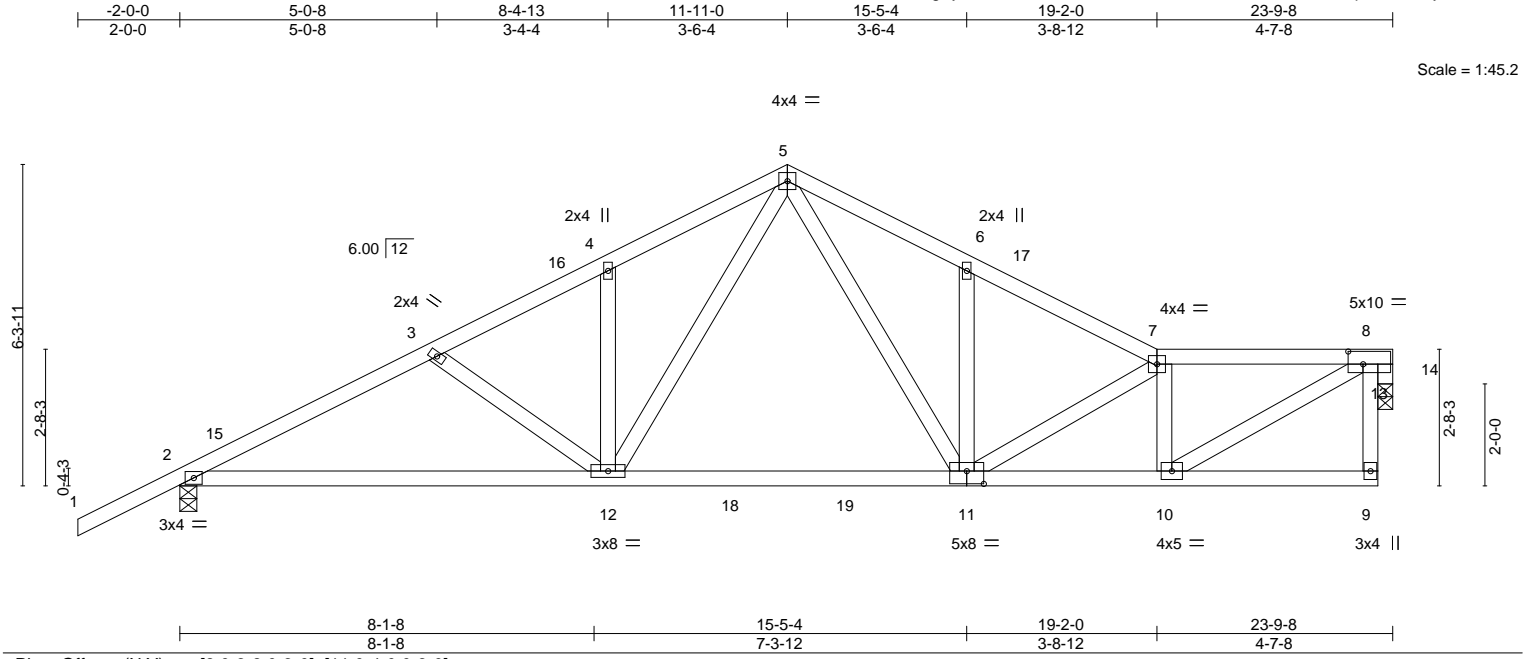


Plate Offsets (X,Y)--		[8:0-3-8,0-3-0], [11:0-4-0,0-3-0]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.58	Vert(LL)	-0.10	11-12	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.48	Vert(CT)	-0.31	11-12	>904	240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.41	Horz(CT)	0.02	14	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.04	11-12	>999	240	Weight: 134 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP M 31 or 2x4 SP SS
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-4-0, 14=0-3-8
Max Horz 2=92(LC 12)
Max Grav 2=1304(LC 17), 14=1132(LC 19)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2085/0, 3-4=-1880/0, 4-5=-1887/0, 5-6=-1870/0, 6-7=-1862/0, 7-8=-1757/0
BOT CHORD 2-12=0/1849, 11-12=0/1227, 10-11=0/1812
WEBS 5-12=0/897, 5-11=0/882, 7-10=-904/0, 8-10=0/1837, 8-14=-1311/0

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 11-11-0, Zone2 11-11-0 to 16-1-15, Zone1 16-1-15 to 23-4-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 5-7=-60, 7-8=-60, 2-12=-20, 11-12=-60, 9-11=-20
- Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-50, 5-7=-50, 7-8=-50, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35

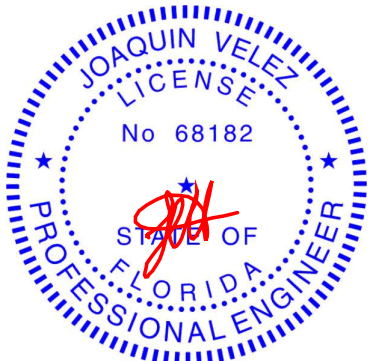

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534223
6243113	B02	Roof Special	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:01 2024 Page 2
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-7Wi2A3Ank01S7611A6OVd9i?rJeH3zq8IPQ5Wyuwse

LOAD CASE(S) Standard

- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-7=-20, 7-8=-20, 2-12=-40, 11-12=-80, 9-11=-40
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=47, 2-15=32, 5-15=17, 5-17=26, 7-17=17, 7-8=17, 2-12=-12, 11-12=-52, 9-11=-12
Horz: 1-2=-55, 2-15=-40, 5-15=-25, 5-17=35, 7-17=25
Drag: 7-8=0
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=12, 2-16=17, 5-16=26, 5-7=17, 7-8=17, 2-12=-12, 11-12=-52, 9-11=-12
Horz: 1-2=-21, 2-16=-25, 5-16=-35, 5-7=25
Drag: 7-8=0
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-8, 2-5=-32, 5-7=-32, 7-8=-32, 2-12=-20, 11-12=-60, 9-11=-20
Horz: 1-2=-12, 2-5=12, 5-7=-12
Drag: 7-8=0
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-28, 2-5=-32, 5-7=-32, 7-8=-32, 2-12=-20, 11-12=-60, 9-11=-20
Horz: 1-2=8, 2-5=12, 5-7=-12
Drag: 7-8=0
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-5=3, 5-7=9, 7-8=8, 2-12=-12, 11-12=-52, 9-11=-12
Horz: 1-2=-24, 2-5=-11, 5-7=17
Drag: 7-8=0
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=4, 2-5=9, 5-7=3, 7-8=18, 2-12=-12, 11-12=-52, 9-11=-12
Horz: 1-2=-13, 2-5=-17, 5-7=11
Drag: 7-8=0
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-24, 2-5=-28, 5-7=-12, 7-8=-21, 2-12=-20, 11-12=-60, 9-11=-20
Horz: 1-2=4, 2-5=8, 5-7=8
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-5=-12, 5-7=-28, 7-8=-21, 2-12=-20, 11-12=-60, 9-11=-20
Horz: 1-2=-13, 2-5=-8, 5-7=-8
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=28, 2-5=15, 5-7=15, 7-8=15, 2-12=-12, 11-12=-52, 9-11=-12
Horz: 1-2=-37, 2-5=-24, 5-7=24
Drag: 7-8=0
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-5=3, 5-7=3, 7-8=3, 2-12=-12, 11-12=-52, 9-11=-12
Horz: 1-2=-24, 2-5=-11, 5-7=11
Drag: 7-8=0
- 14) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-16, 2-5=-21, 5-7=-21, 7-8=-21, 2-12=-20, 11-12=-60, 9-11=-20
Horz: 1-2=-4, 2-5=1, 5-7=-1
- 15) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-16, 2-5=-21, 5-7=-21, 7-8=-21, 2-12=-20, 11-12=-60, 9-11=-20
Horz: 1-2=-4, 2-5=1, 5-7=-1
- 16) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-7=-20, 7-8=-20, 2-12=-40, 12-18=-80, 18-19=-100, 11-19=-80, 9-11=-40
- 17) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-53, 2-5=-56, 5-7=-44, 7-8=-51, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35
Horz: 1-2=3, 2-5=6, 5-7=6
- 18) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-5=-44, 5-7=-56, 7-8=-51, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35
Horz: 1-2=-10, 2-5=-6, 5-7=-6
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534223
6243113	B02	Roof Special	1	1	Job Reference (optional)	

- LOAD CASE(S)** Standard
- Uniform Loads (plf)
- Vert: 1-2=-47, 2-5=-51, 5-7=-51, 7-8=-51, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35
- Horz: 1-2=-3, 2-5=1, 5-7=-1
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-47, 2-5=-51, 5-7=-51, 7-8=-51, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35
- Horz: 1-2=-3, 2-5=1, 5-7=-1
- 21) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=8, 2-5=-25, 5-7=-25, 7-8=-25, 2-12=-12, 11-12=-52, 9-11=-12
- Horz: 1-2=-16, 2-5=16, 5-7=-16
- Drag: 7-8=0
- 22) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-5=8, 5-7=8, 7-8=8, 2-12=-12, 11-12=-52, 9-11=-12
- Horz: 1-5=-16, 5-7=16
- Drag: 7-8=0
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-5=-60, 5-7=-20, 7-8=-20, 2-12=-20, 11-12=-60, 9-11=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-5=-20, 5-7=-60, 7-8=-60, 2-12=-20, 11-12=-60, 9-11=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-5=-50, 5-7=-20, 7-8=-20, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-5=-20, 5-7=-50, 7-8=-50, 2-12=-35, 12-18=-75, 18-19=-90, 11-19=-75, 9-11=-35

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534224
6243113	C1	Corner Jack	4	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:01 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAwZSLZ-7Wi2A3Ank01S7611A6OVd9i4WJle33G8IPQ5WYuswe

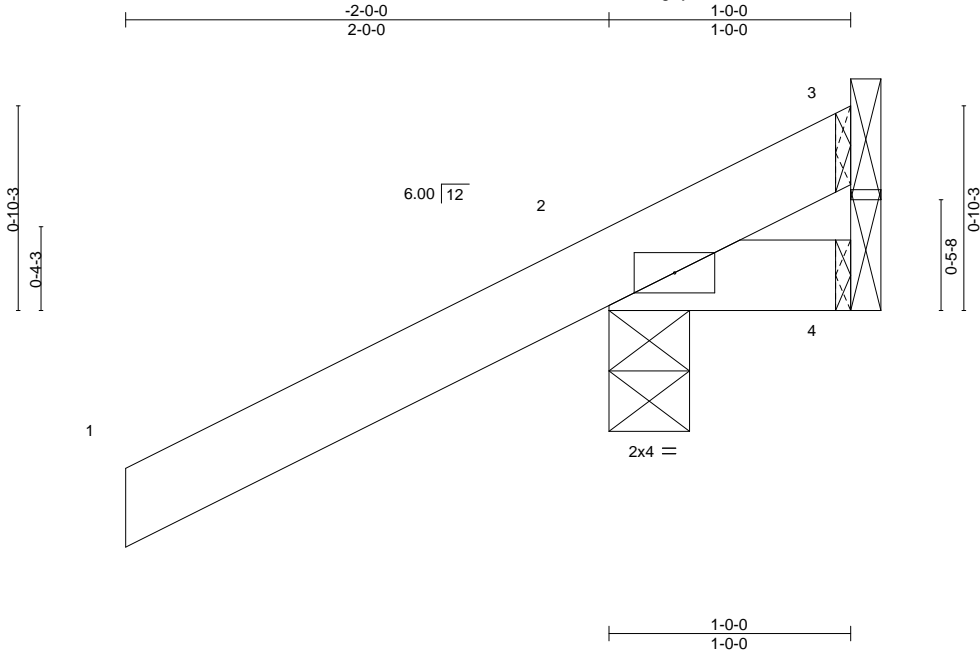

Scale = 1:9.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29	Vert(LL)	-0.00	2	>999	360	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.01	Vert(CT)	-0.00	2	>999	240	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240	
									Weight: 7 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=48(LC 12)
Max Uplift 3=101(LC 1), 2=134(LC 12)
Max Grav 3=68(LC 12), 2=290(LC 1), 4=19(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 3=101, 2=134.

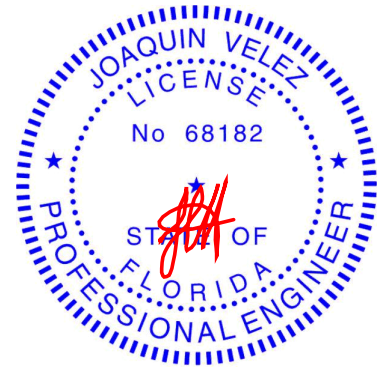

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534225
6243113	C3	Corner Jack	4	1		
Job Reference (optional)						

Tibbetts Lumber Co., LLC (Ocala, FL),
Ocala, FL - 34472,
8.730 s Jul 11 2024 MiTek Industries, Inc.
Wed Jul 24 11:27:02 2024
Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-biGQNPBQVJ9JIGcEkpvkANFEWj4goWWIW38zdyyswd



Scale = 1:14.6

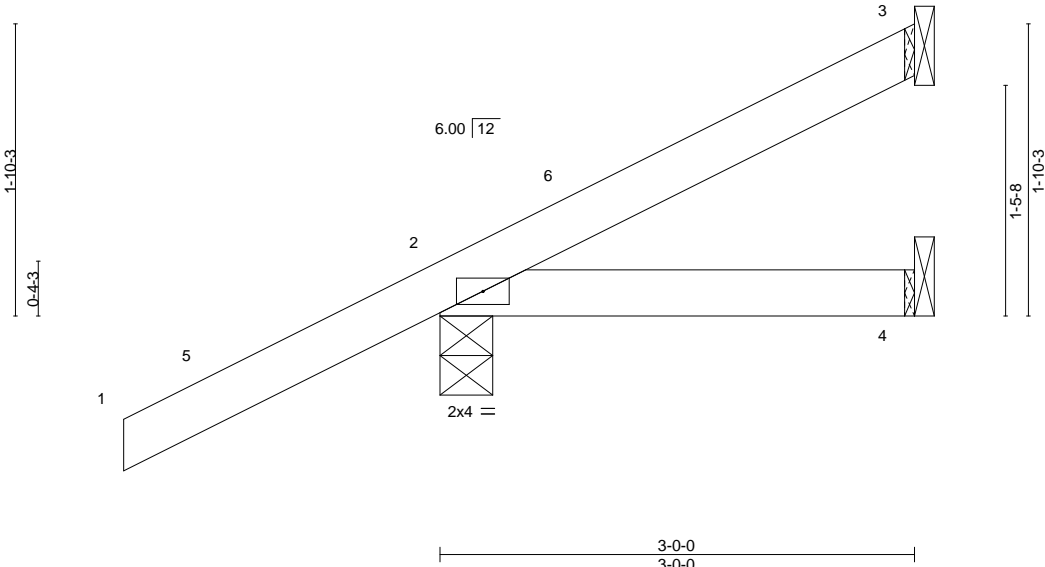

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.33	Vert(LL)	-0.00	2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	-0.01	2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TP12014		Matrix-P	Wind(LL)	0.00	2	****	240		
									Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical

Max Horz 2=71(LC 12)


Max Uplift 3=-14(LC 9), 2=-86(LC 12)

Max Grav 3=35(LC 17), 2=292(LC 1), 4=55(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 2-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

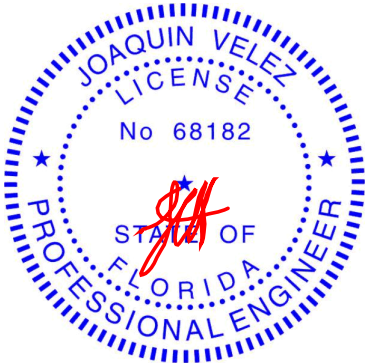

Joaquin Velez PE No.68182

MiTek Inc. DBA MiTek USA FL Cert 6634

16023 Swingley Ridge Rd. Chesterfield, MO 63017

Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534226
6243113	C5	Corner Jack	4	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:02 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-biGQNPBQVJ9JIGcEkpvkANFFkj1doWWIW38zdyyswd

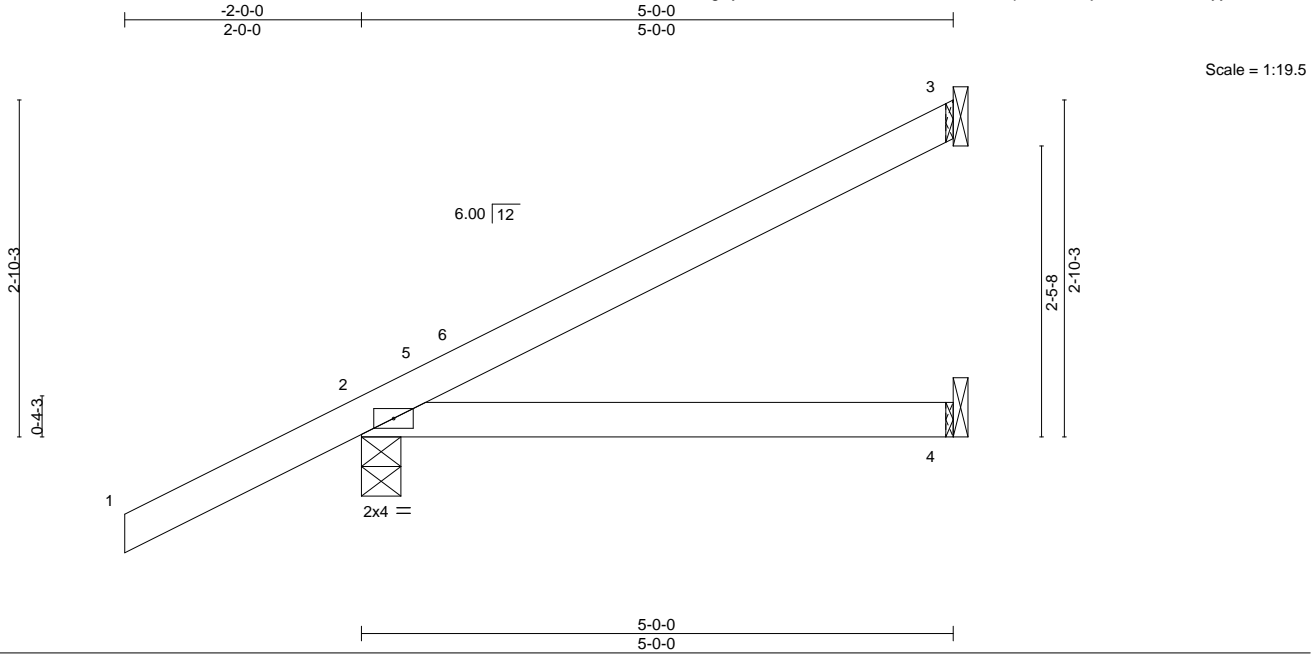

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.03 2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.28	Vert(CT)	-0.06 2-4	>921	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2023/TP12014		Matrix-P	Wind(LL)	0.00 2	****	240	Weight: 19 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=95(LC 12)
Max Uplift 3=35(LC 12), 2=-71(LC 12)
Max Grav 3=114(LC 1), 2=350(LC 1), 4=95(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

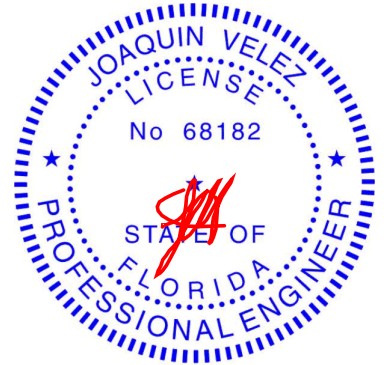

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534227
6243113	E01	Roof Special	2	1		
Job Reference (optional)						

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:03 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-3vqoblC2GdHAMQBQlXQzjanND6L8XttRljuW9Oyuswc

-2-0-0	4-4-12	8-0-4	8-8-0	14-11-4	21-4-0	23-4-0
2-0-0	4-4-12	3-7-8	0-7-12	6-3-4	6-4-12	2-0-0

Scale = 1:44.7

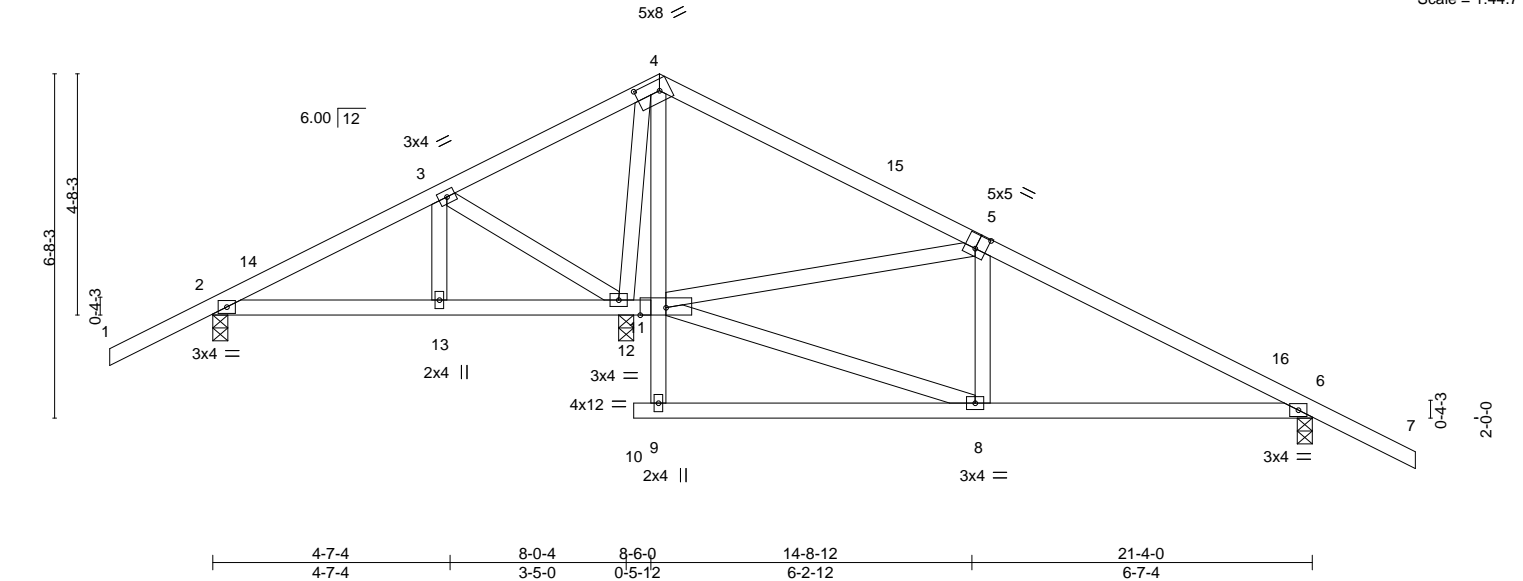


Plate Offsets (X,Y)-- [4:0-5-8,0-2-8], [5:0-2-8,0-3-4]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.46	Vert(LL)	-0.04 6-8 >999	360	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.39	Vert(CT)	-0.08 6-8 >999	240	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.00 6 n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	-0.01 6-8 >999	240	Weight: 121 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:
10-0-0 oc bracing: 9-11

REACTIONS.


(size) 2=0-3-8, 6=0-3-8, 12=0-3-8
Max Horz 2=-104(LC 10)
Max Uplift 2=-96(LC 12), 6=-106(LC 12)
Max Grav 2=362(LC 23), 6=593(LC 24), 12=1057(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=0/357, 4-5=0/265, 5-6=602/99
BOT CHORD 6-8=-16/463
WEBS 3-12=-348/79, 8-11=-34/448, 5-11=-620/136, 4-12=-603/45

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 8-7-12, Zone2 8-7-12 to 12-10-11, Zone1 12-10-11 to 23-4-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=106.

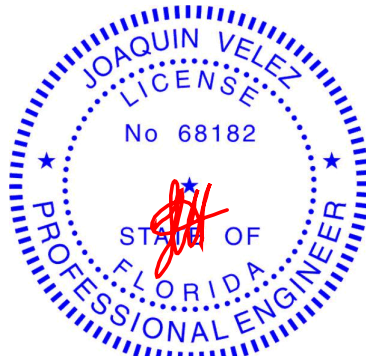

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534228
6243113	E01X	GABLE	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:03 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-3vqoblC2GdHAMQBQIXQzjanMR6LuXsTRljiuW9Oyuswc

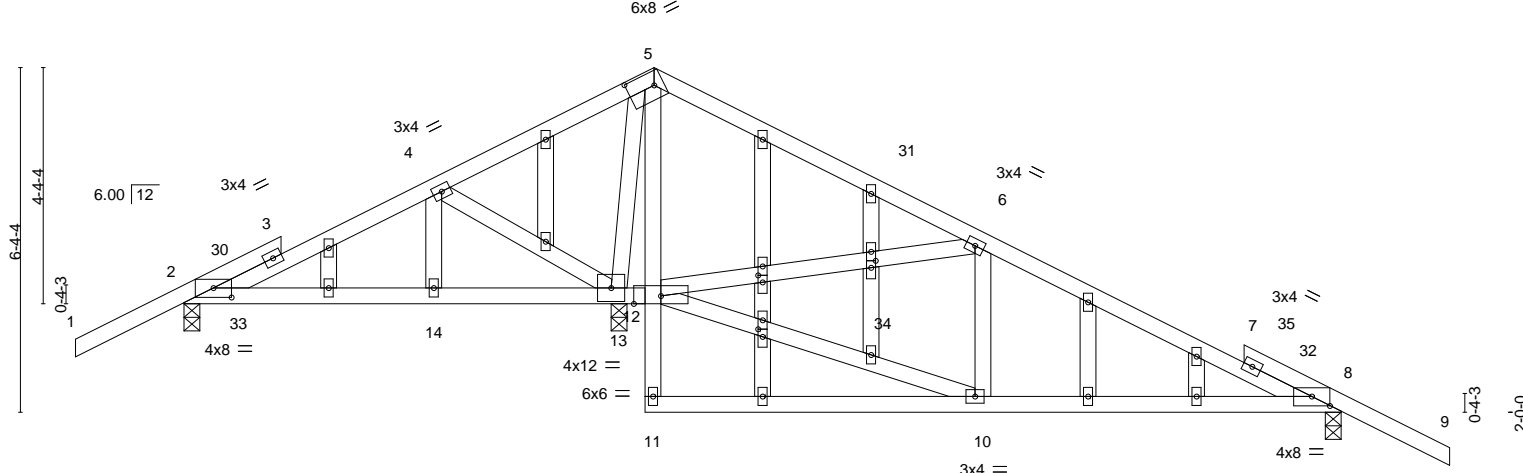



Plate Offsets (X,Y)--	[2:0-4-0,0-2-1], [5:0-5-14,0-3-0], [8:0-4-0,0-2-1], [20:0-1-9,0-1-0], [22:0-1-11,0-1-0], [25:0-1-9,0-1-0]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.51	Vert(LL)	-0.04 8-10	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.41	Vert(CT)	-0.10 8-10	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.47	Horz(CT)	-0.00 8	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.05 8-10	>999	240	Weight: 141 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS.	(size) 2=0-3-8, 8=0-3-8, 13=0-3-8
	Max Horz 2=173(LC 11)
	Max Uplift 2=115(LC 12), 8=187(LC 12), 13=254(LC 12)
	Max Grav 2=328(LC 23), 8=562(LC 24), 13=1141(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=-91/261, 4-5=-101/522, 5-6=-76/405, 6-8=-548/220
BOT CHORD	12-13=-355/225, 8-10=-134/439
WEBS	10-12=-131/438, 6-12=-709/336, 4-13=-366/173, 5-13=-692/186

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 8-7-12, Zone2 8-7-12 to 12-10-11, Zone1 12-10-11 to 23-4-0 zone; cantilever left and right exposed ; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=115, 8=187, 13=254.

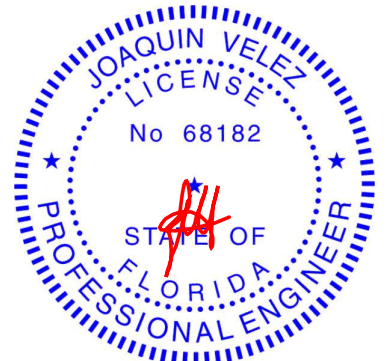

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:


July 25,2024

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534229
6243113	E02	Monopitch	3	1		

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:04 2024 Page 1
ID:Ts3RJ0261_Xu2fygSyBHAwZSLZ-X5OAo5Dg1xP1_amcrEyCFoKadWhIGPda_Nd4hryuswb



Scale = 1:28.8

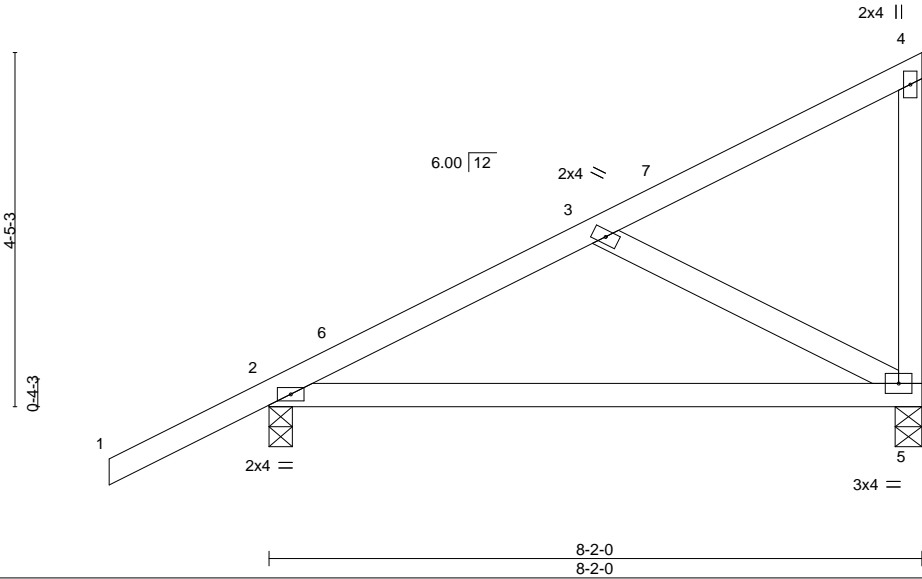

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.36	Vert(LL)	-0.18 2-5	>527	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.40	Vert(CT)	-0.36 2-5	>263	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00 5	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.00 2	****	240	Weight: 41 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP M 31 or 2x4 SP SS
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-4-0, 2=0-3-8
Max Horz 2=132(LC 12)
Max Uplift 5=-28(LC 12), 2=-60(LC 12)
Max Grav 5=297(LC 1), 2=461(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-322/70
WEBS 3-5=-259/240

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 8-0-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2.

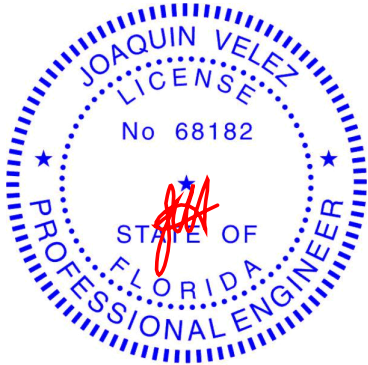

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:04 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAwZSSLZ-X5OAo5Dg1xP1_amcrEyCFoKadWhJGQ?a_Nd4hryuswb

2-0-0 1-9-7 1-11-1 4-1-0 6-4-9 8-2-0 10-2-0
2-0-0 1-9-7 0-1-9 2-1-15 2-1-15 0-1-9 1-9-7 2-0-0


Scale = 1:22.5

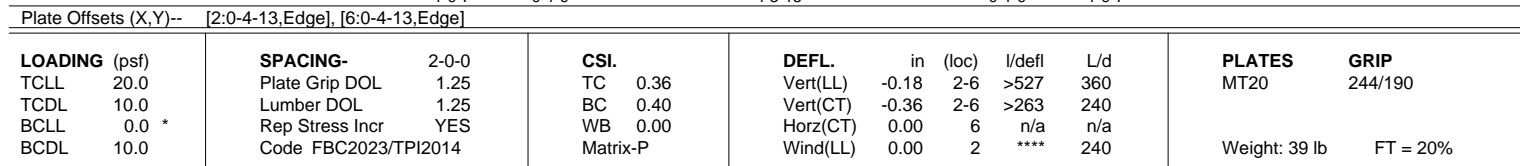

REACTIONS. (size) 2=0-3-8, 6=0-3-8
 Max Horz 2=-45(LC 10)
 Max Uplift 2=-74(LC 12), 6=-74(LC 12)
 Max Grav 2=444(LC 1), 6=444(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-259/134, 4-6=-259/135

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-1-0, Zone2 4-1-0 to 8-3-15, Zone1 8-3-15 to 10-2-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.

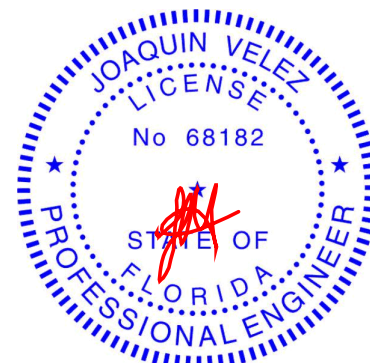

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25, 2024




WARNING – verify design parameters and READ NOTES on this and INCLUDED REFERRED REFERENCE ASSESSMENT before USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534231
6243113	E7	Jack-Open	35	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:04 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAwzSLZ-X5OAo5Dg1xP1_amcrEyCFoKU8We6GQ?a_Nd4hryuswb

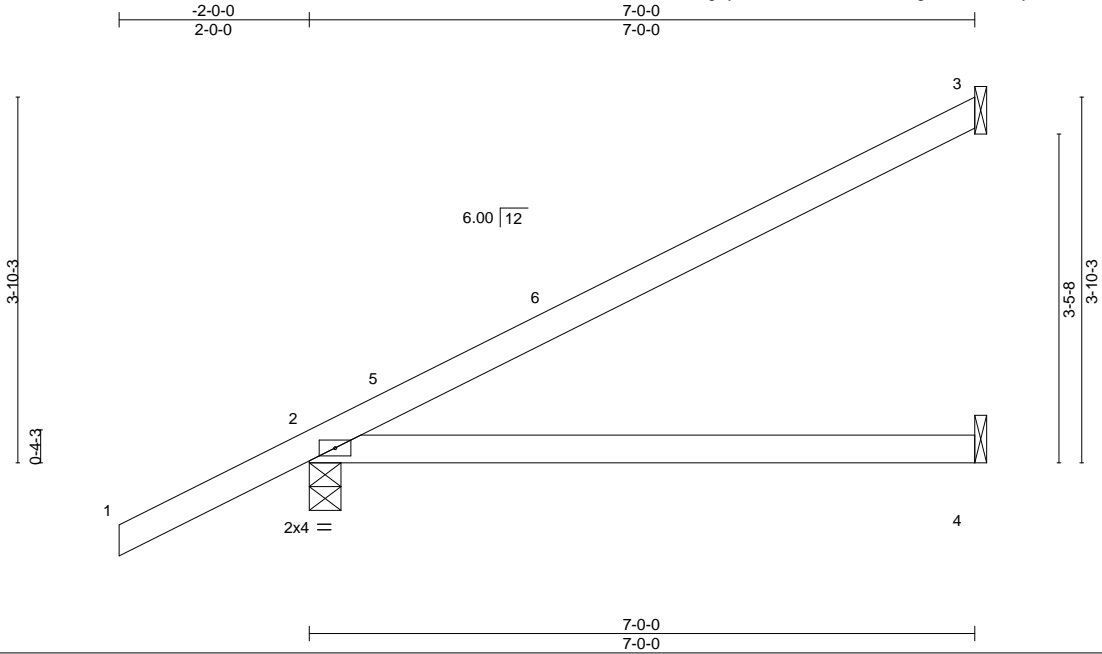

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.71	Vert(LL)	-0.13 2-4	>645	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.60	Vert(CT)	-0.25 2-4	>322	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2023/TP12014		Matrix-P	Wind(LL)	0.00 2	****	240	Weight: 26 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=119(LC 12)
Max Uplift 3=62(LC 12), 2=63(LC 12)
Max Grav 3=182(LC 1), 2=422(LC 1), 4=135(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

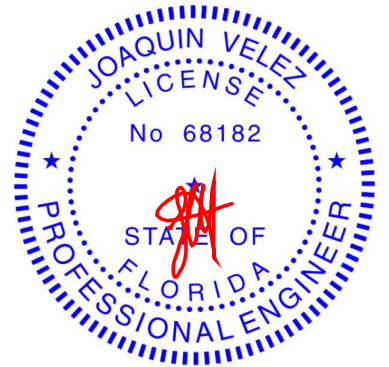

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534232
6243113	E7B	Jack-Open Supported Gable	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),


Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:05 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-?HxZ0REIoEXucjLpPyTRo?tefw_X?iFkC1NdEHyswa



Scale = 1:25.6

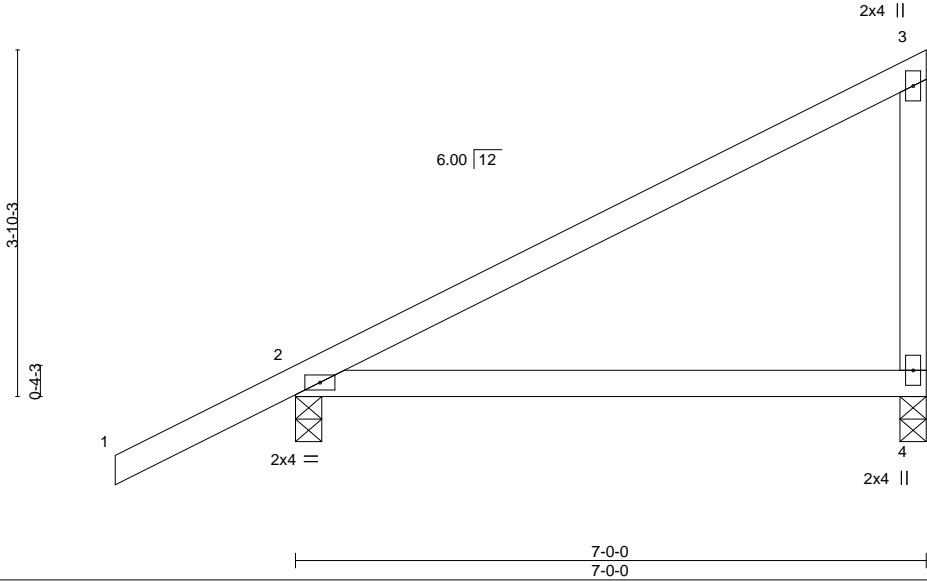

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.79	Vert(LL)	-0.12 2-4	>663	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.59	Vert(CT)	-0.24 2-4	>331	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.00 2	****	240	Weight: 30 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=0-3-8, 2=0-3-8
Max Horz 2=118(LC 12)
Max Uplift 4=21(LC 12), 2=63(LC 12)
Max Grav 4=248(LC 1), 2=418(LC 1)


FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-181/252

NOTES-

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.

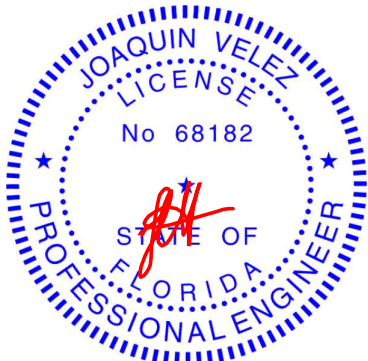

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534233
6243113	E7V	Jack-Open	3	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:05 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAwZSLZ-?HxZ0REIoEXucjLpPyTRo?tfuw_!?tFkC1NdEHyswa

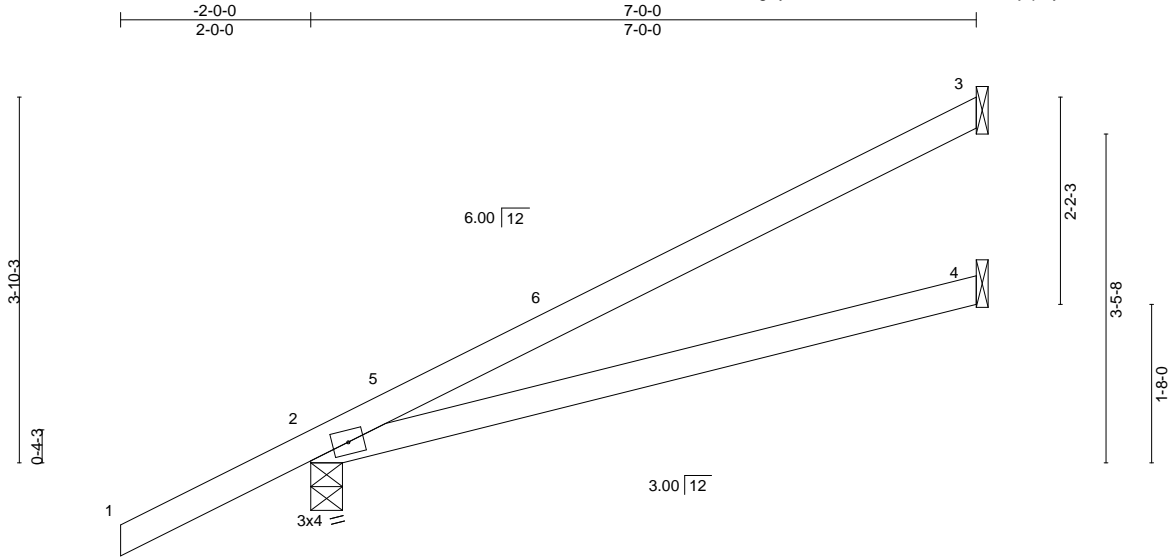

Scale: 1/2"=1'

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.71	Vert(LL)	-0.13 2-4	>625	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.60	Vert(CT)	-0.26 2-4	>313	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.00 2	****	240		
								Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=118(LC 12)
Max Uplift 3=63(LC 12), 2=63(LC 12)
Max Grav 3=182(LC 1), 2=422(LC 1), 4=135(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

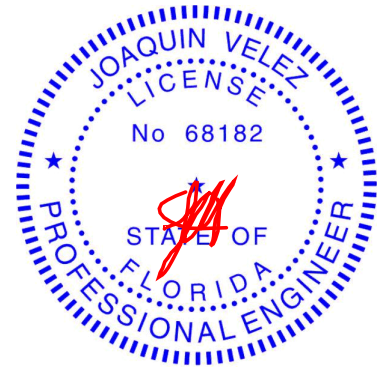

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534234
6243113	E7VA	Jack-Open	1	1		
Job Reference (optional)						

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:06 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-TUVxNwEwZyflDtw?zf_gKDPqpKMrkK0tRh6BmjyuswZ



Scale: 1/2"=1'

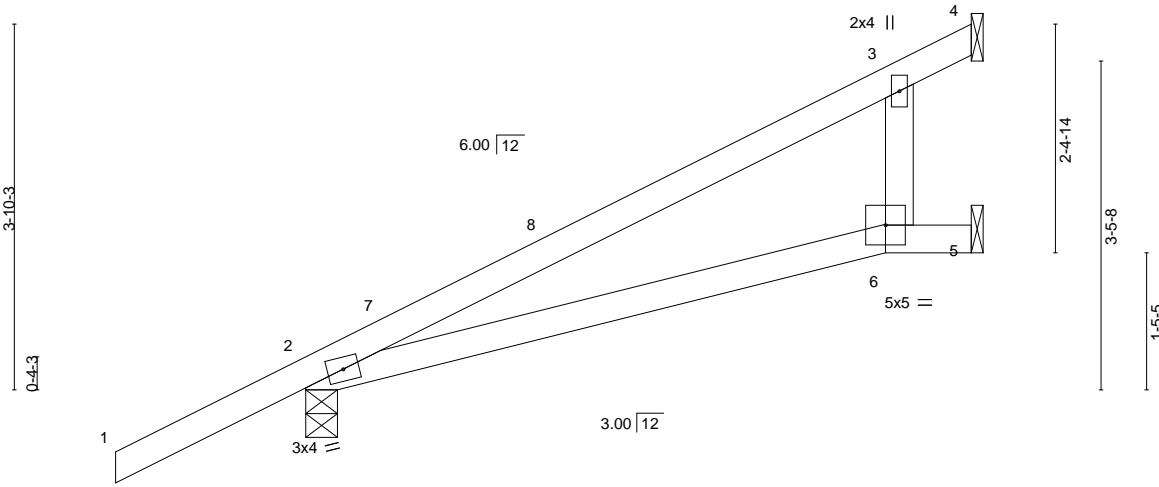

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.76	Vert(LL)	-0.08 2-6	>966	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.46	Vert(CT)	-0.19 2-6	>434	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.03 5	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.08 6	>999	240	Weight: 28 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=Mechanical, 2=0-4-0, 5=Mechanical
Max Horz 2=118(LC 12)
Max Uplift 4=27(LC 12), 2=63(LC 12)
Max Grav 4=242(LC 1), 2=422(LC 1), 5=17(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.

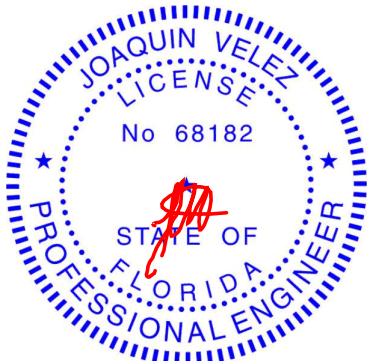

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534235
6243113	E7VB	Jack-Open	1	1		

Tibbetts Lumber Co., LLC (Ocala, FL),
Ocala, FL - 34472,
8.730 s Jul 11 2024 MiTek Industries, Inc.
Wed Jul 24 11:27:06 2024
Page 1

ID:Ts3RJ0261_Xu2fygSyBHAWzZSLZ-TUVxDnEwZYfIDtw?zf_gKDPxwKQ5kkYtRh6BmjyuswZ



Scale: 1/2"=1'

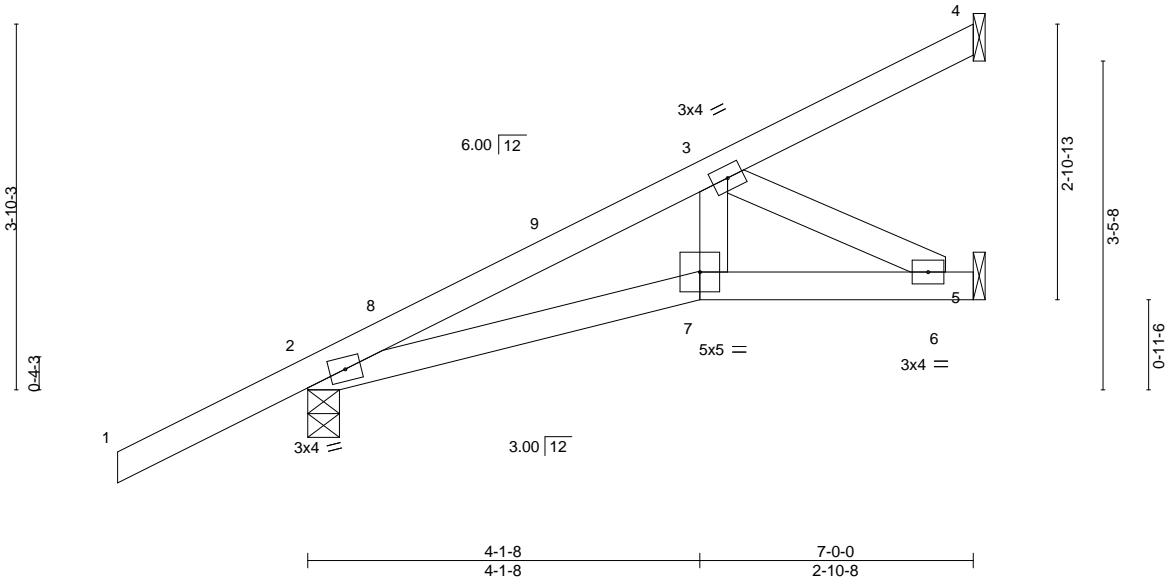

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.31	Vert(LL)	-0.02	2-7	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.25	Vert(CT)	-0.04	2-7	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.01	7	>999	240		
									Weight: 31 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 4=Mechanical, 2=0-4-0, 5=Mechanical
Max Horz 2=118(LC 12)
Max Uplift 4=24(LC 12), 2=63(LC 12)
Max Grav 4=65(LC 1), 2=422(LC 1), 5=185(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-480/106
BOT CHORD 2-7=-210/380, 6-7=-198/341
WEBS 3-6=-381/221

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.

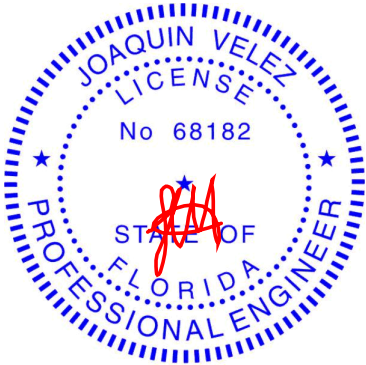

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534236
6243113	E7VC	Jack-Open	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),


Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:06 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-TUVxDnEwZYfIDtw?zf_gKDPpzKPuKk?R6BmjyuswZ



Scale: 1/2"=1'

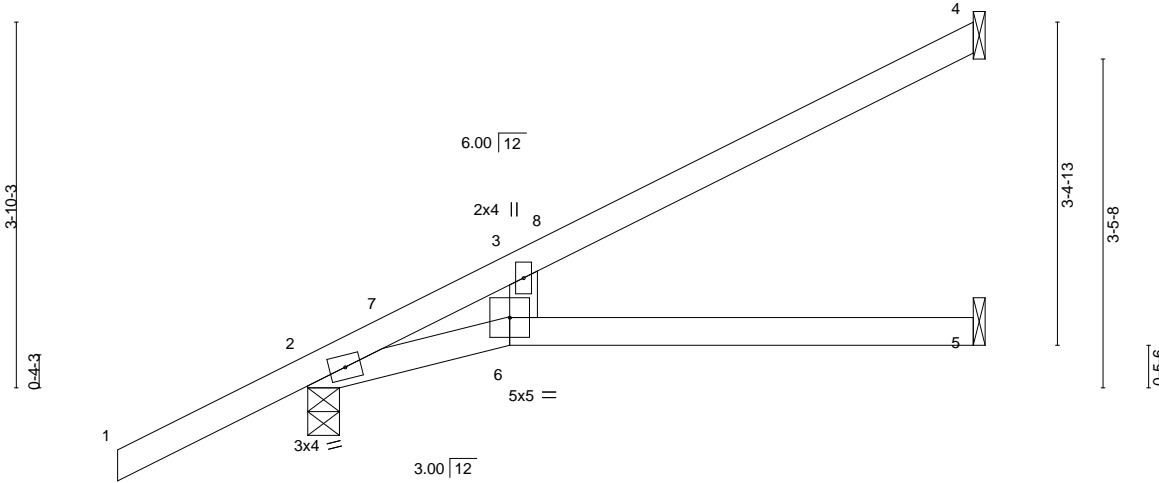

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.82	Vert(LL)	-0.16 6 >517 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.29	Vert(CT)	-0.31 6 >264 240				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.08 5 n/a n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-P		Wind(LL)	0.19 6 >437 240				
								Weight: 26 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=Mechanical, 2=0-4-0, 5=Mechanical
Max Horz 2=118(LC 12)
Max Uplift 4=51(LC 12), 2=63(LC 12)
Max Grav 4=202(LC 1), 2=422(LC 1), 5=96(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.

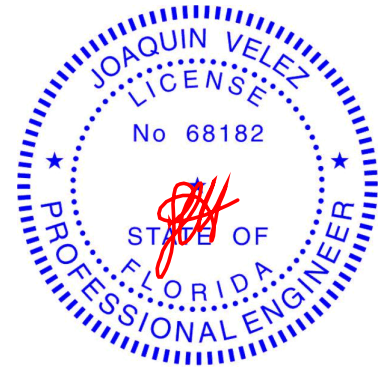

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:


July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbsccomponents.com)




16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534238
6243113	PB1	Piggyback	1	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:07 2024 Page 1

ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-yg3JQ7FYKsncr1VBXNVvtQy8fkn?TmP1gLskl9yuswY



Scale = 1:18.1

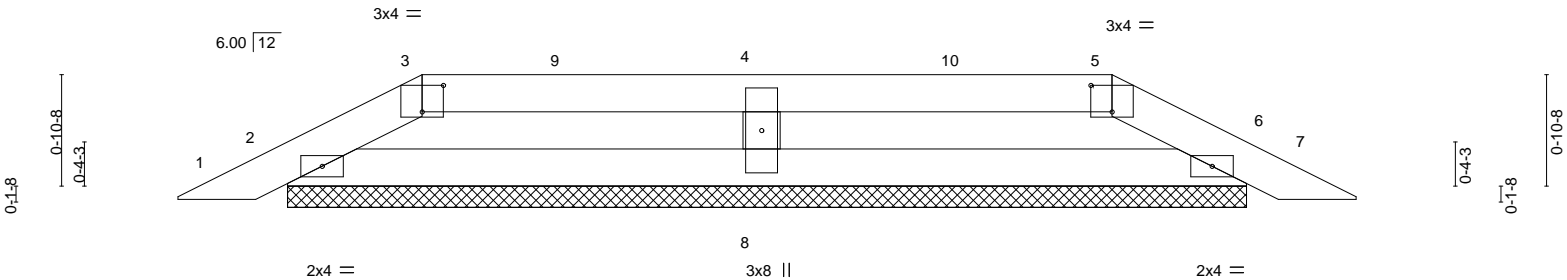

	9-5-0
	9-5-0


Plate Offsets (X,Y)--		[3:0-2-0,0-2-8], [5:0-2-0,0-2-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.12
TCDL 10.0	Lumber DOL	1.25	BC 0.14
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.00 7 n/r 120
			Vert(CT) 0.00 7 n/r 120
			Horz(CT) 0.00 6 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 26 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS.	(size) 2=7-6-6, 6=7-6-6, 8=7-6-6
	Max Horz 2=-14(LC 10)
	Max Uplift 2=-29(LC 12), 6=-29(LC 12), 8=-8(LC 9)
	Max Grav 2=184(LC 1), 6=188(LC 1), 8=297(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-4-11 to 2-0-0, Zone2 2-0-0 to 6-2-15, Zone1 6-2-15 to 7-5-0, Zone3 7-5-0 to 9-0-5 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 8.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

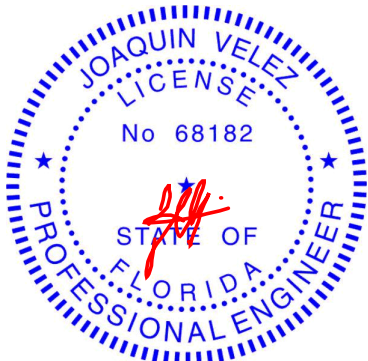

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534239
6243113	PB2	Piggyback	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:08 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-QsdheSGA49vTTB4N4408QeVJz76DCDkAv?bHqcyuswX



Scale = 1:18.1

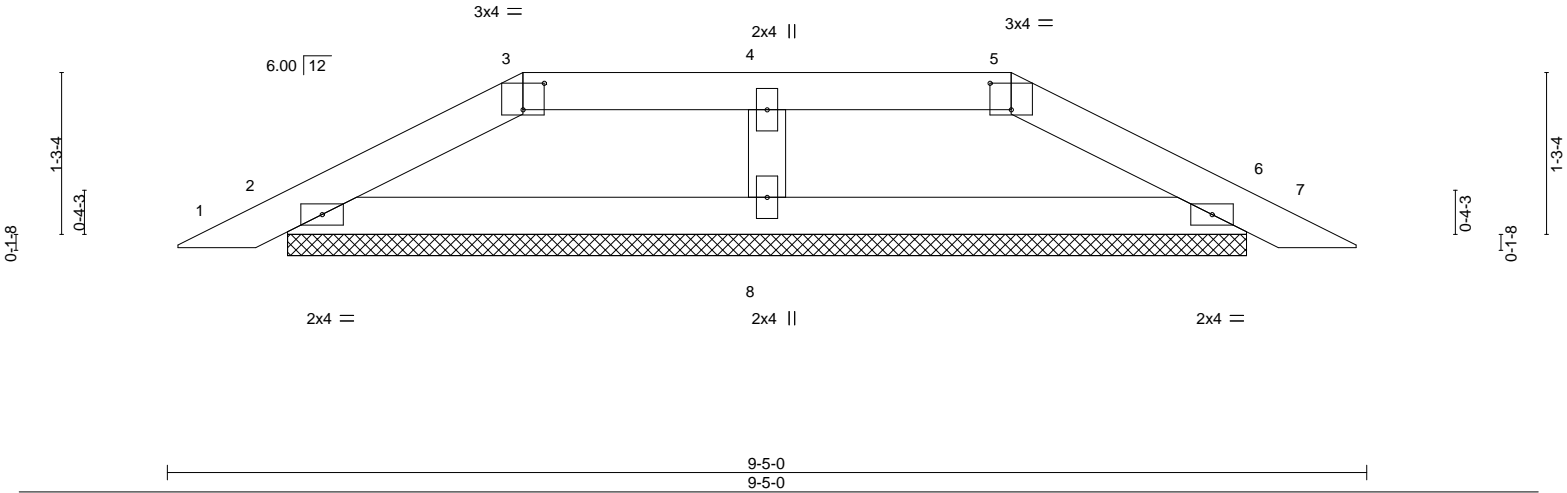



Plate Offsets (X,Y)-- [3:0-2-0,0-2-8], [5:0-2-0,0-2-8]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.08	Vert(LL)	0.00 7 n/r	120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.14	Vert(CT)	0.00 7 n/r	120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00 6 n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S					Weight: 27 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. (size) 2=7-6-6, 6=7-6-6, 8=7-6-6
Max Horz 2=-20(LC 10)
Max Uplift 2=-35(LC 12), 6=-35(LC 12)
Max Grav 2=209(LC 1), 6=209(LC 1), 8=252(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

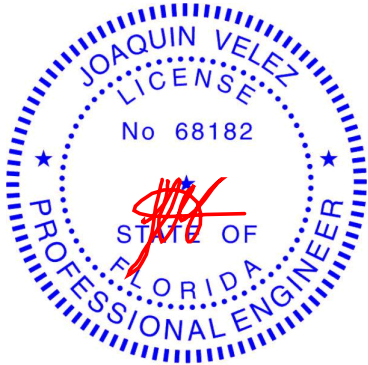

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534240
6243113	PB3	Piggyback	4	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:08 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-QsdheSGA49vTTB4N4408QeVHH76CCDDAv?bHqcyuswX



Scale = 1:17.8

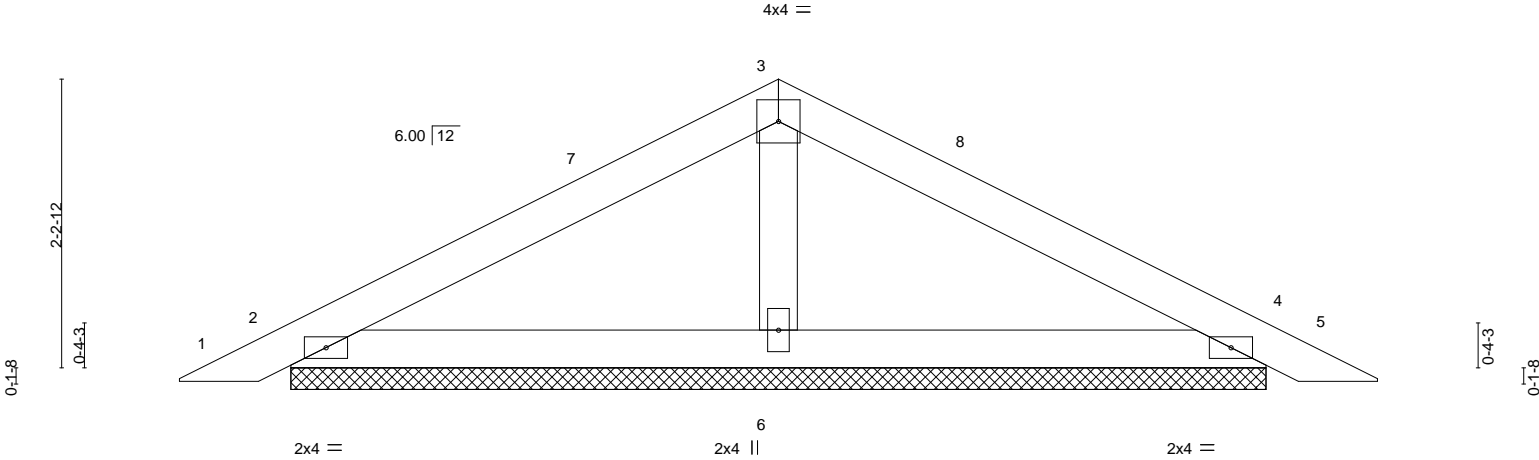

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	0.01 5 n/r 120	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.14	Vert(CT)	0.01 5 n/r 120				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00 4 n/a n/a				
BCDL	10.0	Code FBC2023/TP12014		Matrix-P							
								Weight: 29 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 2=7-6-6, 4=7-6-6, 6=7-6-6
Max Horz 2=-36(LC 10)
Max Uplift 2=-38(LC 12), 4=-38(LC 12)
Max Grav 2=188(LC 1), 4=188(LC 1), 6=294(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-4-11 to 3-4-11, Zone1 3-4-11 to 4-8-8, Zone3 4-8-8 to 9-0-5 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

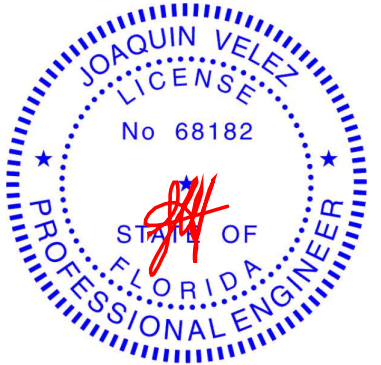

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	2508-CR-2 Car	T34534241
6243113	PB4	Piggyback	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Jul 11 2024 MiTek Industries, Inc. Wed Jul 24 11:27:09 2024 Page 1
ID:Ts3RJ0261_Xu2fYgSyBHAWzZSLZ-u3B3roHprT1K5LfaenXNyr1TwXSSxg_K7fLrN2yuswW



Scale = 1:18.1

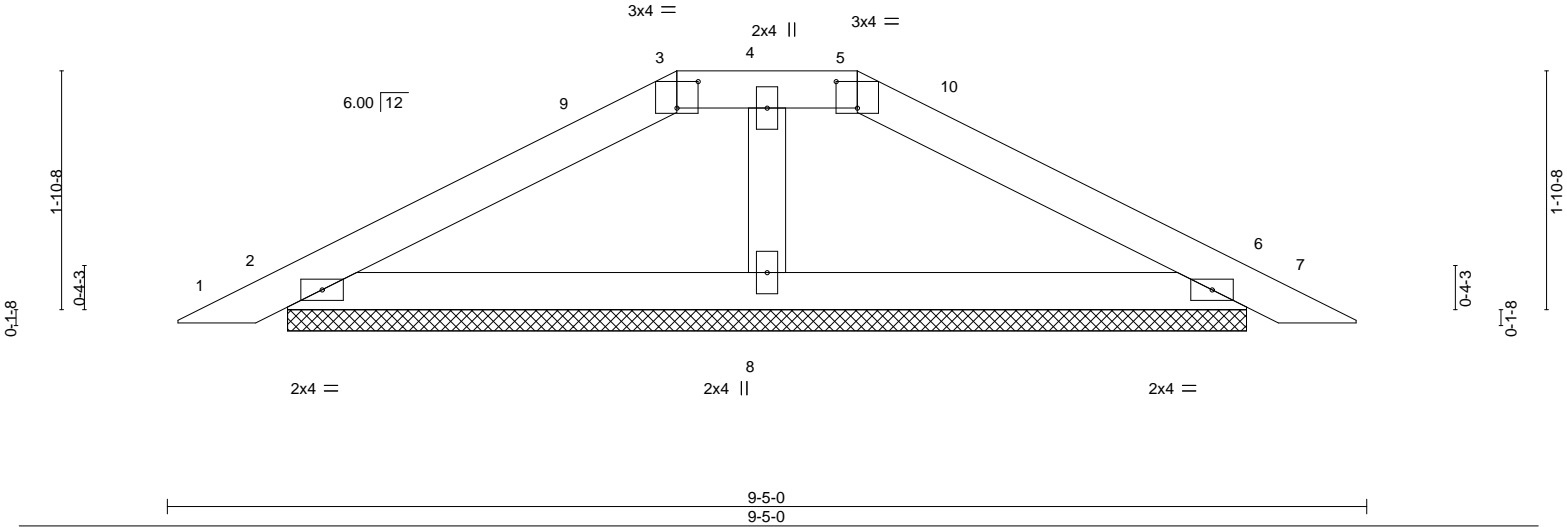



Plate Offsets (X,Y)--		[3:0-2-0,0-2-8], [5:0-2-0,0-2-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.13
TCDL 10.0	Lumber DOL	1.25	BC 0.14
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.00 7 n/r 120
			Vert(CT) 0.01 7 n/r 120
			Horz(CT) 0.00 6 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 28 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. (size) 2=7-6-6, 6=7-6-6, 8=7-6-6
Max Horz 2=-30(LC 10)
Max Uplift 2=-38(LC 12), 6=-38(LC 12)
Max Grav 2=203(LC 1), 6=203(LC 1), 8=264(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-4-11 to 3-4-11, Zone1 3-4-11 to 4-0-0, Zone3 4-0-0 to 9-0-5 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

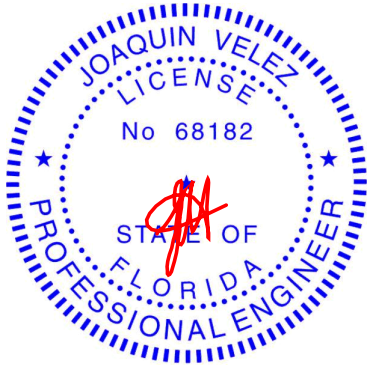

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 25,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

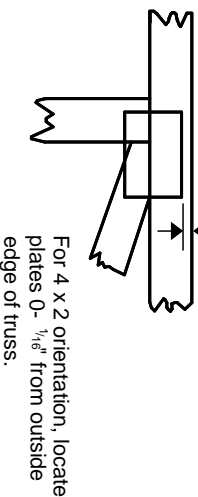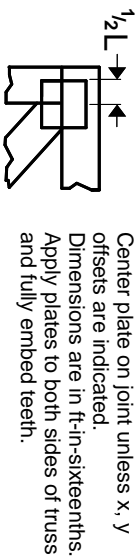


* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

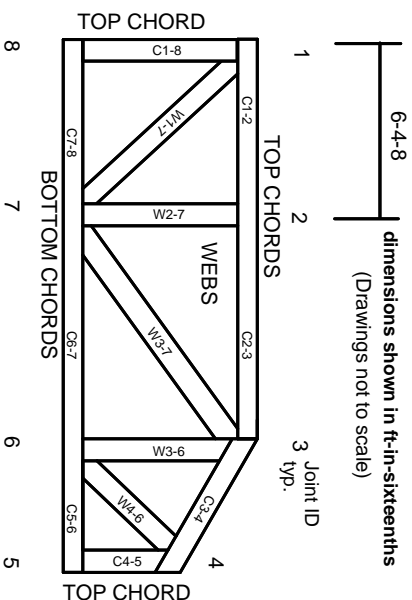

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved


MITek®

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023


General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

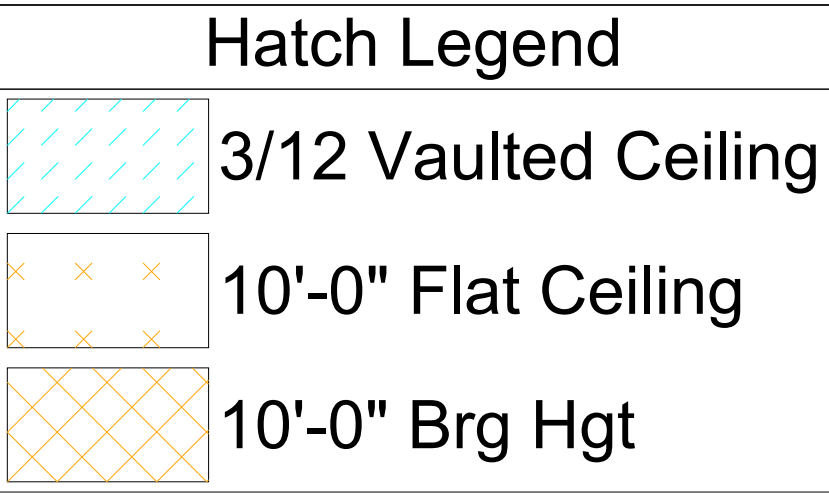

Please Print	Name	Employed By	Approval Date
--------------	------	-------------	---------------



a** Signature of the person who acknowledges that the client has reviewed this trans placement document in its entirety as it documents with the following terms, including, but not limited to:

- (A) The client's responsibility to verify the accuracy of information provided by the trans manufacturer and scheduling, allow access to the trans manufacturer from its facility, and provide accurate information supplied from the client, will be at the client's expense; any field measurements, by an associate of the trans Manufacturer C or LLC, shall be performed by the trans manufacturer or by the client.
- (B) Design Criteria: The client acknowledges that the trans design criteria noted on this trans placement document may exceed the design criteria specified by the building designer, engineer, architect, and local and state health department requirements.
- (C) Fabrication and Delivery: Once approved trans placement document must be returned to the trans manufacturer before fabrication and delivery will be scheduled. It is the client's responsibility to co-ordinate delivery dates and times with the trans manufacturer. The trans manufacturer shall not be responsible for delays due to incorrect level and design of the trans location. In lieu of this, this work will be delivered in the best available location at the time of delivery. Client and architect shall be responsible for any additional costs incurred.
- (D) Installation & Bracing: BCI 2088 (Building Code Compliance Information WCAPAT guidelines shall be followed when installing, handling, & bracing Trans). Temporary and/or permanent bracing and blocking, is not included in the price of the Trans. Transes are designed to be installed without the need for temporary bracing. However, the requirements specified in the construction documents for the building and on the individual trans design drawings shall govern. The overall stability of the building shall remain the responsibility of the owner.
- (E) Field Framing: (1) Truss collies and other ceiling transitions may require field framing to be carried; (2) Ceiling drops and valleys not shown are to be field framed by others; (3) Overhangs may be overhangs - cut tie in the field. Overhangs are 2x6 or 2x8 - no blocking is applied. Corner joints will be square cut and end joints will be double beveled
- (F) Repair: Trans related problems are to be reported to the trans manufacturer ASAP, preferably in writing. Repairs shall be made by the trans manufacturer. The trans manufacturer shall not be responsible for modifications made without an accepted repair drawing submitted by the responsibility of the client. No back charges shall be assessed. Any repairs made by anyone other than the trans manufacturer shall be at the client's expense. All changes of any kind will be accepted unless specifically written in writing by the trans manufacturer's management.
- (G) This Trans Placement Document was created by an agent of the trans manufacturer, Robert T. Hobbins L.L.C., and is hereby to be used as an installation guide and does not require a seal. Trans design analysis are on the Trans OTC Drawing, which will be provided by the trans manufacturer.

Floor: Load: 55# psf; 40 TCLL, 10 TC DL, 00 BC LL, 05 BC DL; Dur.: 1.00
Design checked for 10 psf non-concurrent LL on BC.

Roof: Load: 40# psf; 20 TC LL, 10 TC DL, 00 BC LL, 10 BC DL; Dur.: 1.25
Design checked for 10 psf non-concurrent LL on BC

TYPICAL DESIGN CRITERIA	Mitek Engineering Building Code	: FBC 2023		Exposure	: B
		: ASCE 7-22		Mean Height	: ≤ 15'
		: TPI 1-2014		Bldg. Category	: II
	Truss Design	: Comp. & Cladding		Importance Factor	: 1.00
	Uplift Calculations	: MWFRS		Enclosure	: Enclosed
	Wind Speed	: 130 mph US		Entry	: Exposed to Wind
				Lanai	: Exposed to Wind
	ROOF CRITERIA			FLOOR CRITERIA	
	T.C. Pitch	: 6/12	T.C. Size	: PC42	
	B.C. Pitch	: 3/12	Depth	: 16"	
T.C. Size	: 2x4	Spacing	: 16" O.C.		
Heel Height	: 4 3/16"	Bearing	: 8"		
Bearing	: 8"	Lumber	: SP		
Cantilever	: 0'	Vapor barrier between floor & concrete by other.			
Overhang	: 24"	Floor trusses held back 3/4" at exterior wall,			
O.H. Cut	: Plumb	block and fill by other. Blocking for transfer of			
Spacing	: 24" O.C.	vertical load from above by others. Odd space			
Lumber	: SP	floor trusses around plumbing as noted.			
Roof Truss to Truss Connectors				Floor Truss to Truss Connectors	
A	TYP: THD26			Z	TYP: THD46
a	JUS24	G THDH28-2	MTHD26	Q	THDH46 W MSH422IF
B	THD26-2	H THDH28-3	N	R	THD48 X MSH426
C	THDH26-2	I THDH210-3	O	S	THDH48 Y MSH426IF
D	THDH26-3	J GTWS2T		T	THDH410 Z
E	THD28	K GTWS3T		U	THDH610
F	THDH28	L GTWS4T		V	MSH422
Installation shall be per connector manufacturer's guidelines. All connectors and tie downs other than truss to girder truss connectors are to be specified and supplied by others.					

UPLIFT SUMMARY	1		11		21	
	2		12		22	
	3		13		23	
	4		14		24	
	5		15		25	
	6		16		26	
	7		17		27	
	8		18		28	
	9		19		29	
	10		20		30	

Only points listed above have reactions > 5000# or Uplift > 1000#.
Values shown on the sealed Truss Design Drawings supersede the above

NOTES	N1	.
	N2	.
	N3	.
	N4	.
	N5	.
	N6	.
	N7	.
	N8	.
	N9	.

		Diamond indicates left side of truss on truss design drawings
--	---	---




















Client Info	Client:	Adams Homes
	Project:	Model :2508-CR-2 Car
	Address:	Lot # 096 The Preserve at Laurel Lake
		Lake City ,Fl























Rev.							
	Date	:	11/08/24	Scale	:	1/4" = 1'-0"	D= 1/4
	Revised	:	.	Drawn By	:	Steve R.	
	Sheet #	:	1 of 1	Job #	:	6243113	

 <p>TIBBETTS LUMBER CO. <small>Since 1949</small> WWW.TIBBETTSLUMBER.COM</p>	<h2 style="margin: 0;">Tibbetts Lumber Ocala</h2> <p style="margin: 5px 0;">6100 SE 68th St Ocala, FL 34472 Phone: 352-347-7661 www.tibbettslumber.com</p>	<h3 style="margin: 0;">Reaction Summary</h3> <p>Job Number: 6243113-R</p> <p>Quoted On:</p> <p>Ordered On: 11/4/2024</p> <p>Scheduled Delivery On:</p> <p>Product: Roof</p>

<p>Customer Information</p> <p>Adams Homes of NW FL - Gainesville</p> <p>Address & Phone</p> <p>Phone:</p>	<p>Job Information</p> <p>The Preserve at Laurel Lake 096</p> <p>Address</p> <p>715 SW Rosemary Dr Lake City FL 32024</p>																		
<p>Contact</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;">Lot</td> <td style="width: 33%;">Sub-Division</td> <td style="width: 34%;"></td> </tr> <tr> <td>096</td> <td>The Preserve at Laurel Lake</td> <td></td> </tr> <tr> <td>Sales Person</td> <td colspan="2">Customer P.O. No.</td> </tr> <tr> <td>Chris Adam</td> <td colspan="2"></td> </tr> <tr> <td>Estimator</td> <td colspan="2">Designer</td> </tr> <tr> <td>Steven Roberts</td> <td colspan="2">Steven Roberts</td> </tr> </table>	Lot	Sub-Division		096	The Preserve at Laurel Lake		Sales Person	Customer P.O. No.		Chris Adam			Estimator	Designer		Steven Roberts	Steven Roberts	
Lot	Sub-Division																		
096	The Preserve at Laurel Lake																		
Sales Person	Customer P.O. No.																		
Chris Adam																			
Estimator	Designer																		
Steven Roberts	Steven Roberts																		

Loading				Building Code	Wind Design Method	Velocity	Exp Cat	Wind Max	
TCLL	TCDL	BCLL	BCDL				Occ Cat	TCDL	BCDL
20	10	0	10	FBC2023/TPI2014	MWFRS (Directional)/C-C hybrid Wind ASCE 7-22	130 mph	B II	4.2	6

Roof Trusses									
Label	Profile	Qty Ply	Span Height	TC Pitch BC Pitch	TC BC	Reactions			
A01		1	43-11-00	6 /12	2 x 6	Joint 11	Joint 2		
		2-ply	4-09-15		2 x 6	3631 -261	3443 -229		
A02		1	43-11-00	6 /12	2 x 4	Joint 10	Joint 2		
		1-ply	5-09-15		2 x 4	1741 -80	1877 -133		
A03		1	43-11-00	6 /12	2 x 4	Joint 10	Joint 2		
		1-ply	6-05-03		2 x 4	1741 -82	1877 -132		
A04		1	43-11-00	6 /12	2 x 4	Joint 12	Joint 2		
		1-ply	7-05-03		2 x 4	1753 -70	1891 -128		
A05		1	43-11-00	6 /12	2 x 4	Joint 11	Joint 2		
		1-ply	8-05-03		2 x 4	1753 -70	1891 -128		
A06		1	43-11-00	6 /12	2 x 4	Joint 11	Joint 2		
		1-ply	9-05-03		2 x 4	1944 -70	2117 -128		
A07		1	43-11-00	6 /12	2 x 4	Joint 13	Joint 2		
		1-ply	10-05-03		2 x 4	1984 -68	2139 -116		
A08		1	43-11-00	6 /12	2 x 4	Joint 12	Joint 2	Joint 23	
		1-ply	11-05-03		2 x 4	1704 -58	357 -110	2007 -137	
A09		1	43-11-00	6 /12	2 x 4	Joint 12	Joint 2	Joint 23	
		1-ply	11-05-03		2 x 4	1704 -58	357 -56	2044 -88	
A10		1	45-10-00	6 /12	2 x 4	Joint 12	Joint 2	Joint 23	
		1-ply	11-05-03		2 x 4	1880 -132	353 -140	2080 -112	
A11		4	45-10-00	6 /12	2 x 4	Joint 11	Joint 2	Joint 21	
		1-ply	11-05-03		2 x 4	1716 -126	327 -155	2281 -150	
A11A		1	45-10-00	6 /12	2 x 4	Joint 11	Joint 2	Joint 21	
		1-ply	11-05-03		2 x 4	1789 -128	326 -146	2208 -135	
A12		1	45-02-00	6 /12	2 x 4	Joint 11	Joint 2	Joint 20	
		1-ply	11-09-15		2 x 4	1572 -62	350 -76	2283 -79	
A13		1	45-02-00	6 /12	2 x 4	Joint 12	Joint 2	Joint 22	
		1-ply	10-09-15		2 x 4	1585 -61	336 -144	2242 -164	
A14		1	45-02-00	6 /12	2 x 4	Joint 10	Joint 18	Joint 2	
		1-ply	9-09-15		2 x 4	1597 -61	2258 -86	360 -70	
A15		1	45-02-00	6 /12	2 x 4	Joint 11	Joint 19	Joint 2	
		1-ply	8-09-15		2 x 4	1390 -61	2090 -87	272 -70	
A16		1	49-10-00	6 /12	2 x 4	Joint 14	Joint 17	Joint 2	
		1-ply	7-09-15	-3 /12	2 x 4	197 -41	2765 -133	1616 -105	
A17		1	49-10-00	6 /12	2 x 4	Joint 14	Joint 17	Joint 2	
		1-ply	6-09-15	-3 /12	2 x 4	172 -45	2461 -124	1459 -109	
A18		1	49-10-00	6 /12	2 x 4	Joint 14	Joint 17	Joint 2	
		1-ply	5-09-15	-3 /12	2 x 4	238 -43	2370 -114	1484 -114	

Roof Trusses								
Label	Profile	Qty	Span	TC Pitch	TC	Reactions		
		Ply	Height	BC Pitch	BC			
A19		1	49-10-00	6 /12	2 x 6	Joint 12	Joint 15	Joint 2
		2-ply	4-09-15	-3 /12	2 x 6	901 -34	4624 -318	2758 -181
B01		9	23-10-00	6 /12	2 x 4	Joint 2	Joint 8	
		1-ply	7-03-07		2 x 4	1298 39	1298 39	
B01X		1	23-10-00	6 /12	2 x 4	Continuous Support		
		1-ply	6-11-08		2 x 4			
B02		1	23-09-08	6 /12	2 x 4	Joint 14	Joint 2	
		1-ply	7-03-07		2 x 4	1132 102	1304 38	
C1		4	1-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	1-09-15		2 x 4	290 -134	68 -101	19 6
C3		4	3-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	2-09-15		2 x 4	292 -86	35 -14	55 17
C5		4	5-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	3-09-15		2 x 4	350 -71	114 -35	95 29
E01		2	21-04-00	6 /12	2 x 4	Joint 12	Joint 2	Joint 6
		1-ply	7-07-15		2 x 4	1057 14	362 -96	593 -106
E01X		1	21-04-00	6 /12	2 x 4	Joint 13	Joint 2	Joint 8
		1-ply	7-04-00		2 x 4	1141 -254	328 -115	562 -187
E02		3	8-02-00	6 /12	2 x 4	Joint 2	Joint 5	
		1-ply	5-04-15		2 x 4	461 -60	298 -28	
E02X		1	8-02-00	6 /12	2 x 4	Joint 2	Joint 6	
		1-ply	3-00-08		2 x 4	444 -74	444 -74	
E7		35	7-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	4-09-15		2 x 4	422 -63	182 -62	135 41
E7B		1	7-00-00	6 /12	2 x 4	Joint 2	Joint 4	
		1-ply	4-09-15		2 x 4	418 -63	248 -21	
E7V		3	7-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	4-09-15	3 /12	2 x 4	422 -63	182 -63	135 41
E7VA		1	7-00-00	6 /12	2 x 4	Joint 2	Joint 4	Joint 5
		1-ply	4-09-15	3 /12	2 x 4	422 -63	242 -27	17 5
E7VB		1	7-00-00	6 /12	2 x 4	Joint 2	Joint 4	Joint 5
		1-ply	4-09-15	3 /12	2 x 4	422 -63	65 -24	185 2
E7VC		1	7-00-00	6 /12	2 x 4	Joint 2	Joint 4	Joint 5
		1-ply	4-09-15	3 /12	2 x 4	422 -63	202 -51	96 29
H7		2	9-10-01	4.24 /12	2 x 4	Joint 2	Joint 4	Joint 5
		1-ply	4-09-07		2 x 4	583 -171	164 -50	271 18
PB1		1	9-05-00	6 /12	2 x 4	Joint 2	Joint 6	Joint 8
		1-ply	11-12		2 x 4	184 -29	188 -29	297 -8
PB2		1	9-05-00	6 /12	2 x 4	Joint 2	Joint 6	Joint 8
		1-ply	1-04-08		2 x 4	209 -35	209 -35	252 7
PB3		4	9-05-00	6 /12	2 x 4	Joint 2	Joint 4	Joint 6
		1-ply	2-04-00		2 x 4	188 -38	188 -38	294 18
PB4		1	9-05-00	6 /12	2 x 4	Joint 2	Joint 6	Joint 8
		1-ply	1-11-12		2 x 4	203 -38	203 -38	264 19