


NOTES

- ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE REQUIREMENTS 2020 FLORIDA BUILDING CODE AND 2017 NATIONAL ELECTRICAL CODE WITH ANY LOCAL AMENDMENTS.
- CIRCUITS FOR COOLERS AND FREEZERS BEING REMOVED SHALL BE REMOVED IN THEIR ENTIRETY BACK TO THE PANELBOARD AND CIRCUIT SHALL BE LABELED AS 'SPARE', OR RE-USED AS INDICATED.
- CONTRACTOR SHALL COORDINATE LOCATION OF ALL POWER DROPS WITH DOLLAR GENERAL'S FINAL FIXTURE LOCATIONS.
- CONTRACTOR SHALL COORDINATE INSTALLATION OF ALL NEW COOLERS AND FREEZERS WITH MANUFACTURER AND SHALL CONNECT TO MANUFACTURER PROVIDED DISCONNECT ON TOP OF EQUIPMENT.
- PROPERLY LABEL ALL EXISTING PANELBOARDS WITH NEW CIRCUITING ON TYPEWRITTEN DIRECTORY CARD.
- WIRE SIZES #12 CU UNLESS NOTED OTHERWISE.

10661 EQUIPMENT SCHEDULE

CALLOUT	SYMBOL	VOLTS	MCA	MOCP	CIRCUIT	WIRE CALLOUT
3 DOOR LOW TEMP		240/120V 2P 3W	20.8	25	C-14,16	1/2"C,2#10,#10N,#10G
4 DOOR LOW TEMP		240/120V 2P 3W	27.8	40	C-6,8	3/4"C,2#8,#8N,#10G
4 DOOR LOW TEMP		240/120V 2P 3W	27.8	40	C-10,12	3/4"C,2#8,#8N,#10G
5 DOOR LOW TEMP		240/120V 2P 3W	32.1	40	C-2,4	3/4"C,2#8,#8N,#10G
5 DOOR MED TEMP		240/120V 2P 3W	14.8	15	C-1,3	1/2"C,2#12,#12N,#12G
5 DOOR MED TEMP		240/120V 2P 3W	14.8	15	C-5,7	1/2"C,2#12,#12N,#12G
5 DOOR MED TEMP		240/120V 2P 3W	14.8	15	C-9,11	1/2"C,2#12,#12N,#12G
5 DOOR MED TEMP		240/120V 2P 3W	14.8	15	A-29,31	1/2"C,2#12,#12N,#12G
8' PRODUCE CASE		240/120V 2P 3W	18	20	C-20,22	1/2"C,2#12,#12N,#12G
8' PRODUCE CASE-120V		120V 1P 2W	10	15	C-18	1/2"C,1#12,#12N,#12G

EQUIPMENT LISTED ABOVE IS INDICATED AS THAT OF PROTOTYPE EQUIPMENT FOR DOLLAR GENERAL IN THIS AREA. SHOULD EQUIPMENT DELIVERED TO THE SITE VARY IN REQUIREMENTS, ADJUST CB AND FEEDS AS NEEDED TO COMPLY WITH ALL APPLICABLE CODES.

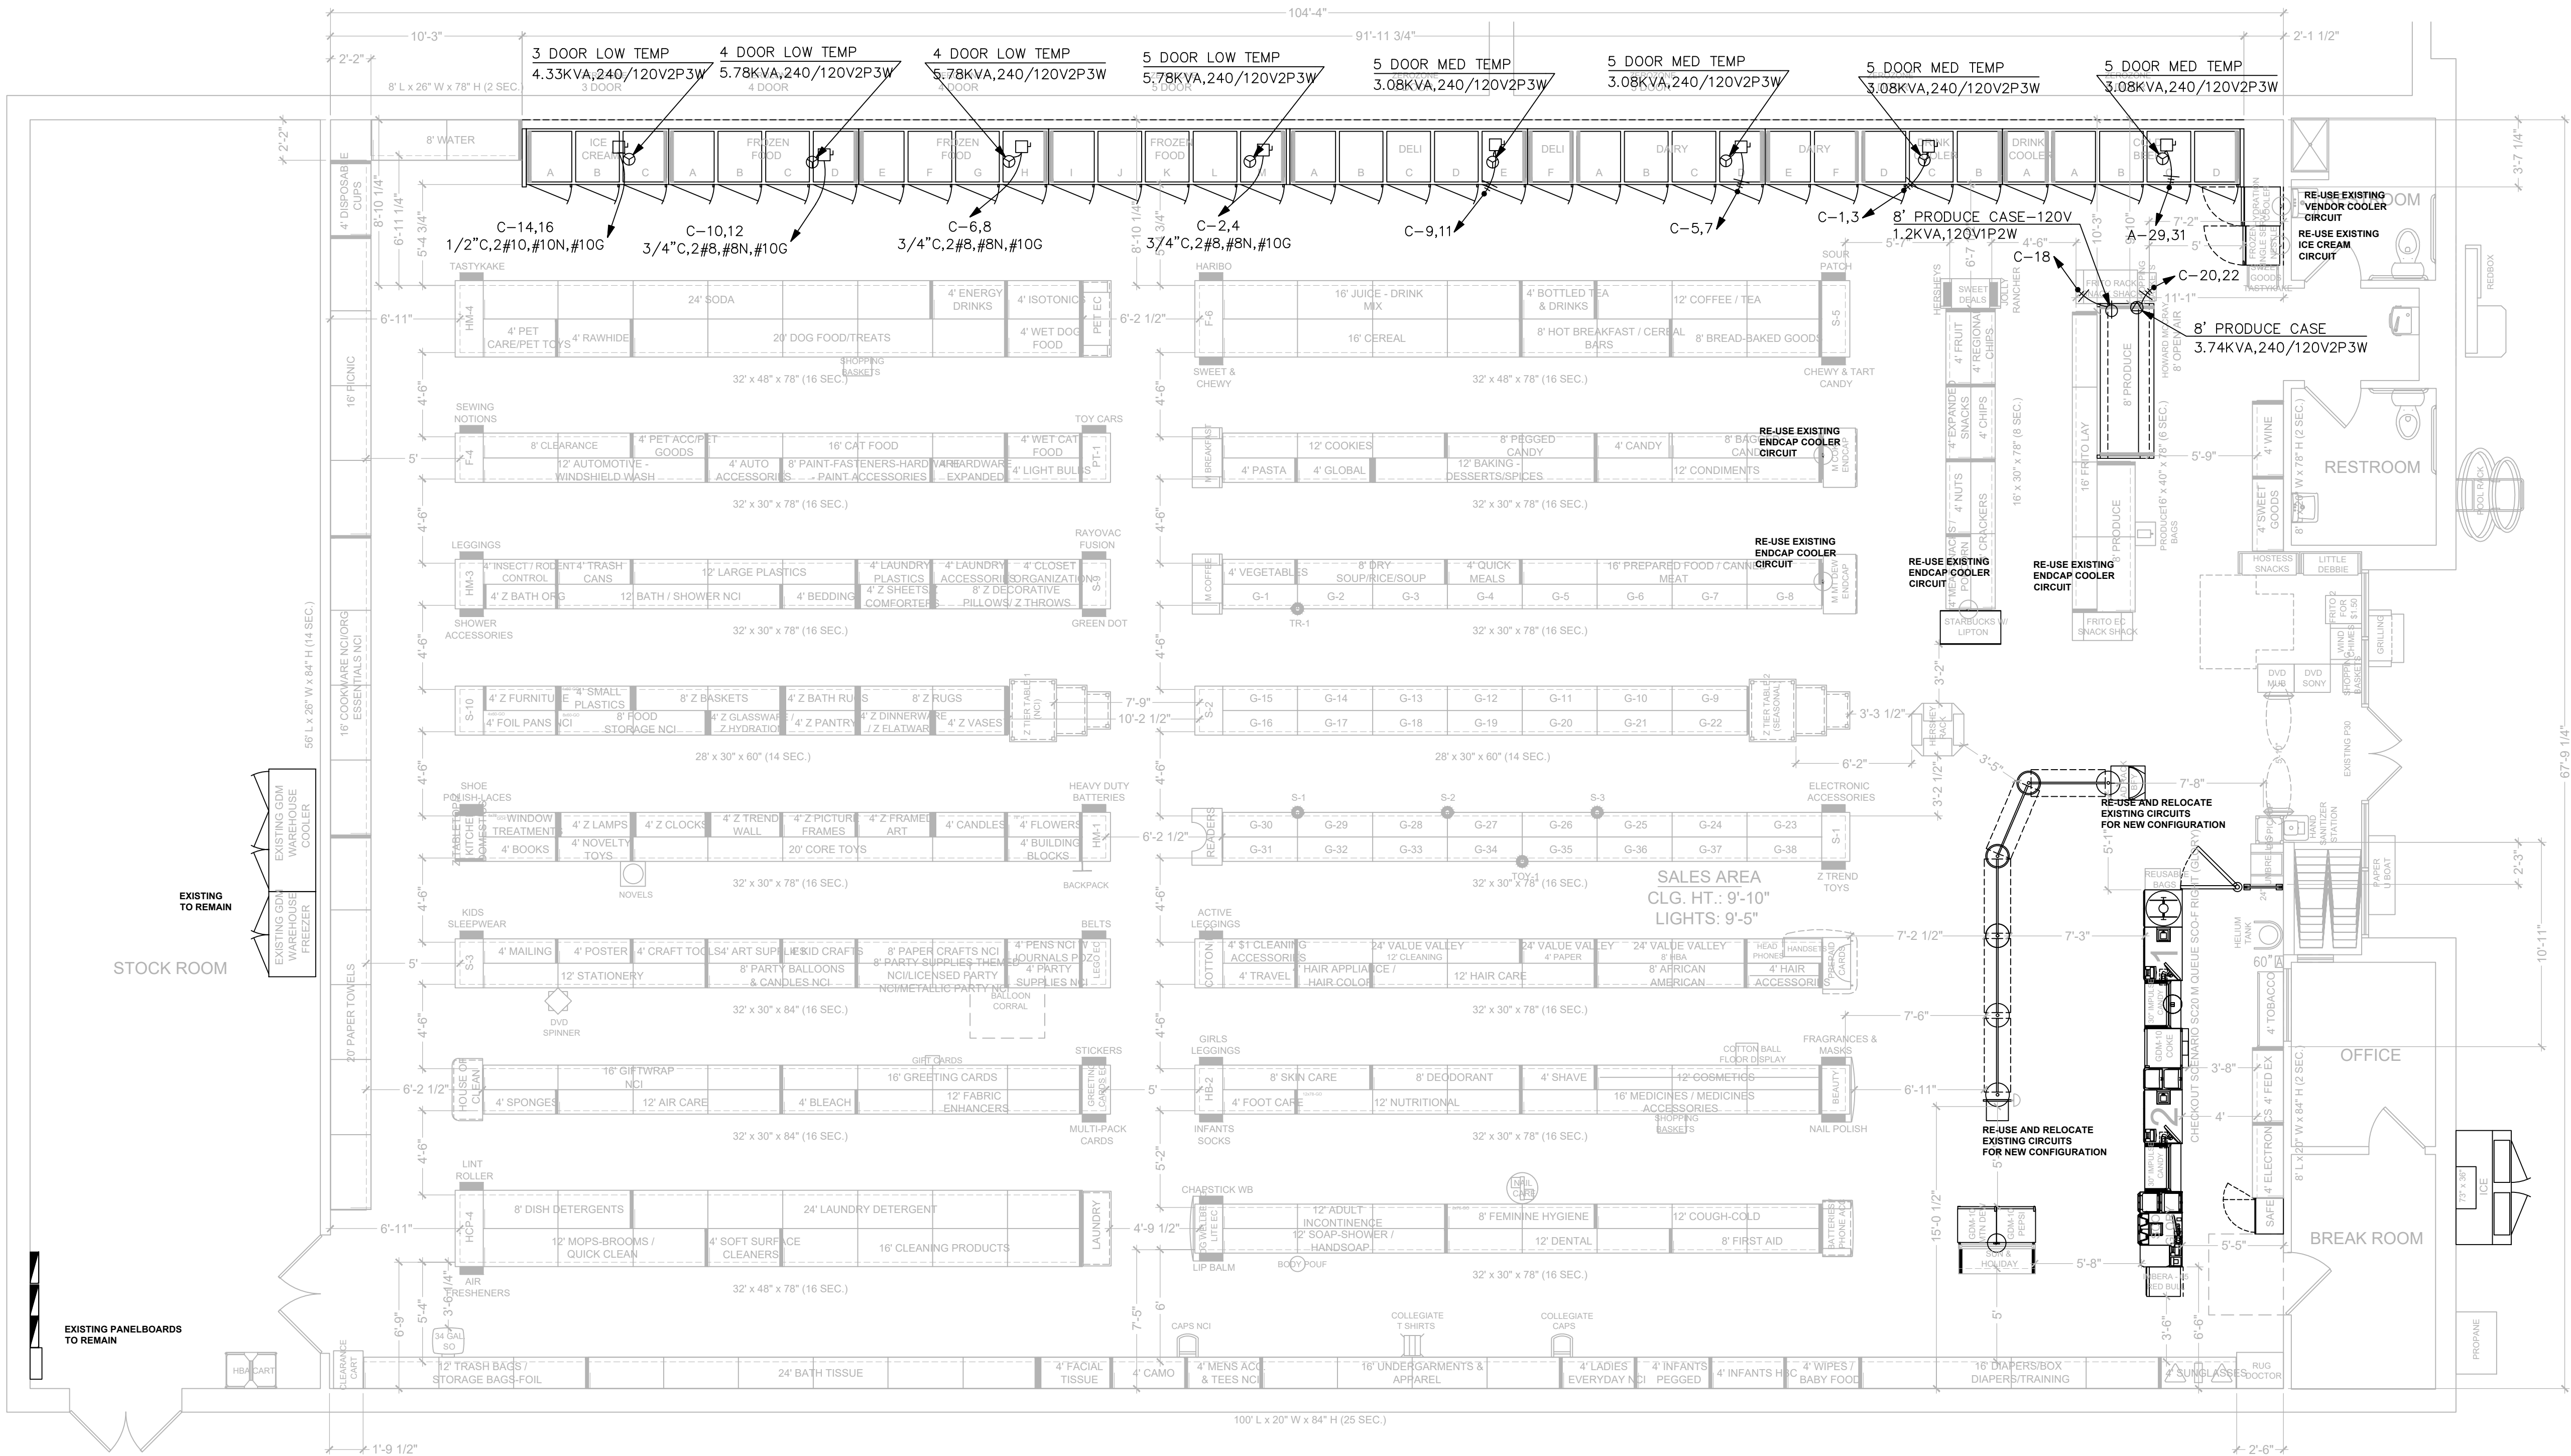

Constance Hickey Scott P.E.

7846 Wood Oak Cove
Cordova, TN
(901) 830-5300
chscott@chsengineering.com

FL license # 39054 exp 2/28/25

DOLLAR GENERAL

STORE NUMBER 10661
2172 SE Baya Drive #115
Lake City, FL

NO. DATE DESCRIPTION

REVISIONS

SHEET TITLE
ELECTRICAL
REMODEL
PLAN

constance hickey scott

DRAWN
CS

RED
15

DATE
04/27/2023

E1