
DATE DRAWN BY 8/18/05 W.H.F.

REVISIONS

SHEET A-6

PROJECT NO.

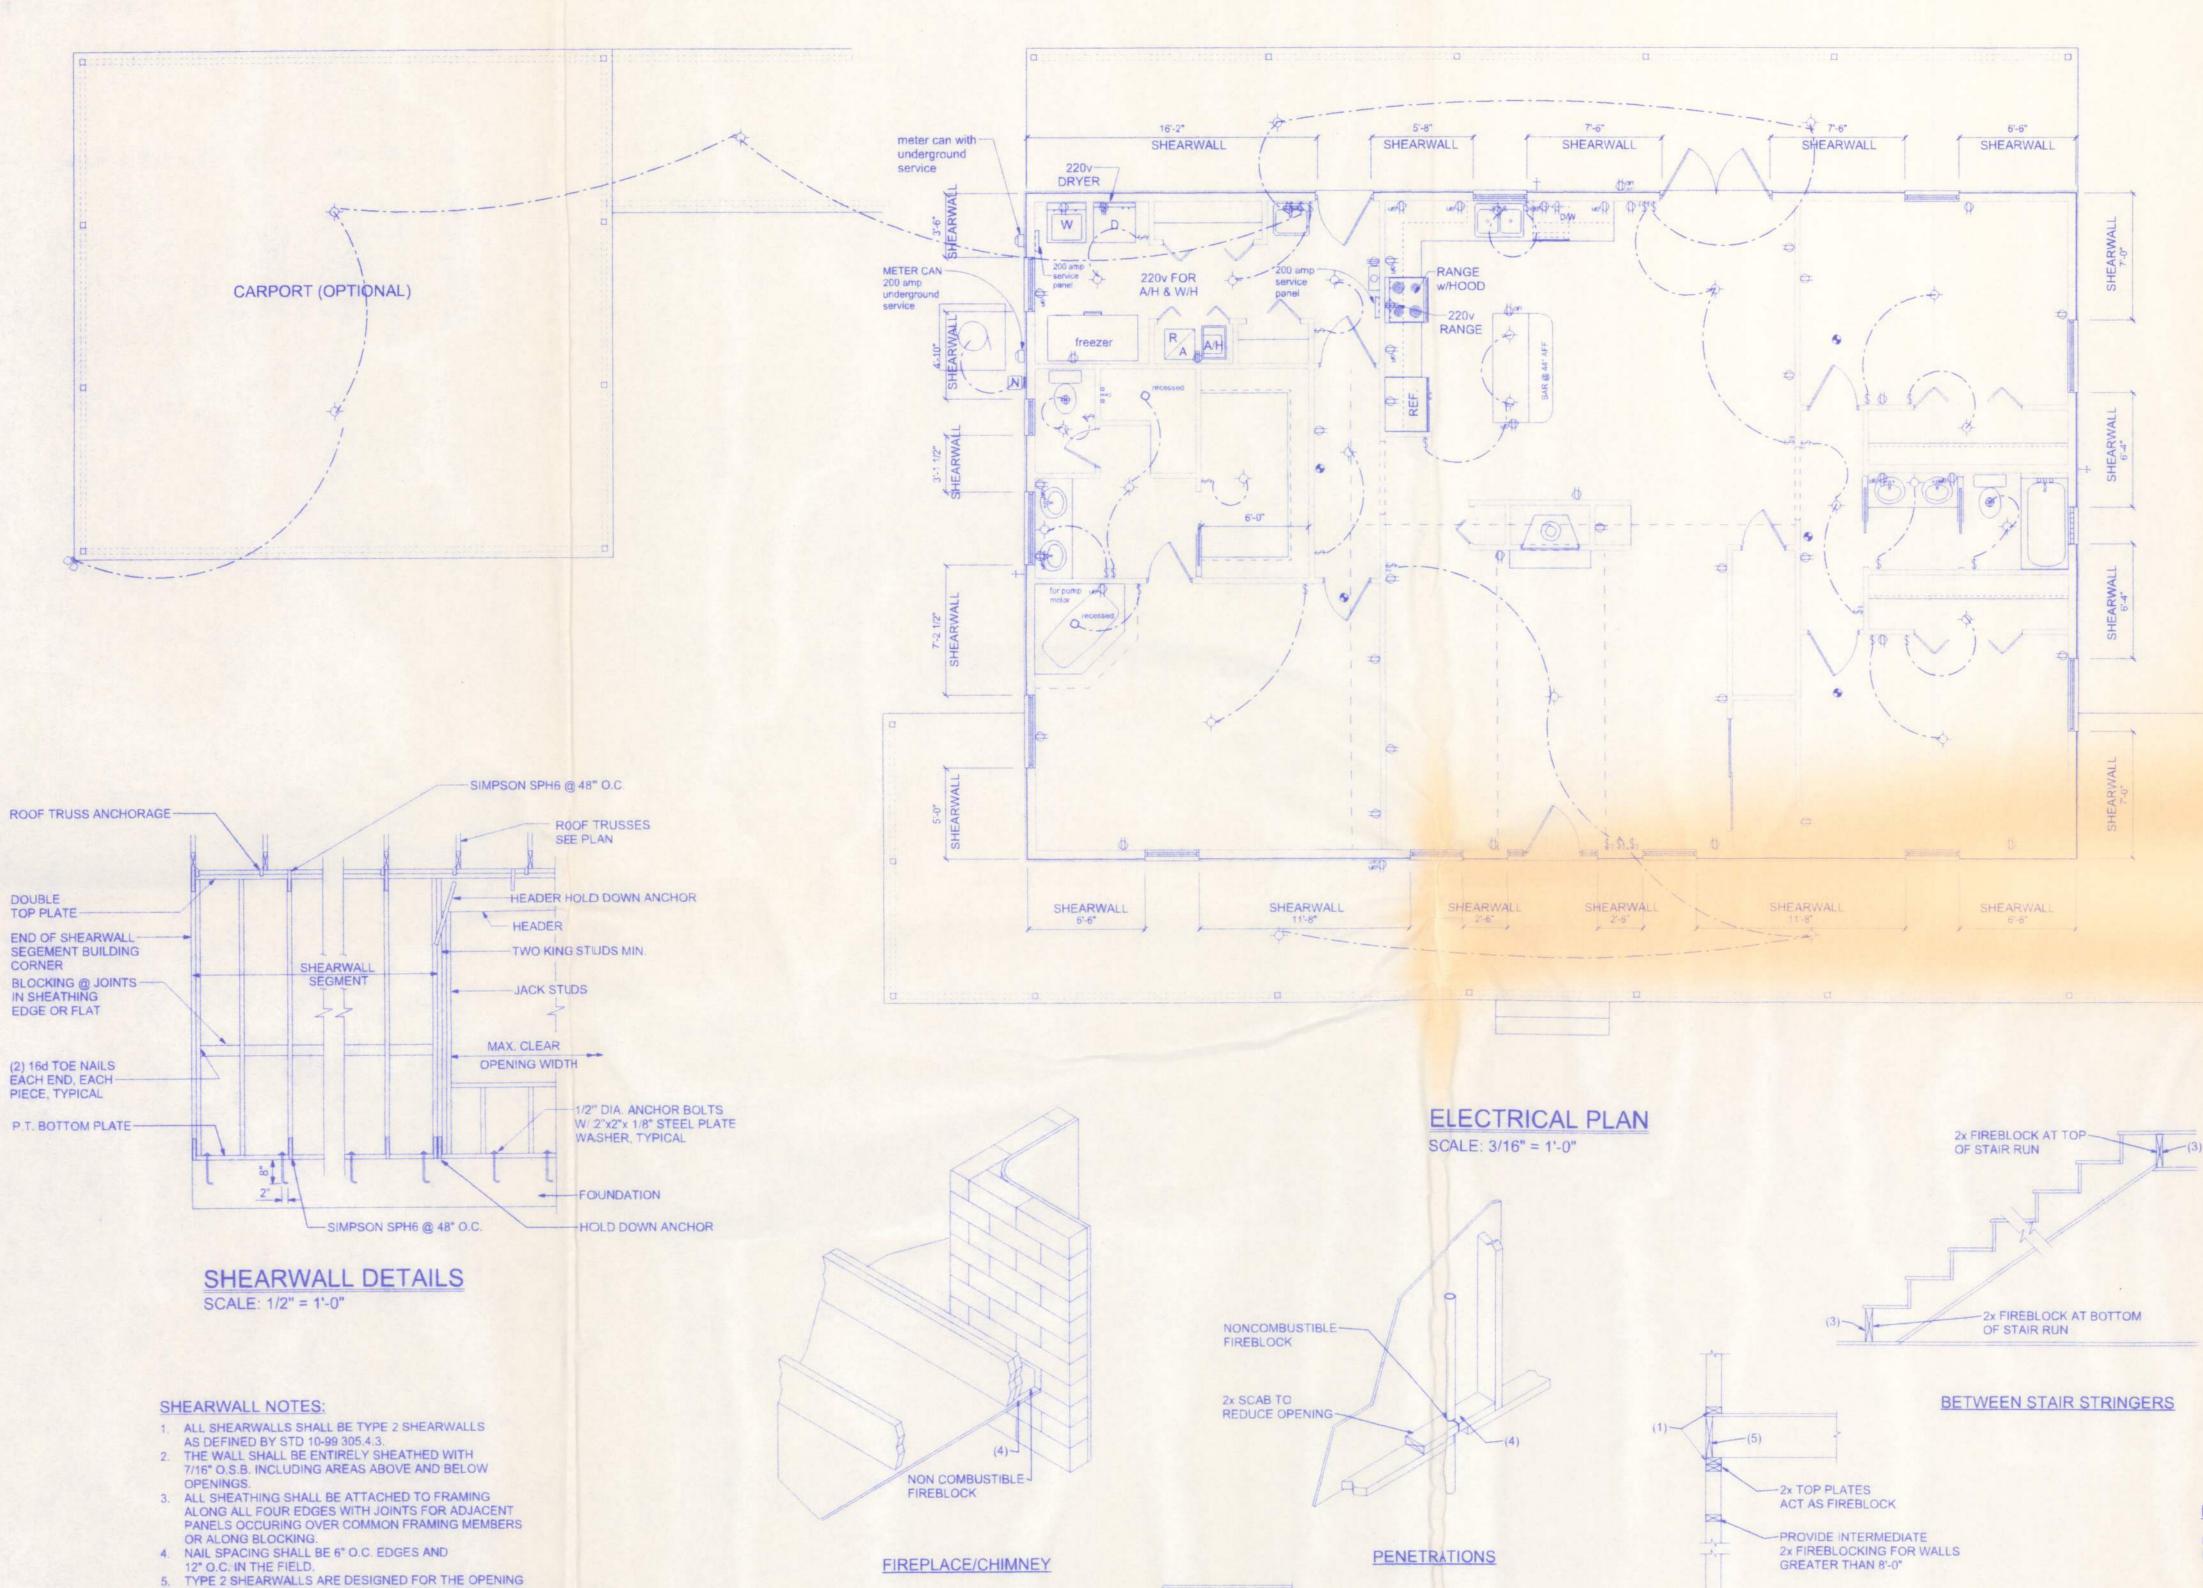

-ADD 2x FIREBLOCK

SOFFIT/DROPPED CLG.

CUT BETWEEN STUDS

IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE

5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE

BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5

16d TOE NAILS

EACH END

ie. FOR 8'-0" WALLS - (2'-3").

UP TO 6'-0" (1) 2x4 OR (1) 2x6

> 6' TO 9'-0" (3) 2x4 OR (1) 2x6

> 9' TO 12'-0" (5) 2x4 OR (2) 2x6

OPENING WIDTH

ELECTRICAL	SYMBOL
double spotlight	ap
recessed light	0
Meter can	6
electric motor	O
electrical panel	(1
meter can	۵
non-fused disconnect	N
50 cfm exhaust fan	*
light	·\$-
outlet	0
outlet 220v	•
outlet gfi	Ø.
smoke detector	•
switch	\$
switch 3 way	\$,
weather proof gfi	de

## **ELECTRICAL NOTES:**

1 ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE, LATEST EDITION, AND ALL OTHER APPLICABLE LOCAL CODES AND ORDINANCES.

2. OPTIONAL SECURITY LIGHT SWITCH LOCATIONS TO BE MADE DURING CONSTRUCTION.

3. PREWIRE LOW VOLTAGE CONTROL WIRING FOR ELECTRIC GARAGE DOOR OPENERS.

4. PROVIDE WIRING AS REQUIRED FOR AIR COND-ITIONING, HEATING, AND WATER HEATING EQUIPMENT.

ALL SMOKE DETECTORS TO BE WIRED TOGETHER TO ACTUATE ALL ALARMS IF ANY ONE UNIT IS ACTUATED.

## ELECTRICAL PLAN NOTES

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.

INSTALLATION SHALL BE PER NAT'L ELECTRIC CODE.

ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER INSTALL INSIDE AND NEAR ALL BEDROOMS.

TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.

ELECTRICAL CONT'R SHALL PREPARE "AS-BUILT" SHOP DWGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADD'NS TO THE ELEC. PLAN. RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT Nr., DESCRIPTION & BRKR, SERVICE ENT. & ALL UNDERGROUND WIRE LOCATIONS/ROUTING/DEPTH. RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT TYPE W/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY

ALL BRANCH CIRCUITS THAT SUPPLY 125-VOLT, SINGLE PHASE, 15 AND 20 AMP OUTLETS INSTALLED IN DWELLING UNIT BEDROOMS SHALL BE PROTECTED BY AN ARC FAULT CIRCUIT INTERRUPTER LISTED TO PROVIDE PROTECTION OF THE ENTIRE BRANCH CIRCUIT.

## FIREBLOCKING NOTES:

-2x BOTTOM PLATE

PLATFORM FRAMING

ACTS AS FIREBLOCK

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS

1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.

2. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.

3. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF

THE RUN.

4. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH PYROPANEL MULTIFLEX SEALANT

5. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.