

BEARING HEIGHT SCHEDULE

9' 1-11/16"

NOTES:

- 1) REFER TO HIB 91 RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING. REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED
- 2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DESIGNED TO DETAIL VOS FOR ALTERNATE BRACING REQUIREMENTS
- 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER
- 4) ALL TRUSSES ARE DESIGNED FOR 2' O.C. MAXIMUM SPACING, UNLESS OTHERWISE NOTED
- 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED
- 6) 5x42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP
- 7) BEARING ADJ. INTEL. (HQR) TO BE FURNISHED BY BUILDER.



Jacksonville
PHONE 904-772-6100 FAX 904-772-1973


Tampa
PHONE 813-621-4831 FAX 813-628-8996

Freeport
PHONE 850-835-4541 FAX 850-635-6835

IC CONSTRUCTION

MICHAUD RES.

DATE	5-14-19	DESIGNED BY	KLH	ORIGINAL ESTIMATE	1767895
SCALE	1/4" = 1'-0"	INTERVIEW		REV. DATE	1767895

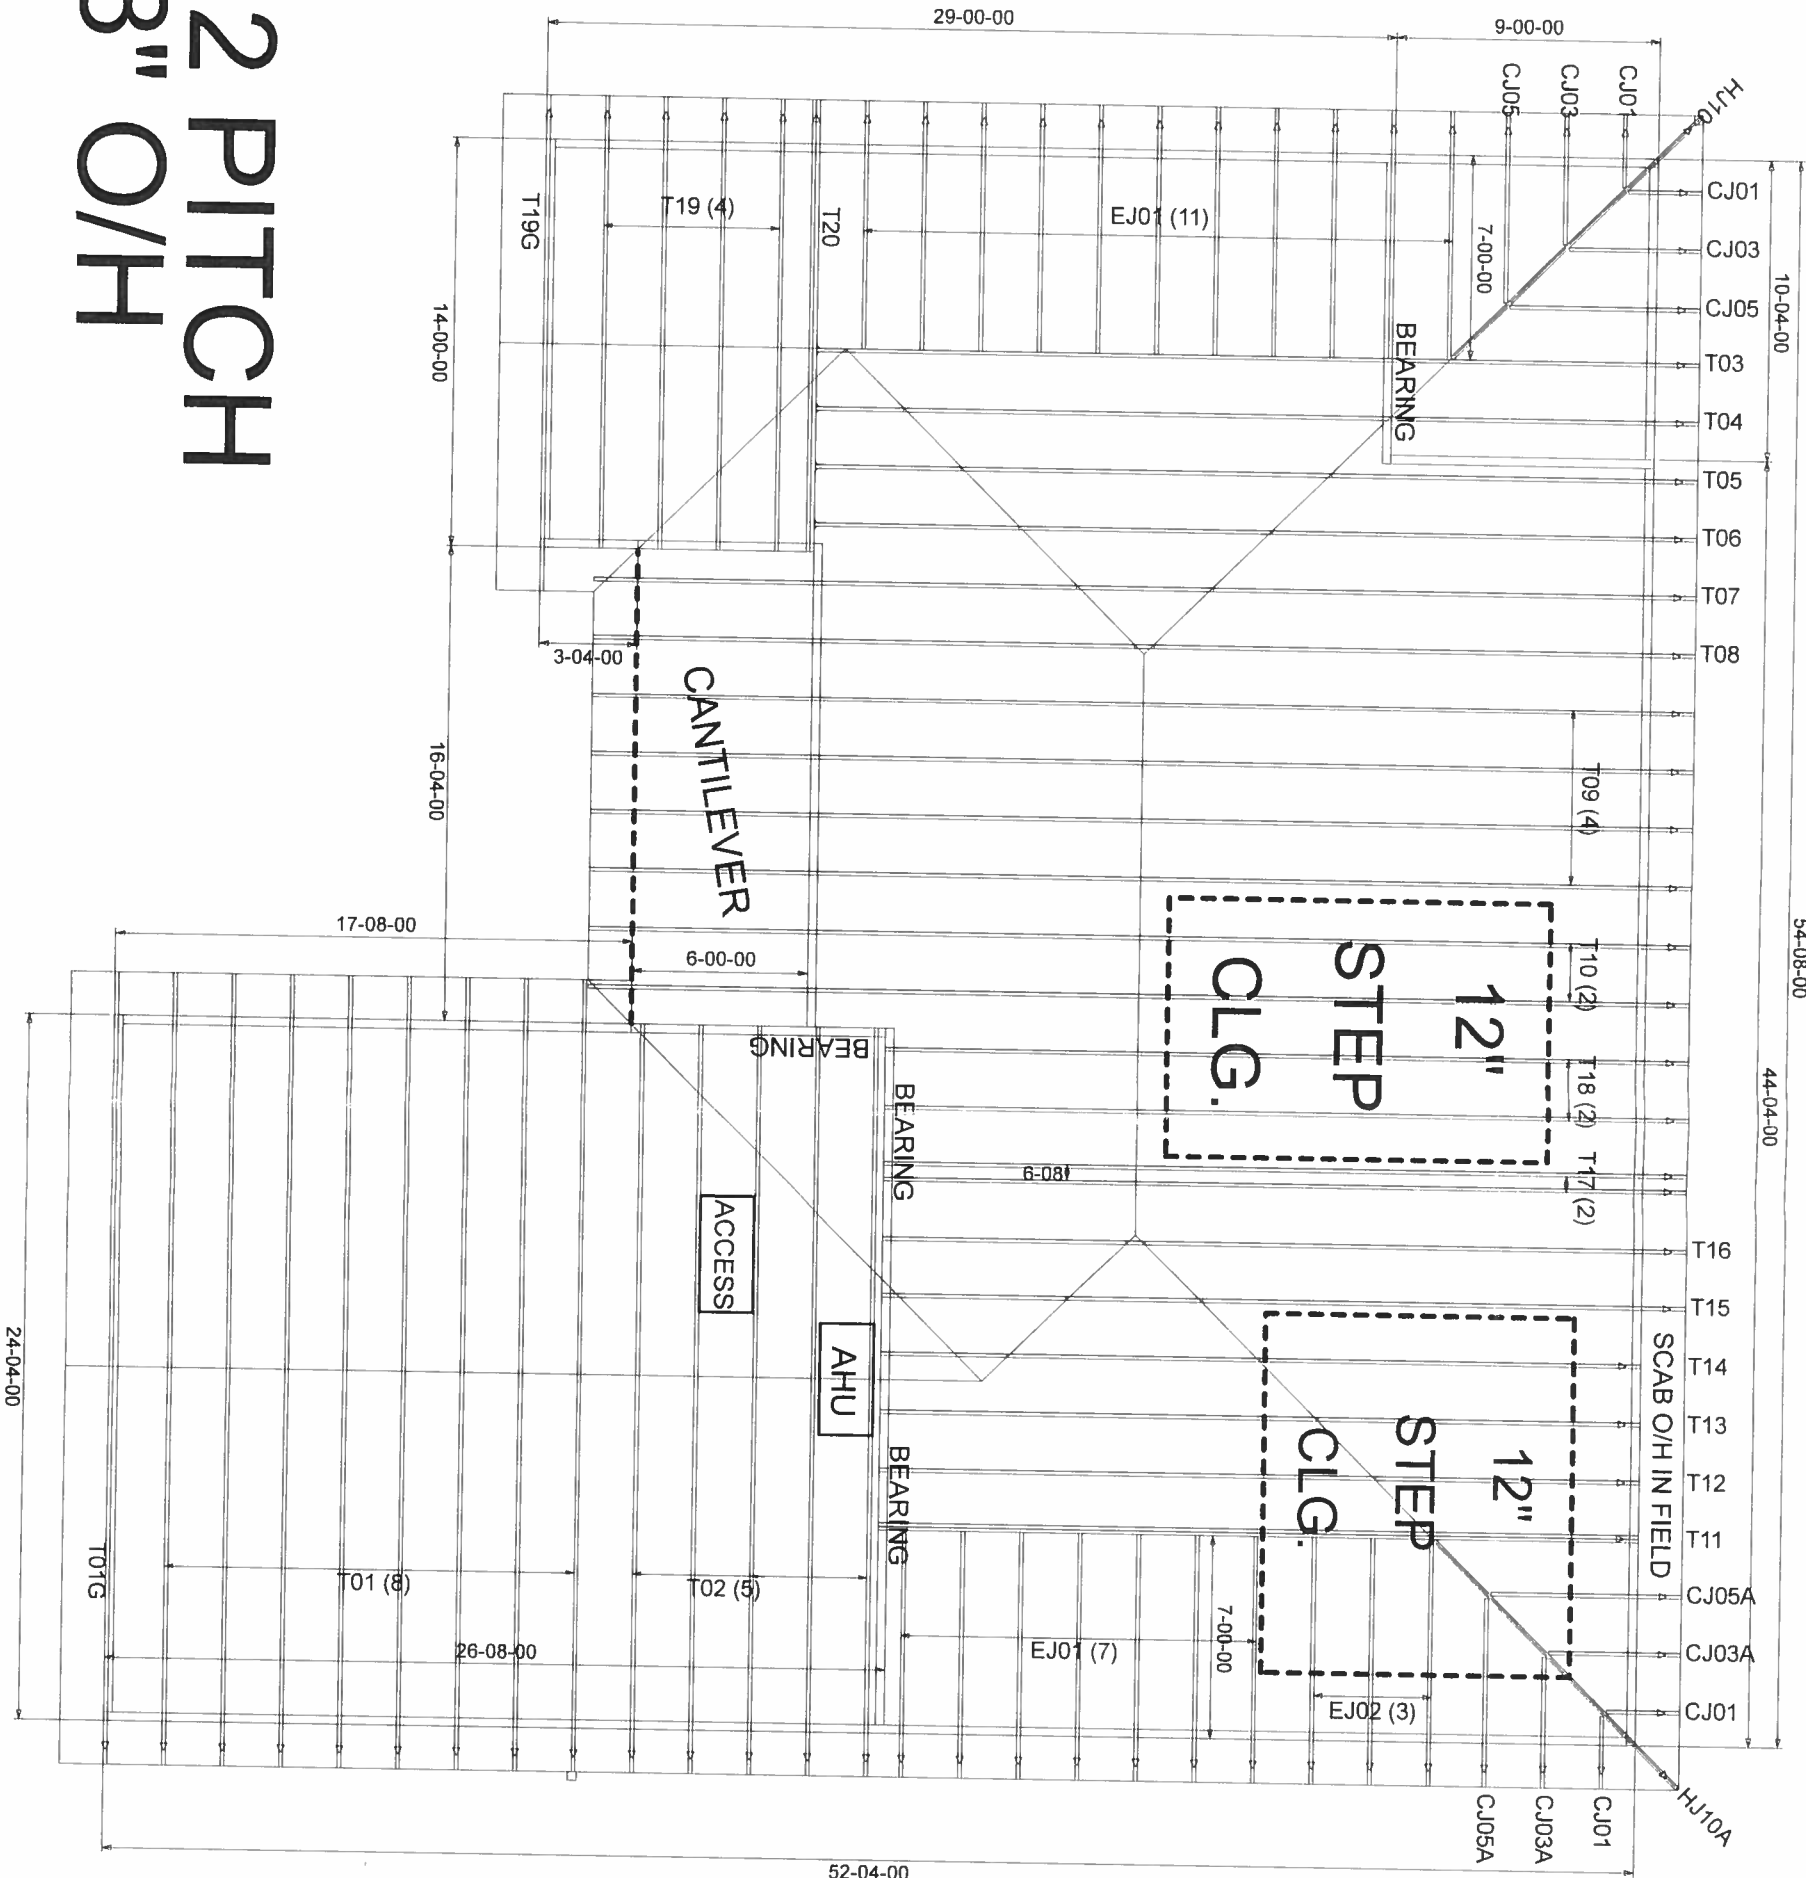

6/12 PITCH
18" O/H

FL Approval Codes - Mitek Plates #'s 2197.2 - 2197.4, Versa-Lam #1644-R4 & BCI Joists #1392-R4