


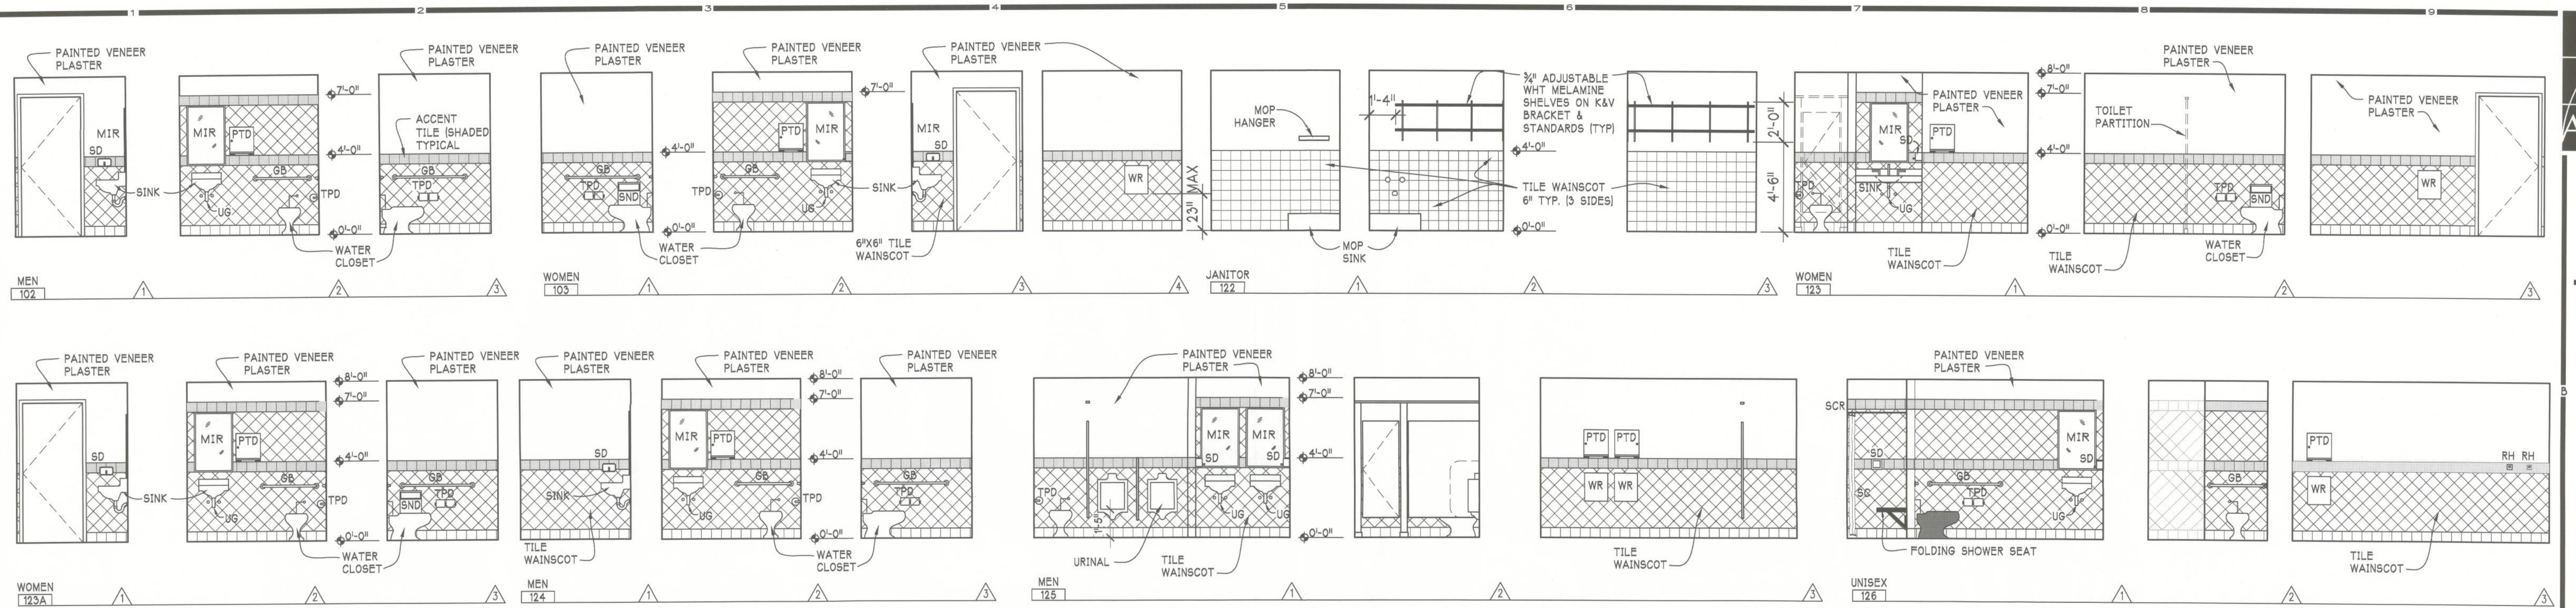


INTERIOR ELEVATIONS OF TOILETS


SCALE: 1/4" = 1'-0"

SD = SOAP DISPENSER
PTD = PAPER TOWEL DISPENSER
SND = SANITARY NAPKIN DISPOSAL
TPD = DBL TOILET PAPER DISPENSER
WR = WASTE RECEPTACLE
RH = ROBE HOOK
MBH = MOP & BROOM HOLDER
WH = WATER HEATER - SEE PLUMBING DRWG-
FD = FLOOR DRAIN - SEE PLUMBING DRWG-

PROVIDED BY AND INSTALLED
BY G.C. - PROVIDE BLOCKING
AS REQUIRED

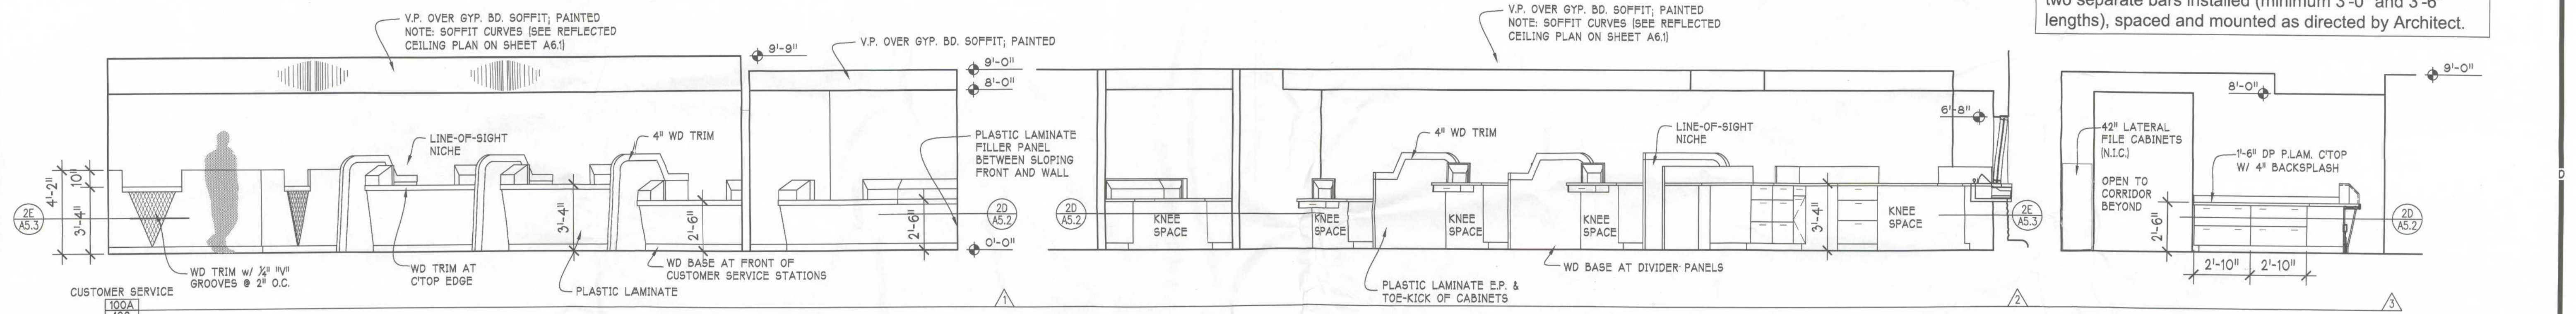


NOTE: Typical grab bars at handicapped toilets shall be two separate bars installed (minimum 3'-0" and 3'-6" lengths), spaced and mounted as directed by Architect.

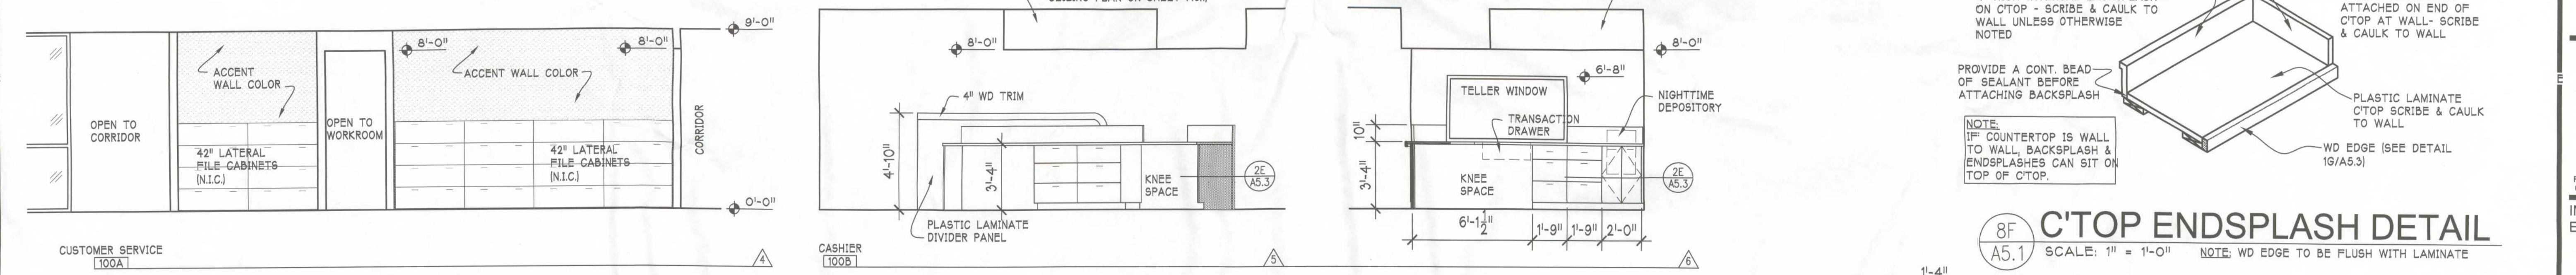

C'TOP ENDSPLASH DETAIL

SCALE: 1" = 1'-0" NOTE: WD EDGE TO BE FLUSH WITH LAMINATE

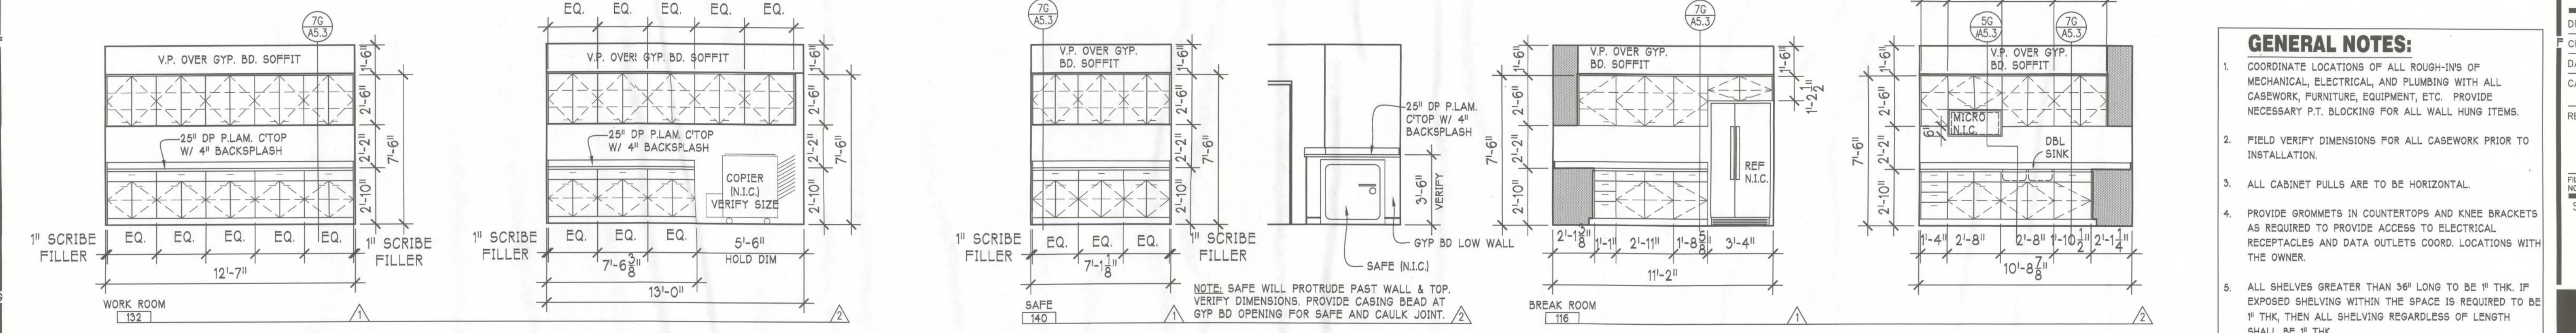

GENERAL NOTES:

- COORDINATE LOCATIONS OF ALL ROUGH-INS OF MECHANICAL, ELECTRICAL, AND PLUMBING WITH ALL CASEWORK, FURNITURE, EQUIPMENT, ETC. PROVIDE NECESSARY P.T. BLOCKING FOR ALL WALL HUNG ITEMS.
- FIELD VERIFY DIMENSIONS FOR ALL CASEWORK PRIOR TO INSTALLATION.
- ALL CABINET PULLS ARE TO BE HORIZONTAL.
- PROVIDE GROMMETS IN COUNTERTOPS AND KNEE BRACKETS AS REQUIRED TO PROVIDE ACCESS TO ELECTRICAL RECEPTACLES AND DATA OUTLETS COORD. LOCATIONS WITH THE OWNER.
- ALL SHELVES GREATER THAN 36" LONG TO BE 1" THK. IF EXPOSED SHELVING WITHIN THE SPACE IS REQUIRED TO BE 1" THK, THEN ALL SHELVING REGARDLESS OF LENGTH SHALL BE 1" THK.
- ALL SHELVES TO BE EDGE BANDED ON ALL 4 SIDES.

INTERIOR ELEVATIONS

SCALE: 1/4" = 1'-0"

NOTE: C'TOP TO FIT TIGHT TO WALL WITH ONLY A CAULK LINE. FIELD VERIFY, MEASURE AND FABRICATE: COUNTERTOP ACCORDINGLY.