
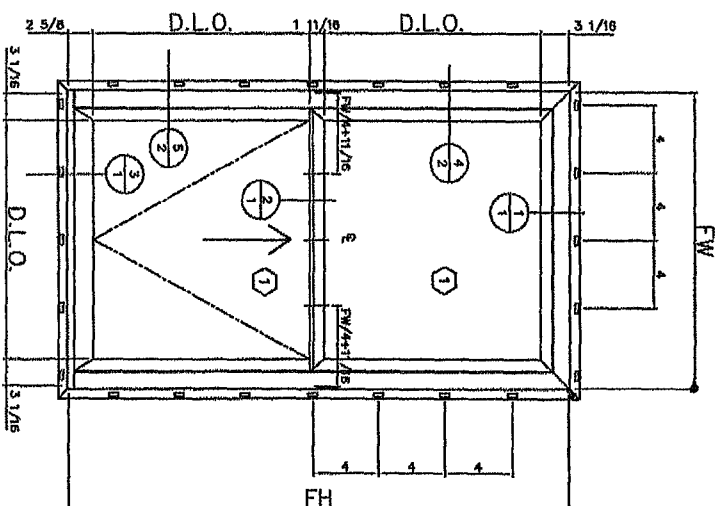


ELEVATION

- (1) TEST (AAMA 101)
FOR DP-50

- | | | |
|---|---|--|
| <p>① GLASS TIE, 3/4" INSULATED UNIT
 1-A : 3/32" LOW-EAN x 9/16" AIR x 3/32" CL-PAN
 (SH350, SH350Z, SH460, SH460Z)
 1-B : 1/8" LOW-EAN x 1/2" AIR x 1/8" CL-PAN
 (SH350, SH350Z, SH460Z, SH460Z)
 ● (TW - 5 5/32") x (H)2-2 1/16")</p> | <p>INDICATES LOCK LOCATION</p> <p>FR3363 ONE LOCK(CEILING)
 FW3365 TWO LOCK(TW-4/11/16)</p> | <p>STATION</p> <p>STYLE VIEW</p> <p>SCALE 1/2"</p> |
|---|---|--|

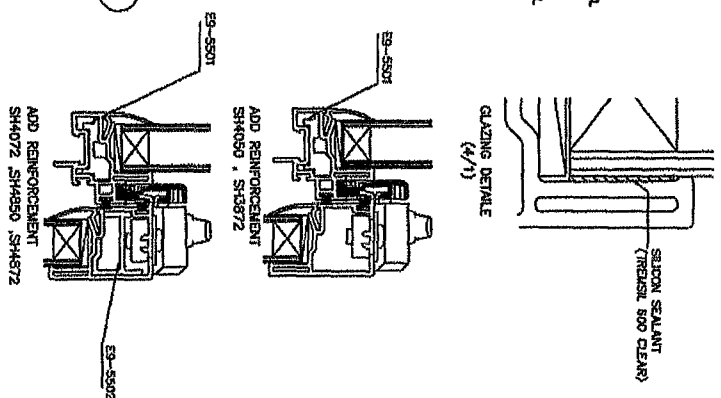

AS TESTED UNLESS
OTHERWISE NOTED

Abstract Laboratory

8)	CRIME	SCALE
SECTION	STYLE VIEW	1/2
SINGLE HUNG (DP-50)		
SEASON	FEBS-7000-0105	ICV
APPROVED BY	DATE	SHEET NO.
MAN	JLCMD	1 OF 2
	03/18/05	

NO.	DESCRIPTION	ST	DATE
1	JOHN SCOTT	12	01/02



plastpro

5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045


Smooth / Wood Grain / White Wood Grain Rustic / Mahogany Series N Fiberglass Door INSWING / OUTSWING "NON-IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 2010 Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with Section 1609.1.2 of the FBC.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	Typical elevation, design pressures & general notes
2	Door panel details
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring - 2x buck masonry construction
6	Frame anchoring - 1x buck masonry construction
7	Bill of Materials, glazing detail & components

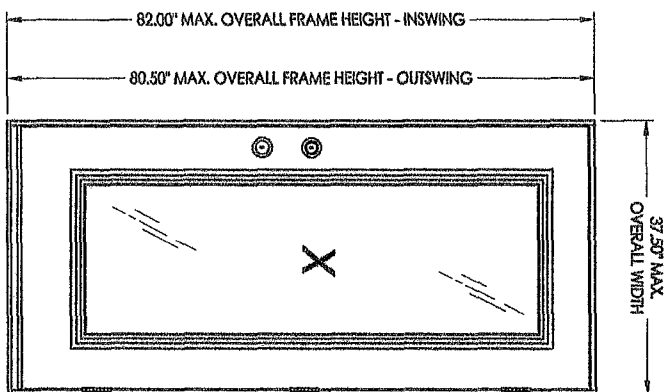

SWING	MAX. FRAME DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)
INSWING	37.50" x 82.00"	G1	+47.0 -50.0
OUTSWING	37.50" x 90.50"		+50.0 -50.0


DATE 02/15/12 SCALE N.T.S. DWG. BY JK CHK. BY LFS DRAWING NO. FL-15213.14 SHEET 1 OF 2		PRODUCT: PLASTPRO INC. FIBERGLASS DOOR PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES	Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 1782-0012 Lyndon F. Schmidt, P.E. No. 43409
NO. DATE REVISIONS		BY	

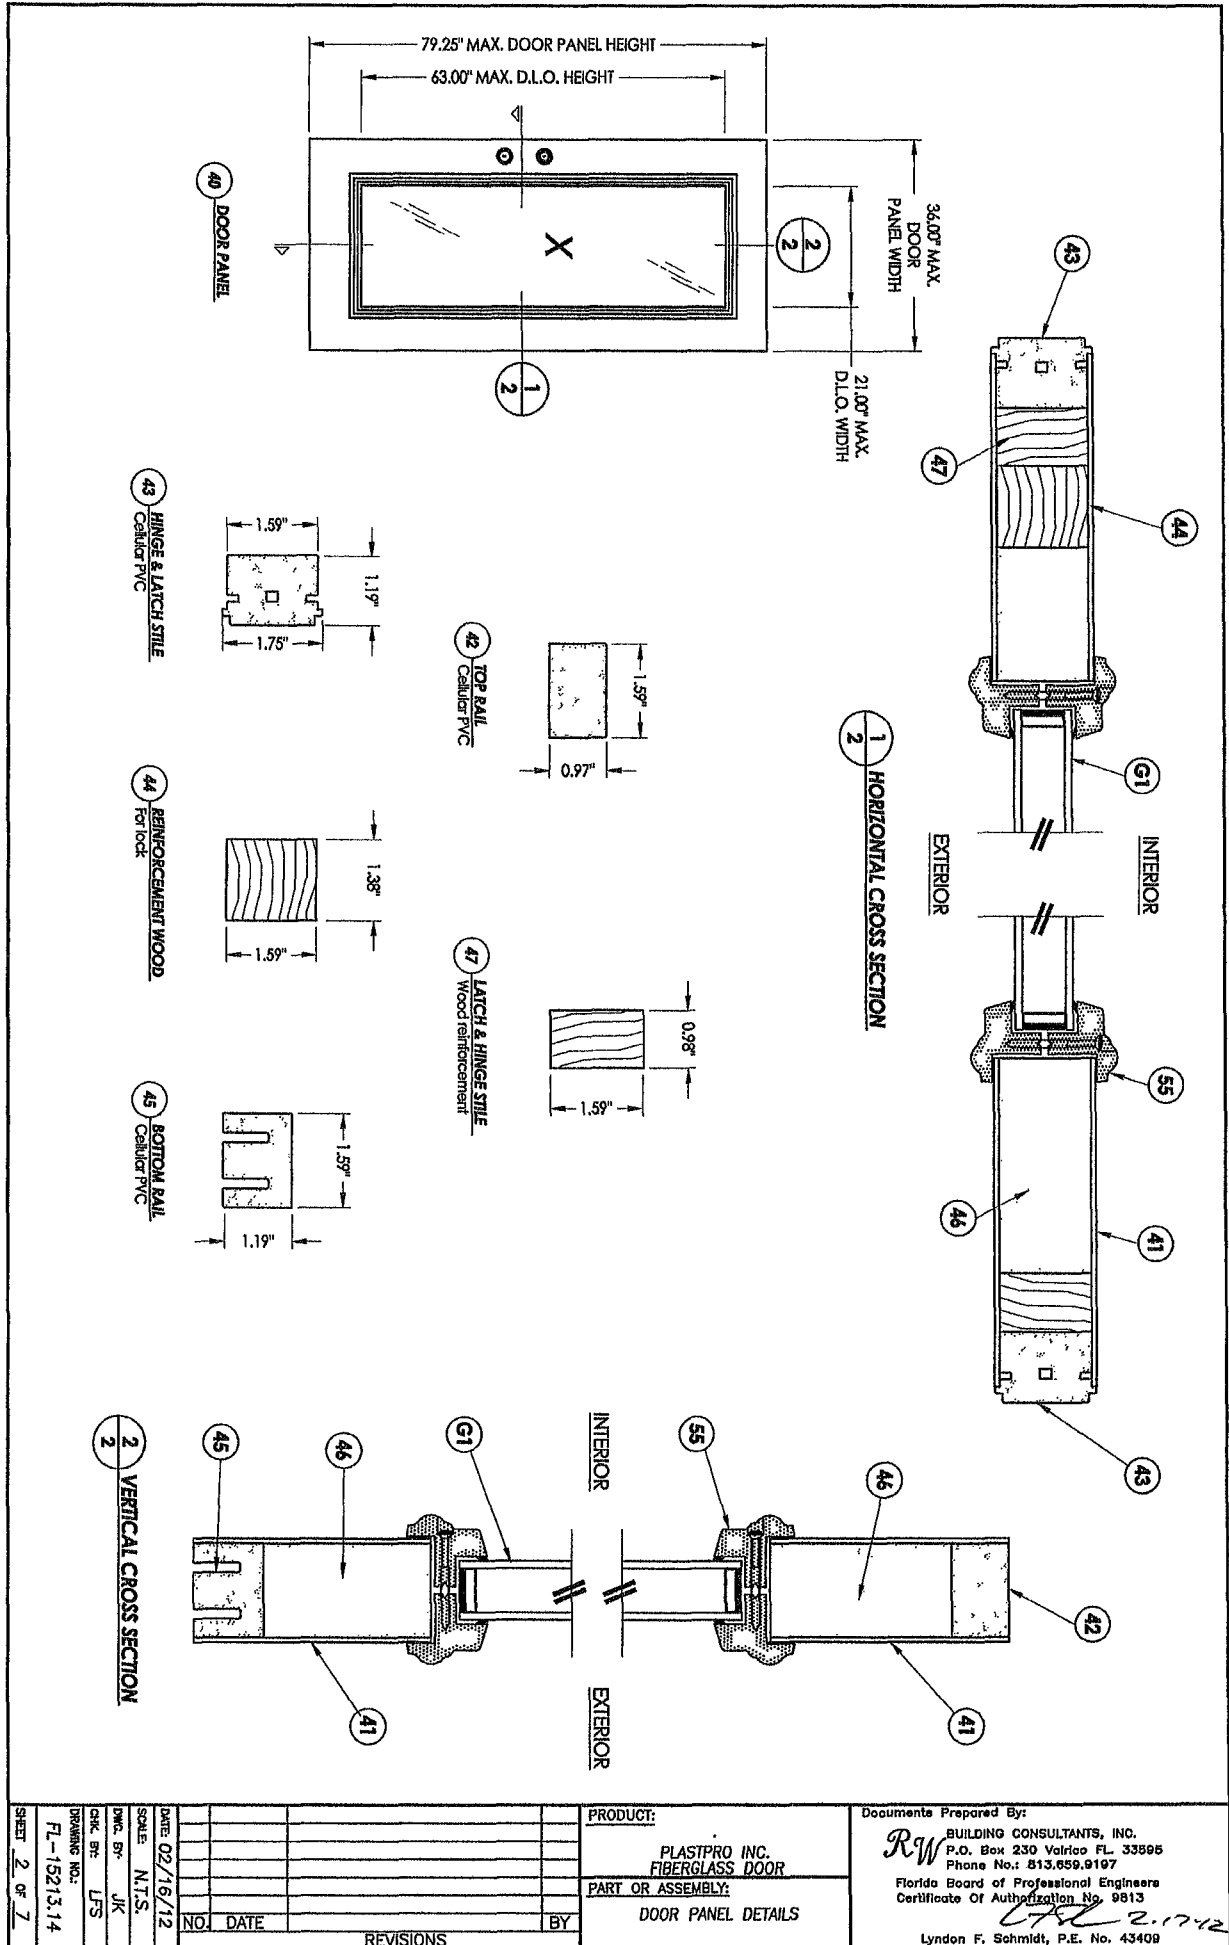



NO.	DATE	REVISIONS	BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			
46			
47			
48			
49			
50			
51			
52			
53			
54			
55			
56			
57			
58			
59			
60			
61			
62			
63			
64			
65			
66			
67			
68			
69			
70			
71			
72			
73			
74			
75			
76			
77			
78			
79			
80			
81			
82			
83			
84			
85			
86			
87			
88			
89			
90			
91			
92			
93			
94			
95			
96			
97			
98			
99			
100			

PRODUCT:	PLASTPRO INC. FIBERGLASS DOOR
PART OR ASSEMBLY:	DOOR PANEL DETAILS


Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
Lyndon F. Schmidt, P.E. No. 43409

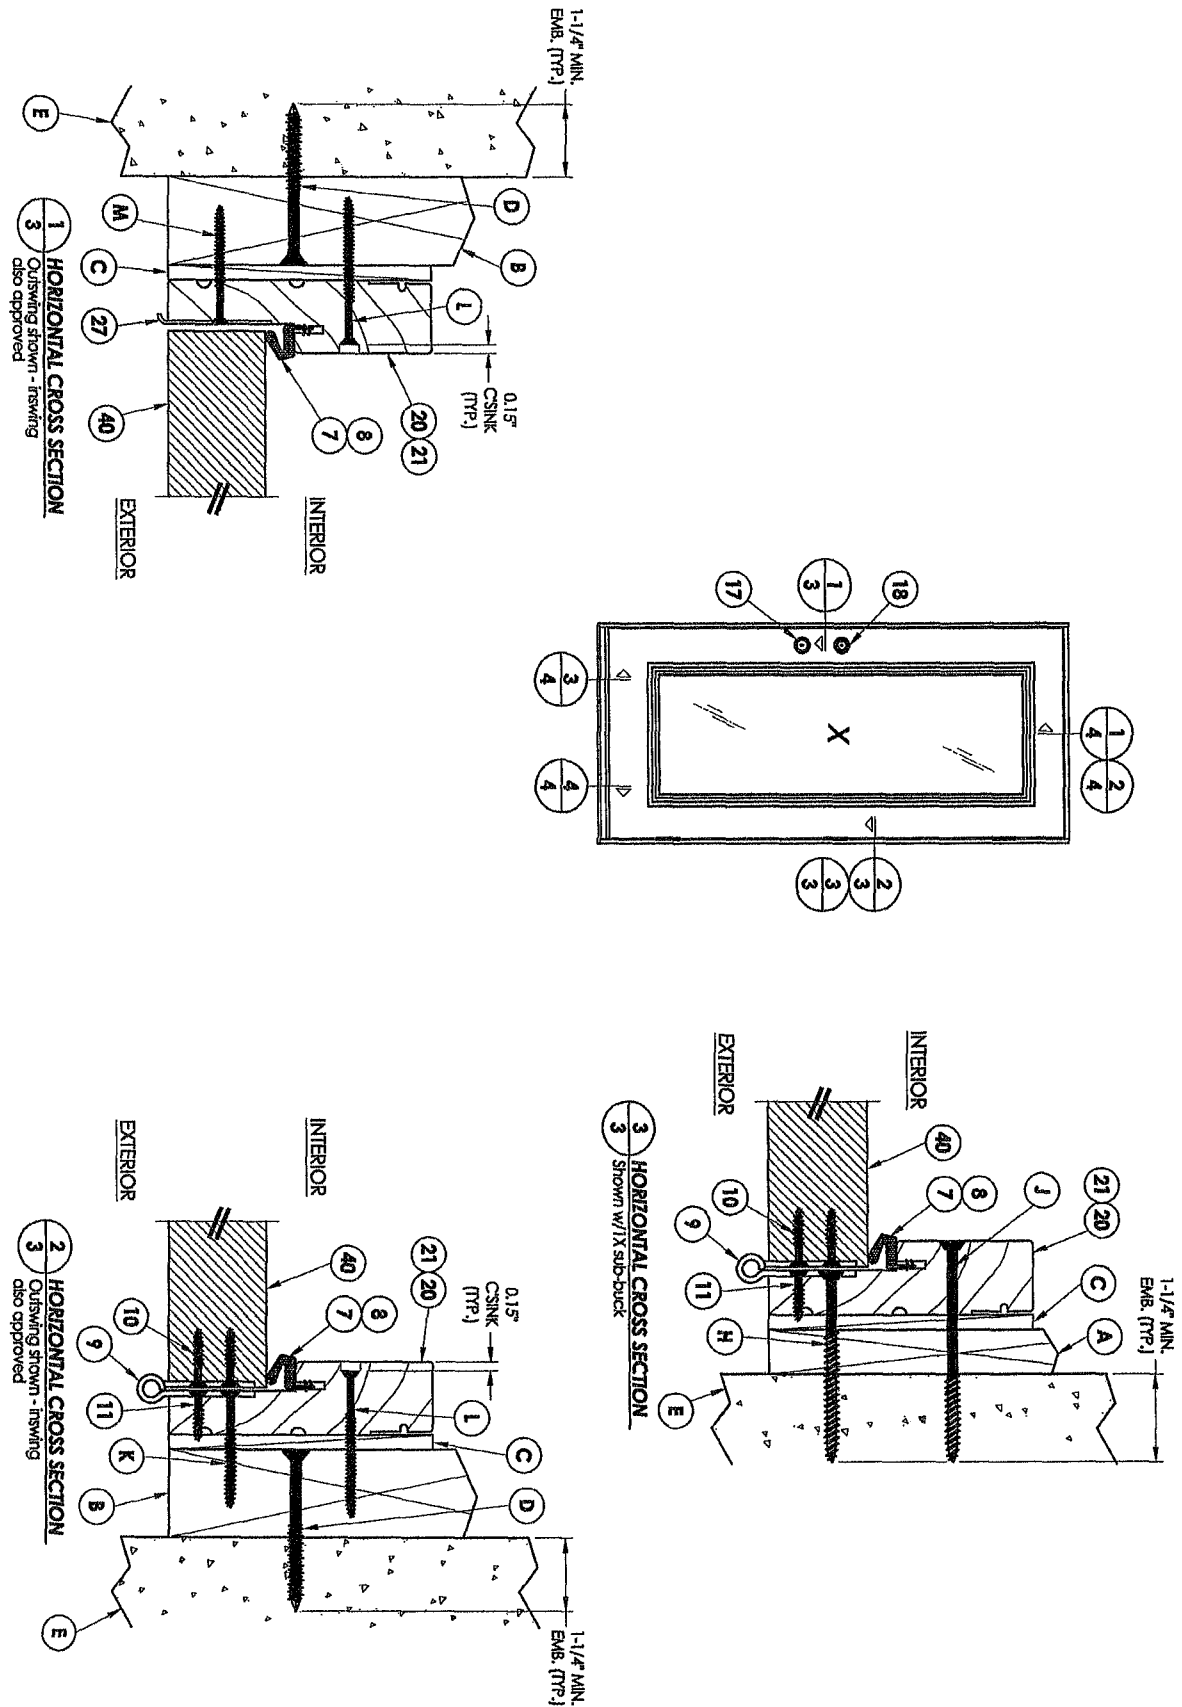


DATE 02/16/12 SCALE: N.T.S. DWG. BY: JK CHK. BY: LFS DESIGN NO.: FL-15213.14 SHEET 3 of 7										PRODUCT: PLASTPRO INC. FIBERGLASS DOOR PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS										Documents Prepared By: <i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate of Authorization No. 9813 <i>CS</i> 2/17/12 Lyndon F. Schmidt, P.E. No. 43409									
NO. DATE										REVISIONS										BY									

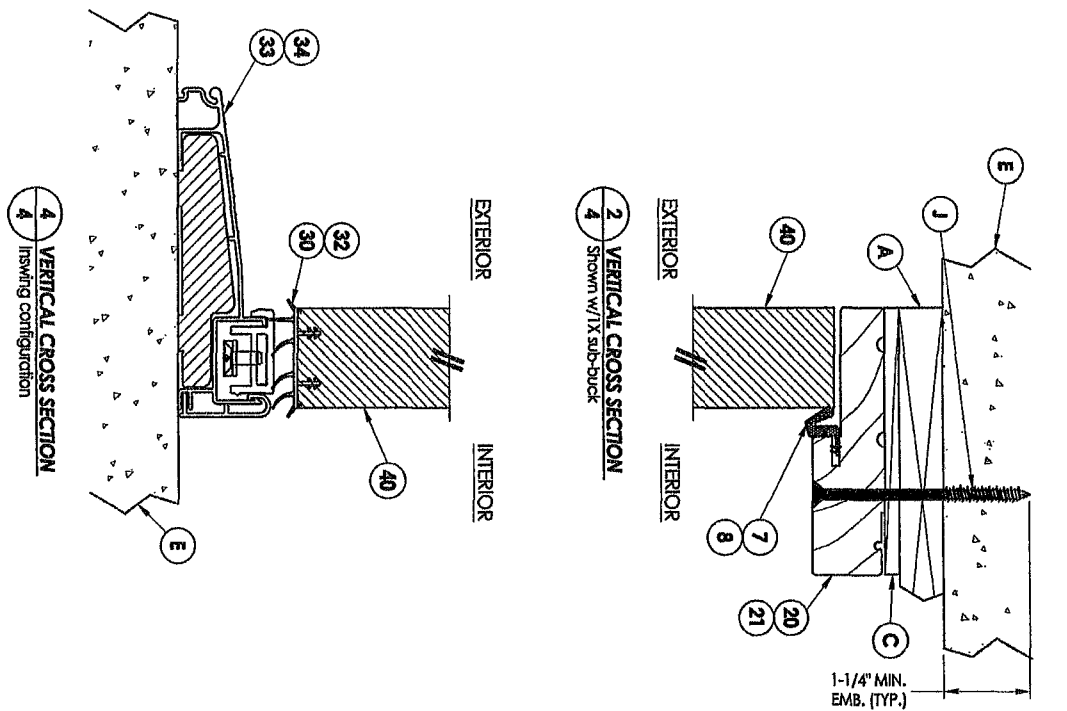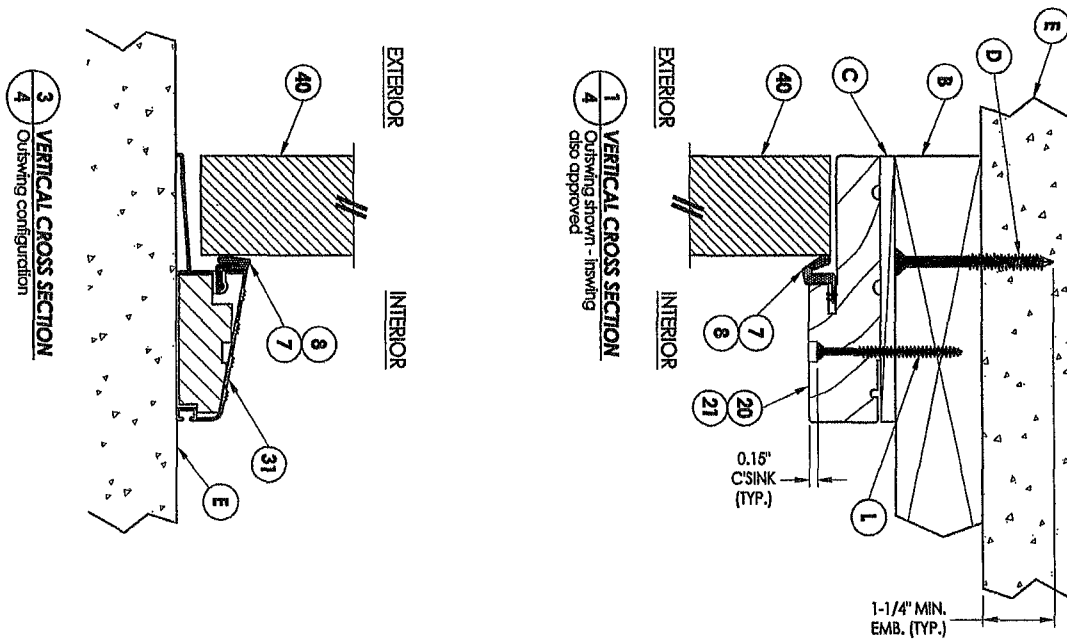


SHEET 4 OF 7				DATE 02/16/12		SCALE N.T.S.		DWG. BY JK		CHK. BY LFS		DRAWING NO.: FL-15213.14		<table><tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td colspan="10">NO.</td><td colspan="2">DATE</td><td colspan="2"></td><td colspan="2">BY</td></tr><tr><td colspan="16">REVISIONS</td></tr></table>																		NO.										DATE				BY		REVISIONS																<table><tr><td colspan="4">PRODUCT:</td></tr><tr><td colspan="4">PLASTPRO INC.</td></tr><tr><td colspan="4">FIBERGLASS DOOR</td></tr><tr><td colspan="4">PART OR ASSEMBLY:</td></tr><tr><td colspan="4">VERTICAL CROSS SECTIONS</td></tr></table>				PRODUCT:				PLASTPRO INC.				FIBERGLASS DOOR				PART OR ASSEMBLY:				VERTICAL CROSS SECTIONS				<table><tr><td colspan="4">Documents Prepared By:</td></tr><tr><td colspan="4">RW BUILDING CONSULTANTS, INC.</td></tr><tr><td colspan="4">P.O. Box 230 Valrico FL 33595</td></tr><tr><td colspan="4">Phone No.: 813.659.9197</td></tr><tr><td colspan="4">Florida Board of Professional Engineers</td></tr><tr><td colspan="4">Certificate Of Authorization No. 9813</td></tr><tr><td colspan="4">Lyndon F. Schmidt, P.E. No. 43409</td></tr></table>				Documents Prepared By:				RW BUILDING CONSULTANTS, INC.				P.O. Box 230 Valrico FL 33595				Phone No.: 813.659.9197				Florida Board of Professional Engineers				Certificate Of Authorization No. 9813				Lyndon F. Schmidt, P.E. No. 43409			
NO.										DATE				BY																																																																																																									
REVISIONS																																																																																																																							
PRODUCT:																																																																																																																							
PLASTPRO INC.																																																																																																																							
FIBERGLASS DOOR																																																																																																																							
PART OR ASSEMBLY:																																																																																																																							
VERTICAL CROSS SECTIONS																																																																																																																							
Documents Prepared By:																																																																																																																							
RW BUILDING CONSULTANTS, INC.																																																																																																																							
P.O. Box 230 Valrico FL 33595																																																																																																																							
Phone No.: 813.659.9197																																																																																																																							
Florida Board of Professional Engineers																																																																																																																							
Certificate Of Authorization No. 9813																																																																																																																							
Lyndon F. Schmidt, P.E. No. 43409																																																																																																																							

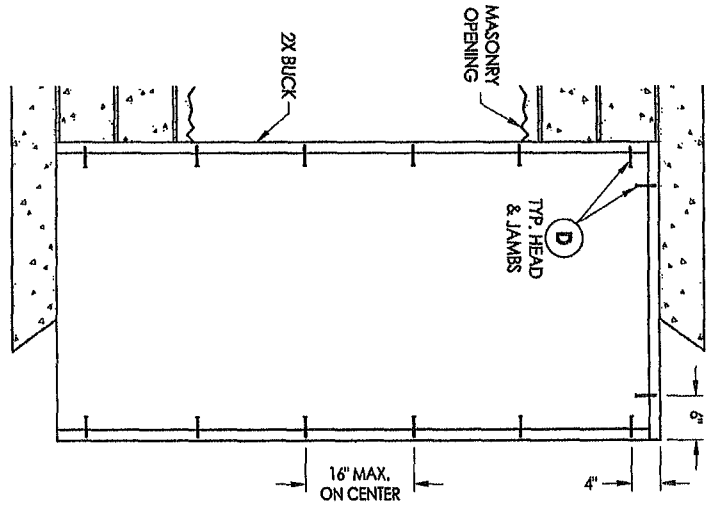


BUCK ANCHORING



STRIKE JAMB

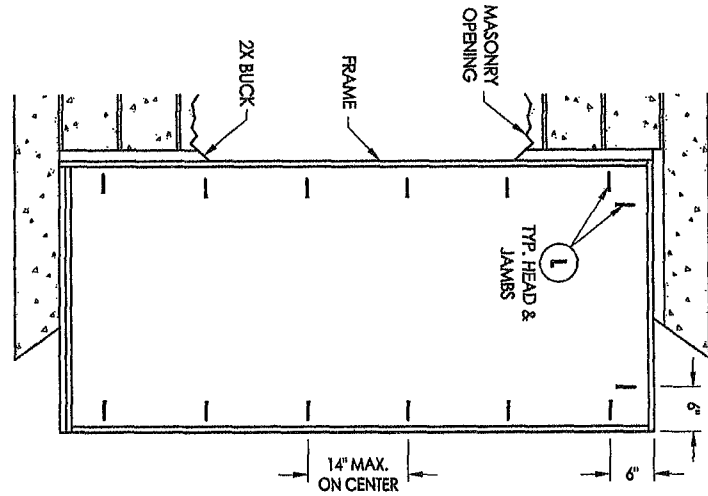

FRAME ANCHORING
Masonry 2x buck construction




HINGE JAMB

CONCRETE ANCHOR NOTES:

1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance of the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.
2. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-1/4"	2-1/2"	3"
ELCO	1/4"	1-1/4"	1"	4"

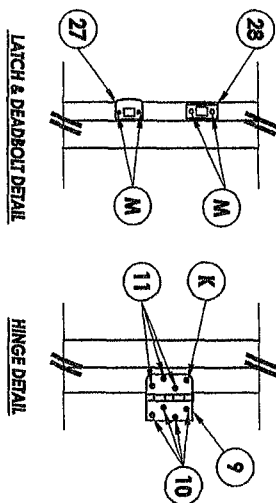

LATCH & DEADBOLT DETAIL


HINGE DETAIL

SHEET 5 OF 7	DRAWING NO.: FL-15213.14	DATE: 02/16/12	SCALE: N.T.S.	CHK. BY: LFS	DATE: 02/16/12	NO.	DATE	BY	REVISIONS	PRODUCT: PLASTPRO INC. FIBERGLASS DOOR	PART OR ASSEMBLY: BUCK AND FRAME ANCHORING 2X BUCK MASONRY CONSTRUCTION	Documents Prepared By: R.W. BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 Lyndon F Schmidt, P.E. No. 43409


CONCRETE ANCHOR NOTES:

1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
2. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.
3. Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-1/4"	2-1/2"	3"
ITW	3/16"	1-1/4"	2-5/8"	2-1/4"




STRIKE JAMB

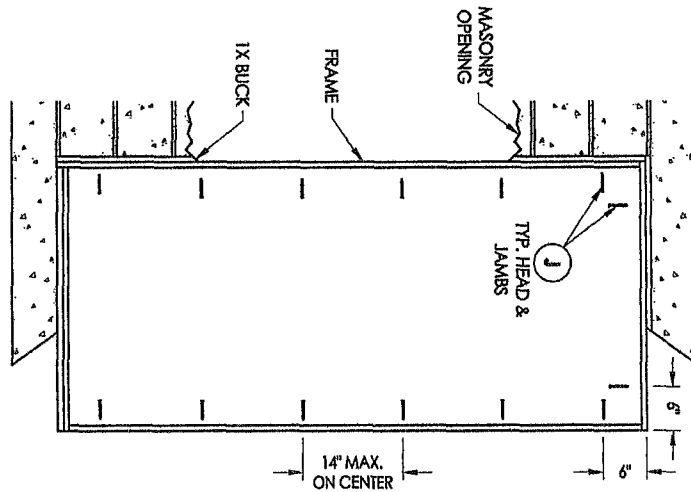


FRAME ANCHORING
Masonry 1x BUCK construction



HINGE JAMB




LATCH & DEADBOLT DETAIL




HINGE DETAIL

DATE 02/16/12		PRODUCT:		Documents Prepared By:	
SCALE N.T.S.		PLASTPRO INC.		BUILDING CONSULTANTS, INC.	
DWG. BY JK		FIBERGLASS DOOR		P.O. Box 230 Valrico FL 33595	
CHK. BY LFS		PART OR ASSEMBLY:		Phone No.: 813.669.9197	
DRAWING NO.: FL-15213.14		FRAME ANCHORING 1X BUCK MASONRY CONSTRUCTION		Florida Board of Professional Engineers Certificate Of Authorization No. 9813	
SHEET 6 OF 7		REVISIONS		Lyndon F. Schmidt, P.E. No. 43409	


ITEM	DESCRIPTION	MATERIAL
A	1X BLACK SG >= 0.55	WOOD
B	2X BLACK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	
D	1/4" X 2-3/4" PPH ELCO OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,192 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" PPH ITW CONCRETE SCREW	STEEL
H	1/4" X 3-1/4" PPH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PPH ITW CONCRETE SCREW	STEEL
K	#10 X 2" PPH WOOD SCREW	STEEL
L	#8 X 2-1/2" PPH WOOD SCREW	STEEL
M	#8 X 2" PPH WOOD SCREW	STEEL
N	FORCE 5 WEATHER STRIPPING BY ENDURA	FOAM
7	COMPRESSION WEATHER STRIP GLON 650 BY SCHLEGEL	FOAM
8	4" X 4" BUTT HINGE	STEEL
9	#9 X 1" PPH WOOD SCREW	STEEL
10	#9 X 3/4" PPH WOOD SCREW	STEEL
11	KWIKSET KEFED ENTRY - SIGNATURE SERIES	STEEL
17	KWIKSET DEADBOLT - SIGNATURE SERIES (780)	STEEL
18	FINGER JOINTED PINE FRAME, HEAD & HINGE JAMBS	WOOD
20	POLYMER JAMB	COMP. / VINYL
21	LATCH STRIKE PLATE	STEEL
27	DEADBOLT STRIKE PLATE	VINYL
28	OUTSWING VINYL DOOR BOTTOM SWEEP BY ENDURA	VINYL
30	VINYL DOOR BOTTOM SWEEP #3628 BY HOLM IND.	ALUM. / WOOD
31	INSWING ADJUSTABLE THRESHOLD BY ENDURA	PVC
32	INSWING ADJUSTABLE THRESHOLD BY ENDURA	ALUM. / WOOD
33	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	ALUM. / WOOD
40	DOOR SKIN (MIN. 0.075" THICK)	FIBERGLASS
41	TOP RAIL	CELLULAR/PVC
42	LATCH & HINGE STILE	CELLULAR/PVC
43	REINFORCEMENT WOOD FOR LOCKS (20" LONG)	WOOD
44	BOTTOM RAIL	CELLULAR/PVC
45	POLYURETHANE FOAM BY NAN YA	POLYURETHANE
46	CONTINUOUS LATCH & HINGE STILE REINFORCEMENT	WOOD
47	GLAZING COMPOUND	SILICONE
49	LP LITE ODI/WESTERN REFLECTIONS HP	POLYPROPYLENE
55	GLAZING SPACER	ALUM.
56	#8 X 1-1/2" PPH LITE FRAME SCREW	STEEL

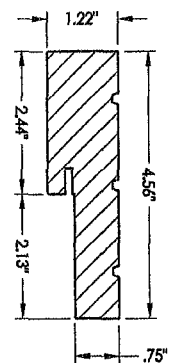


20 HEAD & SIDE Joint

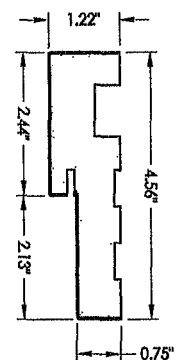


21 HEAD & SIDE Poly fiber jamb

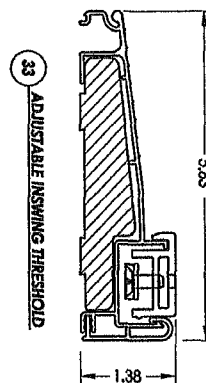


33 ADJUSTABLE INSWING THRESHOLD

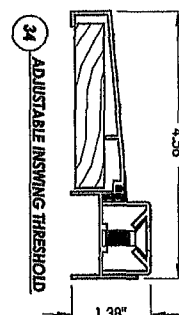

34 ADJUSTABLE INSWING THRESHOLD

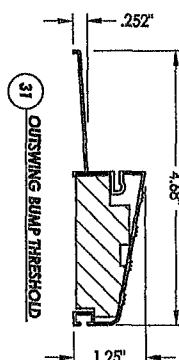


31 OUTSWING BUMP THRESHOLD

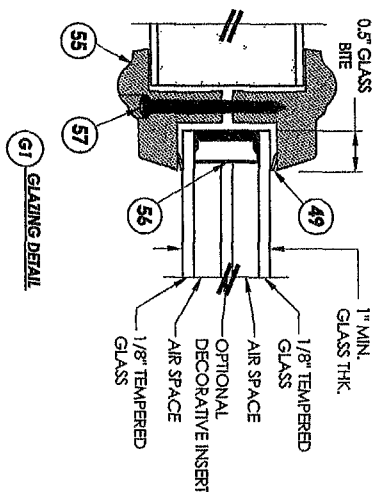

G1 GLAZING DETAIL

PRODUCT: PLASTPRO INC. FIBERGLASS DOOR PART OR ASSEMBLY: BILL OF MATERIALS, GLAZING DETAIL & COMPONENTS		Documents Prepared By: <i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9187 Florida Board of Professional Engineers Certificate of Authorization No. 9813 2.17.12 Lyndon F. Schmidt, P.E. No. 43409	
DATE: 02/16/12 SCALE: N.T.S. CHK. BY: LFS DNG. BY: JK DRAWING NO.: FL-15213.14 SHEET: 2 OF 2		REVISIONS NO. DATE BY	



plastpro

5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045


Smooth / Wood Grain / White Wood Grain
Rustic / Mahogany
Series N Fiberglass Door
INSWING / OUTSWING
"NON-IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 2010 Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with Section 1607.1.2 of the FBC.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS



SHEET #	DESCRIPTION
1	Typical elevation, design pressures, & general notes
2	Door panel details
3	Sidelite panel details
4	Horizontal cross sections
5	Vertical cross sections
6	Vertical cross sections
7	Buck and frame anchoring - 2x buck masonry construction
8	Frame anchoring - 1x buck masonry construction
9	Bill of materials, glazing detail & components

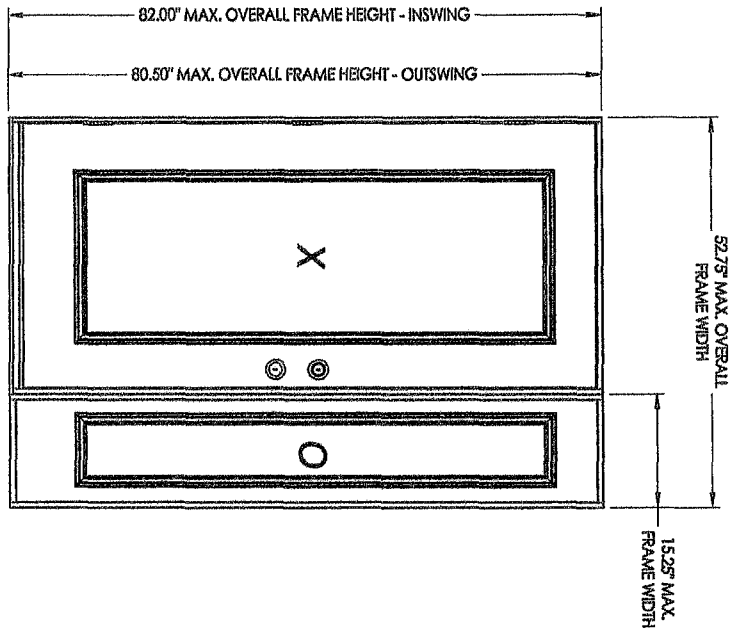


SWING	OVERALL FRAME DIMENSION	DOOR D.O. DIMENSION	SIDEITE D.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)
INSWING	82.75" x 82.00"	21.00" x 63.00"	7.00" x 63.00"	G1	+48.0 -50.0
OUTSWING	82.75" x 80.50"	21.00" x 63.00"	7.00" x 63.00"		+50.0 -50.0

DATE: 02/16/12	SCALE: N.T.S.	CHK. BY: JK	DESIGNING NO.: FL-15213.15	SHEET 1 OF 9
PRODUCT: PLASTPRO INC. FIBERGLASS DOOR				
PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES				
Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Vero Beach, FL 33598 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 Lyndon F. Schmidt, P.E. No. 43409				

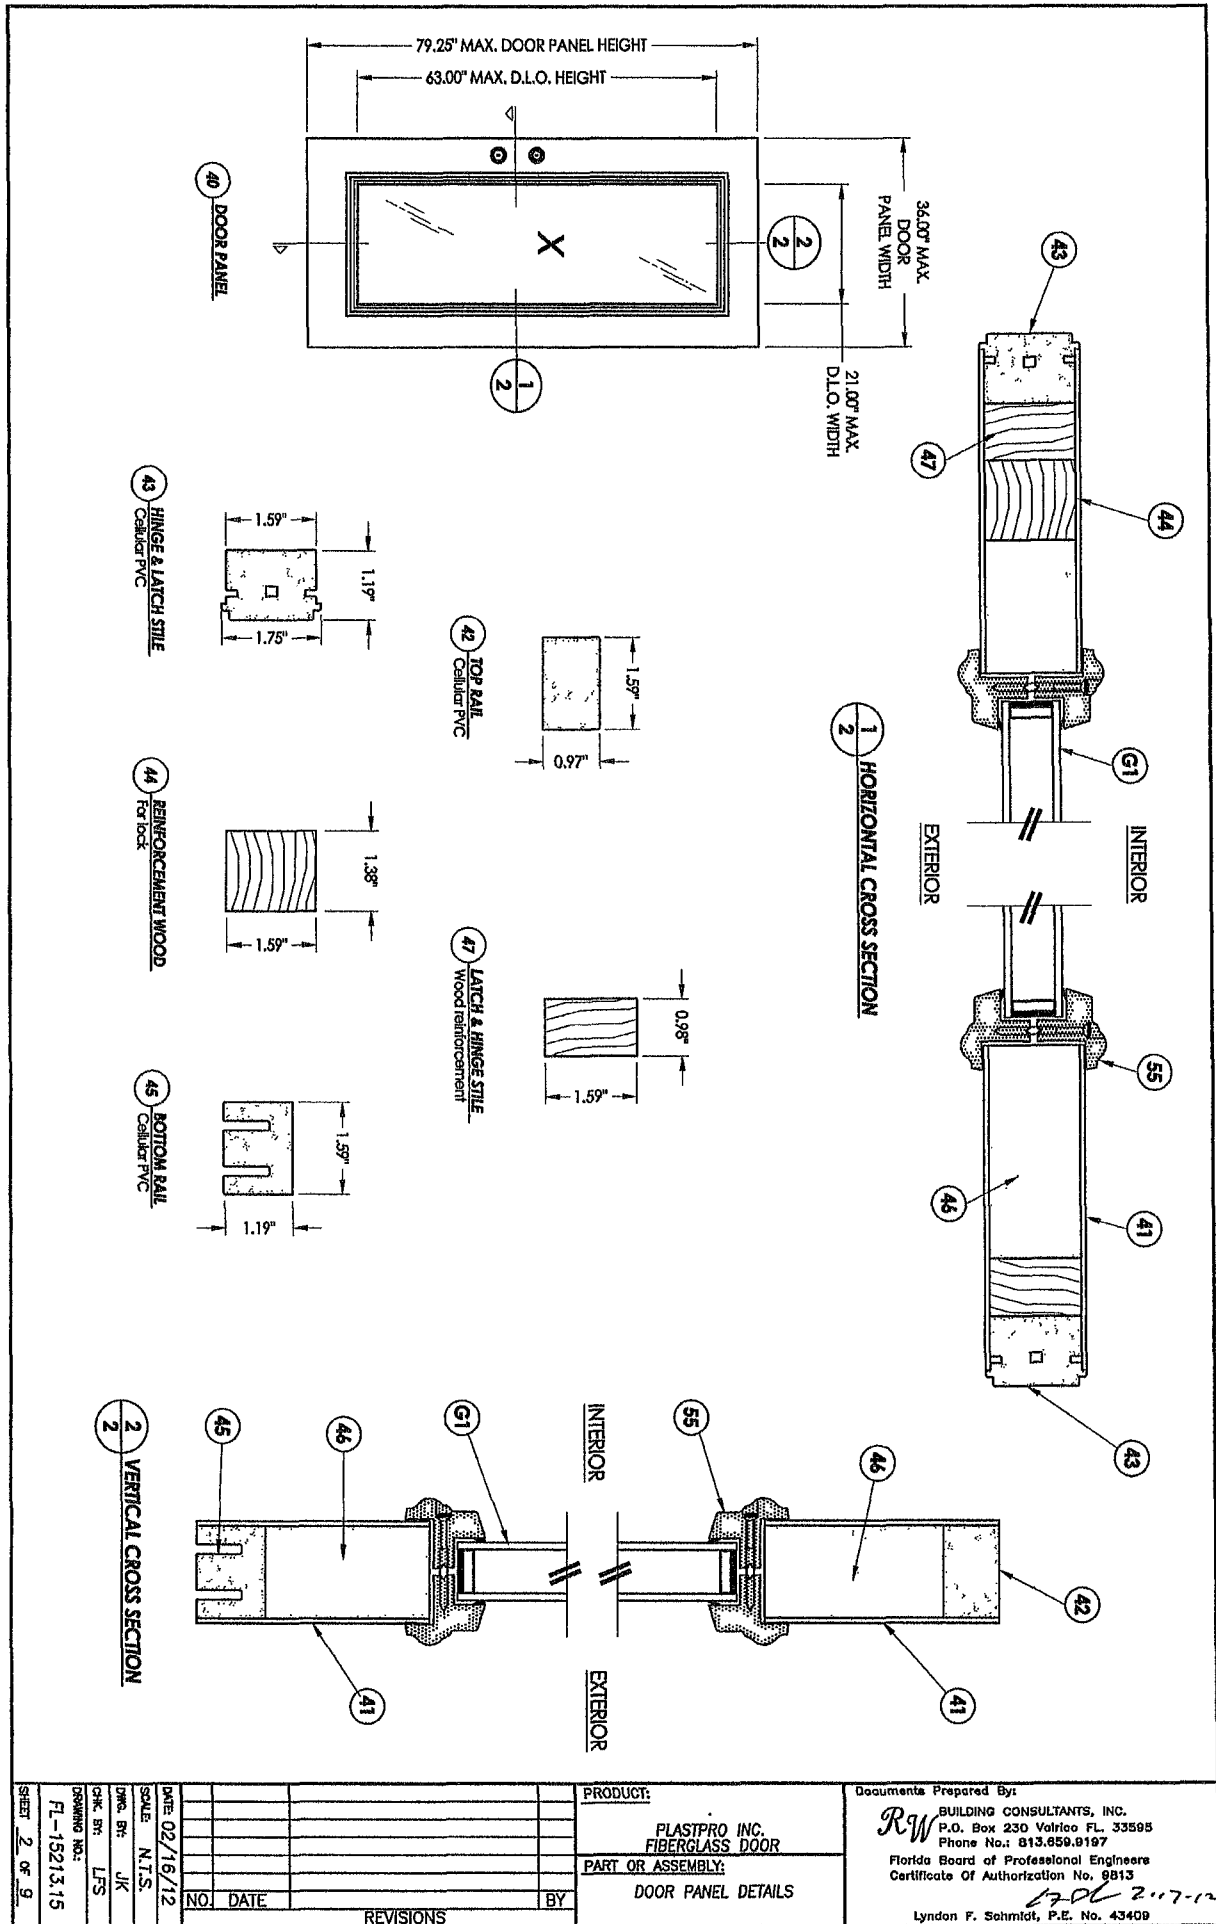


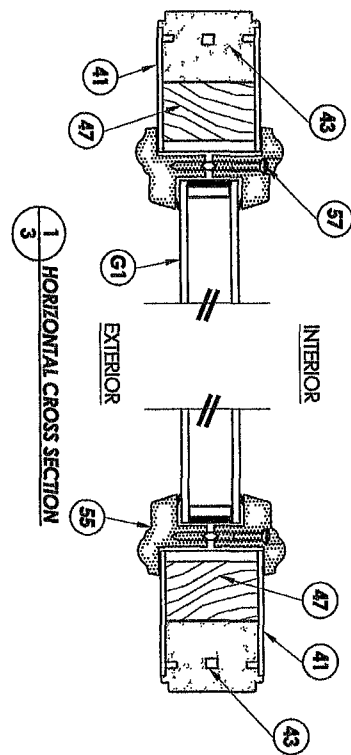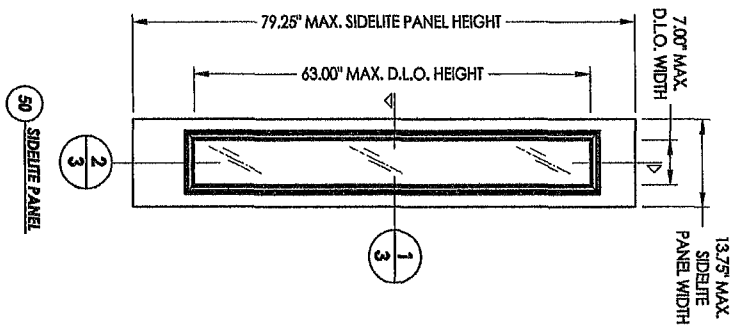



51 SIDELITE TOP & BOTTOM RAIL
Cellulose PVC



43 HINGE & LATCH STILE
Stainless Steel
Cellulose PVC




47 LATCH & HINGE STILE
Stainless Steel
Wood Reinforcement

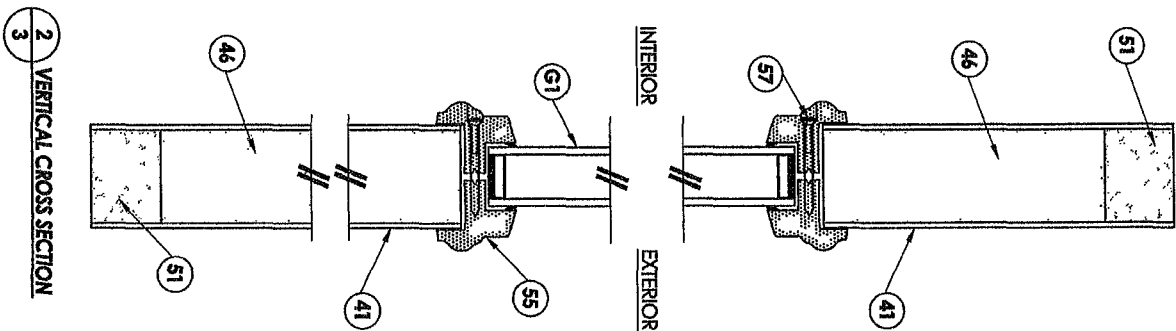

SHEET 3 OF 9		DRAWING NO.: FL-15213.15		CHK. BY: LFS		DWG. BY: JK		SCALE: N.T.S.		DATE: 02/16/12	
NO.		DATE		BY		REVISIONS		PRODUCT:		PART OR ASSEMBLY:	
								PLASTPRO INC.		SIDELITE PANEL DETAILS	
								FIBERGLASS DOOR			





Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Vairloo FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 8813
Lyndon F. Schmidt, P.E. No. 43409




NOTE:
1 Sidelite panel secured to the sidelite frame with (4) of item #M located 10", 30.5", 51" and 71.5" from top of each jamb and (2) of item #M in the head, 3" from each end

DRAWING NO.: FL-15213.15		DATE 02/16/12		PRODUCT: PLASTPRO INC. FIBERGLASS DOOR	
COK. BR. LFS		SOLE. M.T.S.		PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS	
COK. BR. JK		NO. DATE		BY	
		REVISIONS			
SHEET 4 OF 9					


Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
LF 2-17
 Lyndon F. Schmidt, P.E. 43409

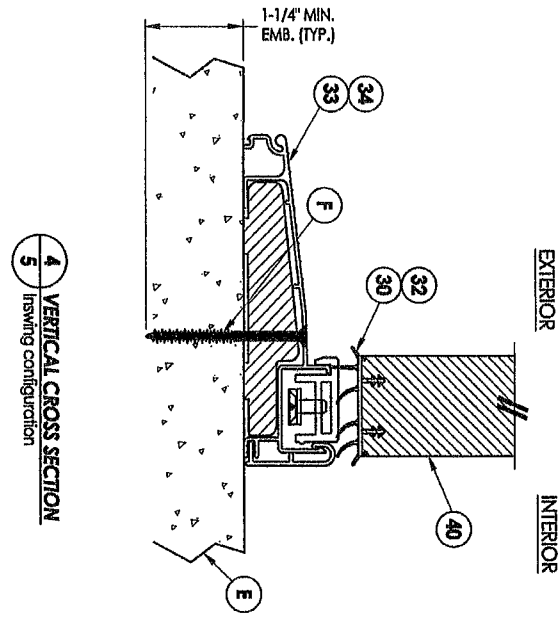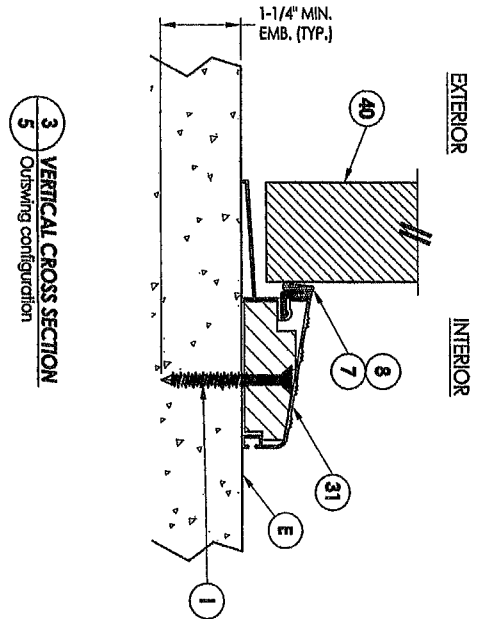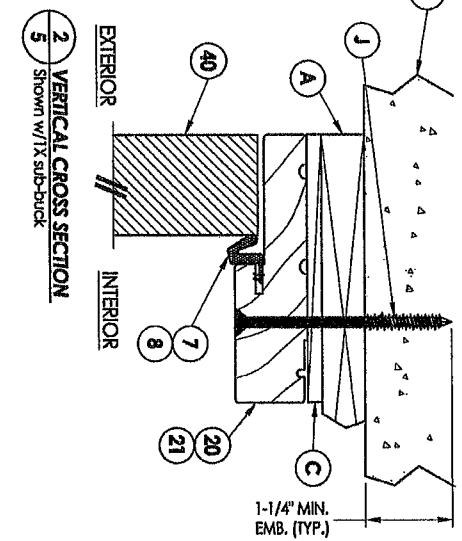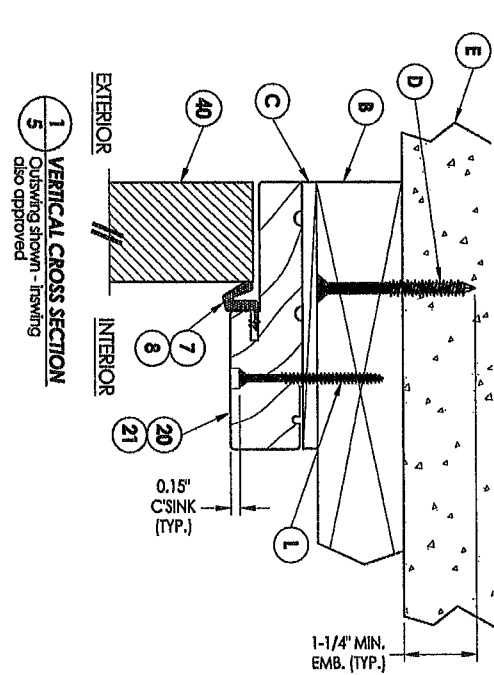

SHEET 5 OF 9		DRAWING NO.: FL-15213.15		CHK. BY: LFS		DWG. BY: JK		SCALE: N.T.S.		DATE: 02/16/12		NO. DATE		REVISIONS		BY		PRODUCT: PLASTPRO INC. FIBERGLASS DOOR		PART OR ASSEMBLY: VERTICAL CROSS SECTIONS		Documents Prepared By: R.W. BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 2.17.12 Lyndon F. Schmidt, P.E. No. 43409	
--------------	--	--------------------------	--	--------------	--	-------------	--	---------------	--	----------------	--	----------	--	-----------	--	----	--	--	--	---	--	--	--

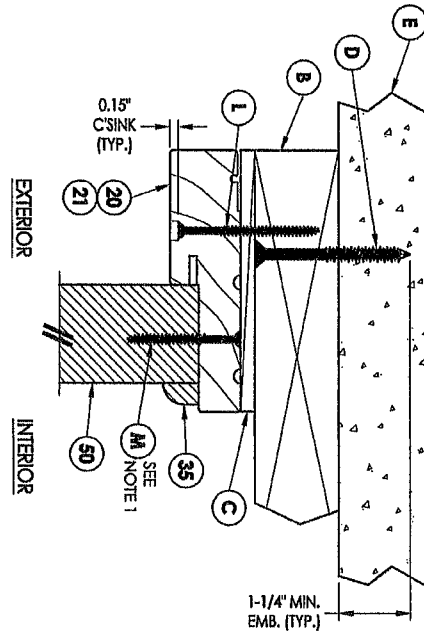


1 VERTICAL CROSS SECTION
6 Outsling shown - Insling also approved

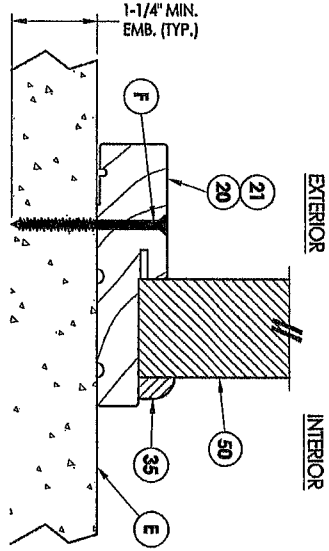


3 VERTICAL CROSS SECTION
6 Outsling shown - Insling also approved

NOTE:
1 Sidelife panel secured to the sidelife frame with (4) of item #M located 10", 30.5", 51" and 71.5" from top of each jamb and (2) of item #M in the head, 3" from each end

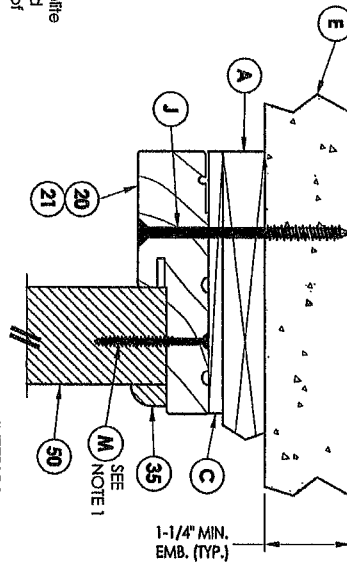


2 VERTICAL CROSS SECTION
6 Shown w/1X sub-buck

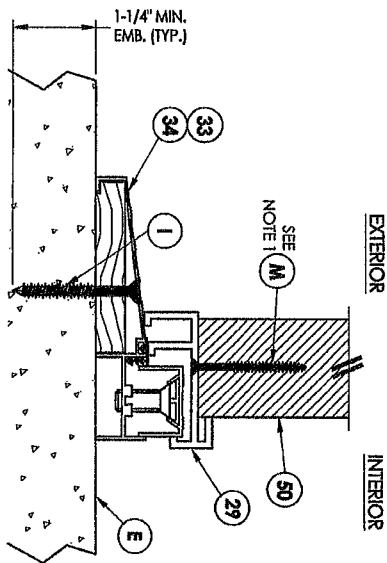


4 VERTICAL CROSS SECTION
6 Insling configuration


SHEET 6 OF 9 DATE: 02/16/12 SCALE: N.T.S. DWG. BY: JK CHK. BY: LPS DRAWING NO.: FL-15213.15		PRODUCT: PLASTRO INC. FIBERGLASS DOOR PART OR ASSEMBLY: VERTICAL CROSS SECTIONS	Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Vero Beach, FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9843 Lyndon F. Schmidt, P.E. No. 43409
NO. DATE REVISIONS		BY	




HINGE JAMB

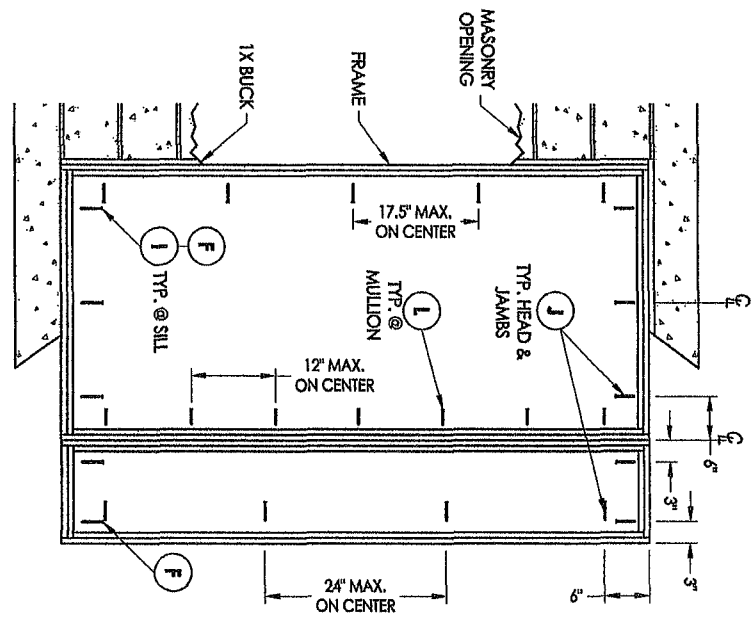


FRAME ANCHORING
Masonry 1X buck construction



STRIKE JAMB



LATCH & DEADBOLT DETAIL



HINGE DETAIL

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-1/4"	2-1/2"	3"
ITW	3/16"	1-1/4"	2-5/8"	2-1/4"

- CONCRETE ANCHOR NOTES:**
1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
 2. Concrete anchor locations of the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.
 3. Concrete anchor table:

DATE: 02/16/12		PRODUCT: PLASTPRO INC. FIBERGLASS DOOR		Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Vairtoo FL 33595 Phone No.: 813.659.9197	
SCALE: N.T.S.		PART OR ASSEMBLY: FRAME ANCHORING 1X BUCK MASONRY CONSTRUCTION		Florida Board of Professional Engineers Certificate Of Authorization No. 9813	
CHK. BY: LFS		BY:		2.17.12 Lyndon F. Schmidt, P.E. No. 43409	
DRAWING NO.: FL-15213.15		NO. DATE		REVISIONS	
SHEET 8 OF 9					

DATE 02/16/12		SCALE: N.T.S.		Dwg. No. J/K		FORMING NO. FL-15213.15		Dwg. 9 of 9		PRODUCT: PLASTPRO INC. FIBERGLASS DOOR PART OR ASSEMBLY: BILL OF MATERIALS, GLAZING DETAIL & COMPONENTS	
NO.		DATE		BY		REVISIONS					

