




Alpine, an ITW Company
 155 Harlem Ave
 North Building, 4th Floor
 Glenview, IL 60052
 Phone: (800)755-6001
www.alpineitw.com

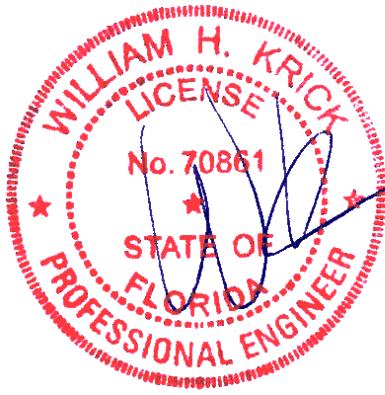

This item has been digitally signed by William H. Krick on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

COA #0 278

Florida Certificate of Product Approval #FL 1999

10/06/2025



Site Information:	Page 1:
Customer: Seminole Trusses, Inc.	Job Number: B61800a
Job Description: DAVIS RESIDENCE	
Address: 242 SW GOLDBOND AVE, Lake City, FL 32024	

Job Engineering Criteria:	
Design Code: FBC 8th Ed. 2023 Res.	IntelliVIEW Version: 24.02.00C JRef #: 1YdX8570003
Wind Standard: ASCE 7-22 Building Type: Closed	Wind Speed (mph): 120 Design Loading (psf): 37


This package contains general notes pages, 92 truss drawing(s) and 6 detail(s).

Item	Drawing Number	Truss
1	276.25.1434.24187	A1 32'10" Stepdown Hip
3	276.25.1437.12730	B1 32'10" Stepdown Hip
5	276.25.1437.25260	B2 32'10" Special Girder
7	276.25.1437.40820	C2 32'6" Stepdown Hip Girder
9	276.25.1437.48047	D2 27'7" Stepdown Hip Girder
11	276.25.1437.53423	E1a 24'2" Stepdown Hip
13	276.25.1438.50243	G1 21'7"8 Stepdown Hip
15	276.25.1438.59230	G1b 21'7"8 Stepdown Hip
17	276.25.1439.20033	H1 14'10" Common Girder
19	276.25.1441.17927	K1 14'9"8 Common Girder
21	276.25.1441.21773	L1 12'8" Common
23	276.25.1441.26980	L2-G 12'8" Gable
25	276.25.1441.31700	M2 7'6" Mono Hip
27	276.25.1441.36197	N1 5'3"8 Mono
29	276.25.1441.39377	N3 5'7"8 Mono Hip Girder
31	276.25.1441.43320	O2 3'11"8 Mono
33	276.25.1441.47943	PB1 20'10" Common
35	276.25.1442.12780	PB3 20'10" Common
37	276.25.1442.19430	PB5 15'6" Common
39	276.25.1442.25753	PB7 15'6" Common
41	276.25.1442.33510	PB9 10'2" Common
43	276.25.1442.02707	PB11 6'3"8 Common
45	276.25.1438.11037	V1 13'11"9 Valley
47	276.25.1438.36787	V3 9'11"9 Valley
49	276.25.1438.39857	V5 5'11"9 Valley

Item	Drawing Number	Truss
2	276.25.1436.10650	A2 32'10" Stepdown Hip Girder
4	276.25.1437.16383	B1a 32'10" Stepdown Hip
6	276.25.1437.38710	C1 32'6" Stepdown Hip Girder
8	276.25.1437.44187	D1 27'7" Stepdown Hip
10	276.25.1437.51533	E1 23'10" Stepdown Hip
12	276.25.1437.55490	E2 24'2" Stepdown Hip Girder
14	276.25.1438.54390	G1a 21'7"8 Stepdown Hip
16	276.25.1439.01273	G2 21'7"8 Stepdown Hip Girder
18	276.25.1439.22943	H2-G 14'10" Gable
20	276.25.1441.19803	K2-G 14'9"8 Gable
22	276.25.1441.24373	L1a 12'8" Common
24	276.25.1441.29820	M1 7'6" Mono
26	276.25.1441.33943	M3 7'6" Mono Hip Girder
28	276.25.1441.37827	N2 5'7"8 Mono
30	276.25.1441.41210	O1 5'7"8 Mono
32	276.25.1441.45803	O3-G 3'11"8 Gable
34	276.25.1442.09233	PB2 20'10" Common
36	276.25.1442.15977	PB4 15'6" Common
38	276.25.1442.22717	PB6 15'6" Common
40	276.25.1442.28470	PB8 10'2" Common
42	276.25.1441.58970	PB10 10'2" Common
44	276.25.1442.06550	PB12 6'3"8 Common
46	276.25.1438.35247	V2 11'11"9 Valley
48	276.25.1438.38417	V4 7'11"9 Valley
50	276.25.1438.41300	V6 3'11"9 Valley



Alpine, an ITW Company
155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025
Phone: (800)755-6001
www.alpineitw.com

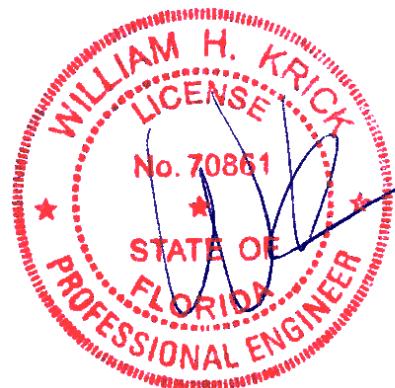

This item has been digitally signed by William H. Krick on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

COA # 0278

Florida Certificate of Product Approval #FL 1999

10/06/2025

Site Information:		Page 2:
Customer:	Seminole Trusses, Inc.	Job Number: B61800a
Job Description:	DAVIS RESIDENCE	
Address:	242 SW GOLDBOND AVE, Lake City, FL 32024	

Item	Drawing Number	Truss
51	276.25.1438.42733	V7 6'11"5 Valley
53	276.25.1438.45927	V9 4'11"5 Valley
55	276.25.1438.14263	V11 2'11"5 Valley
57	276.25.1439.26823	JA 9'10"1 Hip Jack Girder
59	276.25.1439.38453	JC 7' End Jack
61	276.25.1439.42593	JD 4'11"11 Jack
63	276.25.1439.46080	JF 11"11 Jack
65	276.25.1439.49727	JH 7' End Jack
67	276.25.1439.57143	JJ 2'11"11 Jack
69	276.25.1440.02057	JJB 1' End Jack
71	276.25.1440.06003	JL 9'4"6 Hip Jack Girder
73	276.25.1440.16573	JN 6'8" End Jack
75	276.25.1440.20537	JOa 4'7"11 Jack
77	276.25.1440.24857	JPa 2'7"11 Jack
79	276.25.1440.29333	JQa 7'11"7 Hip Jack Girder
81	276.25.1440.38230	JRa 5'8" End Jack
83	276.25.1440.41813	JSa 3'7"11 Jack
85	276.25.1440.54213	JTa 1'7"11 Jack
87	276.25.1440.57300	JV 3' End Jack
89	276.25.1441.02820	JX 5'7"2 Hip Jack Girder
91	276.25.1441.05947	JZ 1'11"11 Jack
93	REPCHRD1014	
95	BRCLBSUB0119	
97	VALTN220723	

Item	Drawing Number	Truss
52	276.25.1438.44340	V8 6'11"1 Valley
54	276.25.1438.12740	V10 4'11"1 Valley
56	276.25.1438.15803	V12 2'11"1 Valley
58	276.25.1439.36813	JB 7' End Jack Girder
60	276.25.1439.40637	JCa 7' End Jack
62	276.25.1439.44320	JE 2'11"11 Jack
64	276.25.1439.47753	JG 9'10"1 Hip Jack Girder
66	276.25.1439.55357	JL 4'11"11 Jack
68	276.25.1440.00510	JJA 2'5"6 Hip Jack Girder
70	276.25.1440.03750	JK 11"11 Jack
72	276.25.1440.14280	JM 6'8" End Jack Girder
74	276.25.1440.18420	JO 4'7"11 Jack
76	276.25.1440.22767	JP 2'7"11 Jack
78	276.25.1440.27237	JQ 7'11"7 Hip Jack Girder
80	276.25.1440.35727	JR 5'8" End Jack
82	276.25.1440.39693	JS 3'7"11 Jack
84	276.25.1440.44267	JT 1'7"11 Jack
86	276.25.1440.55860	JU 4'2"3 Hip Jack Girder
88	276.25.1440.59437	JW 11"11 Jack
90	276.25.1441.04317	JY 4' End Jack
92	276.25.1441.07430	JZa 1'11"11 Jack
94	CNNAILSP1014	
96	VAL180220723	
98	GBLDIAG220923	

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high-quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed, and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Bearing Information:

The bearing area factor, C_b , is considered for the allowable capacity of solid sawn wood bearings supporting trusses that are located a minimum of 3" from the end of the lumber piece.

General Notes (continued)

Coated Lumber:

Coated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Coated lumber has no adjustments to lumber properties. Coated lumber may be more brittle than uncoated lumber. Special handling care must be taken to prevent breakage during all handling activities. Refer to manufacturer literature, specifications, and code evaluation reports for restrictions, details, and requirements.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

C = Coated lumber.

C-AT = AtTEK coated lumber.

C-FX = FX Lumber Guard coated lumber.

C -TE = TechWood 4400 coated lumber.

CL = Certified lumber.

Des Ld = total of TCLL, TCDL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-BF = Boraflame Fire Retardant Treated lumber

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-ON = OnWood Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

FRT-PR = ProWood Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for all load cases.

Max Web CSI= Maximum bending and axial Combined Stress Index for Webs for all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

General Notes (continued)

Key to Terms (continued):

R_w = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCLL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 155 Harlem Ave, North Building, 4th Floor, Glenview, IL 60025; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpininst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcacomponents.com

SEQN: 66439	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T65
FROM: RJL		Qty: 4	DAVIS RESIDENCE	DrwNo: 276.25.1434.24187 GA / FV 10/03/2025

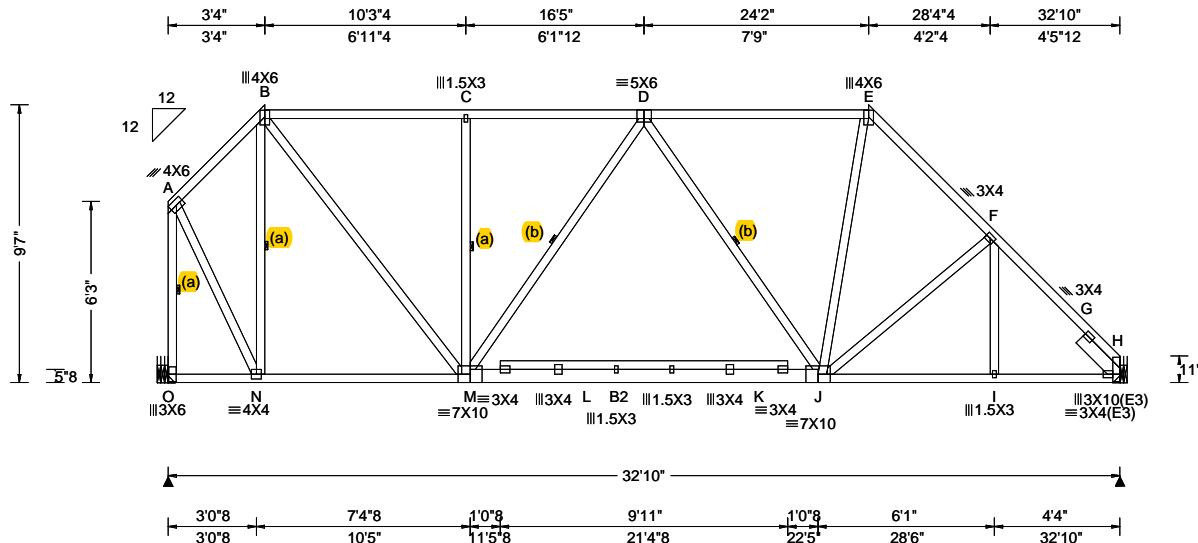

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/R-	/Rh	Non-Gravity /Rw	/U /RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.279 L 999 360	O	1681	/-	/-	/601	/239 /153
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.343 L 999 240	H	1575	/-	/-	/673	/239 /-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.051 H - -	Wind reactions based on MWFRS					
Des Ld:	37.00	EXP: B Kzt: NA	Building Code: FBC 8th Ed. 2023 Res.	HORZ(TL): 0.065 H - -	O	Brg Wid = -	Min Req = -			
NCBCLL:	10.00	Mean Height: 23.83 ft	TPI Std: 2014	Creep Factor: 2.0	H	Brg Wid = -	Min Req = -			
Soffit:	2.00	TCDL: 4.2 psf	Rep Fac: No	Max TC CSI: 0.549	Members not listed have forces less than 375#					
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	FT/RT:20(0)/10(0)	Max BC CSI: 0.603	Maximum Top Chord Forces Per Ply (lbs)					
Loc. from endwall: not in 9.00 ft	GCpi: 0.18	MWFRS Parallel Dist: h/2 to h	Plate Type(s): WAVE	Max Web CSI: 0.874	Chords	Tens. Comp.	Chords	Tens. Comp.		
Wind Duration: 1.60		C&C Dist a: 3.28 ft			A - B	186 -825	E - F	357 -1721		
		Loc. from endwall: not in 9.00 ft			B - C	355 -1421	F - G	301 -1885		
		GCpi: 0.18			C - D	350 -1413	G - H	316 -1943		
		Wind Duration: 1.60			D - E	316 -1335				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Webs: 2x4 SP #3;
Rt Slider: 2x6 SP #1; block length = 1.833'

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
(b) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Special Loads


-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at 0.00 to 60 plf at 32.83
BC: From 20 plf at 0.00 to 20 plf at 10.42
BC: From 60 plf at 10.42 to 60 plf at 22.42
BC: From 20 plf at 22.42 to 20 plf at 32.83
PLB: From 40 plf at 3.33 to 40 plf at 7.25

Hangers / Ties

(J) Hanger Support Required, by others

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

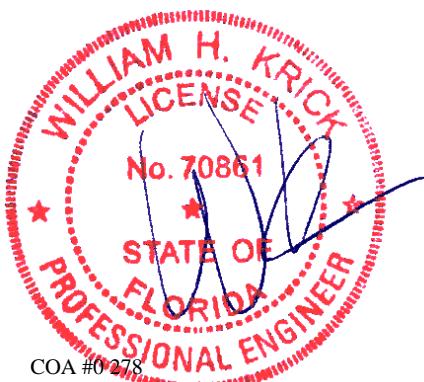

10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66387	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T62
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: A2 32'10" Stepdown Hip Girder	DrwNo: 276.25.1436.10650 GA / FV 10/03/2025

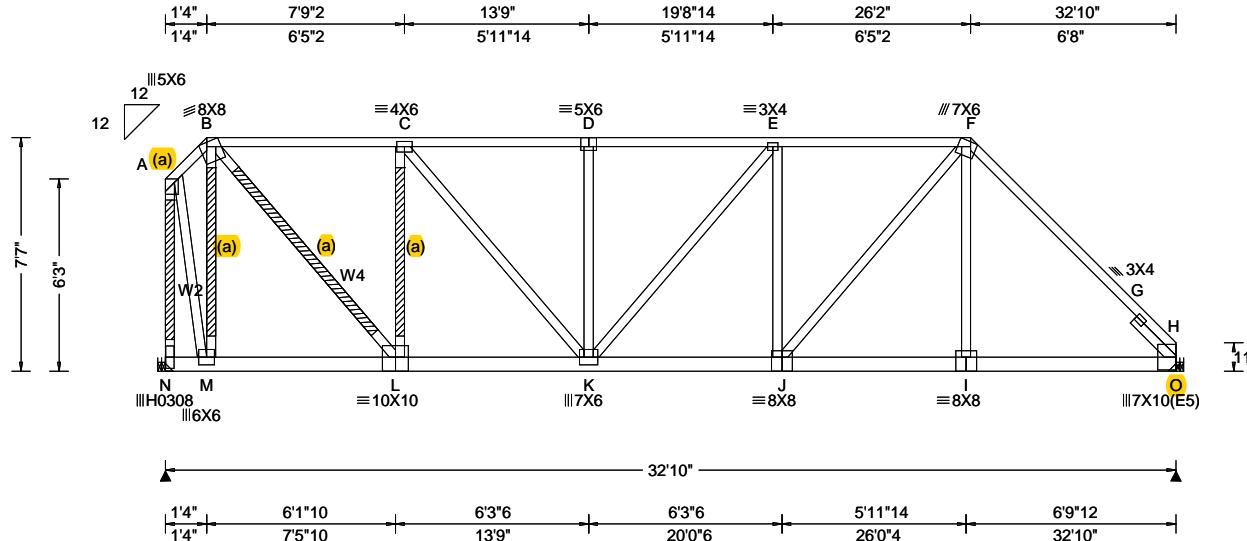

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					Non-Gravity	
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.328 D 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.347 D 999 240	N	3497	/-	/-	/714	/-	
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.091 B - -	O	3859	/-	/-	/990	/-	
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.096 B - -							
Mean Height: 22.83 ft				Creep Factor: 2.0							
NCBCLL: 10.00		TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.725							
Soffit: 2.00		BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.997							
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.869							
Spacing: 24.0 "		C&C Dist a: 3.28 ft	Rep Fac: No								
Loc. from endwall: not in 9.00 ft		FT/RT:20(0)/10(0)	Plate Type(s):								
GCpi: 0.18		WAVE, HS									
Wind Duration: 1.60				VIEW Ver: 24.02.00C.1213.15							

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3; W2,W4 2x4 SP #1;
Rt Slider: 2x4 SP #3; block length = 1.833'

Bracing

(a) #3 or better scab reinforcement. Same size & 80% length of web member. Attach with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Hangers / Ties

(J) Hanger Support Required, by others

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads and reactions based on MWFRS.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Special loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at 0.00 to 60 plf at 6.70
TC: From 30 plf at 6.70 to 30 plf at 32.83
PLB: From 40 plf at 1.62 to 40 plf at 4.28
PLB: From 20 plf at 7.76 to 20 plf at 10.42
PLB: From 20 plf at 17.08 to 20 plf at 19.74
PLB: From 20 plf at 23.22 to 20 plf at 25.87
PLB: From 20 plf at 26.17 to 20 plf at 29.38
BC: From 20 plf at 0.00 to 20 plf at 6.70
BC: From 10 plf at 6.70 to 10 plf at 32.83
BC: 912 lb Conc. Load at 6.70
BC: 349 lb Conc. Load at 8.73,10.73,12.73,14.73
16.50,18.50,20.50,22.50,24.50,26.50,28.50,30.50
32.50



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66343	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T75
FROM: RJL		Qty: 4	DAVIS RESIDENCE Truss Label: B1a 32'10" Stepdown Hip	DrwNo: 276.25.1437.16383 GA / FV 10/03/2025

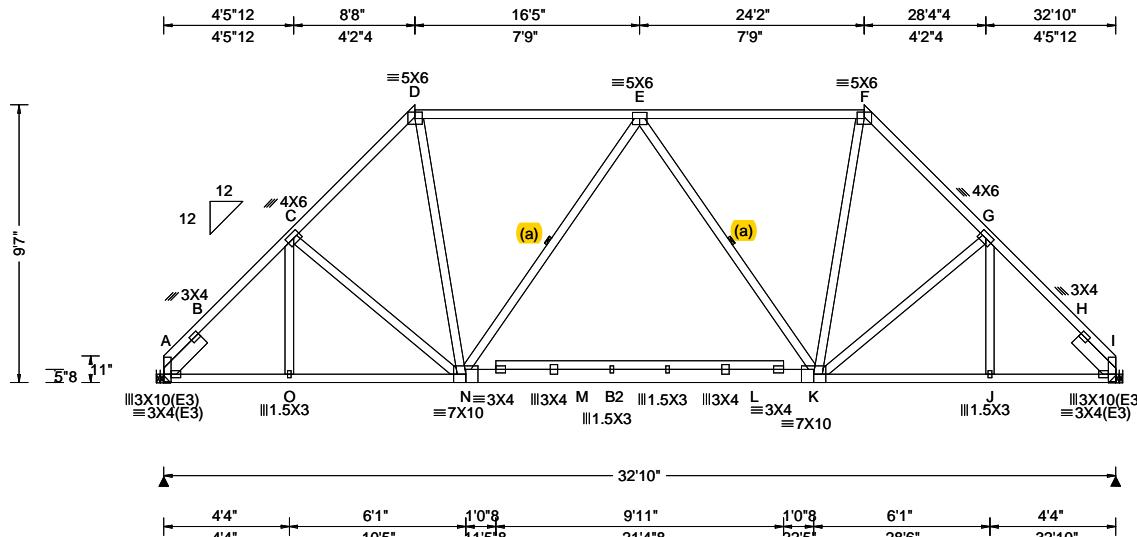

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.198 M 999 360	Loc R+ / R-	/ Rh				
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.342 M 999 240						
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.043 I - -						
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.074 I - -						
NCBCLL:	10.00	Mean Height: 23.83 ft		Creep Factor: 2.0						
Soffit:	2.00	TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.602						
Load Duration:	1.25	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.612						
Spacing:	24.0 "	MWFRS Parallel Dist: h to 2h	TPI Std: 2014	Max Web CSI: 0.371						
		C&C Dist a: 3.28 ft	Rep Fac: No							
		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)							
		GCpi: 0.18	Plate Type(s):							
		Wind Duration: 1.60	WAVE							
				VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP #1; block length = 1.833'
Rt Slider: 2x6 SP #1; block length = 1.833'

Additional Notes

WIND LOAD CASE MODIFIED!

	Gravity	Non-Gravity
Loc R+ / R-	/ Rh	
A	1550 / -	/ 667 / 239 / 169

Wind reactions based on MWFRS

A	Brg Wid = -	Min Req = -
I	Brg Wid = -	Min Req = -

Members not listed have forces less than 375#

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
A - B	316 - 1910	E - F	309 - 1307
B - C	301 - 1853	F - G	348 - 1688
C - D	348 - 1688	G - H	301 - 1853
D - E	309 - 1307	H - I	316 - 1910

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
A - O	1225 - 197	L - K	1465 - 285
O - N	1224 - 197	K - J	1224 - 197
N - M	1465 - 285	J - I	1225 - 197
M - N	2510 - 1320		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
D - N	787 - 123	K - F	787 - 123


COA #0278

10/06/2025


Florida Certificate of Product Approval #FL 1999

SEQN: 66378	SPEC	Ply: 2	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T69
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo: 276.25.1437.25260

2 Complete Trusses Required

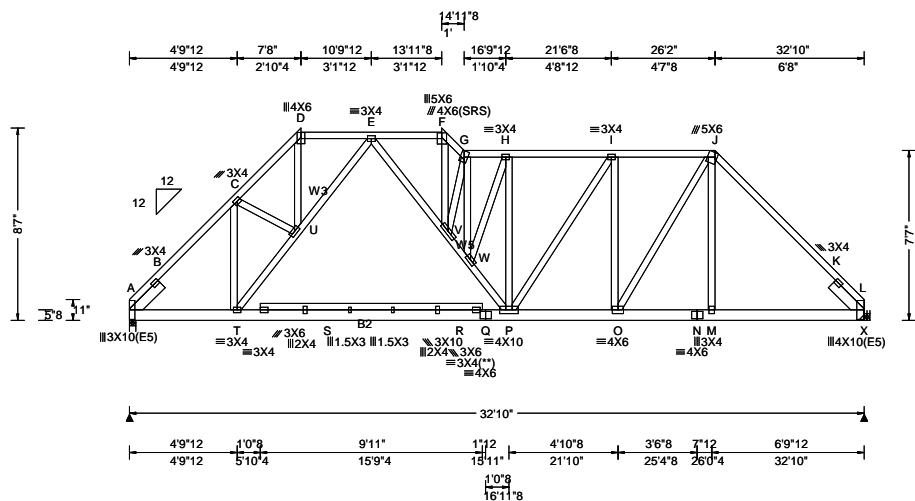

3 Complete Trusses Required

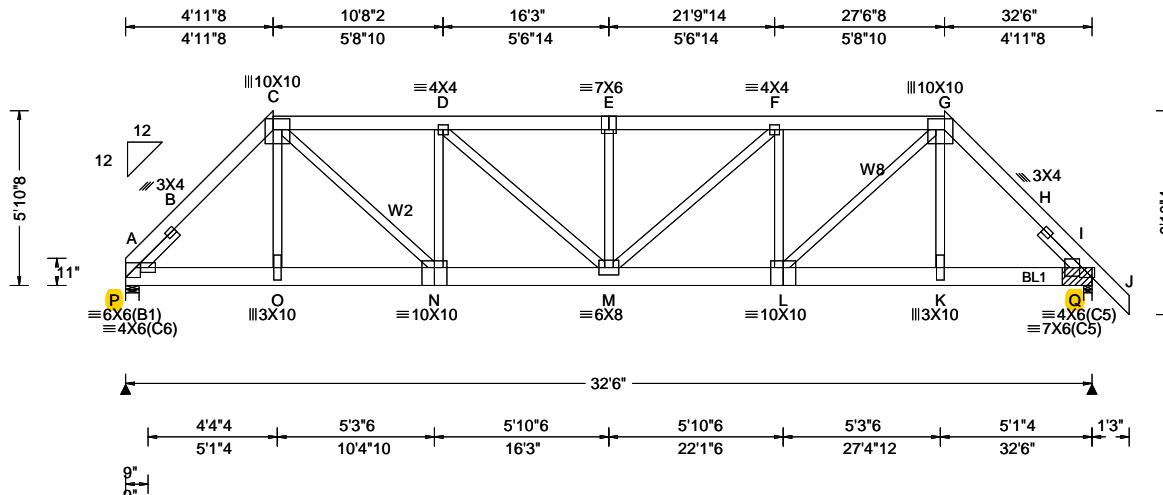

Lumber

Top chord: 2x6 SP #1;
Bot chord: 2x8 SP SS Dense;
Webs: 2x4 SP #3; W2,W8 2x4 SP #1;
Lt Slider: 2x4 SP #3; block length = 1.833'
Lt Slider: 2x4 SP #3; block length = 1.833'

Nailnote

Nail Schedule: 0.128" x 3", min. nails
Top Chord: 1 Row @ 12.00" o.c.
Bot Chord: 2 Rows @ 4.00" o.c. (Each Row
Webs: 1 Row @ 4" o.c.

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 60 plf at 0.00 to 60 plf at 33.75
 BC: From 10 plf at 0.00 to 10 plf at 29.77
 BC: From 20 plf at 29.77 to 20 plf at 32.50
 BC: From 6 plf at 32.50 to 6 plf at 33.75
 BC: 1550 lb Conc. Load at 1.85, 3.85, 5.85, 7.85
 BC: 1548 lb Conc. Load at 9.85,11.85,13.77,15.77
 BC: 1681 lb Conc. Load at 17.77,19.77,21.77,23.77
 BC: 3497 lb Conc. Load at 25.77
 BC: 185 lb Conc. Load at 27.77
 BC: 105 lb Conc. Load at 29.77

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.



— 10/06/20

Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS** Refer to and follow the latest version of the applicable codes and regulations.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TP1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TP1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66401	HIPS	Ply: 3	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T14
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo: 276.25.1437.38710
Page 2 of 2			Truss Label: C1 32'6" Stepdown Hip Girder	GA / FV 10/03/2025

Blocking

Apply additional nailing over the following bearings with fasteners at 9" oc perpendicular to grain and 4" oc parallel to grain. In lieu of additional nailing, apply blocking reinforcement to prevent buckling of members over the bearings:
 Bearing 1 located at 0.0' (blocking \geq 3.50" if used)
 Bearing 2 located at 32.2' (blocking \geq 3.50" if used)



COA #0-278

Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66249	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T39
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: C2 32'6" Stepdown Hip Girder	DrwNo: 276.25.1437.40820 GA / FV 10/03/2025

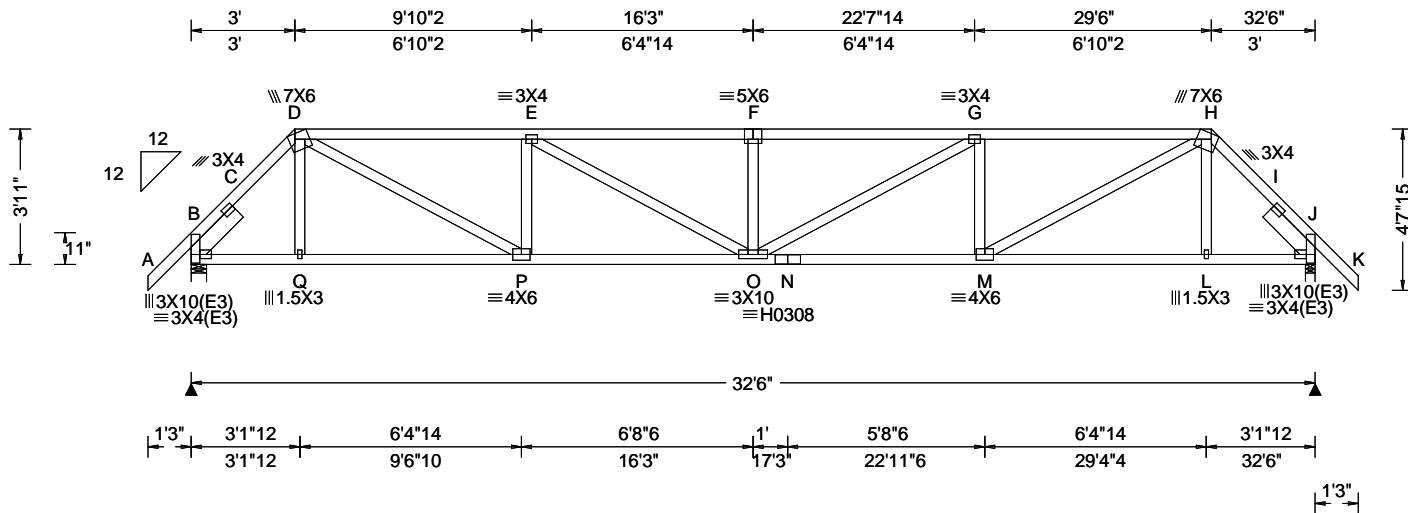

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+ / R-	/ Rh	Non-Gravity / Rw	/ U / RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.186 F 999 360	B	1492	/ -	/ -	/24 / -
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.377 F 999 240	J	1497	/ -	/ -	/25 / -
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.045 D - -	Wind reactions based on MWFRS				
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.091 D - -	B	Brg Wid = 5.4	Min Req = 1.8 (Truss)		
NCBCLL:	0.00	Mean Height: 20.38 ft	Building Code:	Creep Factor: 2.0	J	Brg Wid = 3.4	Min Req = 1.8 (Truss)		
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.615	Bearings B & J are a rigid surface.				
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max BC CSI: 0.546	Members not listed have forces less than 375#				
Spacing: 24.0 "	C&C Dist a: 3.25 ft	Rep Fac: No	Rep Fac: No	Max Web CSI: 0.677	Maximum Top Chord Forces Per Ply (lbs)				
	Loc. from endwall: NA	FT/RT:20(0)/10(0)	FT/RT:20(0)/10(0)		Chords	Tens.Comp.	Chords	Tens. Comp.	
	GCpi: 0.18	Plate Type(s):	WAVE, HS		B - C	13 - 1736	F - G	10 - 3185	
	Wind Duration: 1.60				C - D	3 - 1679	G - H	9 - 2669	
Lumber									
Top chord: 2x4 SP #1;									
Bot chord: 2x4 SP #1;									
Web: 2x4 SP #3;									
Lt Slider: 2x6 SP #1; block length = 1.833'									
Rt Slider: 2x6 SP #1; block length = 1.833'									
Loading									
#1 hip supports 3-0-0 jacks with no webs.									
Purlins									
In lieu of structural panels use purlins to brace all flat									
TC @ 24" oc.									
Wind									
Wind loads and reactions based on MWFRS.									
Wind loading based on both gable and hip roof types.									
VIEW Ver: 24.02.00C.1213.15									



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66247	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T27
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo: 276.25.1437.44187

Truss Label: D1 277" Stepdown Hip

GA / FV 10/03/2025

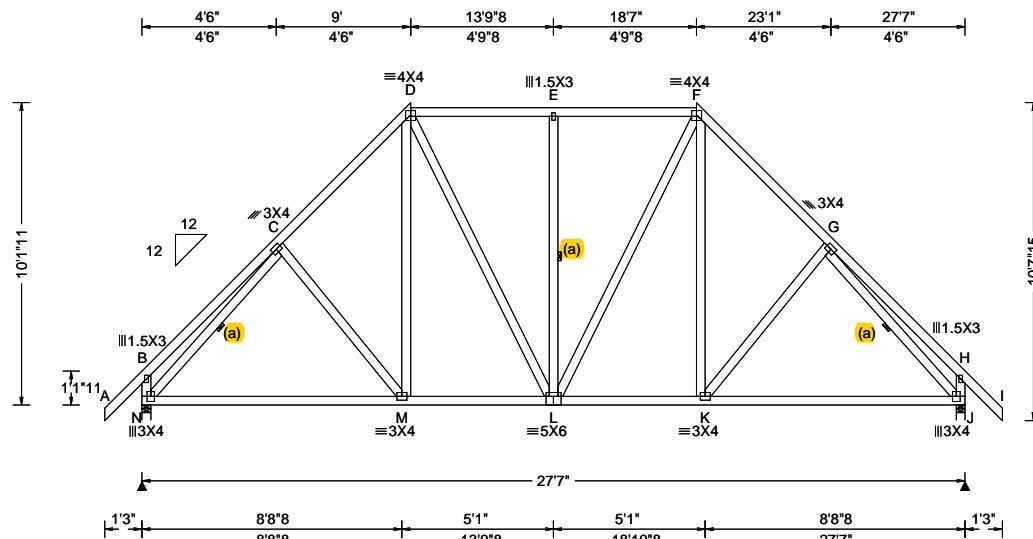

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in	loc	L/defl	L/#	Gravity	Non-Gravity
TCDL:	7.00	Speed: 120 mph		Lu: NA		Cs: NA		VERT(LL): 0.040 E 999 360		VERT(CL): 0.069 E 999 240		Loc R+ / R-		
BCLL: 0.00		Enclosure: Closed		HORZ(LL): 0.028 H - -		HORZ(TL): 0.049 H - -		/ Rh		/ Rw		/ U		
BCDL: 10.00		Risk Category: II		Building Code:		Creep Factor: 2.0		/ RL		N 1375 / - / - / 581 / - / 167		J 1375 / - / - / 581 / - / -		
Des Ld: 37.00		EXP: B Kzt: NA		FBC 8th Ed. 2023 Res.		Max TC CSI: 0.204		Wind reactions based on MWFRS		N Brg Wid = 3.5 Min Req = 1.6 (Truss)		J Brg Wid = 3.5 Min Req = 1.6 (Truss)		
NCBCLL: 10.00		Soffit: 2.00		TPI Std: 2014		Max BC CSI: 0.593		Bearings N & J are a rigid surface.		Members not listed have forces less than 375#		Maximum Top Chord Forces Per Ply (lbs)		
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2		Rep Fac: No		Max Web CSI: 0.728		Chords Tens.Comp. Chords Tens. Comp.		Chords Tens.Comp. Chords Tens. Comp.		C - D 223 - 1308 E - F 228 - 953		
Spacing: 24.0 "		C&C Dist a: 3.00 ft		FT/RT:20(0)/10(0)		Plate Type(s):		VIEW Ver: 24.02.00C.1213.15		D - E 228 - 953 F - G 223 - 1308				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66235	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T36
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: D2 277" Stepdown Hip Girder	DrwNo: 276.25.1437.48047 GA / FV 10/03/2025

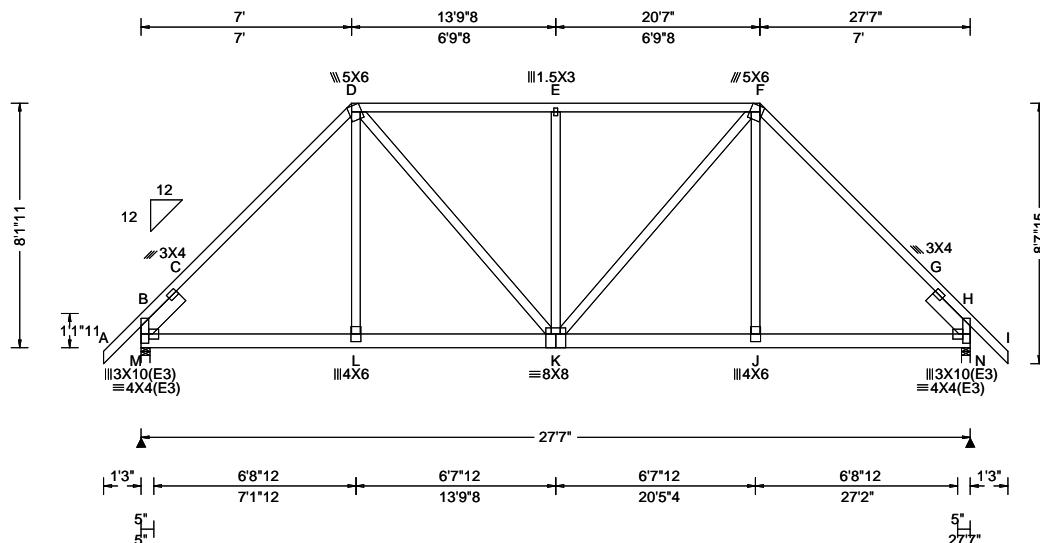

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)							
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity				Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.078 E 999 360	Loc	R+	/ R-	/ Rh	/ Rw / U / RL			
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.154 E 999 240	M	2281	/ -	/ -	/ 47 / - / -			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.045 G - -	N	2281	/ -	/ -	/ 47 / - / -			
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.090 G - -	Wind reactions based on MWFRS							
NCBCLL:	0.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	M	Brg Wid = 3.5	Min Req = 2.7 (Truss)					
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.612	N	Brg Wid = 3.5	Min Req = 2.7 (Truss)					
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max BC CSI: 0.622	Bearings M & N are a rigid surface.							
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No	Rep Fac: No	Max Web CSI: 0.362	Members not listed have forces less than 375#							
	Loc. from endwall: NA	FT/RT:20(0)/10(0)	FT/RT:20(0)/10(0)		Maximum Top Chord Forces Per Ply (lbs)							
	GCpi: 0.18	Plate Type(s):	WAVE	VIEW Ver: 24.02.00C.1213.15	Chords	Tens.Comp.	Chords	Tens. Comp.				
	Wind Duration: 1.60				B - C	2 - 2745	E - F	0	- 2319			
					C - D	0 - 2682	F - G	0	- 2682			
					D - E	0 - 2319	G - H	2	- 2745			

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Web: 2x4 SP #3;
Lt Slider: 2x6 SP #1; block length = 1.833'
Rt Slider: 2x6 SP #1; block length = 1.833'

Loading

#1 hip supports 7-0-0 jacks to BC.

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.

Blocking

Blocking reinforcement required to
prevent buckling of members over the bearings:
Bearing 1 located at 0.0' (blocking >= 5.50" if used)
Bearing 2 located at 27.3' (blocking >= 5.50" if used)



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A/8 for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66145	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T47
FROM: RJL		Qty: 7	DAVIS RESIDENCE	DrwNo: 276.25.1437.51533

Truss Label: E1 23'10" Stepdown Hip

GA / FV 10/03/2025

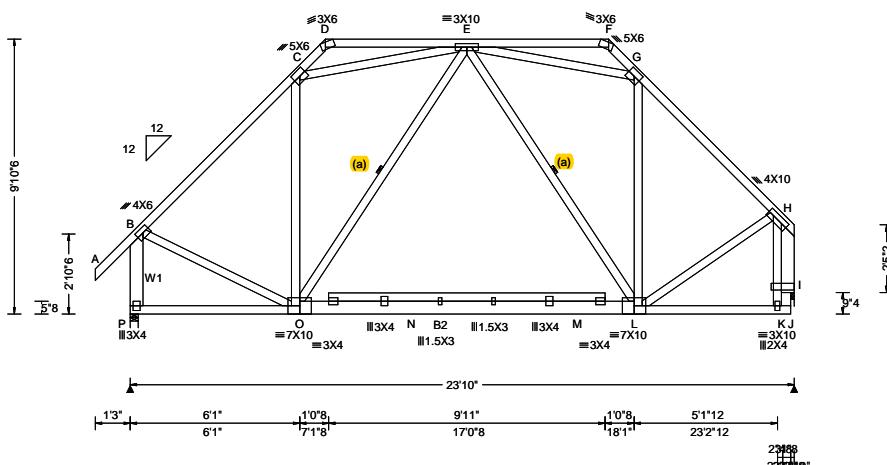

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/ R-	/ Rh	Non-Gravity / Rw / U / RL		
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.145 N 999 360	P	1268	/ -	/ -	/487 /109 /183		
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.241 N 999 240	I	1193	/ -	/ -	/468 /106 /-		
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.016 K - -	Wind reactions based on MWFRS						
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.026 K - -	P	Brg Wid = 3.5	Min Req = 1.5 (Truss)				
NCBCLL:	10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	I	Brg Wid = 1.5	Min Req = 1.5 (Support)				
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.292	Bearings P & I are a rigid surface.						
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h to 2h	TPI Std: 2014	Max BC CSI: 0.510	Members not listed have forces less than 375#						
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No	Rep Fac: No	Max Web CSI: 0.518	Maximum Top Chord Forces Per Ply (lbs)						
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)	FT/RT:20(0)/10(0)		Chords	Tens.Comp.	Chords	Tens. Comp.			
	GCpi: 0.18	Plate Type(s):	WAVE		B - C	193 - 1119	G - H	185 - 1059			
	Wind Duration: 1.60				VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Web: 2x4 SP #3; W1 2x6 SP #1;
Rt Bearing Leg: 2x6 SP #1;

Additional Notes

WIND LOAD CASE MODIFIED!

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
O - N	718 - 108	M - L	718 - 108
N - O	1743 - 1097		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
B - P	174 - 1232	E - G	124 - 558
B - O	722 - 85	L - H	589 - 68
C - E	161 - 630	H - I	361 - 1393

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3", min.)nails @ 6" oc.

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at -1.25 to 60 plf at 23.83
BC: From 6 plf at -1.25 to 6 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 6.08
BC: From 60 plf at 6.08 to 60 plf at 18.08
BC: From 20 plf at 18.08 to 20 plf at 23.71

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66143	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T46
FROM: RJL		Qty: 2	DAVIS RESIDENCE Truss Label: E1a 24'2" Stepdown Hip	DrwNo: 276.25.1437.53423 GA / FV 10/03/2025

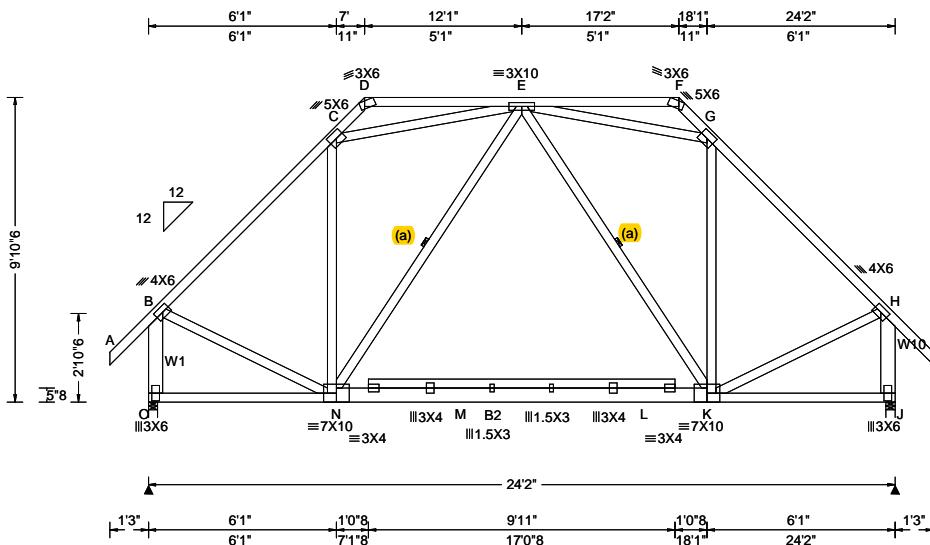

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.146 M 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.242 M 999 240	O	1286	/ -	/ 492	/ 110	/ 211
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.015 J - -	J	1286	/ -	/ 492	/ 110	/ -
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.025 J - -	Wind reactions based on MWFRS					
NCBCLL:	10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	O	Brg Wid = 3.5	Min Req = 1.5 (Truss)			
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.292	J	Brg Wid = 3.5	Min Req = 1.5 (Truss)			
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max BC CSI: 0.512	Bearings O & J are a rigid surface.					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No	Rep Fac: No	Max Web CSI: 0.483	Members not listed have forces less than 375#					
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)	Plate Type(s):		Maximum Top Chord Forces Per Ply (lbs)					
	GCpi: 0.18	WAVE			Chords	Tens.Comp.	Chords	Tens. Comp.		
	Wind Duration: 1.60				B - C	194 - 1137	G - H	192 - 1137		
VIEW Ver: 24.02.00C.1213.15										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Webs: 2x4 SP #3; W1, W10 2x6 SP #1;

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
N - M	741 - 127	L - K	741 - 127
M - N	1764 - 1097		

Maximum Web Forces Per Ply (lbs)

Web	Tens.Comp.	Web	Tens. Comp.
B - O	180 - 1249	E - G	161 - 642
B - N	735 - 87	K - H	735 - 87
C - E	162 - 642	H - J	182 - 1249

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "I" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3", min.)nails @ 6" oc.

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at -1.25 to 60 plf at 25.42
BC: From 6 plf at -1.25 to 6 plf at 0.00
TC: From 20 plf at 0.00 to 20 plf at 6.08
BC: From 60 plf at 6.08 to 60 plf at 18.08
BC: From 20 plf at 18.08 to 20 plf at 24.17
BC: From 6 plf at 24.17 to 6 plf at 25.42

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.

Additional Notes

WIND LOAD CASE MODIFIED!



COA #0278

10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66197 FROM: RJL	HIPS Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: E2 24'2" Stepdown Hip Girder	Cust: R 857 JRef:1YdX8570003 T8 DrwNo: 276.25.1437.55490 GA / FV 10/03/2025
--------------------------	----------------	---	---

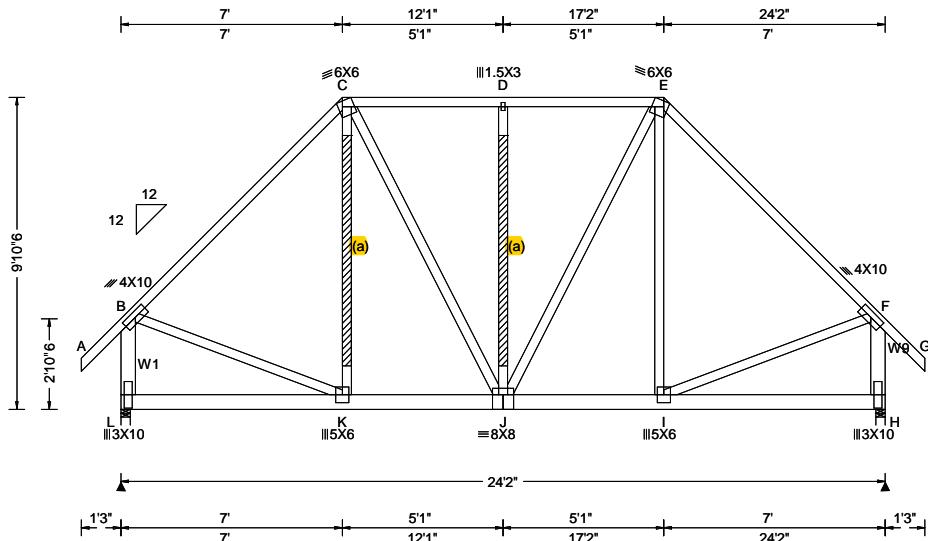

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3; W1,W9 2x6 SP #1;

Bracing

(a) #3 or better scab reinforcement. Same size & 80% length of web member. Attach with 10d Box or Gun (0.128" x 3", min.) nails @ 6" oc.

Special Loads

Special Loads					
		Lumber Dur.Fac.=1.25		Plate Dur.Fac.=1.25	
TC: From	60 plf at	-1.25 to	60 plf at	12.73	
TC: From	30 plf at	12.73 to	30 plf at	17.17	
TC: From	60 plf at	17.17 to	60 plf at	25.42	
BC: From	6 plf at	-1.25 to	6 plf at	0.00	
BC: From	20 plf at	0.00 to	20 plf at	12.08	
BC: From	10 plf at	12.08 to	10 plf at	17.14	
BC: From	20 plf at	17.14 to	20 plf at	24.17	
BC: From	6 plf at	24.17 to	6 plf at	25.42	
PLB: From	40 plf at	7.29 to	40 plf at	9.99	
PLB: From	20 plf at	14.18 to	20 plf at	16.88	
BC: 900 lb Conc. Load at	12.73				
BC: 283 lb Conc. Load at	13.10				
BC: 275 lb Conc. Load at	15.10				
BC: 886 lb Conc. Load at	17.14				

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads and reactions based on MWFRS.
End verticals exposed to wind pressure. Deflection

Wind loading based on both gable and hip roof types.



Florida Dept. of Product Approval #FL-1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**


****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCS1 (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCS1. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCS1 sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66282	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T19
FROM: RJL		Qty: 3	DAVIS RESIDENCE Truss Label: G1 21'7"8 Stepdown Hip	DrwNo: 276.25.1438.50243 GA / FV 10/03/2025

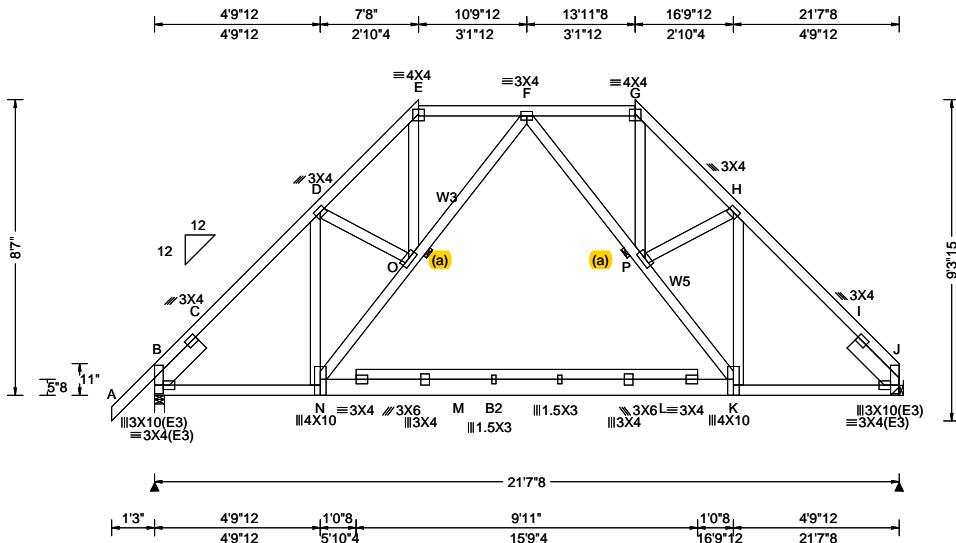

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	R+ / R-	/ Rh	Gravity	Non-Gravity	
TCDL:	7.00	Speed:	120 mph	Pf: NA	Ce: NA		VERT(LL):	M	999	360	/459	/232	/162
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL):	M	999	240	J	1100	/-
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL):	J	-	-		/445	/215
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	J	-	-			/-
NCBCLL:	10.00	Mean Height:	22.71 ft				Creep Factor: 2.0						
TCDL:	4.2 psf	Building Code:	FBC 8th Ed. 2023 Res.				Max TC CSI:	0.196					
Soffit:	2.00	BCDL:	5.2 psf				Max BC CSI:	0.508					
Load Duration:	1.25	MWFRS Parallel Dist:	h/2 to h				Max Web CSI:	0.174					
Spacing:	24.0 "	C&C Dist a:	3.00 ft										
		Loc. from endwall:	not in 9.00 ft										
		GCpi:	0.18										
		Wind Duration:	1.60										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Webs: 2x4 SP #3; W3,W5 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'
Rt Slider: 2x6 SP #1; block length = 1.833'

Bracing

(a) Continuous lateral restraint equally spaced on member.

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at -1.25 to 60 plf at 21.62
BC: From 6 plf at -1.25 to 6 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 4.81
BC: From 60 plf at 4.81 to 60 plf at 16.81
BC: From 20 plf at 16.81 to 20 plf at 21.62

Hangers / Ties

(J) Hanger Support Required, by others

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

WIND LOAD CASE MODIFIED!



COA #0278

10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66279	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T57
FROM: RJL		Qty: 3	DAVIS RESIDENCE Truss Label: G1a 21'7"8 Stepdown Hip	DrwNo: 276.25.1438.54390 GA / FV 10/03/2025

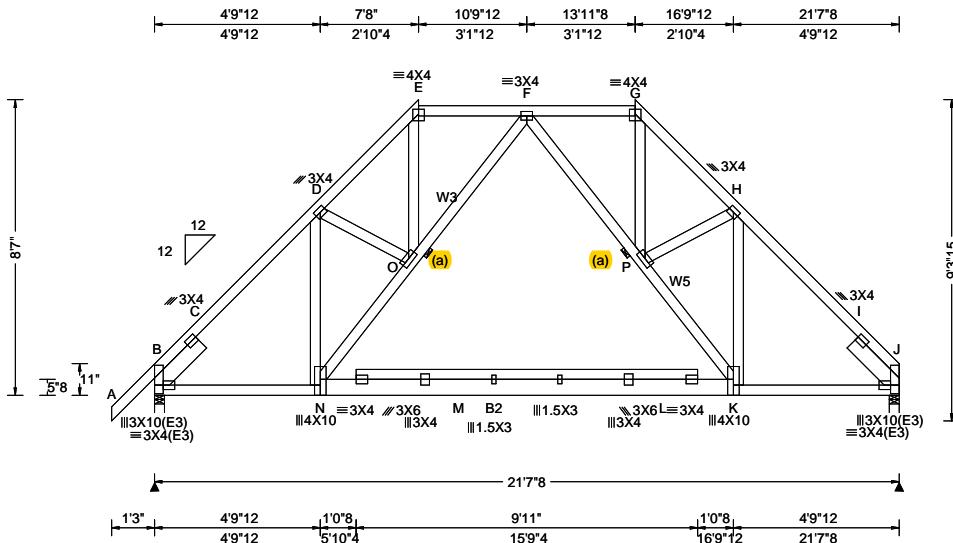

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	R+	/ R-	Gravity / Rh	Non-Gravity / Rw	/ U / RL
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL):	M	999	360	B 1187	/ -	/ -
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL):	M	999	240	J 1100	/ -	/ -
BCDL:	10.00	Risk Category:	II				HORZ(LL):	J	-	-			
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	J	-	-			
NCBCLL:	10.00	Mean Height:	22.71 ft				Creep Factor: 2.0						
Soffit:	2.00	TCDL:	4.2 psf				Max TC CSI: 0.196						
Load Duration:	1.25	BCDL:	5.2 psf				Max BC CSI: 0.508						
Spacing:	24.0 "	MWFRS Parallel Dist:	h/2 to h				Max Web CSI: 0.174						
		C&C Dist a:	3.00 ft										
		Loc. from endwall:	not in 9.00 ft										
		GCpi:	0.18										
		Wind Duration:	1.60										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Webs: 2x4 SP #3; W3,W5 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'
Rt Slider: 2x6 SP #1; block length = 1.833'

Bracing

(a) Continuous lateral restraint equally spaced on member.

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at -1.25 to 60 plf at 21.62
BC: From 6 plf at -1.25 to 6 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 4.81
BC: From 60 plf at 4.81 to 60 plf at 16.81
BC: From 20 plf at 16.81 to 20 plf at 21.62

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24° oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

WIND LOAD CASE MODIFIED!



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66286	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T54
FROM: RJL		Qty: 3	DAVIS RESIDENCE Truss Label: G1b 21'7"8 Stepdown Hip	DrwNo: 276.25.1438.59230 GA / FV 10/03/2025

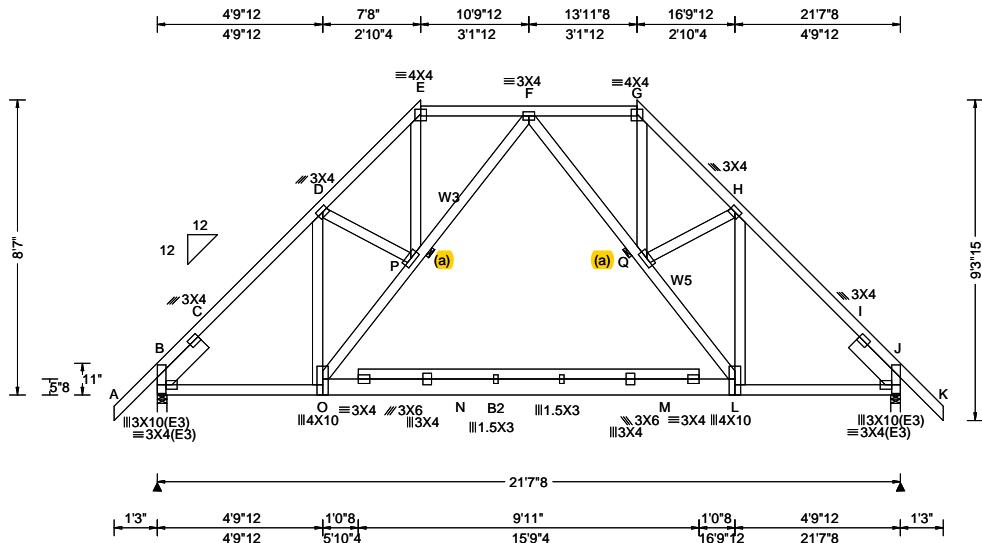

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)										
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity	Non-Gravity						
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL):	1.053	N	999	360	B	1185	/ -	/ -	/459	/232	/150
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL):	0.250	N	999	240	J	1185	/ -	/ -	/459	/215	/ -
BCDL:	10.00	Risk Category:	II				HORZ(LL):	0.025	I	-	-							
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	0.041	I	-	-							
NCBCLL: 10.00	Mean Height: 22.71 ft	TCDL: 4.2 psf	Building Code:	Creep Factor: 2.0			Creep Factor: 2.0											
Soffit: 2.00	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.195				Max TC CSI: 0.195											
Load Duration: 1.25	Load Duration: 22.71 ft	TPI Std: 2014	Max BC CSI: 0.508				Max BC CSI: 0.508											
Spacing: 24.0 "	Spacing: 24.0 "	Rep Fac: No	Max Web CSI: 0.169				Max Web CSI: 0.169											
		FT/RT: 20(0)/10(0)	Plate Type(s):				VIEW Ver: 24.02.00C.1213.15											
		WAVE																

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1; B2 2x6 SP #1;
Webs: 2x4 SP #3; W3,W5 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'
Rt Slider: 2x6 SP #1; block length = 1.833'

Bracing

(a) Continuous lateral restraint equally spaced on member.

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at -1.25 to 60 plf at 22.87
BC: From 6 plf at -1.25 to 6 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 4.81
BC: From 60 plf at 4.81 to 60 plf at 16.81
BC: From 20 plf at 16.81 to 20 plf at 21.62
BC: From 6 plf at 21.62 to 6 plf at 22.87

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

WIND LOAD CASE MODIFIED!



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66441	HIPS	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T25
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: G2 21'7"8 Stepdown Hip Girder	DrwNo: 276.25.1439.01273 GA / FV 10/03/2025

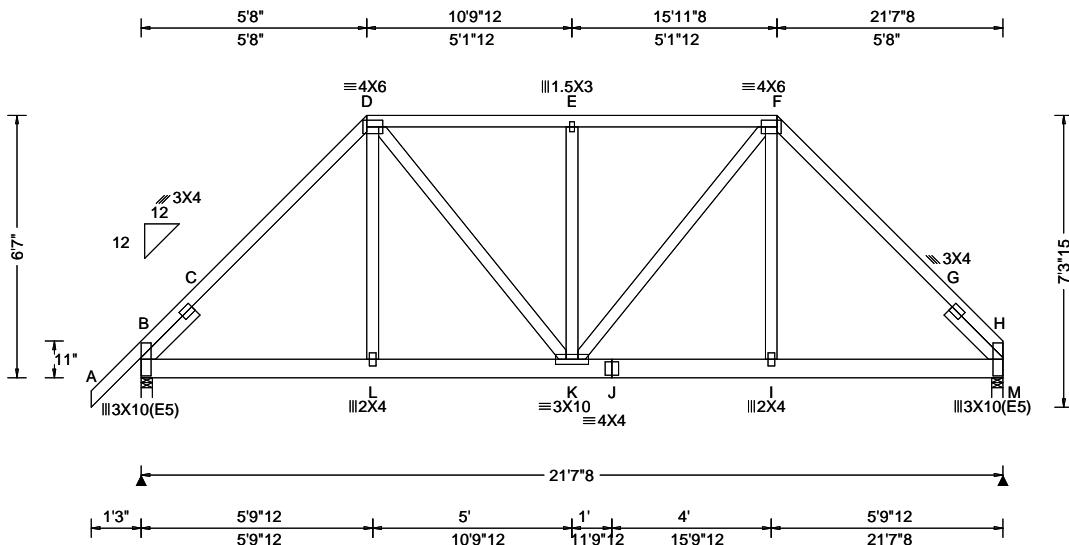

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	Gravity R+	/ R-	/ Rh	Non-Gravity / Rw	/ U / RL
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL): 0.034 E 999 360	B	1562	/-	/-	/83	/-
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL): 0.068 E 999 240	M	1477	/-	/-	/65	/-
BCDL:	10.00	Risk Category:	II				HORZ(LL): 0.021 C - -						
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL): 0.042 C - -						
Mean Height: 21.71 ft		Building Code:					Creep Factor: 2.0						
NCBCLL: 0.00		FBC 8th Ed. 2023 Res.					Max TC CSI: 0.456						
Soffit: 2.00		TPI Std: 2014					Max BC CSI: 0.220						
Load Duration: 1.25		Rep Fac: No					Max Web CSI: 0.410						
Spacing: 24.0 "		FT/RT:20(0)/10(0)											
C&C Dist a: 3.00 ft		Plate Type(s):											
Loc. from endwall: NA		WAVE											
GCpi: 0.18													
Wind Duration: 1.60													
Lumber		VIEW Ver: 24.02.00C.1213.15											

Lumber
 Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3;
 Lt Slider: 2x4 SP #3; block length = 1.833'
 Rt Slider: 2x4 SP #3; block length = 1.833'

Loading
 #1 hip supports 5-8-0 jacks with no webs.

Purlins
 In lieu of structural panels use purlins to brace all flat
 TC @ 24" oc.

Wind
 Wind loads and reactions based on MWFRS.
 Wind loading based on both gable and hip roof types.

Maximum Bot Chord Forces Per Ply (lbs)					
Chords	Tens.Comp.	Chords	Tens. Comp.		
B - L	1178	-51	J - I	1193	-50
L - K	1185	-48	I - H	1185	-52
K - J	1193	-50			

Maximum Web Forces Per Ply (lbs)					
Web	Tens.Comp.	Web	Tens. Comp.		
D - L	420	0	K - F	466	-22
D - K	478	-24	I - F	428	0
E - K	137	-560			



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A7 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66382	COMM	Ply: 2	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T55
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: H1 14'10" Common Girder	DrwNo: 276.25.1439.20033 GA / FV 10/03/2025

2 Complete Trusses Required

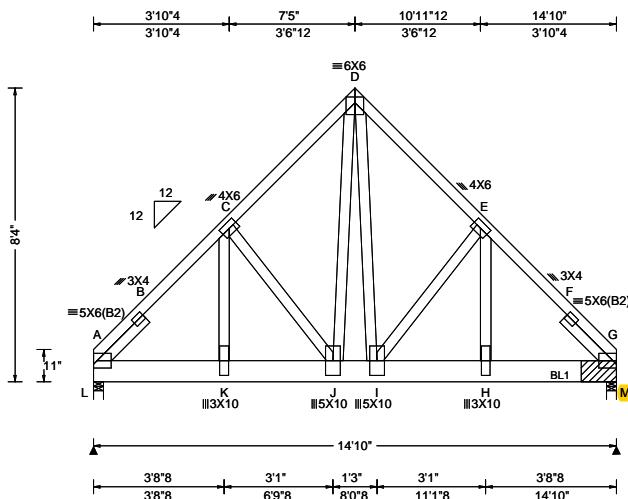

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/R-	/Rh	Non-Gravity /Rw	/U /RL	
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.041 J 999 360	L	4044	/-	/-	/760	/-	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.077 J 999 240	M	7331	/-	/-	/1266	/-	
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.018 C - -	Wind reactions based on MWFRS						
Des Ld:	37.00	EXP: B Kzt: NA	Building Code:	HORZ(TL): 0.032 C - -	L	Brg Wid = 3.4	Min Req = 2.0 (Truss)				
NCBCLL: 0.00	Mean Height: 23.21 ft	FBC 8th Ed. 2023 Res.	Creep Factor: 2.0	Max TC CSI: 0.210	M	Brg Wid = 3.4	Min Req = -				
Soffit: 2.00	TCDL: 4.2 psf	TPI Std: 2014	Max BC CSI: 0.248	Max Web CSI: 0.641	Bearings L & M are a rigid surface.						
Load Duration: 1.25	BCDL: 5.2 psf	Rep Fac: No	VIEW Ver: 24.02.00C.1213.15	Members not listed have forces less than 375#						Maximum Top Chord Forces Per Ply (lbs)	
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2	FT/RT:20(0)/10(0)	Chords Tens.Comp. Chords Tens. Comp.						A - B 476 -2451 D - E 472 -2446		
C&C Dist a: 3.00 ft	C&C Dist b: 3.00 ft	Plate Type(s):	B - C 467 -2419 E - F 568 -3131						C - D 481 -2456 F - G 576 -3163		
Loc. from endwall: not in 4.50 ft	GCpi: 0.18	WAVE									
Wind Duration: 1.60											

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x8 SP SS Dense;
Webs: 2x4 SP #3;
Lt Slider: 2x4 SP #3; block length = 1.833'
Rt Slider: 2x4 SP #3; block length = 1.833'

Nailnote

Nail Schedule: 0.128"x3", min. nails
Top Chord: 1 Row @ 12.00" o.c.
Bot Chord: 2 Rows @ 4.50" o.c. (Each Row)
Webs : 1 Row @ 4" o.c.
Use equal spacing between rows and stagger nails in each row to avoid splitting.

Special Loads


----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at 0.00 to 60 plf at 14.83
BC: From 20 plf at 0.00 to 20 plf at 6.79
BC: From 10 plf at 6.79 to 10 plf at 14.83
BC: 4072 lb Conc. Load at 6.79
BC: 1550 lb Conc. Load at 8.73,10.73,12.73,14.73

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.

Bearing Block(s)

Brg blocks: 0.128"x3", min. nails
brg x-loc #blocks length/blk #nails/blk wall plate
2 14.552' 1 12" 6 Rigid Surface
Brg block to be same size and species as chord.
Refer to drawing CNNAILSP1014 for more information.

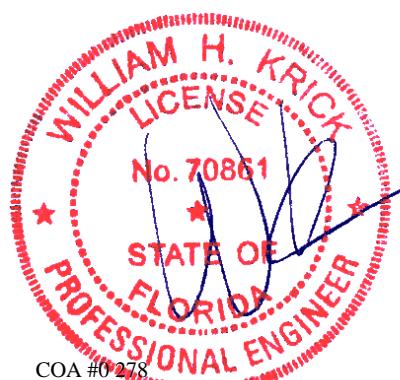

Florida Dept. of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66259	GABL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T43
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: H2-G 14'10" Gable	DrwNo: 276.25.1439.22943 GA / FV 10/03/2025

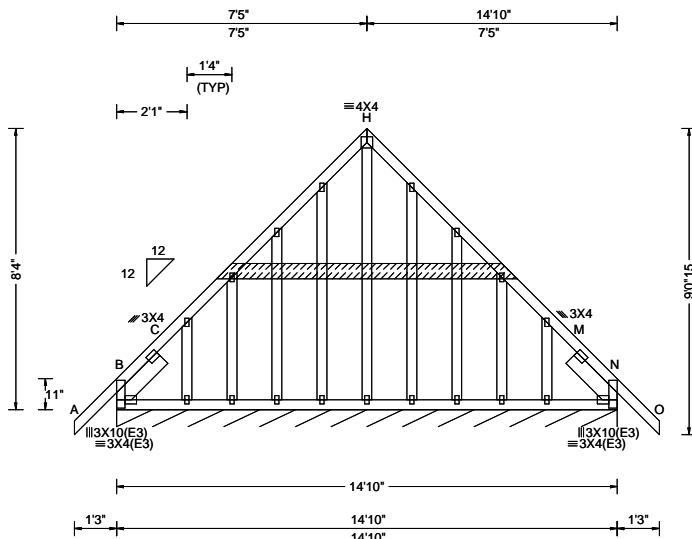

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 I 999 360	Loc R+	/ R-	/ Rh	/ Rw	/ U / RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.002 M 999 240	Wind reactions based on MWFRS					
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.000 I - -	N* 113	/ -	/ -	/ 46	/ 8	/ 11
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.006 C - -	N	Brg Wid = 177	Min Req = -			
NCBCLL:	10.00	Mean Height: 22.58 ft		Creep Factor: 2.0	Bearing B is a rigid surface.					
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.104	Members not listed have forces less than 375#					
Load Duration: 1.25		BCDL: 5.2 psf		Max BC CSI: 0.024						
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.296						
		C&C Dist a: 3.00 ft								
		Loc. from endwall: not in 5.00 ft								
		GCpi: 0.18								
		Wind Duration: 1.60								
					VIEW Ver: 24.02.00C.1213.15					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP #1; block length = 1.833'
Rt Slider: 2x6 SP #1; block length = 1.833'

Plating Notes

All plates are 1.5X3 except as noted.

Loading

Truss designed to support 1-0-0 top chord outlookers and cladding load not to exceed 5.00 PSF one face and 24.0" span opposite face. Top chord must not be cut or notched, unless specified otherwise.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types. Gable meets L/120 deflection criteria for wind load applied to face. Calculated deflection ratio is L/999.

Additional Notes

See DWGS GBLDIAG220325 and GBLLEDG220325 for gable ledger and diagonal reinforcement details.

Exposed portion of gable face shall be reinforced with sheathing and the wind pressures shall be transferred into lateral diaphragms. Connections and designs for diaphragms is the responsibility of the Building Designer in accordance with ANSI/TPI 1.



Florida 10/06/2025 State of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66395	COMM	Ply: 2	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T56
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: K1 14'9"8 Common Girder	DrwNo: 276.25.1441.17927 GA / FV 10/03/2025

2 Complete Trusses Required

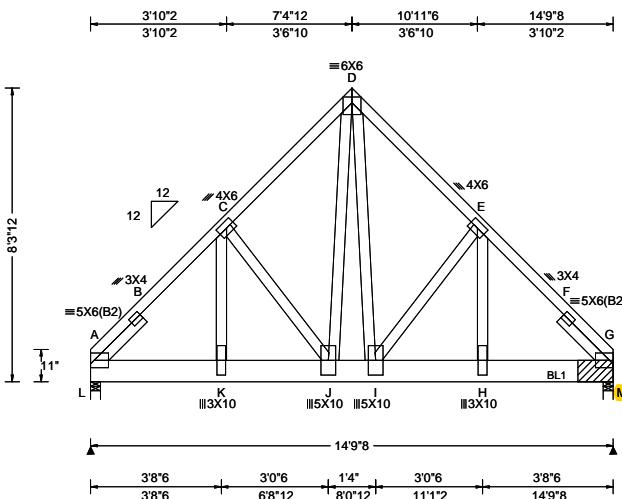

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	R+	/R-	/Rh	Gravity	Non-Gravity
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL): 0.040 I 999 360	L	3944	/-	/-	/785	/-
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL): 0.075 I 999 240	M	7316	/-	/-	/1285	/-
BCDL:	10.00	Risk Category:	II				HORZ(LL): 0.017 C - -						
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL): 0.032 C - -						
NCBCLL: 0.00	Mean Height: 23.20 ft	TCDL: 4.2 psf	BCDL: 5.2 psf	Building Code:	Creep Factor: 2.0		Creep Factor: 2.0	Wind reactions based on MWFRS					
Soffit: 2.00	Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2	C&C Dist a: 3.00 ft	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.208		Max TC CSI: 0.208	L	Brg Wid = 3.4	Min Req = 2.0 (Truss)			
Spacing: 24.0 "		Loc. from endwall: Any	GCpi: 0.18	TPI Std: 2014	Max BC CSI: 0.247		Max BC CSI: 0.247	M	Brg Wid = 3.4	Min Req = -			
			Wind Duration: 1.60	Rep Fac: No	Max Web CSI: 0.615		Max Web CSI: 0.615						
				FT/RT:20(0)/10(0)	Plate Type(s):		VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x8 SP SS Dense;
Webs: 2x4 SP #3;
Lt Slider: 2x4 SP #3; block length = 1.833'
Rt Slider: 2x4 SP #3; block length = 1.833'

Nailnote

Nail Schedule: 0.128" x 3", min. nails
Top Chord: 1 Row @ 12.00" o.c.
Bot Chord: 2 Rows @ 4.50" o.c. (Each Row)
Webs : 1 Row @ 4" o.c.
Use equal spacing between rows and stagger nails
in each row to avoid splitting.

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at 0.00 to 60 plf at 14.79
BC: From 20 plf at 0.00 to 20 plf at 6.73
BC: From 10 plf at 6.73 to 10 plf at 14.79
BC: 3859 lb Conc. Load at 6.73
BC: 1575 lb Conc. Load at 8.73,10.73,12.73,14.73

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.

Bearing Block(s)

Brg blocks: 0.128" x 3", min. nails
brg x-loc #blocks length/blk #nails/blk wall plate
2 14.510' 1 12" 6 Rigid Surface
Brg block to be same size and species as chord.
Refer to drawing CNNAILSP1014 for more information.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A2 for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66257	GABL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T45
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: K2-G 14'9"8 Gable	DrwNo: 276.25.1441.19803 GA / FV 10/03/2025

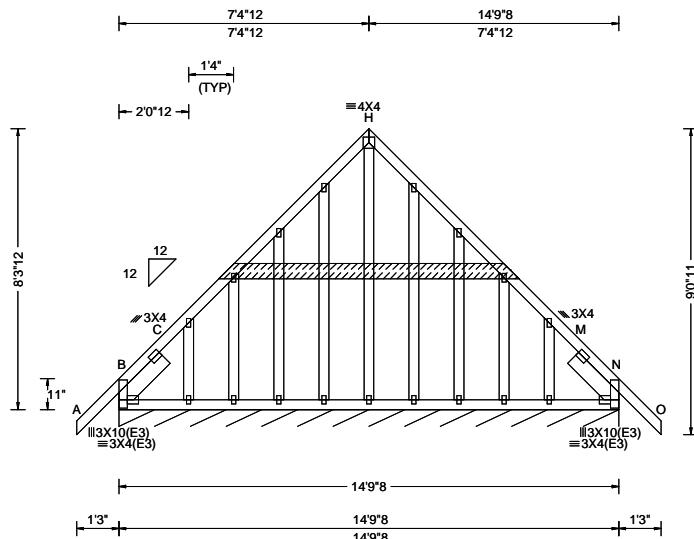

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF										
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity									
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 G 999 360	Loc R+	/ R-	/ Rh	/ Rw	/ U / RL						
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.002 M 999 240	Wind reactions based on MWFRS										
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.000 I - -	N* 113	/ -	/ -	/ 46	/ 8	/ 11					
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.006 C - -	N Brg Wid = 177 Min Req = -										
NCBCLL:	10.00	Mean Height: 22.57 ft		Creep Factor: 2.0	Bearing B is a rigid surface.										
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.104	Members not listed have forces less than 375#										
Load Duration: 1.25		BCDL: 5.2 psf		Max BC CSI: 0.024											
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.300											
		C&C Dist a: 3.00 ft													
		Loc. from endwall: Any													
		GCpi: 0.18													
		Wind Duration: 1.60													
Lumber															
Top chord: 2x4 SP #1;															
Bot chord: 2x4 SP #1;															
Webs: 2x4 SP #3;															
Lt Slider: 2x6 SP #1; block length = 1.833'															
Rt Slider: 2x6 SP #1; block length = 1.833'															
Plating Notes															
All plates are 1.5X3 except as noted.															
Loading															
Truss designed to support 1-0-0 top chord outlookers and cladding load not to exceed 5.00 PSF one face and 24.0" span opposite face. Top chord must not be cut or notched, unless specified otherwise.															
Wind															
Wind loads based on MWFRS with additional C&C member design.															
Wind loading based on both gable and hip roof types.															
Gable meets L/120 deflection criteria for wind load applied to face. Calculated deflection ratio is L/999.															
Additional Notes															
See DWGS GBLEDIG220325 and GBLLEDG220325 for gable ledger and diagonal reinforcement details.															
Exposed portion of gable face shall be reinforced with sheathing and the wind pressures shall be transferred into lateral diaphragms. Connections and designs for diaphragms is the responsibility of the Building Designer in accordance with ANSI/TPI 1.															

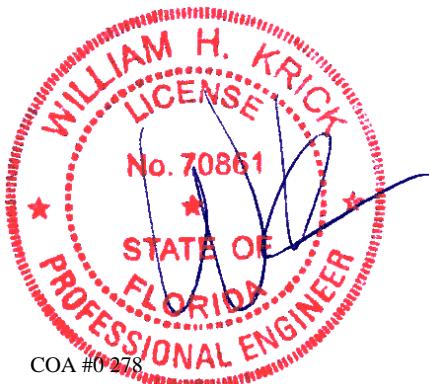

10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66151 FROM: RJL	COMM Ply: 1 Qty: 3	Job Number: B61800a DAVIS RESIDENCE Truss Label: L1 12'8" Common	Cust: R 857 JRef: 1YdX8570003 T4 DrwNo: 276.25.1441.21773 GA / FV 10/03/2025
--------------------------	--------------------------	--	--

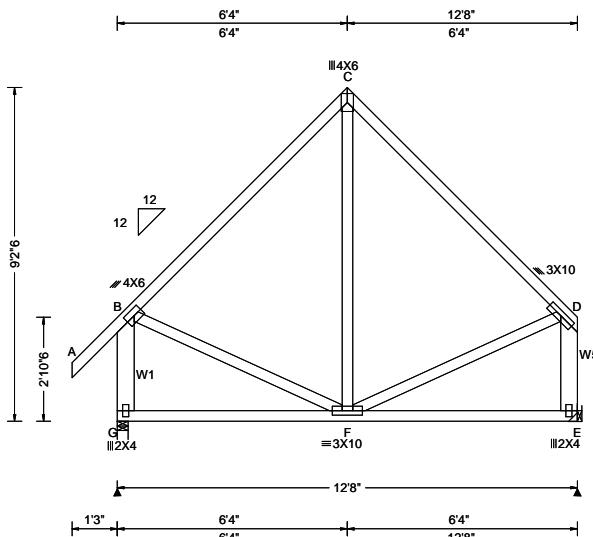

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/R-	/Rh	Non-Gravity /Rw	/U	/RL
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.003 F 999 360	G	591	/-	/	/304	/-	/171
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.007 F 999 240	E	501	/-	/	/293	/-	/-
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.001 B - -							
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.003 C - -							
NCBCLL: 10.00		Mean Height: 15.00 ft		Creep Factor: 2.0							
Soffit: 2.00		TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.368							
Load Duration: 1.25		BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.277							
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.085							
		C&C Dist a: 3.00 ft	Rep Fac: No								
		Loc. from endwall: Any	FT/RT:20(0)/10(0)								
		GCpi: 0.18	Plate Type(s):								
		Wind Duration: 1.60	WAVE								
				VIEW Ver: 24.02.00C.1213.15							

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W1,W5 2x6 SP #1;

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.				
B - G	161	-536	D - E	130	-446		

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66147 FROM: RJL	COMM Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: L1a 12'8" Common	Cust: R 857 JRef: 1YdX8570003 T3 DrwNo: 276.25.1441.24373 GA / FV 10/03/2025
--------------------------	----------------	---	--

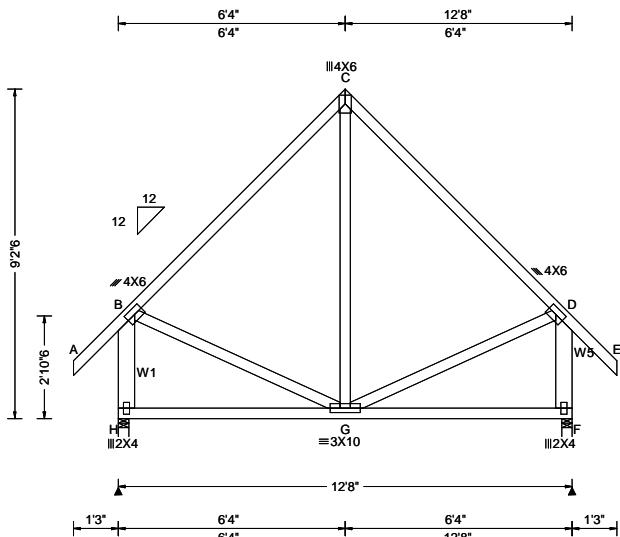

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/R-	/Rh	Non-Gravity /Rw	/U	/RL
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.003 G 999 360	H	587	/-	/	/308	/-	/198
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.007 G 999 240	F	587	/-	/	/308	/-	/-
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 F - -							
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.003 C - -							
NCBCLL: 10.00		Mean Height: 15.00 ft		Creep Factor: 2.0							
Soffit: 2.00		TCDL: 4.2 psf		Max TC CSI: 0.354							
Load Duration: 1.25		BCDL: 5.2 psf		Max BC CSI: 0.276							
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.072							
		C&C Dist a: 3.00 ft									
		Loc. from endwall: Any									
		GCpi: 0.18									
		Wind Duration: 1.60									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W1,W5 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - H	179	-532	D - F	179	-532



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66153	GABL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T2
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo: 276.25.1441.26980

Truss Label: L2-G 12'8" Gable

GA / FV 10/03/2025

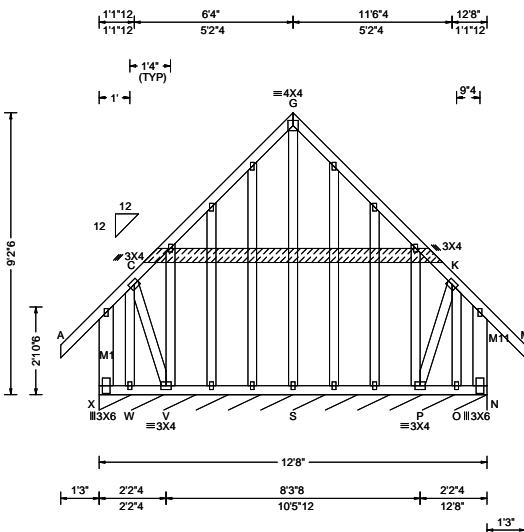

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 F 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.004 G 999 240	N* 122	/ -	/ -	/ 47	/ 6
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 C - -					/ 23
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.017 B - -					
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0					
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.150					
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2		Max BC CSI: 0.047					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.406					
	Loc. from endwall: Any	FT/RT:20(0)/10(0)							
	GCpi: 0.18	Plate Type(s):							
	Wind Duration: 1.60	WAVE							
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; M1,M11 2x6 SP #1;

Plating Notes

All plates are 1.5X3 except as noted.

Loading

Truss designed to support 1-0-0 top chord outlookers and cladding load not to exceed 5.00 PSF one face and 24.0" span opposite face. Top chord must not be cut or notched, unless specified otherwise.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.

Gable meets L/120 deflection criteria for wind load applied to face. Calculated deflection ratio is L/999.

Additional Notes

See DWGS GBLDIAG220325 and GBLLEDG220325 for gable ledger and diagonal reinforcement details.

Exposed portion of gable face shall be reinforced with sheathing and the wind pressures shall be transferred into lateral diaphragms. Connections and designs for diaphragms is the responsibility of the Building Designer in accordance with ANSI/TPI 1.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66199	MONO	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T15
FROM: RJL		Qty: 7	DAVIS RESIDENCE Truss Label: M1 76" Mono	DrwNo: 276.25.1441.29820 GA / FV 10/03/2025

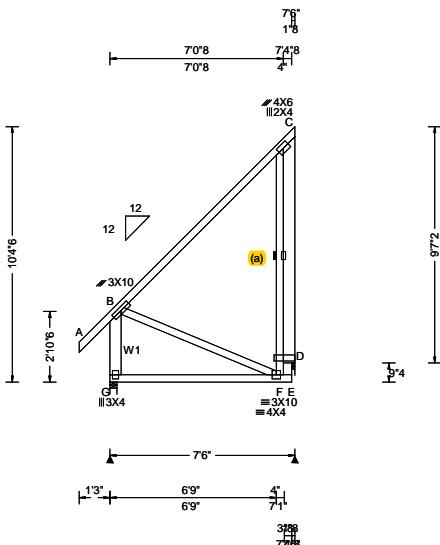

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					Non-Gravity	
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): -0.006 E 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): -0.020 E 999 240	G	385	/-	/-	/175	/-	/227
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.004 C - -	D	292	/-	/-	/268	/137	/-
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.009 C - -	Wind reactions based on MWFRS						
NCBCLL: 10.00		Mean Height: 15.08 ft	Building Code:	Creep Factor: 2.0	G	Brg Wid = 3.5	Min Req = 1.5	(Truss)			
Soffit: 2.00		TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.412	D	Brg Wid = 1.5	Min Req = 1.5	(Support)			
Load Duration: 1.25		BCDL: 5.2 psf	TPI Std: 2014	Max BC CSI: 0.378	Bearings G & D are a rigid surface.						
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h	Rep Fac: No	Max Web CSI: 0.202	Members not listed have forces less than 375#						
		C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)		Maximum Bot Chord Forces Per Ply (lbs)						
		Loc. from endwall: not in 9.00 ft	Plate Type(s):		Chords	Tens.Comp.					
		GCpi: 0.18	WAVE		G - F	172	- 410				
		Wind Duration: 1.60									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W1 2x6 SP #1;
Rt Bearing Leg: 2x6 SP #1;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Maximum Web Forces Per Ply (lbs)

Web	Tens.Comp.	Web	Tens. Comp.		
B - F	397	- 152	C - D	958	- 863



Florida 10/06/2023 State of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66201	HIPM	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T28
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: M2 7'6" Mono Hip	DrwNo: 276.25.1441.31700 GA / FV 10/03/2025

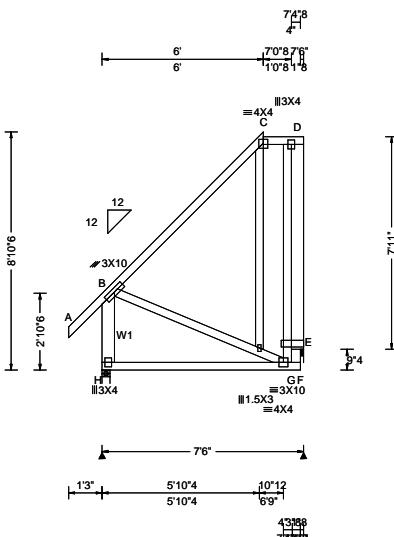

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/R-	Non-Gravity /Rh	/Rw	/U	/RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.032 C 999 360	H	385	/-	/	176	/-	/196
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.048 C 999 240	E	292	/-	/	224	/103	/-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.033 D - -							
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.050 D - -							
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0							
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.347							
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h/2 to h		Max BC CSI: 0.377							
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.338							
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)									
	GCpi: 0.18	Plate Type(s):									
	Wind Duration: 1.60	WAVE									
VIEW Ver: 24.02.00C.1213.15											
D - E 838 - 789											

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Web: 2x4 SP #3; W1 2x6 SP #1;
Rt Bearing Leg: 2x6 SP #1;

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24° oc.

Wind

Wind loads based on MWFRS with additional C&C
member design.

Left end vertical exposed to wind pressure. Deflection
meets L/360.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



Florid 10/06/2025 Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66203	HIPM	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T13
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: M3 7'6" Mono Hip Girder	DrwNo: 276.25.1441.33943 GA / FV 10/03/2025

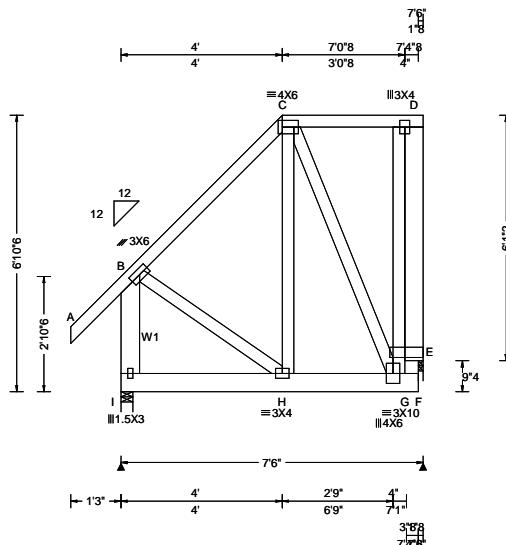

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity	Non-Gravity	
TCDL:	7.00	Speed:	120 mph	Pf: NA	Ce: NA		VERT(LL):	0.004	H	999	360	I	459
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL):	0.008	H	999	240	E	425
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL):	0.003	C	-	-		
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	0.007	C	-	-		
NCBCLL: 0.00	Mean Height: 15.00 ft	TCDL: 4.2 psf	BCDL: 5.2 psf	Building Code:			Creep Factor: 2.0					Wind reactions based on MWFRS	
Soffit: 2.00	Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2	C&C Dist a: 3.00 ft	FBC 8th Ed. 2023 Res.			Max TC CSI: 0.120					I	Brg Wid = 3.5 Min Req = 1.5 (Truss)
Spacing: 24.0 "	Loc. from endwall: NA	GCpi: 0.18	Loc. from endwall: NA	TPI Std: 2014			Max BC CSI: 0.048					E	Brg Wid = 1.5 Min Req = 1.5 (Support)
		Wind Duration: 1.60		Rep Fac: No			Max Web CSI: 0.239						Bearings I & E are a rigid surface.
				FT/RT:20(0)/10(0)									Members not listed have forces less than 375#
				Plate Type(s):									Maximum Web Forces Per Ply (lbs)
				WAVE									Webs Tens.Comp. Webs Tens. Comp.
													B - I 15 -423 D - E 320 -446

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Web: 2x4 SP #3; W1 2x6 SP #1;
Rt Bearing Leg: 2x6 SP #1;

Loading

#1 hip supports 4-0-0 jacks W/2 panel TC and no end vert.

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind

Wind loads and reactions based on MWFRS.
Left end vertical exposed to wind pressure. Deflection
meets L/360.
Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.



Florida 06/2025 Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66213 MONO Ply: 1 Job Number: B61800a Cust: R 857 JRef: 1YdX8570003 T32
FROM: RJL Qty: 11 DAVIS RESIDENCE DrwNo: 276.25.1441.36197
Truss Label: N1 5'3" Mono GA / FV 10/03/2025

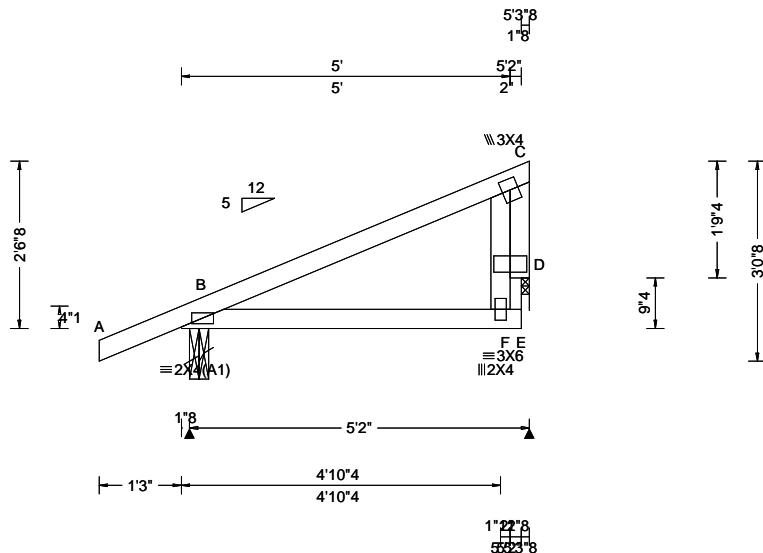

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)								
					Gravity			Non-Gravity					
					Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL		
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP	Deflection in	loc	L/defl	L/#			
TCDL:	7.00	Speed: 120 mph	Pf: NA		Ce: NA	VERT(LL):	0.007	B	999	360	B	287	/ -
BCLL:	0.00	Enclosure: Closed	Lu: NA	Cs: NA		VERT(CL):	0.012	B	999	240	D	183	/ -
BCDL:	10.00	Risk Category: II	Snow Duration: NA			HORZ(LL):	0.003	B	-	-			
Des Ld:	37.00	EXP: B Kzt: NA				HORZ(TL):	0.006	B	-	-			
NCBLL:	10.00	Mean Height: 15.00 ft	Building Code:			Creep Factor: 2.0					Wind reactions based on MWFRS		
TCDL:	4.2 psf		FBC 8th Ed. 2023 Res.			Max TC CSI:	0.176				B	Brg Wid = 3.5	Min Req = 1.5 (Truss)
Soffit:	2.00		TPI Std: 2014			Max BC CSI:	0.175				D	Brg Wid = 1.5	Min Req = 1.5 (Support)
Load Duration:	1.25		Rep Fac: No			Max Web CSI:	0.155				Bearings B & D are a rigid surface.		
Spacing:	24.0 "		FT/RT:20(0)/10(0)								Members not listed have forces less than 375#		
			Plate Type(s):								Maximum Web Forces Per Ply (lbs)		
			WAVE								Webs	Tens.Comp.	
			VIEW Ver: 24.02.00C.1213.15								C - D	422	- 449

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Rt Bearing Leg: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design

Right end vertical not exposed to wind pressure.

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**


****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
FURNITURE, BATH, KITCHEN, PLUMBING, ELECTRICAL, AND ROOFING CONTRACTORS
and follow the latest codes and regulations.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66215	MONO	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T29
FROM: RJL		Qty: 3	DAVIS RESIDENCE Truss Label: N2 5'7"8 Mono	DrwNo: 276.25.1441.37827 GA / FV 10/03/2025

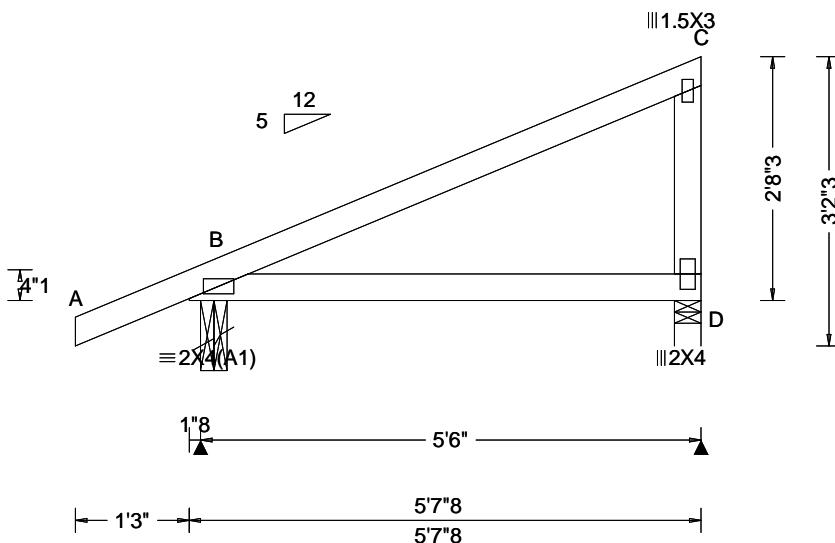

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg, Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)										
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc	L/defl	L/#	Gravity	Non-Gravity	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL): NA			B	301	/ -	/ -	/119	/2	/56		
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL): NA			D	196	/ -	/ -	/115	/11	/ -		
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL): 0.006 B	-	-									
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL): 0.011 B	-	-									
NCBCLL:	10.00	Mean Height:	15.00 ft	Building Code:			Creep Factor: 2.0											
Soffit:	2.00	TCDL:	4.2 psf	FBC 8th Ed. 2023 Res.			Max TC CSI: 0.299											
Load Duration:	1.25	BCDL:	5.2 psf	TPI Std: 2014			Max BC CSI: 0.234											
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2	Rep Fac: No			Max Web CSI: 0.125											
		C&C Dist a:	3.00 ft	FT/RT:20(0)/10(0)														
		Loc. from endwall:	Any	Plate Type(s):														
		GCpi:	0.18	WAVE														
		Wind Duration:	1.60															
VIEW Ver: 24.02.00C.1213.15																		

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types.

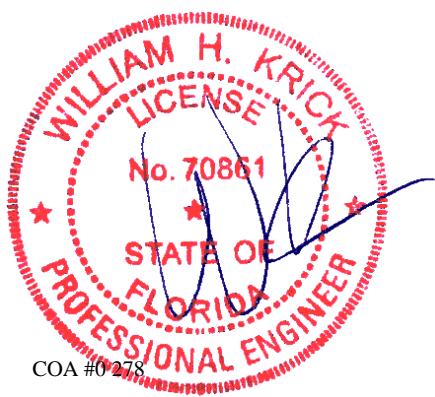

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-7 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66217	HIPM	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T20
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo:	276.25.1441.39377	
			Truss Label: N3 57'8 Mono Hip Girder	GA / FV		10/03/2025

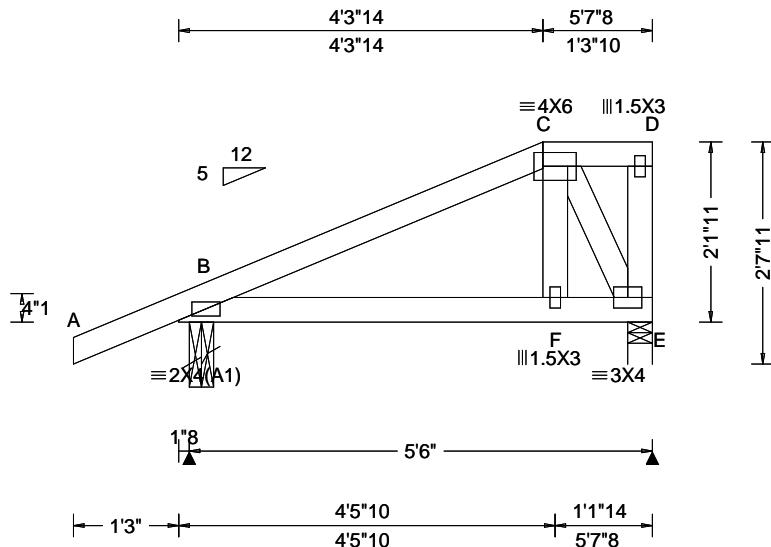

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Loading

#1 hip supports 1-0-0 jacks with no webs.

Left side jacks have 4-3-14 setback with 0-1-8 cant and 0-10-6 overhang. End jacks have 1-0-0 setback with 0-0-0 cant and 0-10-6 overhang.

Pyrlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind

Wind loads and reactions based on MWFRS.

Right end vertical not exposed to wind pressure

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types



Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66223	MONO	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T24
FROM: RJL		Qty: 4	DAVIS RESIDENCE	DrwNo: 276.25.1441.41210 GA / FV 10/03/2025

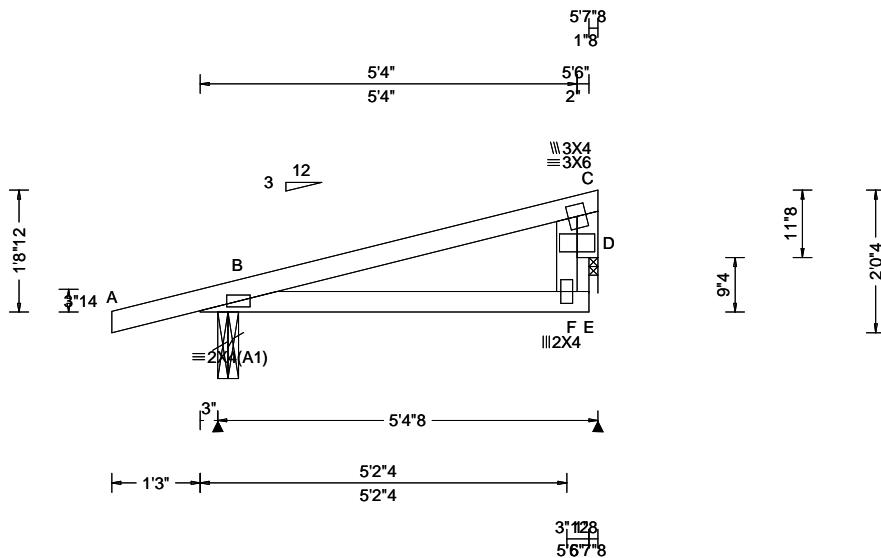

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.012 B 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.019 B 999 240	Wind reactions based on MWFRS						
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.004 B - -	B Brg Wid = 3.5 Min Req = 1.5 (Truss)						
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.006 B - -	D Brg Wid = 1.5 Min Req = 1.5 (Support)						
NCBCLL:	10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Bearings B & D are a rigid surface.						
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.183	Members not listed have forces less than 375#						
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max BC CSI: 0.181	Maximum Web Forces Per Ply (lbs)						
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No	Rep Fac: No	Max Web CSI: 0.241	Webs Tens.Comp.						
	Loc. from endwall: Any	FT/RT:20(0)/10(0)	Plate Type(s):								
	GCpi: 0.18	WAVE									
	Wind Duration: 1.60				C - D 565 -475						
Lumber											

Top chord: 2x4 SP #1;

Bot chord: 2x4 SP #1;

Web: 2x4 SP #3;

Rt Bearing Leg: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66225	MONO	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T23
FROM: RJL		Qty: 8	DAVIS RESIDENCE	DrwNo:	276.25.1441.43320	
			Truss Label: O2 3'11"8 Mono	GA / FV		10/03/2025

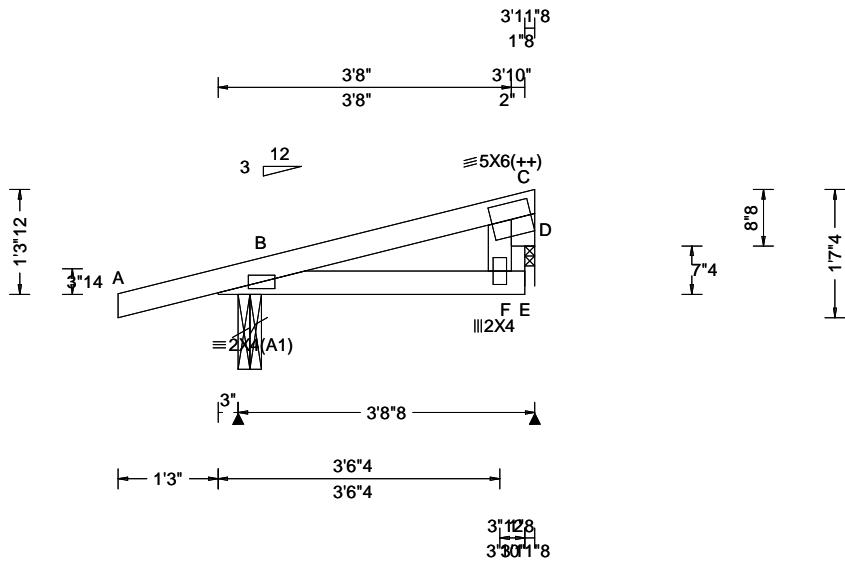

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Rt Bearing Leg: 2x4 SP #3;

Plating Notes

(++) - This plate works for both joints covered.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL-1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66227 FROM: RJL	GABL Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: O3-C 3'11"8 Gable	Cust: R 857 JRef: 1YdX8570003 T22 DrwNo: 276.25.1441.45803 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

3'9"12 3'11"8
3'9"12 1"12

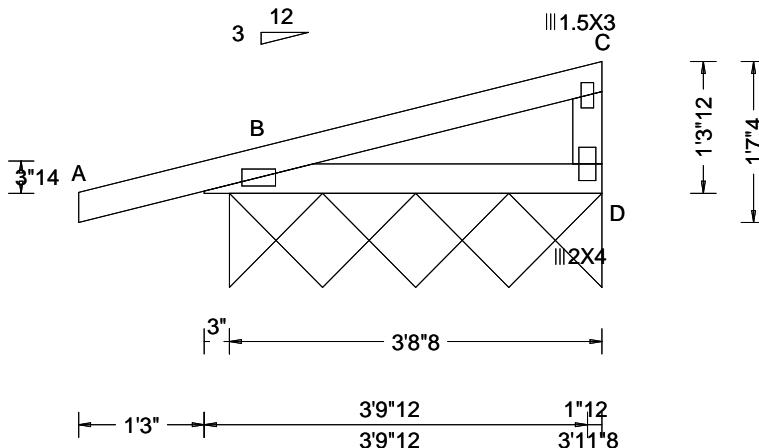

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg, Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs), or *=PLF									
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed:	120 mph	Pf: NA			VERT(LL):	NA			R+ / R-	/ Rh	/ Rw	/ U	/ RL		
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL):	NA			D*	102	/ -	/ -	/ 44	/ 44	/ 16
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL):	0.001	B	-							
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	0.003	B	-							
NCBCLL:	10.00	Mean Height:	15.00 ft				Creep Factor:	2.0									
Soffit:	2.00	TCDL:	4.2 psf				Max TC CSI:	0.115									
Load Duration:	1.25	BCDL:	5.2 psf				Max BC CSI:	0.088									
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2				Max Web CSI:	0.062									
		C&C Dist a:	3.00 ft														
		Loc. from endwall:	Any														
		GCpi:	0.18														
		Wind Duration:	1.60														
								VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4(A1) except as noted.

Loading

Truss designed to support 1-0-0 top chord outlookers and cladding load not to exceed 5.00 PSF one face and 24.0" span opposite face. Top chord must not be cut or notched, unless specified otherwise.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66431 COMN Ply: 1 Job Number: B61800a Cust: R 857 JRef: 1YdX8570003 T93
FROM: RJL Qty: 1 DAVIS RESIDENCE DrwNo: 276.25.1441.47943
Truss Label: PB1 20'10" Common GA / EV 10/03/2025

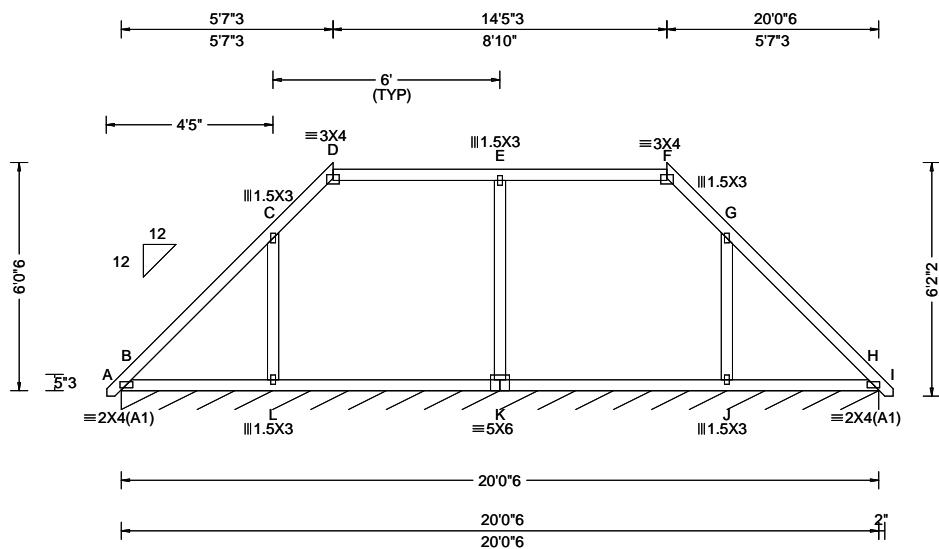

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL-1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**


****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



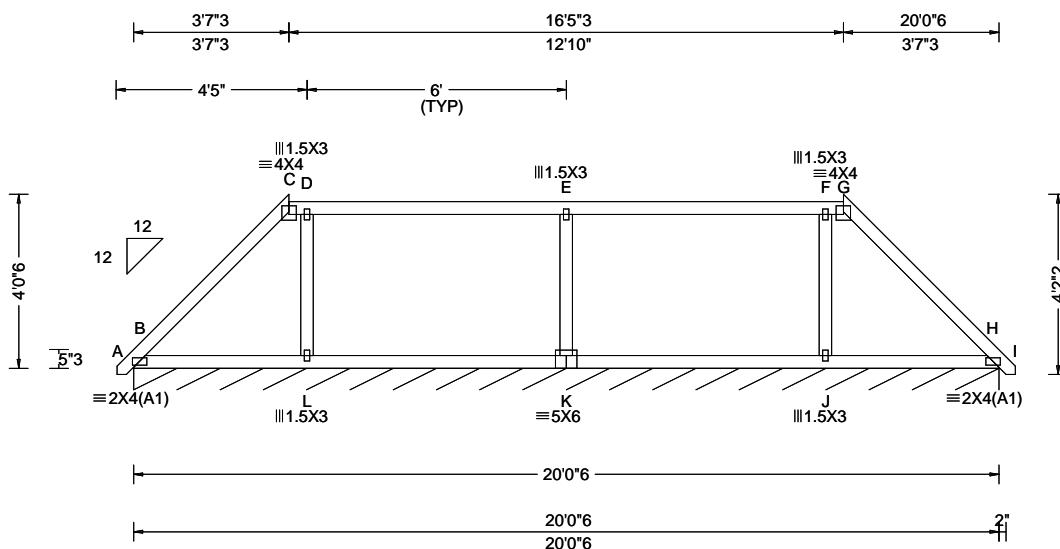

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
			Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity			Non-Gravity			
		Wind Std: ASCE 7-22	Pf: NA Ce: NA	VERT(LL): -0.003 C 999 360	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
TCLL: 20.00		Speed: 120 mph	Lu: NA Cs: NA	VERT(CL): -0.006 C 999 240	B* 82 /- /- /37 /6 /4			Wind reactions based on MWFRS			
TCDL: 7.00		Enclosure: Closed	Snow Duration: NA	HORZ(LL): 0.002 F - -	B Brg Wid = 240 Min Req = -			Bearing B is a rigid surface.			
BCLL: 0.00		Risk Category: II		HORZ(TL): 0.005 F - -	Members not listed have forces less than 375#			Maximum Web Forces Per Ply (lbs)			
BCDL: 10.00		EXP: B Kzt: NA		Creep Factor: 2.0	Webs Tens.Comp.						
Des Ld: 37.00		Mean Height: 31.09 ft		FBC 8th Ed. 2023 Res.	E - K 318 -388						
NCBCLL: 10.00		TCDL: 4.2 psf		TPI Std: 2014							
Soffit: 2.00		BCDL: 5.2 psf		Rep Fac: No							
Load Duration: 1.25		MWFRS Parallel Dist: h/2 to h		FT/RT:20(0)/10(0)							
Spacing: 24.0 "		C&C Dist a: 3.00 ft		Plate Type(s):							
		Loc. from endwall: not in 9.00 ft		WAVE	VIEW Ver: 24.02.00C.1213.15						
		GCpi: 0.18									
		Wind Duration: 1.60									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Pyrlins


In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.

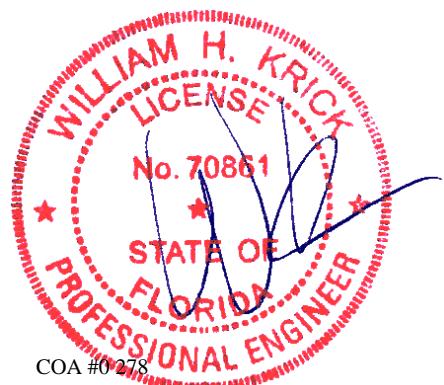

10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66437 FROM: RJL	COMM Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB3 20'10" Common	Cust: R 857 JRef:1YdX8570003 T91 DrwNo: 276.25.1442.12780 GA / FV 10/03/2025
--------------------------	--------------------------	--	--

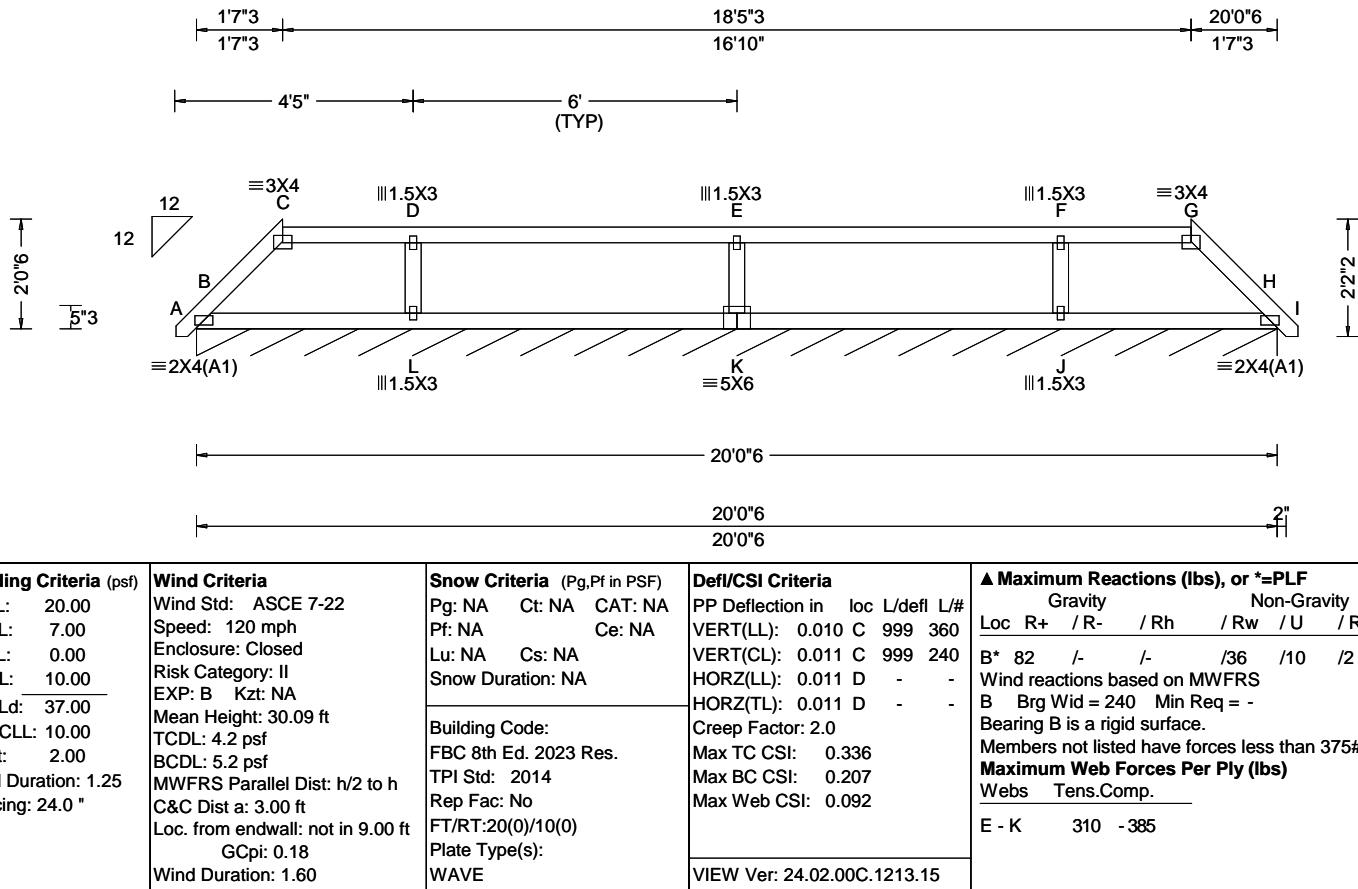

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.010 C 999 360	Loc R+ / R-	/ Rh / Rw / U / RL			
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.011 C 999 240	B*	/ - / - /36 /10 /2			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.011 D - -	B	Wind reactions based on MWFRS			
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.011 D - -	Brg Wid = 240	Min Req = -			
NCBCLL:	10.00	Mean Height: 30.09 ft		Creep Factor: 2.0	Bearing B is a rigid surface.				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.336	Members not listed have forces less than 375#				
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h/2 to h		Max BC CSI: 0.207	Maximum Web Forces Per Ply (lbs)				
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.092	Webs Tens.Comp.				
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)							
	GCpi: 0.18	Plate Type(s):							
	Wind Duration: 1.60	WAVE							
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins


In lieu of structural panels use purlins to brace all flat TC @ 24° oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.

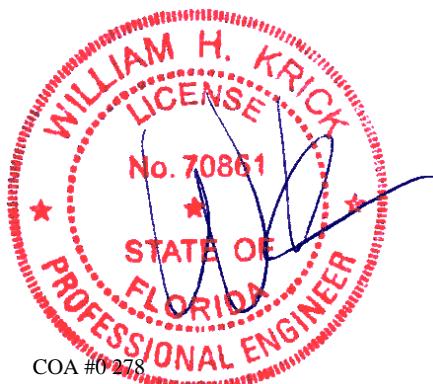

10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66416	COMM	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T80
FROM: RJL		Qty: 4	DAVIS RESIDENCE Truss Label: PB4 15'6" Common	DrwNo: 276.25.1442.15977 GA / FV 10/03/2025

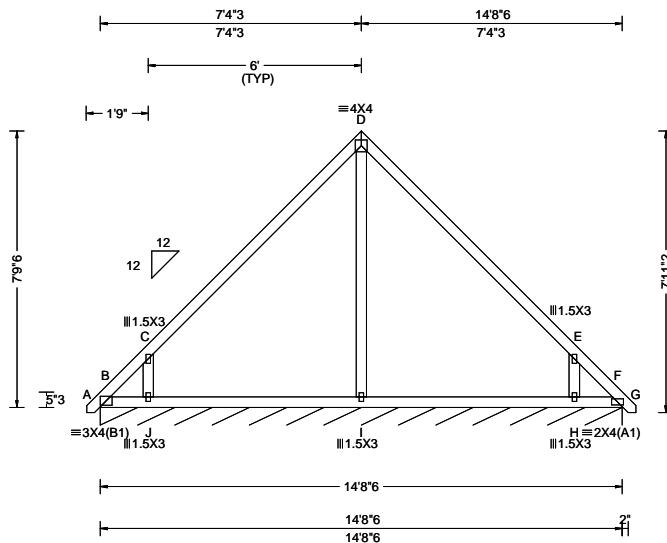

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs), or *=PLF							
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in loc	L/defl	L/#	Gravity	Non-Gravity		
TCDL:	7.00	Speed: 120 mph		Lu: NA		Cs: NA		VERT(LL): 0.002 D 999 360		Loc R+ / R- / Rh		/ Rw / U		/ RL	
BCLL: 0.00		Enclosure: Closed		VERT(CL): 0.003 D 999 240		B* 102 / - / -		/42 / - /10		B		/-159			
BCDL: 10.00		Risk Category: II		HORZ(LL): -0.002 B - -		B		/-159				F		/-159	
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.003 B - -		Wind reactions based on MWFRS									
NCBCLL: 10.00		Mean Height: 32.05 ft		Building Code:		B		Brg Wid = 176 Min Req = -				Bearing B is a rigid surface.			
Soffit: 2.00		TCDL: 4.2 psf		FBC 8th Ed. 2023 Res.		Members not listed have forces less than 375#		Max TC CSI: 0.410		Maximum Web Forces Per Ply (lbs)					
Load Duration: 1.25		BCDL: 5.2 psf		TPI Std: 2014		Max BC CSI: 0.280		Max Web CSI: 0.237		Webs Tens.Comp. Webs Tens. Comp.					
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h		Rep Fac: No		VIEW Ver: 24.02.00C.1213.15				C - J 351 -423 H - E 351 -423					
		C&C Dist a: 3.00 ft		FT/RT:20(0)/10(0)											
		Loc. from endwall: not in 9.00 ft		Plate Type(s):											
		GCpi: 0.18		WAVE											
		Wind Duration: 1.60													

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.



10/06/2025 Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66420 FROM: RJL	COMM Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB5 15'6" Common	Cust: R 857 JRef: 1YdX8570003 T89 DrwNo: 276.25.1442.19430 GA / FV 10/03/2025
--------------------------	--------------------------	---	---

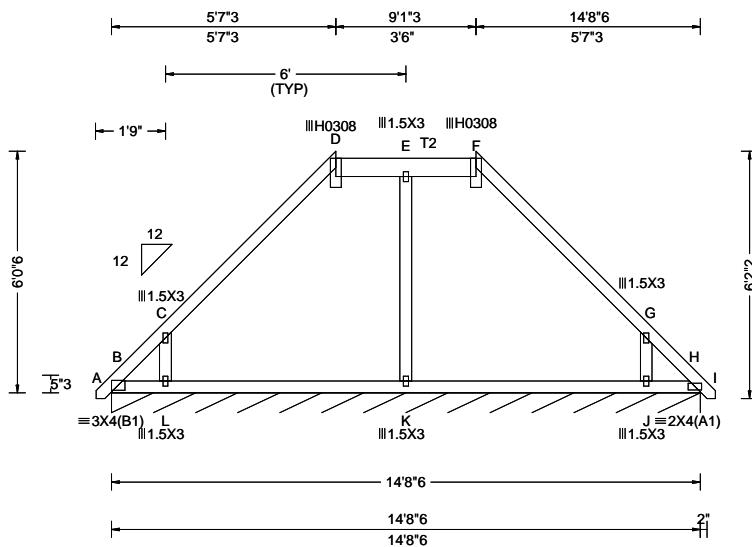

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+	/ R-	Non-Gravity / Rh	/ Rw	/ U	/ RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.046 F 999 360							
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.048 F 999 240							
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.045 E - -							
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.045 E - -							
NCBCLL:	10.00	Mean Height: 31.18 ft		Creep Factor: 2.0							
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.272							
Load Duration:	1.25	BCDL: 5.2 psf		Max BC CSI: 0.300							
Spacing:	24.0 "	MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.083							
		C&C Dist a: 3.00 ft									
		Loc. from endwall: not in 9.00 ft									
		GCpi: 0.18									
		Wind Duration: 1.60									
Wind Duration: 1.60											
VIEW Ver: 24.02.00C.1213.15											

Lumber

Top chord: 2x4 SP #1; T2 x6 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins


In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.

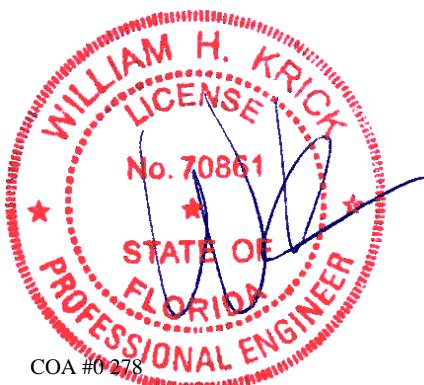

Florida 10/06/2025 State of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66424 FROM: RJL	COMM Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB6 15'6" Common	Cust: R 857 JRef: 1YdX8570003 T85 DrwNo: 276.25.1442.22717 GA / FV 10/03/2025
--------------------------	--------------------------	---	---

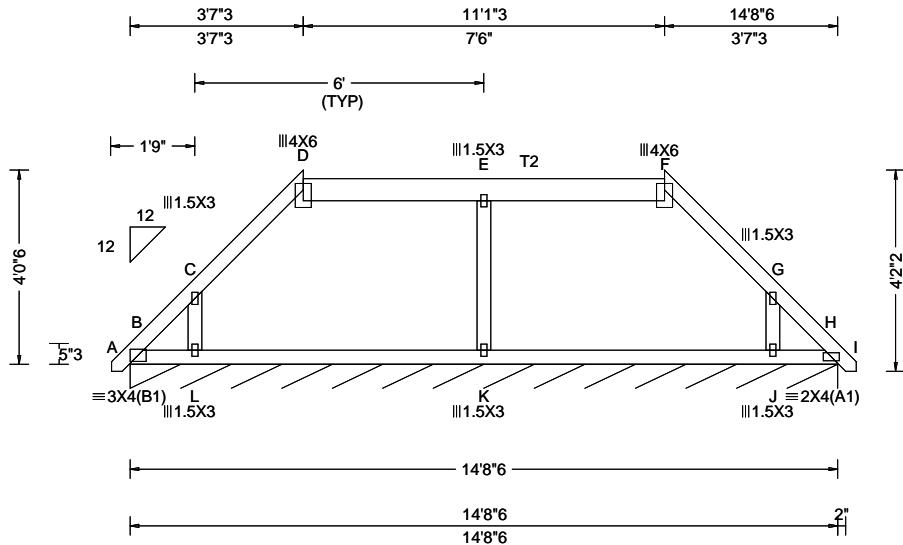

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.011 F 999 360	Loc	R+	/R-	/Rh	/Rw
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.033 F 999 240	/Rw /U /RL				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.010 E - -	Wind reactions based on MWFRS				
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.029 E - -	B: Brg Wid = 176 Min Req = -				
NCBCLL:	10.00	Mean Height: 30.18 ft	Building Code:	Creep Factor: 2.0	Bearing B is a rigid surface.				
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.165	Members not listed have forces less than 375#				
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max BC CSI: 0.223					
Spacing: 24.0 "		C&C Dist a: 3.00 ft	Rep Fac: No	Max Web CSI: 0.076					
		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)						
		GCpi: 0.18	Plate Type(s):						
		Wind Duration: 1.60	WAVE		VIEW Ver: 24.02.00C.1213.15				

Lumber

Top chord: 2x4 SP #1; T2 2x6 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.



10/06/2025 Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-7 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66428 COMN Ply: 1 Job Number: B61800a Cust: R 857 JRef: 1YdX8570003 T81
FROM: RJL Qty: 1 DAVIS RESIDENCE DrwNo: 276.25.1442.25753
Truss Label: PB7 15'6" Common GA / FV 10/03/2025

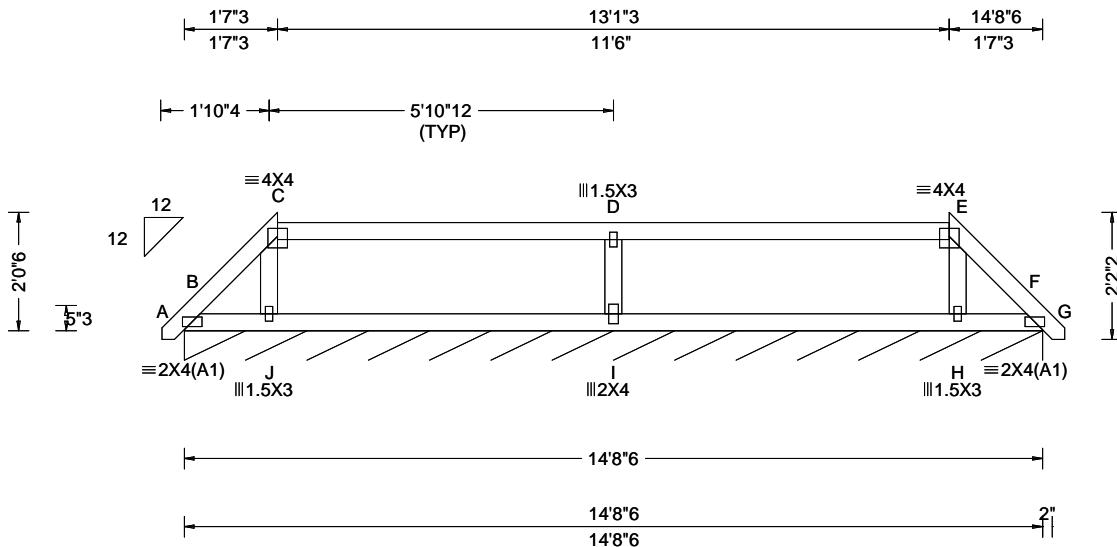

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Pyrlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.



Eduardo 10/06/2024

Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING
DO NOT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66403 FROM: RJL	COMM Qty: 7	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB8 10'2" Common	Cust: R 857 JRef:1YdX8570003 T48 DrwNo: 276.25.1442.28470 GA / FV 10/03/2025
--------------------------	----------------	---	--

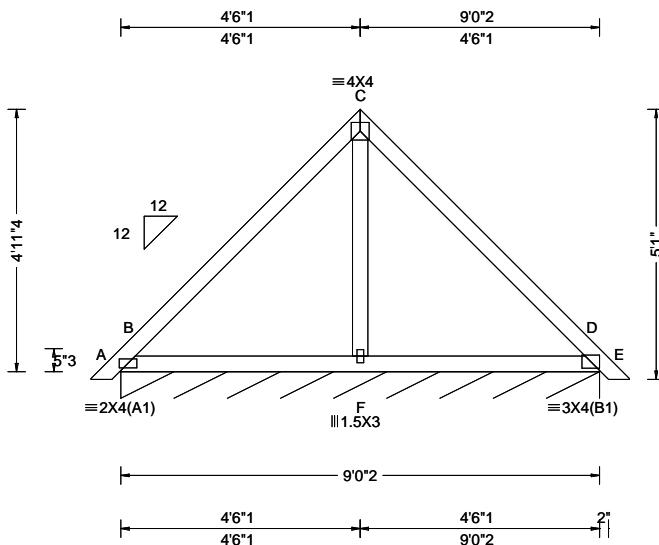

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF								
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity							
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 D 999 360	Loc R+ / R-	/ Rh / Rw / U / RL							
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.002 D 999 240	B* 85 / - / -	/ 42 / - / 10							
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.002 D - -	B: Brg Wid = 108	Min Req = -							
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.005 B - -	Bearing B is a rigid surface.								
NCBCLL:	10.00	Mean Height: 21.51 ft		Creep Factor: 2.0	Members not listed have forces less than 375#								
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.232									
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max BC CSI: 0.188									
		MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.086									
		C&C Dist a: 3.00 ft											
		Loc. from endwall: not in 9.00 ft											
		GCpi: 0.18											
		Wind Duration: 1.60											
					VIEW Ver: 24.02.00C.1213.15								

Lumber


Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.

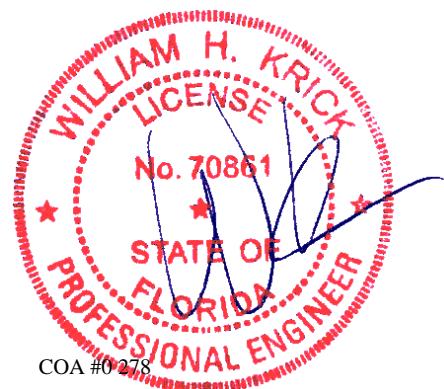

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-7 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66406 FROM: RJL	COMM Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB9 10'2" Common	Cust: R 857 JRef: 1YdX8570003 T70 DrwNo: 276.25.1442.33510 GA / FV 10/03/2025
--------------------------	--------------------------	---	---

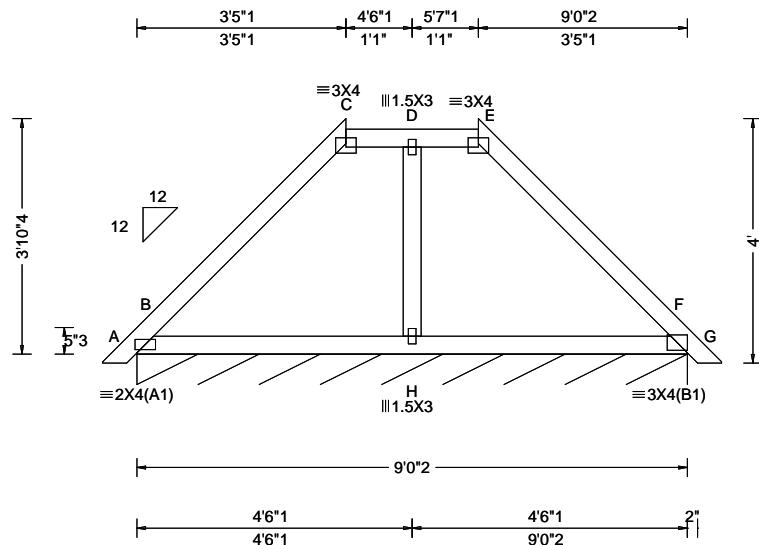

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 E 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.009 E 999 240	B* 85 /- /- /40 /- /7				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 B - -	Wind reactions based on MWFRS				
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.012 D - -	B Brg Wid = 108 Min Req = -				
NCBLL:	10.00	Mean Height: 20.97 ft		Creep Factor: 2.0	Bearing B is a rigid surface.				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.095	Members not listed have forces less than 375#				
Load Duration:	1.25	BCDL: 5.2 psf		Max BC CSI: 0.145					
Spacing:	24.0 "	MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.013					
C&C Dist a:	3.00 ft	C&C Dist a: 3.00 ft							
Loc. from endwall:	not in 9.00 ft	Loc. from endwall: not in 9.00 ft							
GCpi:	0.18	GCpi: 0.18							
Wind Duration:	1.60	Wind Duration: 1.60							
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66409 FROM: RJL	COMM Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB10 10'2" Common	Cust: R 857 JRef: 1YdX8570003 T71 DrwNo: 276.25.1441.58970 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

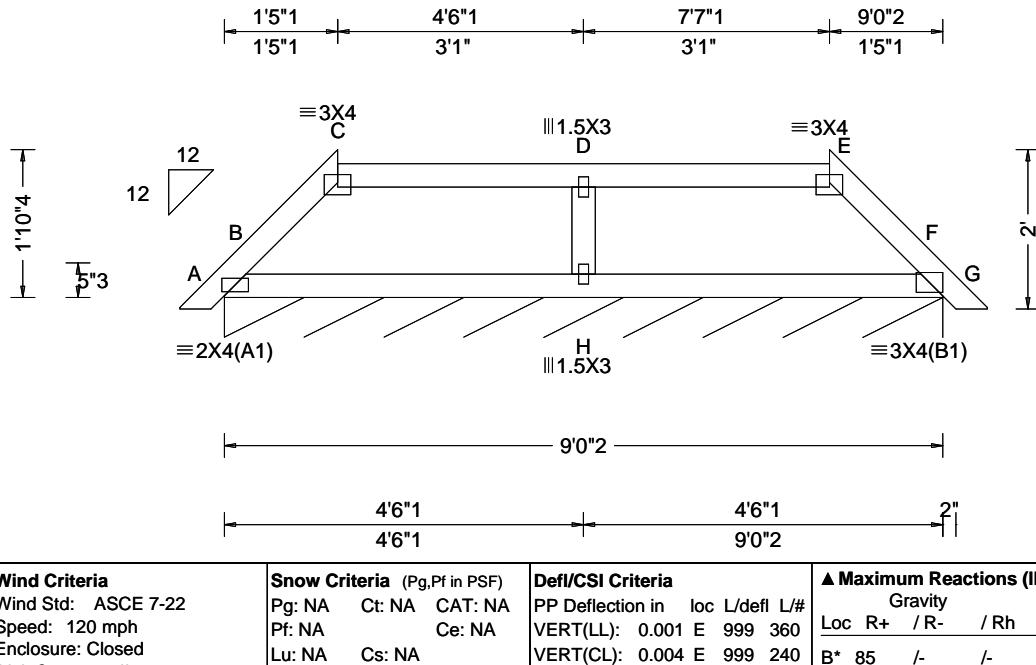

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 E 999 360	Loc	R+	/R-	/Rh	/Rw /U /RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.004 E 999 240	Wind reactions based on MWFRS				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 B - -	B: Brg Wid = 108 Min Req = -				
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.004 E - -	Bearing B is a rigid surface.				
NCBCLL:	10.00	Mean Height: 20.88 ft		Creep Factor: 2.0	Members not listed have forces less than 375#				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.104					
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h/2 to h		Max BC CSI: 0.139					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.066					
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)							
	GCpi: 0.18	Plate Type(s):							
	Wind Duration: 1.60	WAVE			VIEW Ver: 24.02.00C.1213.15				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24° oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66411 FROM: RJL	COMM Ply: 1 Qty: 9	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB11 6'3"8 Common	Cust: R 857 JRef:1YdX8570003 T72 DrwNo: 276.25.1442.02707 GA / FV 10/03/2025
--------------------------	--------------------------	--	--

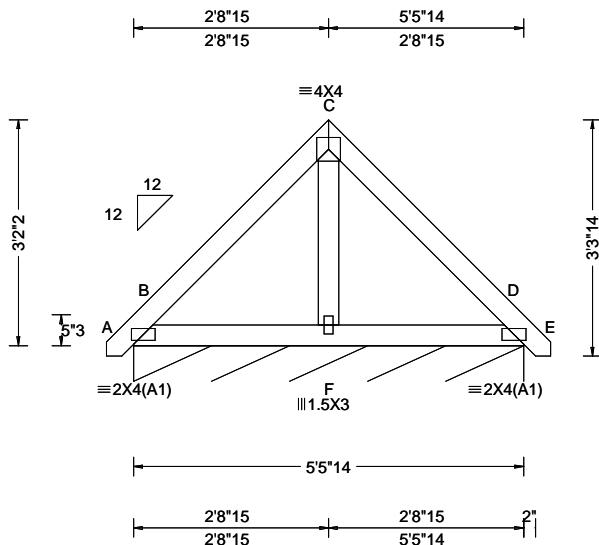

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 D 999 240	B* 89	/ -	/ -	/ 43	/ -
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 D - -	Wind reactions based on MWFRS				/ 10
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 B - -	B	Brg Wid = 65.8	Min Req = -		
NCBCLL:	10.00	Mean Height: 28.75 ft		Creep Factor: 2.0	Bearing B is a rigid surface.				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.124	Members not listed have forces less than 375#				
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: h/2 to h		Max BC CSI: 0.059					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.023					
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)							
	GCpi: 0.18	Plate Type(s):							
	Wind Duration: 1.60	WAVE							
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.



Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66414 FROM: RJL	COMM Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: PB12 6'3"8 Common	Cust: R 857 JRef: 1YdX8570003 T74 DrwNo: 276.25.1442.06550 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

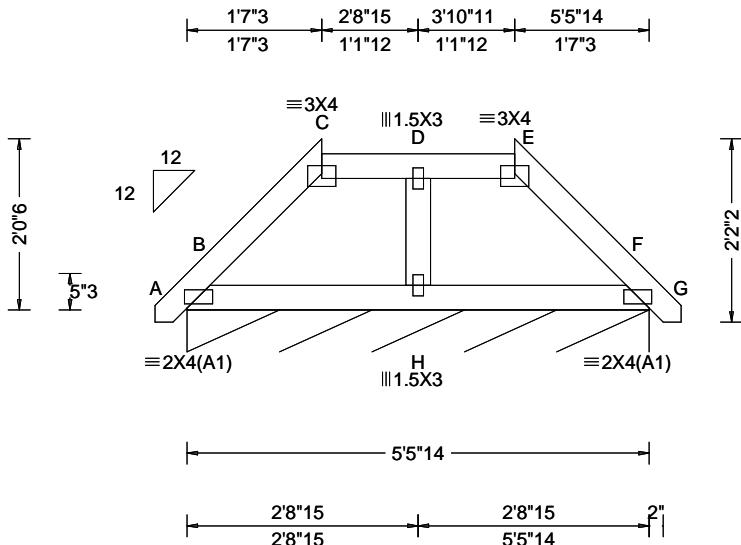

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 E 999 360	Loc R+ / R-	/ Rh / Rw / U / RL			
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.002 E 999 240	/ /40 / - / - / 5				Wind reactions based on MWFRS
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.000 B - -	B* 89 / - / - /40 / - / 5				B Brg Wid = 65.8 Min Req = -
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.002 D - -	Bearing B is a rigid surface.				
NCBCLL:	10.00	Mean Height: 28.18 ft		Creep Factor: 2.0	Members not listed have forces less than 375#				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.029					
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max BC CSI: 0.050					
		MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.032					
		C&C Dist a: 3.00 ft							
		Loc. from endwall: not in 9.00 ft							
		GCpi: 0.18							
		Wind Duration: 1.60							
					VIEW Ver: 24.02.00C.1213.15				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins


In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160220723 for piggyback details.

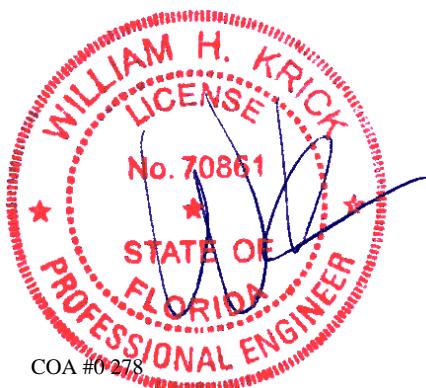

10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66345	VAL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T44
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: V1 13'11"9 Valley	DrwNo: 276.25.1438.11037 GA / FV 10/03/2025

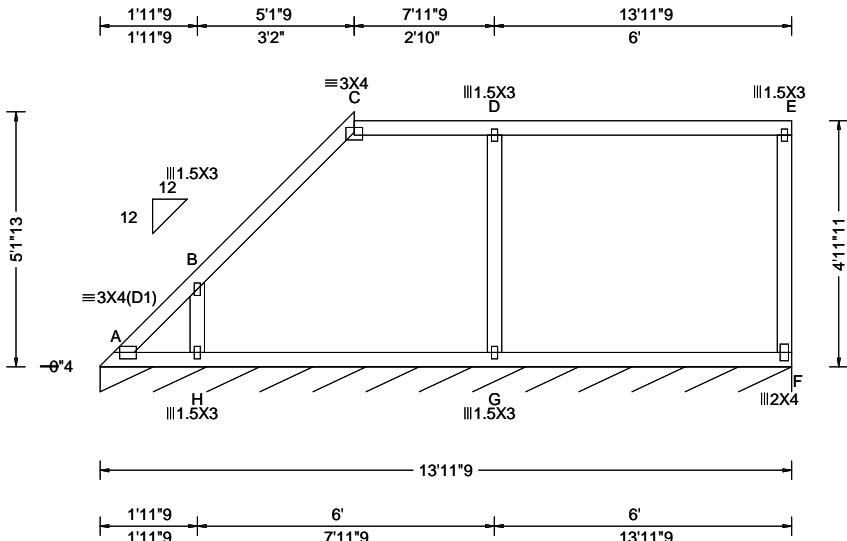

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.038 C 999 360	Loc R+ / R- / Rh / Rw				/ U / RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.076 C 999 240	F* 80 / - / - /40				/ 7 / 9	
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.038 D - -	Wind reactions based on MWFRS				Wind Brg Wid = 167 Min Req = -	
Des Ld:	37.00	EXP: B Kzt: NA	Building Code:	HORZ(TL): 0.076 D - -	Bearing A is a rigid surface.				Members not listed have forces less than 375#	
NCBLL:	10.00	Mean Height: 24.07 ft	FBC 8th Ed. 2023 Res.	Creep Factor: 2.0	Maximum Web Forces Per Ply (lbs)				Webs Tens.Comp.	
Soffit:	2.00	TCDL: 4.2 psf	TPI Std: 2014	Max TC CSI: 0.518	D - G 369 - 423					
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	Rep Fac: No	Max BC CSI: 0.329						
Spacing: 24.0 "	C&C Dist a: 3.00 ft	C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)	Max Web CSI: 0.187						
		Loc. from endwall: not in 4.50 ft	Plate Type(s):							
		GCpi: 0.18	WAVE							
		Wind Duration: 1.60			VIEW Ver: 24.02.00C.1213.15					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24° oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66348	VAL	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T60
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo:	276.25.1438.35247	
			Truss Label: V2 11'11"9 Valley	GA	/ FV	10/03/2025

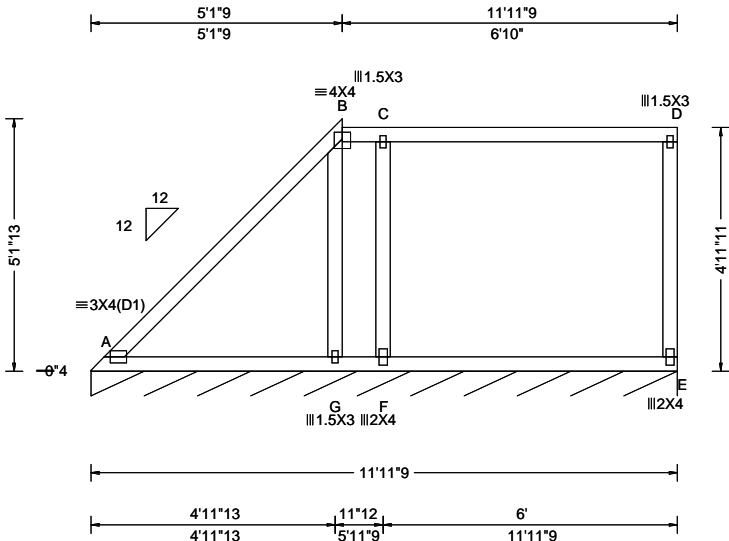

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF											
					Gravity			Non-Gravity								
Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL										
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	loc	L/defl	L/#	E*	80	/ -	/ -	/41	/9	/12
TCDL:	7.00	Speed: 120 mph	Pf: NA		Ce: NA	VERT(LL):	0.011	A	999	360						
BCLL:	0.00	Enclosure: Closed	Lu: NA	Cs: NA		VERT(CL):	0.021	A	999	240						
BCDL:	10.00	Risk Category: II	Snow Duration: NA			HORZ(LL):	0.005	A	-	-						
Des Ld:	37.00	EXP: B Kzt: NA				HORZ(TL):	0.010	A	-	-						
NCBLL:	10.00	Mean Height: 26.07 ft				Creep Factor: 2.0										
TCDL:	4.2 psf	Building Code:				FBC 8th Ed. 2023 Res.										
Soffit:	2.00	BCDL: 5.2 psf				TPI Std: 2014										
Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2	Rep Fac: No				Rep Fac: No										
Spacing: 24.0 "	C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)				Plate Type(s):										
	Loc. from endwall: not in 9.00 ft	WAVE					VIEW Ver: 24.02.00C.1213.15									
	GCpi: 0.18															
	Wind Duration: 1.60															

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



Florida Certificate of Product Approval #FL-1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING TRUSS INSTALLERS.
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66350	VAL	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T63
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo:	276.25.1438.36787	
			Truss Label: V3 9'11"9 Valley	GA	/ FV	10/03/2025

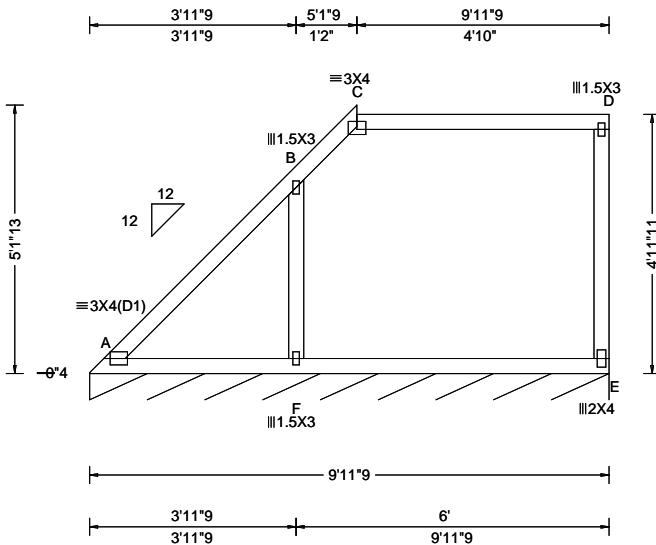

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

The Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66352	VAL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T64
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: V4 7'11"9 Valley	DrwNo: 276.25.1438.38417 GA / FV 10/03/2025

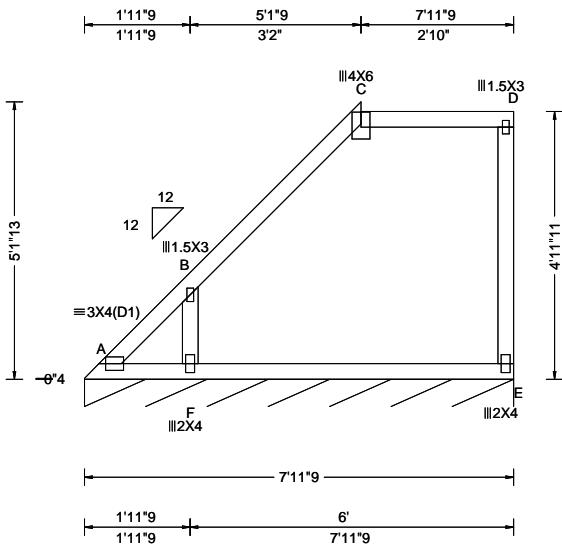

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.089 C 999 360	Loc R+ / R- / Rh	/ Rw / U / RL			
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.176 C 531 240	E* 80 / - / - /44 /11 /20				Wind reactions based on MWFRS
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.089 D - -	E Brg Wid = 95.5 Min Req = -				Bearing A is a rigid surface.
Des Ld:	37.00	EXP: B Kzt: NA	Building Code:	HORZ(TL): 0.178 D - -	Members not listed have forces less than 375#				Maximum Web Forces Per Ply (lbs)
NCBCLL:	10.00	Mean Height: 30.07 ft	FBC 8th Ed. 2023 Res.	Creep Factor: 2.0	Webs Tens.Comp.				
Soffit:	2.00	TCDL: 4.2 psf	TPI Std: 2014	Max TC CSI: 0.399	B - F 520 - 403				
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	Rep Fac: No	Max BC CSI: 0.285					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)	Max Web CSI: 0.155					
		Loc. from endwall: not in 9.00 ft	Plate Type(s):						
		GCpi: 0.18	WAVE						
		Wind Duration: 1.60			VIEW Ver: 24.02.00C.1213.15				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins


In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

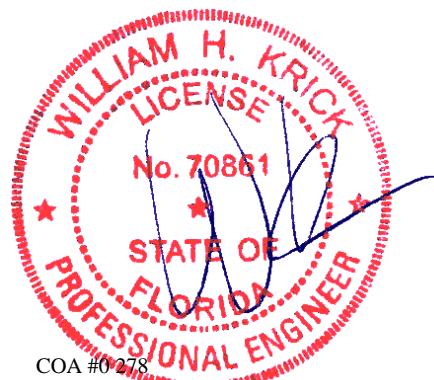

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66355	VAL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T68
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: V5 5'11"9 Valley	DrwNo: 276.25.1438.39857 GA / FV 10/03/2025

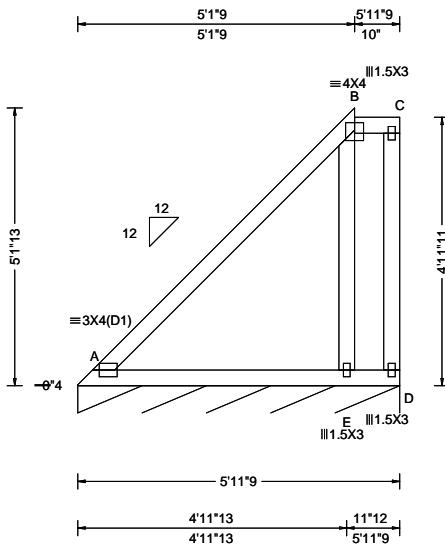

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.015 A 999 360	Loc R+ / R-	/ Rh / Rw / U / RL			
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.021 A 999 240	D* 80 / - / -	/ 47 / - / 16			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.008 A - -	Wind reactions based on MWFRS	D Brg Wid = 71.5 Min Req = -			
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.010 A - -	Bearing A is a rigid surface.	Bearing A is a rigid surface.			
NCBLL:	10.00	Mean Height: 32.07 ft		Creep Factor: 2.0	Members not listed have forces less than 375#				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.336					
Load Duration: 1.25	BCDL: 5.2 psf	BCDL: 5.2 psf		Max BC CSI: 0.207					
Spacing: 24.0 "	MWFRS Parallel Dist: h/2 to h	MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.071					
	C&C Dist a: 3.00 ft	Rep Fac: No							
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)							
	GCpi: 0.18	Plate Type(s):							
	Wind Duration: 1.60	WAVE			VIEW Ver: 24.02.00C.1213.15				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66357 FROM: RJL	VAL Qty: 1	Ply: 1 Job Number: B61800a DAVIS RESIDENCE Truss Label: V6 3'11"9 Valley	Cust: R 857 JRef: 1YdX8570003 T73 DrwNo: 276.25.1438.41300 GA / FV 10/03/2025
--------------------------	---------------	---	---

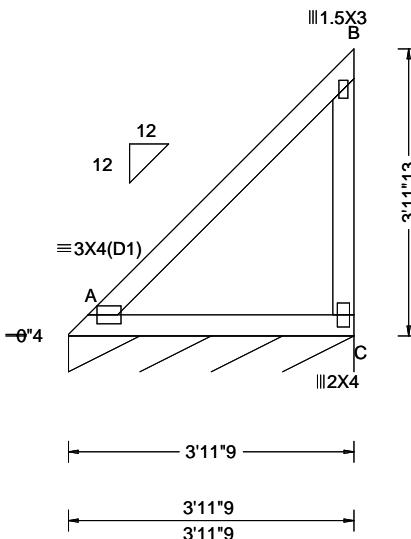

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	Loc	R+/R-	Gravity / Rh	Non-Gravity / Rw	Non-Gravity / U	Non-Gravity / RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA	C*	79	/ -	/ -	/49	/ -
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.003 A	-	-				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.005 A	-	-				
Des Ld:	37.00	EXP: B Kzt: NA		Creep Factor: 2.0						
NCBCLL:	10.00	Mean Height: 33.49 ft		Max TC CSI: 0.212						
Soffit:	2.00	TCDL: 4.2 psf		Max BC CSI: 0.136						
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max Web CSI: 0.111						
Loc. from endwall: not in 9.00 ft		MWFRS Parallel Dist: h/2 to h								
		C&C Dist a: 3.00 ft								
		Loc. from endwall: not in 9.00 ft								
		GCpi: 0.18								
		Wind Duration: 1.60								
					VIEW Ver: 24.02.00C.1213.15					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66316 FROM: RJL	VAL Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: V7 6'11"5 Valley	Cust: R 857 JRef: 1YdX8570003 T78 DrwNo: 276.25.1438.42733 GA / FV 10/03/2025
--------------------------	-------------------------	---	---

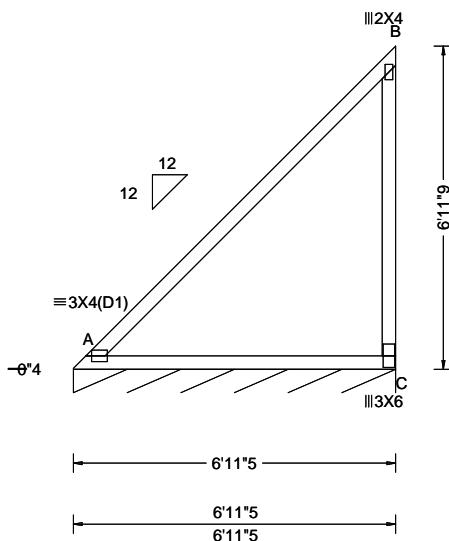

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	Loc	R+/R-	Gravity / Rh	Non-Gravity / Rw	/ U	/ RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA	C*	80	/ -	/ -	/50	/4
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.016 A	-	-				/26
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.032 A	-	-				
Des Ld:	37.00	EXP: B Kzt: NA		Creep Factor: 2.0						
NCBCLL:	10.00	Mean Height: 23.58 ft		Max TC CSI: 0.595						
Soffit:	2.00	TCDL: 4.2 psf		Max BC CSI: 0.449						
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max Web CSI: 0.149						
		MWFRS Parallel Dist: 0 to h/2								
		C&C Dist a: 3.00 ft								
		Loc. from endwall: not in 4.50 ft								
		GCpi: 0.18								
		Wind Duration: 1.60								
					VIEW Ver: 24.02.00C.1213.15					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind


Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.

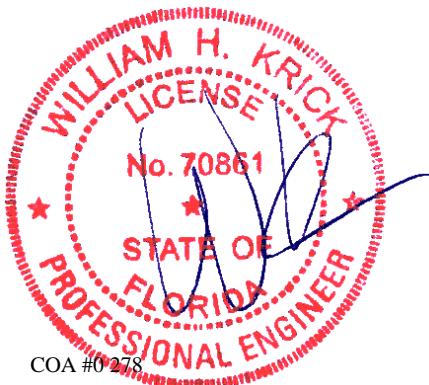

10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66322	VAL	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T67
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: V8 6'11"1 Valley	DrwNo: 276.25.1438.44340 GA / FV 10/03/2025

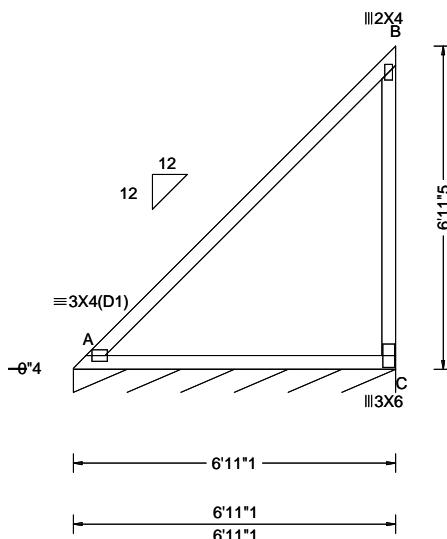

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
				Loc	R+	/R-	Gravity / Rh	Non-Gravity / Rw	/U /RL
TCLL: 20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	C*	80	/-	/-	/50	/4 /26
TCDL: 7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA						
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.016 A	-	-	-			
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.031 A	-	-	-			
Des Ld: 37.00	EXP: B Kzt: NA		Creep Factor: 2.0						
NCBCLL: 10.00	Mean Height: 23.57 ft		Max TC CSI: 0.667						
Soffit: 2.00	TCDL: 4.2 psf		Max BC CSI: 0.446						
Load Duration: 1.25	BCDL: 5.2 psf		Max Web CSI: 0.148						
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2								
	C&C Dist a: 3.00 ft								
	Loc. from endwall: Any								
	GCpi: 0.18								
	Wind Duration: 1.60								
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.
Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66318	VAL	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T79
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo:	276.25.1438.45927	
			Truss Label: V9 4'11"5 Valley	GA	/ FV	10/03/2025

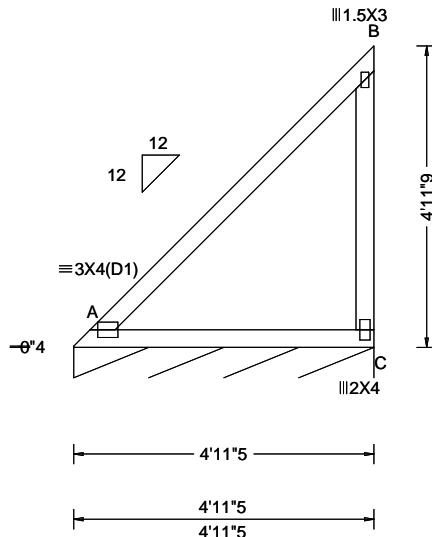

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3:

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



10/06/2025 Florida Certificate of Product Approval #FL 1999


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpinetw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66324 FROM: RJL	VAL Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: V10 4'11"1 Valley	Cust: R 857 JRef: 1YdX8570003 T76 DrwNo: 276.25.1438.12740 GA / FV 10/03/2025
--------------------------	-------------------------	--	---

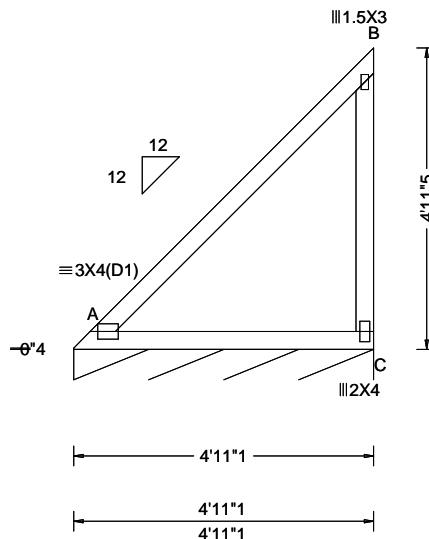

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL		
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	C* 79	/ -	/ -	/ 49	/ 5		
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.006 A	-	-	-	-	/ 26		
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.011 A	-	-	-	-			
NCBCLL:	10.00	Mean Height: 24.57 ft		Creep Factor: 2.0	Wind reactions based on MWFRS						
Soffit:	2.00	TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.314	C	Brg Wid = 59.0	Min Req = -	Bearing A is a rigid surface.			
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.220	Members not listed have forces less than 375#						
		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.052							
		C&C Dist a: 3.00 ft	Rep Fac: No								
		Loc. from endwall: not in 4.50 ft	FT/RT:20(0)/10(0)								
		GCpi: 0.18	Plate Type(s):								
		Wind Duration: 1.60	WAVE		VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Web: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



Florid 10/06/2025 Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66320 FROM: RJL	VAL Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: V11 2'11"5 Valley	Cust: R 857 JRef: 1YdX8570003 T88 DrwNo: 276.25.1438.14263 GA / FV 10/03/2025
--------------------------	-------------------------	--	---

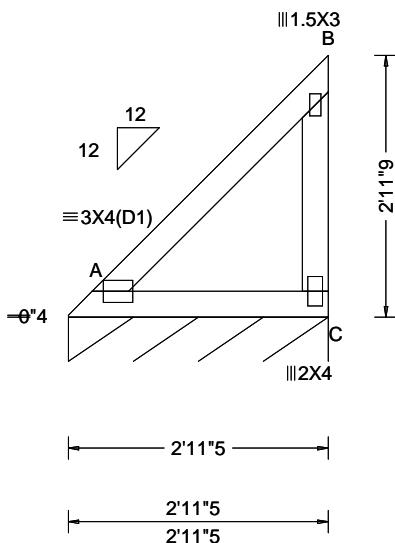

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	Loc	R+/R-	Gravity / Rh	Non-Gravity / Rw	Non-Gravity / U	Non-Gravity / RL
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA	C*	79	/ -	/ -	/48	/4
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.001 A	L/defl	-	-	-	-	/25
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.002 A	L/#	-	-	-	-	
Des Ld:	37.00	EXP: B Kzt: NA		Creep Factor: 2.0						
NCBCLL:	10.00	Mean Height: 25.58 ft		Max TC CSI: 0.097						
Soffit:	2.00	TCDL: 4.2 psf		Max BC CSI: 0.074						
Load Duration:	1.25	BCDL: 5.2 psf		Max Web CSI: 0.060						
Spacing:	24.0 "	MWFRS Parallel Dist: 0 to h/2								
		C&C Dist a: 3.00 ft								
		Loc. from endwall: not in 9.00 ft								
		GCpi: 0.18								
		Wind Duration: 1.60								
					VIEW Ver: 24.02.00C.1213.15					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66326 FROM: RJL	VAL Ply: 1 Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: V12 2'11"1 Valley	Cust: R 857 JRef: 1YdX8570003 T77 DrwNo: 276.25.1438.15803 GA / FV 10/03/2025
--------------------------	-------------------------	--	---

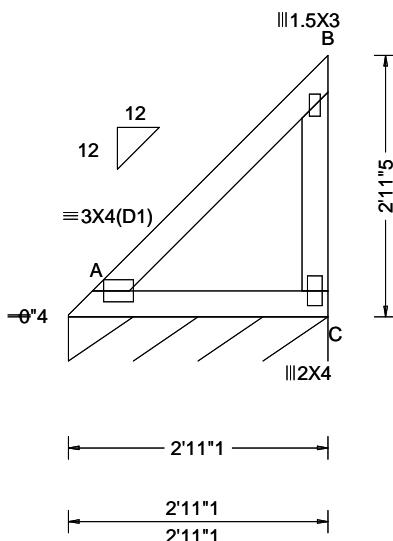

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
				Loc	R+	/R-	Gravity / Rh	Non-Gravity / Rw	/U /RL
TCLL: 20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	C*	79	/-	/-	/48	/4 /25
TCDL: 7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA						
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.001 A	-	-	-			
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.002 A	-	-	-			
Des Ld: 37.00	EXP: B Kzt: NA		Creep Factor: 2.0						
NCBLL: 10.00	Mean Height: 25.57 ft		Max TC CSI: 0.096						
Soffit: 2.00	TCDL: 4.2 psf		Max BC CSI: 0.073						
Load Duration: 1.25	BCDL: 5.2 psf		Max Web CSI: 0.059						
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2								
	C&C Dist a: 3.00 ft								
	Loc. from endwall: not in 4.50 ft								
	GCpi: 0.18								
	Wind Duration: 1.60								
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS VALTN220723 and VAL180220723 for valley details.



Florida 10/06/2025 State of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66187 HIP_ Ply: 1 Job Number: B61800a Cust: R 857 JRef: 1YdX8570003 T7
FROM: RJL Qty: 1 DAVIS RESIDENCE DrwNo: 276.25.1439.26823
 Truss Label: JA 9'10"1 Hip Jack Girder GA / FV 10/03/2025

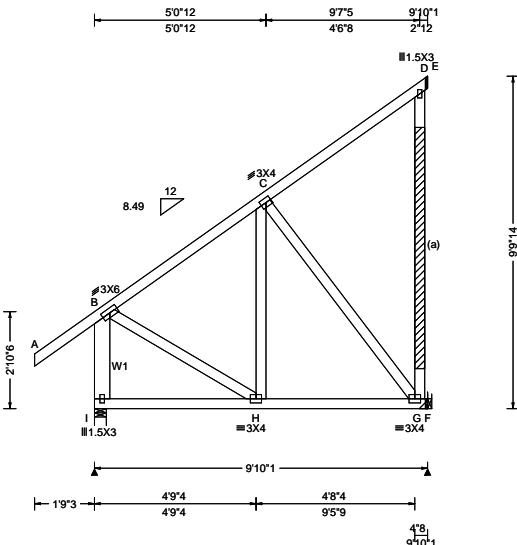

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W1 2x6 SP #1;

Bracing

(a) #3 or better scab reinforcement. Same size & 80% length of web member. Attach with 10d Box or Gun (0.128" x 3" min.) nails @ 6" oc.

Hangers / Ties

(J) Hanger Support Required, by others

Loading

Hipjacks supports 6-11-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.



Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66161	EJAC	Ply: 1	Job Number: B61800a	Cust: R 857	JRef:1YdX8570003	T9
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo:	276.25.1439.36813	
			Truss Label: JB 7' End Jack Girder	GA / FV	10/03/2025	

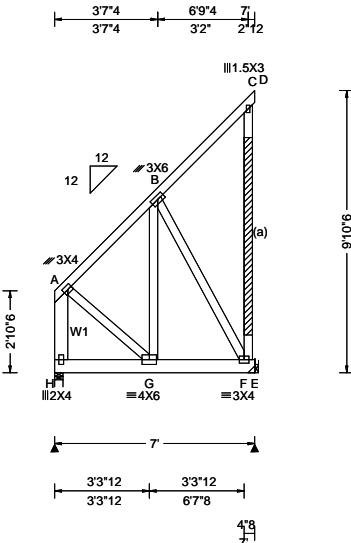

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)							
				Gravity				Non-Gravity			
Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL	/ U	/ RL			
TCLL: 20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#								
TCDL: 7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.008 G 999 360								
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.015 G 999 240								
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.003 B - -								
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.006 B - -								
Mean Height: 15.46 ft											
NCBLL: 10.00	TCDL: 4.2 psf	Building Code: FBC 8th Ed. 2023 Res.	Creep Factor: 2.0								
Soffit: 2.00	BCDL: 5.2 psf	TPI Std: 2014	Max TC CSI: 0.129								
Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2	Rep Fac: No	Max BC CSI: 0.299								
Spacing: 24.0 "	C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)	Max Web CSI: 0.631								
	Loc. from endwall: not in 9.00 ft	Plate Type(s):									
	GCpi: 0.18	WAVE									
	Wind Duration: 1.60		VIEW Ver: 24.02.00C.1213.15								
				A - B	18	-615					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3; W1 2x6 SP #1;

Bracing

(a) #3 or better scab reinforcement. Same size & 80% length of web member. Attach with 10d Box or Gun (0.128" x 3", min.) nails @ 6" oc.

Special Loads

 -----Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 60 plf at 0.00 to 60 plf at 7.00
 BC: From 10 plf at 0.00 to 10 plf at 7.00
 BC: 501 lb Conc. Load at 1.00, 3.00, 5.00

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads and reactions based on MWFRS.
Left end vertical exposed to wind pressure. Deflection meets L/260.

Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.



Florida Veneer - Date of Product Approval #FL-1999


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66180	EJAC	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T11
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JC 7' End Jack	DrwNo: 276.25.1439.38453 GA / FV 10/03/2025

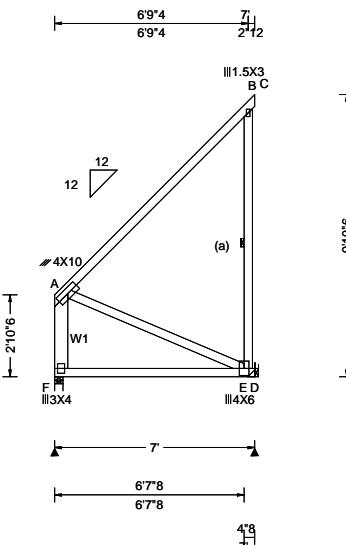

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.002 B 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.003 B 999 240	Wind reactions based on MWFRS				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.002 B - -	F 276	/ -	/ -	/141	/ - /187
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.007 B - -	D 283	/ -	/ -	/259	/126 / -
NCBCLL:	10.00	Mean Height: 15.46 ft	Building Code:	Creep Factor: 2.0	F Brg Wid = 3.5 Min Req = 1.5 (Truss)				
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.589	D Brg Wid = -	D Brg Wid = - Min Req = -			
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	TPI Std: 2014	Max BC CSI: 0.396	Bearing F is a rigid surface.				
Loc. from endwall: not in 4.50 ft		MWFRS Parallel Dist: h/2 to h	Rep Fac: No	Max Web CSI: 0.185	Members not listed have forces less than 375#				
GCpi: 0.18		C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)		Maximum Bot Chord Forces Per Ply (lbs)				
Wind Duration: 1.60		Loc. from endwall: not in 4.50 ft	Plate Type(s):		Chords Tens.Comp.				
			WAVE						
				VIEW Ver: 24.02.00C.1213.15	F - E	186	- 380		

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W1 2x6 SP #1;

Maximum Web Forces Per Ply (lbs)

Webs Tens.Comp.

A - E 405 - 197

Bracing

(a) Continuous lateral restraint equally spaced on member.

Hangers / Ties

(J) Hanger Support Required, by others


Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

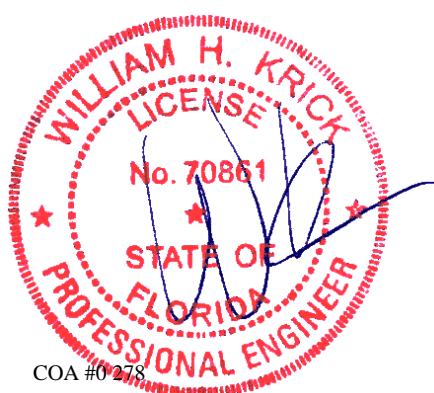

10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66177 FROM: RJL	EJAC Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JCa 7' End Jack	Cust: R 857 JRef: 1YdX8570003 T12 DrwNo: 276.25.1439.40637 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

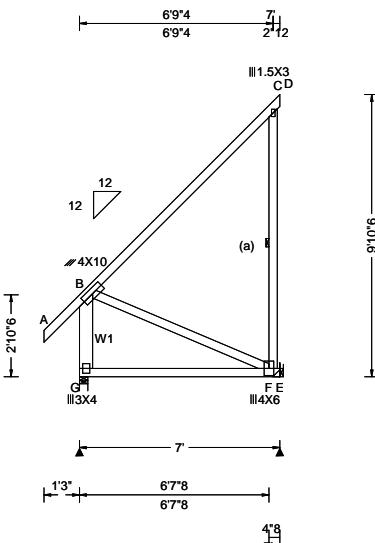

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity				Non-Gravity
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.002 C 999 360	Loc	R+	/R-	/Rh	/Rw /U /RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.003 C 999 240	G	365	/-	/	/166 /- /217
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.002 C - -	E	275	/-	/	/256 /133 /-
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.007 C - -					
NCBCLL: 10.00		Mean Height: 15.00 ft		Building Code: Creep Factor: 2.0					
Soffit: 2.00		TCDL: 4.2 psf		FBC 8th Ed. 2023 Res.					
Load Duration: 1.25		BCDL: 5.2 psf		TPI Std: 2014					
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h		Rep Fac: No					
		C&C Dist a: 3.00 ft		FT/RT:20(0)/10(0)					
		Loc. from endwall: not in 4.50 ft		Plate Type(s):					
		GCpi: 0.18		WAVE					
		Wind Duration: 1.60							
VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W1 2x6 SP #1;

▲ Maximum Reactions (lbs)

Gravity		Non-Gravity
Loc	R+	/R-
	/Rh	
	/Rw	/U
		/RL

G 365 /- /- /166 /- /217

E 275 /- /- /256 /133 /-

Wind reactions based on MWFRS

G Brg Wid = 3.5 Min Req = 1.5 (Truss)

E Brg Wid = - Min Req = -

Bearing G is a rigid surface.

Members not listed have forces less than 375#

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.
--------	------------

G - F 183 - 428

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.
------	------------

B - F 455 - 195

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66189 FROM: RJL	JACK Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JD 4'11"11 Jack	Cust: R 857 JRef: 1YdX8570003 T16 DrwNo: 276.25.1439.42593 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

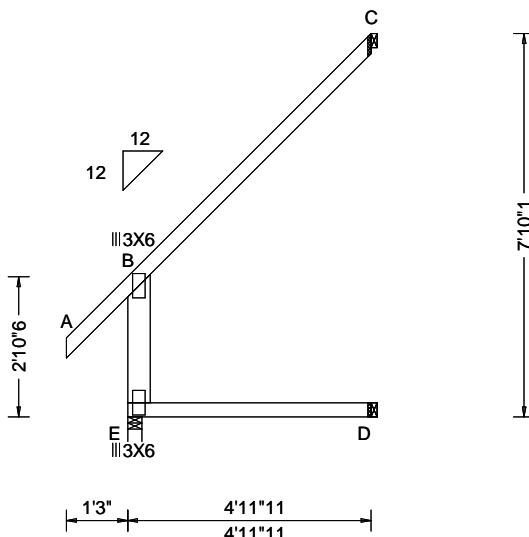

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.001 B 999 240						
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - -						
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.002 B - -						
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0						
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.341						
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2		Max BC CSI: 0.248						
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.054						
	Loc. from endwall: not in 4.50 ft	FT/RT:20(0)/10(0)								
	GCpi: 0.18	Plate Type(s):								
	Wind Duration: 1.60	WAVE								
VIEW Ver: 24.02.00C.1213.15										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66191 FROM: RJL	JACK Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JE 2'11"11 Jack	Cust: R 857 JRef: 1YdX8570003 T66 DrwNo: 276.25.1439.44320 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

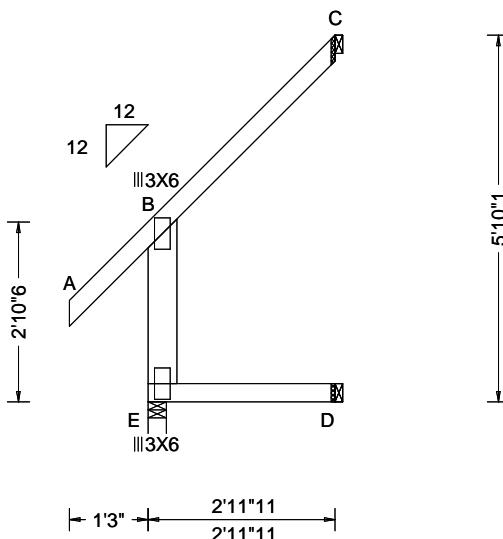

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity		Non-Gravity			
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360					E 218	/ - / - /175 /84 / -
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240					D 59	/ - / - /30 / - /38
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - - -					C 72	/ - / - /83 /49 /106
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 B - - -						Wind reactions based on MWFRS
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0					E Brg Wid = 3.5	Min Req = 1.5 (Truss)
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.137					D Brg Wid = 1.5	Min Req = -
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2		Max BC CSI: 0.081					C Brg Wid = 1.5	Min Req = -
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No		Max Web CSI: 0.057						Bearing E is a rigid surface.
	Loc. from endwall: Any	FT/RT:20(0)/10(0)								Members not listed have forces less than 375#
	GCpi: 0.18	Plate Type(s):								Maximum Web Forces Per Ply (lbs)
	Wind Duration: 1.60	WAVE							Webs	Tens.Comp.
VIEW Ver: 24.02.00C.1213.15										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.

B - E 383 - 188



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66193 FROM: RJL	JACK Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JF 11"11 Jack	Cust: R 857 JRef: 1YdX8570003 T90 DrwNo: 276.25.1439.46080 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

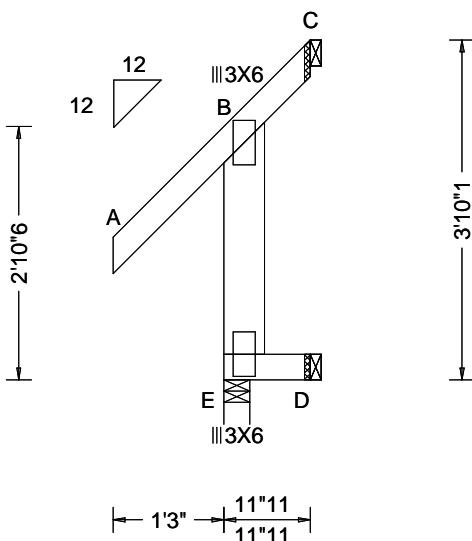

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240	E 173 /- /- /134 /81 /-		D 19 /- /- /10 /- /38			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - - -	C - /-23 /- /86 /80 /72		HORZ(TL): 0.001 B - - -			
Des Ld:	37.00	EXP: B Kzt: NA		Creep Factor: 2.0	Wind reactions based on MWFRS		E Brg Wid = 3.5 Min Req = 1.5 (Truss)			
NCBCLL:	10.00	Mean Height: 15.00 ft	Building Code: FBC 8th Ed. 2023 Res.	Max TC CSI: 0.118	D Brg Wid = 1.5 Min Req = -		C Brg Wid = 1.5 Min Req = -			
Soffit:	2.00	TCDL: 4.2 psf	TPI Std: 2014	Max BC CSI: 0.008	Bearing E is a rigid surface.		Bearing E is a rigid surface.			
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	Rep Fac: No	Max Web CSI: 0.054	Members not listed have forces less than 375#		Members not listed have forces less than 375#			
C&C Dist a: 3.00 ft	Loc. from endwall: Any	MWFRS Parallel Dist: 0 to h/2	FT/RT:20(0)/10(0)		VIEW Ver: 24.02.00C.1213.15					
GCpi: 0.18		Plate Type(s): WAVE								
Wind Duration: 1.60										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
webs: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66237 HIP_ Ply: 1 Job Number: B61800a Cust: R 857 JRef: 1YdX8570003 T1
FROM: RJL Qty: 2 DAVIS RESIDENCE DrwNo: 276.25.1439.47753
 Truss Label: JG 9'10"1 Hip Jack Girder GA / FV 10/03/2025

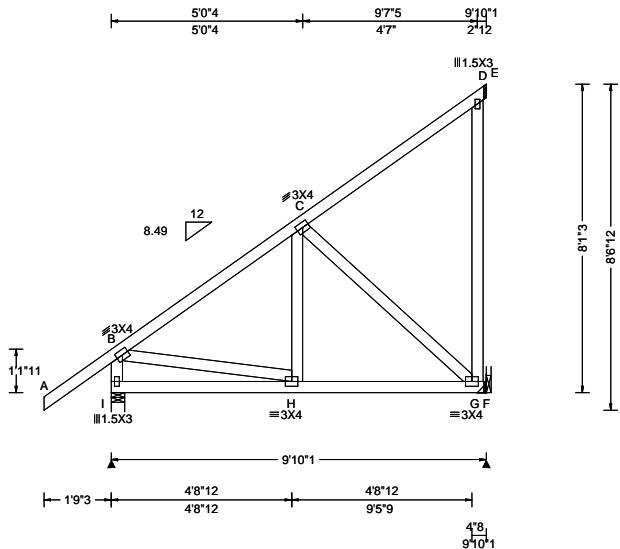

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Hangers / Ties

(J) Hanger Support Required, by others

Loading

Hipjack supports 6-11-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.

End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Maximum Web Forces Per Ply (lbs)

Maximum Web Forces for Fly (lb) Webs Tens. Comp. Webs Tens. Comp.



Florida Certificate of Product Approval #FL 1999

*** READ AND FOLLOW ALL NOTES ON THIS DRAWING

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

The Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66239	EJAC	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T30
FROM: RJL		Qty: 8	DAVIS RESIDENCE Truss Label: JH 7' End Jack	DrwNo: 276.25.1439.49727 GA / FV 10/03/2025

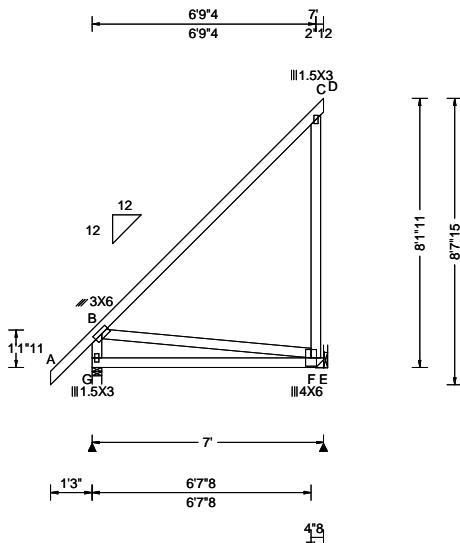

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity				Non-Gravity
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.001 C 999 360	Loc	R+	/R-	/Rh	/Rw /U /RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.003 C 999 240	G	365	/-	/-	/160 /- /161
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.002 C - -	E	275	/-	/-	/227 /82 /-
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.006 C - -	Wind reactions based on MWFRS				
NCBCLL: 10.00		Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	G	Brg Wid = 3.5	Min Req = 1.5	(Truss)	
Soffit: 2.00		TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.673	E	Brg Wid = -	Min Req = -		
Load Duration: 1.25		BCDL: 5.2 psf	TPI Std: 2014	Max BC CSI: 0.469	Bearing G is a rigid surface.				
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h	Rep Fac: No	Max Web CSI: 0.263	Members not listed have forces less than 375#				
		C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)		Maximum Bot Chord Forces Per Ply (lbs)				
		Loc. from endwall: not in 4.50 ft	Plate Type(s):		Chords	Tens. Comp.			
		GCpi: 0.18	WAVE		G - F	163	- 401		
		Wind Duration: 1.60			Maximum Web Forces Per Ply (lbs)				
					Web	Tens. Comp.			
					B - F	404	- 164		

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Web: 2x4 SP #3;

Maximum Web Forces Per Ply (lbs)

Web Tens. Comp.

B - F 404 - 164

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66241 FROM: RJL	JACK Ply: 1 Qty: 4	Job Number: B61800a DAVIS RESIDENCE Truss Label: JI 4'11"11 Jack	Cust: R 857 JRef: 1YdX8570003 T31 DrwNo: 276.25.1439.55357 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

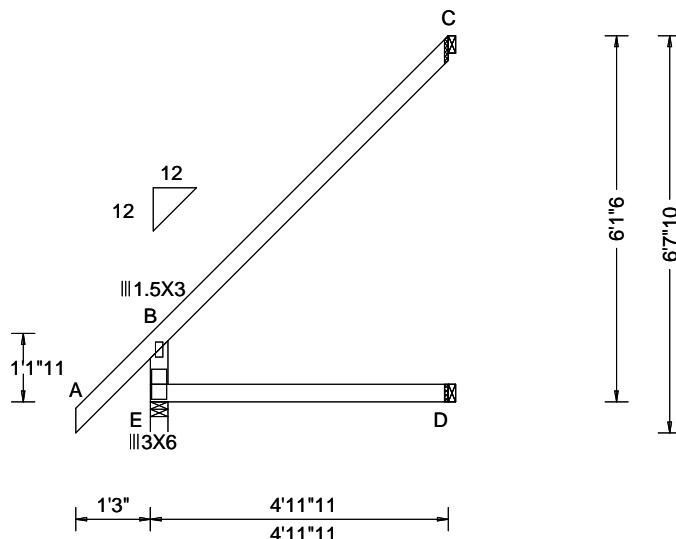

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240	E 291 /- /- /160 /70 /-		D 99 /- /- /50 /- /-			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - -	C 138 /- /- /69 /- /120		HORZ(TL): 0.001 B - -			
Des Ld:	37.00	EXP: B Kzt: NA	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS		E Brg Wid = 3.5 Min Req = 1.5 (Truss)			
NCBCLL:	10.00	Mean Height: 15.00 ft	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.450	D Brg Wid = 1.5 Min Req = -		C Brg Wid = 1.5 Min Req = -			
Soffit:	2.00	TCDL: 4.2 psf	TPI Std: 2014	Max BC CSI: 0.248	Bearing E is a rigid surface.		Bearing E is a rigid surface.			
Load Duration: 1.25	Load Duration: 1.25	BCDL: 5.2 psf	Rep Fac: No	Max Web CSI: 0.125	Members not listed have forces less than 375#		Members not listed have forces less than 375#			
Spacing: 24.0 "	Wind Duration: 1.60	MWFRS Parallel Dist: 0 to h/2	FT/RT:20(0)/10(0)	Plate Type(s):	Maximum Web Forces Per Ply (lbs)		Maximum Web Forces Per Ply (lbs)			
		C&C Dist a: 3.00 ft	WAVE	VIEW Ver: 24.02.00C.1213.15	Webs	Tens.Comp.				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

B - E 421 - 241



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66243 FROM: RJL	JACK Ply: 1 Qty: 4	Job Number: B61800a DAVIS RESIDENCE Truss Label: JJ 2'11"11 Jack	Cust: R 857 JRef: 1YdX8570003 T34 DrwNo: 276.25.1439.57143 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

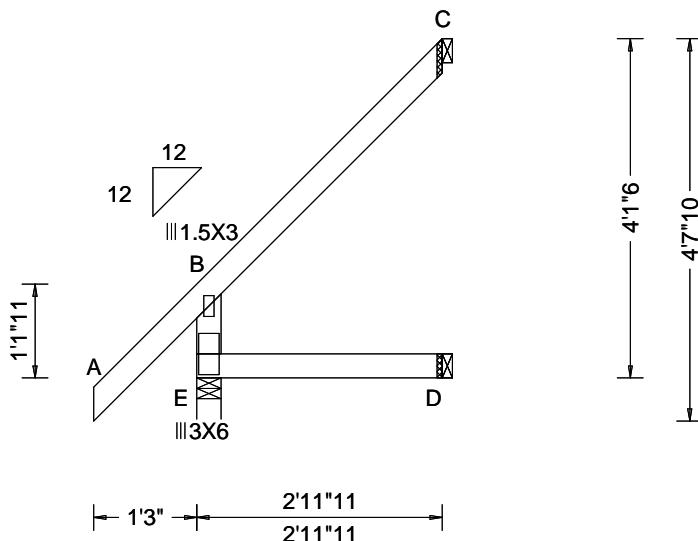

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)							
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity						
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240	E	218	/-	/-	/99	/54	/-	
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - -	D	59	/-	/-	/30	/-	/-	
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 B - -	C	72	/-	/-	/49	/-	/79	
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS							
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.137	E	Brg Wid = 3.5 Min Req = 1.5 (Truss)						
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max BC CSI: 0.081	D	Brg Wid = 1.5 Min Req = -						
		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.102	C	Brg Wid = 1.5 Min Req = -						
		C&C Dist a: 3.00 ft			Bearing E is a rigid surface.							
		Loc. from endwall: Any			Members not listed have forces less than 375#							
		GCpi: 0.18										
		Wind Duration: 1.60										
					VIEW Ver: 24.02.00C.1213.15							

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66219	HIP_	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T26
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo: 276.25.1440.00510

Truss Label: JJA 2'5"6 Hip Jack Girder
GA / FV 10/03/2025

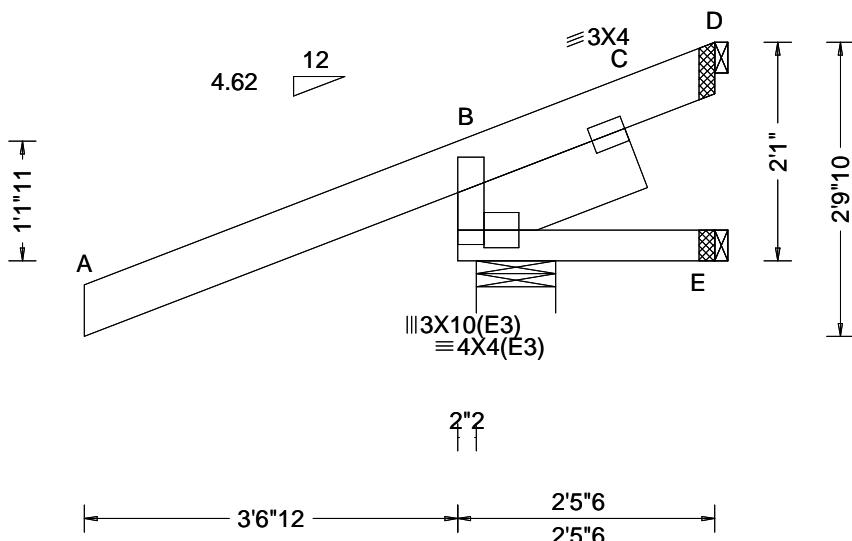

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	loc	L/defl	L/#	Gravity	Non-Gravity	
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL):	NA			B	/R+	/R-
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL):	NA			E	/Rh	/Rw
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL):	-0.001	C	-	D	/U	/RL
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	0.002	C	-			
NCBCLL:	0.00	Mean Height:	15.00 ft				Creep Factor:	2.0					
Soffit:	2.00	TCDL:	4.2 psf	Building Code:			Max TC CSI:	0.157					
Load Duration:	1.25	BCDL:	5.2 psf	FBC 8th Ed. 2023 Res.			Max BC CSI:	0.032					
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2	TPI Std: 2014			Max Web CSI:	0.001					
		C&C Dist a:	3.00 ft	Rep Fac: No									
		Loc. from endwall:	NA	FT/RT:20(0)/10(0)									
		GCpi:	0.18	Plate Type(s):									
		Wind Duration:	1.60	WAVE									
VIEW Ver: 24.02.00C.1213.15													

Lumber

Top chord: 2x6 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x8 SP SS Dense; block length = 1.833'

Loading


The following trusses need concentrated loads at the end of their overhangs: 1-8-13 span/setback member on the 0-1-8 cant side requires 13 lbs and the 1-8-13 span/setback member on the 0-1-8 cant side requires 13 lbs.

Sub-fascia beam assumptions: 3-2-13 sub-fascia beam on the 0-1-8 cantilever side. 3-2-13 sub-fascia beam on the 0-1-8 cantilever side.

Hipjack supports 1-8-13 setback jacks with 0-1-8 cantilever one face; 0-1-8 cantilever opposite face.

Wind

Wind loads and reactions based on MWFRS.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

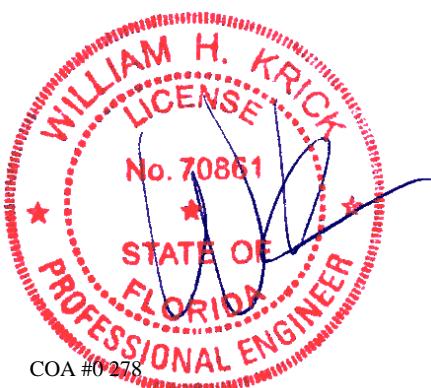

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66221 FROM: RJL	EJAC Qty: 1	Job Number: B61800a DAVIS RESIDENCE Truss Label: JJB 1' End Jack	Cust: R 857 JRef: 1YdX8570003 T33 DrwNo: 276.25.1440.02057 GA / FV 10/03/2025
--------------------------	----------------	--	---

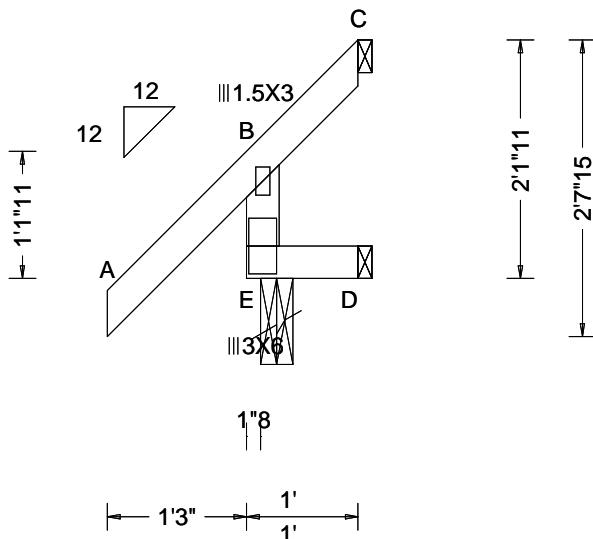

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					Non-Gravity	
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240	E	173	/-	/-	/48	/44	/-
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - -	D	20	/-	/-	/10	/-	/-
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.000 B - -	C	-	/-21	/-	/38	/-	/39
NCBCLL: 10.00		Mean Height: 15.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS						
Soffit: 2.00		TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.115	E	Brg Wid = 3.5	Min Req = 1.5	(Truss)			
Load Duration: 1.25		BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.008	D	Brg Wid = 1.5	Min Req = -				
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.087	C	Brg Wid = 1.5	Min Req = -				
		C&C Dist a: 3.00 ft	Rep Fac: No		Bearing E is a rigid surface.						
		Loc. from endwall: not in 4.50 ft	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#						
		GCpi: 0.18	Plate Type(s):								
		Wind Duration: 1.60	WAVE								
					VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Left cantilever is exposed to wind

Wind loading based on both gable and hip roof types.



10/06/2025 Date of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66245 FROM: RJL	JACK Ply: 1 Qty: 4	Job Number: B61800a DAVIS RESIDENCE Truss Label: JK 11"11 Jack	Cust: R 857 JRef: 1YdX8570003 T35 DrwNo: 276.25.1440.03750 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

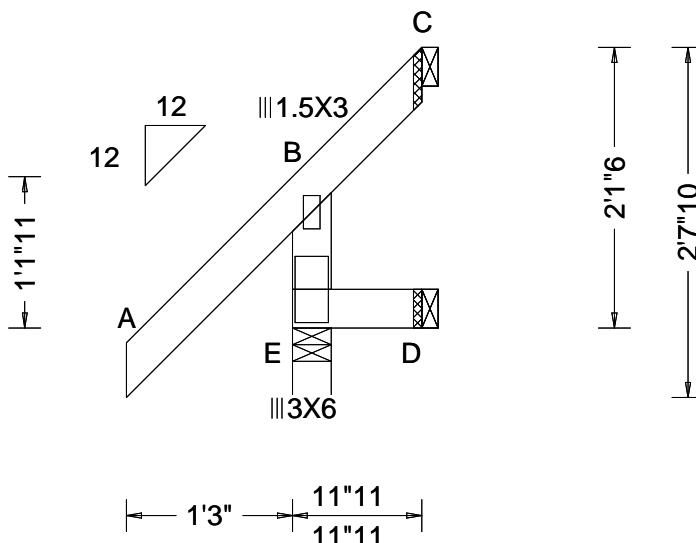

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)							
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity						
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240	E	173	/-	/-	/48	/44	/-	
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - -	D	19	/-	/-	/10	/-	/-	
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.000 B - -	C	-	/-23	/-	/38	/-	/38	
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS							
Soffit:	2.00	TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.119	E	Brg Wid = 3.5 Min Req = 1.5 (Truss)						
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.008	D	Brg Wid = 1.5 Min Req = -						
C&C Dist a: 3.00 ft	Loc. from endwall: Any	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.091	C	Brg Wid = 1.5 Min Req = -						
GCpi: 0.18	GCpi: 0.18		Rep Fac: No		Bearing E is a rigid surface.							
Wind Duration: 1.60			FT/RT:20(0)/10(0)		Members not listed have forces less than 375#							
			Plate Type(s):		VIEW Ver: 24.02.00C.1213.15							

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Web: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66328	HIP_	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T37
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JL 9'4"6 Hip Jack Girder	DrwNo: 276.25.1440.06003 GA / FV 10/03/2025

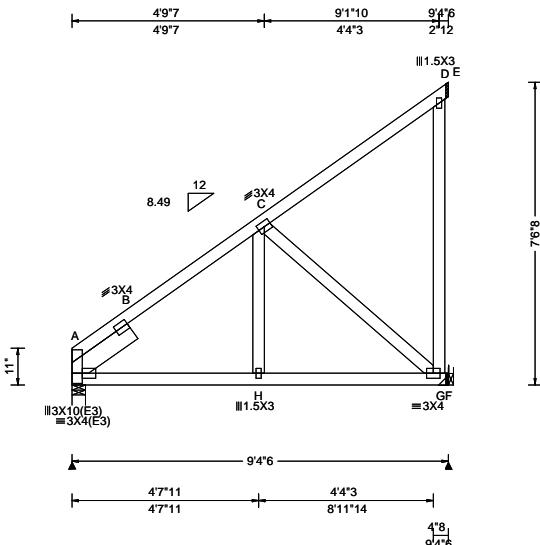

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): -0.006 B 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): -0.012 B 999 240	A	274	/-	/-	/	16	/-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.007 B - -	F	563	/-	/-	/	33	/-
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.015 B - -	Wind reactions based on MWFRS						
NCBCLL: 0.00	Mean Height: 22.81 ft	TCDL: 4.2 psf	Building Code: FBC 8th Ed. 2023 Res.	Creep Factor: 2.0	A	Brg Wid = 4.0	Min Req = 1.5	(Truss)			
Soffit: 2.00	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max TC CSI: 0.400	F	Brg Wid = -	Min Req = -				
Load Duration: 1.25	C&C Dist a: 3.00 ft	Rep Fac: No	Rep Fac: No	Max BC CSI: 0.215	Bearing A is a rigid surface.						
Spacing: 24.0 "	Loc. from endwall: NA	FT/RT:20(0)/10(0)	FT/RT:20(0)/10(0)	Max Web CSI: 0.260	Members not listed have forces less than 375#						
	GCpi: 0.18	Plate Type(s): WAVE			Maximum Top Chord Forces Per Ply (lbs)						
	Wind Duration: 1.60				A - B	25	-392	B - C	23	-382	
VIEW Ver: 24.02.00C.1213.15											

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP #1; block length = 1.833'

Maximum Web Forces Per Ply (lbs)

Webs Tens.Comp.

C - G 24 -387

Hangers / Ties

(J) Hanger Support Required, by others

Loading

Hipjack supports 6-7-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66314	EJAC	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T58
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JM 68" End Jack Girder	DrwNo: 276.25.1440.14280 GA / FV 10/03/2025

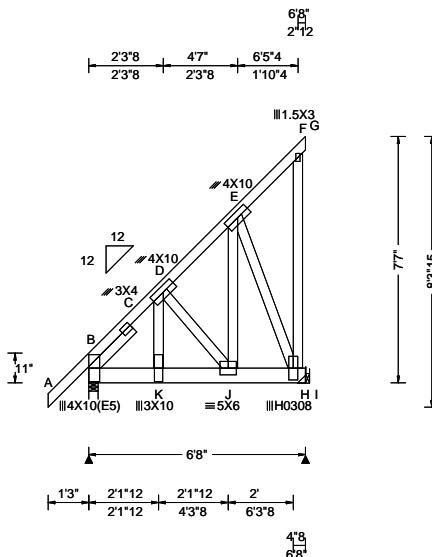

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					Non-Gravity	
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.035 K 999 360	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.037 K 999 240	B	2085	/ -	/ -	/ -	/399	/ -
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.018 D - -	H	1764	/ -	/ -	/ -	/331	/ -
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.019 D - -	Wind reactions based on MWFRS						
NCBCLL:	10.00	Mean Height: 22.21 ft	Building Code:	Creep Factor: 2.0	B	Brg Wid = 3.4	Min Req = 2.5 (Truss)				
Soffit:	2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.137	H	Brg Wid = -	Min Req = -				
Load Duration: 1.25	BCDL: 5.2 psf	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max BC CSI: 0.382	Bearing B is a rigid surface.						
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: No	Rep Fac: No	Max Web CSI: 0.869	Members not listed have forces less than 375#						
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)	Plate Type(s):		Maximum Top Chord Forces Per Ply (lbs)						
	GCpi: 0.18	WAVE, HS			Chords	Tens.Comp.	Chords	Tens.	Comp.		
	Wind Duration: 1.60				B - C	415 -2168	D - E	197	- 1023		
					C - D	401 -2114					

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Web: 2x4 SP #3;
Lt Slider: 2x4 SP #3; block length = 1.833'

Special Loads

-----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 60 plf at -1.25 to 60 plf at 6.67
BC: From 6 plf at -1.25 to 6 plf at 0.00
BC: From 10 plf at 0.00 to 10 plf at 6.67
BC: 1100 lb Conc. Load at 1.73, 2.60, 4.85

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads and reactions based on MWFRS.
Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Blocking

Blocking reinforcement required to prevent buckling of members over the bearings:
Bearing 1 located at 0.0' (blocking >= 3.50" if used)



Florida 10/06/2023 State of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66309 FROM: RJL	EJAC	Ply: 1 Qty: 20	Job Number: B61800a DAVIS RESIDENCE Truss Label: JN 6'8" End Jack	Cust: R 857 DrwNo: 276.25.1440.16573 GA / FV 10/03/2025	JRef: 1YdX8570003 T50
--------------------------	------	-------------------	---	--	--------------------------

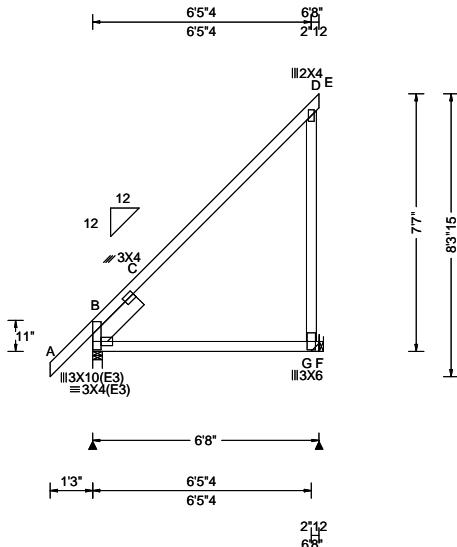

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria				▲ Maximum Reactions (lbs)									
				Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity			Non-Gravity					
				Pf: NA			VERT(LL):	NA			Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL		
				Lu: NA	Cs: NA	Snow Duration: NA				Wind reactions based on MWFRS									
TCLL: 20.00	Wind Std: ASCE 7-22						VERT(CL):	NA			B	385	/-	/-	/153	/-	/202		
TCDL: 7.00	Speed: 120 mph						HORZ(LL):	0.129	C	-	-	F	349	/-	/-	/215	/114	/-	
BCLL: 0.00	Enclosure: Closed						HORZ(TL):	0.207	C	-	-								
BCDL: 10.00	Risk Category: II						Building Code:	Creep Factor: 2.0				Wind Brg Wid = 3.4 Min Req = 1.5 (Truss)							
Des Ld: 37.00	EXP: B Kzt: NA						FBC 8th Ed. 2023 Res.	Max TC CSI: 0.799				F Brg Wid = - Min Req = -							
NCBCLL: 10.00	Mean Height: 22.21 ft						TPI Std: 2014	Max BC CSI: 0.529				Bearing B is a rigid surface.							
Soffit: 2.00	BCDL: 5.2 psf						Rep Fac: No	Max Web CSI: 0.180				Members not listed have forces less than 375#				Maximum Top Chord Forces Per Ply (lbs)			
Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2						FT/RT:20(0)/10(0)					Chords Tens.Comp.							
Spacing: 24.0 "	C&C Dist a: 3.00 ft						Plate Type(s):												
	Loc. from endwall: Any						WAVE	VIEW Ver: 24.02.00C.1213.15								B - C 502 -804			
	GCpi: 0.18																		
	Wind Duration: 1.60																		

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP #1: block length = 1.8333

Hangers / Ties

(J) Hanger Support Required, by others
(H2) = (J) Special hanger required (2)2x6 SP #1
supporting member.

Loading


Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure

Wind loading based on both gable and hip roof types

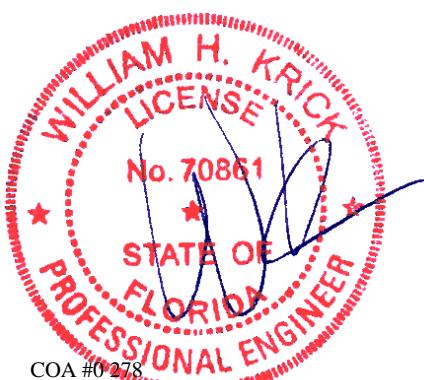

Florida Certificate of Product Approval #FL-1999

Florida Certificate of F
READ AND FOLLOW ALL NOTES ON THIS DRAWING

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
NT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 66330	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T82
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JO 47"11 Jack	DrwNo: 276.25.1440.18420 GA / FV 10/03/2025

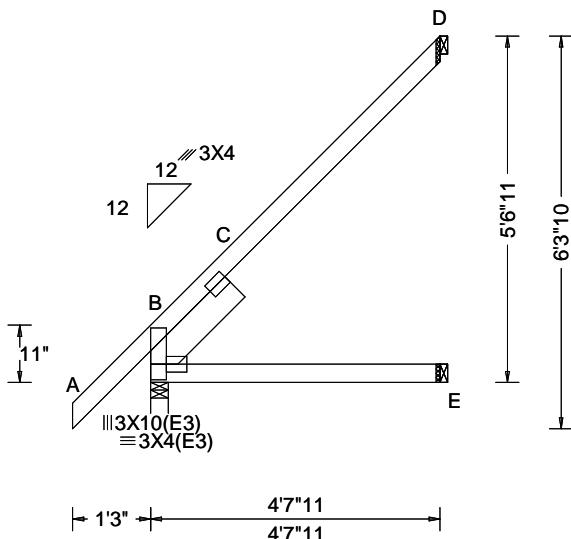

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)							
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in VERT(LL): NA	Loc	L/defl	L/#	Gravity	Non-Gravity	
TCDL:	7.00	Speed:	120 mph	Lu: NA	Cs: NA				VERT(CL): NA				B 278	/ -	
BCLL:	0.00	Enclosure:	Closed	Snow Duration:	NA				HORZ(LL): 0.046	C	-	-	E 89	/ -	
BCDL:	10.00	Risk Category:	II						HORZ(TL): 0.074	C	-	-	D 120	/ -	
Des Ld:	37.00	EXP: B	Kzt: NA						Creep Factor: 2.0						
NCBCLL:	10.00	Mean Height:	21.20 ft	Building Code:					Max TC CSI: 0.435						
Soffit:	2.00	TCDL:	4.2 psf	FBC 8th Ed. 2023 Res.					Max BC CSI: 0.196						
Load Duration:	1.25	BCDL:	5.2 psf	TPI Std: 2014					Max Web CSI: 0.037						
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2	Rep Fac: No											
		C&C Dist a:	3.00 ft	FT/RT:20(0)/10(0)											
		Loc. from endwall: Any		Plate Type(s):											
		GCpi: 0.18		WAVE											
		Wind Duration: 1.60													
VIEW Ver: 24.02.00C.1213.15															

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66334	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T86
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JOa 47"11 Jack	DrwNo: 276.25.1440.20537 GA / FV 10/03/2025

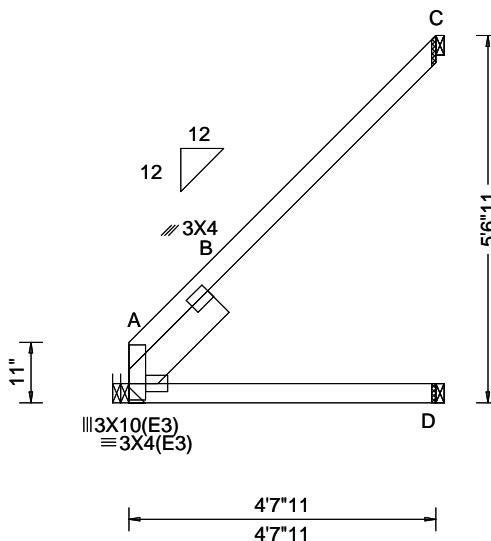

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity	Non-Gravity	
TCDL:	7.00	Speed:	120 mph	Pf: NA	Ce: NA		VERT(LL): NA	A	185	/-	/-	/92	
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL): NA	D	90	/-	/-	/54	
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL): 0.039 B	-	-	-	/-	/-	
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL): 0.077 B	-	-	-	/97	/66	
Mean Height: 21.82 ft		Building Code:		Creep Factor: 2.0									
NCBCLL: 10.00		FBC 8th Ed. 2023 Res.		Max TC CSI: 0.419									
Soffit: 2.00		TPI Std: 2014		Max BC CSI: 0.201									
Load Duration: 1.25		Rep Fac: No		Max Web CSI: 0.046									
Spacing: 24.0 "		FT/RT:20(0)/10(0)											
C&C Dist a: 3.00 ft		Plate Type(s):											
Loc. from endwall: not in 9.00 ft		WAVE											
GCpi: 0.18													
Wind Duration: 1.60													
VIEW Ver: 24.02.00C.1213.15													

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'


Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

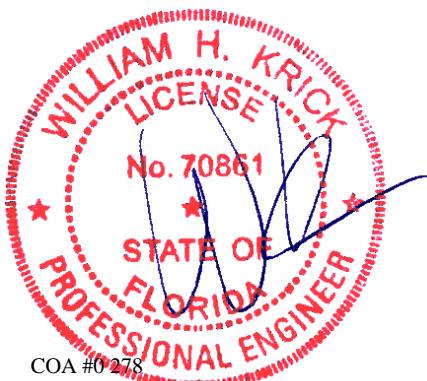

Florida 10/06/2025 Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66332	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T83
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JP 2'7"11 Jack	DrwNo: 276.25.1440.22767 GA / FV 10/03/2025

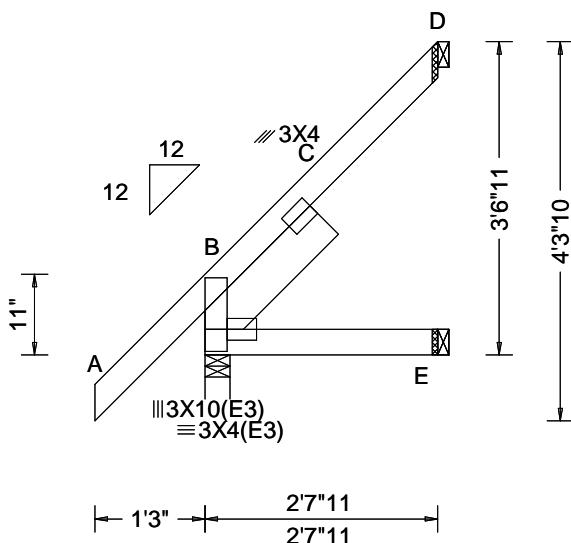

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)										
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity	Non-Gravity						
TCDL:	7.00	Speed: 120 mph		Pf: NA	Ce: NA		VERT(LL): NA	VERT(CL): NA	C	-	/77	/-	/89					
BCLL:	0.00	Enclosure: Closed		Lu: NA	Cs: NA		VERT(CL): NA											
BCDL:	10.00	Risk Category: II		Snow Duration: NA		HORZ(LL): 0.003												
Des Ld:	37.00	EXP: B Kzt: NA		Building Code:		HORZ(TL): 0.009					/29		/-					
NCBCLL:	10.00	Mean Height: 20.20 ft		FBC 8th Ed. 2023 Res.		Creep Factor: 2.0					/55		/52					
Soffit:	2.00	TCDL: 4.2 psf		TPI Std: 2014		Max TC CSI: 0.137					/89		Wind reactions based on MWFRS					
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Rep Fac: No		Max BC CSI: 0.056					Brg Wid = 3.4 Min Req = 1.5 (Truss)		B					
		MWFRS Parallel Dist: 0 to h/2		FT/RT:20(0)/10(0)		Max Web CSI: 0.006					Brg Wid = 1.5 Min Req = -		E					
		C&C Dist a: 3.00 ft		Plate Type(s):		WAVE		VIEW Ver: 24.02.00C.1213.15						D				

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66336	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef: 1YdX8570003 T87
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JPa 2'7"11 Jack	DrwNo: 276.25.1440.24857 GA / FV 10/03/2025

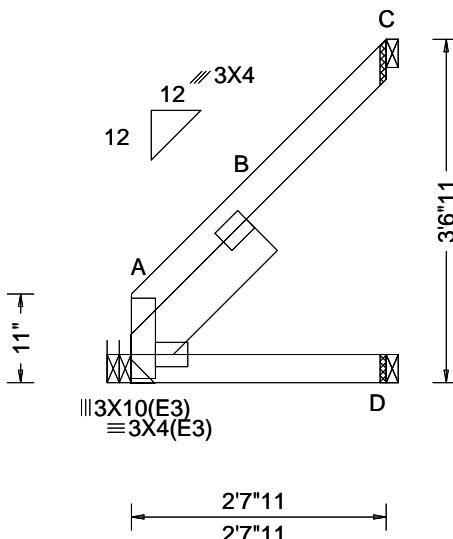

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	A	105	/-	/-	/52	/-	/52
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.011 B	D	51	/-	/-	/29	/-	/-
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.014 B	C	75	/-	/-	/58	/43	/-
Mean Height: 20.82 ft				Creep Factor: 2.0	Wind reactions based on MWFRS						
NCBCLL: 10.00		TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.164	A	Brg Wid = -		Min Req = -			
Soffit: 2.00		BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.058	D	Brg Wid = 1.5		Min Req = -			
Load Duration: 1.25		MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max Web CSI: 0.009	C	Brg Wid = 1.5		Min Req = -			
Spacing: 24.0 "		C&C Dist a: 3.00 ft	Rep Fac: No		Members not listed have forces less than 375#						
Loc. from endwall: not in 9.00 ft		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)		VIEW Ver: 24.02.00C.1213.15						
GCpi: 0.18		GCpi: 0.18	Plate Type(s):								
Wind Duration: 1.60		Wind Duration: 1.60	WAVE								

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66299	HIP_	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T53
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JQ 711"7 Hip Jack Girder	DrwNo: 276.25.1440.27237 GA / FV 10/03/2025

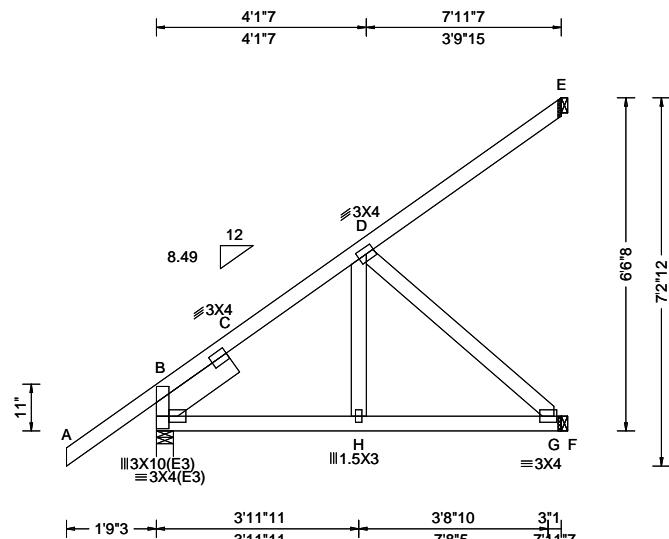

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc	L/defl	L/#	Gravity	Non-Gravity		
TCDL:	7.00	Speed:	120 mph	Pf: NA		Ce: NA	VERT(LL):	-0.008	C 999 360				
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL):	-0.016	C 999 240				
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL):	-0.009	C - -				
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	0.018	C - -				
Mean Height: 21.69 ft		Building Code:		Creep Factor: 2.0									
NCBCLL: 0.00		FBC 8th Ed. 2023 Res.		Max TC CSI: 0.259									
Soffit: 2.00		TPI Std: 2014		Max BC CSI: 0.158									
Load Duration: 1.25		Rep Fac: No		Max Web CSI: 0.137									
Spacing: 24.0 "		FT/RT:20(0)/10(0)											
C&C Dist a: 3.00 ft		Plate Type(s):											
Loc. from endwall: NA		WAVE											
GCpi: 0.18													
Wind Duration: 1.60													
VIEW Ver: 24.02.00C.1213.15													

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP #1; block length = 1.833'

Loading

Hipjack supports 5-7-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66292	HIP_	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T49
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JQa 7'11"7 Hip Jack Girder	DrwNo: 276.25.1440.29333 GA / FV 10/03/2025

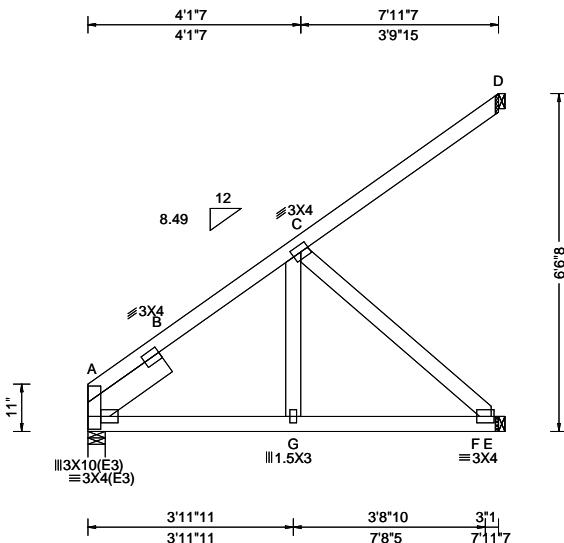

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.004 G 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.009 G 999 240	A	199	/-	/-	/	/11	/-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.004 B - -	E	237	/-	/-	/	/17	/-
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.007 B - -	D	161	/-	/-	/	/39	/-
NCBCLL: 0.00	Mean Height: 22.31 ft	Building Code:	Creep Factor: 2.0		Wind reactions based on MWFRS						
Soffit: 2.00	TCDL: 4.2 psf	FBC 8th Ed. 2023 Res.	Max TC CSI: 0.247	A	Brg Wid = 4.0	Min Req = 1.5 (Truss)					
Load Duration: 1.25	BCDL: 5.2 psf	TPI Std: 2014	Max BC CSI: 0.160	E	Brg Wid = 1.5	Min Req = -					
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2	Rep Fac: No	Max Web CSI: 0.149	D	Brg Wid = 1.5	Min Req = -					
	C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)			Bearing A is a rigid surface.						
	Loc. from endwall: NA	Plate Type(s):			Members not listed have forces less than 375#						
	GCpi: 0.18	WAVE									
	Wind Duration: 1.60				VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP #1; block length = 1.833'

Loading

Hipjack supports 5-7-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.



Florida 10/06/2025 State of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66294	EJAC	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T84
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo: 276.25.1440.35727

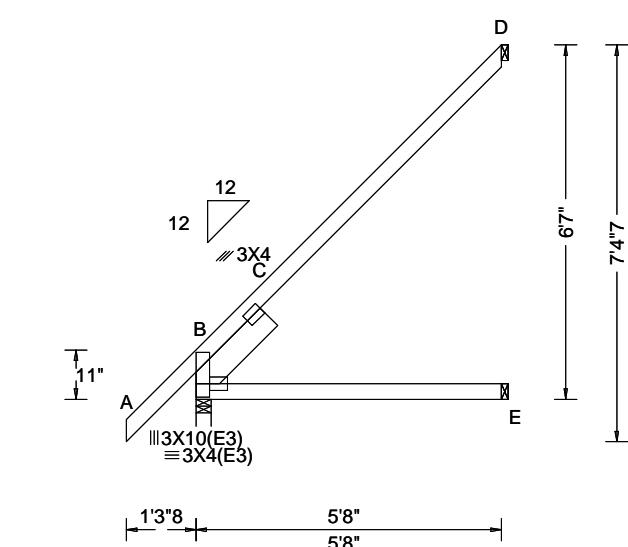

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity		Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	B	320	/-	/-	/136	/-	/136
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.060 C	E	109	/-	/-	/66	/-	/-
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.116 C	D	149	/-	/-	/115	/78	/-
NCBCLL:	10.00	Mean Height: 21.69 ft		Creep Factor: 2.0	Wind reactions based on MWFRS						
Soffit:	2.00	TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.475	B	Brg Wid = 3.4	Min Req = 1.5	(Truss)			
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.303	E	Brg Wid = 1.5	Min Req = -				
		MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max Web CSI: 0.054	D	Brg Wid = 1.5	Min Req = -				
		C&C Dist a: 3.00 ft	Rep Fac: No		Bearing B is a rigid surface.						
		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#						
		GCpi: 0.18	Plate Type(s):		Maximum Top Chord Forces Per Ply (lbs)						
		Wind Duration: 1.60	WAVE		Chords	Tens.	Comp.				
VIEW Ver: 24.02.00C.1213.15											

Lumber

Top chord: 2x4 SP #1;
 Bot chord: 2x4 SP #1;
 Lt Slider: 2x6 SP #1; block length = 1.833'

B - C 229 -503

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-7 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66297 FROM: RJL	EJAC Qty: 6	Job Number: B61800a DAVIS RESIDENCE Truss Label: JRa 5'8" End Jack	Cust: R 857 JRef: 1YdX8570003 T59 DrwNo: 276.25.1440.38230 GA / FV 10/03/2025
--------------------------	----------------	--	---

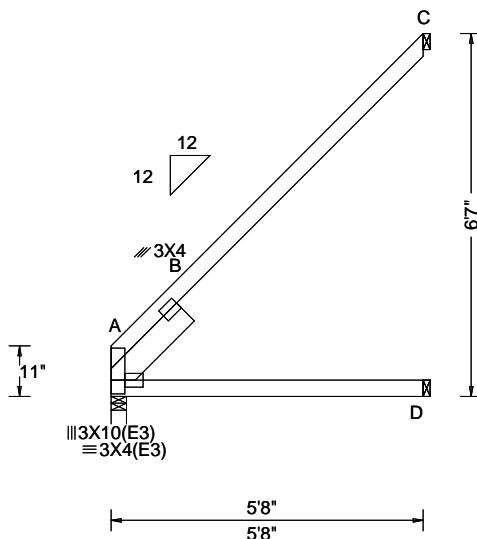

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	A	226	/-	/-	/112	/-	/115
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.069 B	D	110	/-	/-	/66	/-	/-
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.137 B	C	155	/-	/-	/116	/79	/-
NCBCLL:	10.00	Mean Height: 22.33 ft		Creep Factor: 2.0	Wind reactions based on MWFRS						
Soffit:	2.00	TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.557	A	Brg Wid = 3.4	Min Req = 1.5	(Truss)			
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.310	D	Brg Wid = 1.5	Min Req = -				
		MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max Web CSI: 0.078	C	Brg Wid = 1.5	Min Req = -				
		C&C Dist a: 3.00 ft	Rep Fac: No		Bearing A is a rigid surface.						
		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#						
		GCpi: 0.18	Plate Type(s):		Maximum Top Chord Forces Per Ply (lbs)						
		Wind Duration: 1.60	WAVE		Chords	Tens.	Comp.				
VIEW Ver: 24.02.00C.1213.15											

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

A - B 420 - 692

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66301	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T6
FROM: RJL		Qty: 2	DAVIS RESIDENCE Truss Label: JS 3'7"11 Jack	DrwNo: 276.25.1440.39693 GA / FV 10/03/2025

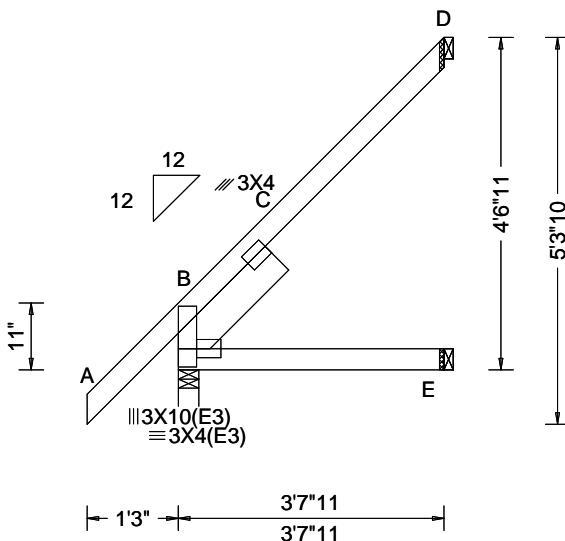

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)									
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc	L/defl	L/#	Gravity	Non-Gravity					
TCDL:	7.00	Speed: 120 mph		Pf: NA	Ce: NA		VERT(LL): NA	B	/ -	/ -	/96	/ -	/94				
BCLL:	0.00	Enclosure: Closed		Lu: NA	Cs: NA		VERT(CL): NA				E	/ -	/41				
BCDL:	10.00	Risk Category: II		Snow Duration: NA		HORZ(LL): 0.014 C					/ -	/ -	/ -				
Des Ld:	37.00	EXP: B Kzt: NA		Building Code:		HORZ(TL): 0.026 C					D	90	/ -	/76			
NCBCLL:	10.00	Mean Height: 20.70 ft		FBC 8th Ed. 2023 Res.		Creep Factor: 2.0					Wind reactions based on MWFRS						
Soffit:	2.00	TCDL: 4.2 psf		TPI Std: 2014		Max TC CSI: 0.201					B	Brg Wid = 3.4	Min Req = 1.5 (Truss)				
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Rep Fac: No		Max BC CSI: 0.114					E	Brg Wid = 1.5	Min Req = -				
Loc. from endwall: not in 9.00 ft	GCpi: 0.18	MWFRS Parallel Dist: h/2 to h		FT/RT:20(0)/10(0)		Max Web CSI: 0.014					D	Brg Wid = 1.5	Min Req = -				
	Wind Duration: 1.60	C&C Dist a: 3.00 ft		Plate Type(s):		WAVE		VIEW Ver: 24.02.00C.1213.15									

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



Florida CeHafee of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66305 FROM: RJL	JACK Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JSa 37"11 Jack	Cust: R 857 JRef: 1YdX8570003 T61 DrwNo: 276.25.1440.41813 GA / FV 10/03/2025
--------------------------	--------------------------	---	---

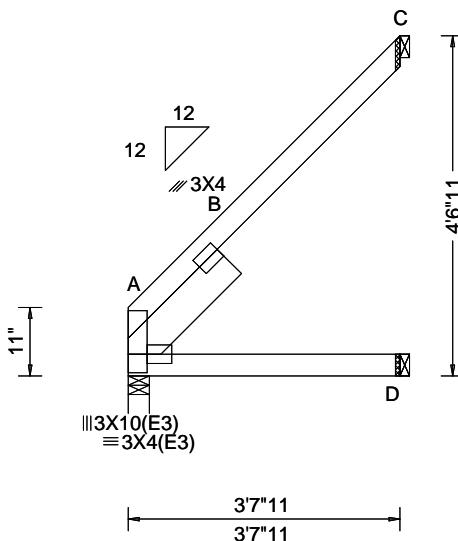

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	Loc	L/defl	L/#	Gravity	Non-Gravity	
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA	A	/-	/	/72	/-	/73
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.024 B	D	/-	/	/41	/-	/-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.038 B	C	/-	/	/77	/55	/-
Des Ld:	37.00	EXP: B Kzt: NA		Creep Factor: 2.0						
NCBCLL:	10.00	Mean Height: 21.32 ft	Building Code: FBC 8th Ed. 2023 Res.	Max TC CSI: 0.285						
Soffit:	2.00	TCDL: 4.2 psf	TPI Std: 2014	Max BC CSI: 0.118						
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	Rep Fac: No	Max Web CSI: 0.022						
Loc. from endwall: not in 9.00 ft		MWFRS Parallel Dist: h/2 to h	FT/RT:20(0)/10(0)							
GCpi: 0.18		C&C Dist a: 3.00 ft	Plate Type(s):							
Wind Duration: 1.60		Loc. from endwall: not in 9.00 ft	WAVE							
				VIEW Ver: 24.02.00C.1213.15						

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66303 FROM: RJL	JACK Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JT 17"11 Jack	Cust: R 857 JRef: 1YdX8570003 T51 DrwNo: 276.25.1440.44267 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

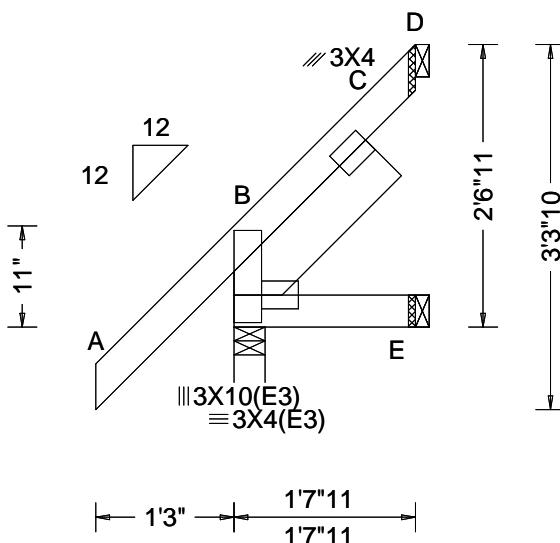

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-22	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	loc	L/defl	L/#	Gravity	Non-Gravity	
TCDL:	7.00	Speed:	120 mph	Pf: NA	Ce: NA		VERT(LL):	NA			B	178	/-
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA		VERT(CL):	NA			E	31	/-
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA		HORZ(LL):	0.000	B	-			/17
Des Ld:	37.00	EXP: B	Kzt: NA				HORZ(TL):	0.002	C	-			/-
NCBCLL:	10.00	Mean Height:	19.70 ft				Creep Factor:	2.0					
Soffit:	2.00	TCDL:	4.2 psf	Building Code:			Max TC CSI:	0.120					
Load Duration:	1.25	BCDL:	5.2 psf	FBC 8th Ed. 2023 Res.			Max BC CSI:	0.020					
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2	TPI Std: 2014			Max Web CSI:	0.004					
		C&C Dist a:	3.00 ft	Rep Fac: No									
		Loc. from endwall:	not in 4.50 ft	FT/RT:20(0)/10(0)									
		GCpi: 0.18		Plate Type(s):									
		Wind Duration:	1.60	WAVE									
												VIEW Ver: 24.02.00C.1213.15	


Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

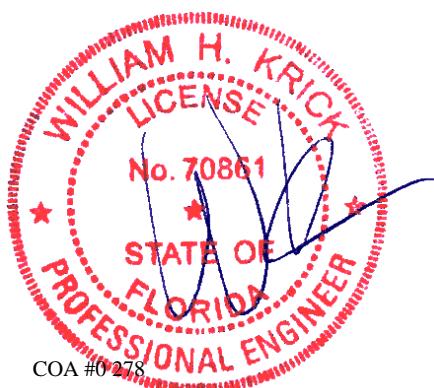

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66307 FROM: RJL	JACK Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JTa 1'7"11 Jack	Cust: R 857 JRef: 1YdX8570003 T52 DrwNo: 276.25.1440.54213 GA / FV 10/03/2025
--------------------------	--------------------------	--	---

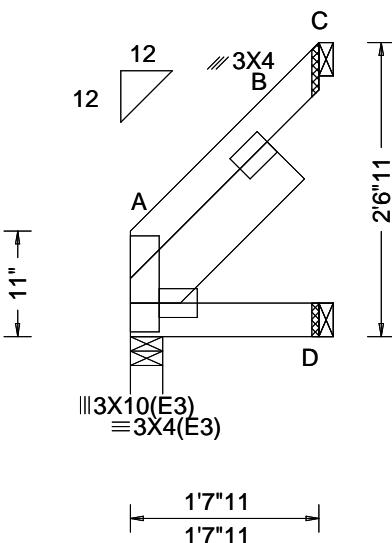

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
				Loc	R+	R-	Gravity / Rh	Non-Gravity / Rw	Non-Gravity / U	Non-Gravity / RL
TCLL: 20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in VERT(LL): NA	A	65	/-	/-	/32	/-	/32
TCDL: 7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(CL): NA	D	31	/-	/-	/17	/-	/-
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	HORZ(LL): 0.001 B	-	-	-				
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(TL): 0.002 B	-	-	-				
Des Ld: 37.00	EXP: B Kzt: NA		Creep Factor: 2.0							
NCBCLL: 10.00	Mean Height: 20.32 ft		Max TC CSI: 0.067							
Soffit: 2.00	TCDL: 4.2 psf		Max BC CSI: 0.020							
Load Duration: 1.25	BCDL: 5.2 psf		Max Web CSI: 0.002							
Spacing: 24.0 "	MWFRS Parallel Dist: h/2 to h									
	C&C Dist a: 3.00 ft									
	Loc. from endwall: not in 9.00 ft									
	GCpi: 0.18									
	Wind Duration: 1.60									
Wind reactions based on MWFRS										
A Brg Wid = 3.4 Min Req = 1.5 (Truss)										
D Brg Wid = 1.5 Min Req = -										
C Brg Wid = 1.5 Min Req = -										
Bearing A is a rigid surface.										
Members not listed have forces less than 375#										
VIEW Ver: 24.02.00C.1213.15										

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66253	HIP_	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T42
FROM: RJL		Qty: 2	DAVIS RESIDENCE	DrwNo:	276.25.1440.55860	
			Truss Label: JU 4'2"3 Hip Jack Girder	GA	/ FV	10/03/2025

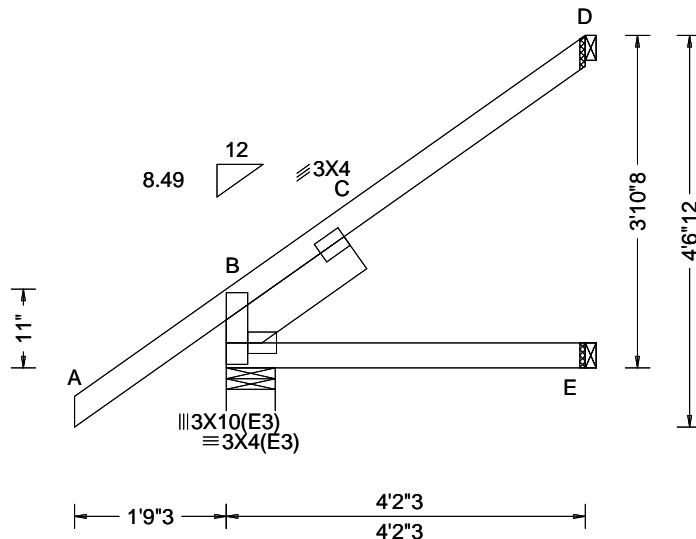

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Loading

Hipjack supports 2-11-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.



Elonika 10/06/2026

Florida Certificate of Product Approval #FL 1999


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabrication, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI section B3, B7, or B10, as applicable. Apply rates to each face of truss and position as shown above and on the joint details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.
Not all trusses shown in this drawing represent Group I trusses. Trusses shall not be responsible for any deviation from this drawing, any failure to build the

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

For more information, see these Web sites: Alpine (alpineltrv.com), FIA (fia.org), CBAC (cbacomponents.com), ICC (iccsafe.org), AWC (awc.org).

SEQN: 66251 FROM: RJL	EJAC Qty: 15	Job Number: B61800a DAVIS RESIDENCE Truss Label: JV 3' End Jack	Cust: R 857 JRef: 1YdX8570003 T41 DrwNo: 276.25.1440.57300 GA / FV 10/03/2025
--------------------------	-----------------	---	---

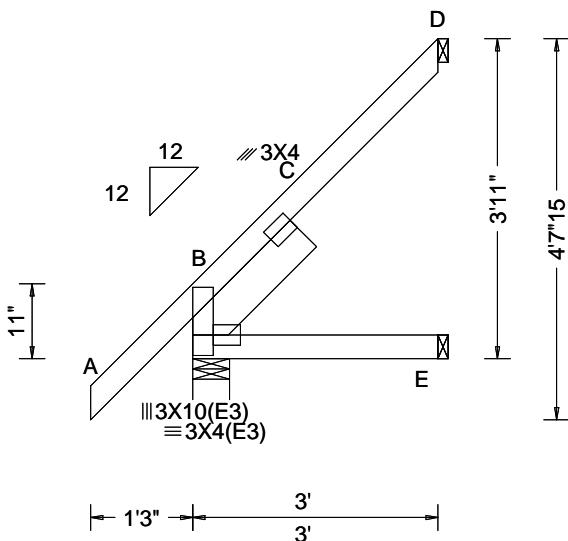

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc	L/defl	L/#	Gravity	Non-Gravity		
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): NA			/ Rh	/ Rw	/ U	/ RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA			B 219	/-	/-	/80
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.006 C	-	-	E 57	/-	/33	/- /-
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.012 C	-	-	D 70	/-	/63	/46 /-
NCBCLL: 10.00		Mean Height: 20.38 ft		Creep Factor: 2.0			Wind reactions based on MWFRS			
Soffit: 2.00		TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.145			Brg Wid = 5.4	Min Req = 1.5 (Truss)		
Load Duration: 1.25		BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.075			E Brg Wid = 1.5	Min Req = -		
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max Web CSI: 0.008			D Brg Wid = 1.5	Min Req = -		
Loc. from endwall: not in 9.00 ft		C&C Dist a: 3.00 ft	Rep Fac: No				Bearing B is a rigid surface.			
GCpi: 0.18		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)				Members not listed have forces less than 375#			
Wind Duration: 1.60			Plate Type(s):				VIEW Ver: 24.02.00C.1213.15			
			WAVE							

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Lt Slider: 2x6 SP #1; block length = 1.833'

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.



10/06/2025 Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66255	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T40
FROM: RJL		Qty: 4	DAVIS RESIDENCE Truss Label: JW 11"11 Jack	DrwNo: 276.25.1440.59437 GA / FV 10/03/2025

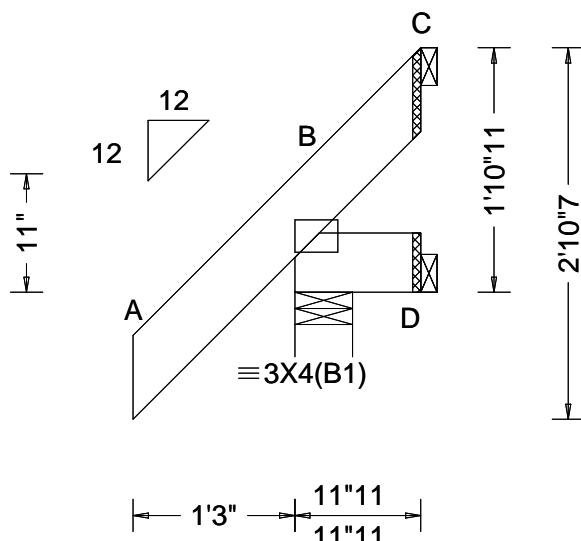

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	B 192 /- /- /58 /5 /46		D 16 /- /- /8 /- /-			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.000 C	-	-	C - /-36 /- /16 /11 /-			
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 C	-	-	Wind reactions based on MWFRS			
NCBCLL:	10.00	Mean Height: 19.36 ft		Creep Factor: 2.0	B Brg Wid = 5.4 Min Req = 1.5 (Truss)		D Brg Wid = 1.5 Min Req = -			
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.049	C Brg Wid = 1.5 Min Req = -		Bearing B is a rigid surface.			
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max BC CSI: 0.005	Members not listed have forces less than 375#					
		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.000						
		C&C Dist a: 3.00 ft								
		Loc. from endwall: Any								
		GCpi: 0.18								
		Wind Duration: 1.60								
					VIEW Ver: 24.02.00C.1213.15					


Lumber

Top chord: 2x6 SP #1;
Bot chord: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

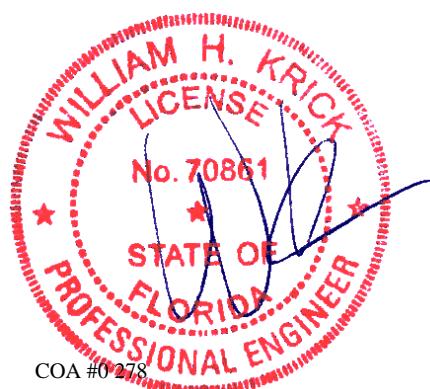

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66205	HIP_	Ply: 1	Job Number: B61800a	Cust: R 857	JRef: 1YdX8570003	T21
FROM: RJL		Qty: 1	DAVIS RESIDENCE	DrwNo:	276.25.1441.02820	
			Truss Label: JX 57'2 Hip Jack Girder	GA / FV		10/03/2025

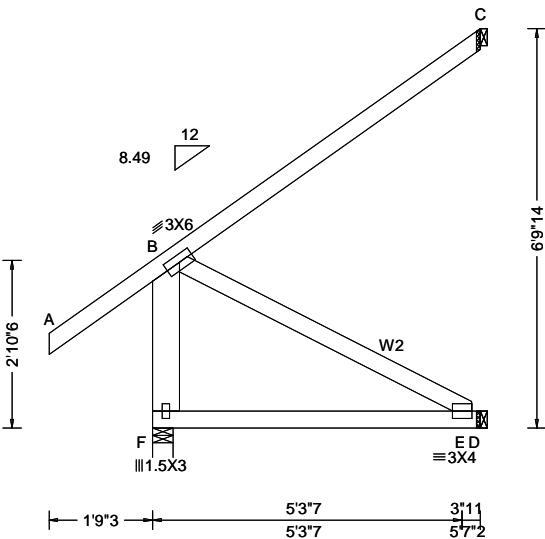

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x6 SP #1; W2 2x4 SP #3;


Loading

Hipjack supports 3-11-8 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Left end vertical exposed to wind pressure. Deflection
meets L/260.

Wind loading based on both gable and hip roof types.

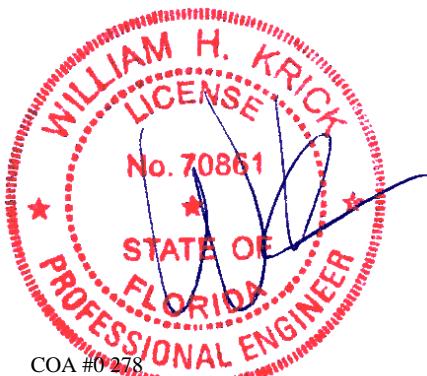

10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING**


****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66207 FROM: RJL	EJAC Ply: 1 Qty: 2	Job Number: B61800a DAVIS RESIDENCE Truss Label: JY 4' End Jack	Cust: R 857 JRef: 1YdX8570003 T17 DrwNo: 276.25.1441.04317 GA / FV 10/03/2025
--------------------------	--------------------------	---	---

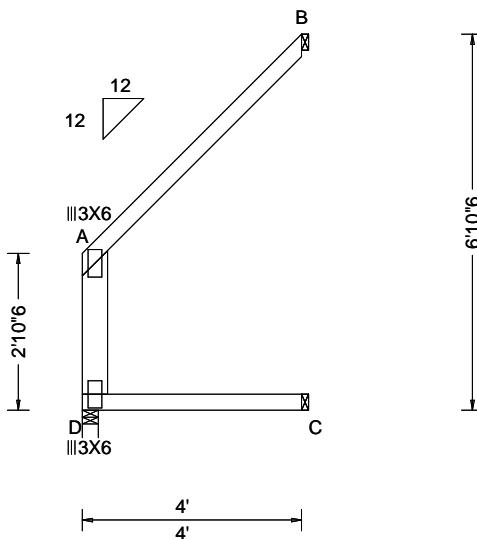

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					Non-Gravity	
TCDL: 7.00		Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 A 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 A 999 240	D	160	/-	/-	/169	/51	/-
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 A - -	C	80	/-	/-	/40	/-	/39
Des Ld: 37.00		EXP: B Kzt: NA		HORZ(TL): 0.001 A - -	B	120	/-	/-	/58	/24	/98
NCBCLL: 10.00		Mean Height: 15.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS						
Soffit: 2.00		TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.305	D	Brg Wid = 3.5	Min Req = 1.5	(Truss)			
Load Duration: 1.25		BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.155	C	Brg Wid = 1.5	Min Req = -				
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.039	B	Brg Wid = 1.5	Min Req = -				
		C&C Dist a: 3.00 ft	Rep Fac: No		Bearing D is a rigid surface.						
		Loc. from endwall: not in 4.50 ft	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#						
		GCpi: 0.18	Plate Type(s):		Members not listed have forces less than 375#						
		Wind Duration: 1.60	WAVE		Wind Duration: 1.60						
					VIEW Ver: 24.02.00C.1213.15						

Lumber


Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.

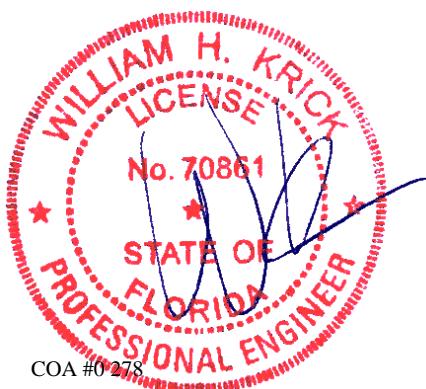

Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66209	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T10
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JZ 1'11"11 Jack	DrwNo: 276.25.1441.05947 GA / FV 10/03/2025

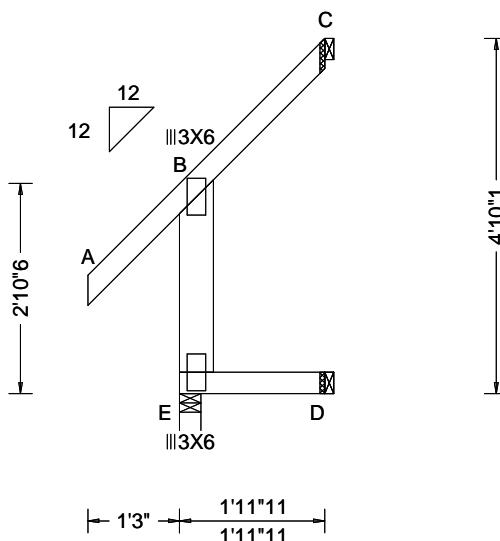

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 B 999 360	Loc R+ / R-	/ Rh / Rw / U / RL				
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 B 999 240	E 186	/ - / - /149 /79 /-				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - - -	D 39	/ - / - /20 / - /38				
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 B - - -	C 33	/ - / - /81 /59 /87				
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0		Wind reactions based on MWFRS				
Soffit:	2.00	TCDL: 4.2 psf		Max TC CSI: 0.102	E Brg Wid = 3.5	Min Req = 1.5 (Truss)				
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf		Max BC CSI: 0.034	D Brg Wid = 1.5	Min Req = -				
		MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.047	C Brg Wid = 1.5	Min Req = -				
		C&C Dist a: 3.00 ft				Bearing E is a rigid surface.				
		Loc. from endwall: not in 4.50 ft				Members not listed have forces less than 375#				
		GCpi: 0.18								
		Wind Duration: 1.60								
						VIEW Ver: 24.02.00C.1213.15				

Lumber


Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.

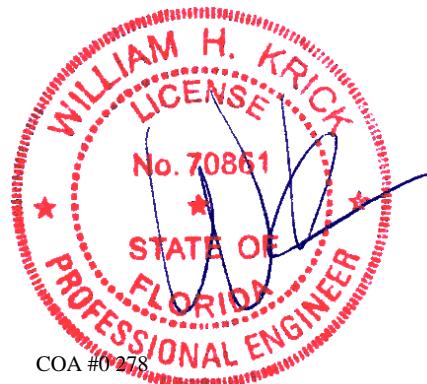

10/06/2025 Florida Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 66211	JACK	Ply: 1	Job Number: B61800a	Cust: R 857 JRef:1YdX8570003 T18
FROM: RJL		Qty: 1	DAVIS RESIDENCE Truss Label: JZA 1'11"11 Jack	DrwNo: 276.25.1441.07430 GA / FV 10/03/2025

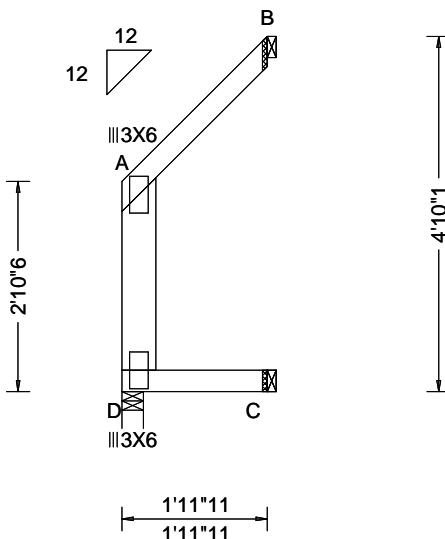

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-22	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity					Non-Gravity	
TCDL:	7.00	Speed: 120 mph	Pf: NA Ce: NA	VERT(LL): 0.000 A 999 360	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.000 A 999 240	D	79	/-	/-	/106	/36	/-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 A - -	C	39	/-	/-	/20	/-	/39
Des Ld:	37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 A - -	B	59	/-	/-	/42	/35	/68
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS						
Soffit:	2.00	TCDL: 4.2 psf	Building Code:	Max TC CSI: 0.071	D	Brg Wid = 3.5 Min Req = 1.5 (Truss)					
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.2 psf	FBC 8th Ed. 2023 Res.	Max BC CSI: 0.034	C	Brg Wid = 1.5 Min Req = -					
		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.041	B	Brg Wid = 1.5 Min Req = -					
		C&C Dist a: 3.00 ft	Rep Fac: No		Bearing D is a rigid surface.						
		Loc. from endwall: Any	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#						
		GCpi: 0.18	Plate Type(s):		Wind loads based on MWFRS with additional C&C member design.						
		Wind Duration: 1.60	WAVE		Wind loads based on MWFRS with additional C&C member design.						
VIEW Ver: 24.02.00C.1213.15											

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x6 SP #1;

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/360.

Wind loading based on both gable and hip roof types.



Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

Cracked or Broken Member Repair Detail

This drawing specifies repairs for a truss with broken chord or web member.

This design is valid only for single ply trusses with 2x4 or 2x6 broken members. No more than one break per chord panel and no more than two breaks per truss are allowed. Contact the truss manufacturer for any repairs that do not comply with this detail.

(B) = Damaged area, 12" max length of damaged section

(L) = Minimum nailing distance on each side of damaged area (B)

(S) = Two 2x4 or two 2x6 side members, same size, grade, and species as damaged member. Apply one scab per face. Minimum side member length(s) = (2)(L) + (B)

Scab member length (S) must be within the broken panel.

Nail into 2x4 members using two (2) rows at 4" o.c., rows staggered.

Nail into 2x6 members using three (3) rows at 4" o.c., rows staggered.


Nail using 10d box or gun nails (0.128" x 3", min) into each side member.

The maximum permitted lumber grade for use with this detail is limited to Visual grade #1 and MSR grade 1650f.

This repair detail may be used for broken connector plate at mid-panel splices.

This repair detail may not be used for damaged chord or web sections occurring within the connector plate area.

Broken chord may not support any tie-in loads.

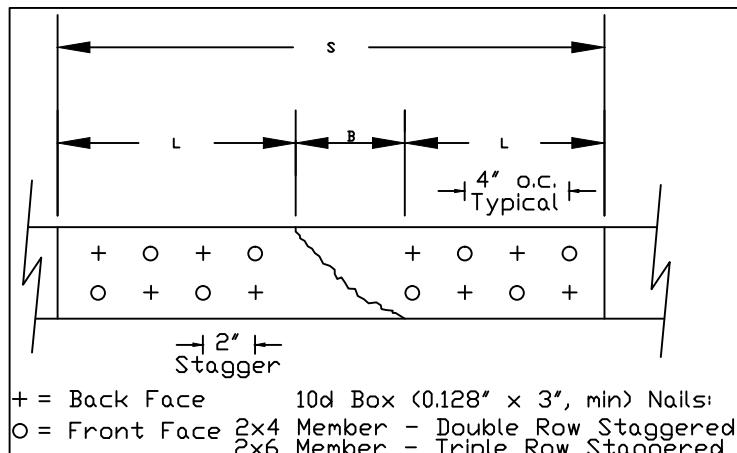

Nail Spacing Detail



155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

WARNING! READ AND FOLLOW ALL NOTES ON THIS DRAWING

IMPORTANT! FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached right ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpihst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

Load Duration = 0%
Member forces may be increased for Duration of Load

Member	Size	L	Maximum Member Axial Force			
			SPF-C	HF	DF-L	SYP
Web Only	2x4	12"	620#	635#	730#	800#
Web Only	2x4	18"	975#	1055#	1295#	1415#
Web or Chord	2x4	24"	975#	1055#	1495#	1745#
			1465#	1585#	2245#	2620#
Web or Chord	2x4	30"	1910#	1960#	2315#	2555#
			2230#	2365#	3125#	3575#
Web or Chord	2x4	36"	2470#	2530#	2930#	3210#
			3535#	3635#	4295#	4745#
Web or Chord	2x4	42"	2975#	3045#	3505#	3835#
			4395#	4500#	5225#	5725#
Web or Chord	2x4	48"	3460#	3540#	4070#	4445#
			5165#	5280#	6095#	6660#

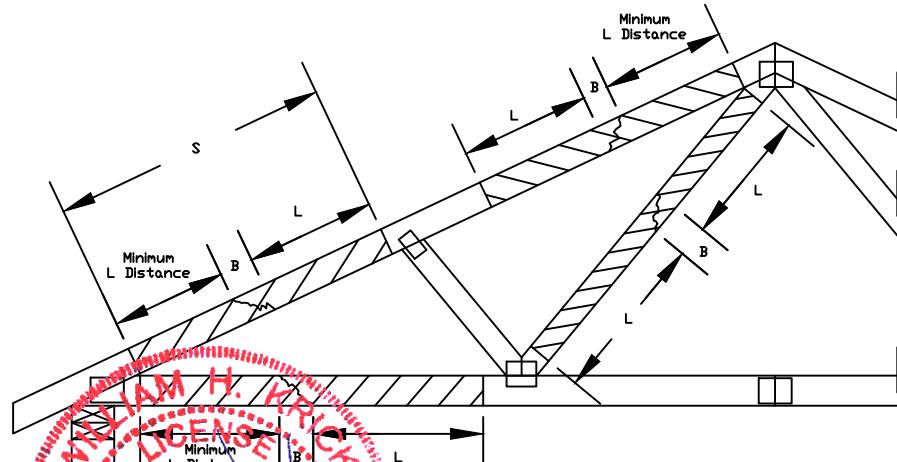

No. 70861

STATE OF
FLORIDA
PROFESSIONAL ENGINEER

COA # 0278 10/06/2025
Florida Certified Product Approval 24.0" MAX 1999

REF MEMBER REPAIR

DATE 10/01/14

DRWG REPCHRD1014

NAIL SPACING DETAIL

MINIMUM SPACING FOR SINGLE BLOCK IS SHOWN. DOUBLE NAIL SPACINGS AND STAGGER NAILING FOR TWO BLOCKS. GREATER SPACING MAY BE REQUIRED TO AVOID SPLITTING.

BLOCK LOCATION, SIZE, LENGTH, GRADE AND TOTAL NUMBER AND TYPE OF NAILS ARE TO BE SPECIFIED ON SEALED DESIGN REFERENCING THIS DETAIL.

LOAD PERPENDICULAR TO GRAIN

A - EDGE DISTANCE AND SPACING BETWEEN STAGGERED ROWS OF NAILS (6 NAIL DIAMETERS)

B - SPACING OF NAILS IN A ROW (12 NAIL DIAMETERS)

C - END DISTANCE (15 NAIL DIAMETERS)

LOAD PARALLEL TO GRAIN

A - EDGE DISTANCE (6 NAIL DIAMETERS)

C - SPACING OF NAILS IN A ROW AND END DISTANCE (15 NAIL DIAMETERS)


D - SPACING BETWEEN STAGGERED ROWS OF NAILS (7 1/2 NAIL DIAMETERS)

IF NAIL HOLES ARE PREBORED, SOME SPACING MAY BE REDUCED BY THE AMOUNTS GIVEN

BELOW:

* SPACING MAY BE REDUCED BY 50%

** SPACING MAY BE REDUCED BY 33%

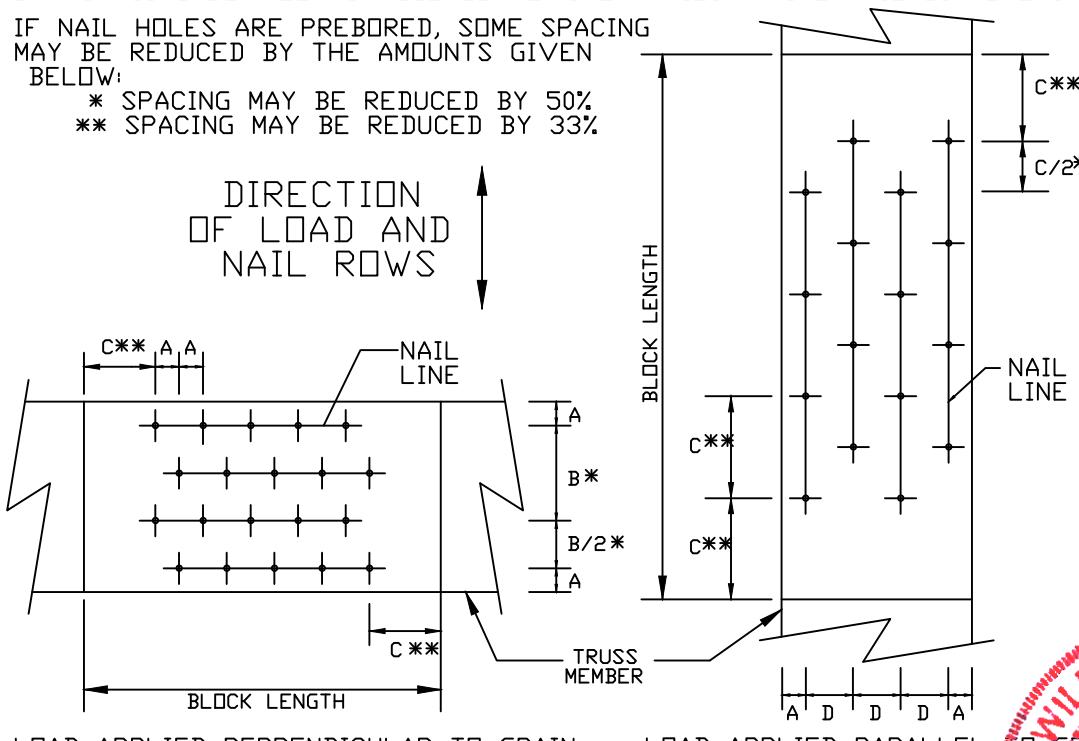

MINIMUM NAIL SPACING DISTANCES

NAIL TYPE	DISTANCES			
	A	B*	C**	D
8d BOX (0.113"X 2.5",MIN)	3/4"	1 3/8"	1 3/4"	7/8"
10d BOX (0.128"X 3.",MIN)	7/8"	1 5/8"	2"	1"
12d BOX (0.128"X 3.25",MIN)	7/8"	1 5/8"	2"	1"
16d BOX (0.135"X 3.5",MIN)	7/8"	1 5/8"	2 1/8"	1 1/8"
20d BOX (0.148"X 4.",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
8d COMMON (0.131"X 2.5",MIN)	7/8"	1 5/8"	2"	1"
10d COMMON (0.148"X 3.",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
12d COMMON (0.148"X 3.25",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
16d COMMON (0.162"X 3.5",MIN)	1'	2"	2 1/2"	1 1/4"
GUN (0.120"X 2.5",MIN)	3/4"	1 1/2"	1 7/8"	1"
GUN (0.131"X 2.5",MIN)	7/8"	1 5/8"	2"	1"
GUN (0.120"X 3.",MIN)	3/4"	1 1/2"	1 7/8"	1"
GUN (0.131"X 3.",MIN)	7/8"	1 5/8"	2"	1"




155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached right chord. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpinetw.com; TPI: www.tpihst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

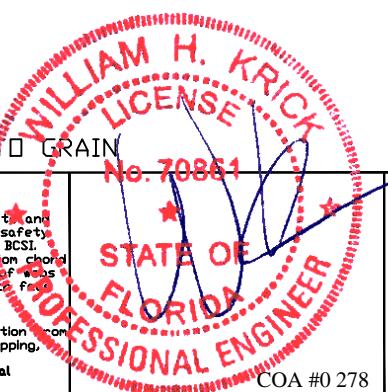

REF NAIL SPACE
DATE 10/01/14
DRWG CNNAILSP1014

10/06/2025

COA #0 278
Florida Certificate of Product Approval #FL 1999

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.

Web Member Size	Specified CLR Restraint	Alternative Reinforcement T- or L- Reinf.	Scab Reinf.
2x3 or 2x4	1 row	2x4	1-2x4
2x3 or 2x4	2 rows	2x6	2-2x4
2x6	1 row	2x4	1-2x6
2x6	2 rows	2x6	2-2x4(*)
2x8	1 row	2x6	1-2x8
2x8	2 rows	2x6	2-2x6(*)

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.


(*) Center scab on wide face of web. Apply (1) scab to each face of web.

T-Reinforcement

OR

L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128" x 3.0", min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

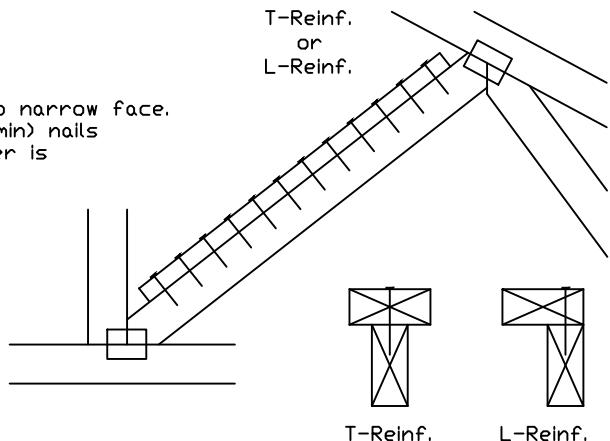


T-Reinf.
or
L-Reinf.

T-Reinf.


L-Reinf.

Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128" x 3.0", min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

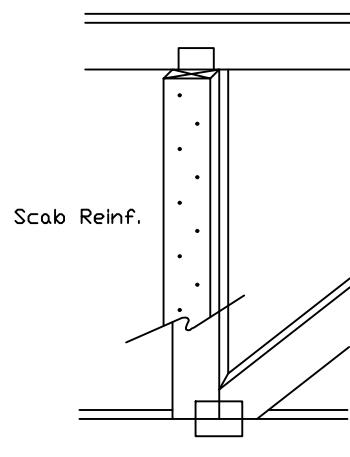

Scab Reinf.

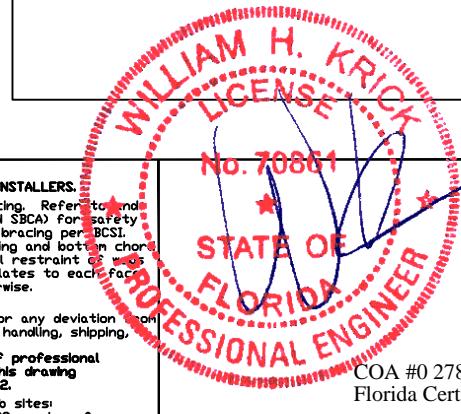

TC LL	PSF	REF CLR Subst.
TC DL	PSF	DATE 01/02/19
BC DL	PSF	DRWG BRCLBSUB0119
BC LL	PSF	
TOT. LD.	PSF	
		10/06/2025
COA #0 278	DUR. FAC.	
	Florida Certif.	Certificate of Product Approval #FL 1999
	SPACING	

Valley Detail - ASCE 7-22: 180 mph, 30' Mean Height, Partially Enclosed, Exp. C, Kzt=1.00

Top Chord 2x4 SP #2N, SPF #1/#2, DF-L #2 or better.
 Bot Chord 2x4 SP #2N or SPF #1/#2 or better.
 Webs 2x4 SP #3, SPF #1/#2, DF-L #2 or better.

** Attach each valley to every supporting truss with:
 535# connection or with (1) Simpson H2.5A or
 equivalent connector for


ASCE 7-22 180 mph, 30' Mean Height, Part. Enc.
 Building, Exp. C, Wind TC DL=5 psf, Kzt = 1.00
 Or

ASCE 7-22 160 mph, 30' Mean Height, Part. Enc.
 Building, Exp. D, Wind TC DL=5 psf, Kzt = 1.00

Bottom chord may be square or pitched cut
 as shown.

Valleys short enough to be cut as solid triangular
 members from a single 2x6, or larger as required,
 shall be permitted in lieu of fabricating from
 separate 2x4 members.

All plates shown are Alpine Wave Plates.

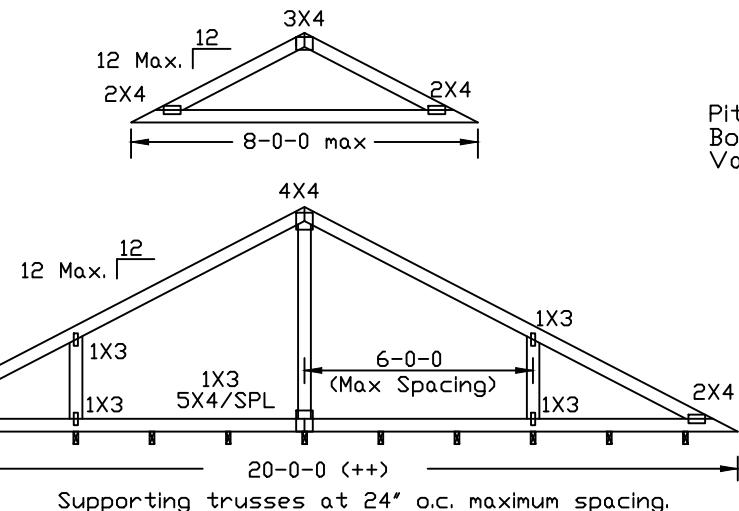


Unless specified otherwise on engineer's sealed design, for vertical valley webs taller than 7'-9" apply 2x4 "T" reinforcement, 80% length of web, same species and grade or better, attached with 10d box (0.128" x 3.0") nails at 6" o.c. In lieu of "T" reinforcement, 2x4 Continuous Lateral Restraint applied at mid-length of web is permitted with diagonal bracing as shown in DRWG BRCLBANC1014.

Top chord of truss beneath valley set must be braced with:
 properly attached, rated sheathing applied prior to valley truss
 installation.

Or
 Purlins at 24" o.c. or as otherwise specified on engineer's sealed design
 Or
 By valley trusses used in lieu of purlin spacing as specified on
 Engineer's sealed design.

*** Note that the purlin spacing for bracing the top chord of the truss
 beneath the valley is measured along the slope of the top chord.

++ Larger spans may be built as long as the vertical height does
 not exceed 14'-0".

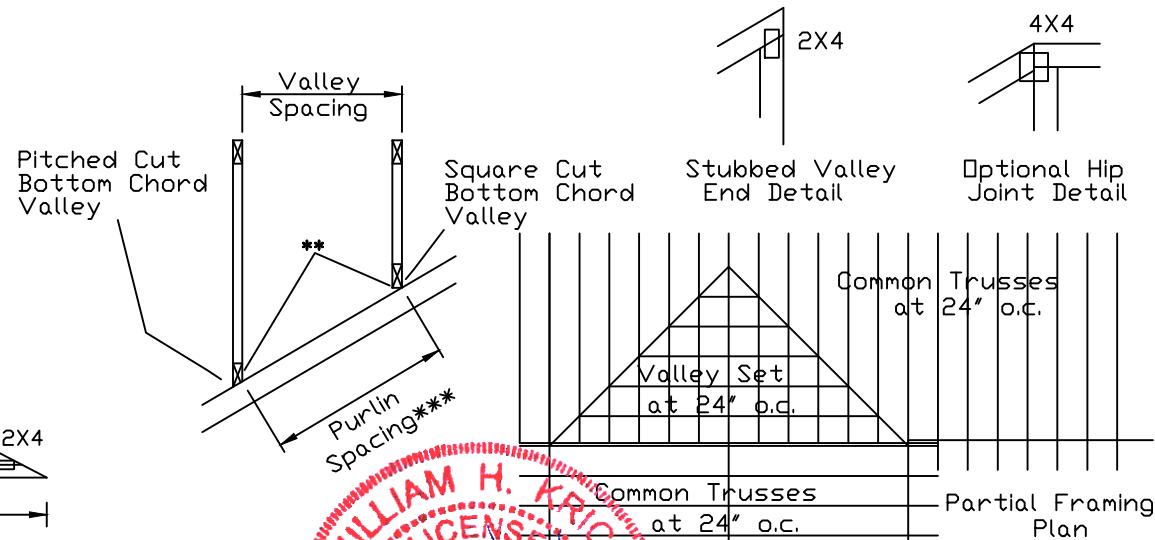

155 Harlem Ave
 North Building, 4th Floor
 Glenview, IL 60025

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
 IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpineitw.com; TPI: www.tpiinst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

REF	VALLEY DETAIL
TC LL	30 30 40PSF
TC DL	20 15 7PSF
BC DL	10 10 10 PSF
BC LL	0 0 0 PSF
TOT. LD.	60 55 57PSF
DUR. FACT.	1.25/1.33
COA #	278
Florida Certificate of Product Approval #	FL 999
SPACING	24.0

Valley Detail - ASCE 7-22: 30' Mean Height, Enclosed, Exp. C, Kzt=1.00

Top Chord 2x4 SP #2N, SPF #1/#2, DF-L #2 or better.
 Bot Chord 2x4 SP #2N or SPF #1/#2 or better.
 Webs 2x4 SP #3, SPF #1/#2, DF-L #2 or better.


** Attach each valley to every supporting truss with:
 (2) 16d box (0.135" x 3.5") nails toe-nailed for
 ASCE 7-22, 30' Mean Height, Enclosed Building, Exp. C,
 Wind TC DL=5 psf, Kzt = 1.00, Max. Wind Speed based on
 supporting truss material at connection location:
 140 mph for SP (G = 0.55, min.),
 125 mph for DF-L (G = 0.50, min.), or
 105 mph for HF & SPF (G = 0.42, min.).

Maximum top chord pitch is 10/12 for supporting trusses
 below valley trusses.

Bottom chord of valley trusses may be square or
 pitched cut as shown.

Valleys short enough to be cut as solid triangular
 members from a single 2x6, or larger as required,
 shall be permitted in lieu of fabricating from
 separate 2x4 members.

All plates shown are Alpine Wave Plates.

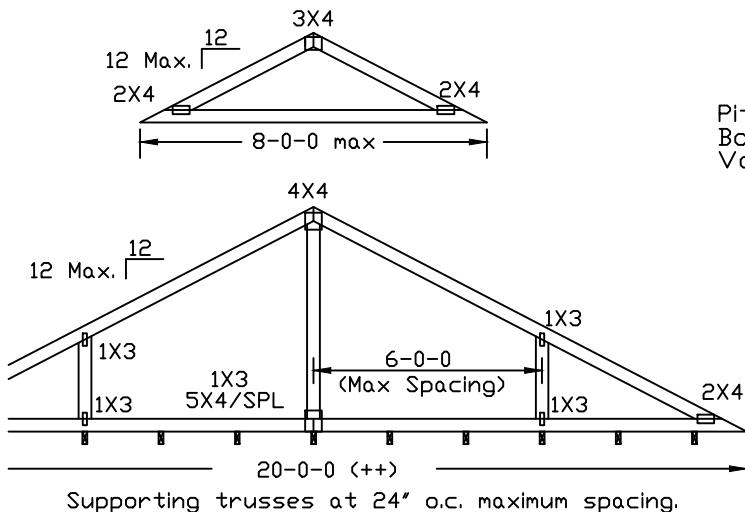

Unless specified otherwise on engineer's sealed design, for vertical valley webs taller than 7-9" apply 2x4 "T" reinforcement, 80% length of web, same species and grade or better, attached with 10d box (0.128" x 3.0") nails at 6" o.c. In lieu of "T" reinforcement, 2x4 Continuous Lateral Restraint applied at mid-length of web is permitted with diagonal bracing as shown in DRWG BRCLBANC1014.

Top chord of truss beneath valley set must be braced with:
 properly attached, rated sheathing applied prior to valley truss
 installation.

Or


Purlins at 24" o.c. or as otherwise specified on engineer's sealed design

Or

By valley trusses used in lieu of purlin spacing as specified on
 Engineer's sealed design.

*** Note that the purlin spacing for bracing the top chord of the truss
 beneath the valley is measured along the slope of the top chord.

++ Larger spans may be built as long as the vertical height does
 not exceed 14'-0".

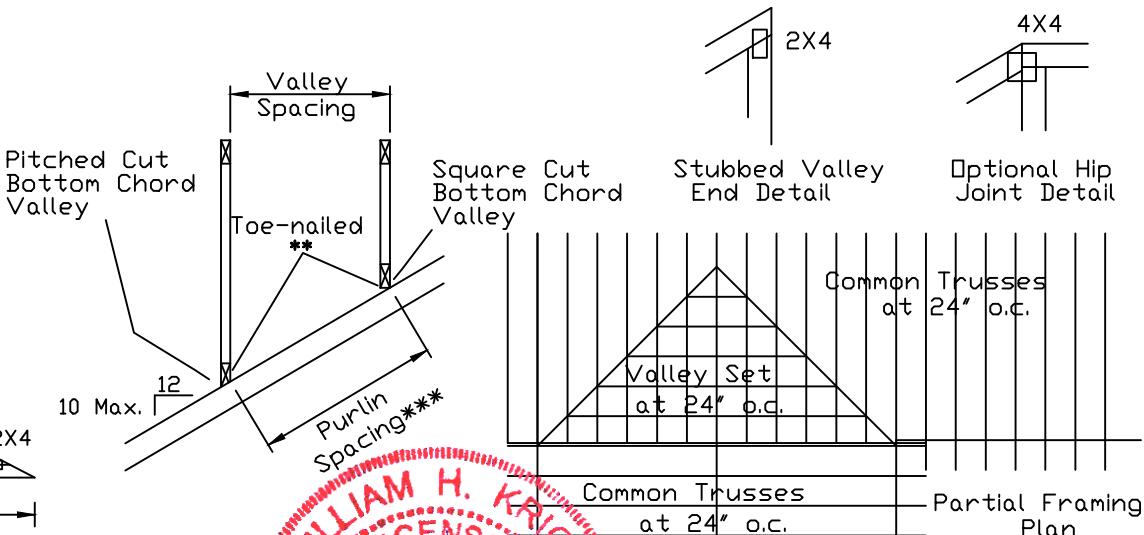

155 Harlem Ave
 North Building, 4th Floor
 Glenview, IL 60025

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING

IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing, and bracing. Refer to end follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpinetw.com; TPI: www.tpihst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

No. 70861

STATE OF
 FLORIDA
 PROFESSIONAL ENGINEER

COA # 0278

Florida Certificate of Project Approval # FL 1999

TC LL	30	30	40PSF	REF	VALLEY DETAIL
TC DL	20	15	7PSF	DATE	07/03/2023
BC DL	10	10	10 PSF	DRWG	VALTN220723
BC LL	0	0	0 PSF		
TOT. LD.	60	55	57PSF		
DUR/PC(125/1.33	1.15	1.15			
SPACING	24"				

Gable End Wind Bracing Details - Stiffback w/ Diagonal Bracing

Apply single or double stiffback as per Engineer's sealed truss design referencing this detail.




Refer to Engineer's sealed truss design for additional information not provided on this detail.

The required locations for lateral restraint or bracing depicted on this detail are for the permanent lateral transfer and support to transfer load and reduce buckling lengths. Details shall be specified by the Building Designer or other Registered Design Professional. This Detail does not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed, and detailed by the Building Designer.

Refer to Building Designer for conditions not addressed by this detail.

Gable Lateral Bracing Components

- (A) Stiffback. Provide connection to each intersecting stud and chord.
- (B) L-reinforcement. Provide connection to narrow edge of stiffback.
- (C) Diagonal brace. Provide connection to gable stud at bottom end and to blocking at top end.
- (D) Blocking, cut to fit tight between trusses. Attach blocking to trusses at each end and to roof sheathing.

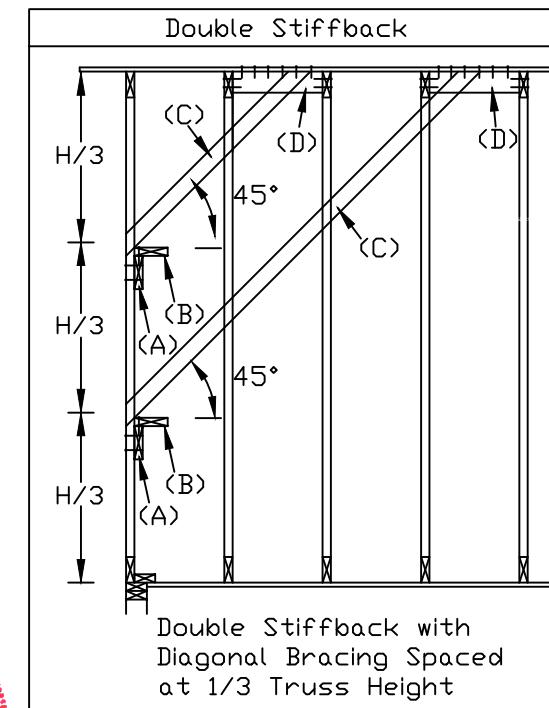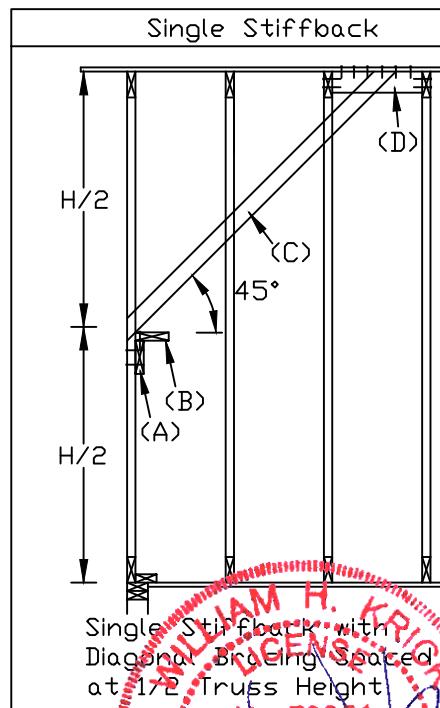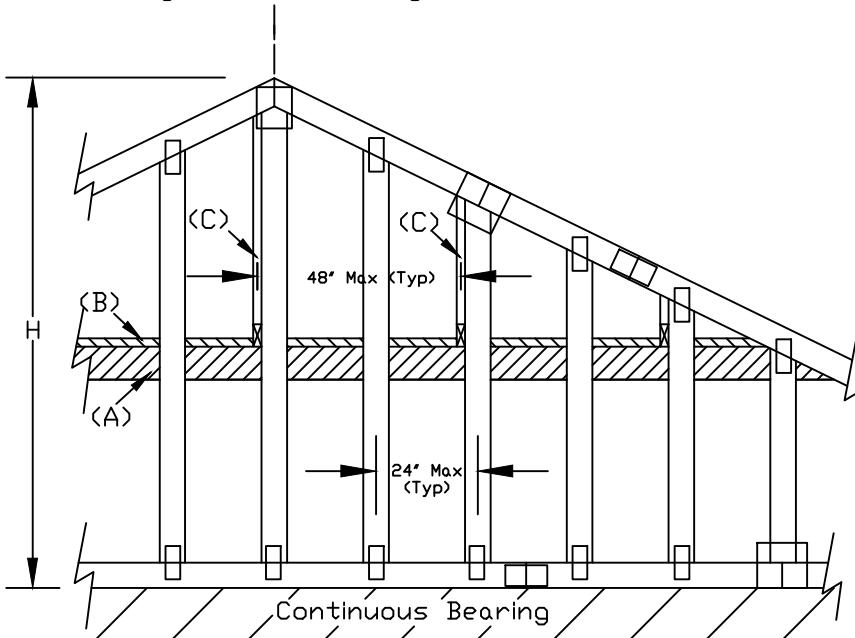

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached right ceiling. Locations shown for permanent lateral restraint or webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpiinst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

NO. 70851

STATE OF
PROFESSIONAL ENGINEER

MAX. TOT. LD.

10/06/2025

COA #0 278

Florida Certificate of Product Approval #FL 1999

MAX. SPACING

REF	GE STIFFBACK
DATE	09/27/2023
DRWG	GBLDIAG220923