




ELECTRICAL LEGEND	
CEILING FAN (PRE-WIRE FOR LIGHT KIT)	
DOUBLE SECURITY LIGHT	
2X4 FLUORESCENT LIGHT FIXTURE	
RECESSED CAN LIGHT	
BATH EXHAUST FAN WITH LIGHT	
BATH EXHAUST FAN	
LIGHT FIXTURE	
DUPEX OUTLET	
220V OUTLET	
GFI DETECTOR OUTLET	
SMOKE DETECTOR	
WALL SWITCH	
3 WAY WALL SWITCH	
4 WAY WALL SWITCH	
WATER PROOF GFI OUTLET	
PHONE JACK	
TELEVISION JACK	
GARAGE DOOR OPENER	
CARBON MONOXIDE ALARM	

- ELECTRICAL PLAN NOTES**
- 1- ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT WIRE AS APPLICABLE, SPECIFICATIONS.
- 2- CONSULT THE OWNER FOR THE NUMBER OF SEPARATE TELEPHONE LINES TO BE INSTALLED.
- 3- ALL INSTALLATIONS SHALL BE PER N.E.T.C. ELECTRICAL CODE.
- 4- ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERCONNECTED TOGETHER, INSTALL INSIDE AND NEAR ALL BEDROOMS.
- 5- DEVICES OR OUTLETS SHALL BE AS PER THE OWNERS DIRECTIONS, IN ACCORDANCE W/ APPLICABLE SECTIONS OF N.E.C. LATEST EDITION.
- 6- ELECTRICAL CONTR. SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- 7- ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
- 8- ALL 120V-1LT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SHALL BE INSTALLED IN DWELLING UNIT FAMILY ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DINING ROOMS, KITCHENS, RECREATION ROOMS, LOBBIES, HALLWAYS OR AREAS SHALL BE PROVIDED BY A LISTED AND-INTERFERENCE, COMBINATION-TYPE INSTALLED TO PROVIDE PROTECT THE BRANCH CIRCUIT.
- 9- ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION
- 10- A SERVICE DISCONNECT W/ OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING
- 11- INSIDE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL
- 12- A POSSIBLE FLOODING HAZARD ON APPLIANCE, A FIREPLAC OR ATTACHED GRAZE
- 13- ALL OUTLETS LOCATED IN RESIDENTIAL
- 14- ALL OUTLETS LOCATED IN RESIDENTIAL

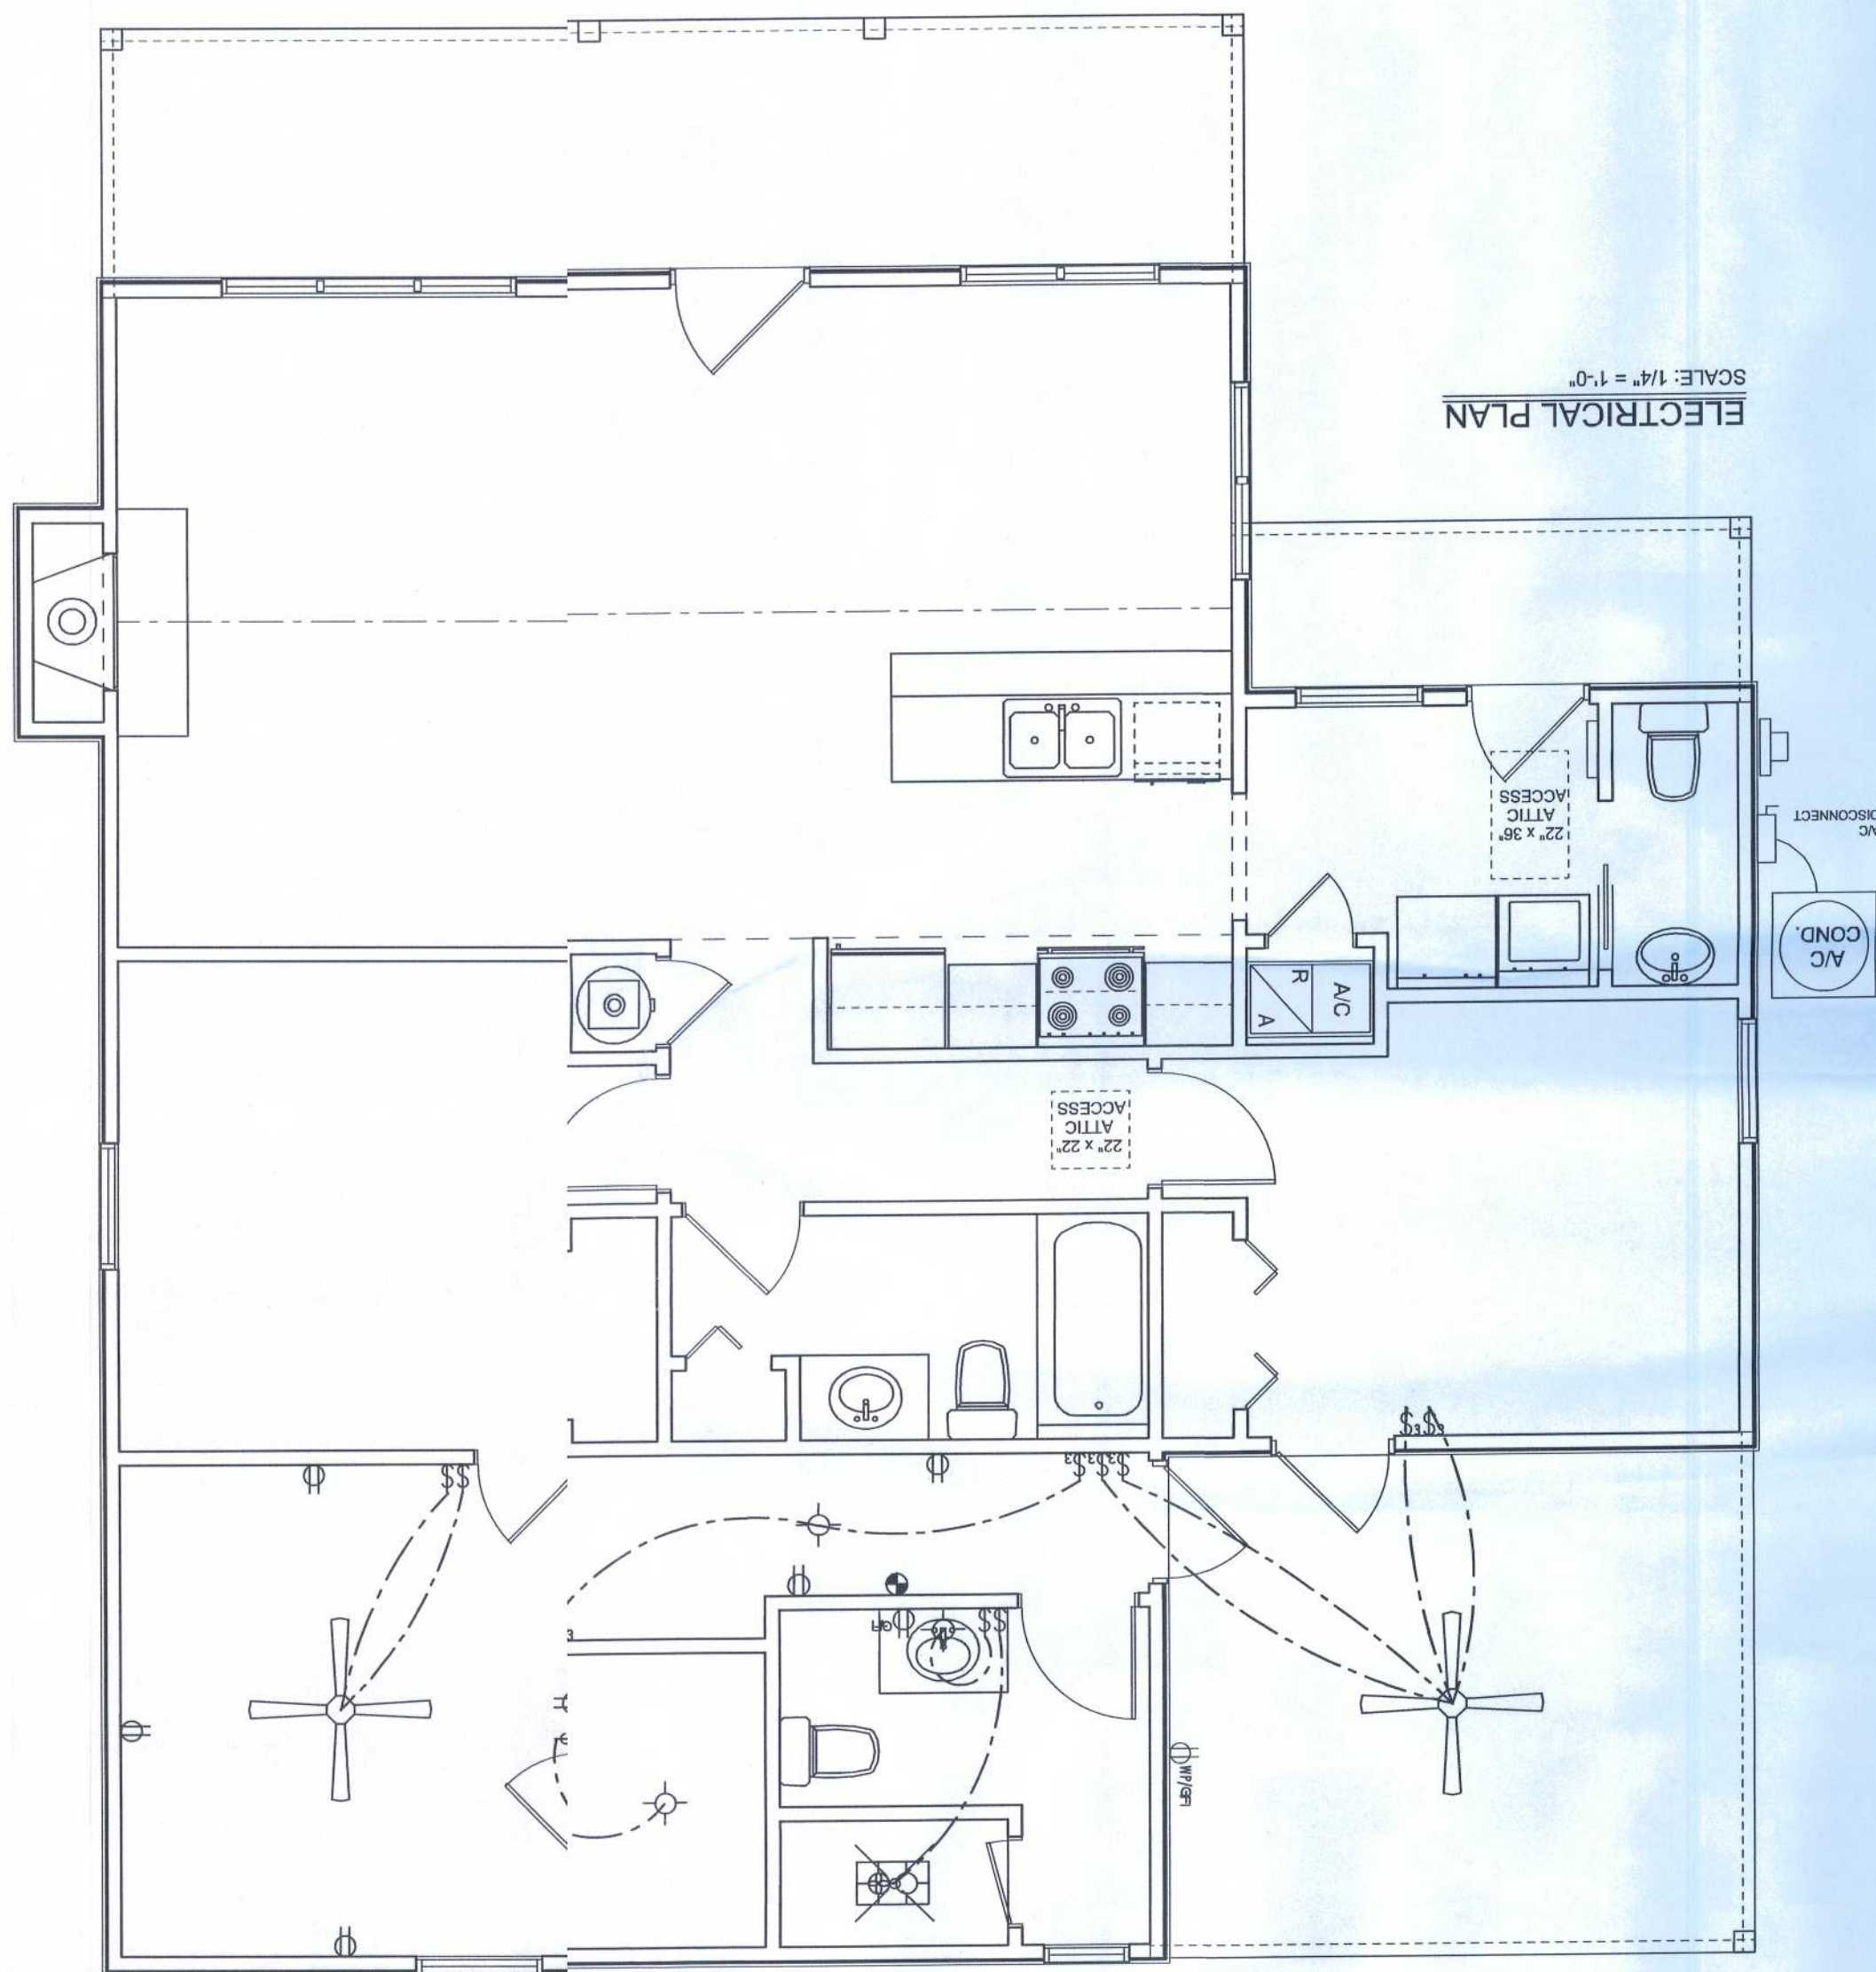