

## CODES AND STANDARDS














1. WIND LOADS AS PER:  
A. FLORIDA RESIDENTIAL BUILDING CODE 7TH EDITION (2020) WITH AN ULTIMATE DESIGN WIND SPEED OF 150 MPH, EXPOSURE B, NOMINAL DESIGN WIND SPEED OF 117 MPH, BUILDING RISK CATEGORY I.
2. ROOF LIVE LOAD DESIGN IS 20 PSF.
3. THE PROJECT WAS DESIGNED IN ACCORDANCE WITH THE:  
A. FLORIDA BUILDING CODE 7TH EDITION (2020).
3. MANUAL OF STANDARD PRACTICE FOR WELDING REINFORCING STEEL, INSERTS & CONNECTIONS IN REINFORCED CONCRETE CONSTRUCTION, AWS, D1.4/ LATEST EDITION  
D. SPECIFICATION FOR THE DESIGN, FABRICATION & ERECTION OF STRUCTURAL STEEL FOR BUILDINGS. (AMERICAN INSTITUTE OF STEEL CONSTRUCTION) AISC 15TH EDITION (ASD).
4. MATERIALS AND ASSEMBLY TEST AS FOLLOWS:  
A. EXTERIOR WINDOWS, SLIDING AND PATIO GLASS DOORS SHALL BE TESTED BY AN APPROVED INDEPENDENT TESTING LABORATORY, AND SHALL BE LABELED WITH AN APPROVED LABEL IDENTIFYING THE MANUFACTURER, PERFORMANCE CHARACTERISTICS AND APPROVED PRODUCT CERTIFICATION AGENCY, TESTING LABORATORY, EVALUATION ENTRY OR FLORIDA STATE-WIDE PRODUCT APPROVAL NUMBER TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF ONE OF THE FOLLOWING SPECIFICATIONS:  
ANSI/AAMA/WDMA 101/15, 2-97 OR TIA 202  
ANSI/AAMA/WDMA 101/15, 2-97 OR TIA 202  
B. EXTERIOR DOOR ASSEMBLIES SHALL BE TESTED FOR STRUCTURAL INTEGRITY IN ACCORDANCE WITH ASTM E330 AT A LOAD OF 1.5 TIMES THE REQUIRED DESIGN PRESSURE LOAD.  
C. SECTIONAL GARAGE DOORS SHALL BE TESTED FOR DETERMINATION OF STRUCTURAL PERFORMANCE UNDER UNIFORM STATIC AIR PRESSURE DIFFERENCE IN ACCORDANCE WITH ANSI/DASMA 115 OR TIA 201.202 AND 203.
5. STEEL FRAMES SHALL BE SPACED NO MORE THAN 56" O.C. U.N.O. ON PLAN, ALL TUBE STEEL SHAPE STRENGTHS ARE 46 KSI STEEL, ALL CUPS ARE 56 KSI STEEL.
6. STEEL WELD STRENGTH SHALL BE 55 KSI TYP. ALL WELDS SHALL BE 1/8" MINIMUM FILLET WELDS.
7. ANCHORING BUILDING:  
A. BUILDING SHALL BE ATTACHED WITH HELICAL ANCHORS PER THE HELICAL ANCHOR DETAIL.  
B. WHEN EMBEDDED INTO ASPHALT HELICAL ANCHORS OR 30" LONG #5 REBAR WITH A NUT WELDED TO THE TOP, SHALL BE INSTALLED AT 12" ON CENTER FROM EACH SIDE AND THE BALANCE 6 56" ON CENTER.  
C. WHEN PLACED ON A 4" CONCRETE SLAB, A 1/2" EXPANSION ANCHOR WITH 2-1/2" OF EMBEDMENT SHALL BE INSTALLED 12" FROM EACH SIDE AND THE BALANCE 6 56" ON CENTER. CONCRETE SHALL BE MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS.
8. ALL STEEL-TO-STEEL FASTENERS ARE TO BE 1/2-14 x 1/4 HWU ULTRA-2 TOPS CS.
9. EACH LOCATION WHERE THE FRAME IS JOINED TOGETHER WILL HAVE 2 SCREWS ON EACH SIDE OF THE JOINT.

## WALL AND OPENING PRESSURES COMPONENTS AND CLADDING (ASD)

OPENING TYPE	HEIGHT	WIDTH	CODE
WINDOW	38.3/37"	37"	23
DOOR	96"	36"	5-750
DOOR	96"	72"	5-750
DOOR	96"	104"	5-750
DOOR	96"	120"	5-750
DOOR	96"	144"	5-3100
TYPE	MATERIAL	PRESSURE (PSF)	
SINGLE HUNG	ALUM*	+21.0 / -28.1	
SINGLE CURTAIN	STEEL	+20.1 / -26.3	
SINGLE CURTAIN	STEEL	+19.2 / -24.6	
SINGLE CURTAIN	STEEL	+18.6 / -23.4	
SINGLE CURTAIN	STEEL	+18.2 / -22.6	
SINGLE CURTAIN	STEEL	+18.1 / -22.2	

• PROVIDE BARRIER BETWEEN ALUMINUM AND STEEL TO PREVENT CORROSION

CONNECTOR SCHEDULE			
CONNECTION	Ø	LENGTH	TYPE
METAL SIDING ROOF	1/4"	3/4"	SELF-TAPPING
METAL SIDING WALL	1/4"	3/4"	SELF-TAPPING
TUBE TO TUBE	1/4"	3/4"	SELF-TAPPING
MATERIAL			
SPACING			
GALV. METAL SCREW	1.5" FROM EACH CORNER, 10" O.C.		
GALV. METAL SCREW	1.5" FROM EACH CORNER, 10" O.C.		
GALV. METAL SCREW	(2) PER TUBE		

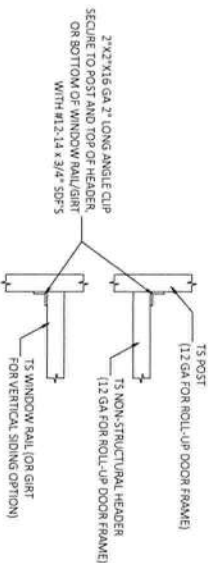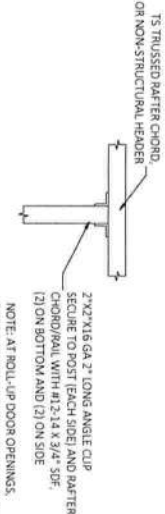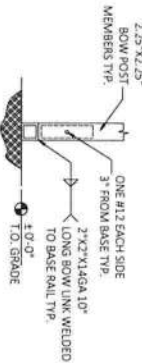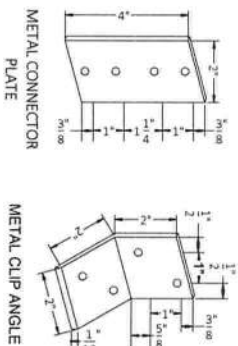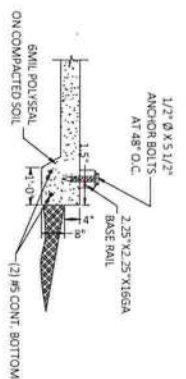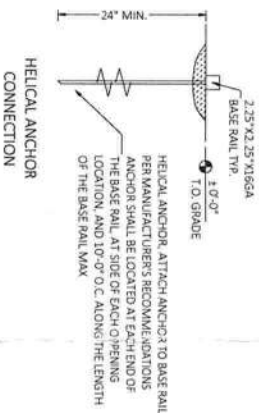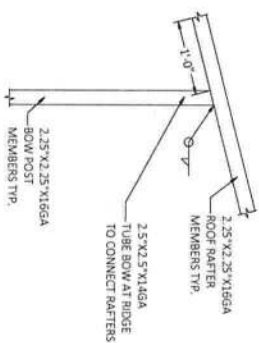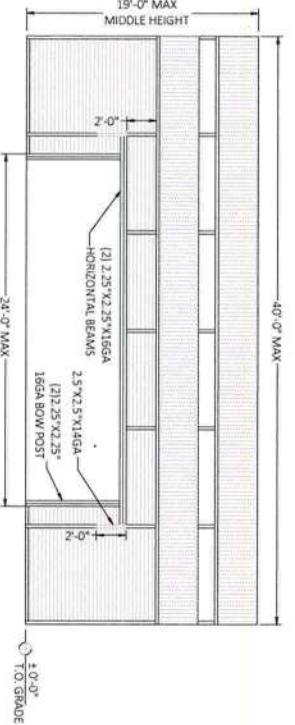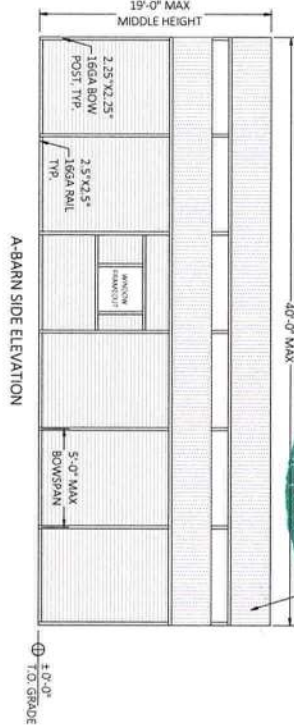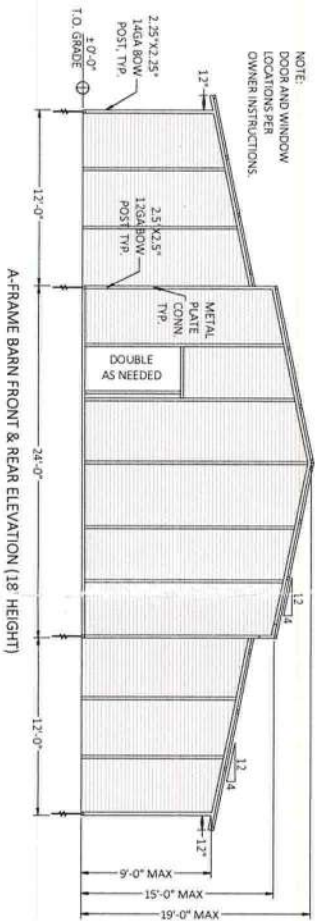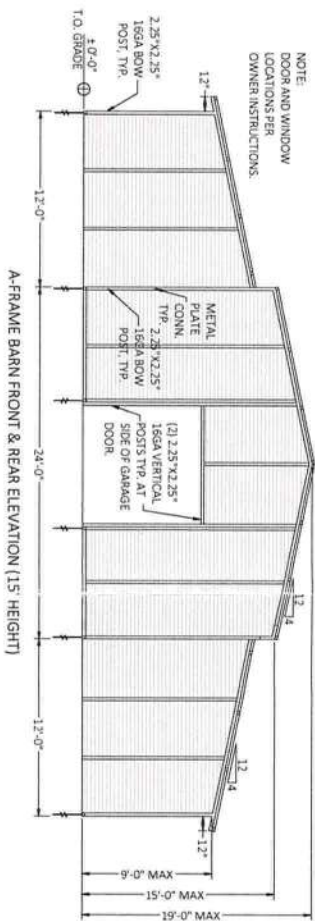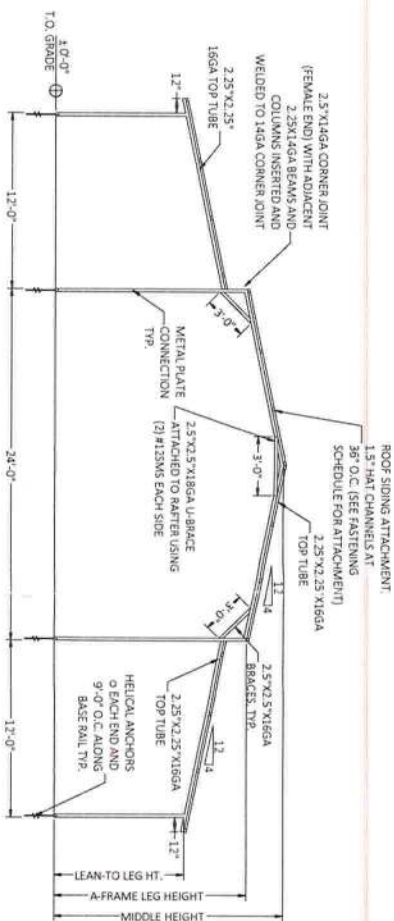

THE CARPORT COMPANY  
945 NW 17TH AVE  
OCALA FL 34475

PROJECT ADDRESS:

## GENERIC PLANS

**FLORIDA ENGINEERING LLC**  
**4161 TAMiami TRAIL, UNIT 101**  
**PORT CHARLOTTE, FLORIDA 33952**  
**(941) 391-5980**  
**FLEng.com**  
**Orders@FLEng.com**

CA CERT. #30782

Craig E. Gunderson, P.E. #60102

DATE: 03/21/2023

DESIGN DATE:	03/21/2023	P,
REVISION 1:	DATE	
REVISION 2:	DATE	
SCALE:	NTS	

1