

GENERAL CONSTRUCTION NOTES:

- Pool installation shall be by a qualified and licensed (approved by local building department and San Juan pools) pool contractor. The installation shall conform to all state and local building codes, as well as tenants of any association with Jurisdiction.
- Water supply and disposal shall be so arranged that there is no cross connection with domestic service.
- Main drain cover to be certified as compliant with ANSI/ASME A112.19.8M or a grate with a minimum open area of 144 sq. in. or as to local codes, securely fastened in place.
- Pool turnover shall be 12 hours maximum with cartridge filter and properly grounded approved pump (min. 1/2 hp per 50 GPM at 55 TDH.) Pool pump to be above ground with weather protective housing.
- All electric shall conform to N.E.C. No overhead wires shall pass within 10 feet of pool.
- Concrete shall be min. 2500 psi at 28 days. Deck Slab to have 6x6, #10/10wmm or equal suspended in conc. Fiberglass conc. may be used in lieu of 6x6 10x10 wmm as allowed by local code.
- Pool bottom to be placed in 4" min. sand or 3/8" max dia stone.
- Hydrostatic pressures: design assumes pool is full at all times, with any required hold downs and reinforcing by others.
- Hydrostatic relief valve not credited for more than 2 feet of the difference of head between pool bottom and floor criteria level, use where code requires.
- Pool shall bear on undisturbed soil, free of peat, muck or other deleterious material of any significant amount.
- Backfill shall have bearing value greater than 60 PSF with Vertical angle of Repose. Back-fill material must not contain rocks that could damage pool walls. Back-fill shall be installed and compacted in lifts to match water level in pool and not deform pool.
- Steps or ladders shall be provided at each end of pool per code.
- Pool ladders shall be corrosion resistant with non-slip treads. Hand rails and ladders shall have No. 8 solid copper grounds and Solidly imbedded anchors.
- Steps, treads and risers shall conform to local codes when different than that shown.
- Therapy seats, where installed, shall be recessed in to the sides of such pool not more than 20 inches below water level, and in such a manner as to clearly distinguish such underwater obstructions from pool areas in to which persons may dive.
- Swimming pool skimmer(s) shall have deck openings.
- Electrical hook-up of pool equipment, rails, boxes, etc. and grounding of deck steel shall be in accordance with the National Electrical Code and all applicable state and local building codes by a licensed electrical contractor.
- Install 12 volt light. When allowed by local code. Higher voltage shall be GFI protected per NEC. At installers option LED or Fiberoptic Lighting may be used.
- If the slope from shallow end to deep end is more than 1:7 a safety rope shall be provided when required.
- Supports and steps shall be properly reinforced and of sufficient structural strength to safely carry all anticipated loads.
- All pipe to be PVC schedule40 suitable for potable water, or to local code.
- Direct suction pipes from the pool shall have Secondary Reliefs.
- Max. velocity in pressure piping to be 10' per second.
- Max. velocity in suction piping to be 8' per second.


POOL EQUIPMENT AND PROPERTIES

Quantity	Item	Manufacturer
*	Inlet-Return 1 1/2" or 2" 10-3300 WHT	Hydro Air or Equal.
*	Inlet-Directional Flow white cycloc "Hydro-stream" with 1/2" hole, Model SP-1419-C	Hayward MFG. Co. or Equal.
*	Main Drain Anti-Entrapment Model 640-359X-V	Waterway or Equal.
*	Sump line Model	Hayward MFG. Co. or Equal.
*	Skimmer Model SP-1076	Hayward MFG. Co. or Equal.
*	Niche Light Assembly PVC SP607 with 1" Conduit connection	Hayward MFG. Co. or Equal.
*	Light Assembly 100 watt, 12 volt with Power Cord or LED light	American Products Co. or Equal.


*Quantities Specified at Construction

Typical properties of a REINFORCED FIBERGLASS pool:


Barcol hardness of 30 mil gel coat	40 - 50
Glass content by weight	27%
Tensile strength, PSI at 77 F	19,200
1" - 2"	1 - 2%
Flexural strength, PSI at 77 F	23,800 - 27,600
Flexural modulus, PS x 10 at 77 F	0.72 - 0.77
Izod Impact FT-LBS/inch of notch	5.9
Compressive strength, PSI	25,000 to 38,000
Typical thickness inches	3/8"

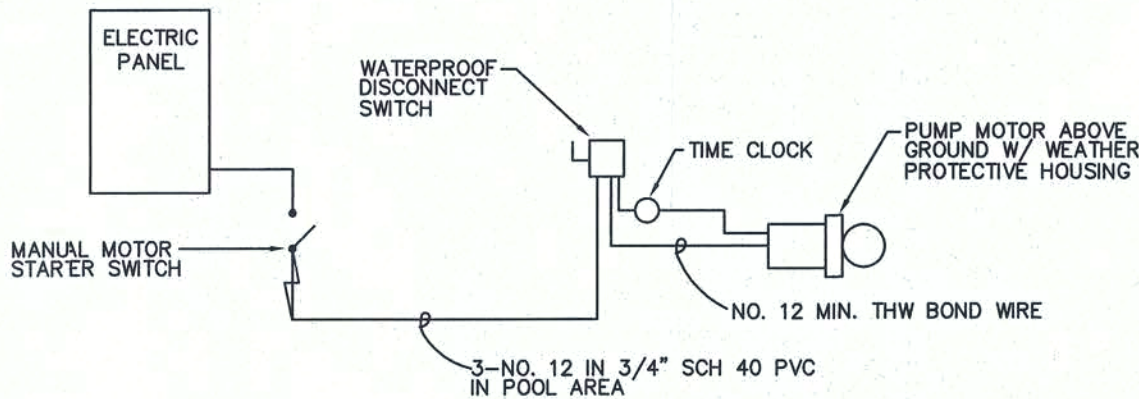


ELECTRICAL DIAGRAM
NTS

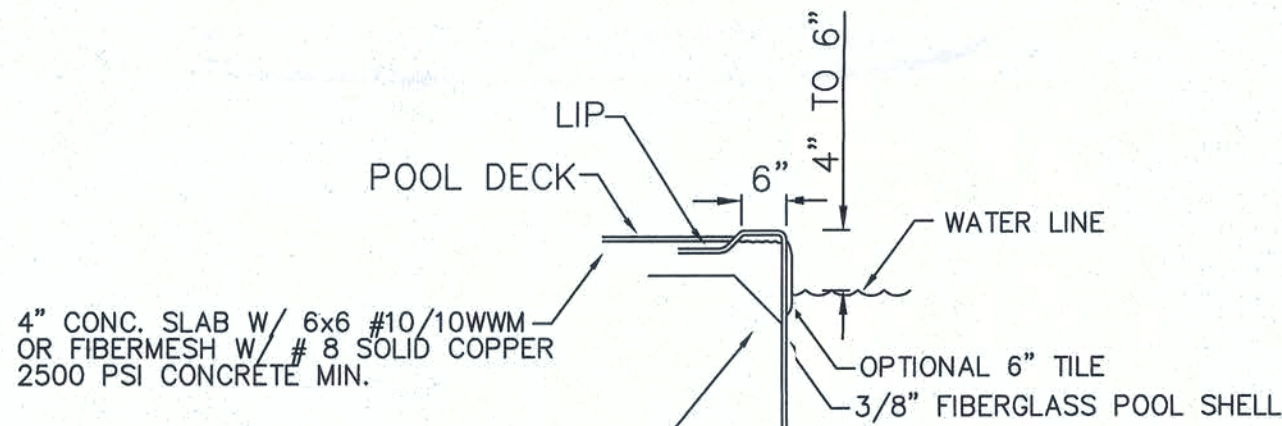


ALTERNATE COPING DETAIL
NOT TO SCALE

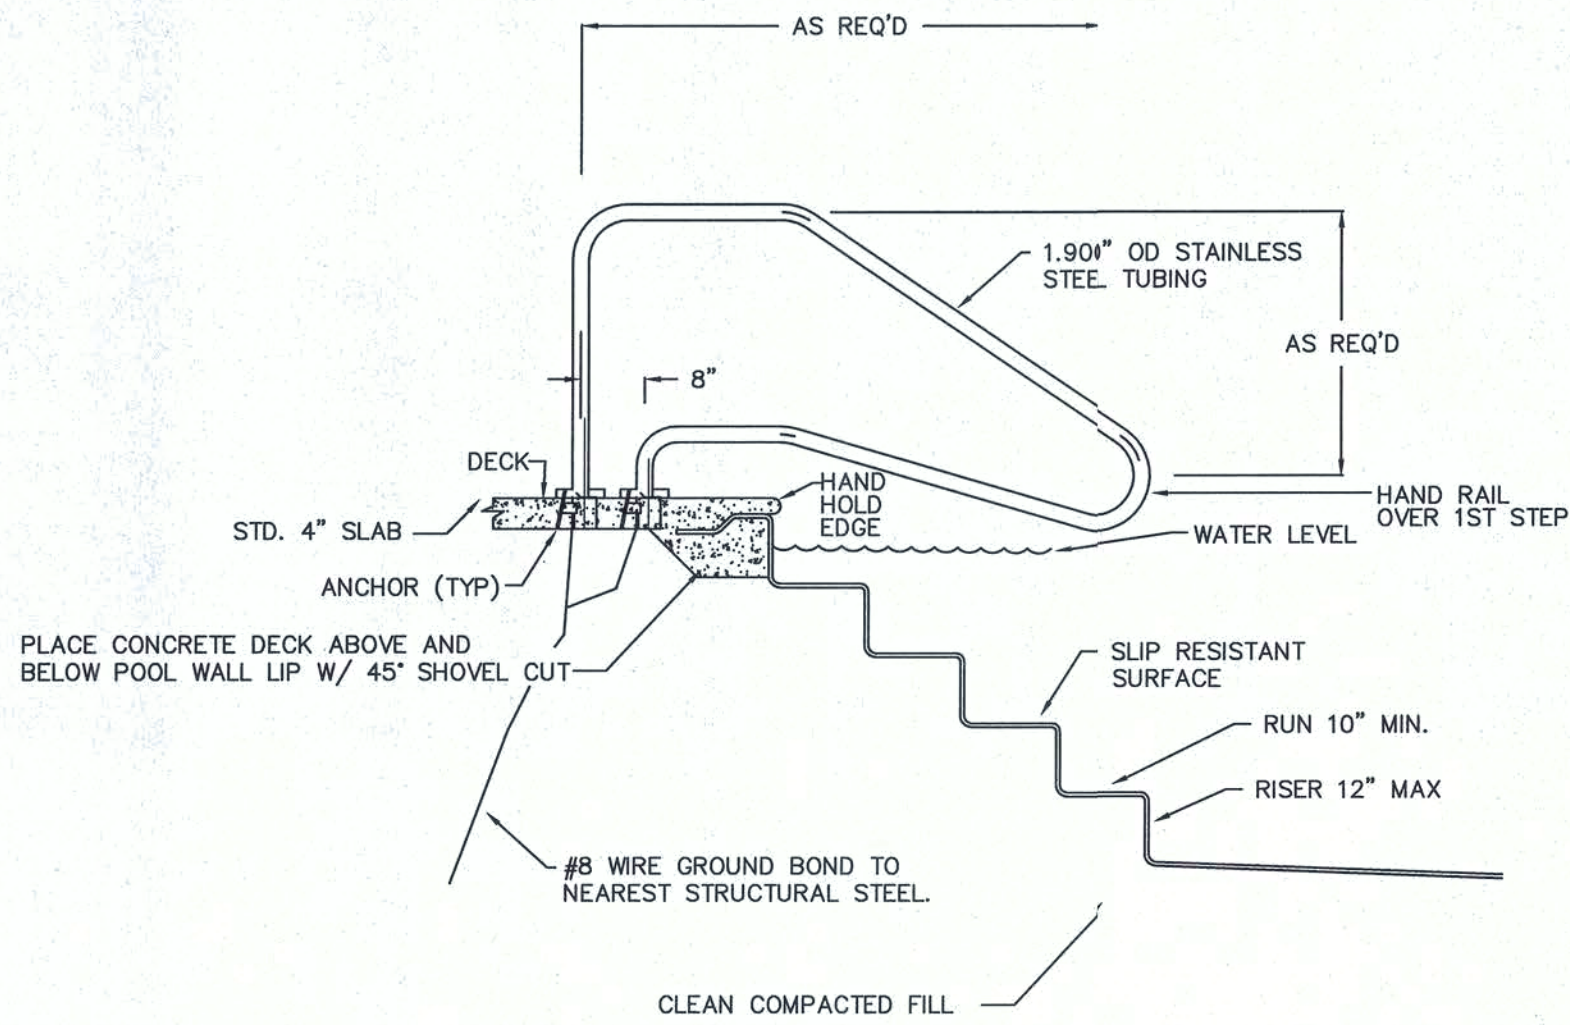

STEP HANDRAIL SECTION
NOT TO SCALE

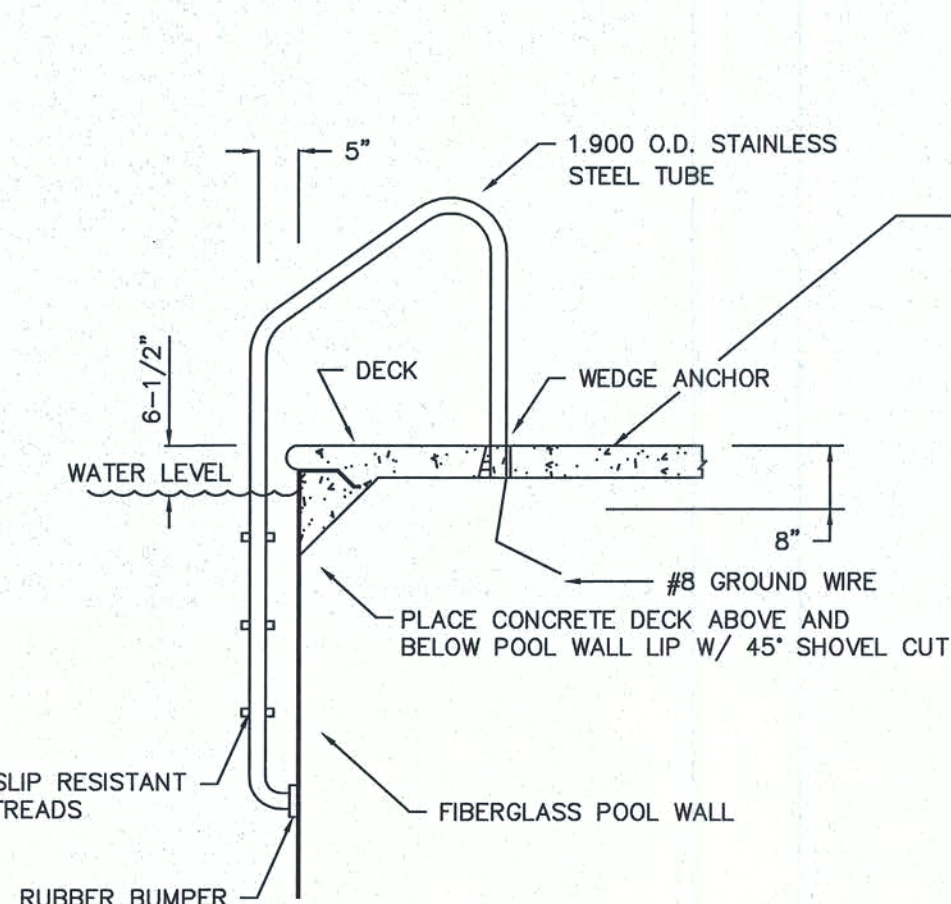


LADDER SECTION
NOT TO SCALE

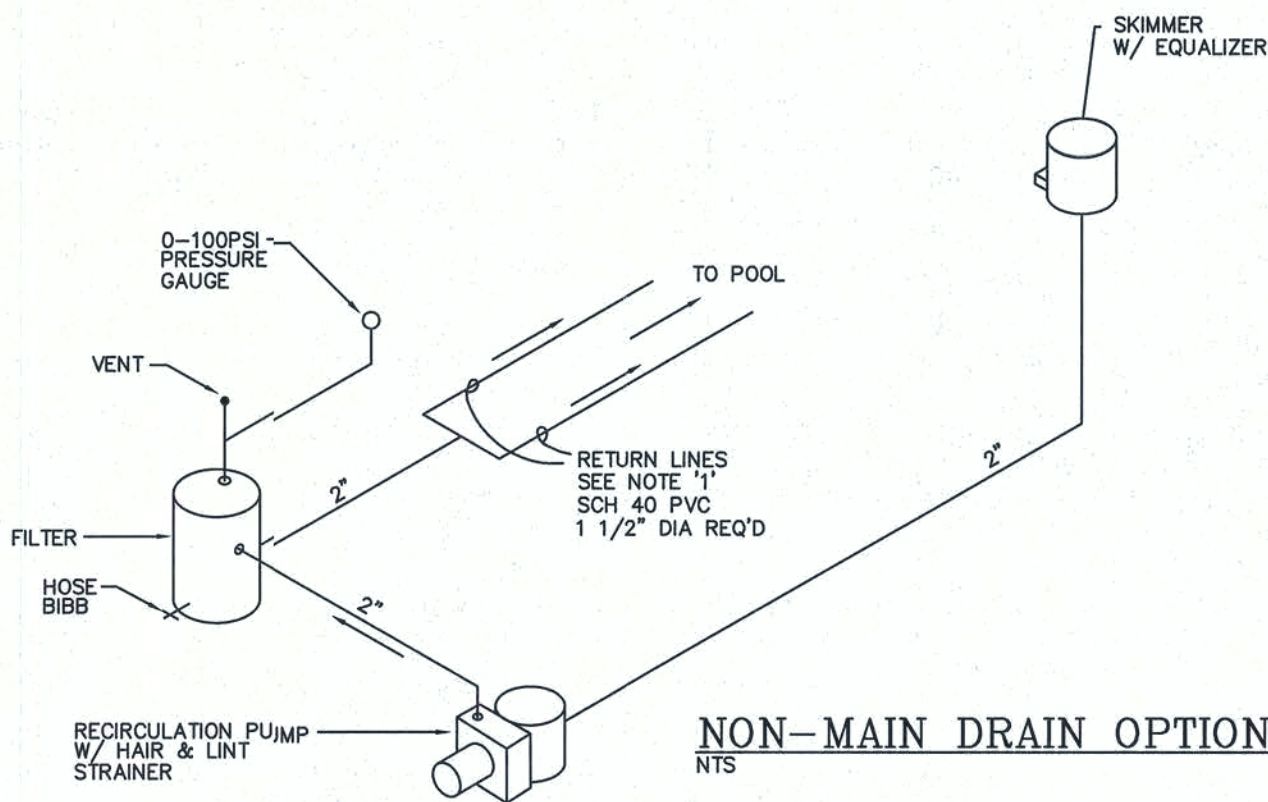

NOTES:


- AT LEAST ONE RETURN LINE IS REQUIRED FOR EVERY 300 SQ. FT. OF SURFACE AREA. MINIMUM SEPARATION OF LINES ENTERING POOL SHALL BE 10 FT.
- SUMP LINE (WHEN REQ'D) TO BE 2" SCH. 40 PVC FROM 4 CUBIC FOOT GRAVEL BED BENEATH MAIN DRAIN TO 18" FROM EQUIPMENT.

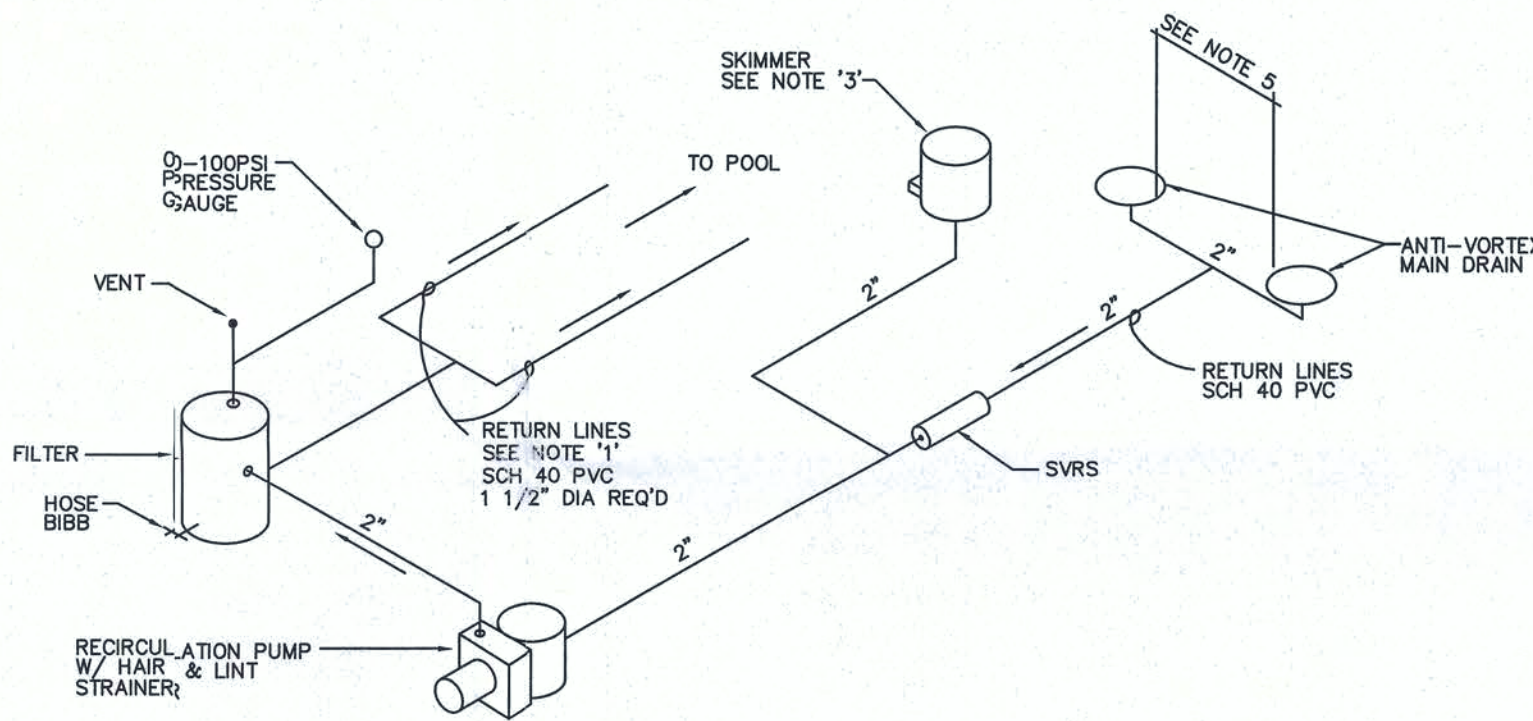


SVRS OPTION
NTS

NOTES:

- AT LEAST ONE RETURN LINE IS REQUIRED FOR EVERY 300 SQ. FT. OF SURFACE AREA. MINIMUM SEPARATION OF LINES ENTERING POOL SHALL BE 10 FT.
- SUMP LINE (WHEN REQ'D) TO BE 2" SCH. 40 PVC FROM 4 CUBIC FOOT GRAVEL BED BENEATH MAIN DRAIN TO 18" FROM EQUIPMENT.
- TWO SKIMMERS REQUIRED IF POOL AREA GREATER THAN 800 SF.
- SKIMMER AND MAIN DRAIN MUST BE PLUMBED TOGETHER WITH A COMMON LINE TO THE PUMP. SKIMMER AND MAIN DRAIN MUST NOT BE VALVED SEPARATELY.
- POOL MUST HAVE MAIN DRAIN MINIMUM 3'-0" APART OR SEPARATED ON DIFFERENT PLANES.
- MAIN DRAINS MUST BE PLUMBED TOGETHER WITH A COMMON LINE TO THE PUMP.

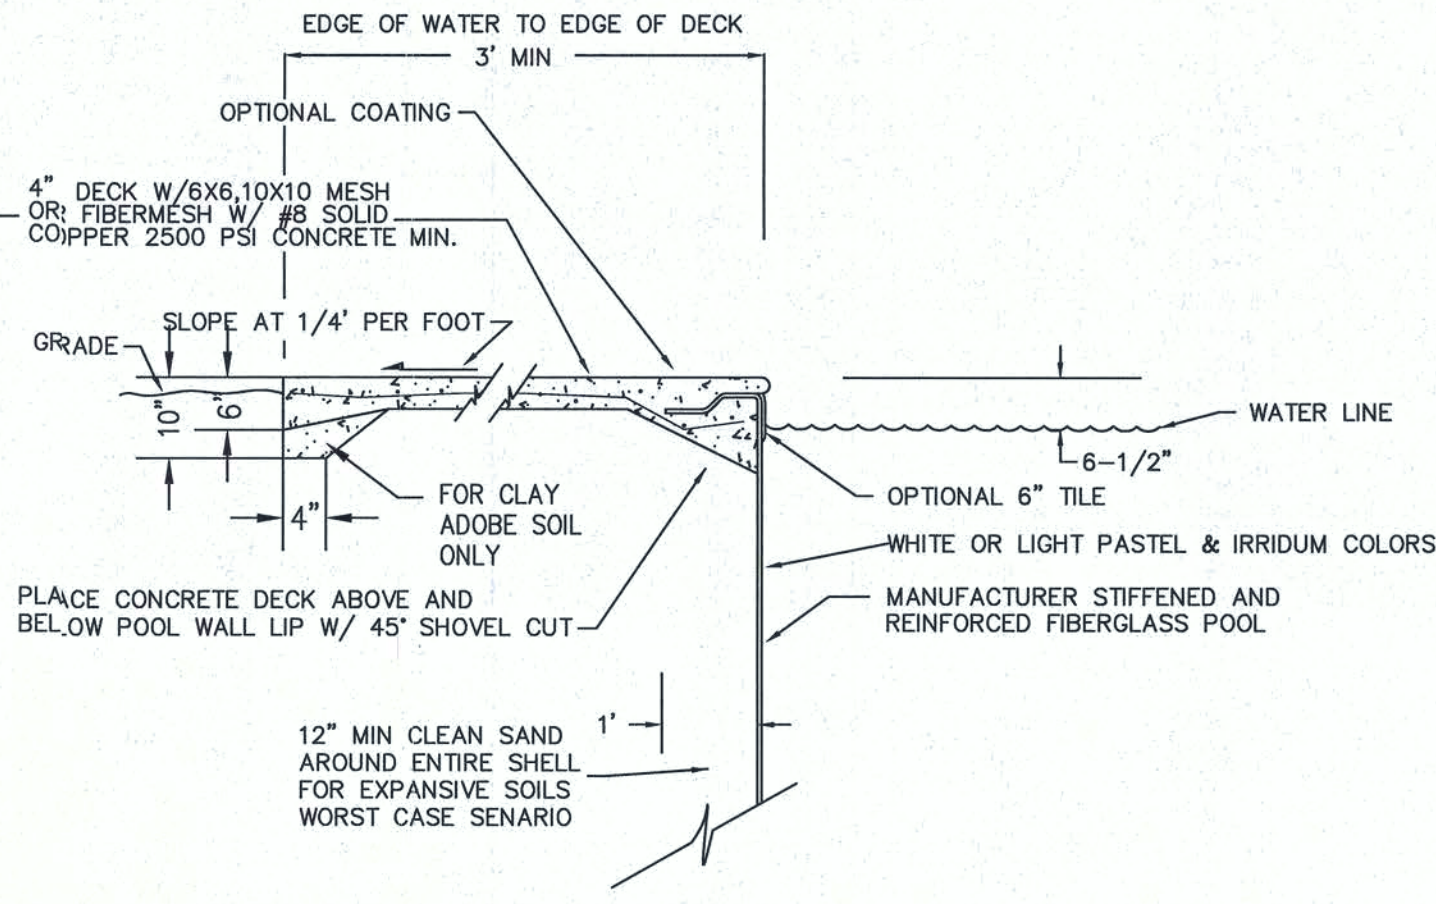


WALL SECTION
NOT TO SCALE

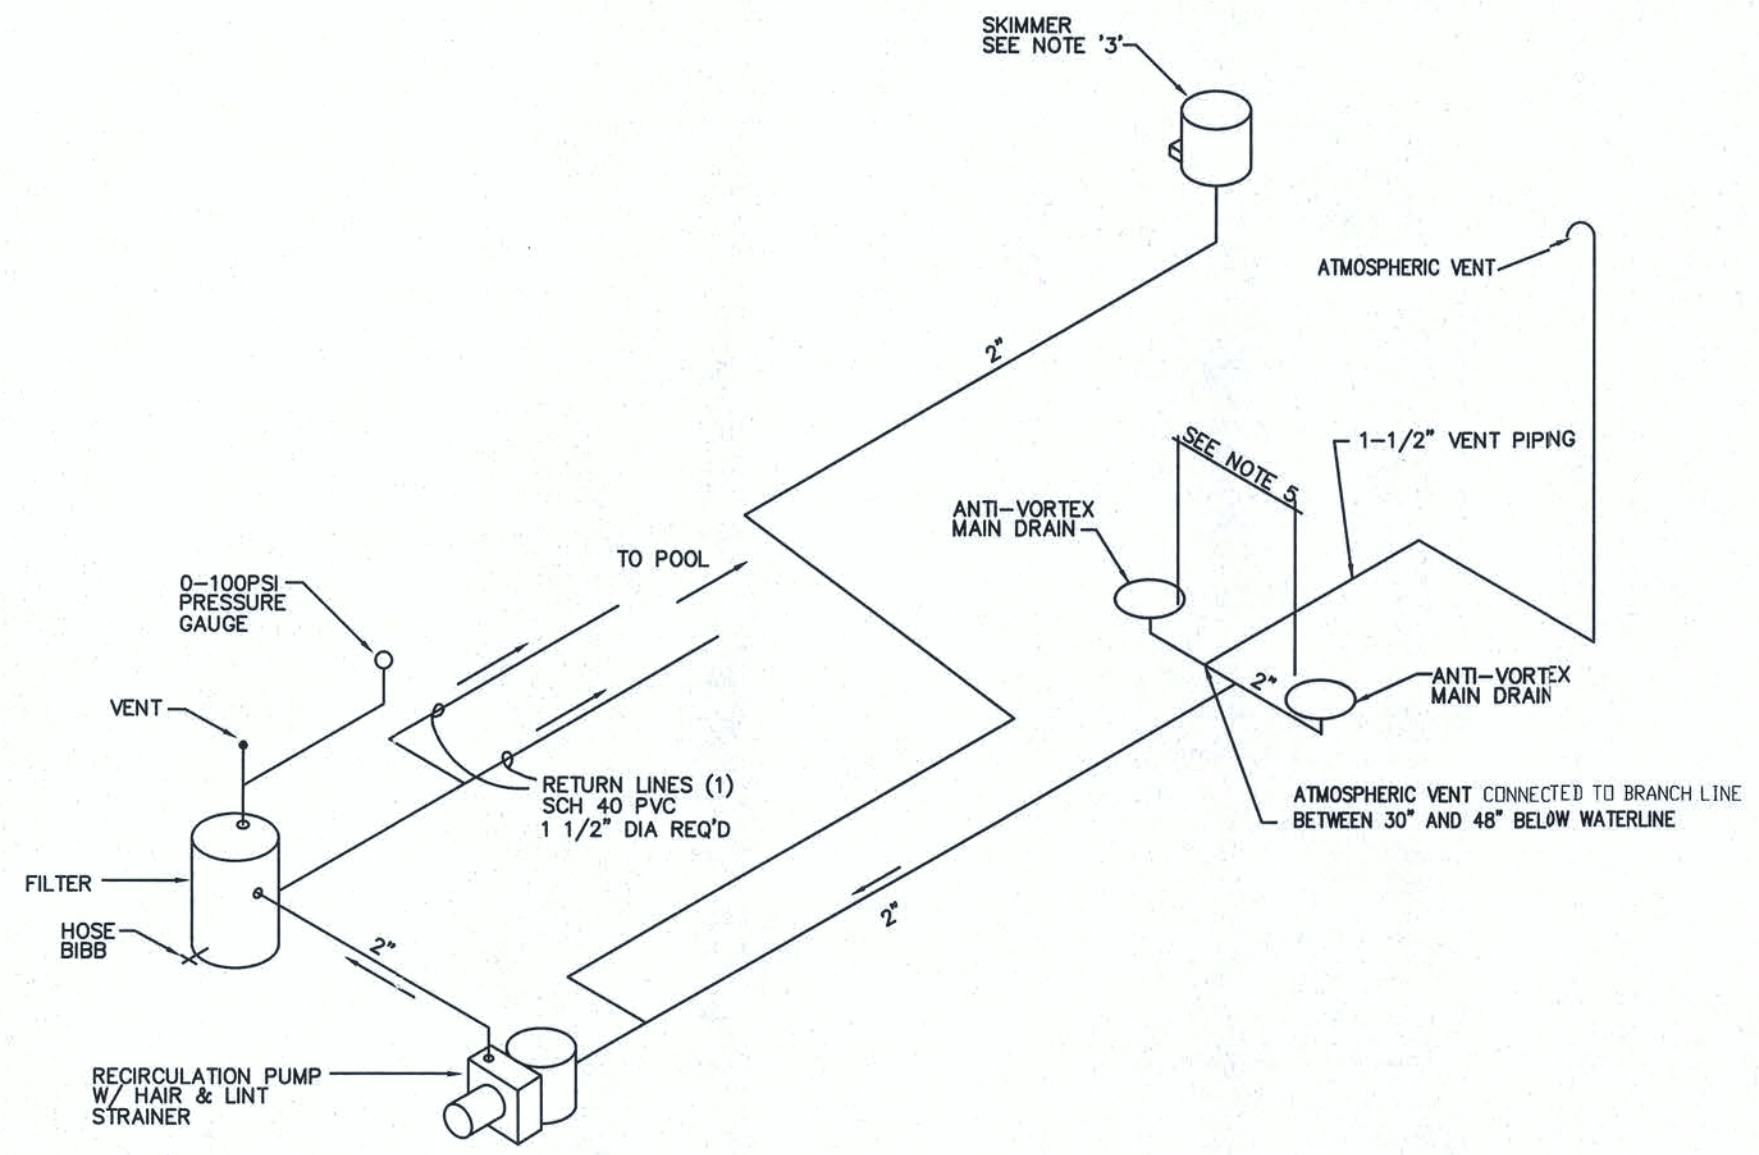

2 MAIN DRAINS W/ VENT OPTION
NTS

NOTES:

- AT LEAST ONE RETURN LINE IS REQUIRED FOR EVERY 300 SQ. FT. OF SURFACE AREA. MINIMUM SEPARATION OF LINES ENTERING POOL SHALL BE 10 FT.
- SUMP LINE (WHEN REQ'D) TO BE 2" SCH. 40 PVC FROM 4 CUBIC FOOT GRAVEL BED BENEATH MAIN DRAIN TO 18" FROM EQUIPMENT.
- TWO SKIMMERS REQUIRED IF POOL AREA GREATER THAN 800 SF.
- MAIN DRAIN LOCATED NEAR DEEPEST PART OF THE POOL.
- POOL MUST HAVE MAIN DRAIN MINIMUM 3'-0" APART OR SEPARATED ON DIFFERENT PLANES.
- MAIN DRAINS MUST BE PLUMBED TOGETHER WITH A COMMON LINE TO THE PUMP.

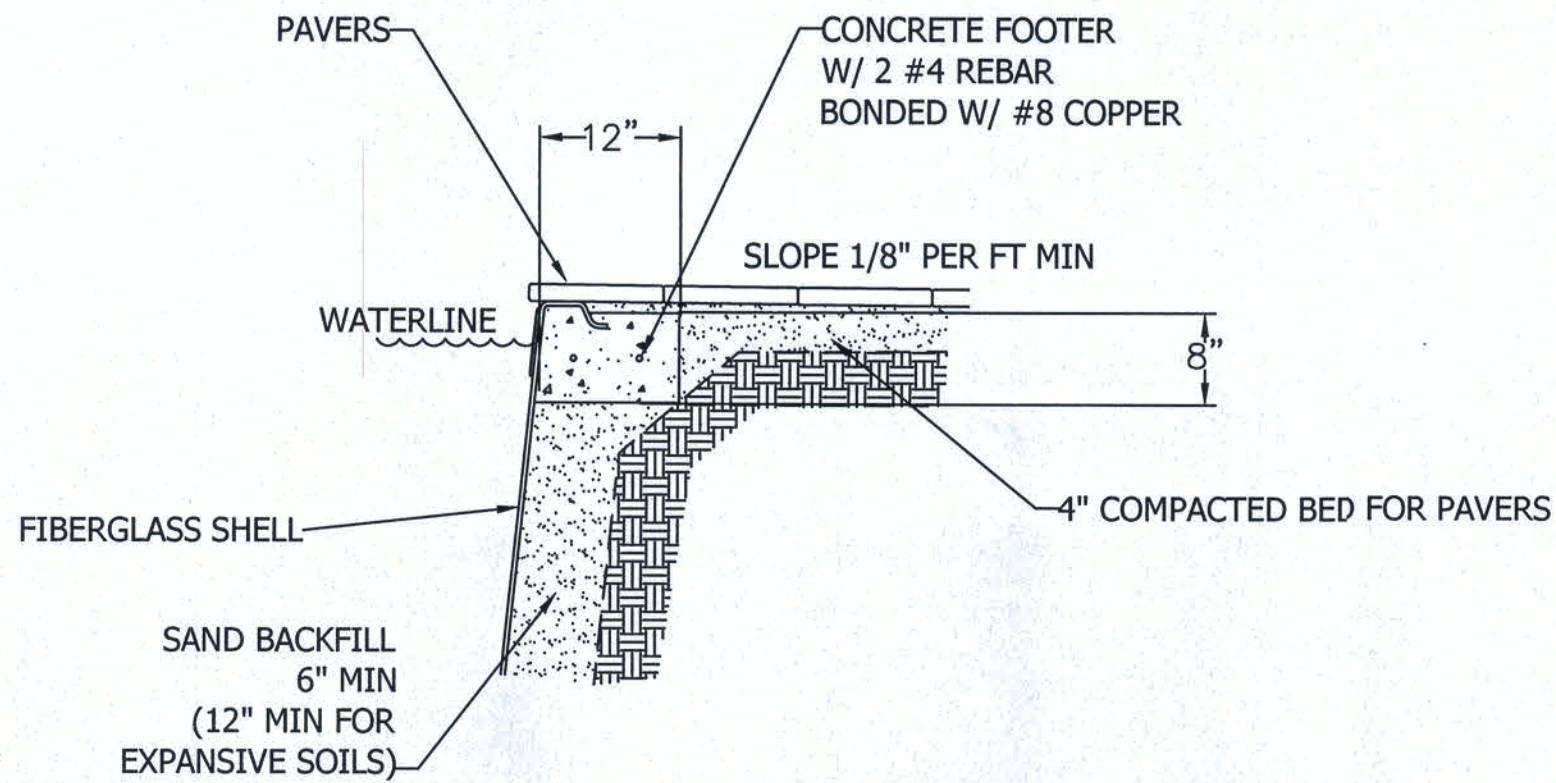

OPTIONAL WALL SECTION
NOT TO SCALE

NOTES:

POOL DESIGN CONFORMS TO THE FOLLOWING:
ANSI/NSPI-3, 5, 7, 15
IAPMO REPORT ER 0298
2017 FLORIDA BUILDING CODE
2017 RESIDENTIAL FLORIDA BUILDING CODE
2017 INTERNATIONAL PLUMBING CODE
2014 NATIONAL ELECTRICAL CODE
2017 MECHANICAL CODE
2017 FLORIDA POOL & SPA CODE

REV	DESCRIPTION	DATE	APRV
AECC/SAN JUAN POOLS			
BY: AMERICAN ENVIRONMENTAL CONTAINER CORP. 2302 LASSO LANE LAKELAND, FLORIDA 33801 (863) 666-3020			
Sealed By Steven W. Schaub State of Florida License No.: 60509			
Date MAY 2019	Checked By KVT	Job No. 1005-19	Pool location:
Title SPECIFICATIONS/DETAILS			Sheet 2 of 2