

CAROL CHADWICK, P.E.

Civil Engineer

1208 S.W. Fairfax Glen

Lake City, FL 32025

307.680.1772

ccpewyo@gmail.com

www.carolchadwickpe.com

October 21, 2025

Austin Bunton

386.361.0203

austinb700@gmail.com

re: ELEVATION LETTER – 862 FIDDLERS LANE, LAKE CITY, FL

As requested, I inspected the building site for the proposed construction at the above referenced site. Per the attached SRWMD map, no floodplains or wetlands are present on the property. Refer to attached site plan by others for the location of the home. The topography of the site drains to the south.

The finished floor elevation of the home shall be 32" above the adjacent ground for the entire perimeter of the foundation. The finished floor of the home will be below required elevation of one foot above the adjacent road.

I certify that the minimum finished floor elevation listed above will protect the structure against water damage from a base flood event, as defined in Article 8 of the Land Development Regulations.

Should you have any questions, please don't hesitate to contact me.


Respectfully,


Carol Chadwick, P.E.

attachments: SRWMD Map & site plan by others

This item has been digitally signed and sealed by Carol Chadwick, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

CC Job #FL25560

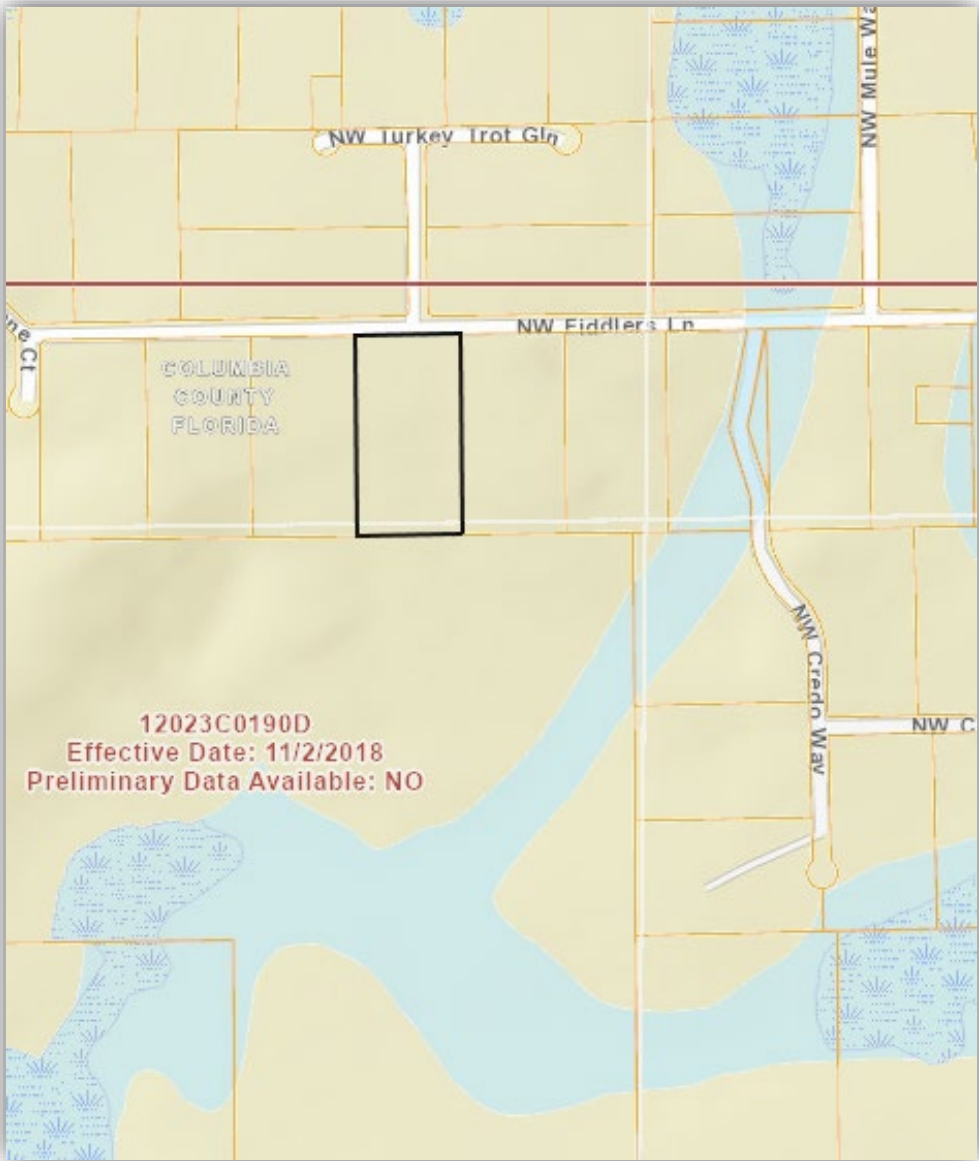

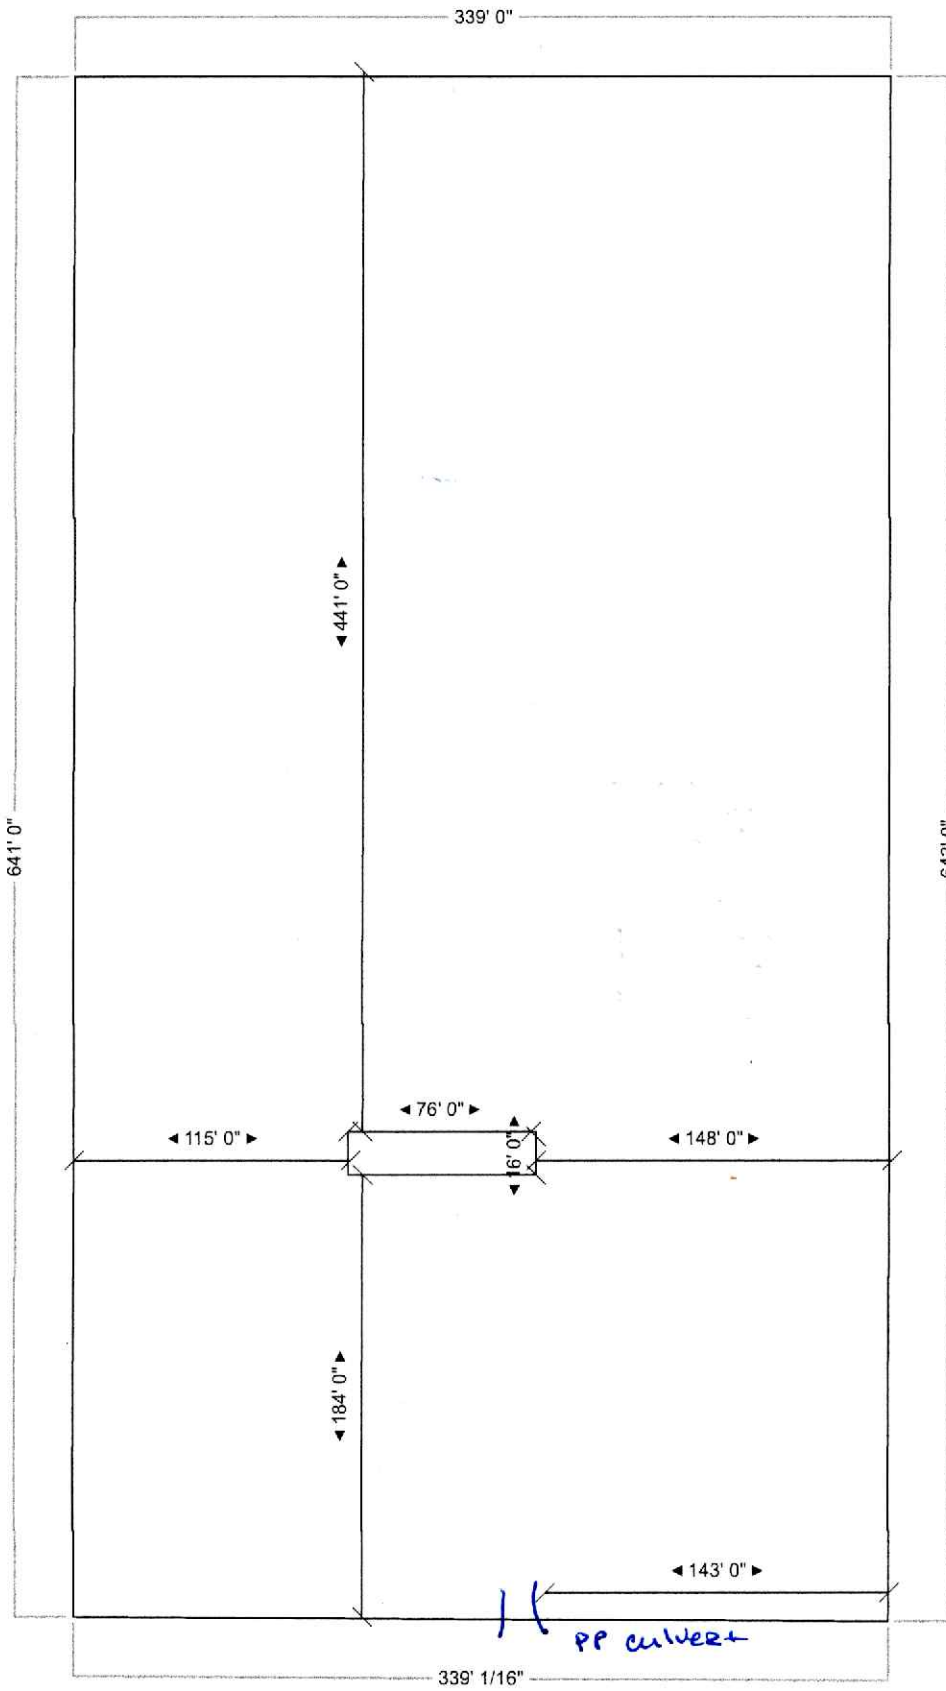

NW Fiddlers Ln