




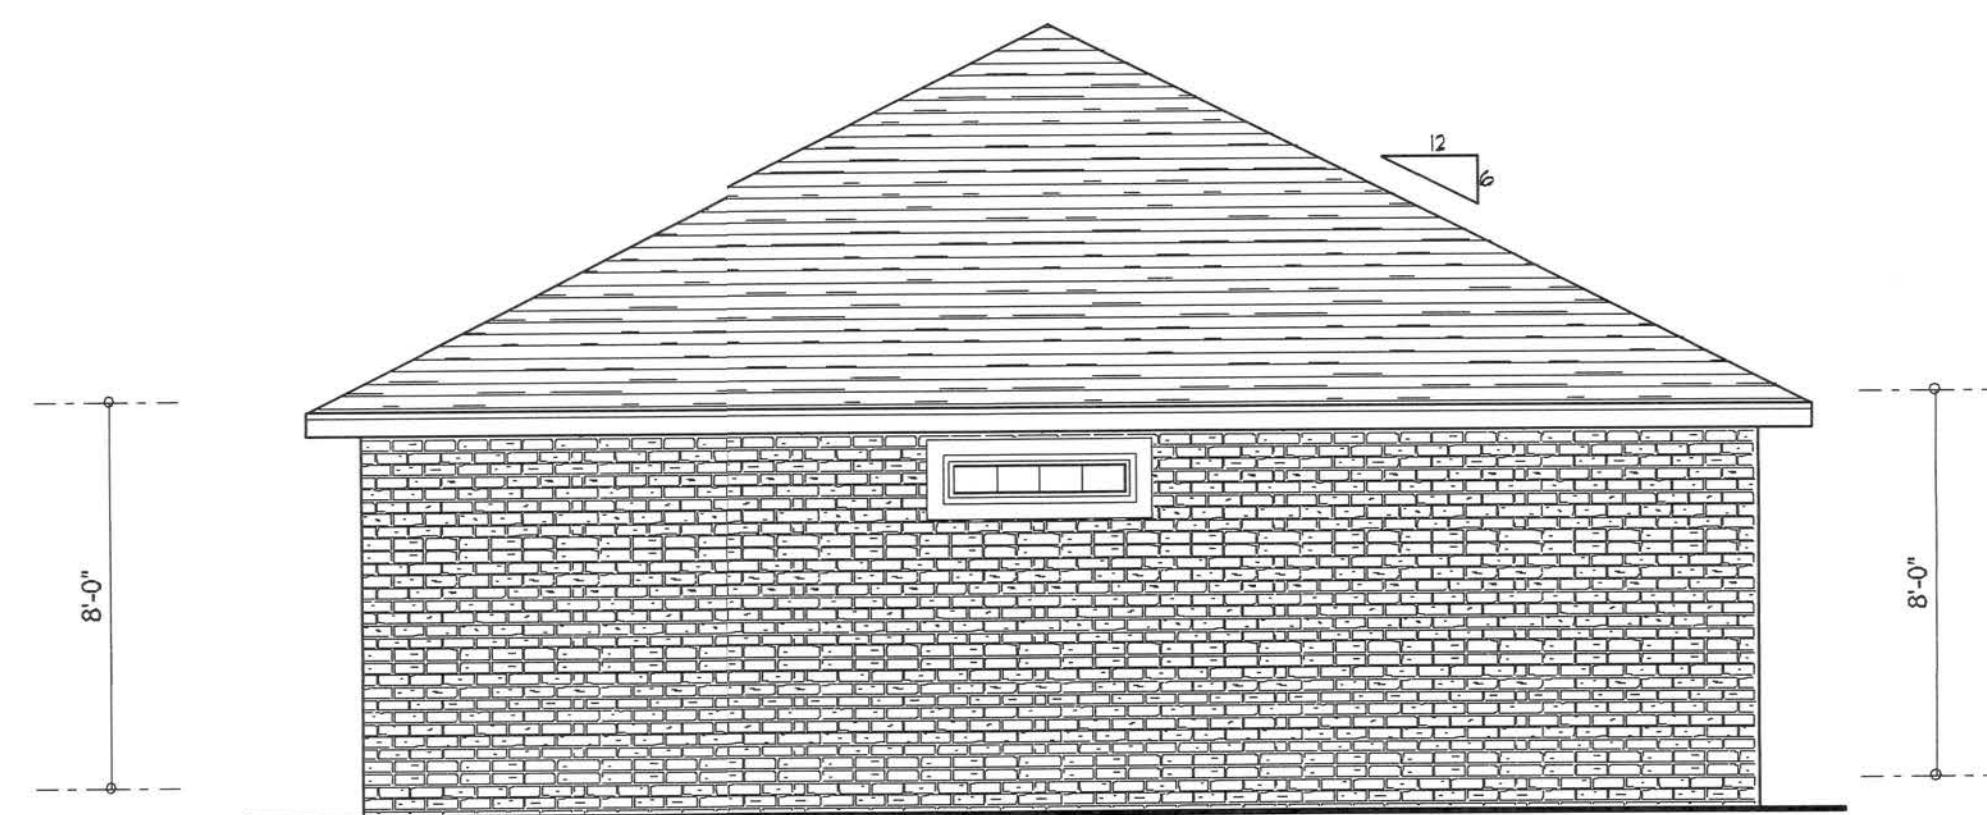


**LEFT ELEVATION**  
SCALE: 1/4" = 1'-0"

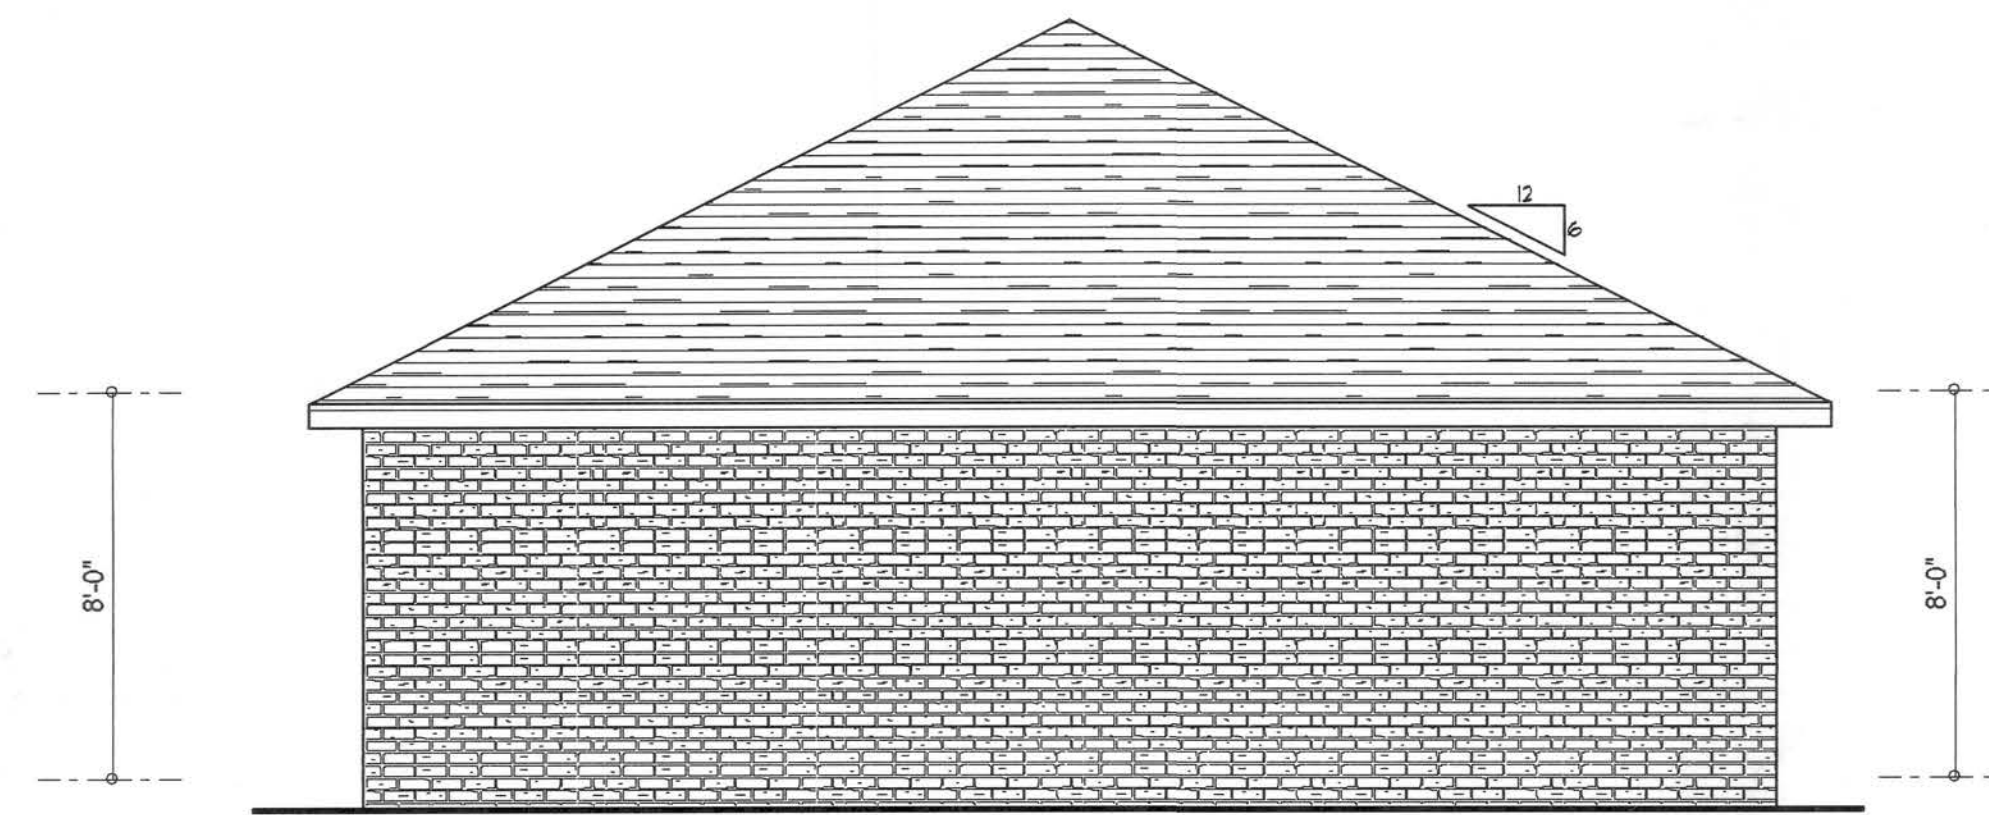

**RIGHT ELEVATION**  
SCALE: 1/4" = 1'-0"

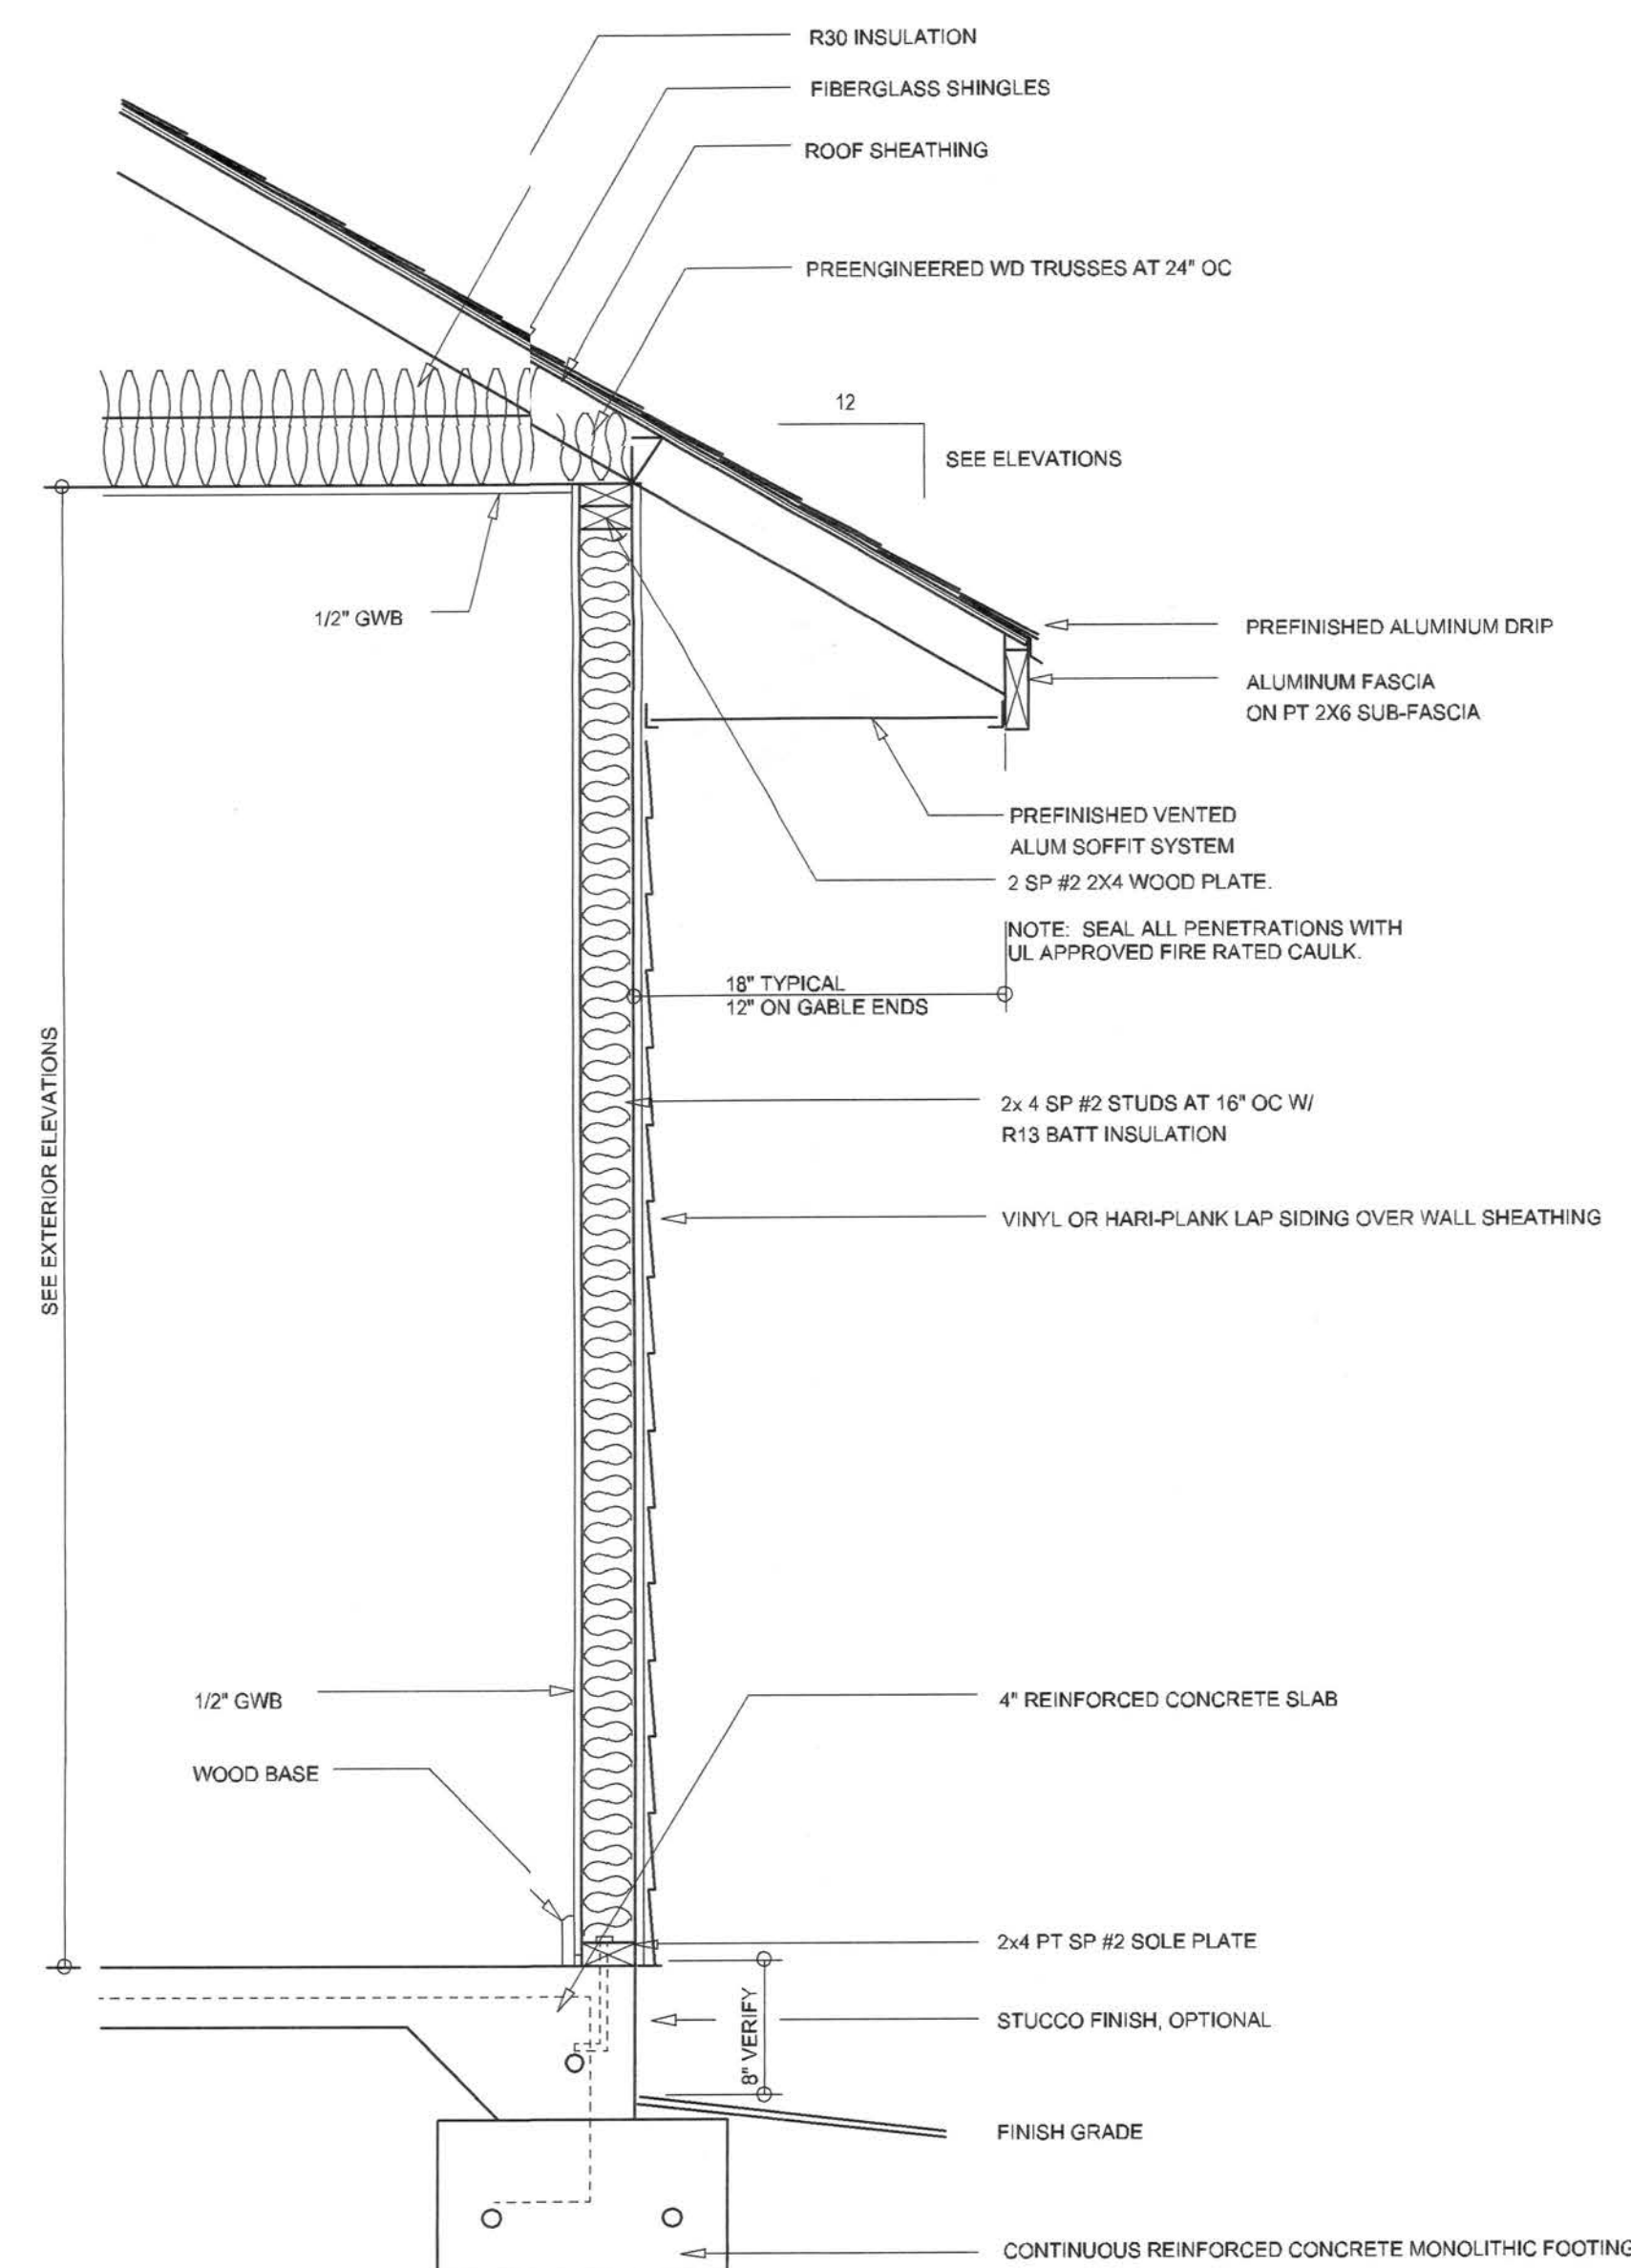

**TYPICAL WALL SECTION**  
SCALE: 1" = 1'-0"

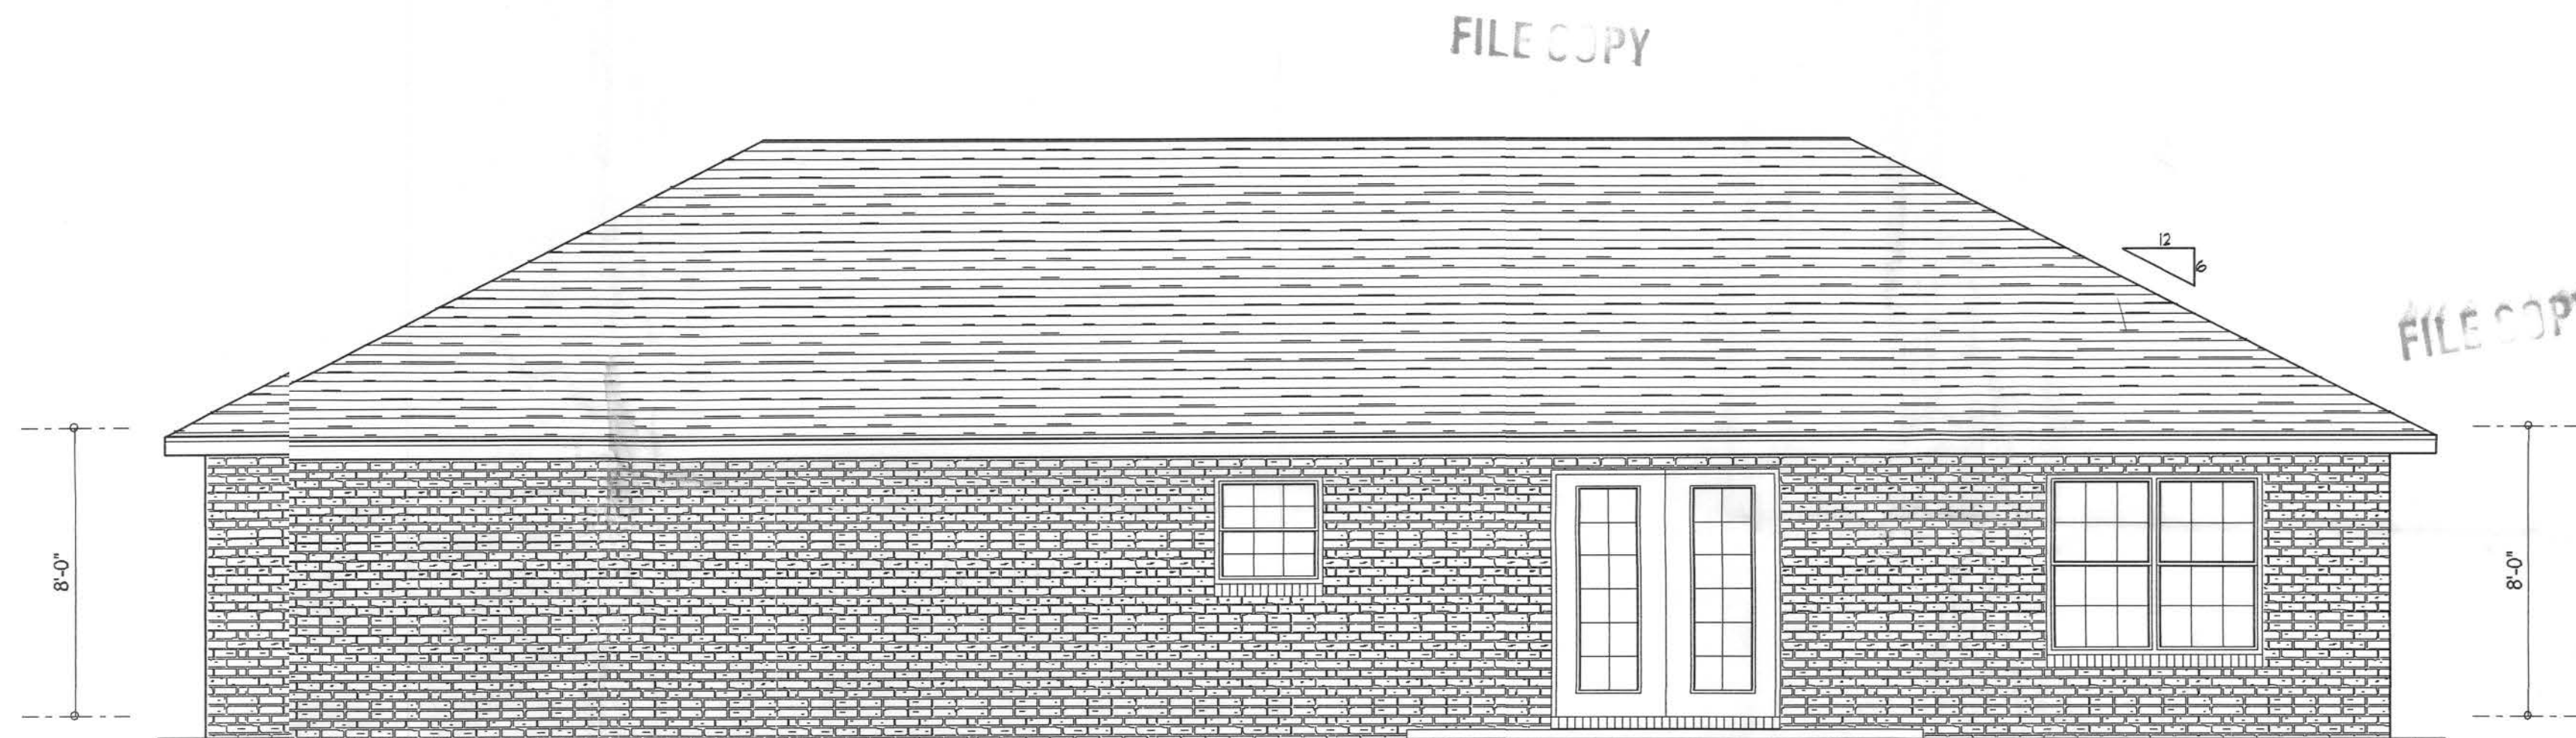

**REAR ELEVATION**  
SCALE: 1/4" = 1'-0"



**FRONT ELEVATION**  
SCALE: 1/4" = 1'-0"


FILE COPY

FILE COPY

| REVISIONS    |
|--------------|
| May 23, 2007 |

**SOFTPLAN**  
ARCHITECTURAL DESIGN SOFTWARE


A SPEC HOUSE FOR: CHARLES TIMMONS  
**MODEL 1297 (RIGHT)**  
PROJECT ADDRESS: NW CAROL PLACE, COLUMBIA COUNTY, FLORIDA 32055

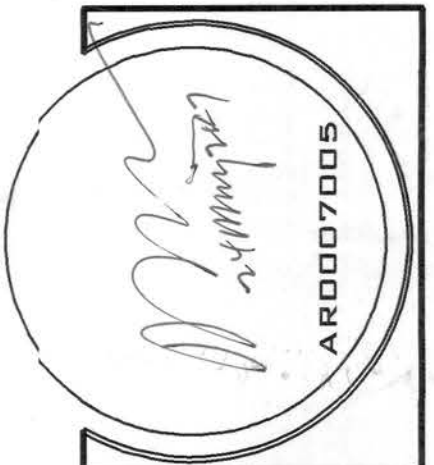

**NICHOLAS BEISLER**  
ARCHITECT  
M.C.A.R.B. Certified  
1758 NW Brown Rd.  
Lake City, FL 32055  
(386) 758-8406

JOINT VENTURED WITH


**WILLIAM MYERS DESIGN**  
P.O. BOX 1513  
LAKE CITY, FL 32055  
(386) 758-8406  
williammyers.net

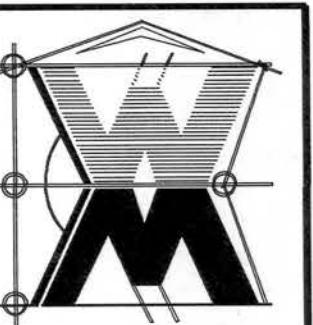

JOB NUMBER  
070515

SHEET NUMBER  
**A.1**  
OF 5 SHEETS

*William Myers*

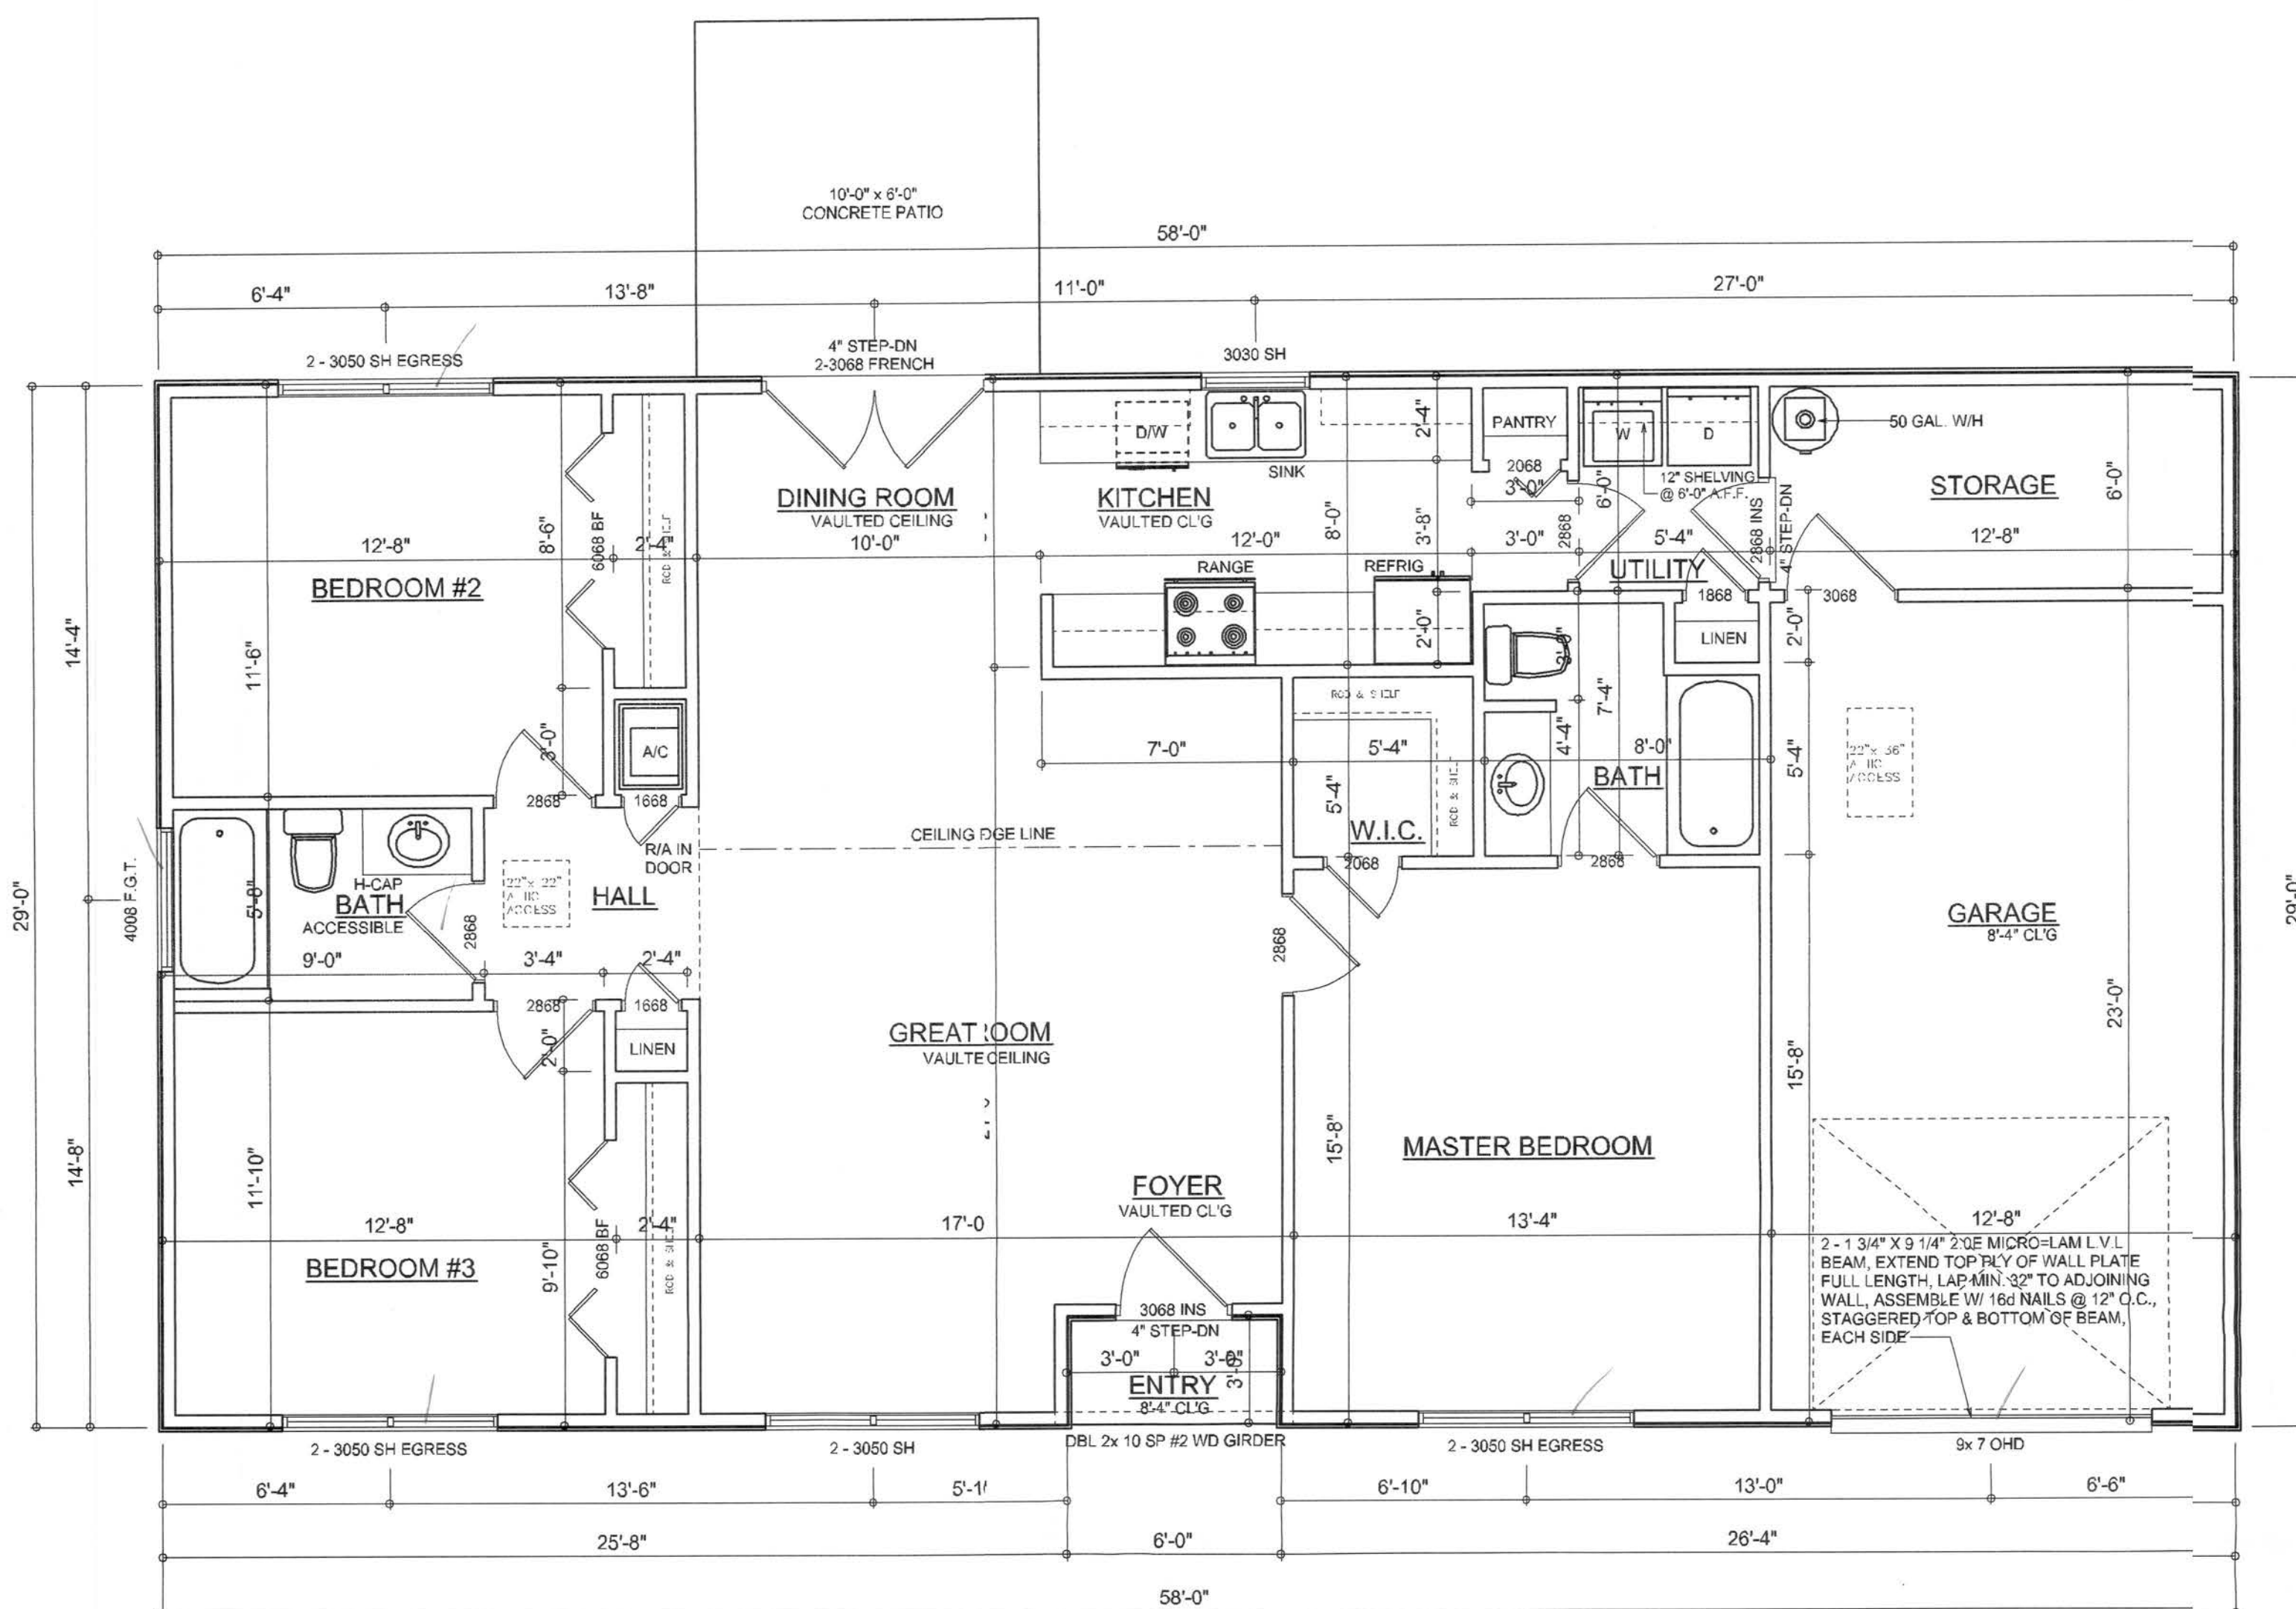

#### Garage fire separations shall comply with the following:

1. The private garage shall be separated from the dwelling unit and its attic area by means of a minimum 1/2-inch (12.7 mm) gypsum board applied to the garage side. Gages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8-inch Type X gypsum board or equivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or solid or honeycomb core steel doors not less than 13/8 inches (34.9 mm) thick, or doors in compliance with Section 715.3.3. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted.
2. Ducts in a private garage and ducts penetrating the walls or ceilings separating the dwelling unit from the garage shall be constructed of a minimum 0.019-inch (0.48 mm) sheet steel and shall have no openings into the garage.
3. A separation is not required between a Group R-3 and U carport provided the carport is entirely open on two or more sides and there are not enclosed areas above.
4. When installing an attic access and/or pull-down stair unit in the garage, ceiling shall have a minimum 20 min. fire rating.

**NOTE:**  
 ALL EXTERIOR WALLS ARE 2X4 STUDS W/  
 1/2" THICK CDX PLYWD. SHEATHING (4")

**NOTE:**  
 THE DESIGN WIND SPEED FOR THIS  
 PROJECT IS 110 MPH PER FBC 1606  
 AND LOCAL JURISDICTION REQUIREMENTS



**NOTE:**  
 ADDED FILL SHALL BE APPLIED IN 8" LIFTS -  
 EA. LIFT SHALL BE COMPACTED TO 95% DRY  
 COMPACTION PER THE "MODIFIED PROCTOR"  
 METHOD.

**NOTE:**  
 PLUMBING CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP  
 DRAWINGS INDICATING ALL PLUMBING WORK, INCLUDING ALL  
 PLUMBING LINE LOCATIONS AND RISER DIAGRAM - CONTR  
 SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER AND  
 1 COPY TO THE PERMIT ISSUING AUTHORITY.

**NOTE:**  
 H.V.A.C. CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP  
 DRAWINGS INDICATING ALL H.V.A.C. WORK, INCLUDING ALL  
 DUCTWORK LOC., SIZES, LINES, EQUIPMENT SCH. & BALANCING  
 REPORT - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS  
 TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

#### AREA SUMMARY

|                     |             |             |
|---------------------|-------------|-------------|
| LIVING AREA         | 1297        | S.F.        |
| GARAGE / STOR. AREA | 367         | S.F.        |
| ENTRY PORCH AREA    | 18          | S.F.        |
| <b>TOTAL AREA</b>   | <b>1682</b> | <b>S.F.</b> |

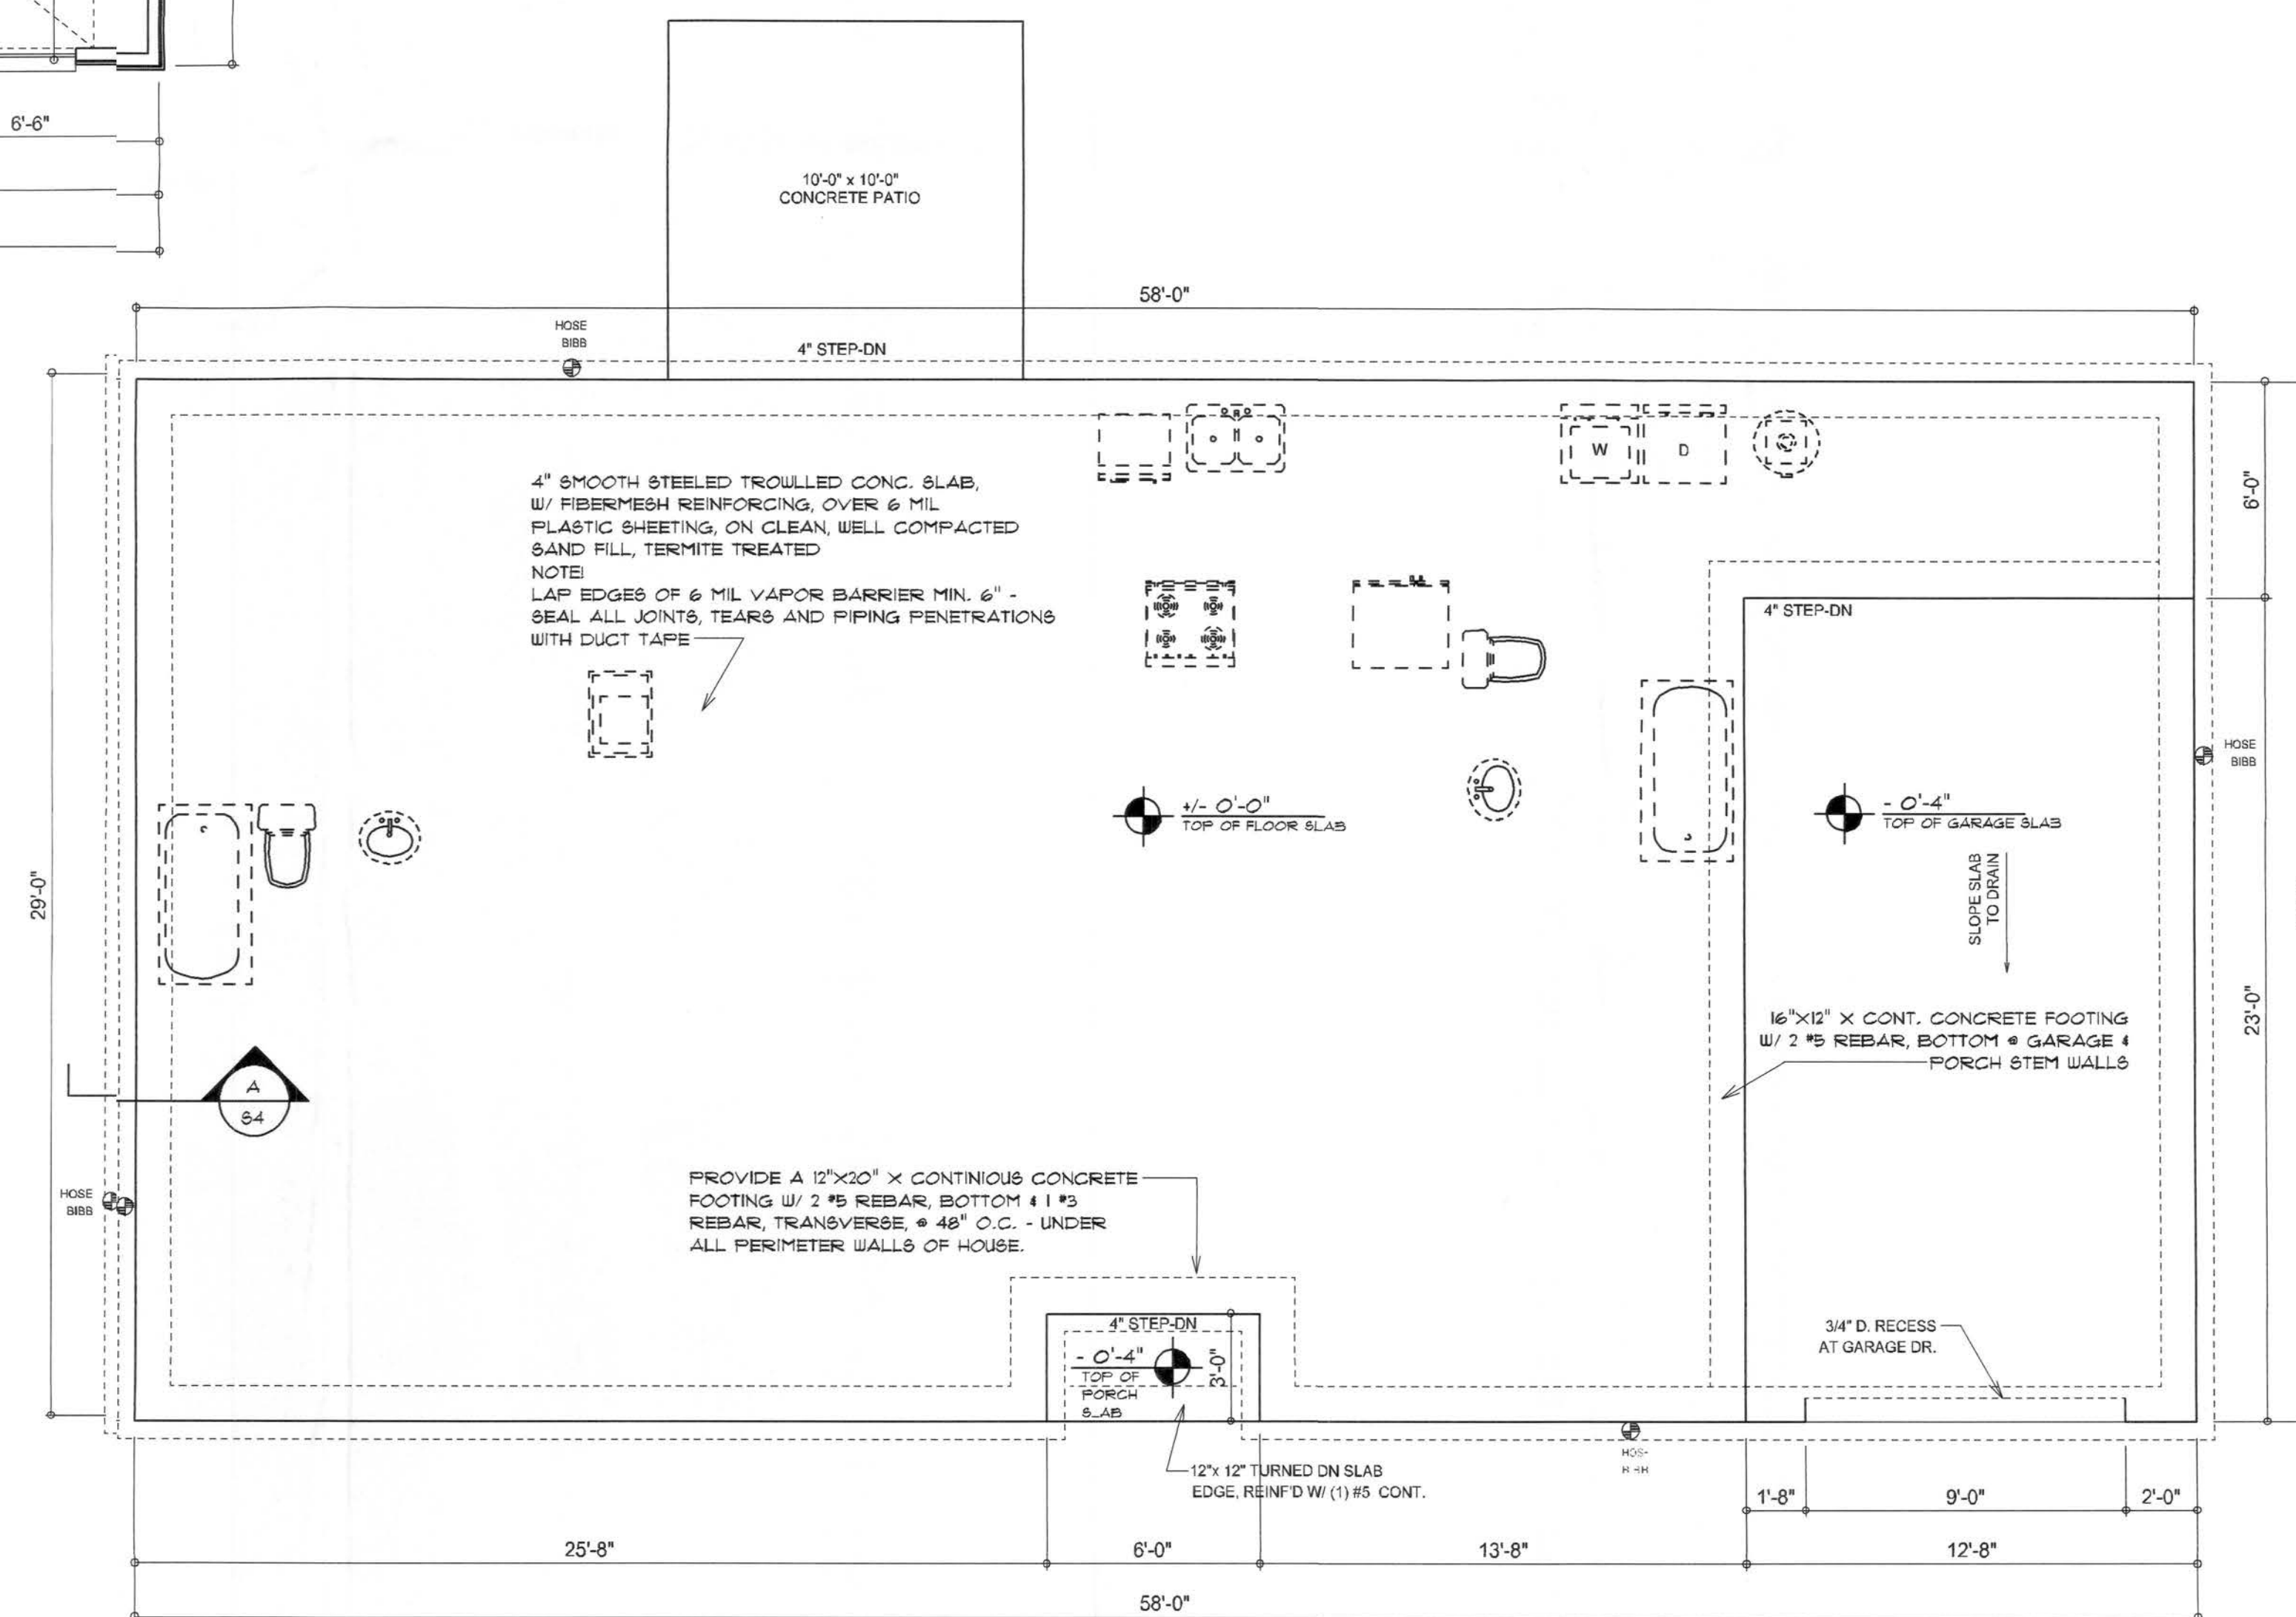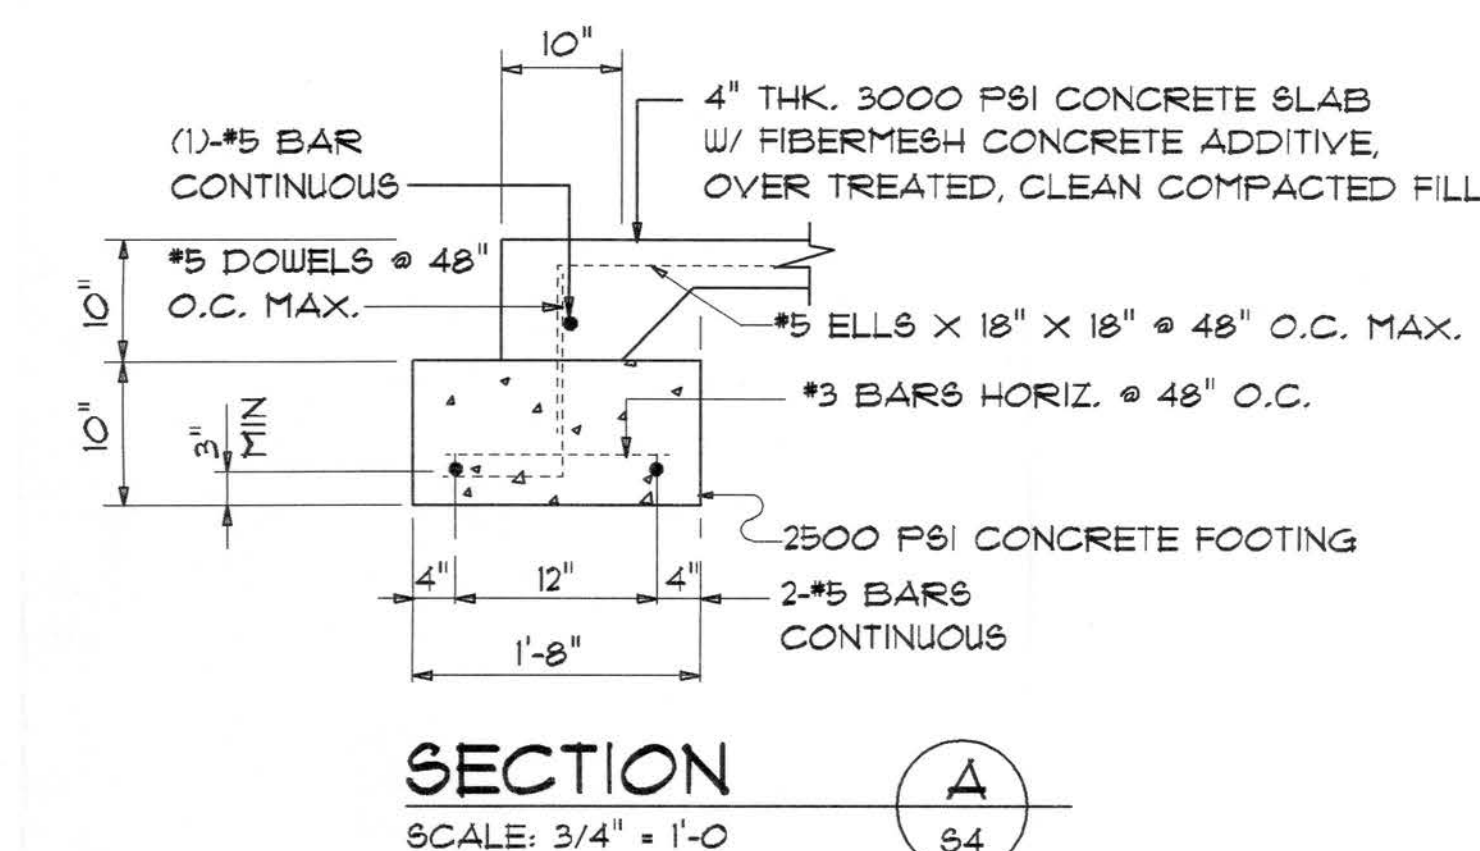

#### CONCRETE / MASONRY / METALS GENERAL NOTES:

1. DESIGN SOIL BEARING PRESSURE: 1000 PSF.
2. EXPANSIVE SOILS: WHERE DIRECTED BY THE SOILS ENGINEER, SOIL AUGMENTATION PER THE SOILS ENGINEER'S SPECIFICATIONS SHALL BE IMPLEMENTED PRIOR TO PLACING ANY FOUNDATIONS - TESTS AS SPECIFIED SHALL BE PERFORMED TO DETERMINE THE SUITABILITY OF THE SUB-GRADE TO SUPPORT THE DESIGN LOADS.
3. CLEAN SAND FILL OVER STRIPPED AND COMPACTED EXISTING GD. SHALL BE PLACED IN 12" LIFTS. BOTH SUB-SOIL AND FILL COMPACTION SHALL BE NOT LESS THAN 98% AS MEASURED BY A MODIFIED PROCTOR TEST AT THE RATE OF ONE TEST FOR EACH 1500 SF OF BUILDING PAD AREA, OR FRACTION THEREOF, FOR EACH 12" LIFT.
4. REINFORCING STEEL SHALL BE GRADE 60 AND MEET THE REQUIREMENTS OF ASTM A615, ALL BENDS SHALL BE MADE COLD.
5. WELDED WIRE MESH SLAB REINFORCING SHALL MEET THE REQUIREMENTS OF ASTM A185 - MIN. YIELD STRESS = 85 KSI.
6. CONCRETE SHALL BE STANDARD MIX F<sub>c</sub> = 3000 PSI FOR ALL FTGS, SLABS, COLUMNS AND BEAMS OR SHALL BE STANDARD PUMP MIX F<sub>c</sub> = 3000 PSI. STRENGTH SHALL BE ATTAINED WITHIN 28 DAYS OF PLACEMENT. MIXING, PLACING AND FINISHING SHALL BE AS PER ACI STANDARDS.
7. CONCRETE BLOCK SHALL BE AS PER MANUFACTURER'S PRODUCT GUIDE FOR ASTM C-90 REQUIREMENTS WITH MEDIUM SURFACE FINISH - F<sub>m</sub> = 1500 PSI.
8. MORTAR SHALL BE TYPE "M" OR "N" FOR ALL MASONRY UNITS.
9. STRUCTURAL STEEL SHALL CONFORM TO ASTM A36 STANDARDS FOR STRENGTH, BOLTS SHALL BE ASTM A307 / GRADE 1 OR A325, AS PER PLAN REQUIREMENTS.
10. WELDS SHALL BE AS PER "AMERICAN WELDING SOCIETY" STANDARDS FOR STRUCTURAL STEEL APPLICATIONS.
11. 2X4 P/T WOOD BILL, CONT., ALL AROUND, W/ 5/8" A.B. W/ 3" SQ. X 1/4" PLATE WASHERS WITHIN 6" FROM EACH CORNER, EA. WAY, & WITHIN 6" FROM ALL WALL OPENINGS / ENDS - 1/2" A.B. W/ 2" SQ. WASHERS ALONG EACH RUN @ 48" O.C. MAX. - ALL ANCHOR BOLTS SHALL HAVE A MINIMUM OF 8" EMBEDMENT INTO THE CONCRETE.

REVISIONS  
 May 23, 2007

SOFTPLAN  
 ARCHITECTURAL DESIGN SOFTWARE


A SPEC HOUSE FOR: CHARLES TIMMONS  
**MODEL 1297 (RIGHT)**  
 PROJECT ADDRESS: NW CAROL PLACE, COLUMBIA COUNTY, FLORIDA 32055

AR0007005  
 2/24/2007

**NICHOLAS PAUL GEISLER ARCHITECT**  
 N.C.A.R.B. Certified  
 1758 NW Brown Rd.  
 AKA CITY, FL 32055  
 (386) 755-5021

JOINT VENTURED WITH

**©VILLIAM MYERS DESIGN**  
 P.O. BOX 1513  
 AKA CITY, FL 32055  
 (386) 758-8406  
 will@villiamyers.net

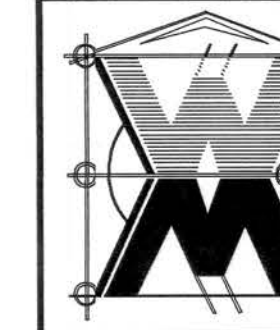


JOB NUMBER  
 070515

SHEET NUMBER

**S.1**  
 OF 5 SHEETS

Wm Myers

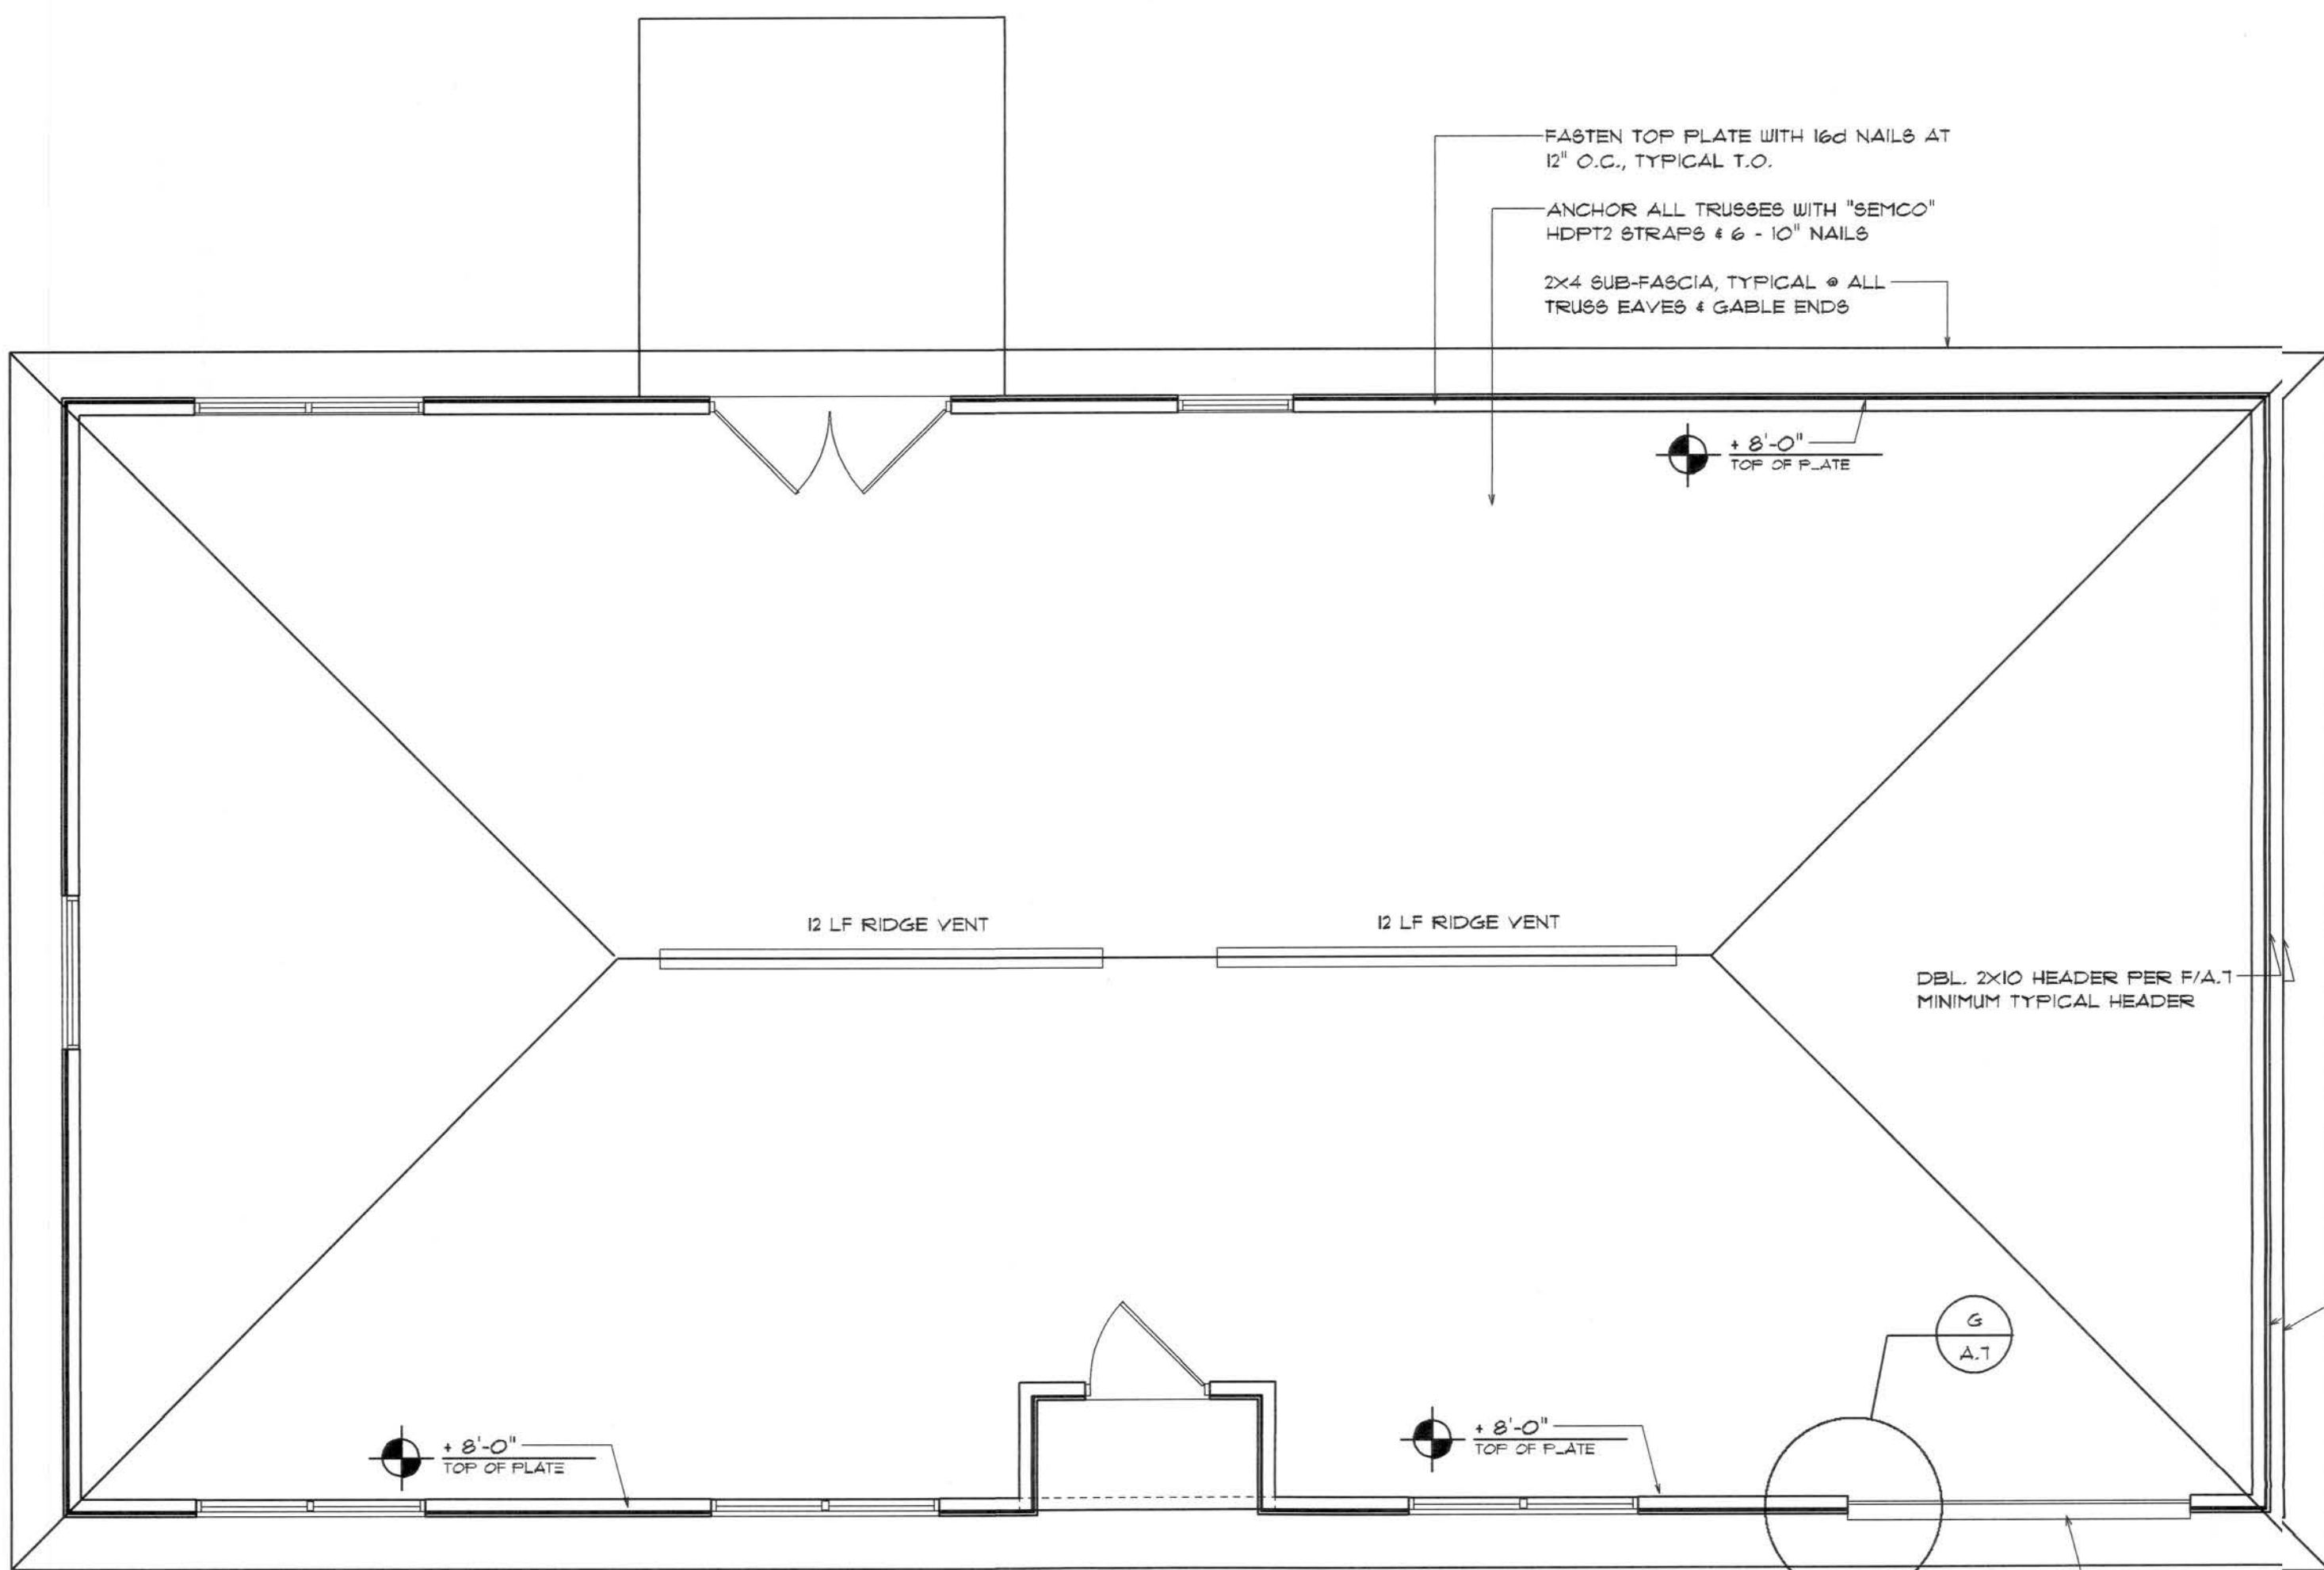



## Roof Framing PLAN

SCALE: 1/4" = 1'-0"

**NOTE:**  
ANCHOR GIRDER TRUSS(ES) TO HEADER WITH 2 "SIMPSON" LGT(2, 3 OR 4). ANCHOR HEADER TO KING STUDS W/ 2 "SIMPSON" ST2 EA. END - TYP., T.O.

**NOTE:**  
REFER TO THE WINDOW/DOOR HEADER SCHEDULE ON SHEET SD.4 FOR ALL MINIMUM SIZE HEADERS AND ALTERNATES. MINIMUM SIZE ALLOWABLE IS 2-2X10.


**NOTE:**  
ALL EXTERIOR WALLS ARE 2X4 STUDS W/ 1/2" THICK CDX PLYUD, SHEATHING (4")

| ELECTRICAL LEGEND                                                                   |                                         |
|-------------------------------------------------------------------------------------|-----------------------------------------|
|  | CEILING FAN<br>(PRE-WIRE FOR LIGHT KIT) |
|  | DOUBLE SECURITY<br>LIGHT                |
|  | RECESSED CAN LIGHT                      |
|  | BATH EXHAUST FAN                        |
|  | LIGHT FIXTURE                           |
|  | DUPLEX OUTLET                           |
|  | 220v OUTLET                             |
|  | GFI DUPLEX OUTLET                       |
|  | TELEVISION JACK                         |
|  | TELEPHONE JACK                          |
|  | SMOKE DETECTOR (see note below)         |
|  | WALL SWITCH                             |
|  | 3 WAY WALL SWITCH                       |
|  | WATER PROOF GFI OUTLET                  |
|  | 2 OR 4 TUB FLUORESCENT FIXTURE          |

**NOTE:**  
ALL BEDROOM RECEPTACLES SHALL BE AFCI (ARC FAULT CIRCUIT INTERRUPT)

ALL SMOKE DETECTORS SHALL HAVE BATTERY BACKUP POWER AND ALL WIRED TOGETHER SO IF ANY ONE UNIT IS ACTUATED THEY ALL ACTIVATE.

THE ELECTRICAL SERVICE OVERCURRENT PROTECTION DEVICE SHALL BE INSTALLED ON THE EXTERIOR OF STRUCTURES TO SERVE AS A DISCONNECT MEANS. CONDUCTORS USED FROM THE EXTERIOR DISCONNECTING MEANS TO A PANEL OR SUB PANEL SHALL HAVE FOUR-WIRE CONDUCTORS, OF WHICH ONE CONDUCTOR SHALL BE USED AS AN EQUIPMENT GROUND.

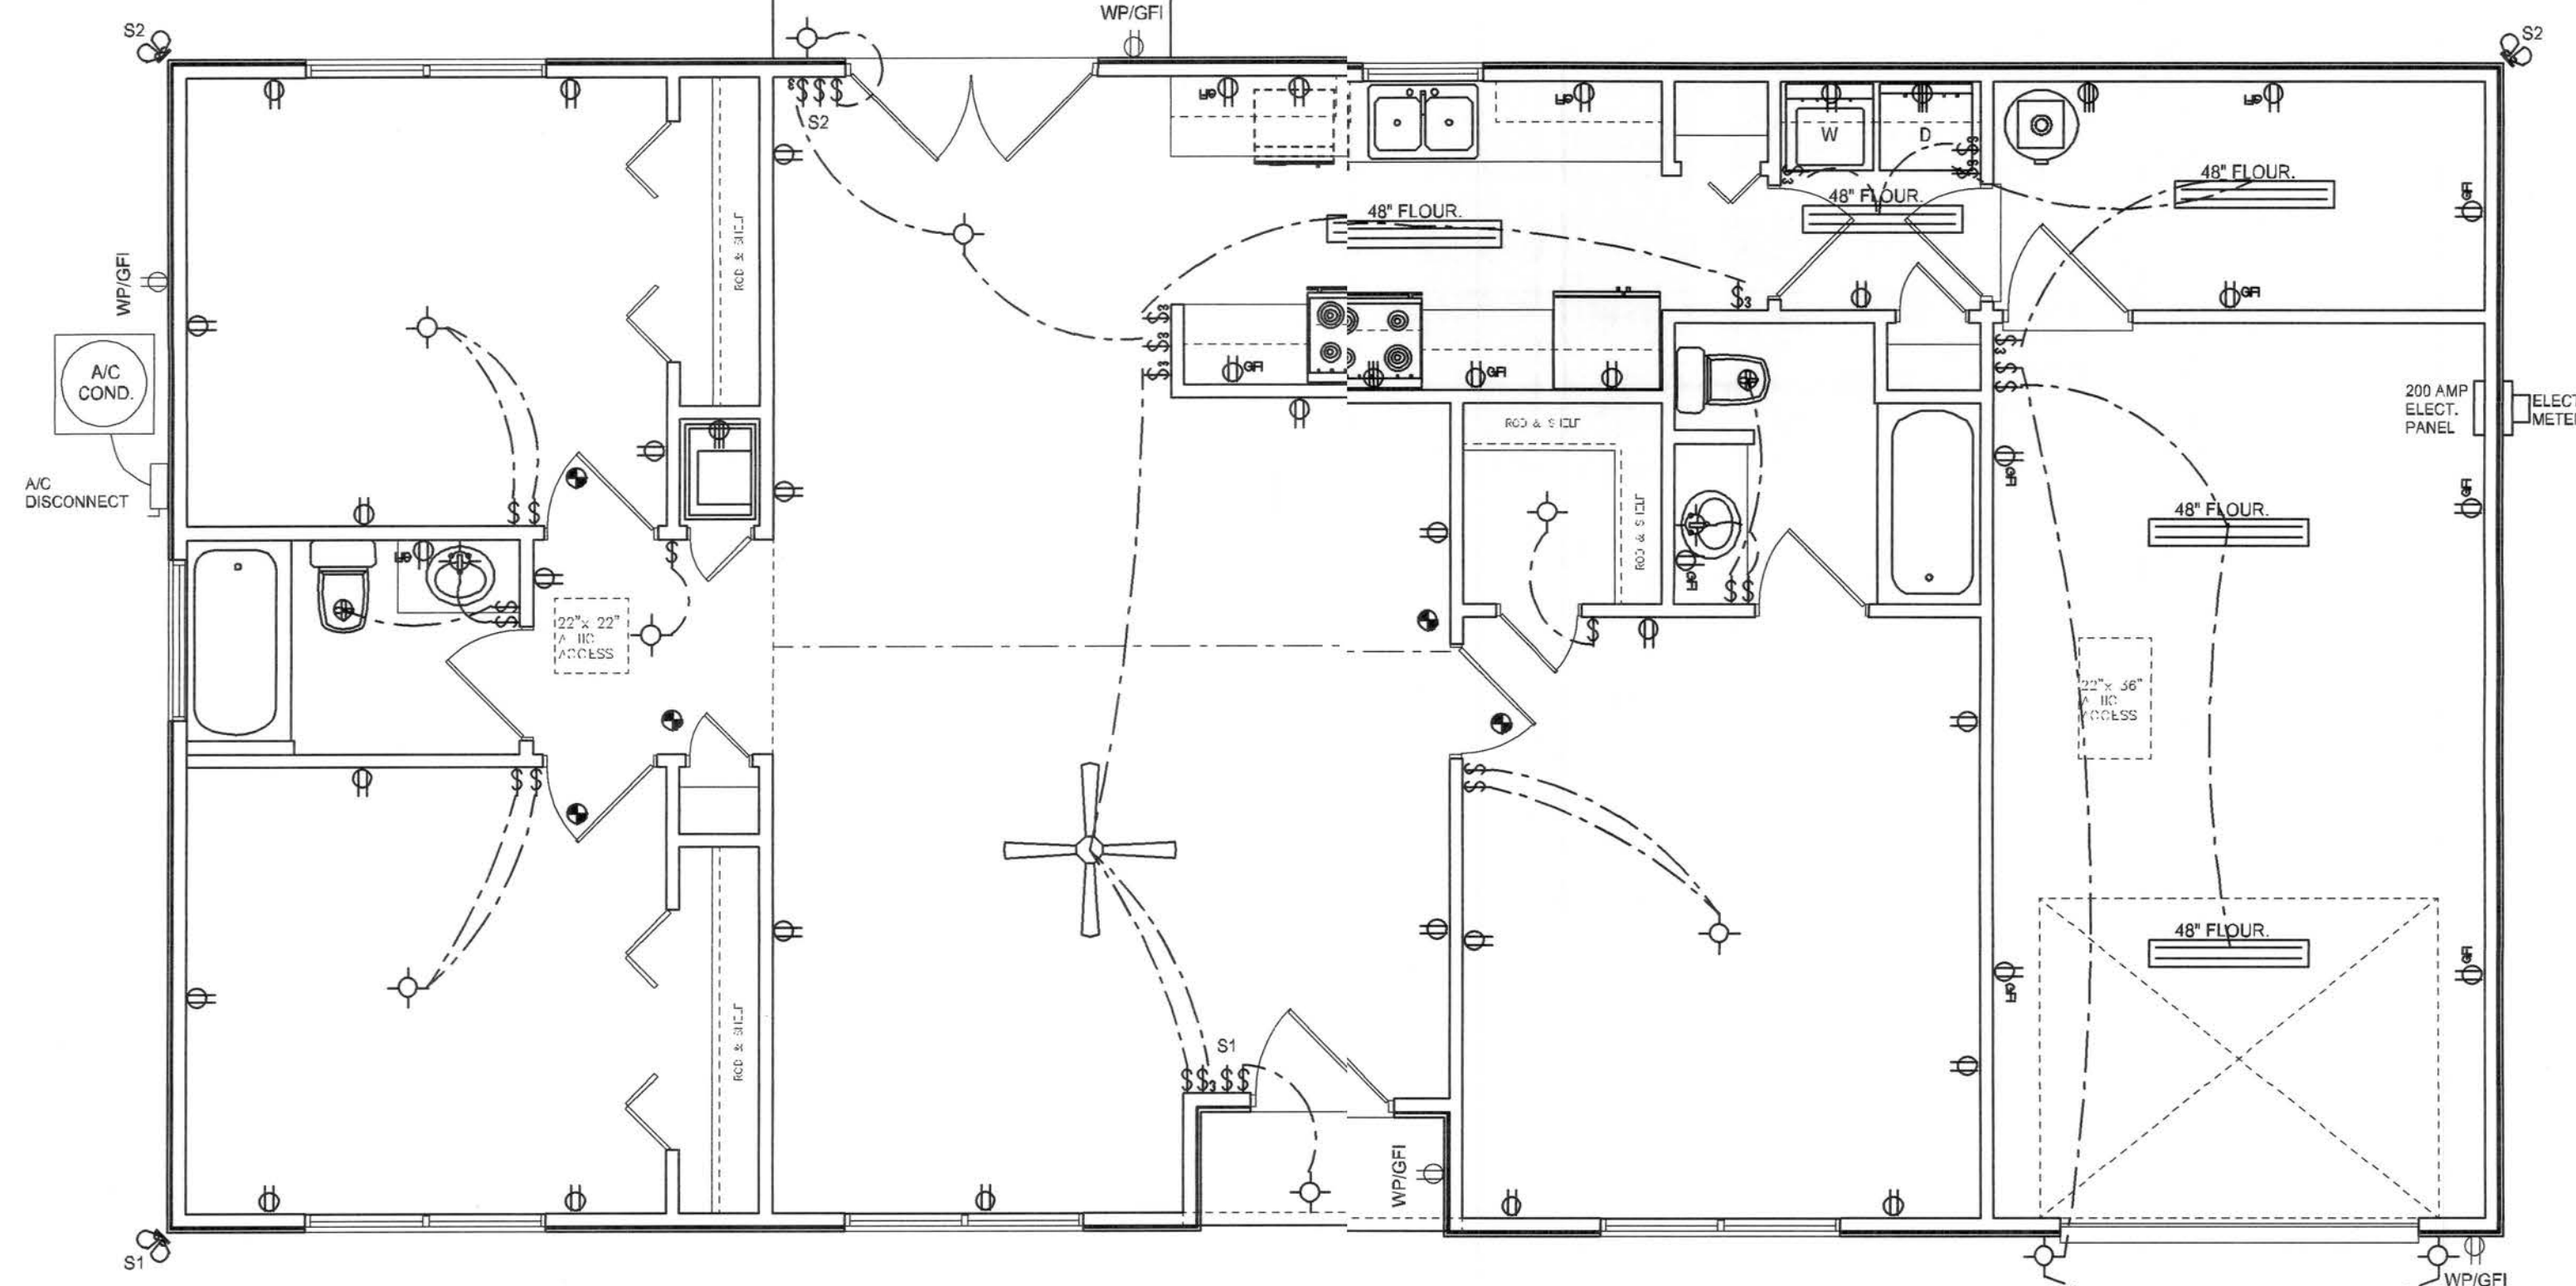

## ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

## ROOF PLAN NOTES

- R-1 ALL ROOF PITCH 6/12
- R-2 ALL OVERHANG 18" UNLESS OTHERWISE NOTED
- R-3 PROVIDE ATTIC VENTILATION IN ACCORDANCE WITH SCHEDULE ON SD.3
- R-4 SEE EXTERIOR ELEVATIONS AND FLOOR PLANS TO VERIFY PLATE AND HEEL HEIGHTS
- R-5 MOVE ALL VENTS AND OTHER ROOF PENETRATIONS TO REAR

**NOTE:**  
ALL PENETRATIONS OF THE TOP PLATE OF ALL LOAD BEARING WALLS SHALL BE SEALED WITH FIRE RETARDANT CAULKING, INCLUDING WIRING, PLUMBING OR OTHER SUCH PENETRATIONS. WALLS OVER 8'-0" TALL SHALL HAVE CONTINUOUS BLOCKING TO LIMIT CAVITY HEIGHT TO 8'-0". PENETRATIONS THROUGH SUCH BLOCKING SHALL BE TREATED IN THE SAME MANNER AS TOP PLATES, NOTED ABOVE

### GENERAL TRUSS NOTES:

- TRUSSES SHALL BE DESIGNED BY A LICENSED ENGINEER, AND IN ACCORDANCE WITH THE REQUIREMENTS OF THE "NATIONAL FOREST PRODUCTS ASSOCIATION" MANUAL FOR "STRESS RATED LUMBER AND ITS CONNECTIONS", LATEST ED., ALONG W/ THE "TRUSS PLATE INSTITUTE" SUGGESTED GUIDELINES FOR TEMPORARY AND PERMANENT BRACING, AND HANDLING OF TRUSSES. TRUSS SHOP DRAWINGS SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, DETS., & TRUSS TO TRUSS CONNECTIONS.
- TRUSS SHOP DRAWINGS SHALL BE SIGNED & SEALED BY THE DESIGNING ENGINEER.
- FOLLOWING DEVELOPMENT OF TRUSS SHOP DRAWINGS, ADJUSTMENTS TO THE ANCHOR REQUIREMENTS MAY BE REQUIRED DEPENDING ON THE ENGINEERED GRAVITY AND WIND UPLIFT REQUIREMENTS OF TRUSSES OR GIRDERS. THE CONTRACTOR SHALL MAKE AVAILABLE A COMPLETE SET OF TRUSS SHOP DRAWINGS TO THE ARCHITECT FOR THE PURPOSE OF REVIEW OF LOADS IMPOSED ON THE BALANCE OF THE STRUCTURE. ANY SUCH REQUIRED CHANGE SHALL BE INCORPORATED INTO THE CONSTRUCTION OF THIS STRUCTURE.


**NOTE:**  
SHEATH ROOF W/ 1/2" CDX PLYWOOD PLACED W/ LONG DIMENSION PERPENDICULAR TO THE ROOF TRUSSES, SECURE TO FRAMING W/ 8d NAILS - AS PER DETAIL ON SHEET SD.4

**NOTE:**  
THE DESIGN WIND SPEED FOR THIS PROJECT IS 110 MPH PER FBC 1606 AND LOCAL JURISDICTION REQUIREMENTS

## WOOD STRUCTURAL NOTES

- TEMPORARY BRACING OF THE STRUCTURE DURING ERECTION, REQUIRED FOR SAFE AND STABLE CONSTRUCTION, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR, SO ENGAGED. TEMPORARY & PERMANENT BRACING OF ROOF TRUSSES SHALL BE AS PER THE STANDARD GUIDELINES OF THE "TRUSS PLATE INSTITUTE".
- ALL TRUSSES SHALL BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER & SHALL BE SIGNED AND SEALED BY SAME. TRUSS DESIGN SHALL INCLUDE PLACEMENT PLANS, TRUSS DETAILS, TRUSS TO TRUSS CONNECTIONS & THE STANDARD SPECIFICATIONS & RECOMMENDATIONS OF INSTALLATION OF THE "TRUSS PLATE INSTITUTE".
- WOOD STUDS IN EXTERIOR WALLS & INTERIOR BEARING WALLS SHALL BE NOT LESS THAN N.Y.2 HEM-FIR OR BETTER.
- CONNECTORS FOR WOOD FRAMING SHALL BE GALVANIZED METAL OR BLACK METAL AS MANUFACTURED OR AS CALLED FOR IN THE PLANS AND BE OF A DESIGN SUITABLE FOR THE LOADS AND USE INTENDED. REFER TO THE JOINT REINFORCEMENT SCHEDULE FOR PRINCIPLE CONNECTIONS.


| AREA OF ATTIC | REQ'D L.F. OF VENT | NET FREE AREA OF INTAKE |
|---------------|--------------------|-------------------------|
| 1600 SF       | 20 LF              | 410 SQ.IN.              |
| 1900 SF       | 24 LF              | 490 SQ.IN.              |
| 2200 SF       | 28 LF              | 570 SQ.IN.              |
| 2500 SF       | 32 LF              | 650 SQ.IN.              |
| 2800 SF       | 36 LF              | 730 SQ.IN.              |
| 3100 SF       | 40 LF              | 810 SQ.IN.              |
| 3600 SF       | 44 LF              | 900 SQ.IN.              |

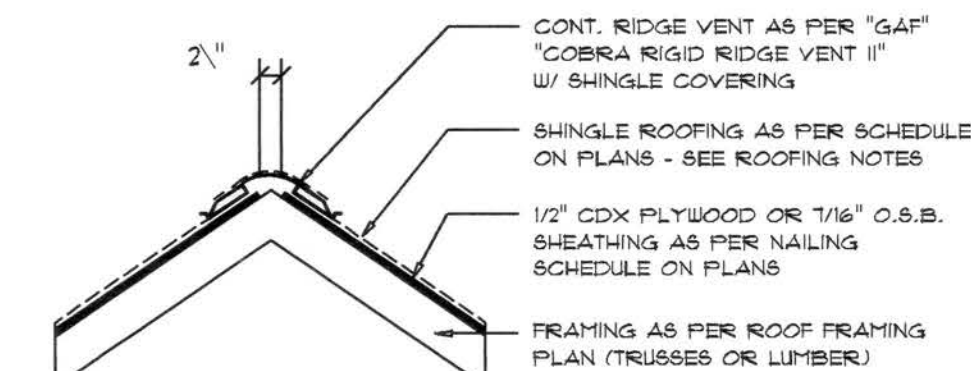

MIAMI/DADE PRODUCT APPROVAL REPORT: #98-0713.05

## Ridge Vent DETAIL

SCALE: 3/4" = 1'-0"

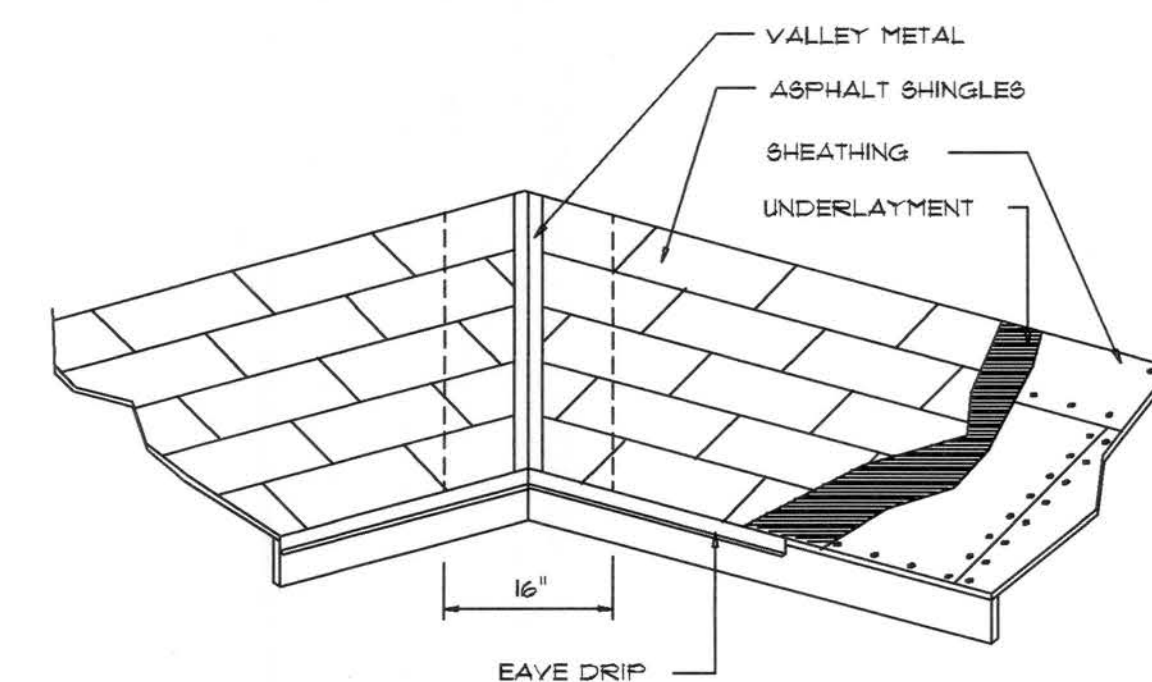

## VALLEY FLASHING

## ROOFING METALS for FLASHING/ROOFING

### MINIMUM THICKNESS REQUIREMENTS

| MATERIAL                      | MINIMUM THICKNESS (in.) | GAGE                 | WEIGHT (OZ.) |
|-------------------------------|-------------------------|----------------------|--------------|
| COPPER                        |                         |                      | 16           |
| ALUMINUM                      | 0.024                   |                      |              |
| STAINLESS STEEL               |                         | 28                   |              |
| GALVANIZED STEEL              | 0.0175                  | 26 (ZINC COATED G90) |              |
| ZINC ALLOY LEAD PAINTED TERNE | 0.021                   |                      | 20           |

## Roofing/Flashing DETS.

SCALE: NONE

REVISIONS  
May 23, 2007

SCFPLAN  
ARCHITECTURAL DESIGN SOFTWARE


A SPEC HOUSE FOR: CHARLES TIMMONS  
**MODEL 1297 (RIGHT)**  
PROJECT ADDRESS: NW CAROL PLACE, COLUMBIA COUNTY, FLORIDA 32055

*William Myers*  
ARCHITECT  
A 00007005

**NICHOLAS PAULER ARCHITECT**  
N.C.A.R.B. Certified  
1755 NW Brown Rd.,  
Lakeland, FL 33805  
(386) 755-9051

JOINT/ENTURED WITH

**WILLIAM MYERS DESIGN**  
10 BOX 1513  
LAKE CITY, FL 32056  
(386) 758-8406  
williammyers.net

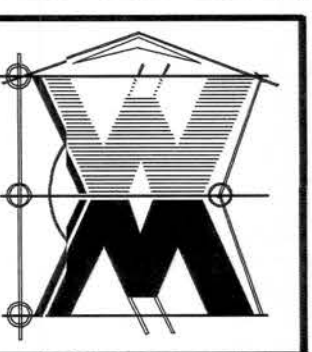

JOB NUMBER  
070515

SHEET NUMBER

**S.2**

OF 5 SHEETS

*William Myers*

FLORIDA BUILDING CODE

Compliance Summary

TYPE OF CONSTRUCTION

Roof: Hip Construction, W/ Trusses @ 24" O

Walls: 2x4 Wood Studs @ 1' O.C.

Floor: 4" Thk. Concrete Slab W/ Fiberglass Concrete Additive

Foundation: Continuous Footer/Stem Wall

ROOF DECKING

Material: 1/2" CD Plywood 7/16" O.S.B.

Sheet Size: 48"x96" Shee Perpendicular to Roof Framing

Fasteners: 8d Common Ns per schedule on sheet A.7

SHEARWALLS

Material: 1/2" CD Plywood 7/16" O.S.B.

Sheet Size: 48"x96" Shee Placed Vertical

Fasteners: 8d Common Nls @ 4" O.C. Edges & 8" O.C. Interior

Dragstrut: Double Top Plt (S.Y.P.) W/16d Nails @ 12" O.C.

Wall Studs: 2x4 Hem Fir Studs @ 16" O.C.

HURRICANE UPLIFT CONNECTOR

Truss Anchors: SEMCO HDPT2 @ Ea. Truss End (Typ. U.O.N.)

Wall Tension: Wall Sheathing Nailing Is Adequate - 8d @ 4" O.C. Top & Bot.

Anchor Bolts: 1/2" A307 o/bts @ 48" O.C. - 1st Bolt 6" from corner

Corner Hold-down Device: (1) HD5a @ each corner

Porch Column Base Connector: Simpson ABU44/ABU66 @ each column

Porch Column to Beam Connector: Simpson EPC44/PC44 @ each column

FOOTINGS AND FOUNDATIONS

Footings: 20"x12" Cont. W/25 Bars Cont. & 1-#3 Transverse @ 24" O.C.

Stemwall: 8" C.M.U. W/1-#5 Vertical Dowel @ 48" O.C.

ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION 1609, FLORIDA BUILDING CODE, 2004 EDITION.

|                                                                                    |                                                                         |
|------------------------------------------------------------------------------------|-------------------------------------------------------------------------|
| BASIC WIND SPEED:                                                                  | 110 MPH                                                                 |
| WIND IMPORTANCE FACTOR (I):                                                        | I = 1.00                                                                |
| BUILDING CATEGORY:                                                                 | CATEGORY II                                                             |
| WIND EXPOSURE:                                                                     | "B"                                                                     |
| INTERNAL PRESSURE COEFFICIENT:                                                     | +/- 0.18                                                                |
| MWFRS PER TABLE 1606.1 (FBC 2004) DESIGN WIND PRESSURE                             | ROOF: -23.1 PSF<br>WALLS: +26.6 PSF<br>EAVES: -32.3 PSF                 |
| COMPONENTS & CLADDING PER TABLES 1609.2B & 1609.2C (FBC 2004) DESIGN WIND PRESSURE | OPNGS: +21.8 / -29.1 PSF<br>EAVES: -68.3 PSF<br>ROOF: +19.9 / -25.6 PSF |

TERMITE PROTECTION NOTES:

SOIL CHEMICAL BARRIER METHOD:


1. A PERMANENT SIGN WHICH IDENTIFIES THE TERMITE TREATMENT PROVIDER AND NEED FOR REINSPECTION AND TREATMENT CONTRACT RENEWAL SHALL BE PROVIDED. THE SIGN SHALL BE POSTED NEAR THE WATER HEATER OR ELECTRIC PANEL. FBC 104.2.6
2. CONDENSATE AND ROOF DOWNSPOUTS SHALL DISCHARGE AT LEAST 1'-0" AWAY FROM BUILDING SIDE WALLS. FBC 1503.4.4
3. IRRIGATION/SPRINKLER SYSTEMS INCLUDING ALL RISERS AND SPRAY HEADS SHALL NOT BE INSTALLED WITHIN 1'-0" FROM BUILDING SIDE WALLS. FBC 1503.4.4
4. TO PROVIDE FOR INSPECTION OR TERMITE INFESTATION, BETWEEN WALL COVERINGS AND FINAL EARTH GRADE SHALL NOT BE LESS THAN 6". EXCEPTION: PAINT AND DECORATIVE CEMENTIOUS FINISH LESS THAN 5/8" THICK ADHERED DIRECTLY TO THE FOUNDATION WALL. FBC 1403.1.6
5. INITIAL TREATMENT SHALL BE DONE AFTER ALL EXCAVATION AND BACKFILL IS COMPLETE. FBC 181.1.1
6. SOIL DISTURBED AFTER THE INITIAL TREATMENT SHALL BE RETREATED INCLUDING SPACES BOXED OR DRUMED. FBC 1816.1.2
7. BOXED AREAS IN CONCRETE FLOOR FOR SUBSEQUENT INSTALLATION OF TRAPS, ETC., SHALL BE MADE WITH PERMANENT METAL OR PLASTIC FORMS. PERMANENT FORMS MUST BE OF A SIZE AND DEPTH THAT WILL ELIMINATE THE DISTURBANCE OF SOIL AFTER THE INITIAL TREATMENT. FBC 1816.1.3
8. MINIMUM 6 MIL VAPOR RETARDER MUST BE INSTALLED TO PROTECT AGAINST RAINFALL DILUTION. IF AINFALL OCCURS BEFORE VAPOR RETARDER PLACEMENT, RETREATMENT IS REQUIRED. FBC 1816.1.4
9. CONCRETE OVERPOUR AND MORTAR ALONG THE FOUNDATION PERIMETER MUST BE REMOVED BEFORE EXTERIOR SOIL TREATMENT. FBC 1816.1.5
10. SOIL TREATMENT MUST BE APPLIED UNDER ALL EXTERIOR CONCRETE OR GRADE WITHIN 1'-0" OF THE STRUCTURE SIDEWALLS. FBC 1816.1.6
11. AN EXTERIOR VERTICAL CHEMICAL BARRIER MUST BE INSTALLED AFTER CONSTRUCTION IS COMPLETE INCLUDING LANDSCAPING AND IRRIGATION. ANY SOIL DISTURBED AFTER THE VERTICAL BARRIER IS APPLIED, SHALL BE RETREATED. FBC 1816.1.6
12. ALL BUILDINGS ARE REQUIRED TO HAVE PER-CONSTRUCTION TREATMENT. FBC 1816.1.7
13. A CERTIFICATE OF COMPLIANCE MUST BE ISSUED TO THE BUILDING DEPARTMENT BY A LICENSED PEST CONTROL COMPANY BEFORE A CERTIFICATE OF OCCUPANCY WILL BE ISSUED. THE CERTIFICATE OF COMPLIANCE SHALL STATE: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. THE TREATMENT IS IN ACCORDANCE WITH THE RULES AND LAWS OF THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES". FBC 1816.1.7
14. AFTER ALL WORK IS COMPLETED, LOOSE WOOD AND FILL MUST BE REMOVED FROM BELOW AND WITHIN 1'-0" OF THE BUILDING. THIS INCLUDES ALL GRADE STAKES, TUB TRAP BOXES, FORMS, SHORING OR OTHER CELLULOSE CONTAINING MATERIAL. FBC 2303.1.3
15. NO WOOD, VEGETATION, STUPS, CARDBOARD, TRASH, ETC., SHALL BE BURIED WITHIN 15'-0" OF ANY BUILDING OR PROPOSED BUILDING. FBC 2303.1.4

FRAMING ANCHOR SCHEDULE

| APPLICATION                  | MANUFACTURER/MODEL             | CAP.      |
|------------------------------|--------------------------------|-----------|
| TRUSS TO WALL:               | SEMCO HDPT2, W/ 6 - 10d NAILS  | 960#      |
| GIRDER TRUSS TO POST/HEADER: | SIMPSON LGT, W/ 28 - 16d NAILS | 1785#     |
| HEADER TO KING STUD(S):      | SIMPSON ST22                   | 1370#     |
| PLATE TO STUD:               | SIMPSON SP2                    | 1065#     |
| STUD TO SILL:                | SIMPSON SP1                    | 585#      |
| PORCH BEAM TO POST:          | SIMPSON PC44/EPC44             | 1700#     |
| PORCH POST TO FND.:          | SIMPSON ABU44                  | 2200#     |
| MISC. JOINTS                 | SIMPSON A34                    | 315#/240# |

NOTE:  
ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.  
NOTE:  
REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/ JOINT REINFORCEMENT AND FASTENERS.  
NOTE:  
ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL T.O.

NOTE:  
"SEMCO" PRODUCT APPROVAL:  
MIAMI/DADE COUNTY REPORT #95-0818.15  
NOTE:  
"SIMPSON" PRODUCT APPROVALS:  
MIAMI/DADE COUNTY REPORT #97-0107.05, #98-1126.11, #99-0623.04  
SBCC1 NER-443, 1 NER-393

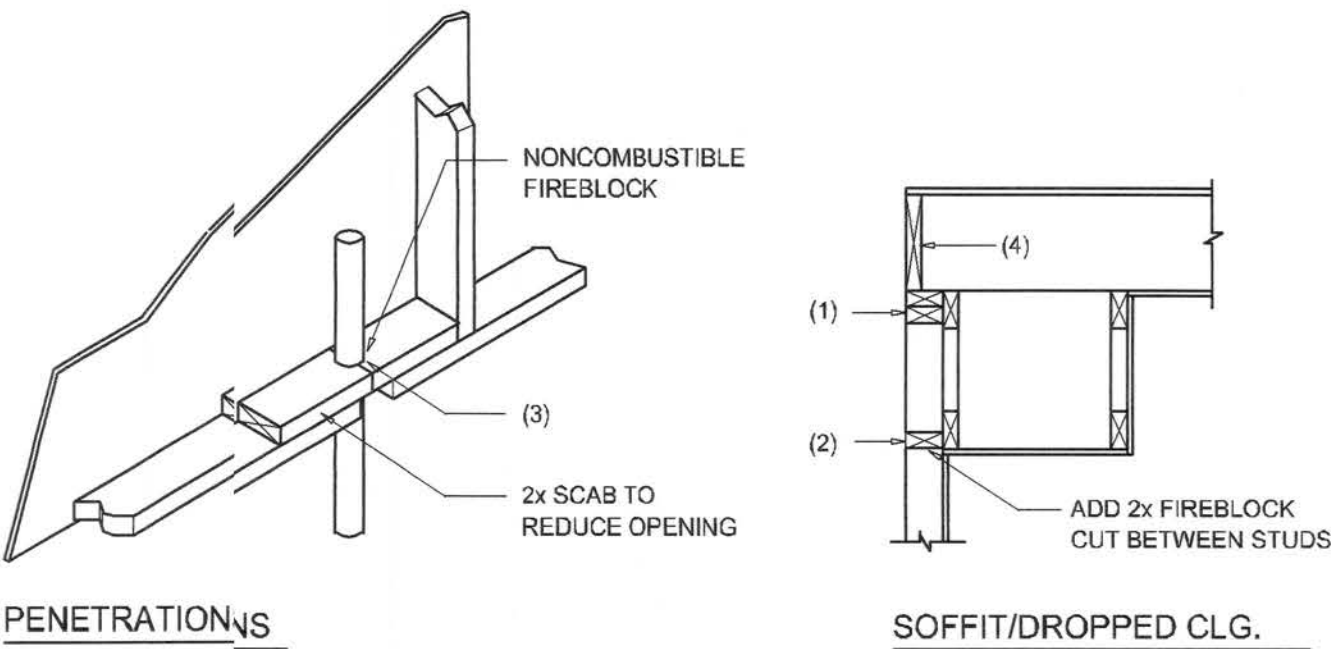


FIREBLOCKING NOTES:

- FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:
1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
  2. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
  3. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH "PYRO PANEL MULTIFLEX SEALANT"
  4. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS. FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

Fire Stopping DETAILS

SCALE: NONE

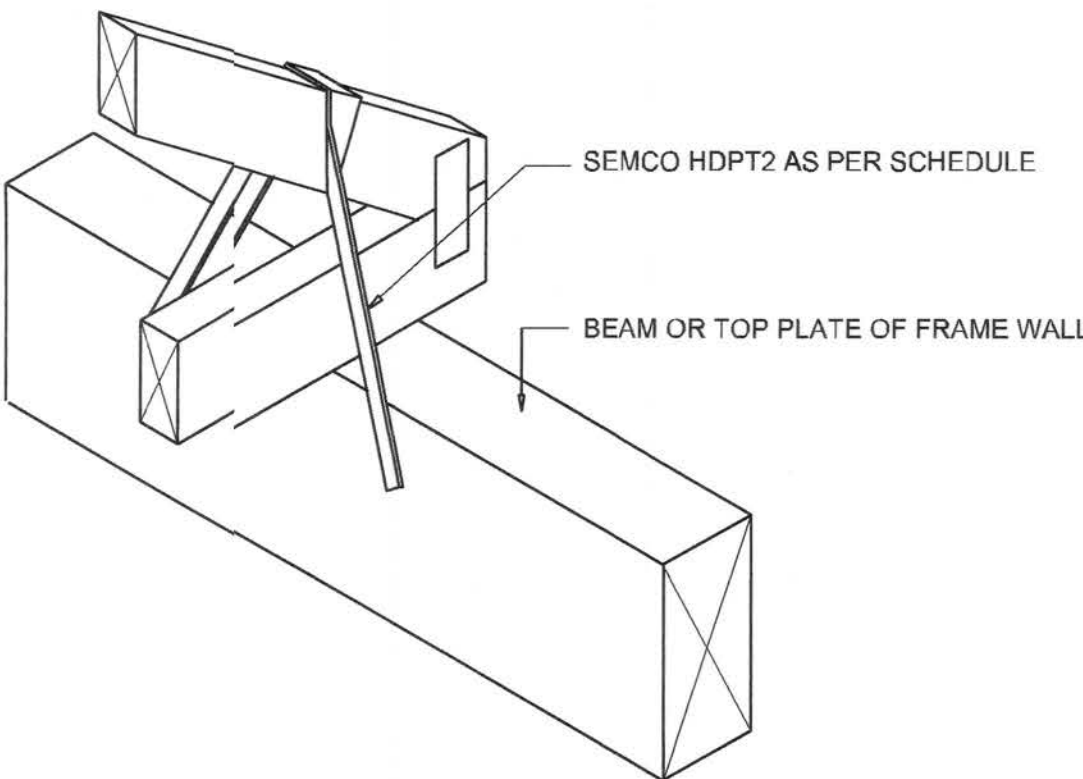

SEMCO HDPT2

SCALE: 1/2" = 1'-0" TRUSS TO WOOD BEAM

General Roofing NOTES:

DECK REQUIREMENTS:  
ASPHALT SHINGLES SHALL BE FASTENED TO SOLIDLY SHEATHED DECKS.

SLOPE:  
ASPHALT SHINGLES SHALL BE USED ONLY ON ROOF SLOPES OF 2:12 OR GREATER. FOR ROOF SLOPES FROM 2:12 TO 4:12, DBL. UNDERLAYMENT IS REQUIRED.

UNDERLAYMENT:  
UNLESS OTHERWISE NOTED, UNDERLAYMENT SHALL CONFORM W/ ASTM D 226, TYPE 1, OR ASTM D 4869, TYPE 1.

SELF-ADHERING POLYMER MODIFIED BITUMEN SHEET:  
SELF ADHERING POLYMER MODIFIED BITUMEN SHALL COMPLY W/ ASTM D 1970.

ASPHALT SHINGLES:  
ASPHALT SHINGLES SHALL HAVE SELF SEAL STRIPS OR BE INTERLOCKING, AND COMPLY WITH ASTM D 225 OR ASTM D 3462.

FASTENERS:  
FASTENERS FOR ASPHALT SHINGLES SHALL BE GALVANIZED, STAINLESS STEEL, ALUMINUM OR COPPER ROOFING NAILS, MINIMUM 12 GAUGE SHANK WITH A MINIMUM 3/8 INCH DIAMETER HEAD, OF A LENGTH TO PENETRATE THROUGH THE ROOFING MATERIAL AND A MINIMUM 3/4" INTO THE ROOF SHEATHING. WHERE THE SHEATHING IS LESS THAN 3/4" THICK, THE NAILS SHALL PENETRATE THROUGH THE SHEATHING.

ATTACHMENT:  
ASPHALT SHINGLES SHALL BE SECURED TO THE ROOF WITH NOT LESS THAN FOUR FASTENERS PER STRIP SHINGLE OR TWO FASTENERS PER INDIVIDUAL SHINGLE. WHERE ROOFS LOCATED IN BASIC WIND SPEED OF 110 MPH OR GREATER, SPECIAL METHODS OF FASTENING ARE REQUIRED. UNLESS OTHERWISE NOTED, ATTACHMENT OF ASPHALT SHINGLES SHALL CONFORM WITH ASTM D 3161 OR M-DC PA 107-95.

UNDERLAYMENT APPLICATION:  
FOR ROOF SLOPES FROM 2:12 TO 4:12, UNDERLAYMENT SHALL BE A MINIMUM OF TWO LAYERS APPLIED AS FOLLOWS:  
1. STARTING AT THE EAVE, A 19 INCH STRIP OF UNDERLAYMENT SHALL BE APPLIED PARALLEL WITH THE EAVE AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

2. STARTING AT THE EAVE, 36 INCH WIDE STRIPS OF UNDERLAYMENT FELT SHALL BE APPLIED OVERLAPPING SUCCESSIVE SHEETS 19 INCHES AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

FOR ROOF SLOPED 4:12 AND GREATER, UNDERLAYMENT SHALL BE A MINIMUM OF ONE LAYER OF UNDERLAYMENT FELT APPLIED AS FOLLOWS:  
STARTING AT THE EAVE, UNDERLAYMENT SHALL BE APPLIED SHINGLE FASHION PARALLEL TO THE EAVE, LAPPED 2 INCHES, AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

BASE AND CAP FLASHINGS:  
BASE AND CAP FLASHING SHALL BE INSTALLED IN ACCORDANCE W/ MFG'S INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE OF EITHER CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS 0.019 INCH OR MINERAL SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 77 LBS PER 100 SQUARE FEET. CAP FLASHING SHALL BE CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS OF 0.019 INCH.

VALLEYS:  
VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE W/ MANUFACTURER'S INSTALLATION INSTRUCTIONS BEFORE APPLYING ASPHALT SHINGLES. VALLEY LININGS OF THE FOLLOWING TYPES SHALL BE PERMITTED.

1. FOR OPEN VALLEYS LINED WITH METAL, THE VALLEY LINING SHALL BE AT LEAST 16" WIDE AND OF ANY OF THE CORROSION RESISTANT METALS IN FBC TABLE 1507.3.9.2
2. FOR OPEN VALLEYS, VALLEY LINING OF TWO PLIES OF MINERAL SURFACE ROLL ROOFING SHALL BE PERMITTED. THE BOTTOM LAYER SHALL BE 18 INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.
3. FOR CLOSED VALLEYS VALLEY LINING SHALL BE ONE OF THE FOLLOWING:  
1. BOTH TYPES 1 AND 2 ABOVE, COMBINED.  
2. ONE PLY OF SMOOTH ROLL ROOFING AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 224.  
3. SPECIALTY UNDERLAYMENT AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 1970.

NOTE !!!  
ROOF SHINGLES SHALL BE AS MANUFACTURED BY "TAMKO ROOFING PRODUCTS" OF THE FOLLOWING MODELS:

GLASS-SEAL AR  
ELITE GLASS-SEAL AR  
HERITAGE 30 AR  
HERITAGE 40 AR  
HERITAGE 50 AR

THESE SHINGLES MEET THE REQUIREMENTS OF ASTM D-3161 TYPE 1 MODIFIED TO 110 MPH WINDS & FBC TAS 100, USING 4 NAILS/SHINGLE

REVISIONS

May 23, 2007


SOFTPLAN

ARCHITECTURAL DESIGN SOFTWARE

A SPEC HOUSE FOR: CHARLES TIMMONS

MODEL 1297 (RIGHT)

PROJECT ADDRESS: NW CAROL PLACE, COLUMBIA COUNTY, FLORIDA 32055

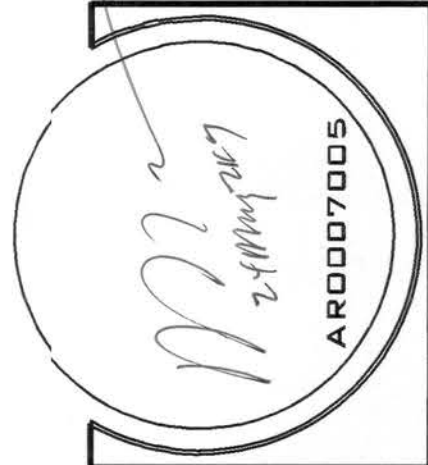


NICHOLAS BEISLER ARCHITECT N.C.A.R.B. Certified

1758 NW Brown Rd. Lake City, FL 32055 (386) 755-5021

JOINT VENTURED WITH

WILLIAM MYERS DESIGN


P.O. BOX 1613 LAKE CITY, FL 32056 (386) 758-8406 will@willmyers.net

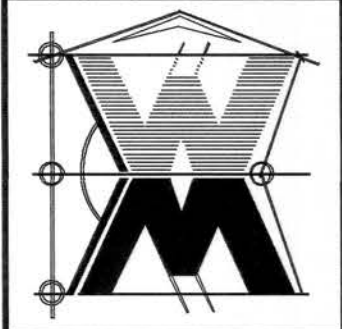

JOB NUMBER  
070515


SHEET NUMBER  
S.3  
OF 5 SHEETS

Wm Myers

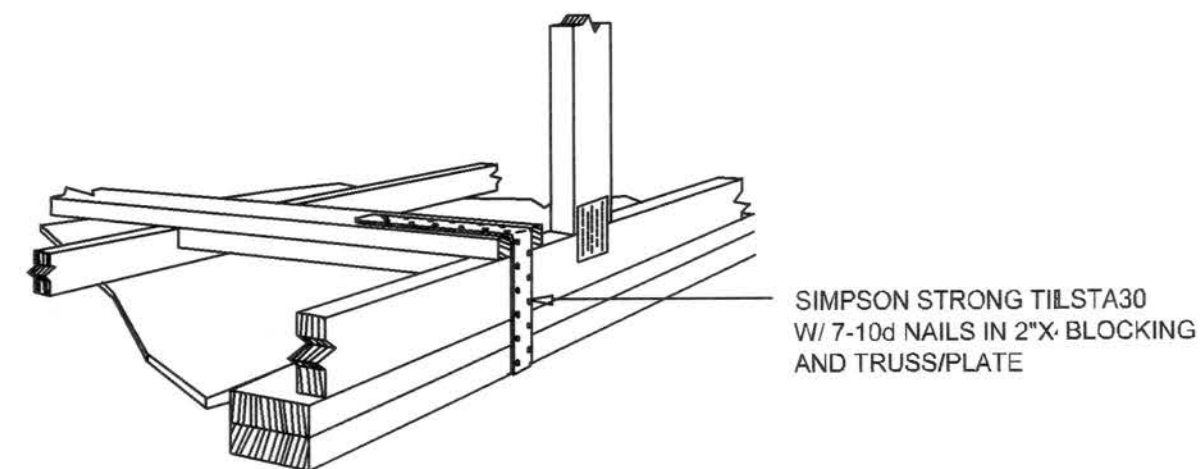

GABLE END GYPSUM DIAPHRAGM  
HOLDOWN CONNECTOR  
SCALE: NONE


A.1

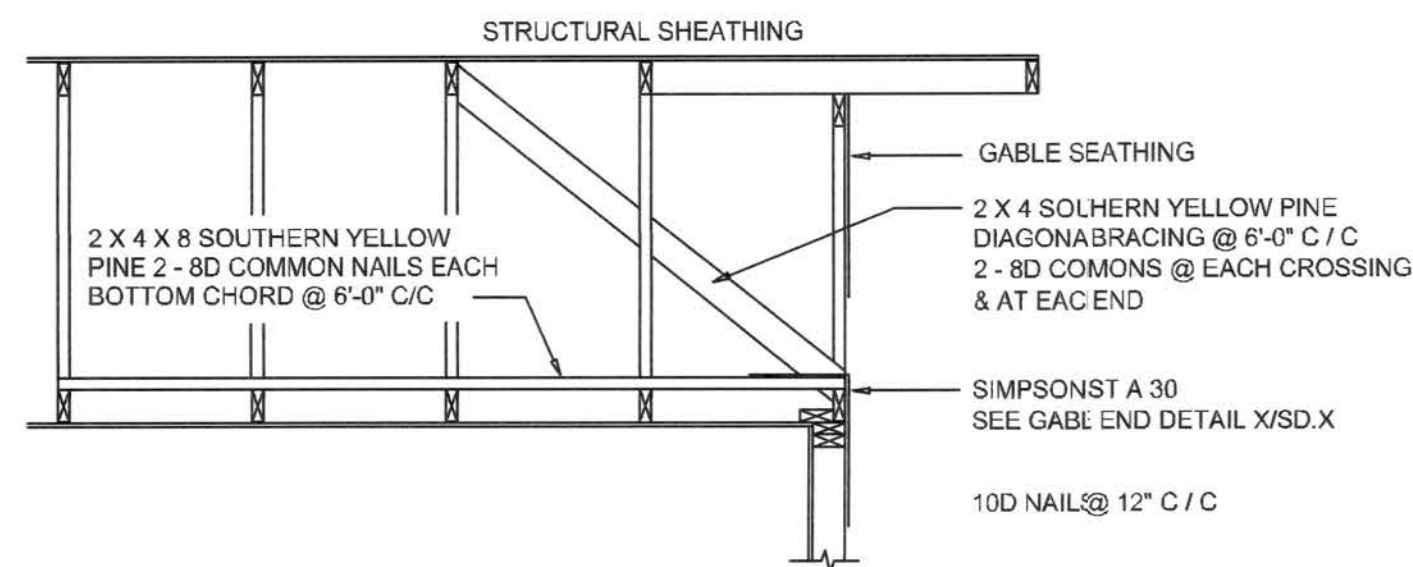


END WALL BRACING FOR  
CEILING DIAPHRAGM  
NTS (ALTERNATIVE TO BALLOON FRAMING)  
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

A

| ROOF SHEATHING FASTENINGS |                              |                                                          |                                                                                     |
|---------------------------|------------------------------|----------------------------------------------------------|-------------------------------------------------------------------------------------|
| NAILING ZONE              | SHEATHING TYPE               | FASTENER                                                 | SPACING                                                                             |
| 1                         |                              |                                                          | 6 IN. O.C. EDGE<br>12 IN. O.C. FIELD                                                |
| 2                         | 7/16" O.S.B.<br>OR 15/32 CDX | 8d COMMON OR<br>8d HOT DIPPED<br>GALVANIZED<br>BOX NAILS | 6 IN. O.C. EDGE<br>6 IN. O.C. FIELD                                                 |
| 3                         |                              |                                                          | 4 IN. O.C. @ GABLE ENDWALL<br>OR GABLE TRUSS<br>6 IN. O.C. EDGE<br>6 IN. O.C. FIELD |

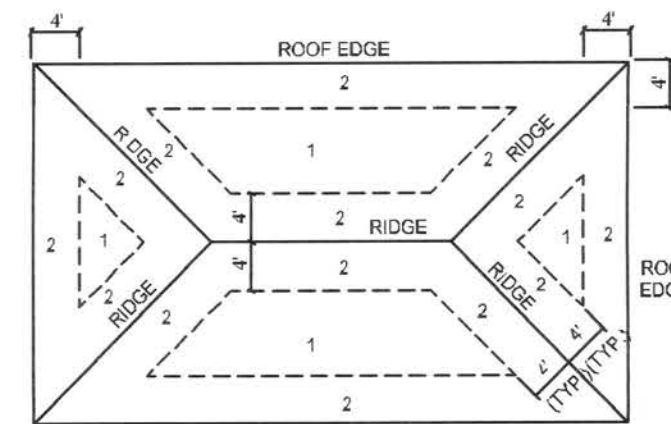

ROOF SHEATHING NAILING ZONES  
(HIP ROOF)

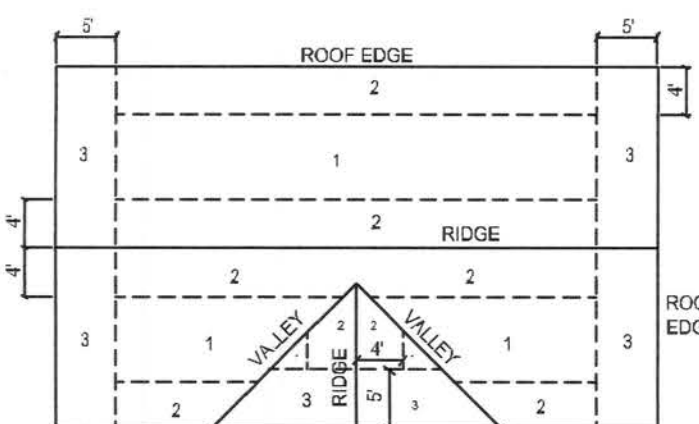


ROOF SHEATHING NAILING ZONES  
(GABLE ROOF)

Roof Nail Pattern DET.

SCALE: NONE

B


| HEADER SPANS FOR EXTERIOR BEARING WALLS |             |                     |         |        |         |         |         |
|-----------------------------------------|-------------|---------------------|---------|--------|---------|---------|---------|
| HEADERS SUPPORTING:                     | HEADER SIZE | BUILDING WIDTH (FT) |         |        |         |         |         |
|                                         |             | 20'                 |         | 28'    |         | 36'     |         |
|                                         |             | SPAN                | # JACKS | SPAN   | # JACKS | SPAN    | # JACKS |
| ROOF, CEILING                           | 2-2x4       | 3'-6"               | 1       | 3'-2"  | 1       | 2'-10"  | 1       |
|                                         | 2-2x6       | 5'-5"               | 1       | 4'-8"  | 1       | 4'-2"   | 1       |
|                                         | 2-2x8       | 6'-10"              | 1       | 5'-11" | 2       | 5'-4"   | 1       |
|                                         | 2-2x10      | 8'-5"               | 2       | 7'-3"  | 2       | 6'-6"   | 2       |
|                                         | 2-2x12      | 9'-9"               | 2       | 8'-5"  | 2       | 7'-6"   | 2       |
|                                         | 3-2x8       | 8'-4"               | 1       | 7'-5"  | 1       | 6'-8"   | 1       |
|                                         | 3-2x10      | 10'-6"              | 1       | 9'-1"  | 2       | 8'-2"   | 1       |
|                                         | 3-2x12      | 12'-2"              | 2       | 10'-7" | 2       | 9'-5"   | 2       |
|                                         | 4-2x8       | 9'-2"               | 1       | 8'-4"  | 1       | 9'-2"   | 1       |
|                                         | 4-2x10      | 11'-8"              | 1       | 10'-6" | 1       | 9'-5"   | 1       |
|                                         | 4-2x12      | 14'-1"              | 1       | 12'-2" | 2       | 10'-11" | 1       |

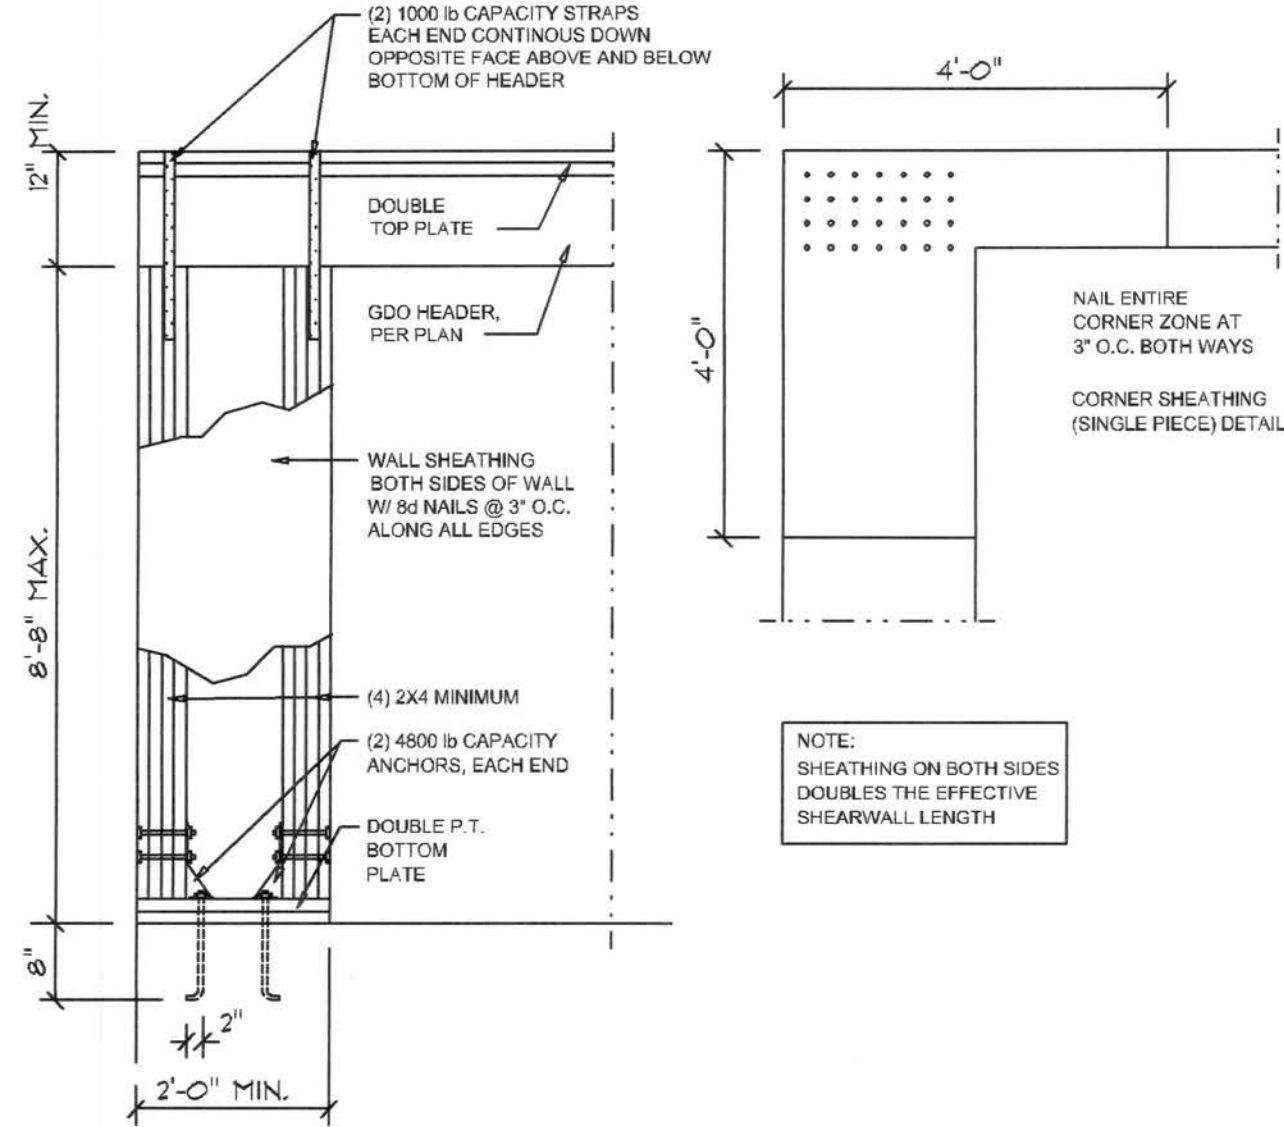

Garage End Wall DETAILS

SCALE: 1/2" = 1'-0"


G

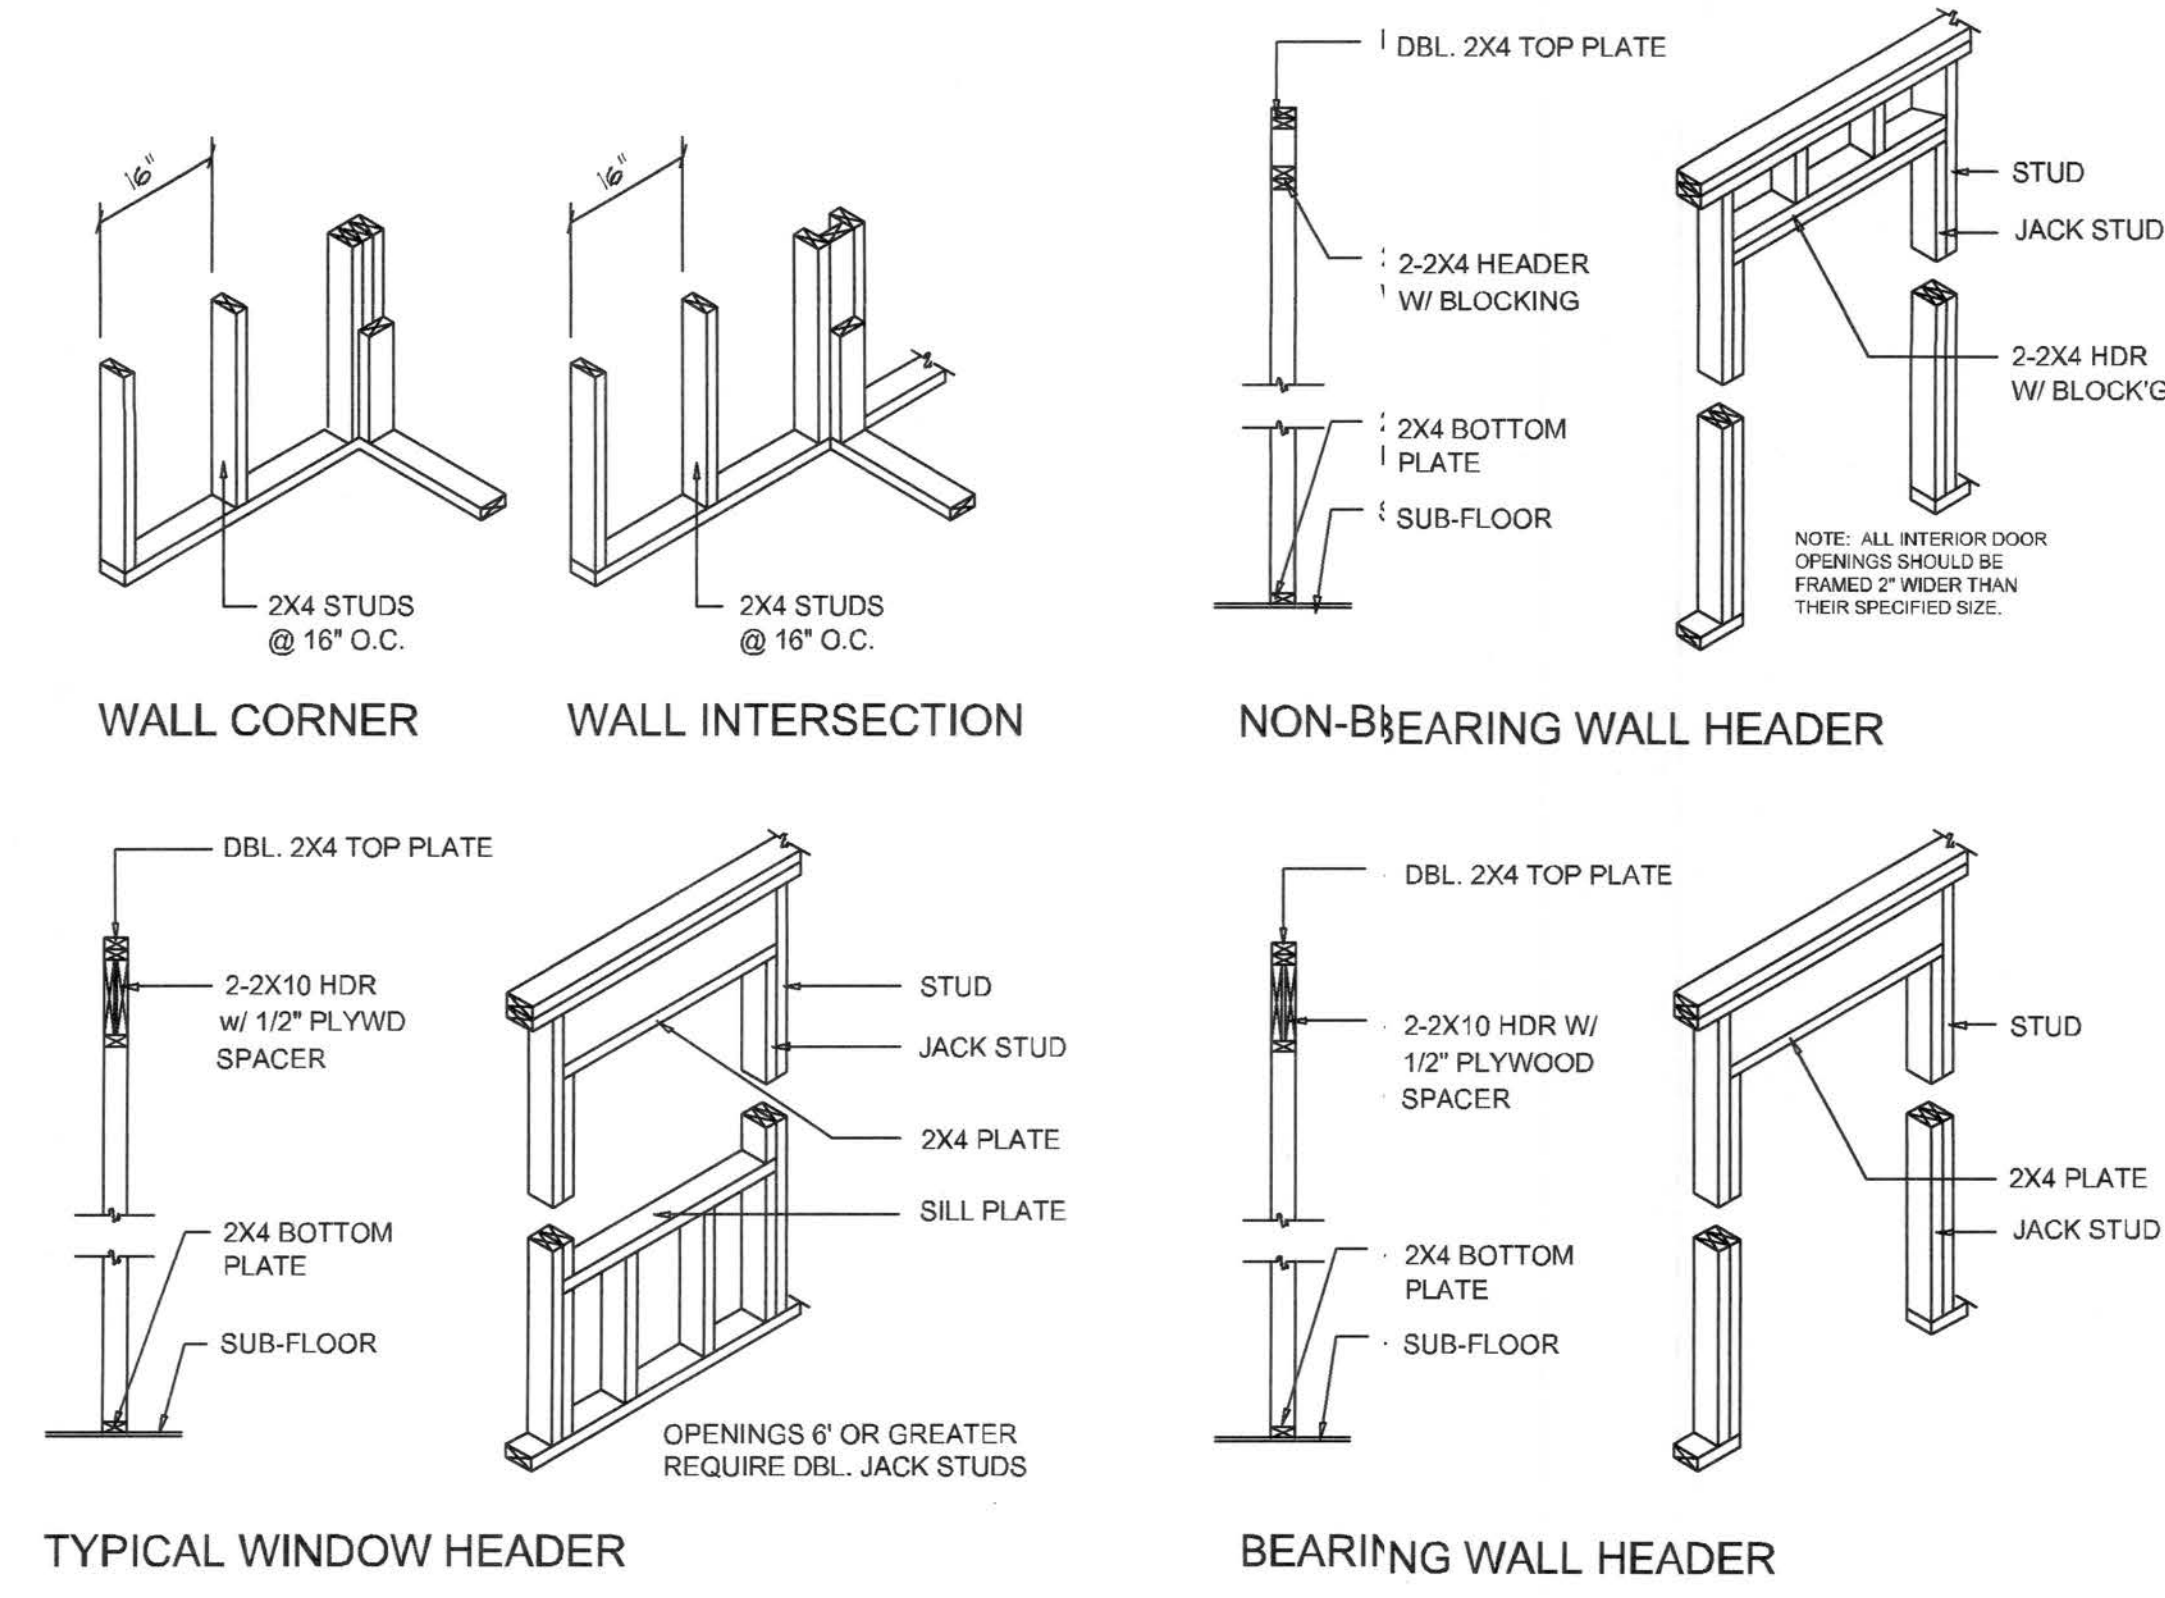

Wall Framing/Header DETAILS

SCALE: NONE


F

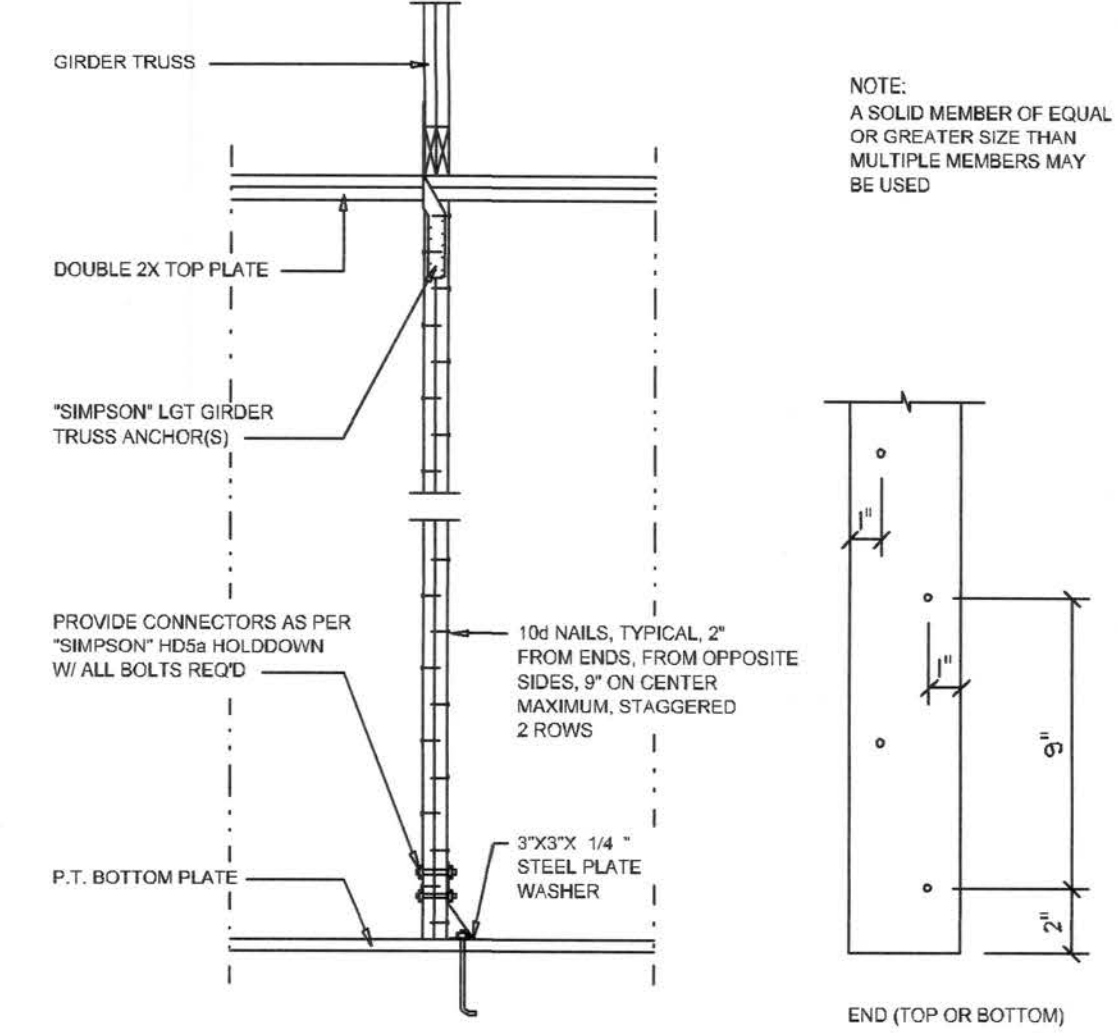

Girder Truss Column DET.

SCALE: 1/2" = 1'-0"

C

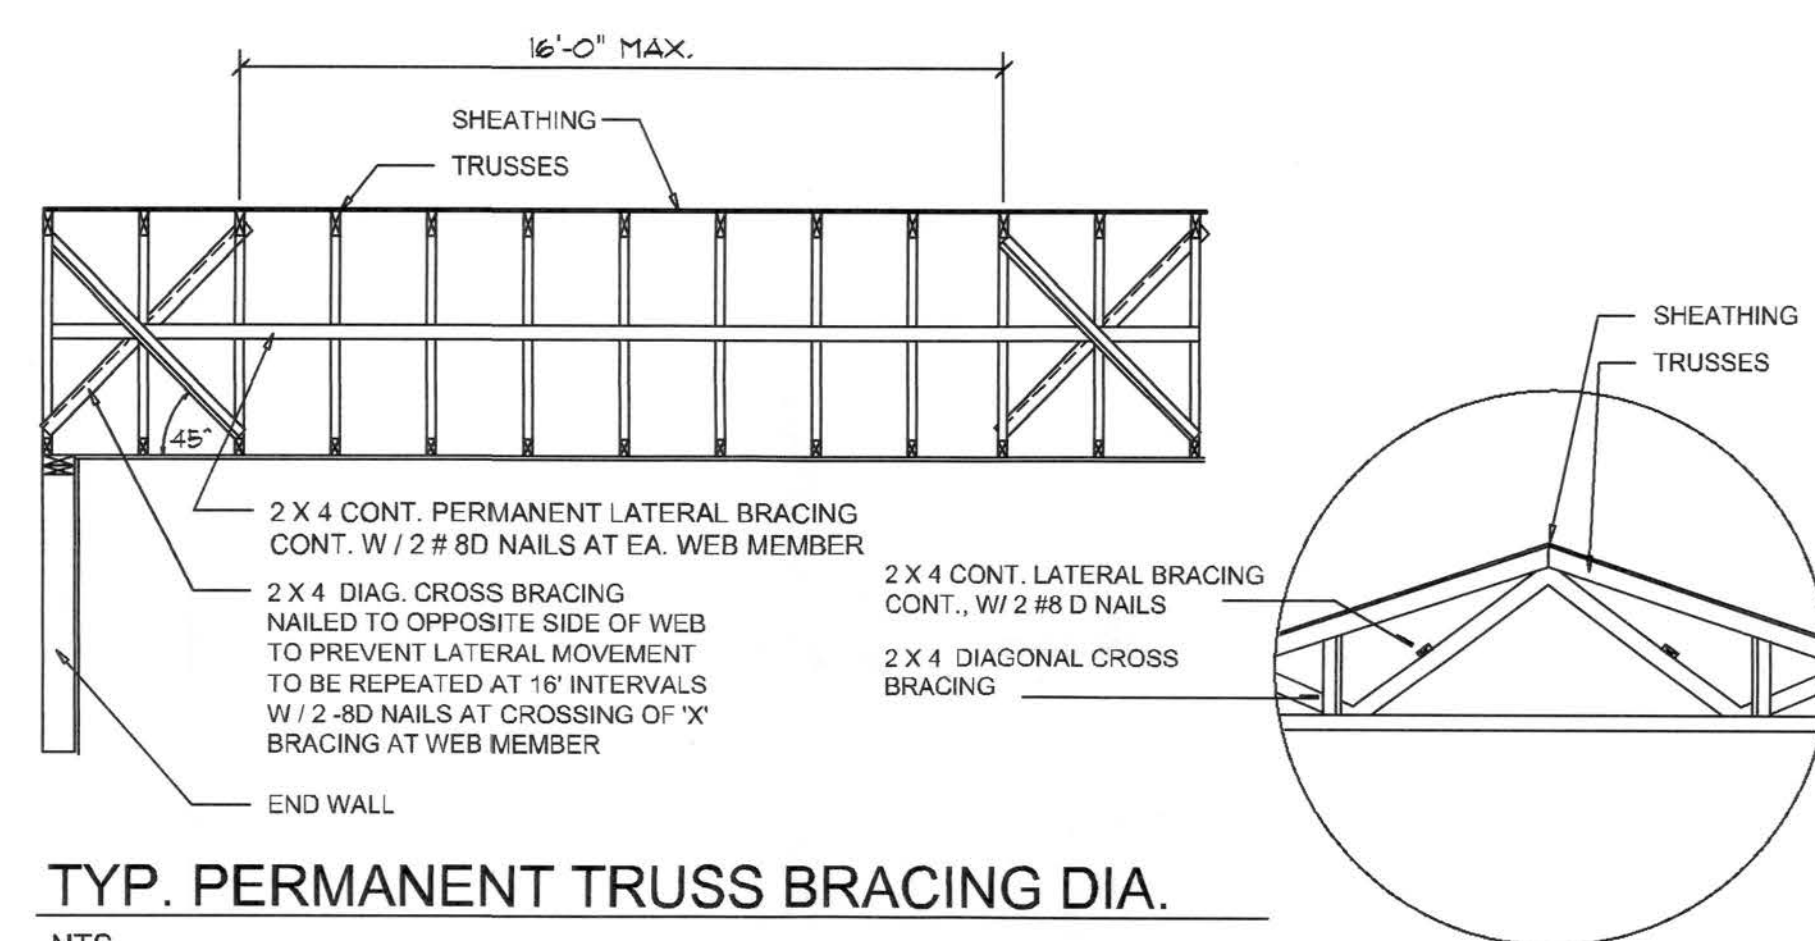


TYP. PERMANENT TRUSS BRACING DIA.

NTS  
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

Truss Bracing DETAILS

SCALE: AS NOTED

D

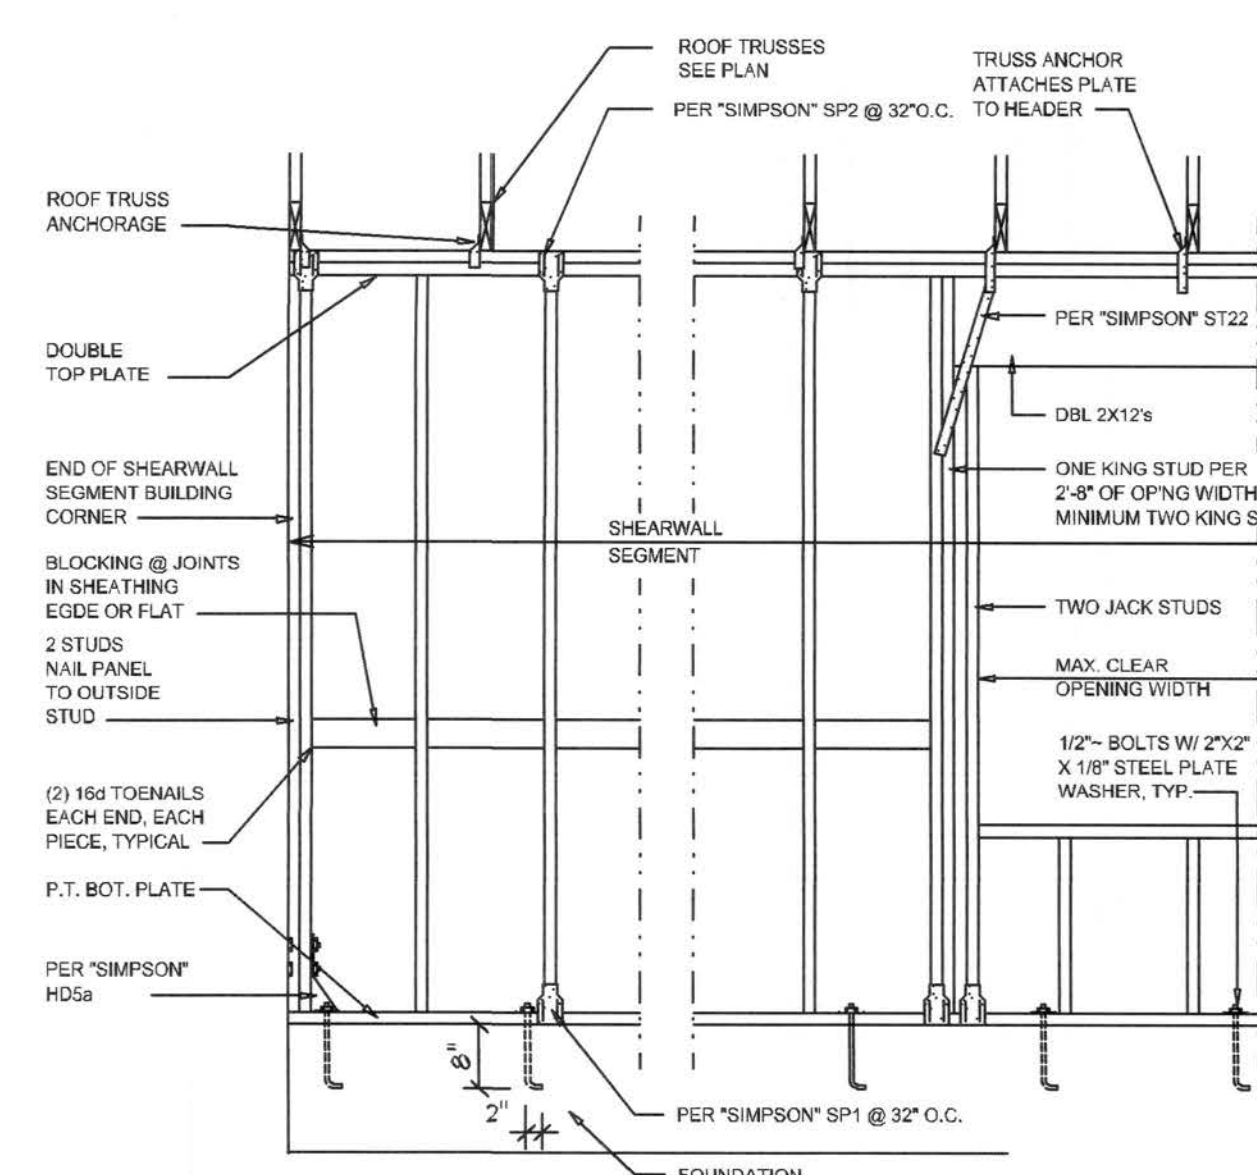

- SHEARWALL NOTES:**
- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-97 SBC 305.4.3.
  - THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
  - ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
  - NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD.
  - TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 50 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3").

| OPENING WIDTH  | SILL PLATES        | 18d TOE NAILS EACH END |
|----------------|--------------------|------------------------|
| UP TO 6'-0"    | (1) 2x4 OR (1) 2x6 | 1                      |
| > 6' TO 9'-0"  | (3) 2x4 OR (1) 2x6 | 2                      |
| > 9' TO 12'-0" | (5) 2x4 OR (2) 2x6 | 3                      |

Shear Wall DETAILS

SCALE: NONE

E


| REVISIONS    |  |
|--------------|--|
| May 23, 2007 |  |




A SPEC HOUSE FOR: CHARLES TIMMONS

MODEL 1297 (RIGHT)

PROJECT ADDRESS: NW CAROL PLACE, COLUMBIA COUNTY, FLORIDA 32055

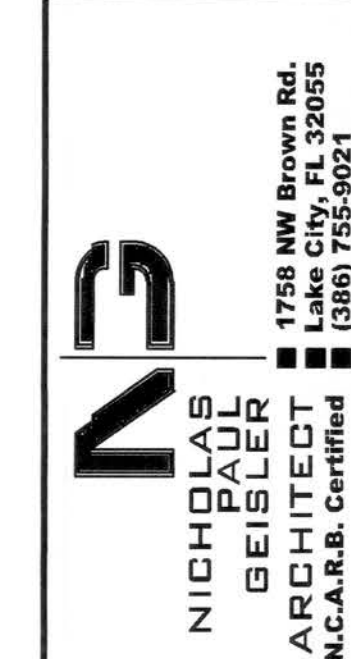

JOINT VENTURED WITH

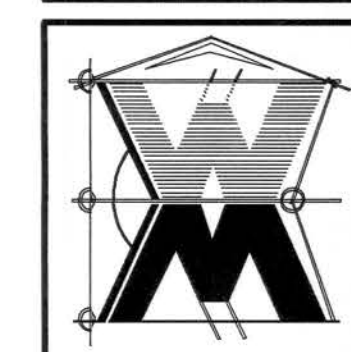

JOB NUMBER  
070515

SHEET NUMBER  
S.4  
OF 5 SHEETS

W.M. Construction