

SEE ARCHITECT DRAWINGS

BOND BEAM W/ (2) #4 CONT.

PLUS CORNER BARS

AT RETURN WALLS —

@ 16" o.c. VERT. ——

JOINT REINF.

(2) #4 @ 24" o.c.

#4 DOWELS

🕹 LAP 2'-0" MIN. —

VERT. & DOWEL —

E.O. #4 BAR TO HOOK

#4 @ 12" o.c. E.W. ——

TYPICAL DUMPSTER MASONRY SCREEN WALL

WALL REINF. ——

DUMPSTER SLAB

22 DETAIL

ADD (4) #4

SEE ARCH.

CONC. DUMPSTER PAD: SEE SLAB SCHEDULE

ON SHT S1.0

8" CMU WALL.

TYP. U.N.O.

— THICKENED EDGE

BELOW MAS. WALL-

SEE DTL NOTED.

/ 22 \

S2.0 / TYP

OF SLAB FDN

SEE ARCH.

THICKEN EDGE OF PAD

SLAB ABUTTING SITE PAVEMENT/GRADING.

SEE DTL 23/S2.0 ----

CONTRACTION OR

- BOND BEAM AT TOP OF WALL AND

JOIST BEARING W/ (2) #5 CONT.

- APPROVED REBAR COUPLERS DEVELOPING 125% OF YIELD MAY

BE USED

MAY VARY

CMU WALL WIDTH

- LAP-SEE SCHEDULE

ON S0.1

DOWEL TO MATCH

- (2) #5 CONT. BOTT., SEE DTL

5/S2.0 FOR CORNER BARS

VERTICAL REINF.

- SEE DTL 15/S4.0 FOR CORNER

CONSTRUCTION JOINTS


EXTENDED FOUNDATION FOR GATE POST FOUNDATION (COORD. REQ. WITH GATE MANUFACTURER) —


21 DETAIL

DUMPSTER ENCLOSURE

SEE DETAIL ON S2.0 -

FOR T/WALL ELEV. & COPING ---

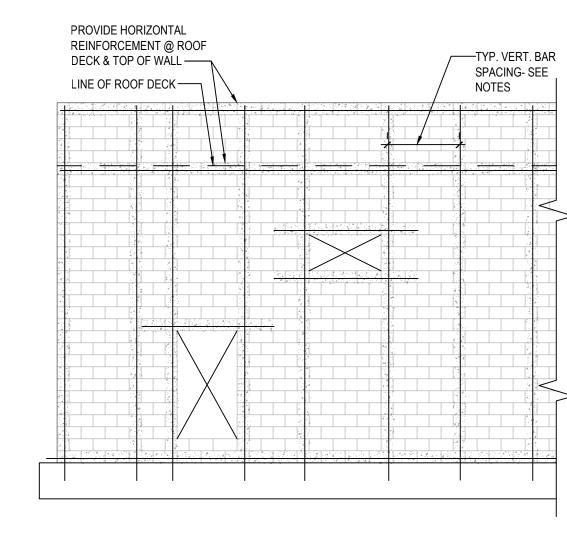

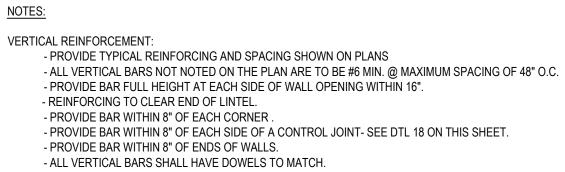

HORIZONTAL REINFORCEMENT:
- PROVIDE HORIZONTAL JOINT REINFORCING - #4 BAR OR GALVANIZED 9 GAGE SIDE
AND CROSS RODS, LADDER TYPE SPACED @ 16" O.C. VERTICALLY.
- PROVIDE #5 AT THE TOP & BOTTOM OF ALL OPENINGS 1'-4" OR LARGER. EXTEND BAR PAST THE
EDGE OF THE OPENING BY THE GREATER OF 24" OR 40 BAR DIAMETERS.
- PROVIDE HORIZONTAL REINFORCEMENT CONTINUOUSLY @ STRUCTURALLY CONNECTED ROOF
AND FLOOR LEVELS AND WITHIN 16" OF TOP OF WALL

- LAP LENGTHS SHALL COMPLY W/ GENERAL NOTES ON S0.1. - REINFORCING SHALL BE COORDINATED W/ARCHITECTURAL ELEVATIONS, PLANS & DETAILS. - MASONRY PIERS SHALL BE SIZED AND LOCATED AS DETAILED ON THE PLANS. - FOR CONDITIONS AT BEAM BEARINGS AND LINTELS SEE TYPICAL DETAILS. - PROVIDE ADDITIONAL BOND BEAMS AS SHOWN IN SECTIONS. - ALL CELLS WITH REINFORCEMENT SHALL BE GROUTED

19	DETAIL
	ORDINARY REINFORCED MASONRY SHEAR WALL



EQUAL (+/-1/2)

SEE PLAN FOR


USE LOW LIFT GROUTING

PROCEDURES PER

ACI 530.1 SECTION 3.5

VERTICAL REINF.

SIZE AND SPACING —

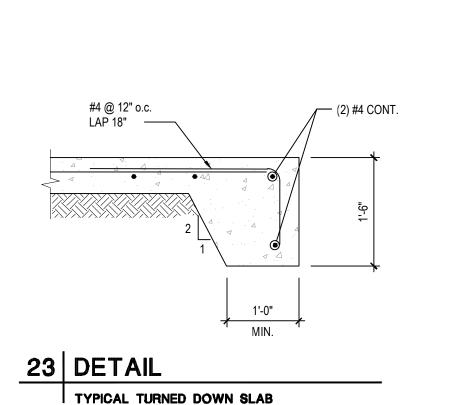

O

04/25/2025

Design and construction documents as

instruments of services are given in confidence and remain the property of Onyx

Creative. The use of this design and these construction documents for purposes other

than the specific project named herein is strictly prohibited without expressed written

SCHEDULE I 4-24-2025

SCHEDULE II -

consent of Onyx Creative.

Project No.: 24.0808 Drawn By: Issue 4-24-2025 Bid & Permit