

- A. THE 2023 FLORIDA BUILDING CODE
- B. ASCE 7-22
- C. ACI 318-19 CONCRETE REFERENCE MANUAL
- D. AISC STEEL CONSTRUCTION MANUAL (17TH EDITION)
- E. AWS D1.1: STRUCTURAL WELDING

1. THESE PLANS BELONG EXCLUSIVELY TO THE STRUCTURE, INCLUDING MAIN WIND FORCE RESISTING SYSTEM (MWFRS), COMPONENTS AND CLADDING (C&C), AND BASE RAIL ANCHORAGE. OTHER DESIGN ISSUES, INCLUDING BUT NOT LIMITED TO PROPERTY SET-BACKS, ELECTRICAL, PLUMBING, INGRESS/EGRESS, FINISH FLOOR SLOPES AND ELEVATIONS, OR OTHER LOCAL ZONING REQUIREMENTS ARE THE LIABILITY OF OTHERS.

2. THESE STRUCTURES ARE ENGINEERED AS (RISK CATEGORY II) CAPABLE OF SUPPORTING DEAD LOAD OF THE STRUCTURE AND LIVE AND WIND LOADS. UPGRADES NOT SPECIFICALLY ADDRESSED HEREIN, SUCH AS WINDOWS, DOORS, OR ANOTHER COMPONENT NOT LISTED IN THE BUILDING CODE APROVED PRODUCT LIST, AND NOT PROVIDED AND INSTALLED BY THE CONTRACTOR, WHICH CAUSE ADDITIONAL LOADS ON THE STRUCTURE SHALL BE AT THE OWNER'S RISK. THE ENGINEER SHALL NOT BE RESPONSIBLE FOR FAILURE OR STRUCTURAL DAMAGE DUE TO THE EXTRA LOAD.

3. ALL STEEL TUBING SHALL BE 50 KSI GALVANIZED STEEL. ALL FASTENERS SHALL BE ZINC COATED HARDWARE.

4. SPECIFICATIONS APPLICABLE TO METAL PANELS FASTENED DIRECTLY TO TUBE STEEL (TS) FRAMING MEMBERS FOR VERTICAL PANELS, METAL PANELS SHALL BE FASTENED TO HAT CHANNELS (UNLESS OTHERWISE NOTED).

DESIGN LOAD NOTES:

- 1. BASIC WIND SPEED = 110 MPH
EXPOSURE CATEGORY = C
RISK CATEGORY = I


- 2. DESIGN LIVE LOAD = 20 PSF

THE ENGINEERING ON THESE PLANS IS SITE SPECIFIC FOR (1) STRUCTURE ONLY AT THE PROVIDED ADDRESS(ES).

ENCLOSED METAL BUILDING DESIGN
MAXIMUM 30'-0" WIDE X 14'-0" EAVE HEIGHT
A-FRAME & REGULAR STYLE



This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

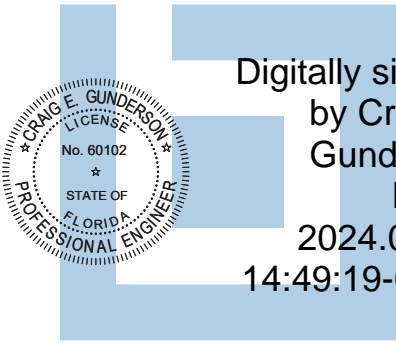

Digitally signed
by Craig E Gunderson
Date:
2024.01.09
14:49:19-05'00'

MEMBER LEGEND

- 1. POST = 2.5"X2.5"X14GA TUBE W/ 2.25"X2.25"X14GA TUBE INSERT
- 2. ROOF GABLE BEAM = 2.5"X2.5"X14GA TUBE
- 3. BASE RAIL = 2.5"X2.5"X14GA TUBE
- 4. PEAK BRACE = 2.5"X2.5"X14GA TUBE/2.5"X1.5"X18GA CHANNEL
- 5. KNEE BRACE = 2.5"X1.5"X14GA CHANNEL
- 6. CONNECTOR SLEEVE = 2.25"X2.25"X12GA TUBE
- 7. BASE ANGLE = 2"X2"X3"X3/16" ANGLE
- 8. PURLIN = 4.25"X1.5"X18GA / 14GA HAT CHANNEL
- 9. GIRT = 4.25"X1.5"X18GA / 14GA HAT CHANNEL
- 10. SHEATHING = 29 GA CORRUGATED SHEET
- 11. END WALL POST = 2.5"X2.5"X14GA TUBE
- 12. DOOR POST = 2.5"X2.5"X14GA TUBE
- 13. SINGLE HEADER = 2.5"X2.5"X14GA TUBE
- 14. DOUBLE HEADER = (2) 2.5"X2.5"X14GA TUBE
- 15. SERVICE DOOR / WINDOW FRAMING = 2.5"X2.5"X14GA TUBE
- 16. ANGLE BRACKET = 2"X2"X2"X14GA ANGLE
- 17. STRAIGHT BRACKET = 2"X2"X4"X14GA PLATE
- 18. PB SUPPORT = 2.5"X2.5"X14GA TUBE
- 19. DIAGONAL BRACE = 2"X2"X14GA TUBE
- 20. GABLE BRACE = 2"X2"X14GA TUBE
- 21. DB BRACKET = 2.25"X2.25"X6"X14GA ANGLE
- 22. TRUSS SPACER = 2.5"X2.5"X14GA TUBE
- 23. ALL FASTENERS = #12X1" SDS (ESR-2196 OR EQ.)

FRAMING NOTES:

- 1. MAX POST SPACING = 4'-0" O.C.
- 2. MAX ROOF SLOPE = 3V:12H
- 3. ALL SHOP CONNECTIONS SHALL BE WELDED CONNECTIONS.
- 5. ALL FIELD CONNECTIONS SHALL BE #12X1" SDS (ESR-2196 OR EQUIVALENT).
- 6. STEEL SHEATHING SHALL BE 29GA CORRUGATED GALVANIZED OR PAINTED STEEL – MAIN RIB HEIGHT ¾" (80 KSI YIELD STRENGTH) OR EQUIVALENT.
- 7. ALL STRUCTURAL LIGHT GAUGE TUBING AND CHANNELS SHALL BE GRADE 50 STEEL.
- 8. STRUCTURAL TUBE TS 2.5"X2.5"X14GA IS EQUIVALENT TO TS 2.25"X2.25"X12GA AND EITHER MAY BE USED IN LIEU OF THE OTHER.

FLORIDA ENGINEERING LLC

4161 TAMiami TRAIL, UNIT 101


PORT CHARLOTTE, FLORIDA 33952

(941) 391-5980

FLeng.com

Orders@FLeng.com

CA CERT. #30782



PROJECT NO. 2400857

CONTRACTOR:

MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:

THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE





REVISION 2: DATE

DRAWN BY: NRB







SCALE: NTS

PAGE :

1

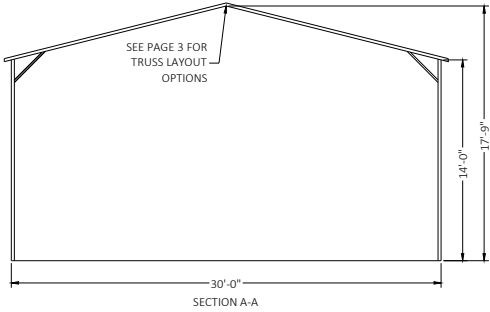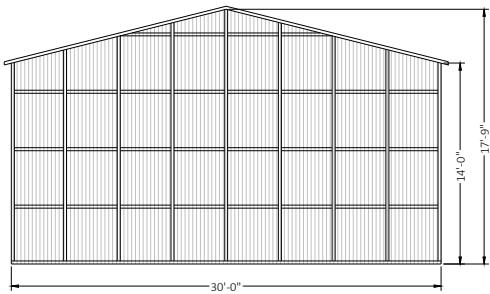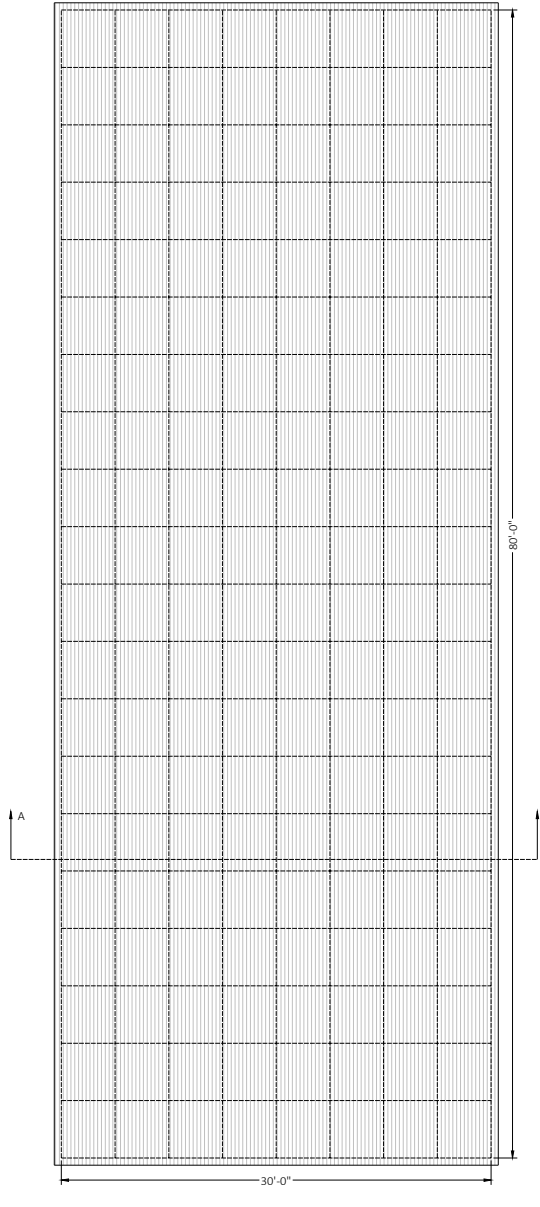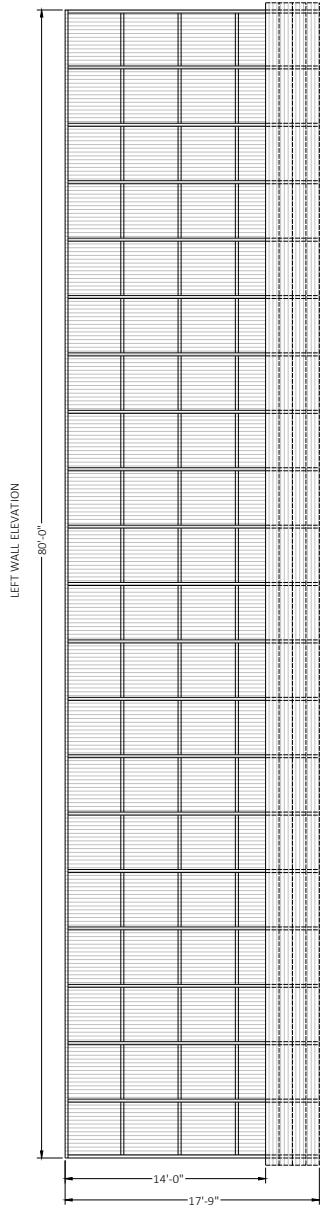


A-FRAME STYLE BUILDING

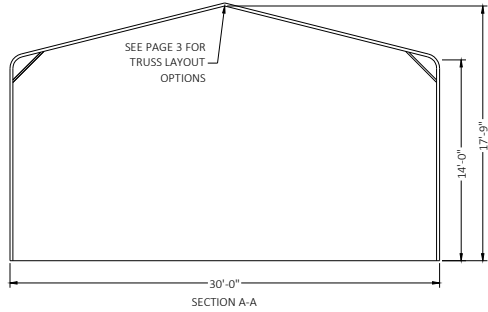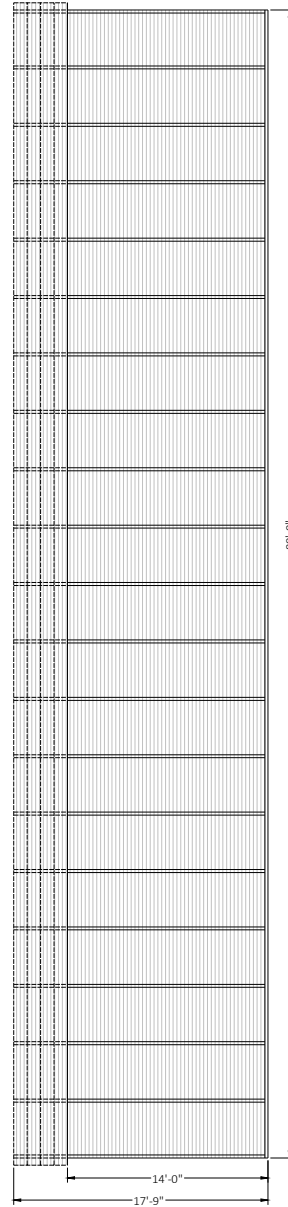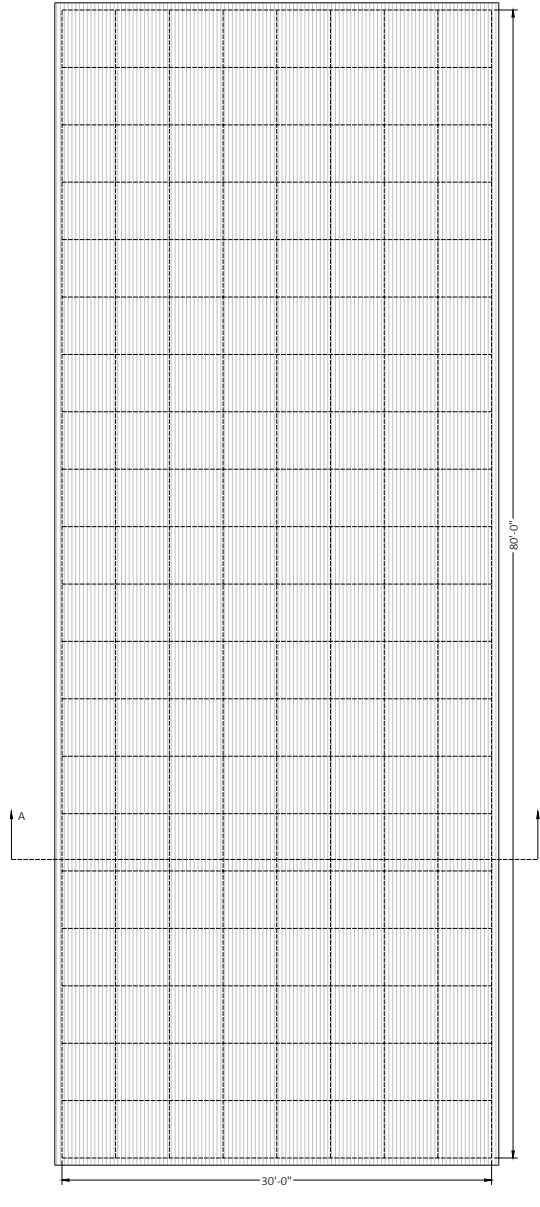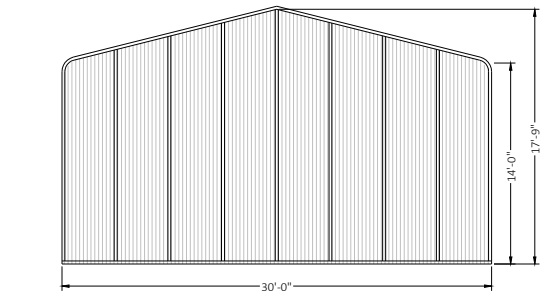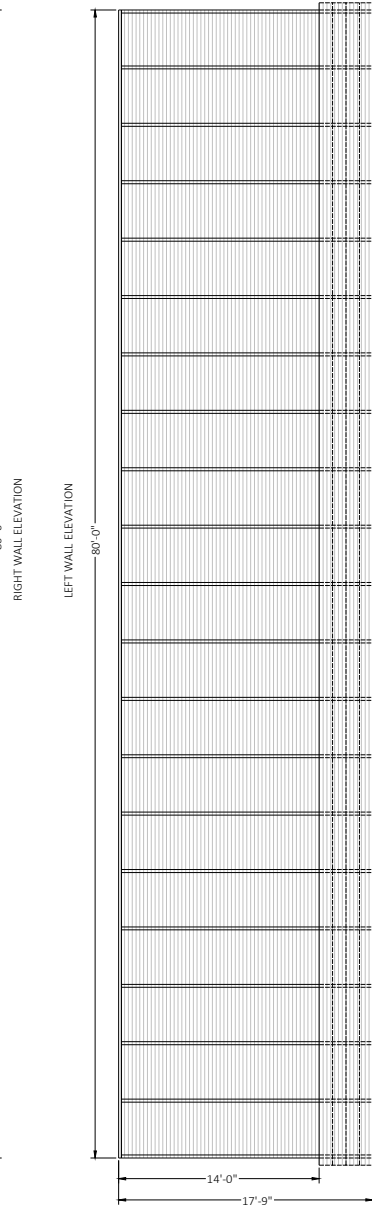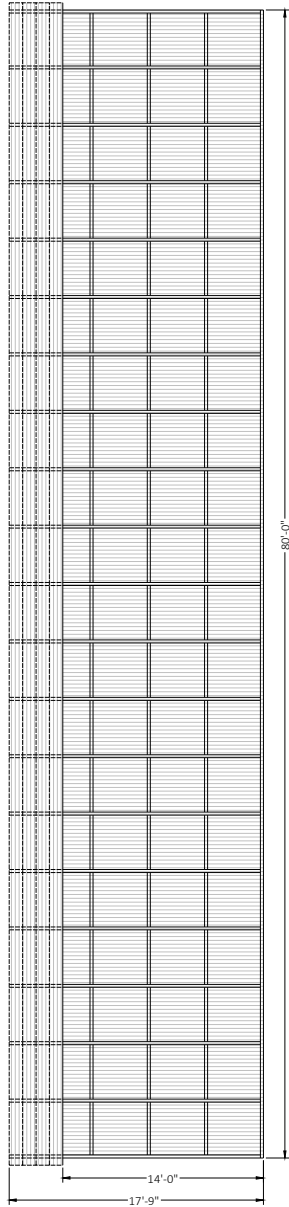

REGULAR STYLE BUILDING

This item has been electronically signed and sealed by Craig E. Gunderson, P.E. on date below using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed
by Craig E Gunderson
Date:
2024.01.09
14:49:20-05'00'



FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com

CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:

THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE


REVISION 2: DATE

DRAWN BY: NRB


SCALE: NTS

PAGE :


2

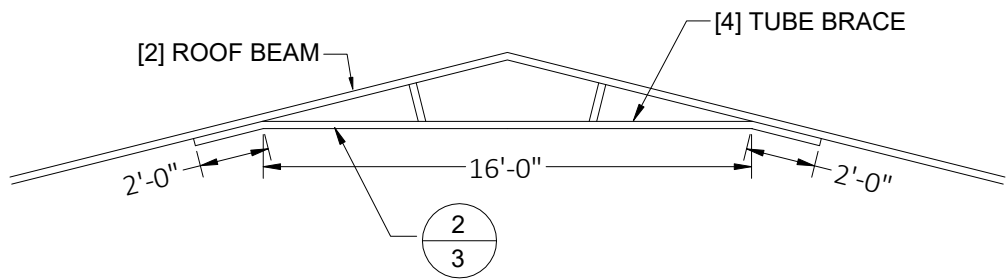


TUBE BRACE
TRUSS DETAIL
SCALE: N.T.S.

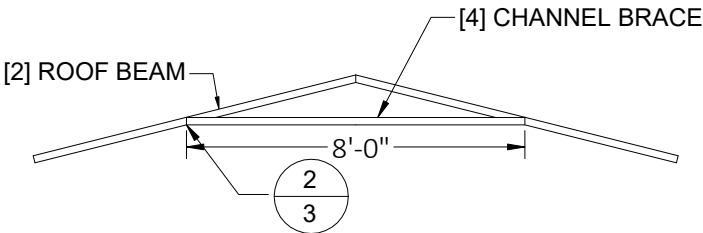

CHANNEL BRACE
TRUSS DETAIL
SCALE: N.T.S.

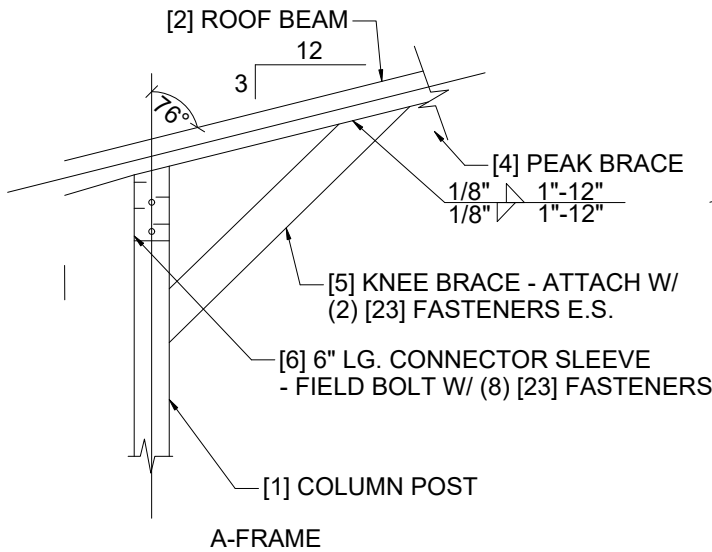


A-FRAME

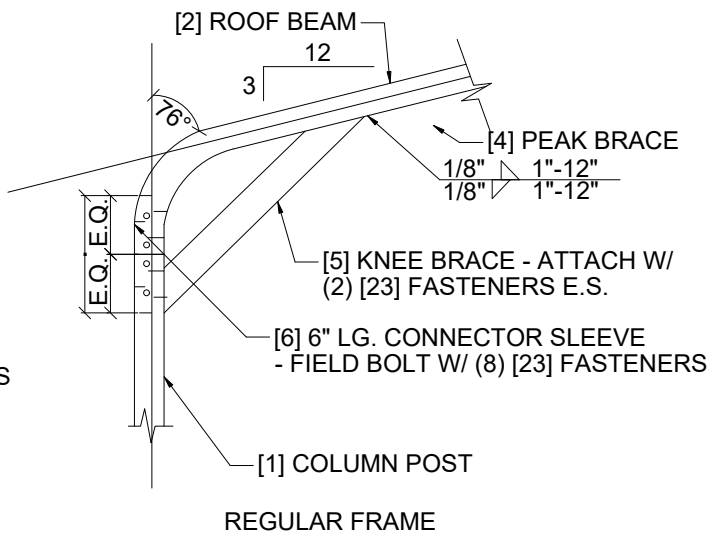


REGULAR FRAME

1. EAVE DETAIL OPTIONS

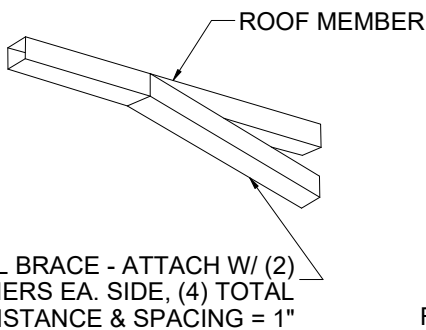


[4] CHANNEL BRACE - ATTACH W/ (2)
[23] FASTENERS EA. SIDE, (4) TOTAL
MIN. EDGE DISTANCE & SPACING = 1"

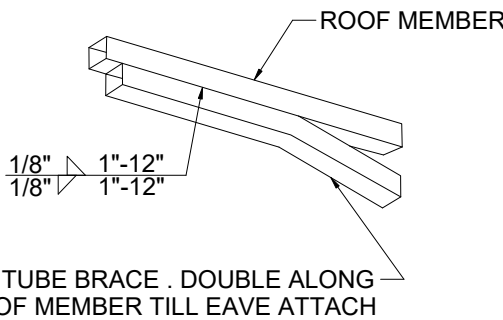


[4] TUBE BRACE . DOUBLE ALONG
ROOF MEMBER TILL EAVE ATTACH

2. PEAK BRACE CONNECTION DETAILS

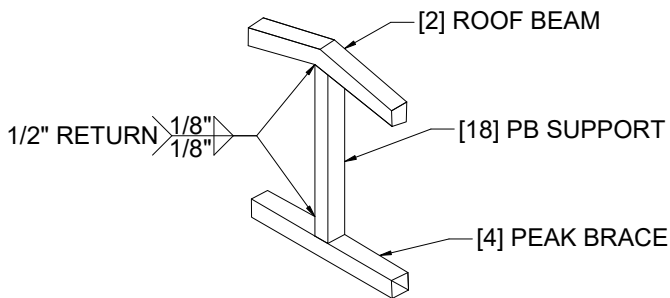


4. PB SUPPORT DETAIL

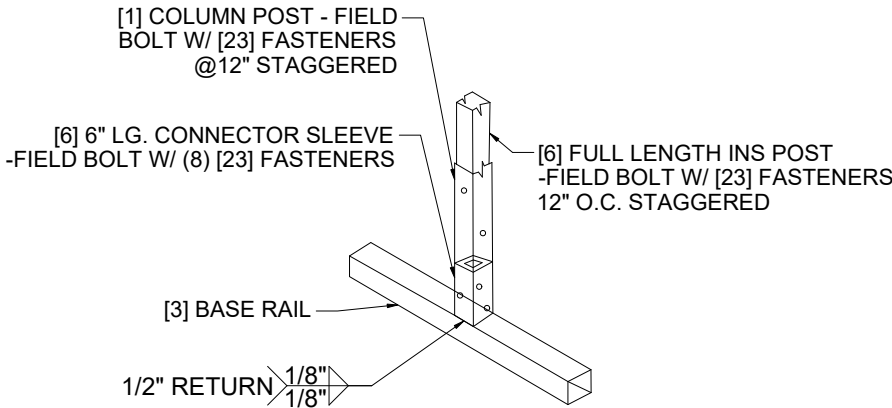

3. BASE DETAIL


NOTE : COLUMN POST MAY BE ADJUSTED +/- 1" FOR LEVELING.
MANUFACTURER IS NOT RESPONSIBLE FOR LEVELING OF GROUND
AND/OR CONCRETE SURFACE PROVIDED BY OTHERS.

This item has been digitally
signed and sealed by Craig E.
Gunderson, P.E. on the date
adjacent to the seal. Printed
copies of this document are not
considered signed and sealed and
the signature must be verified on any
electronic copies.

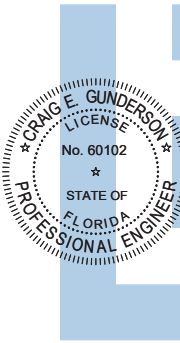

Digitally signed
by Craig E
Gunderson
Date:
2024.01.09
14:49:21-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:

THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE

REVISION 2: DATE

DRAWN BY: NRB


SCALE: NTS

PAGE :


3

() BRACKETS DENOTE QUANTITY


[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

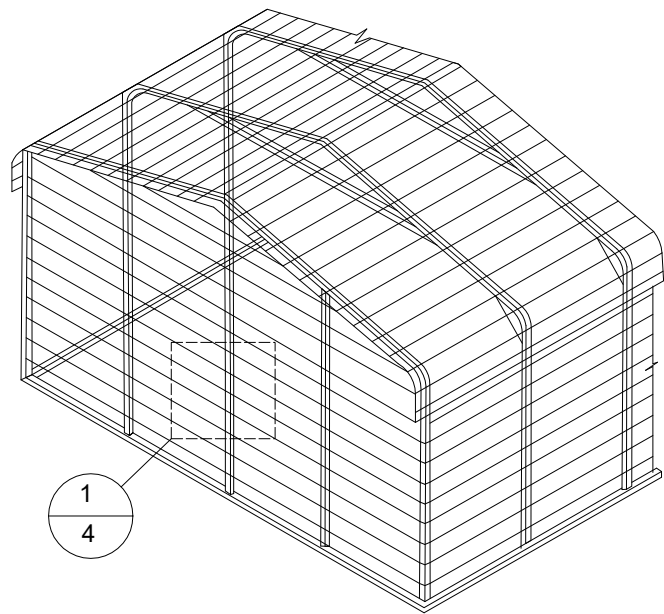


TYP. HORIZONTAL SHEATHING

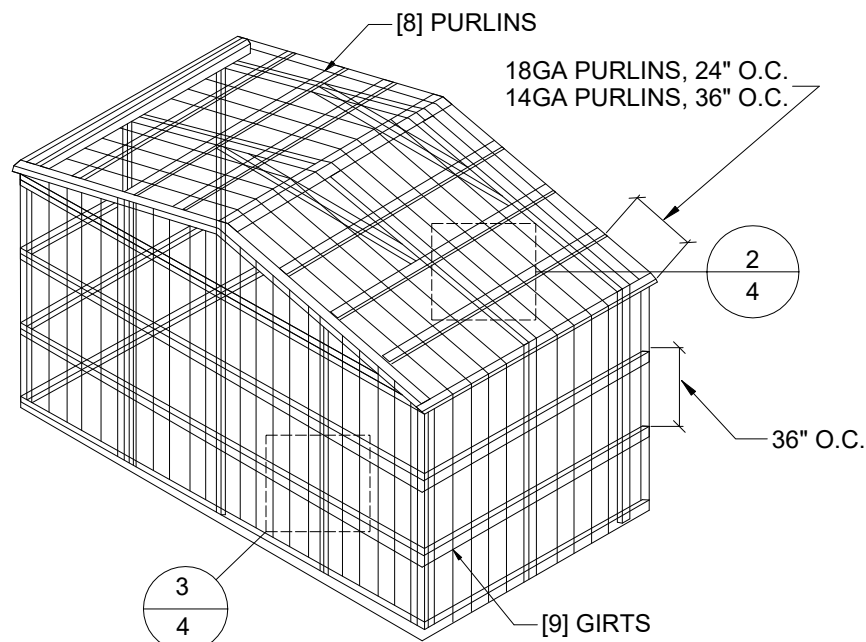


TYP. VERTICAL SHEATHING

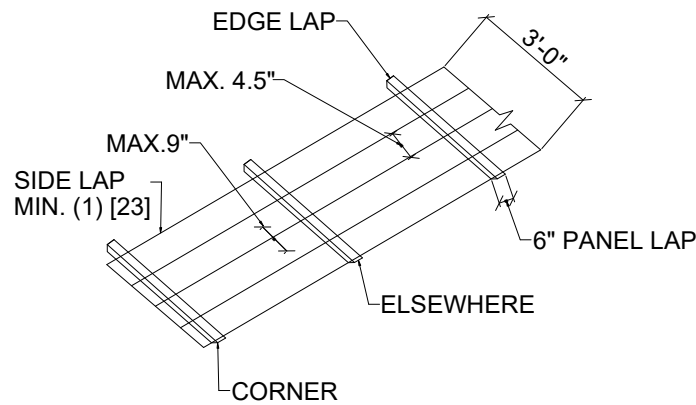


TYP. SHEATHING FASTENER SCHEDULE

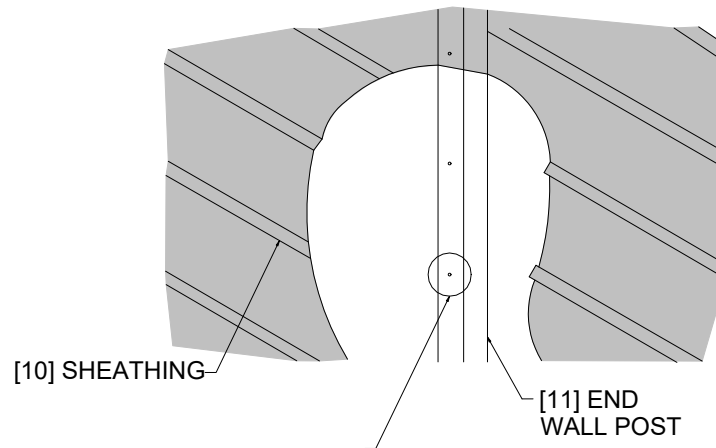


1. TYP. HORIZONTAL SHEATHING DETAILS

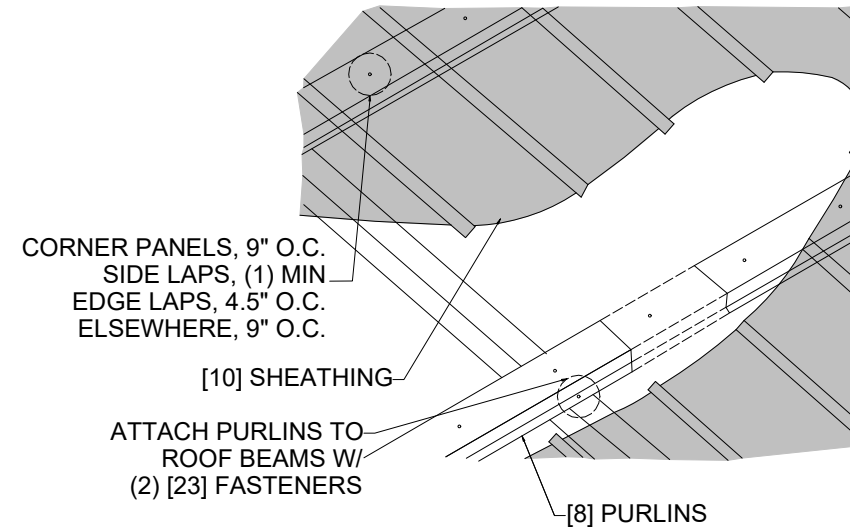

2. ROOF VERTICAL SHEATHING DETAILS

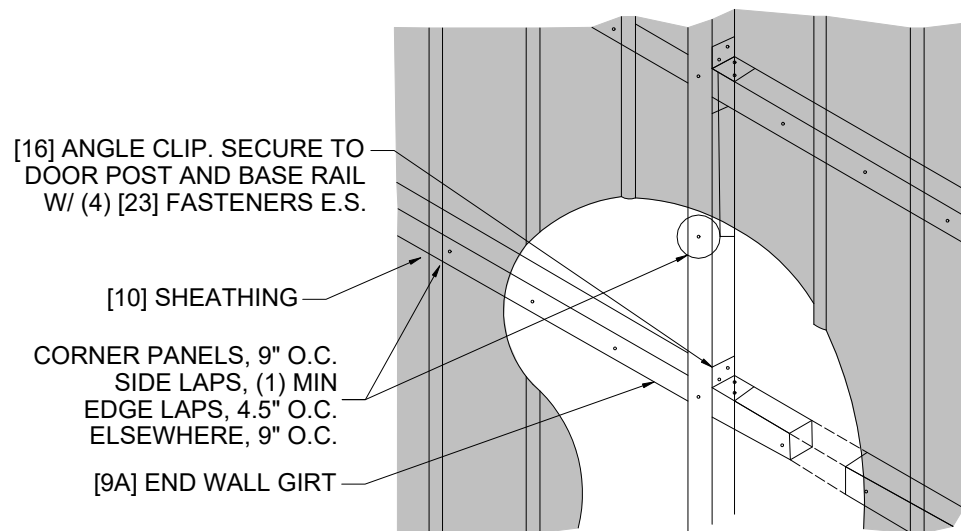


3. WALL VERTICAL SHEATHING- TUBE DETAILS

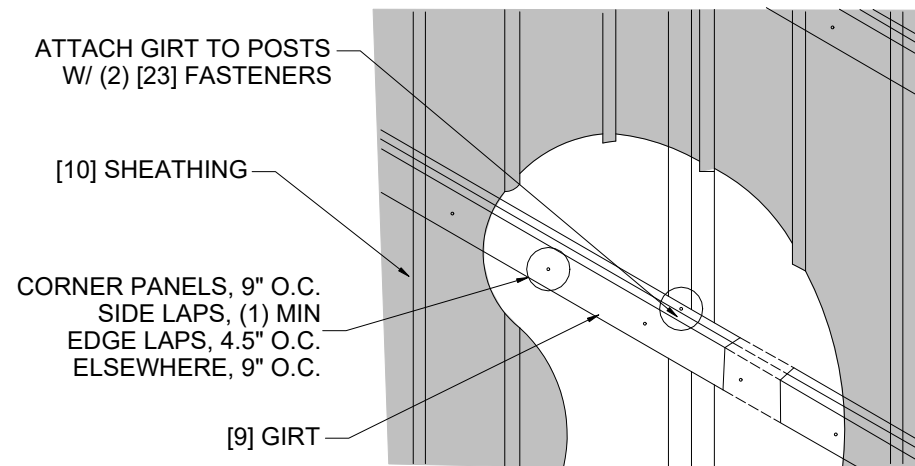

3. WALL VERTICAL SHEATHING- HAT CHANNEL DETAILS


- GENERAL SHEATHING NOTES:
1. REGULAR STYLE BUILDING CAN ONLY HAVE HORIZONTAL SHEATHING ON ROOF AND WALLS.
 2. A FRAME STYLE BUILDING CAN HAVE ANY COMBINATION OF HORIZONTAL OR VERTICAL SHEATHING ON ROOF AND WALLS.
 3. BOTH HORIZONTAL AND VERTICAL ROOF SHEATHING CAN HAVE MAX. 6" OVERHANG.
 4. USING VERTICAL SHEATHING MAY ALLOW FOR GREATER FRAME SPACING.
 5. VERTICAL SHEATHING RECOMMENDED FOR 40'-0" WIDE BUILDING.

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed
by Craig E
Gunderson
Date:
2024.01.09
14:49:21-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:
THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE

REVISION 2: DATE

DRAWN BY: NRB


SCALE: NTS

PAGE :


4

() BRACKETS DENOTE QUANTITY


[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

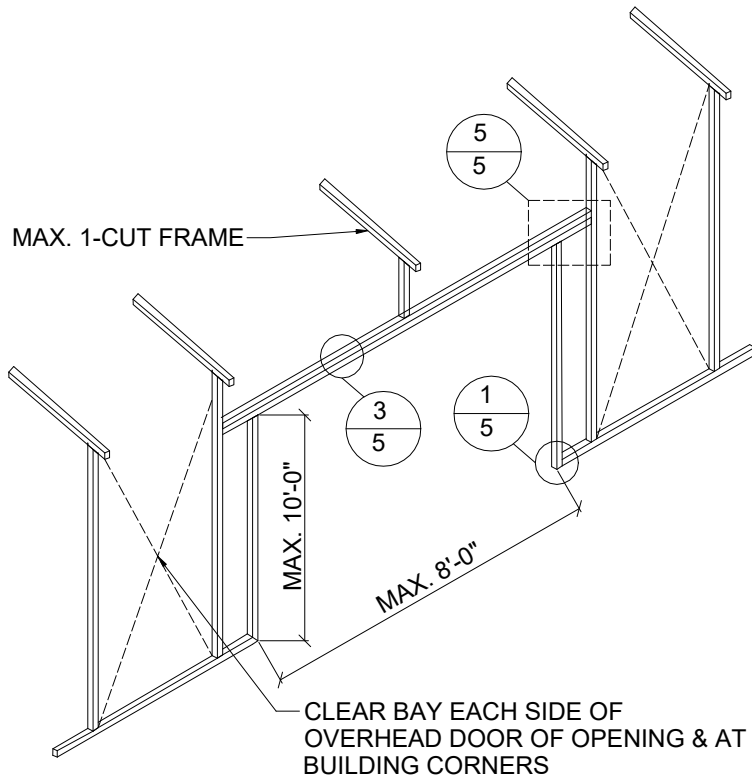


SIDE WALL OVERHEAD DOOR OPENINGS

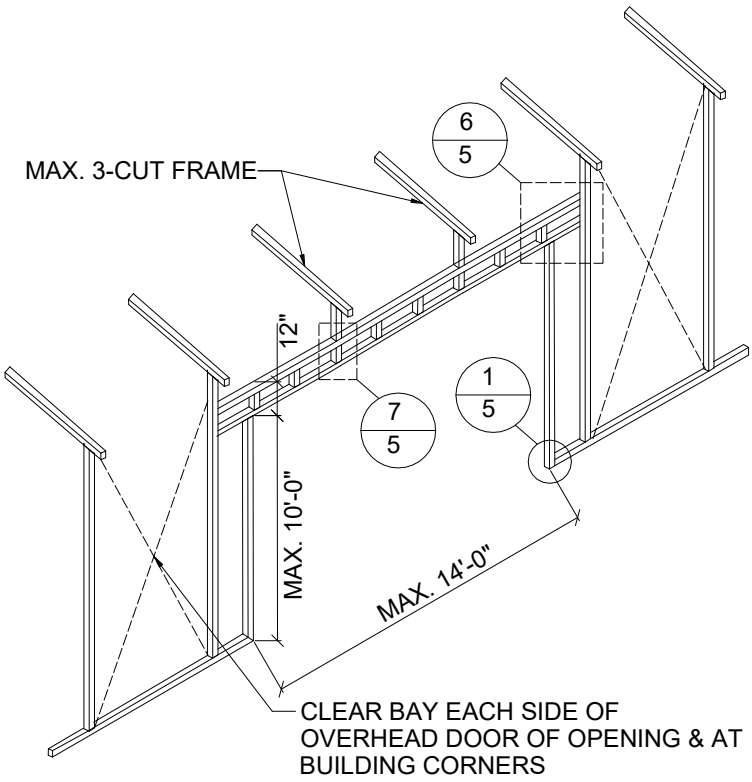


SIDE WALL OVERHEAD DOOR OPENINGS WITH TRUSS STYLE HEADER

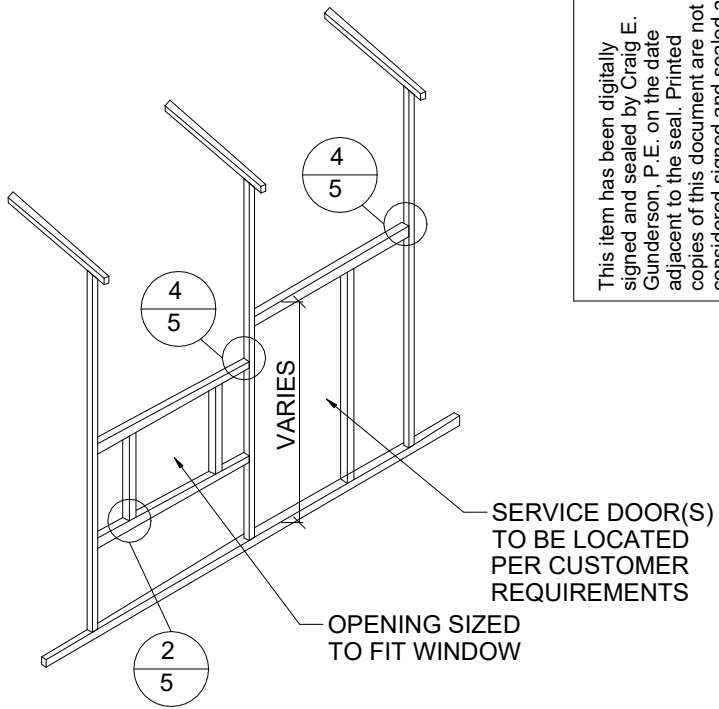


SIDE WALL SERVICE OVERHEAD DOOR/ WINDOW OPENINGS

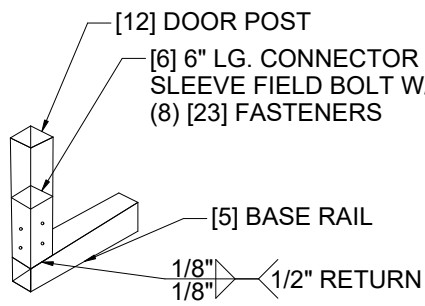


1. DOOR POST BOT. CONN. DETAILS

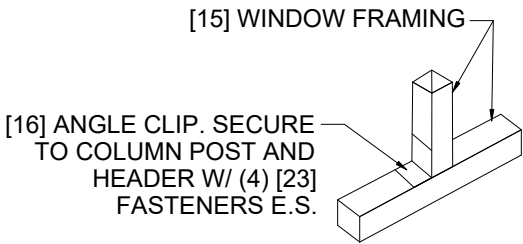


2. TYP. WINDOW FRAMING CONN. DETAILS

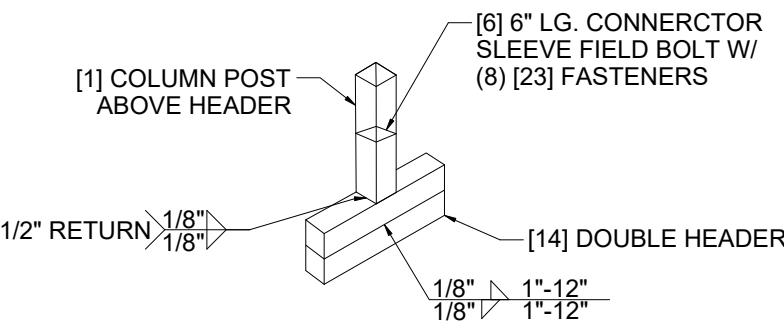


3. COLUMN POST ABOVE DBL. DOOR HEADER CONN. DETAIL

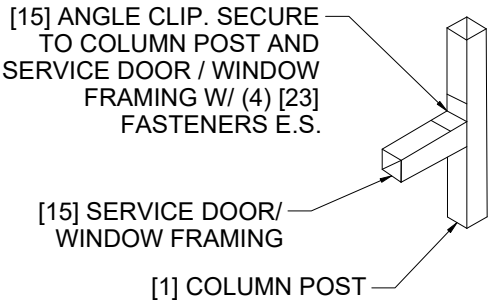


4. TYP. SERVICES DOOR/ WINDOW FRAMING CONN. DETAILS

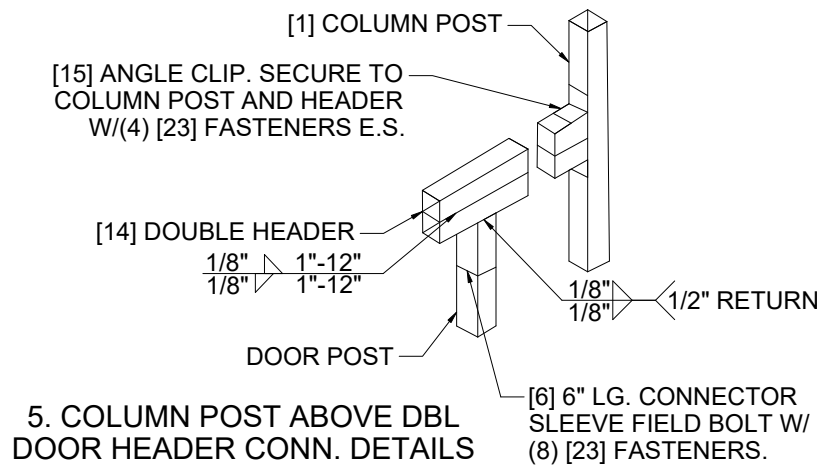

5. COLUMN POST ABOVE DBL DOOR HEADER CONN. DETAILS

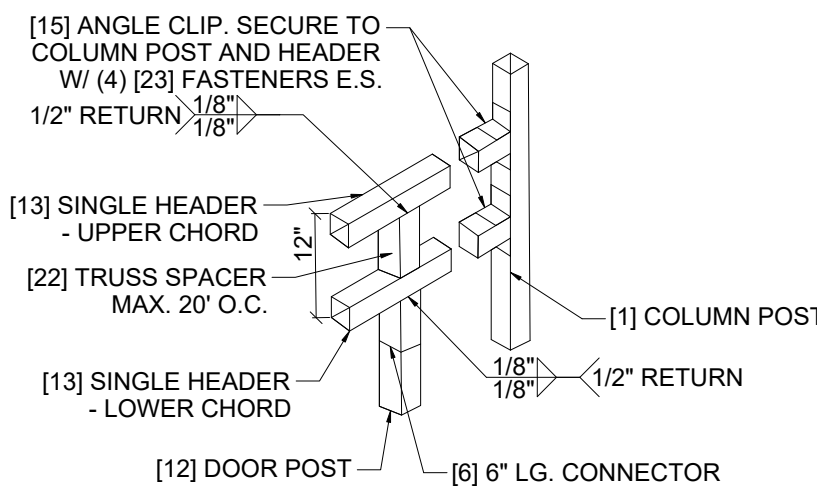


6. COLUMN POST ABOVE TRUSS DOOR HEADER CONN. DETAILS

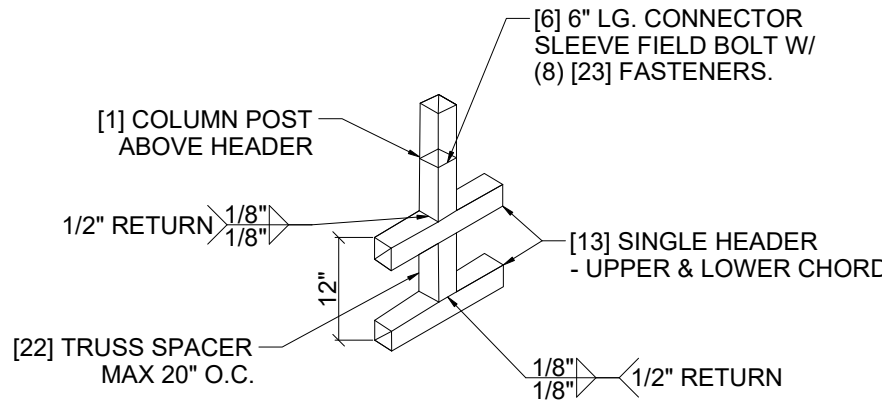


7. COLUMN POST ABOVE TRUSS DOOR HEADER CONN. DETAILS

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by Craig E Gunderson Date: 2024.01.09 14:49:22-05'00'





FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLeng.com
Orders@FLeng.com



PROJECT NO. 2400857 CA CERT. #30782

CONTRACTOR: MARTINEZ CARPORTS LLC		PROJECT DESCRIPTION: THOMAS 6129 SW COUNTY RD 18 FORT WHITE FL 32038	
DESIGN DATE:		01/09/2024	
REVISION 1:		DATE	
REVISION 2:	DATE	PAGE 5	
DRAWN BY:	NRB		
SCALE:	NTS		


() BRACKETS DENOTE QUANTITY
[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

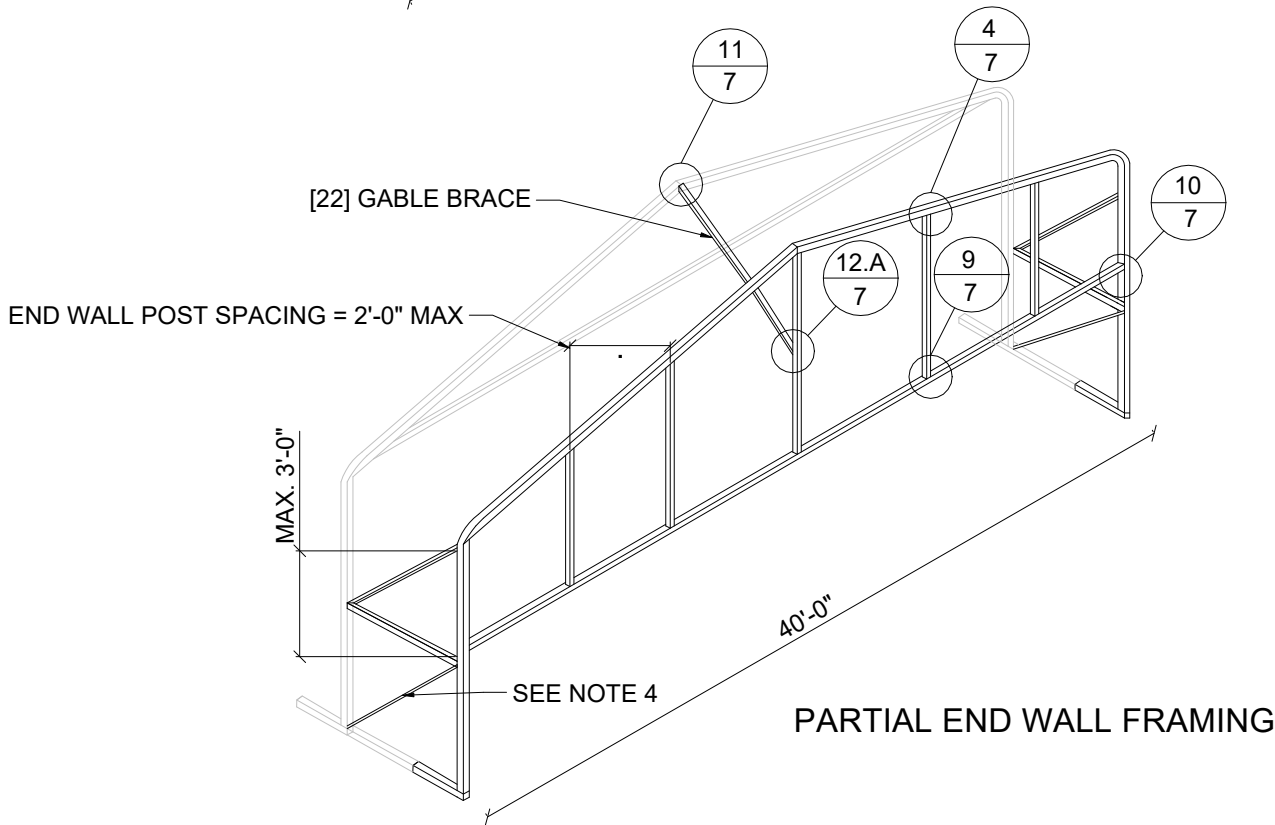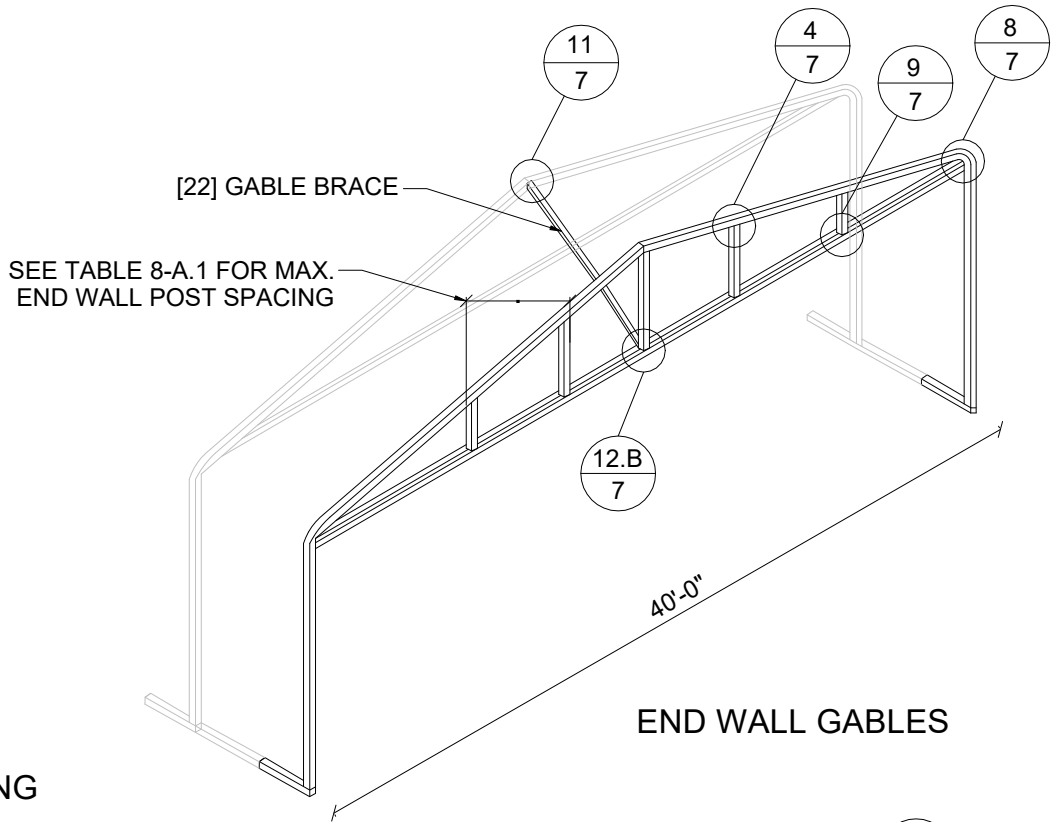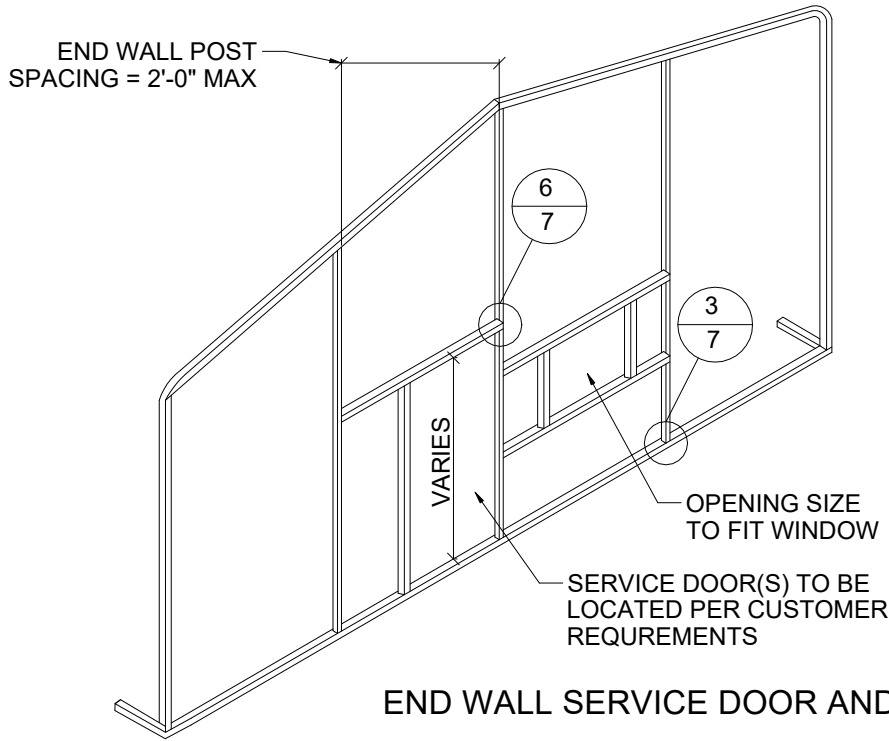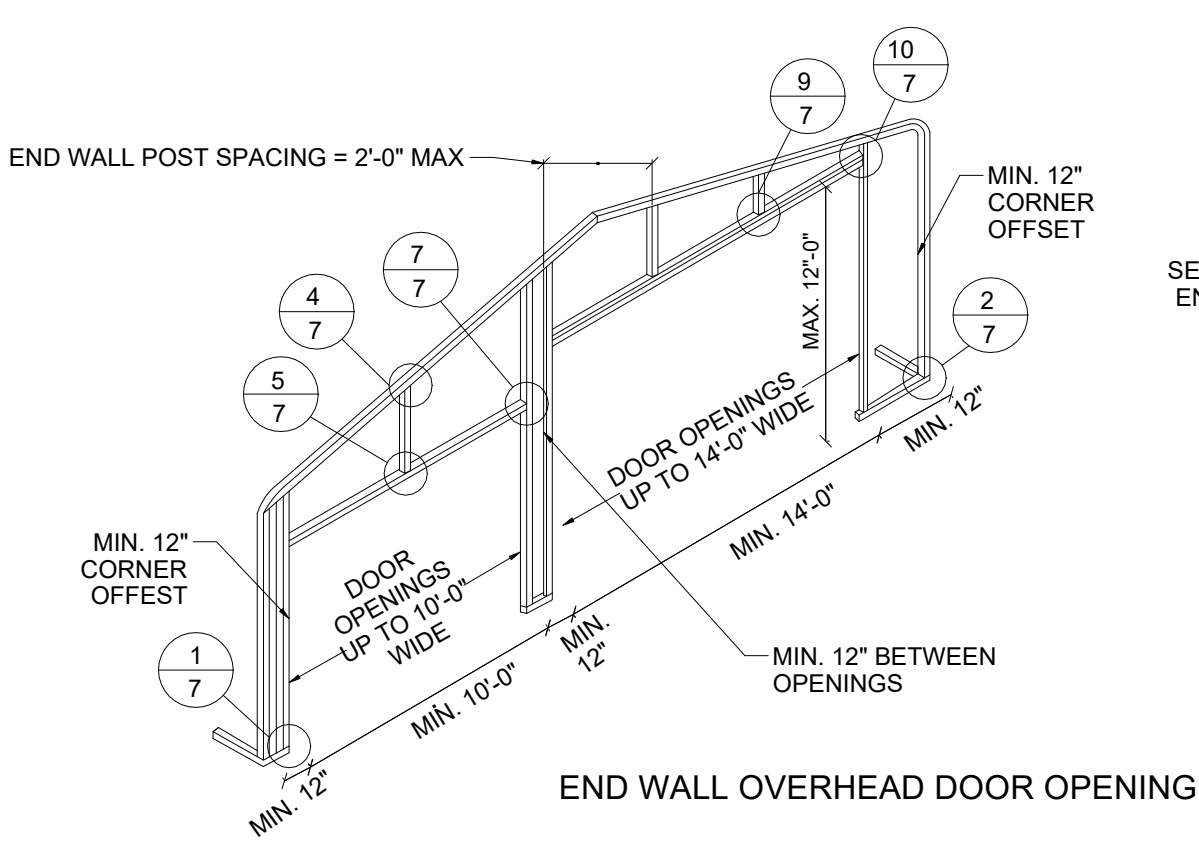

END WALL FRAMING NOTES:

1. DESIGNS AND DETAILS SHOWN HERE ARE APPLICABLE TO BOTH REGULAR AND A- FRAME STYLE BUILDING.
2. MIN. 12" CLEARANCE MUST BE MAINTAINED BETWEEN ANY TWO OPENING (OVERHEAD DOOR OR SERVICE DOOR) AND FROM CORNERS.
3. SERVICE DOOR AND WINDOW CAN BE PLACED AS NEEDED.

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed
by Craig E Gunderson
Date:
2024.01.09
14:49:23-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:
THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE

REVISION 2: DATE














DRAWN BY: NRB

SCALE: NTS

PAGE :

6

() BRACKETS DENOTE QUANTITY
[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

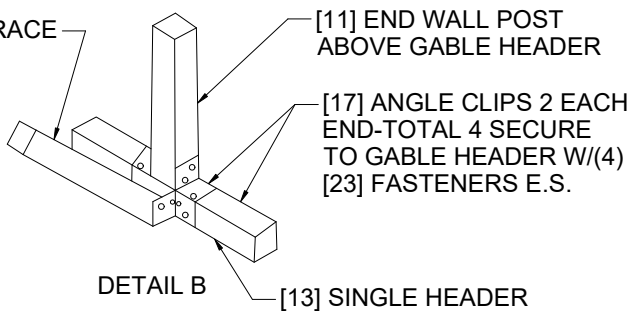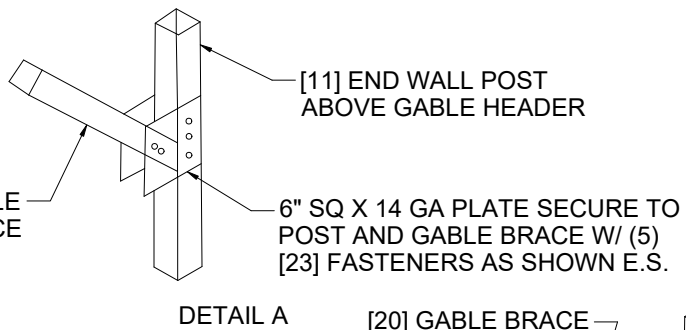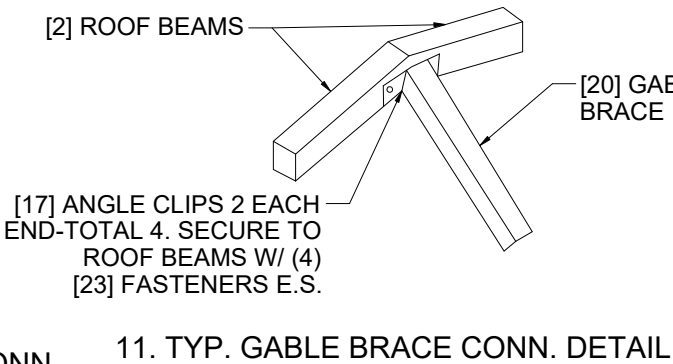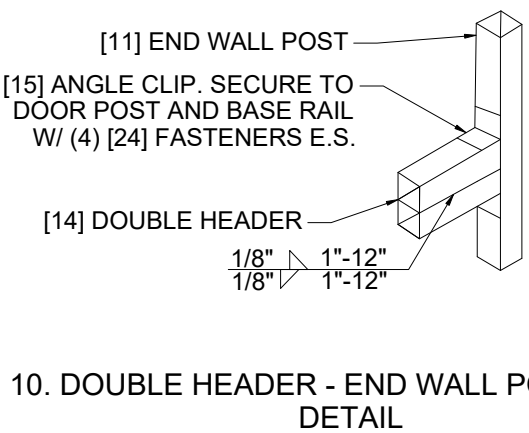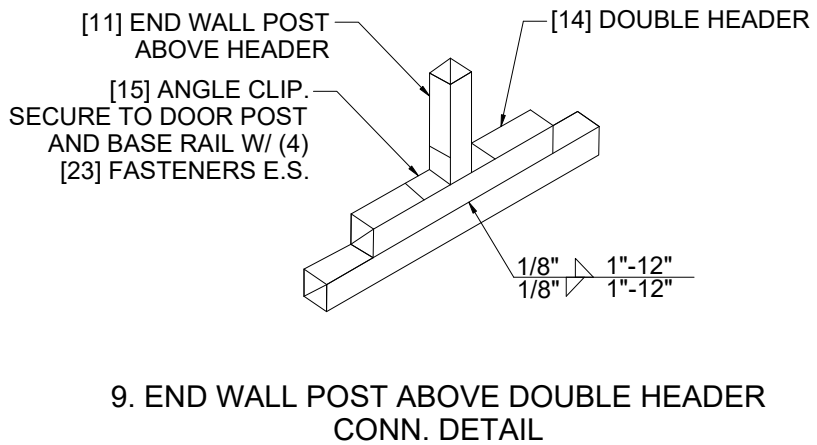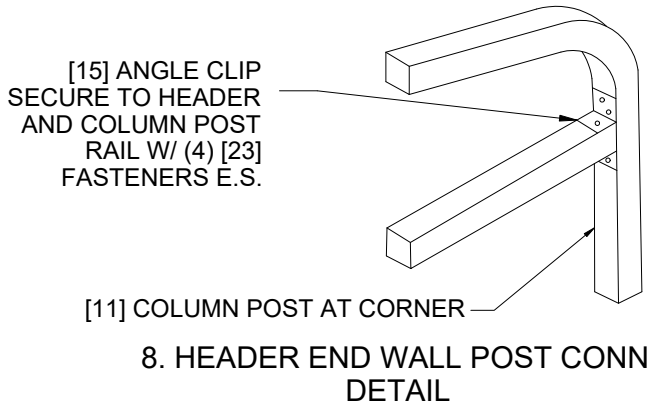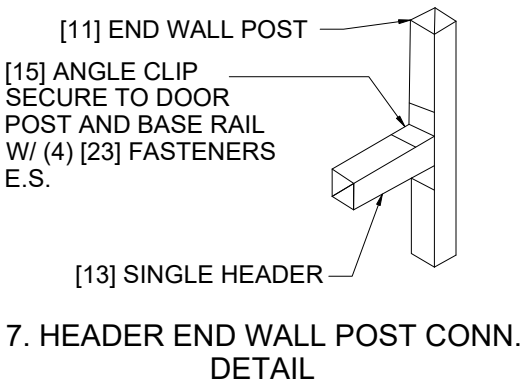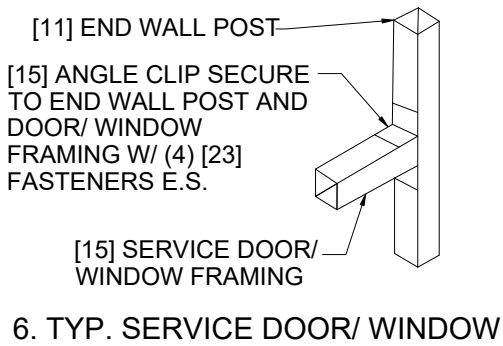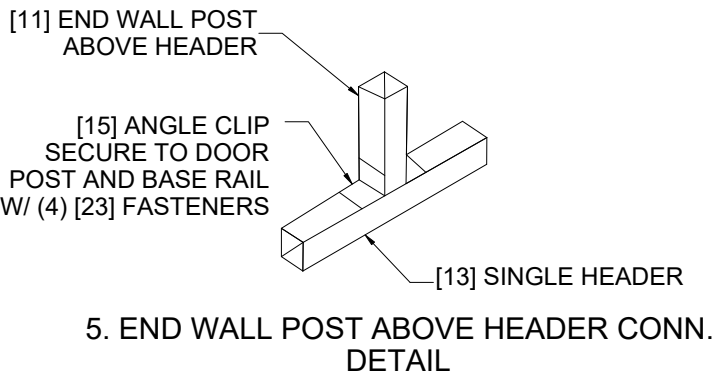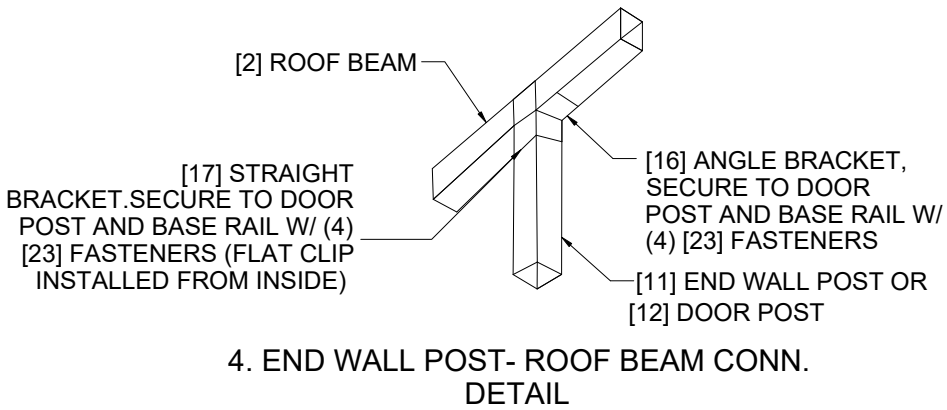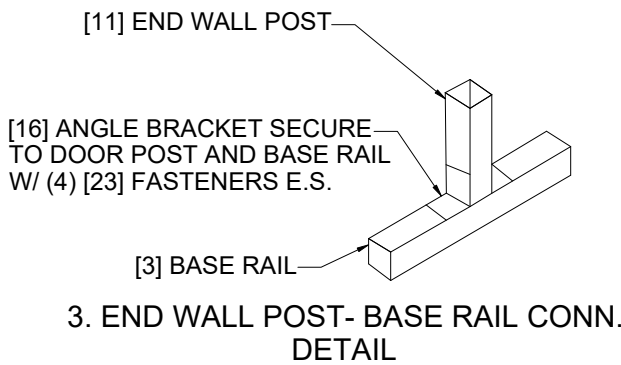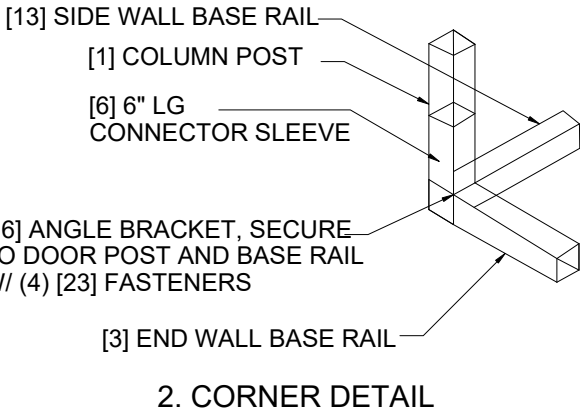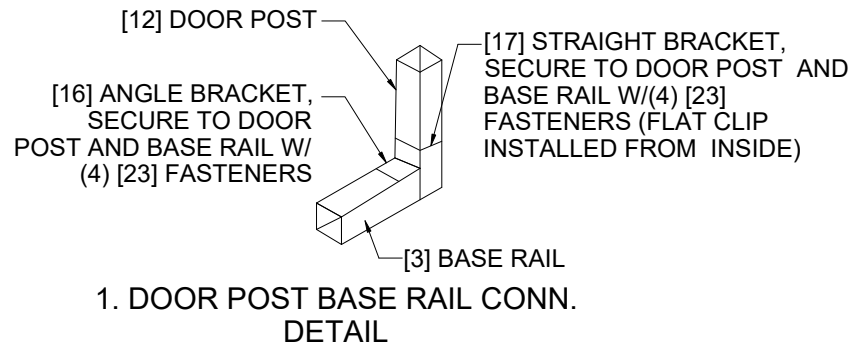

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Craig E. Gunderson

No. 60102

Professional Engineer

State of Florida

Digitally signed by Craig E Gunderson
Date: 2024.01.09 14:49:24-05'00'

FLORIDA ENGINEERING LLC

4161 TAMiami TRAIL, UNIT 101

PORT CHARLOTTE, FLORIDA 33952

(941) 391-5980

FLeng.com

Orders@FLeng.com

CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR: MARTINEZ CARPORTS LLC		PROJECT DESCRIPTION: THOMAS 6129 SW COUNTY RD 18 FORT WHITE FL 32038	
DESIGN DATE:		01/09/2024	
REVISION 1:		DATE	
REVISION 2:	DATE	PAGE 7	
DRAWN BY:	NRB		
SCALE:	NTS		

() BRACKETS DENOTE QUANTITY
[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

CRAIG E. GUNDERSON

LICENSE

No. 60102

★


STATE OF

FLORIDA


PROFESSIONAL ENGINEER

Digitally signed by Craig E Gunderson

Date: 2024.01.09 14:49:25-05'00'

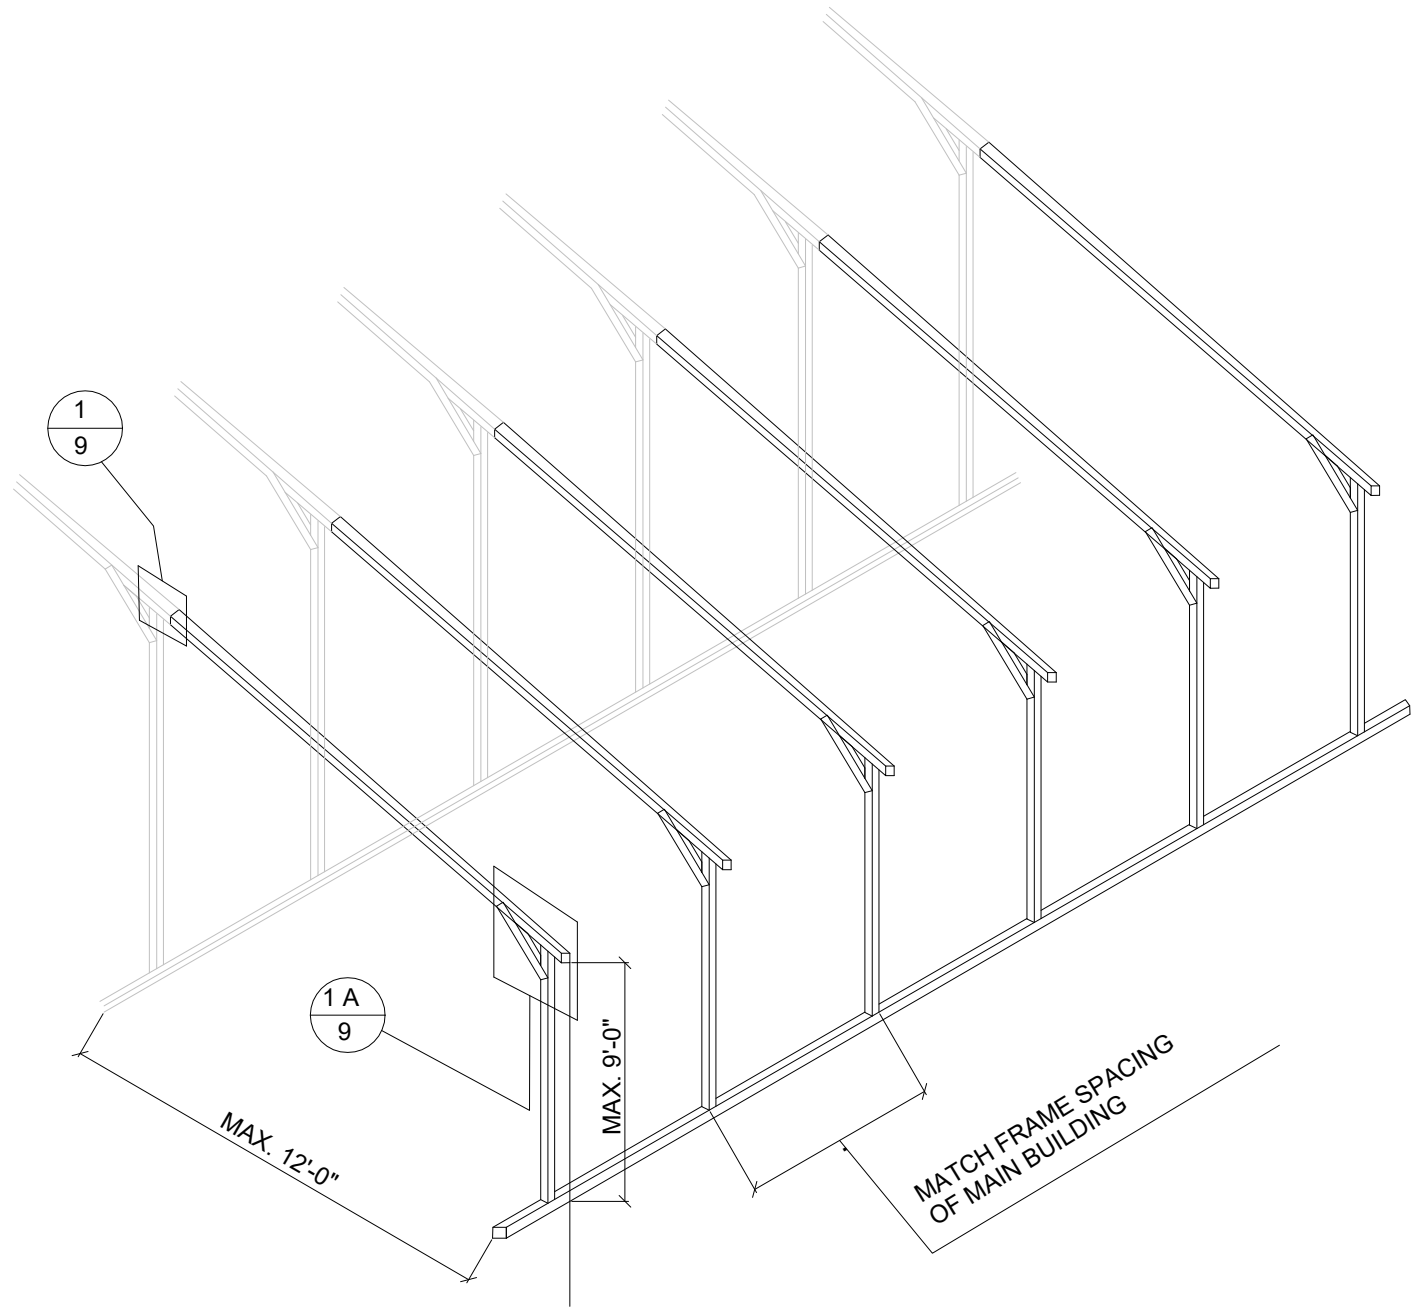

OPTIONAL LEAN-TO ADDITION

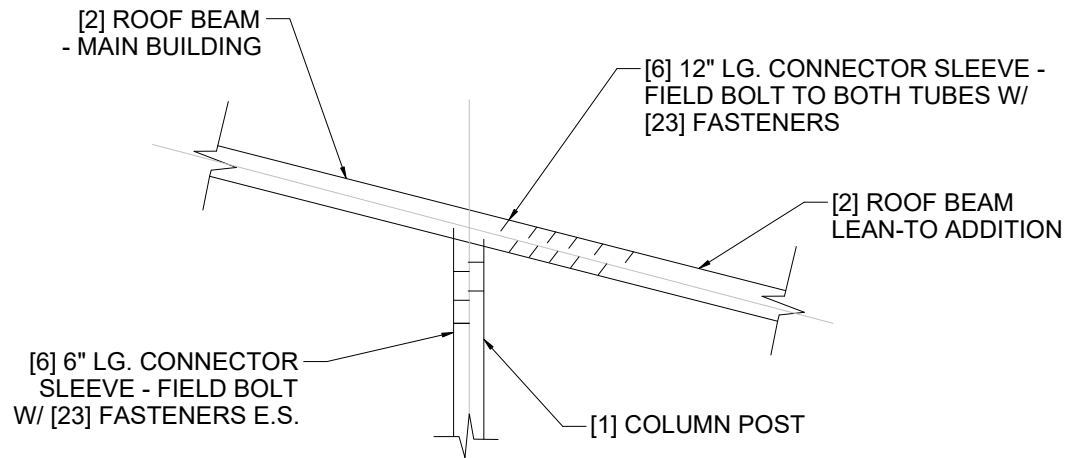

LEAN-TO ATTACHMENT DETAIL

LEAN-TO ADDITION NOTES:

- 1. LEAN-TO ADDITION CAN BE ADDED ON EITHER OR BOTH SIDES OF THE BUILDING.
- 2. ROOF SLOPE, PURLIN, GIRT AND FREAM SPACING OF THE ADDITION HAVE TO MATCH THAT OF THE MAIN STRUCTURE.
- 3. IF THE LEAN-TO ADDITION IS "OPEN" (BOTH END WALLS OR SIDE WALL IS NOT ENCLOSED), THE DESIGN OF THE MAIN BUILDING HAS TO USE THE FRAME SPACING OF 4'-0" MAX.



FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com

CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:
THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE

REVISION 2: DATE

DRAWN BY: NRB

SCALE: NTS


PAGE :

8

() BRACKETS DENOTE QUANTITY
[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

CONCRETE SLAB FOUNDATION NOTES:SLAB FOUNDATION NOTES

1. DESIGN SHOWN ON THIS SHEET ARE FOR CONCRETE SLAB FOUNDATION.
2. CONCRETE ANCHORS SHALL BE LOCATED NEXT TO EVERY POST AND ON EITHER SIDE OF OPENINGS. TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDING WITH END WALLS. ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND,ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST.
3. ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING.
4. MIN. NUMBER OF CONCRETE ANCHOR PER POST SHALL BE AS SHOWN.
5. THE SIZE OF THE SLAB SHALL BE THE SIZE (WIDTH AND LENGTH) OF THE BUILDING PLUS $5\frac{1}{2}$ " FOR 14GA MATERIAL. AND $5\frac{3}{4}$ " FOR 12GA MATERIAL.
6. DEPTH OF SLAB TURN DOWN FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
7. CONTROL JOINTS SHALL BE PLACED SO AS TO LIMIT MAX. SLAB SPANS TO 20' IN EACH DIRECTION.
8. ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.
9. CONCRETE STRENGTH TO BE A MIN. OF 2500 PSI @ 28 DAYS.
10. ANCHORS ARE TO BE 1/2" CONCRETE WEDGE OR EXPANSION ANCHORS.
11. MIN. EMBEDMENT DEPTH TO BE $2\frac{7}{8}$ ".
12. ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS.

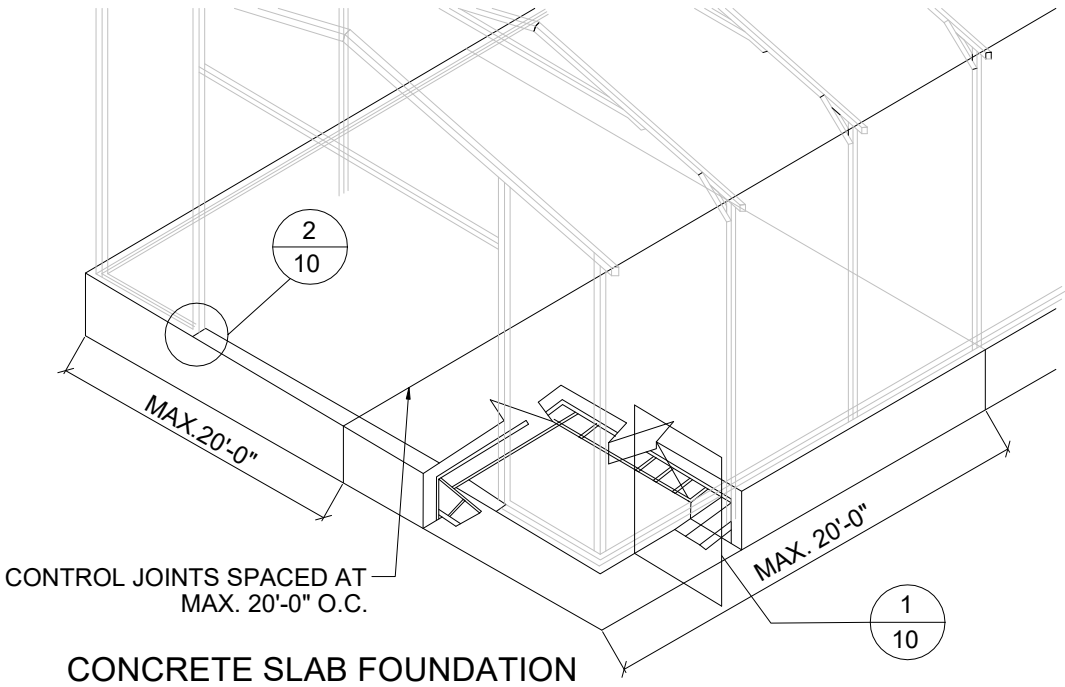

CONCRETE SLAB FOUNDATION






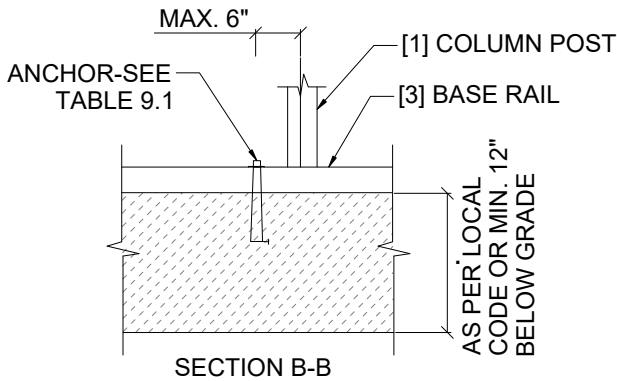


TABLE 9.1: NOTCH WIDTH

HORIZONTAL/OPEN		VERTICAL	
14GA	12GA	14GA	12GA
2.75"	2.875"	1.75"	1.875"


NOTE: DEPTH IS TO BE 1 1/2"

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

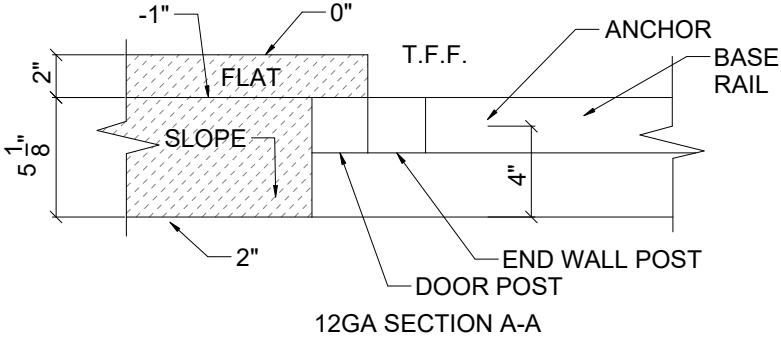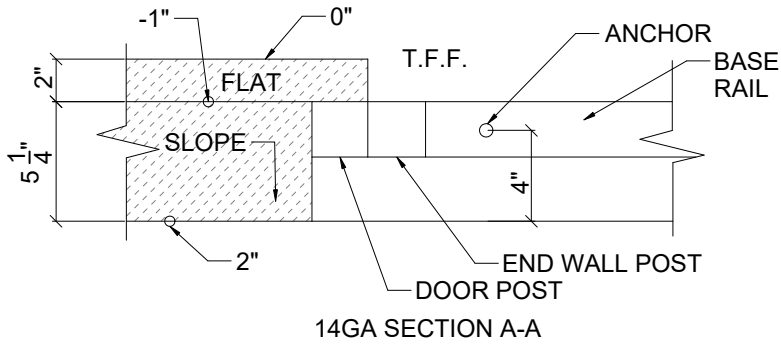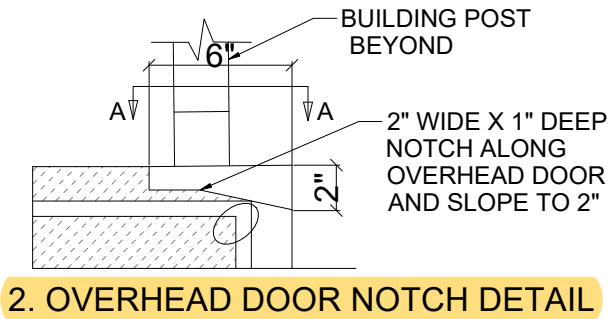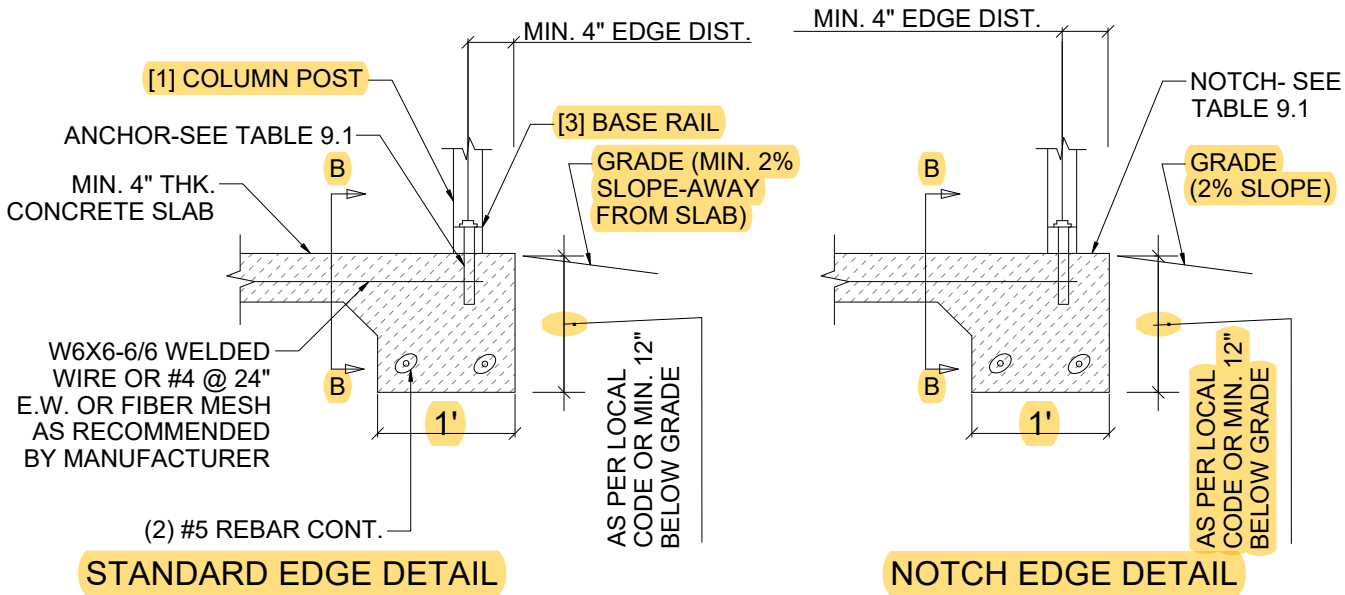

Digitally signed
by Craig E Gunderson
Date:
2024.01.09
14:49:25-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:

THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE

REVISION 2: DATE


DRAWN BY: NRB

SCALE: NTS


PAGE :

9

() BRACKETS DENOTE QUANTITY
[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1

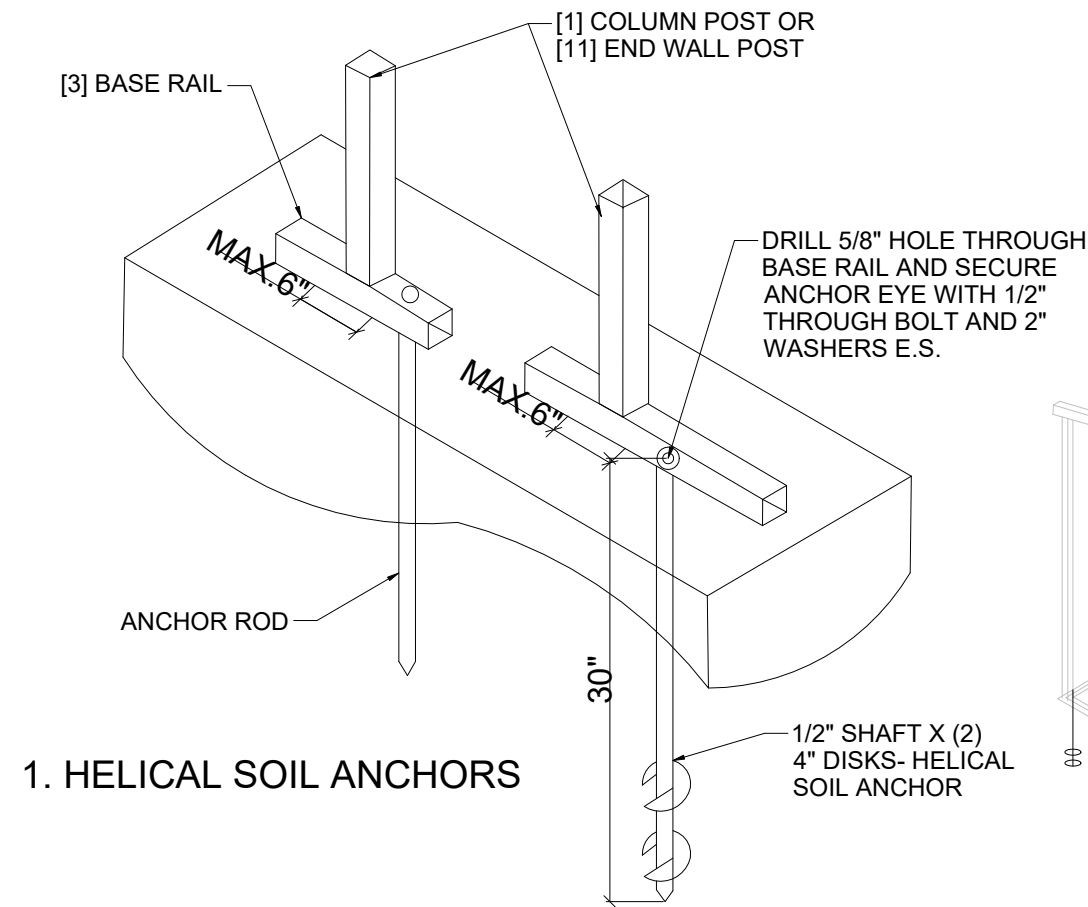

1. HELICAL SOIL ANCHORS

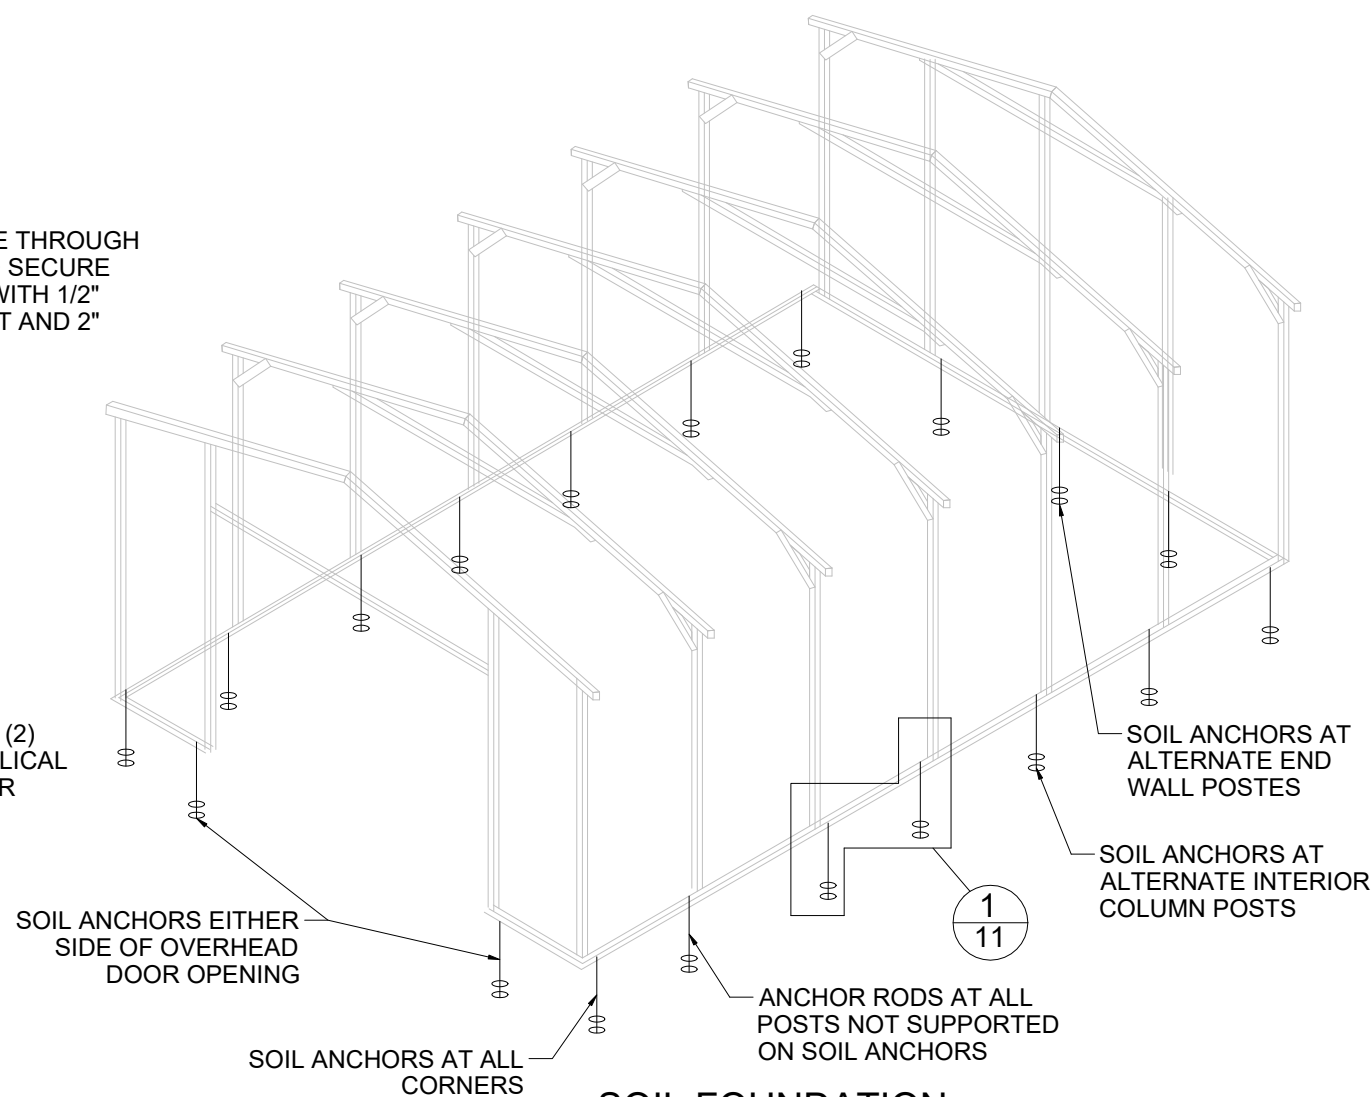


2. ROCK / ASPHALT ANCHORS

SOIL FOUNDATION NOTES: FOUNDATION NOTES:

1. DESIGNS SHOWN ON THIS SHEET ARE FOR SOIL ANCHOR FOUNDATION.
2. SOIL ANCHOR (HELICAL OR ROCK/ASPHALT) SHALL BE LOCATED AT ALL 4 CORNERS, ON EACH SIDE OF OVERHEAD DOOR OPENING. ON POSTS WITH DIAGONAL BRACING IF REQUIRED. AND ON ALTERNATE INTERIOR COLUMN POSTS AND END WALLS POSTS.
3. HELICAL ANCHOR ARE TO BE USE ONLY IF THE DRIVING TORQUE INTO THE GROUND IS 150 FT-LBS OR GREATER. MANUFACTURER IS NOT RESPONSIBLE FOR SOIL QUALITY AT SITE.
4. HELICAL ANCHOR CAN ONLY BE USED FOR CLASS 2, 3 & 4 SOILS (SEE SOIL CLASSIFICATION THIS PAGE)
5. ALL POSTS WITH NO ANCHORS ADJACENT SHALL BE ANCHORED TO THE GROUND WITH A 1/2" X 30" LG. ROD. RODS WILL HAVE A PRE-FORMED HEAD AT THE TOP AND ONE COAT OF RUST PROOF MATERIAL.
6. ASSUME SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF.


SOIL CLASSIFICATIONS

SOIL CLASS	DESCRIPTION
2	SANDY GRAVEL AND GRAVEL, VERY THIN DENSE AND/OR CEMENTED SANDS.
3	SAND, SILTY SAND, CLAYEY SAND, SILTY GRAVEL, MEDIUM DENSE COARSE SAND, SANDY GRAVEL, VERY STIFF SILT AND SANDY CLAYS.
4	LOOSE TO MEDIUM DENSE SAND, FIRM TO STIFF CLAYS AND SILTS AND ALLUVIAL FILLS.

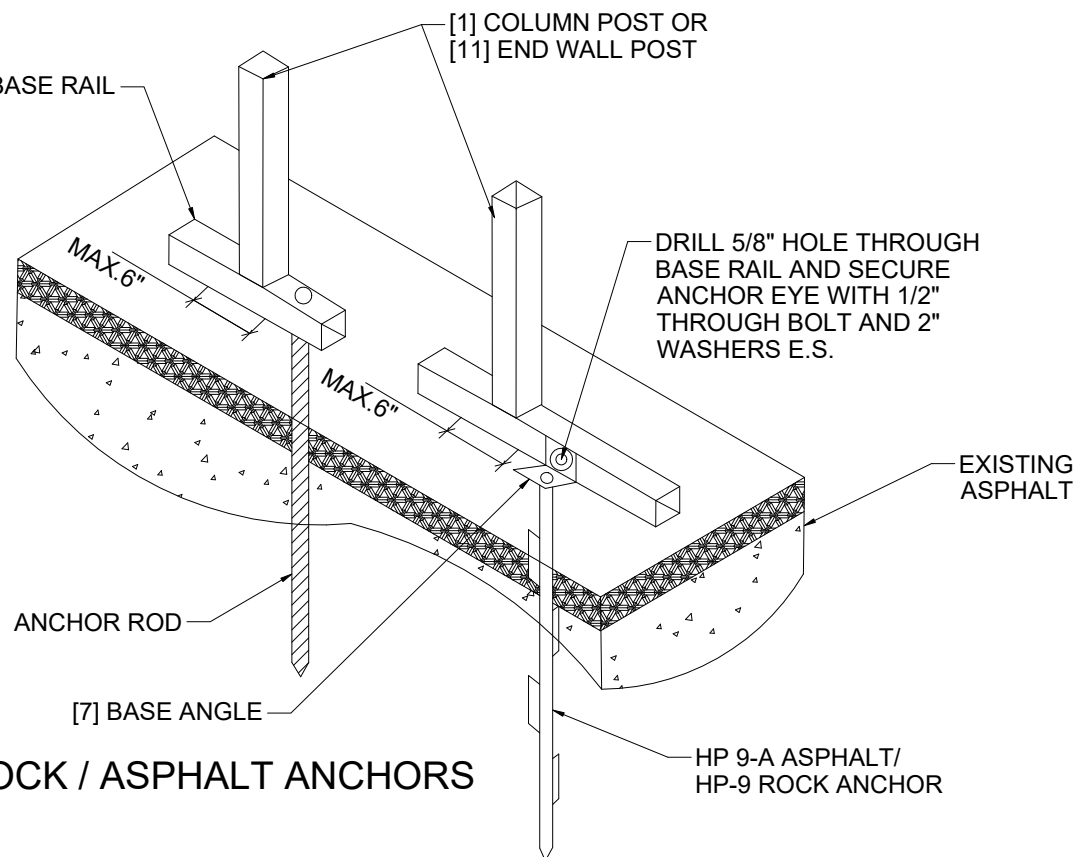


2. ROCK / ASPHALT ANCHORS

This item has been digitally signed and sealed by Craig E. Gunderson, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed
by Craig E
Gunderson
Date:
2024.01.09
14:49:26-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2400857

CONTRACTOR:
MARTINEZ CARPORTS LLC

PROJECT DESCRIPTION:

THOMAS
6129 SW COUNTY RD 18
FORT WHITE FL 32038

DESIGN DATE: 01/09/2024

REVISION 1: DATE

REVISION 2: DATE

DRAWN BY: NRB

SCALE: NTS

PAGE :
10

() BRACKETS DENOTE QUANTITY

[] BRACKETS DENOTE MEMBER, SEE LEGEND ON PG. 1