


Main Floor

FRONT DOOR ORIENTATION IS
SET PER SITE PLAN

IMPORTANT: ANY DEVIATION FROM THIS
DESIGN, IE: ORIENTATION, WEATHER
LOCATION OR OPTIONS WILL REQUIRE
AN UPDATED HVAC DESIGN

NOTE: MUST PROVIDE UNRESTRICTED 1 INCH UNDERCUT
BELOW DOORS TO HABITABLE ROOMS.
TRANSFER DUCTS/GRILLES SIZED IN COMPLIANCE WITH
FLORIDA RESIDENTIAL BUILDING CODE M16-024
BALANCED RETURN AIR. EXCEPTIONS 1-3

REGISTER SIZES ARE ESTIMATED BASED ON
INDUSTRY AVERAGES. TRACE TO ENSURE
ACTUAL REGISTERS CONFORM TO STANDARDS:
500-700 FPM RECOMMENDED VELOCITY

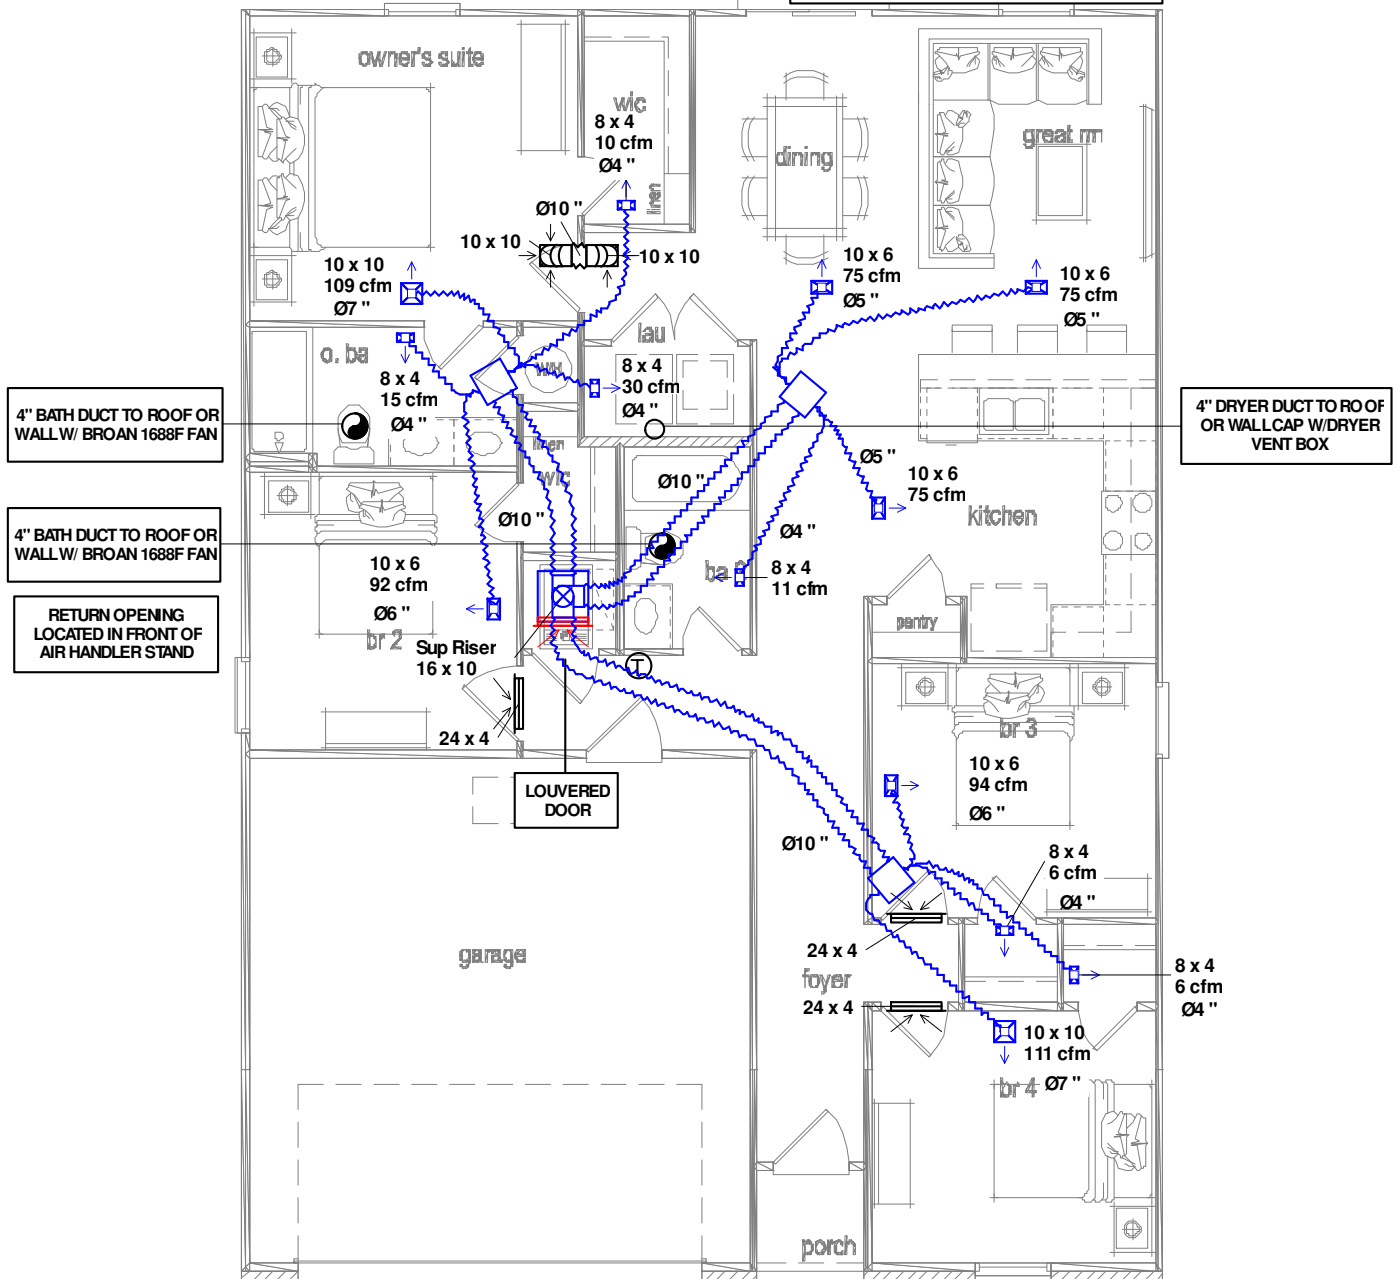

Job #:
Performed for:


Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH
SW BRE LANE
Lake City, FL 32024

MiTek Wrightsoft

131 Hartwell Ave
Lexington, MA 02421
Phone: 800-225-8697 Fax: 781-861-2058
www.wrightsoft.com

Scale: 1 : 91

Page 1
Right-Suite © Universal 2021
21.0.08 RSU00000
2021-Oct-15 10:44:57
...Jewel Lake P2_FrmA1_LS21_LH.rup




Notes

CITED NOTES	
①	
②	RANGE EXHAUST DUCT SIZE AS PER MANF. REQ. 3.25 X 10 DUCT, C/W WALL HOOD AND BACKDRAFT DAMPER (FOR ELECTRIC RANGE)
③	LAUNDRY ROOM COMBUSTION AIR FOR OPTIONAL GAS DRYER, SEE LOCAL CODES AND MANF. SPEC TO VERIFY
④	4" OR 6" VENT TO OUTSIDE, C/W BACKDRAFT DAMPER AND HOOD (ROOF)
⑤	4" OR 6" VENT TO OUTSIDE, C/W BACKDRAFT DAMPER AND HOOD (WALL)

GENERAL NOTES

VERIFY NO STRUCTURAL INTERFERENCE BEFORE CUTTING OPENING FOR TRANSFER GRILLE ABOVE DOOR
THERMOSTAT HEIGHT OF 60" TO THE TOP. WHEN A DESIGN MUST MEET ADA REQUIREMENTS, THERMOSTAT HEIGHT SHALL BE SPECIFIED AT 48" TO THE TOP.

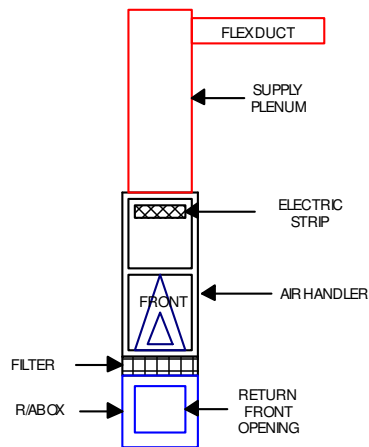

Carrier
25HBC524AP0300
FB4CNP025L
Elec strip Carrier KFCEH2501C08
FILTER TYPE: FLANDERS PRE PLEATED 40 LPD MERV 8 FILTER THICKNESS: 1" FILTER PRESSURE DROP: 0.15 IWC
FB4C CORRECTION COMPONENT PRESSURE DROP (DRY TO WET COIL): 0.039 IWC @ 706 CFM
FAN SPEED TAP: 3 OR 4 (SAME SPEED)

Job #:
Performed for:


Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH
SW BRE LANE
Lake City, FL 32024

MiTek Wrightsoft

131 Hartwell Ave
Lexington, MA 02421
Phone: 800-225-8697 Fax: 781-861-2058
www.wrightsoft.com

Scale: 1 : 91

Page 2
Right-Suite@ Universal 2021
21.0.08 RSU00000
2021-Oct-15 10:44:58
... Jewel Lake P2_FrmA1_LS21_LH.rup



MITEK-WRIGHTSOFT DESIGN DETAIL SUMMARY

MITEK'S RESPONSIBILITY IS SOLELY FOR DESIGN OF THE HVAC SYSTEM BASED UPON THE DESIGN INFORMATION AND CONDITIONS PROVIDED TO IT THAT ARE SPECIFIED IN THE DRAWING AND ACCOMPANYING ACCA MANUAL J, S, D AND T REPORTS. THE HVAC DESIGN IS BASED ONLY UPON THE DESIGN INFORMATION AND CONDITIONS SHOWN, WHICH HAVE NOT BEEN VERIFIED BY THE MITEK-WRIGHTSOFT DESIGN TEAM.

BEFORE USE, THE BUILDING DESIGNER MUST VERIFY THE APPLICABILITY OF THE DESIGN INFORMATION AND CONDITIONS, AND PROPERLY INCORPORATE THIS HVAC DESIGN INTO THE OVERALL BUILDING DESIGN. THE HVAC DESIGN SHOWN IS ONLY VALID FOR THE BUILDING LAYOUT, ELEVATIONS, ORIENTATION, INTERIOR FLOOR PLAN, CONSTRUCTION MATERIALS, EQUIPMENT, AND WEATHER BIN DATA SPECIFIED IN THE DRAWING.

ANY CHANGE TO THE DESIGN INFORMATION AND CONDITIONS, OR DEVIATION FROM THIS DESIGN WILL REQUIRE AN UPDATED HVAC DESIGN. MITEK TAKES NO RESPONSIBILITY FOR DEVIATIONS FROM ITS HVAC DESIGN, USE OF ITS DESIGNS FOR PURPOSE OTHER THAN AS INTENDED BY MITEK-WRIGHTSOFT, OR FOR THE IMPROPER CONSTRUCTION OR INSTALLATION OF HVAC SYSTEMS BASED ON ITS DESIGNS.

MITEK IS NOT RESPONSIBLE FOR THE INSTALLATION OF THE SYSTEM OR THE PERFORMANCE OF EQUIPMENT REFERENCED IN THE HVAC DESIGN. THE HVAC DESIGNS ASSUME FABRICATION AND INSTALLATION BY A CERTIFIED HVAC CONTRACTOR IN STRICT CONFORMANCE WITH HVAC DESIGNS AND THE GUIDELINES PUBLISHED BY ACCA RESIDENTIAL QUALITY INSTALLATION CHECKLIST. FOR GENERAL GUIDANCE REGARDING THE INSTALLATION AND TESTING OF THE HVAC SYSTEM(S), PLEASE SEE ACCA MANUAL D, ACCA MANUAL B, IB C, IMC, AND IRC.

Job #:
Performed for:

Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH
SW BRE LANE
Lake City, FL 32024

MiTek Wrightsoft

131 Hartwell Ave
Lexington, MA 02421
Phone: 800-225-8697 Fax: 781-861-2058
www.wrightsoft.com

Scale: 1 : 91

Page 3
Right-Suite@ Universal 2021
21.0.08 RSU00000
2021-Oct-15 10:44:58
...Jewel Lake P2_FrmA1_LS21_LH.rup

Project Information

For: Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Design Information

	Htg	Clg	Infiltration	
Outside db (°F)	33	92	Method	Blower door
Inside db (°F)	70	75	Shielding / stories	4 (substantial) / 1
Design TD (°F)	37	17	Pressure / AVF	50 Pa / 1129 cfm
Daily range	-	M		
Inside humidity (%)	30	50		
Moisture difference (gr/lb)	11	45		

HEATING EQUIPMENT

Make Carrier
Trade CARRIER
Model 25HBC524AP0300
AHRI ref 204837248

Efficiency 9 HSPF
Heating input
Heating output 24000 Btuh @ 47°F
Temperature rise 0 °F
Actual air flow 0 cfm
Air flow factor 0 cfm/Btuh
Static pressure 0.50 in H2O
Space thermostat
Capacity balance point = 31 °F

Backup: Carrier KFCEH2501C08
Input = 8 kW, Output = 27297 Btuh, 100 AFUE

COOLING EQUIPMENT

Make Carrier
Trade CARRIER
Cond 25HBC524AP0300
Coil FB4CNP025L
AHRI ref 204837248
Efficiency 12.5 EER, 15.5 SEER
Sensible cooling 17831 Btuh
Latent cooling 3914 Btuh
Total cooling 21745 Btuh
Actual air flow 706 cfm
Air flow factor 0.045 cfm/Btuh
Static pressure 0.50 in H2O
Load sensible heat ratio 0.83

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
BEDROOM 3	120	2560	2090	0	94
BATH 2	45	367	237	0	11
BEDROOM 4	123	4145	2481	0	111
HVAC	15	0	0	0	0
LAU	25	40	673	0	30
O. BATH	71	745	329	0	15
O.WIC	39	553	213	0	10
OWNER'S SUITE	169	3270	2422	0	109
GREAT/DIN/KIT	467	6302	4998	0	224
FOYER	86	0	0	0	0
BEDROOM 2	127	2745	2047	0	92
WIC 2	22	0	0	0	0
HALL	58	0	0	0	0
WIC 3	14	329	126	0	6

Bold/italic values have been manually overridden

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

WIC 4	14	408	131	<i>0</i>	<i>6</i>
System 1	1397	21465	15746	<i>0</i>	<i>706</i>
Other equip loads		0	0		
Equip. @ 1.00 RSM			15746		
Latent cooling			3240		
TOTALS	1397	21465	18986	<i>0</i>	<i>706</i>

Bold/italic values have been manually overridden

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.



Right-Suite® Universal 2021 21.0.08 RSU00000

2021-Oct-15 10:44:54

Page 2

...SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH.rup Calc = MJ8 Front Door faces: SW


Project Information

For: Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Design Conditions

Location:		Indoor:		Heating	Cooling
Gainesville Regional AP, FL, US		Indoor temperature (°F)		70	75
Elevation:	164 ft	Design TD (°F)		37	17
Latitude:	30°N	Relative humidity (%)		30	50
		Moisture difference (gr/lb)		10.6	45.4
Outdoor:	Heating	Cooling	Infiltration:		
Dry bulb (°F)	33	92			
Daily range (°F)	-	20 (M)			
Wet bulb (°F)	-	76			
Wind speed (mph)	15.0	7.5			

Front Door	North	Northeast	East	Southeast	South	Southwest	West	Northwest
Sensible Load (Btuh)	15103	16186	16617	16230	15079	15746	15999	15794
Latent Load (Btuh)	3240	3240	3240	3240	3240	3240	3240	3240
Total Load (Btuh)	18343	19426	19857	19470	18319	18986	19238	19034
Heating AVF (cfm)	0	0	0	0	0	0	0	0
Cooling AVF (cfm)	706	706	706	706	706	706	706	706

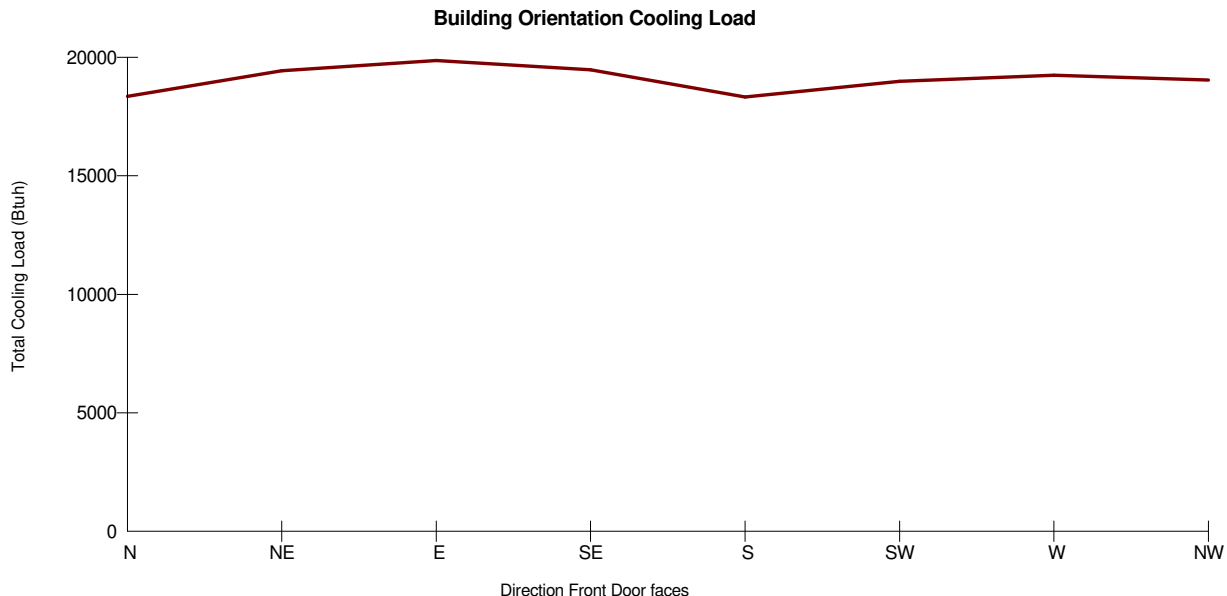

Current Orientation: Front Door faces Southwest
Highest Cooling Load: Front Door faces East

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Project Information

For: Carlisle SLAB Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Design Conditions

Location:

Gainesville Regional AP, FL, US
Elevation: 164 ft
Latitude: 30°N

Outdoor:

Dry bulb (°F)
Daily range (°F)
Wet bulb (°F)
Wind speed (mph)

Heating

33
-
-
15.0

Cooling

92
20 (M)
76
7.5

Indoor:

Indoor temperature (°F)
Design TD (°F)
Relative humidity (%)
Moisture difference (gr/lb)

Heating

70
37
30
10.6

Cooling

75
17
50
45.4


Infiltration:

Method
Shielding / stories
Pressure / AVF

Blower door
4 (substantial) / 1
50 Pa / 1129 cfm


Heating

Component	Btuh/ft²	Btuh	% of load
Walls	3.4	4209	19.6
Glazing	12.2	1323	6.2
Doors	10.7	429	2.0
Ceilings	1.2	1654	7.7
Floors	5.4	7553	35.2
Infiltration	3.2	3561	16.6
Ducts		2736	12.7
Piping		0	0
Humidification		0	0
Ventilation		0	0
Adjustments		0	0
Total		21465	100.0

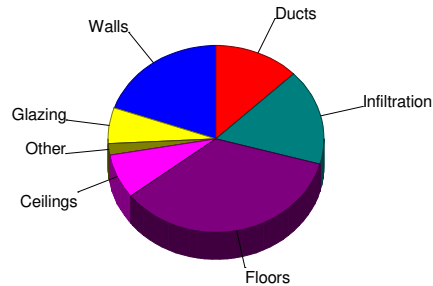

Cooling

Component	Btuh/ft²	Btuh	% of load
Walls	1.9	2426	15.4
Glazing	20.7	2238	14.2
Doors	8.3	331	2.1
Ceilings	1.7	2325	14.8
Floors	0	0	0
Infiltration	0.8	907	5.8
Ducts		3470	22.0
Ventilation		0	0
Internal gains		4050	25.7
Blower		0	0
Adjustments		0	0
Total		15746	100.0

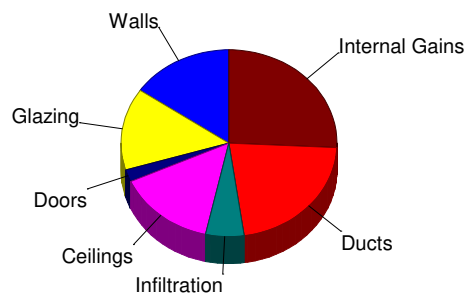

Latent Cooling Load = 3240 Btuh
Overall U-value = 0.098 Btuh/ft²-°F

Data entries checked.

J1 Form - Worksheet A

System 1

MiTek Wrightsoft

Job:
Date: Oct 06, 2021
By:

131 Hartwell Ave, Lexington, MA 02421 Phone: 800-225-8697 Fax: 781-861-2058 Web: www.wrightsoft.com

Supporting Detail	
Project Name: CMP-FL-37-1398_Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH	Date: Oct 06, 2021
Address: SW BRE LANE, Lake City, FL 32024	
Phone:	Job ID:

Worksheet A Location and Design Conditions			
Weather Location: Gainesville Regional AP, FL, US	Elevation = 164	Latitude = 30	
Indoor Conditions, Heating: DB = 70 °F RH = 30 %	Indoor Conditions, Cooling: DB = 75 °F RH = 50 %		
Table 1 Conditions 99% DB = 33 °F 1% DB = 92 °F	Grains Difference = 45 gr/lb	Daily Range = M	
Design Temperature Differences	HTD = 37 °F	CTD = 17 °F	

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Project Information

For: Carlisle SLAB Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Design Conditions

Location:		Indoor:		Heating	Cooling
Gainesville Regional AP, FL, US		Indoor temperature (°F)		70	75
Elevation:	164 ft	Design TD (°F)		37	17
Latitude:	30°N	Relative humidity (%)		30	50
Outdoor:		Moisture difference (gr/lb)		10.6	45.4
Heating		Infiltration:			
Dry bulb (°F)	33	Method		Blower door	
Daily range (°F)	-	Shielding / stories		4 (substantial) / 1	
Wet bulb (°F)	-	Pressure / AVF		50 Pa / 1129 cfm	
Wind speed (mph)	15.0				
Cooling					
	92				
	20 (M)				
	76				
	7.5				

Construction descriptions

	Or	Area ft²	U-value Btuh/ft²·°F	Insul R ft²·°F/Btuh	Htg HTM Btuh/ft²	Loss Btuh	Clg HTM Btuh/ft²	Gain Btuh
Walls 12C-0sw: Frm wall, wd ext, 1/2" wood shth, r-13 cav ins, 1/2" gypsum board int fnsh, 2"x4" wood frm, 16" o.c. stud	ne	232	0.091	13.0	3.37	780	2.14	496
	se	389	0.091	13.0	3.37	1310	2.14	832
	sw	96	0.091	13.0	3.37	324	2.14	206
	nw	258	0.091	13.0	3.37	868	2.14	551
	all	975	0.091	13.0	3.37	3283	2.14	2085

Partitions

12C-0sw: Frm wall, 1/2" gyp.bd ext, r-13 cav ins, 1/2" gypsum board int fnsh, 2"x4" wood frm, 16" o.c. stud		275	0.091	13.0	3.37	926	1.24	340
---	--	-----	-------	------	------	-----	------	-----

Windows

Century Florida Jacksonville SGD: Door; NFRC rated (SHGC=0.29); 50% outdoor insect screen; 1 ft overhang (6.67 ft window ht, 1 ft sep.); 6.67 ft head ht	ne	33	0.330	0	12.2	407	22.6	752
Century Florida Jacksonville Wnd: Window; NFRC rated (SHGC=0.29); 50% blinds 45°, medium; 50% outdoor insect screen; 1 ft overhang (5 ft window ht, 1 ft sep.); 6.67 ft head ht	ne	30	0.330	0	12.2	366	20.0	599
	se	15	0.330	0	12.2	183	19.6	294
	sw	15	0.330	0	12.2	183	19.6	294
	nw	15	0.330	0	12.2	183	20.0	300
	all	75	0.330	0	12.2	916	19.8	1486

Doors

11P0: Door, mtl pur core type	sw	20	0.290	10.5	10.7	215	8.26	165
	n	20	0.290	10.5	10.7	215	8.26	165
	all	40	0.290	10.5	10.7	429	8.26	331

Ceilings

16B-30ad: Attic ceiling, asphalt shingles roof mat, r-30 ceil ins, 1/2" gypsum board int fnsh		1397	0.032	30.0	1.18	1654	1.66	2325
---	--	------	-------	------	------	------	------	------

Floors

22A-tpm: Bg floor, heavy dry or light damp soil, on grade depth		173	1.180	0	43.7	7553	0	0
---	--	-----	-------	---	------	------	---	---

Project Information

For: Carlisle SLAB Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Notes:

Design Information

Weather: Gainesville Regional AP, FL, US

Winter Design Conditions

Outside db	33 °F
Inside db	70 °F
Design TD	37 °F

Summer Design Conditions

Outside db	92 °F
Inside db	75 °F
Design TD	17 °F
Daily range	M
Relative humidity	50 %
Moisture difference	45 gr/lb

Heating Summary

Structure	18729 Btuh
Ducts	2736 Btuh
Central vent (0 cfm)	0 Btuh
(none)	
Humidification	0 Btuh
Piping	0 Btuh
Equipment load	21465 Btuh

Sensible Cooling Equipment Load Sizing

Structure	12276 Btuh
Ducts	3470 Btuh
Central vent (0 cfm)	0 Btuh
(none)	
Blower	0 Btuh
Use manufacturer's data	y
Rate/swing multiplier	1.00
Equipment sensible load	15746 Btuh

Infiltration

Method	Blower door
Shielding / stories	4 (substantial) / 1
Pressure / AVF	50 Pa / 1129 cfm

Latent Cooling Equipment Load Sizing

Structure	2499 Btuh
Ducts	740 Btuh
Central vent (0 cfm)	0 Btuh
(none)	
Equipment latent load	3240 Btuh

	Heating	Cooling
Area (ft²)	1397	1397
Volume (ft³)	11292	11292
Air changes/hour	0.47	0.26
Equiv. AVF (cfm)	88	49

Equipment Total Load (Sen+Lat)	18986 Btuh
Req. total capacity at 0.82 SHR	1.6 ton

Heating Equipment Summary

Make	Carrier
Trade	CARRIER
Model	25HBC524AP0300
AHRI ref	204837248
Efficiency	9 HSPF
Heating input	
Heating output	24000 Btuh @ 47°F
Temperature rise	0 °F
Actual air flow	0 cfm
Air flow factor	0 cfm/Btuh
Static pressure	0.50 in H2O
Space thermostat	
Capacity balance point = 31 °F	
Backup: Carrier KFCEH2501C08	
Input = 8 kW, Output = 27297 Btuh, 100 AFUE	

Cooling Equipment Summary

Make	Carrier
Trade	CARRIER
Cond	25HBC524AP0300
Coil	FB4CNP025L
AHRI ref	204837248
Efficiency	12.5 EER, 15.5 SEER
Sensible cooling	17831 Btuh
Latent cooling	3914 Btuh
Total cooling	21745 Btuh
Actual air flow	706 cfm
Air flow factor	0.045 cfm/Btuh
Static pressure	0.50 in H2O
Load sensible heat ratio	0.83

Bold/italic values have been manually overridden

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Project Information


For: Carlisle SLAB Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
 SW BRE LANE, Lake City, FL 32024

Design Conditions

Location:		Indoor:		Heating	Cooling
Gainesville Regional AP, FL, US		Indoor temperature (°F)		70	75
Elevation: 164 ft		Design TD (°F)		37	17
Latitude: 30°N		Relative humidity (%)		30	50
		Moisture difference (gr/lb)		10.6	45.4
Outdoor:	Heating	Cooling	Infiltration:		
Dry bulb (°F)	33	92			
Daily range (°F)	-	20 (M)			
Wet bulb (°F)	-	76			
Wind speed (mph)	15.0	7.5			

Test for Adequate Exposure Diversity

Hourly Glazing Load

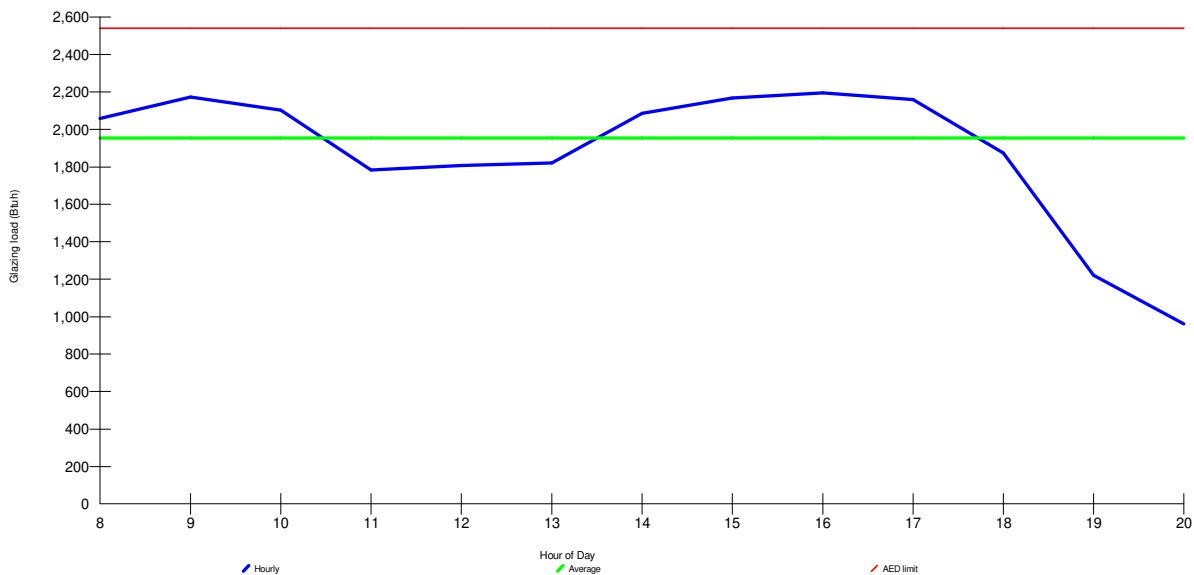

Maximum hourly glazing load exceeds average by 12.3%.

Zone has adequate exposure diversity (AED), based on AED limit of 30%.

AED excursion: 0 Btu/h

131 Hartwell Ave, Lexington, MA 02421 Phone: 800-225-8697 Fax: 781-861-2058 Web: www.wrightsoft.com

For: Carlisle_SLAB_Reserve at Jewel Lake
SW/BR/ALANS21_LH
Lake City, FL 32024

Notes:

Src	Part #	Description	Qty	Unit price	Extension
CARR	KFCEH2501C08	Equipment 8KW,ELECT HTR,W/CIRC BRKR,1-PH,WIND SEAL	1.00	0	0
		Subtotal, Equipment			0
		Duct System Equipment			
WSF	DDVn04	Round vinyl duct, D = 4"	43.0	1.40	60.20
WSF	FBTJ-4	Ceiling rect register, size 4"	6.00	24.00	144.00
WSF	FCLR-4	Collar, d = 4"	6.00	0	0
WSF	FCLR-10	Collar, d = 10"	6.00	0	0
WSF	FCLR-5	Collar, d = 5"	3.00	0	0
WSF	FJB-10	Junction box, size 10"	3.00	32.40	97.20
HACL	301-8X4	301 Curved-Blade Register 8 x 4	6.00	0	0
WSF	DDVn06	Round vinyl duct, D = 6"	15.0	1.60	24.00
WSF	FBTJ-6	Ceiling rect register, size 6"	2.00	26.80	53.60
HACL	301-10X6	301 Curved-Blade Register 10 x 6	5.00	0	0
WSF	DDVn07	Round vinyl duct, D = 7"	17.0	1.70	28.90
WSF	FBTJ-7	Ceiling rect register, size 7"	2.00	28.20	56.40
PGM	FRGRMCR-1010	Rectangular metal ceiling register one way, 10" x 10"	2.00	0	0
WSF	DDVn05	Round vinyl duct, D = 5"	24.0	1.50	36.00
WSF	FBTJ-5	Ceiling rect register, size 5"	3.00	25.40	76.20
WSF	FCLR-7	Collar, d = 7"	2.00	0	0
WSF	FCLR-6	Collar, d = 6"	2.00	0	0
WSF	DDVn10	Round vinyl duct, D = 10"	44.0	2.00	88.00
PGM	FPLH-10	Plenum rect tapered take off, size 10"	3.00	35.20	105.60
PGM	FJB-13	Junction box, size 16" x 10"	1.00	57.60	57.60
WSF	DRFg1610	Rectangular fiberglass duct, 16" x 10"	9.00	4.70	42.30
WSF	FBTS-10	Angle boot without transition, size 10"	2.00	0	0
PGM	FRGRMWG-2404	Rectangular metal high wall grille, 24" x 4"	3.00	0	0
HACL	650-10X10	650 Return Air Grille 10 x 10	2.00	0	0
		Subtotal, Duct System Equipment			870.00
		Overall total			870.00

Project Information

For: Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Available Static Pressure

	Heating (in H ₂ O)	Cooling (in H ₂ O)
External static pressure	0.50	0.50
Pressure losses		
Coil	0	0.04
Heat exchanger	0	0
Supply diffusers	0.05	0.05
Return grilles	0.03	0.03
Filter	0.15	0.15
Humidifier	0	0
Balancing damper	0.02	0.02
Other device	0	0
Available static pressure	0.25	0.21

Total Effective Length

	Supply (ft)	Return (ft)
Measured length of run-out	9	0
Measured length of trunk	19	0
Equivalent length of fittings	170	0
Total length	198	0
Total effective length		198

Friction Rate

	Heating (in/100ft)		Cooling (in/100ft)	
Supply Ducts	0.126	OK	0.107	OK
Return Ducts	0.126	OK	0.107	OK

Fitting Equivalent Length Details

Supply	4AD=60, 11A=20, 11G=5, 11G=5, 1D=10, 11D=60, 11G=5, 11G=5: TotalEL=170
Return	TotalEL=0

Duct System Summary

System 1

MiTek Wrightsoft

Job:
Date: Oct 06, 2021
By:

131 Hartwell Ave, Lexington, MA 02421 Phone: 800-225-8697 Fax: 781-861-2058 Web: www.wrightsoft.com

Project Information

For: Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

	Heating	Cooling
External static pressure	0.50 in H ₂ O	0.50 in H ₂ O
Pressure losses	0.25 in H ₂ O	0.29 in H ₂ O
Available static pressure	0.25 in H ₂ O	0.21 in H ₂ O
Supply / return available pressure	0.125 / 0.125 in H ₂ O	0.105 / 0.105 in H ₂ O
Lowest friction rate	0.126 in/100ft	0.107 in/100ft
Actual air flow	0 cfm	706 cfm
Total effective length (TEL)	198 ft	

Supply Branch Detail Table

Name	Design (Btuh)	Htg (cfm)	Clg (cfm)	Design FR	Diam (in)	H x W (in)	Duct Matl	Actual Ln (ft)	Ftg.Eqv Ln (ft)	Trunk
BATH 2	C 237	0	11	0.116	4.0	0x0	VIFx	21.6	160.0	st2
BEDROOM 2	C 2047	0	92	0.118	6.0	0x0	VIFx	19.1	160.0	st3
BEDROOM 3	C 2090	0	94	0.112	6.0	0x0	VIFx	23.2	165.0	st1
BEDROOM 4	C 2481	0	111	0.109	7.0	0x0	VIFx	28.0	165.0	st1
GREAT/DINKIT	C 1666	0	75	0.111	5.0	0x0	VIFx	25.8	165.0	st2
GREAT/DINKIT-A	C 1666	0	75	0.118	5.0	0x0	VIFx	18.5	160.0	st2
GREAT/DINKIT-B	C 1666	0	75	0.118	5.0	0x0	VIFx	18.5	160.0	st2
LAU	C 673	0	30	0.122	4.0	0x0	VIFx	13.7	160.0	st3
O. BATH	C 329	0	15	0.121	4.0	0x0	VIFx	14.0	160.0	st3
O.WIC-A	C 213	0	10	0.115	4.0	0x0	VIFx	19.1	165.0	st3
OWNER'S SUITE	C 2422	0	109	0.116	7.0	0x0	VIFx	16.5	165.0	st3
WIC 3	C 126	0	6	0.111	4.0	0x0	VIFx	24.5	165.0	st1
WIC 4	C 131	0	6	0.107	4.0	0x0	VIFx	27.9	170.0	st1

Supply Trunk Detail Table

Name	Trunk Type	Htg (cfm)	Clg (cfm)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Duct Material	Trunk
st1	Peak AVF	0	216	0.107	397	10.0	0 x 0	VinIFlx	srs1
srs1	Peak AVF	0	706	0.107	635	12.6	10 x 16	RectFbg	
st2	Peak AVF	0	235	0.111	430	10.0	0 x 0	VinIFlx	srs1
st3	Peak AVF	0	255	0.115	467	10.0	0 x 0	VinIFlx	srs1

Bold/italic values have been manually overridden

Return Branch Detail Table

Name	Grille Size (in)	Htg (cfm)	Clg (cfm)	TEL (ft)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Stud/Joist Opening (in)	Duct Matl	Trunk
rb1	0x 0	0	706	0	0	0	0	0x 0		VIFx	

Project Information

For: Carlisle_SLAB_Reserve at Jewel Lake P2_FrmA1_LS21_LH, Century CMP Florida
SW BRE LANE, Lake City, FL 32024

Cooling Equipment

Design Conditions

Outdoor design DB:	92.0°F	Sensible gain:	15746	Btuh	Entering coil DB:	75.0°F
Outdoor design WB:	76.0°F	Latent gain:	3240	Btuh	Entering coil WB:	62.5°F
Indoor design DB:	75.0°F	Total gain:	18986	Btuh		
Indoor RH:	50%	Estimated airflow:	706	cfm		

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split ASHP				
Manufacturer:	Carrier	Model:	25HBC524AP0300+FB4CNP025L		
Actual airflow:	706	cfm			
Sensible capacity:	17774	Btuh	113%	of load	
Latent capacity:	3971	Btuh	123%	of load	
Total capacity:	21745	Btuh	115%	of load	SHR: 82%

Heating Equipment

Design Conditions

Outdoor design DB:	33.0°F	Heat loss:	21465	Btuh	Entering coil DB:	70.0°F
Indoor design DB:	70.0°F					

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split ASHP				
Manufacturer:	Carrier	Model:	25HBC524AP0300+FB4CNP025L		
Actual airflow:	0	cfm			
Output capacity:	24000	Btuh	112%	of load	Capacity balance: 31 °F
Supplemental heat required:	0	Btuh			Economic balance: -99 °F

Backup equipment type:	Elec strip				
Manufacturer:	Carrier	Model:	KFCEH2501C08		
Actual airflow:	0	cfm			
Output capacity:	8.0	kW	127%	of load	Temp. rise: 35 °F

Meets all requirements of ACCA Manual S.