




REVISIONS	

SCFPPLAN
ARCHITECTURAL DESIGN SOFTWARE

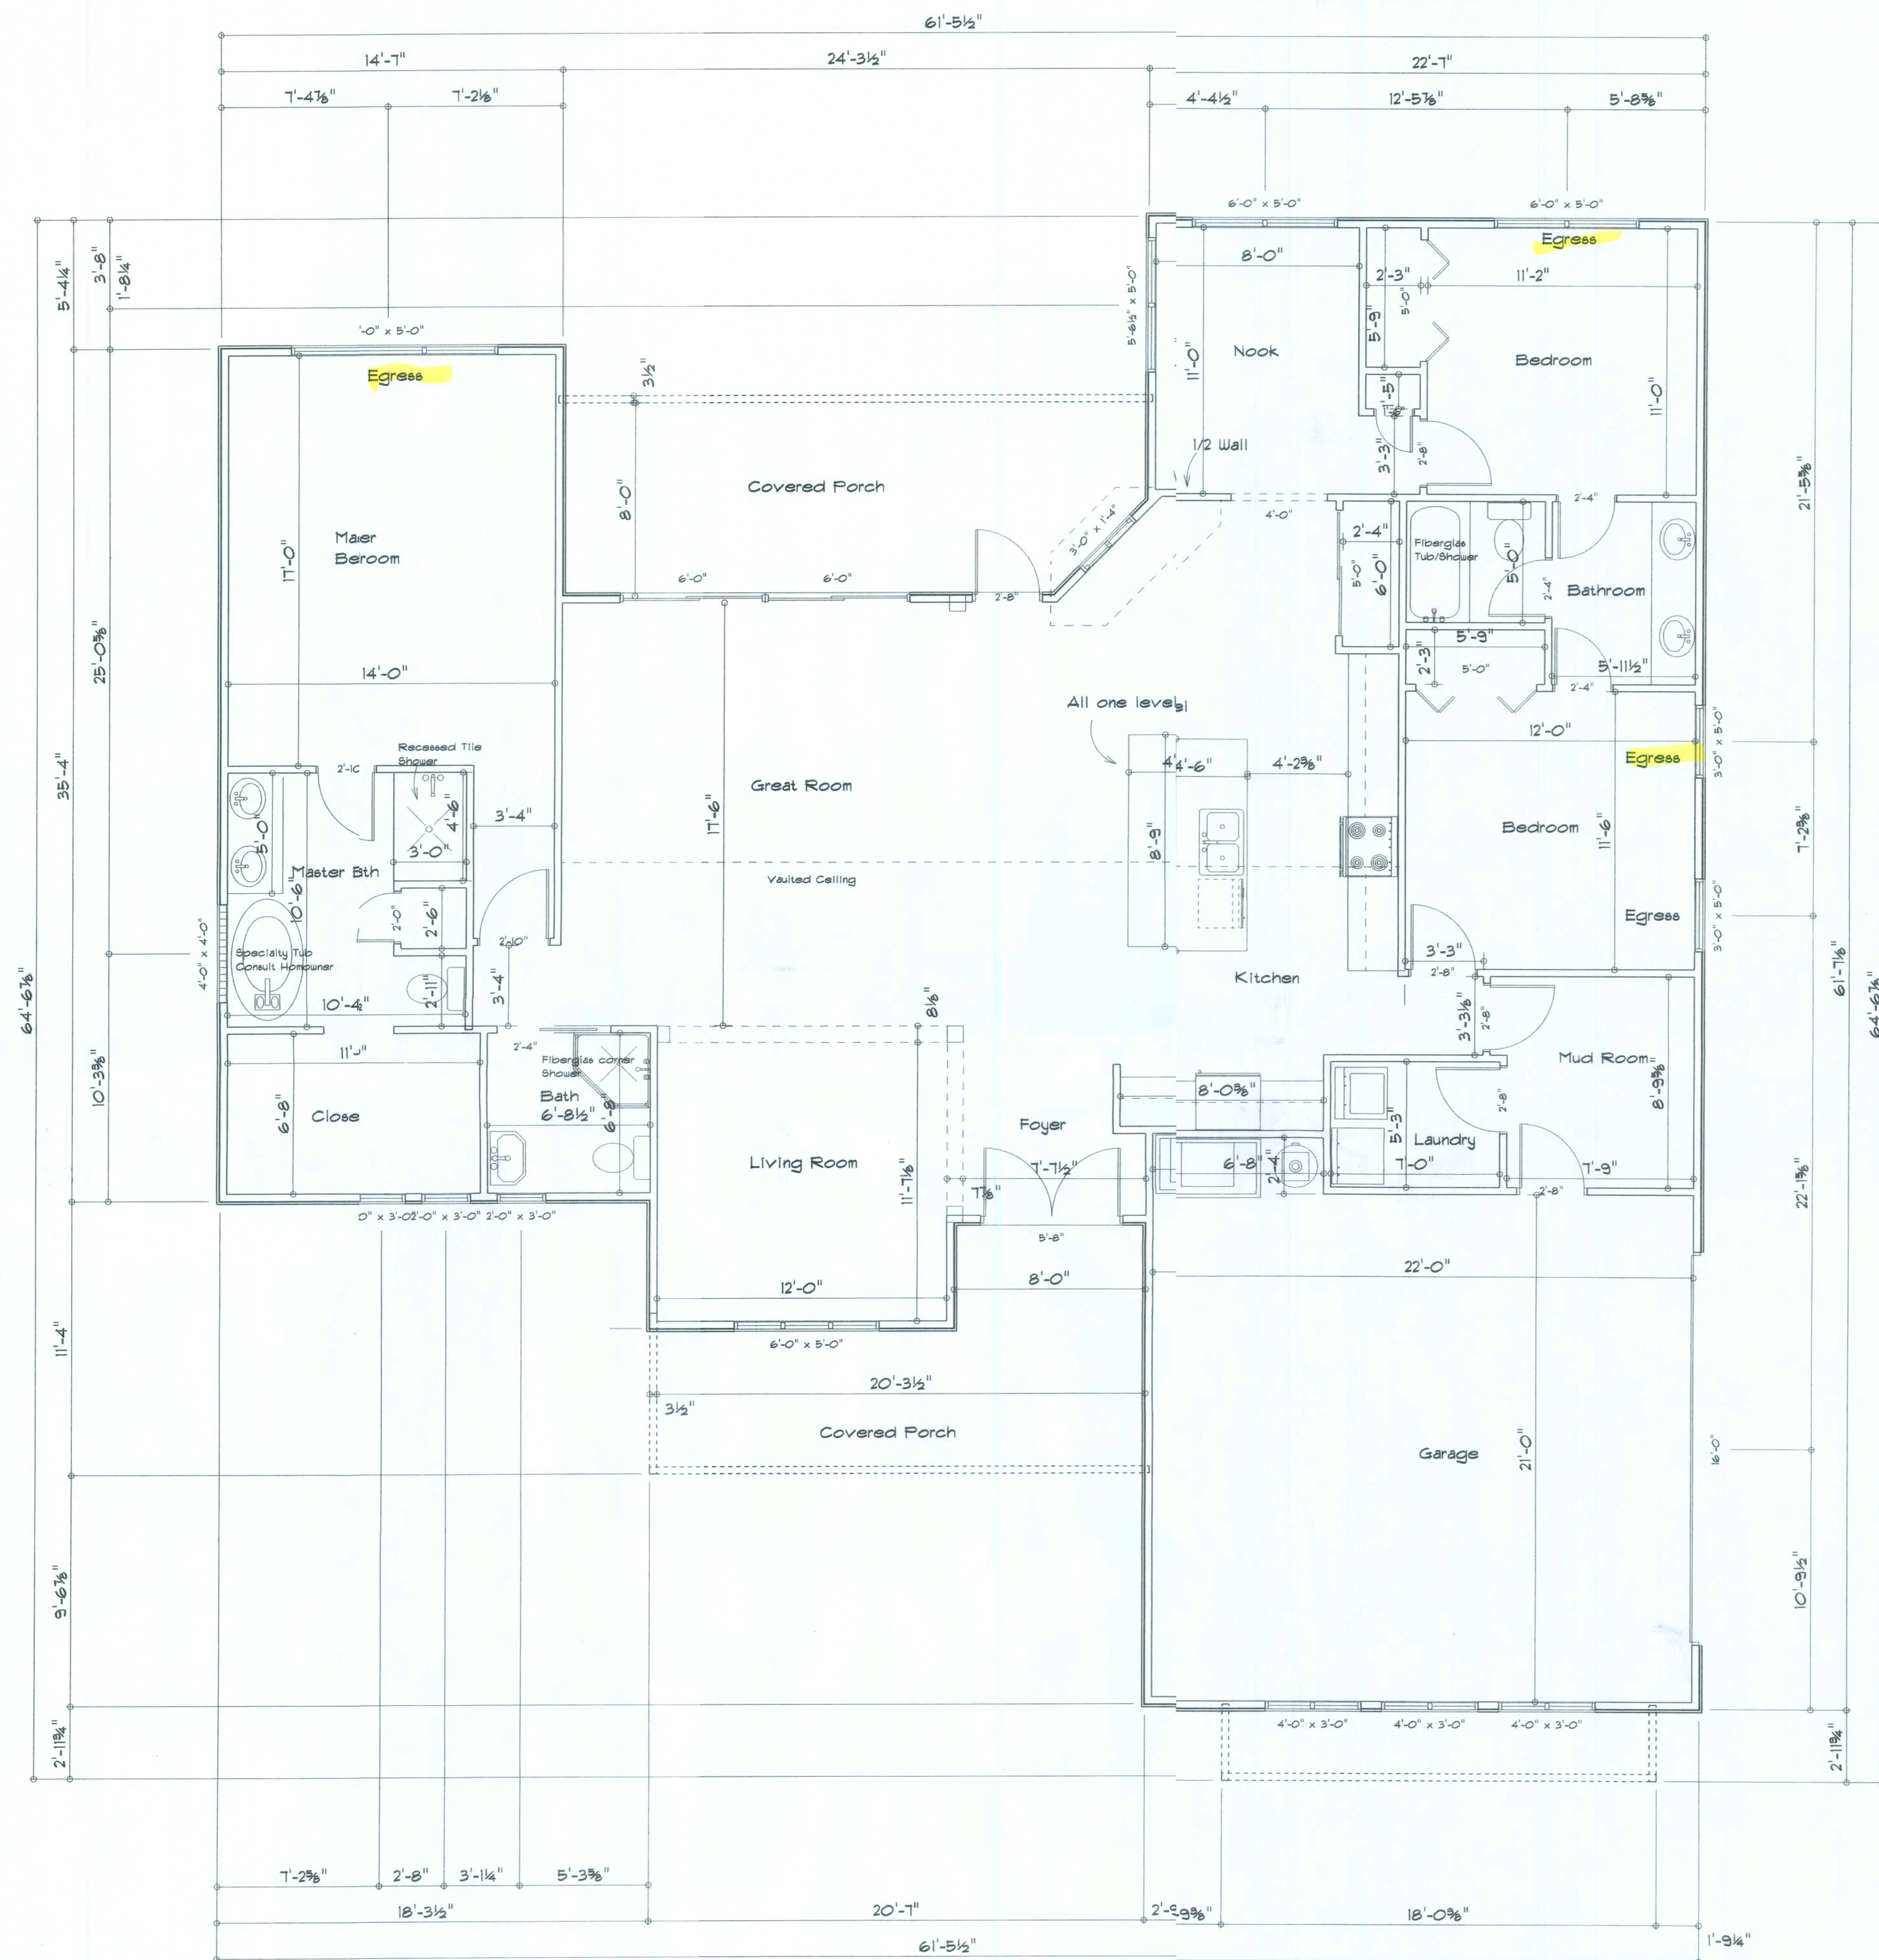

AREA SUMMARY

Living Area	2093 S.F.
Garage Area	512 S.F.
Front Porch Area	151 S.F.
Back Porch Area	193 S.F.
Total Area	2955 S.F.

RESIDENCE
Charles Ward

ADDRESS:
Columbia County, Florida

WoodmanPark Builders, Inc.
Lake City, Florida
Phone: (386) 755 - 2411
Fax: (386) 755-8684
Email:

PRINTED DATE:

DRAWN BY: CHECKED BY:

DESIGNED BY:

Mark Haddock

FINALS DATE:


JOENUMBER:

DRAWING NUMBER

A-1

REVISIONS	

- Electrical Plan Notes:
- E-1 Wire all appliances, HVAC units and other equipment per manufactures specifications.
 - E-2 Consult the owner for the number or separte telephone lines to be installed. Owner is responsible for all overages not noted on plan.
 - E-3 All installations shall be per national code 2008.
 - E-4 All smoke detectors shall be 120v with battery back-up of the photoelectric type, and shall be interlocked together. Install inside and near all bedrooms.
 - E-5 Telephone, television and other low voltage devices or outlets shall be as per the owners directions and in accordance with applicable sections of the National Electric Codes latest edition. Owner is responsible for all overages not noted on plan.
 - E-6 Electrical contractor shall be responsible for the design and sizing of electrical service and circuits.
 - E-7 Entry of service (underground or overhead) to be determined by contractor agreement.
 - E-8 All outlets located in residential to be tamper-resistant per NEC.
 - E-9 All outlets to be located above base flood elevation.
 - E-10 All exterior GFI outlets shall be weatherproof.
 - E-11 Overcurrent Protection device shall be installed on the exterior of structures on the load side of the meter to serve as a disconnecting means. Conductors used from the exterior disconnecting means to a panel or sub panel shall have four-wire conductors, of which one conductor shall be used as an equipment ground.
 - E-12 All 120-VOLT, single phase, 15 and 20 ampere branch circuits supplying outlets installed in dwelling unit family rooms,dining rooms, living rooms, parlors, libraries, dens, bedrooms, sun rooms, recreation rooms, closets, hallways, or similar rooms or areas shall be protected by a listed arc-fault circuit interrupter, combination-type installed to provide protection of the branch circuit.
 - E-13 Carbon Monoxide alarms shall be required within 10' of all rooms for sleeping purposes in buildings having a fossil-fuel burning heater or appliance, a fireplace or attached garage.

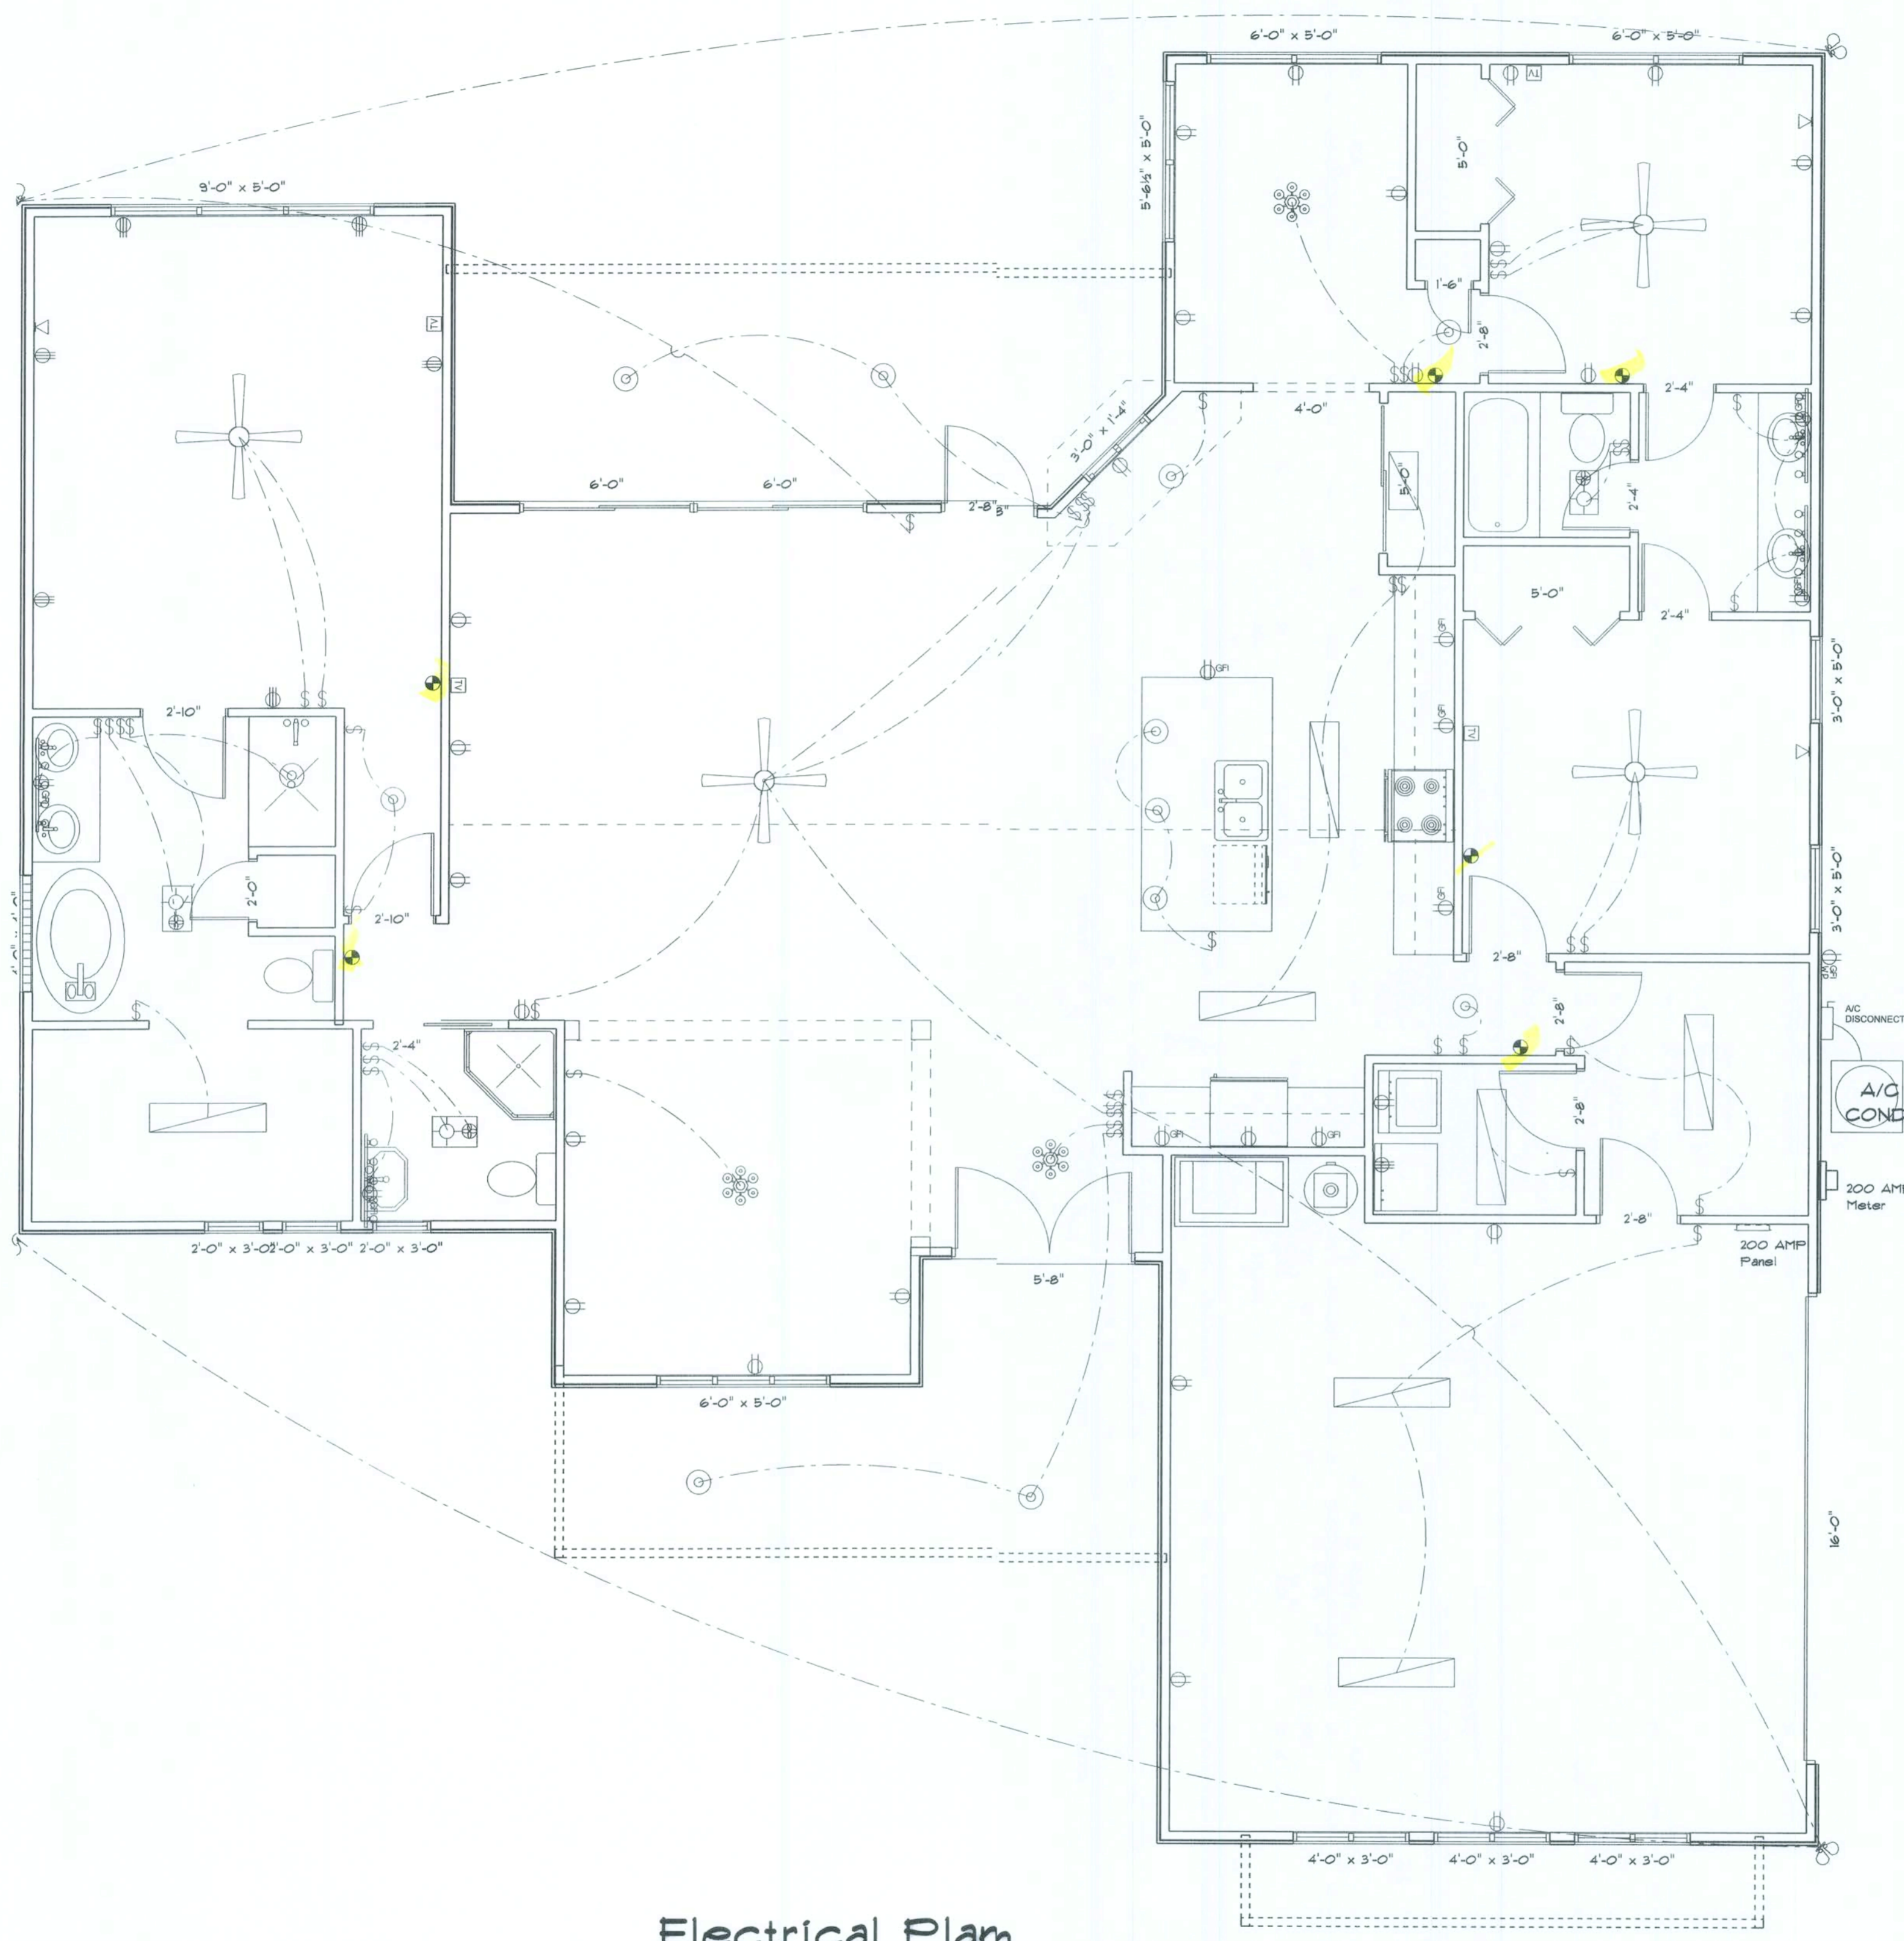

ELECTRICAL	SYMBOL
ceiling fan globe 1	
ceiling fan globe 2	
ceiling globe light	
chandelier	
double spotlight	
fluorescent fixture	
vanity bar light	
electrical panel	
AC Disconnect	
Outlet WP GFI	
cable tv outlet	
fan	
light	
outlet	
outlet 220v	
outlet gfi	
smoke detector	
switch	
telephone	

RESIDENCE
Charles Ward

ADDRESS:
Columbia County, Florida

Woodman Park Builders, Inc.
Lake City, Florida
Phone: (886) 755 - 2411
Fax: (886) 755-8684
Email:

PRINTED DATE:
DRAWN BY: CHECKED BY:

DESIGNED BY:
Mark Haddock
FINALS DATE:


JOBNUMBER:

DRAWING NUMBER

REVISIONS	



FRONT ELEVATION
SCALE: 1/4" = 1'-0"

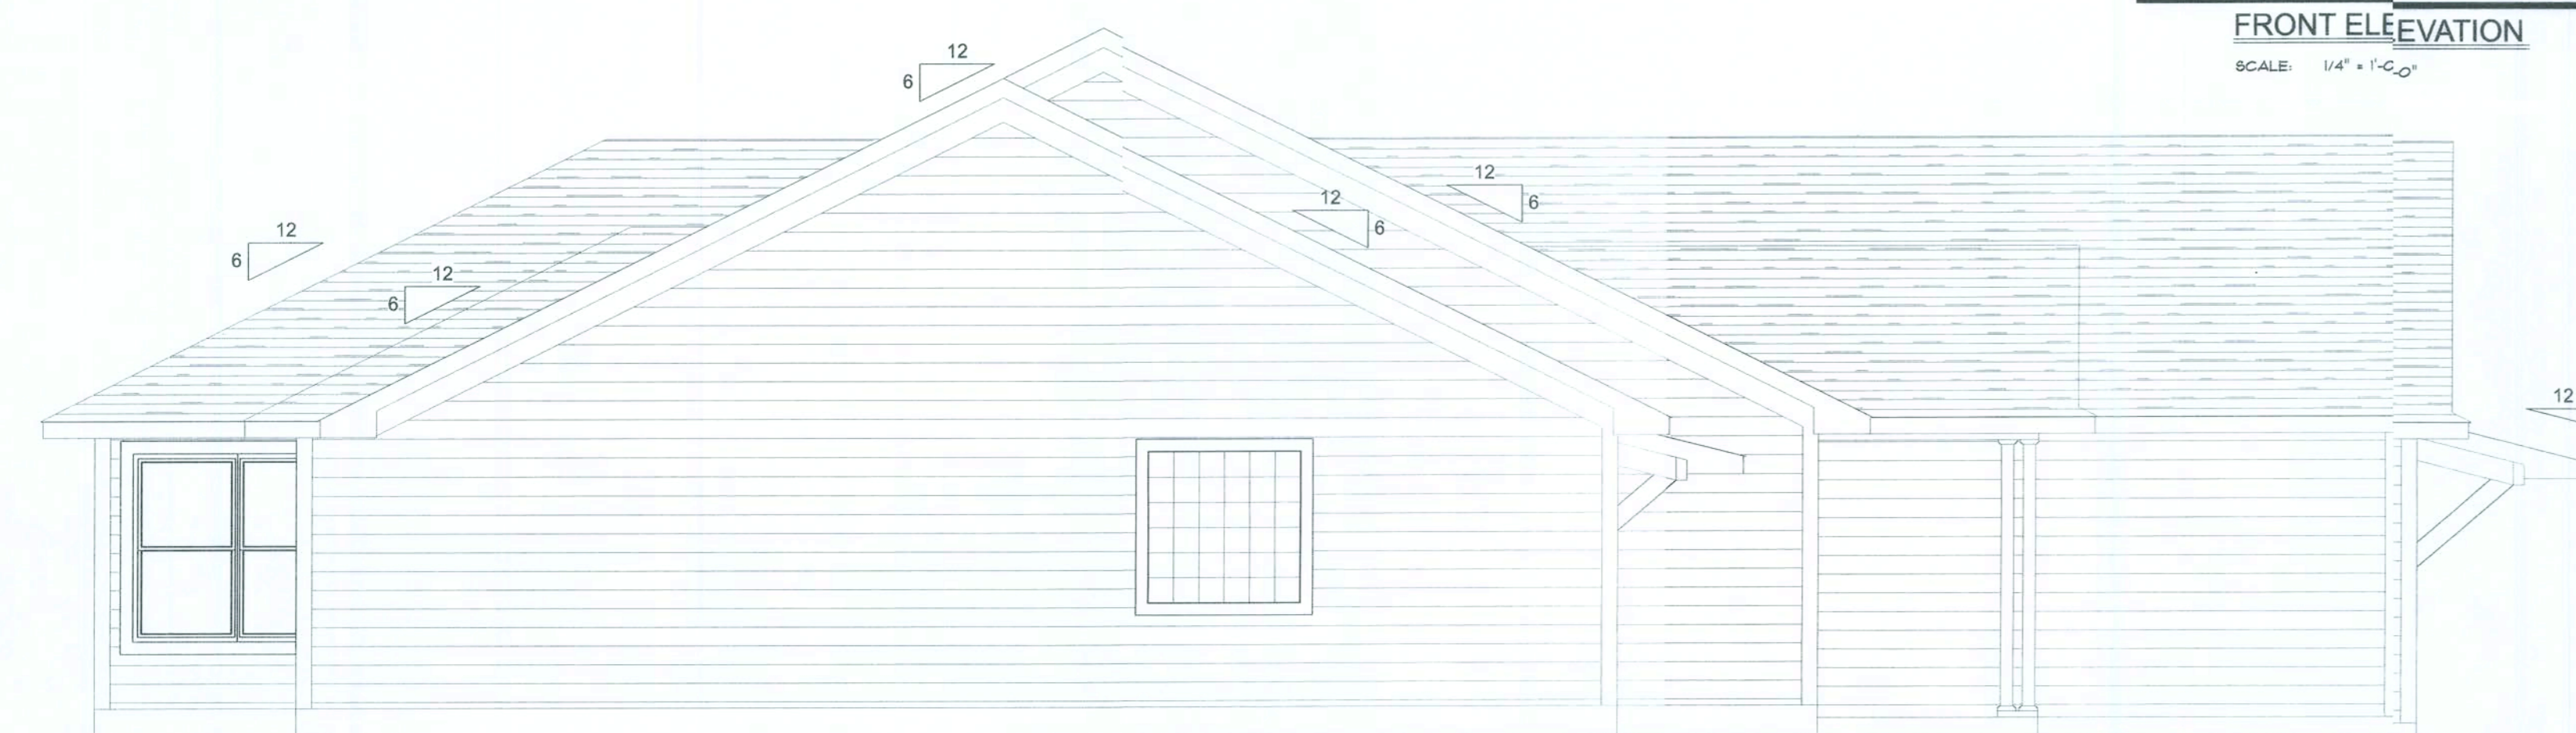

LEFT ELEVATION
SCALE: 1/4" = 1'-0"



RIGHT ELEVATION
SCALE: 1/4" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"

RESIDENCE
Charles Ward

ADDRESS:
Columbia County, Florida

Woodmair Park Builders, Inc.
Lake City, Florida
Phone: (386) 755-2411
Fax: (386) 755-8684
Email:

PRINTED DATE:

DRAWN BY: CHECKED BY:

DESIGNED BY:
Mark Haddox

FINALS DATE:

JOB NUMBER:


DRAWING NUMBER

A-3



Note: For sheathing located a minimum of 4 feet from the peneater edge, of the roof, including 4 feet on each side of ridges and hips, ill spacing is permitted to be 6 inches on center along panel edges and inches on center along intermediate supports in the panel field.

Note: This table specifies the code minimum thickness of rosheathing. The thickness of the sheathing may need to be increased bad in the type of roofing material being used. See manufacturer Florida prbad approval

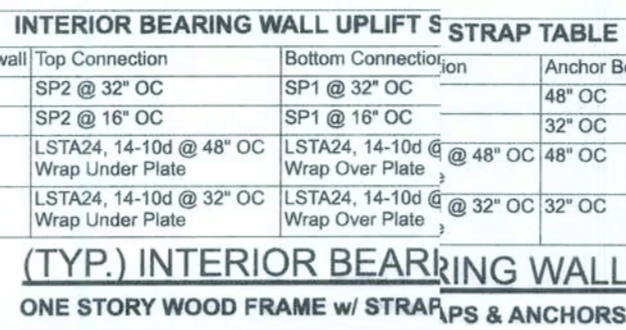

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:


GRADE & SPECIES TABLE			
		Fb	E
2x8	SP #2	925	1.4
2x10	SP #2	800	1.4
2x12	SP #2	750	1.4
GLB	24F-V3 SP	2600	1.9
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PSL	PARALAM	2900	2.0

COMPONENT & CLADDING DESIGN PRESSURES 130 MPH (EXP C)				
EFFECTIVE WIND AREA (FT ²)	ZONE 4 INTERIOR		ZONE 5 END 4' FROM ALL OUTSIDE CORNER	
0 - 20	+25.6(V/vasd)	-27.8(V/vasd)	+25.6(V/vasd)	-34.2(V/vasd)
0 - 20	+42.6(V/uit)	-46.2(V/uit)	+42.6(V/uit)	-57(V/uit)
GARAGE DOOR DESIGN PRESSURES 130 MPH (EXP C)				
9x7 GARAGE DOOR	+22.6(V/vasd)	-25.5(V/vasd)		
16x7 GARAGE DOOR	+21.7(V/vasd)	-24.1(V/vasd)		



Mark Discsway P.E.
163 SW Miltown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
210100

S.1
 OF 3 SHEETS




SILL PLATE SPANS FOR 10'-0" WALL HEIGHT					
DESIGN WIND SPEED	MAX. SPANS FOR SPF #2				BASED ON WFCM TABLE A-3.23B
	(1) 2x4	(2) 2x4	(1) 2x6	(2) 2x6	
0 MPH EXP. C	5'-2"	7'-9"	7'-7"	11'-3"	FOR OTHER WALL HEIGHTS (H) SILL SPAN SHALL BE DIVIDED BY (H/10)

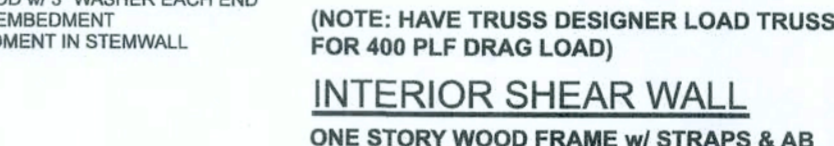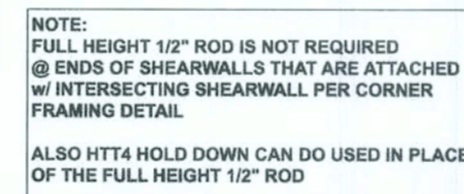


Mark Discsway P.E.
163 SW Miltown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
210100

S.1
 OF 3 SHEETS

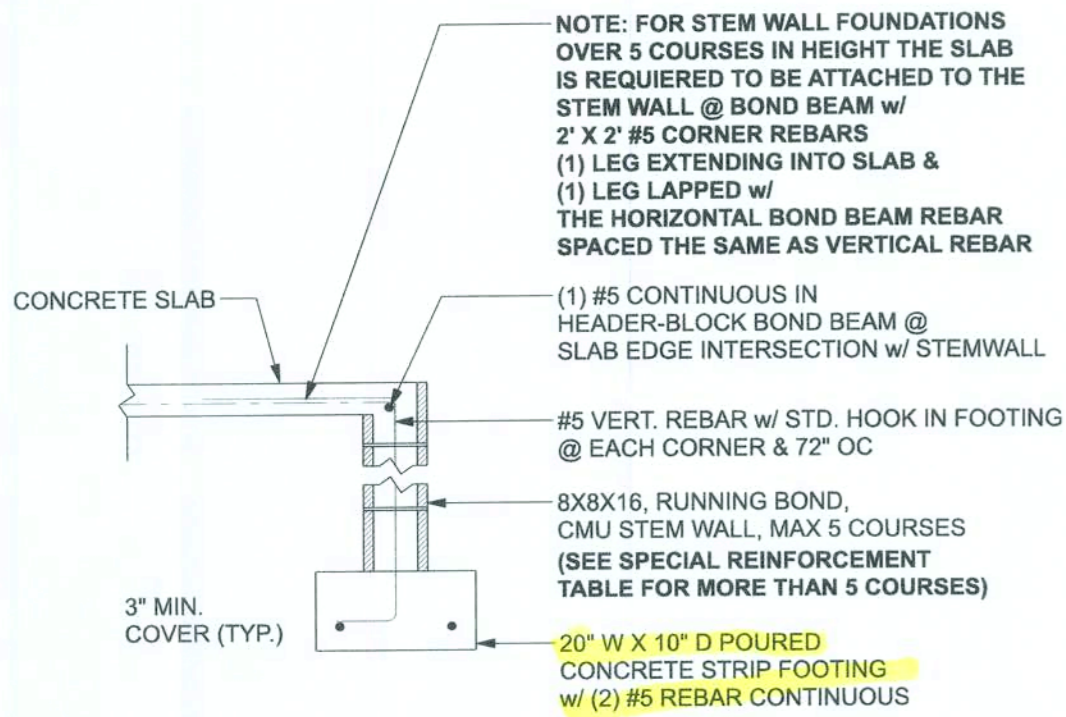

F1 S-2 **OPTIONAL STEM WALL FOOTING**
 SCALE: 1/2" = 1'-0"

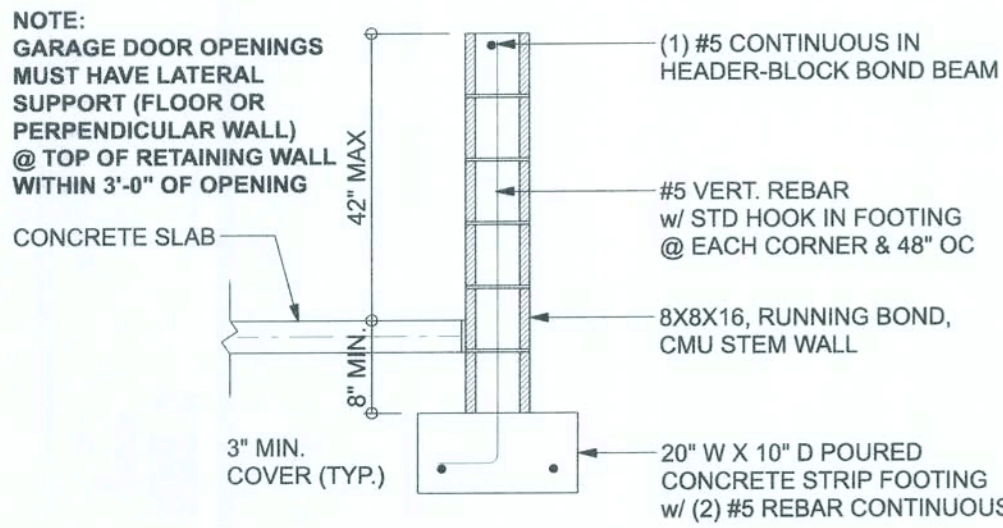

F4 S-2 **OPTIONAL STEM WALL CURB FOOTING**
 SCALE: 1/2" = 1'-0"

TALL STEM WALL TABLE:

The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16"OC vertically or a horizontal bond beam with #5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.


STEMWALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEMWALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEMWALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

MASONRY NOTE:


MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

ACI 530.1-02 Section	Specific Requirements
1.4A Compressive strength	8" block bearing walls Fm = 1500 psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.9"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM A15, Grade 40, Fy = 40 ksi, Lap splices min 40 bar dia. (25" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class G60, 0.60 oz/lb or 304SS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/lb or 304SS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.


BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

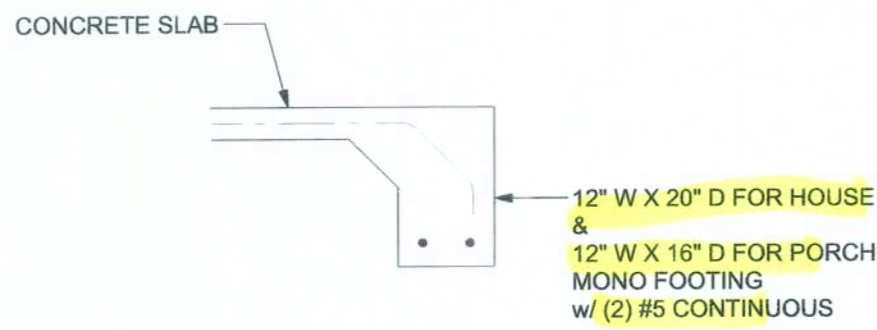


F1 S-2 **MONOLITHIC FOOTING**
 SCALE: 1/2" = 1'-0"

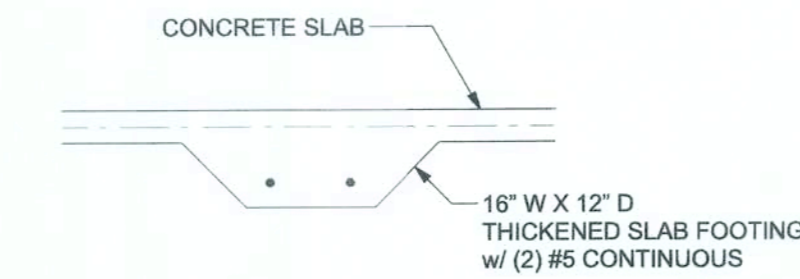


F2 S-2 **INTERIOR BEARING FOOTING**
 SCALE: 1/2" = 1'-0"

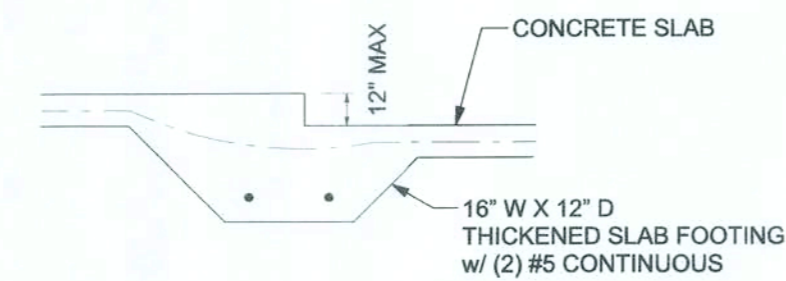

F3 S-2 **INTERIOR BEARING STEP FOOTING**
 SCALE: 1/2" = 1'-0"

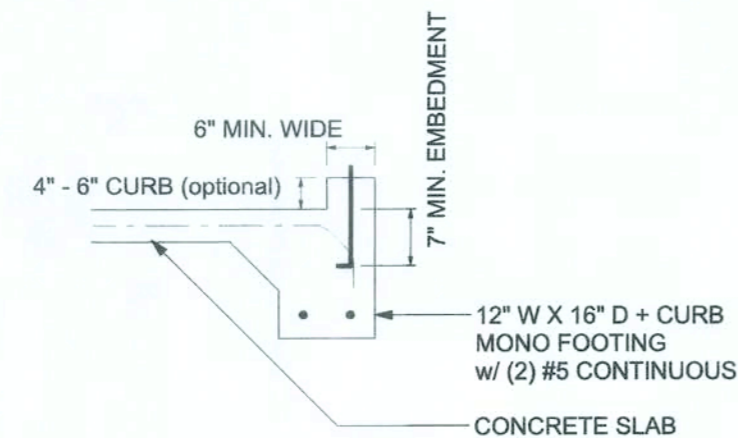

F4 S-2 **MONOLITHIC CURB FOOTING**
 SCALE: 1/2" = 1'-0"

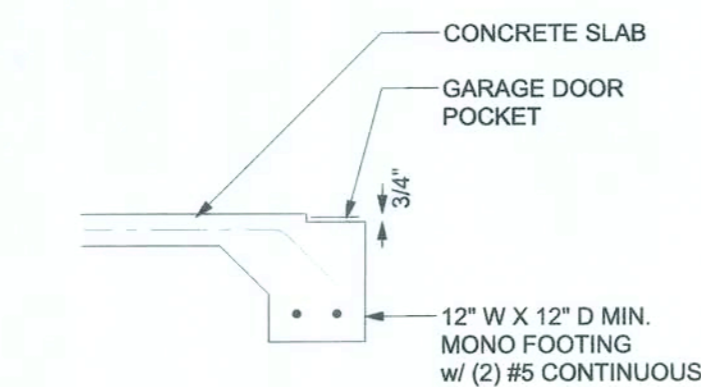


F5 S-2 **GARAGE DOOR POCKET FOOTING**
 SCALE: 1/2" = 1'-0"

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS. RECESSES IN SLAB, STEP DOWNS, ETC. DISOWAY DESIGN GROUP OR MARK DISOWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING IN ALL AREAS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
FN - 3	THE SLAB SHALL BE 4" CONCRETE SLAB REINFORCED w/ 18X18-14"4 WELDED WIRE MESH PLACED ON CHAIRS @ 12" DEPTH OR FIBER MESH CONCRETE 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLYURETHANE TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED TERMITE-TREATMENT METHOD CAN BE USED INSTEAD)

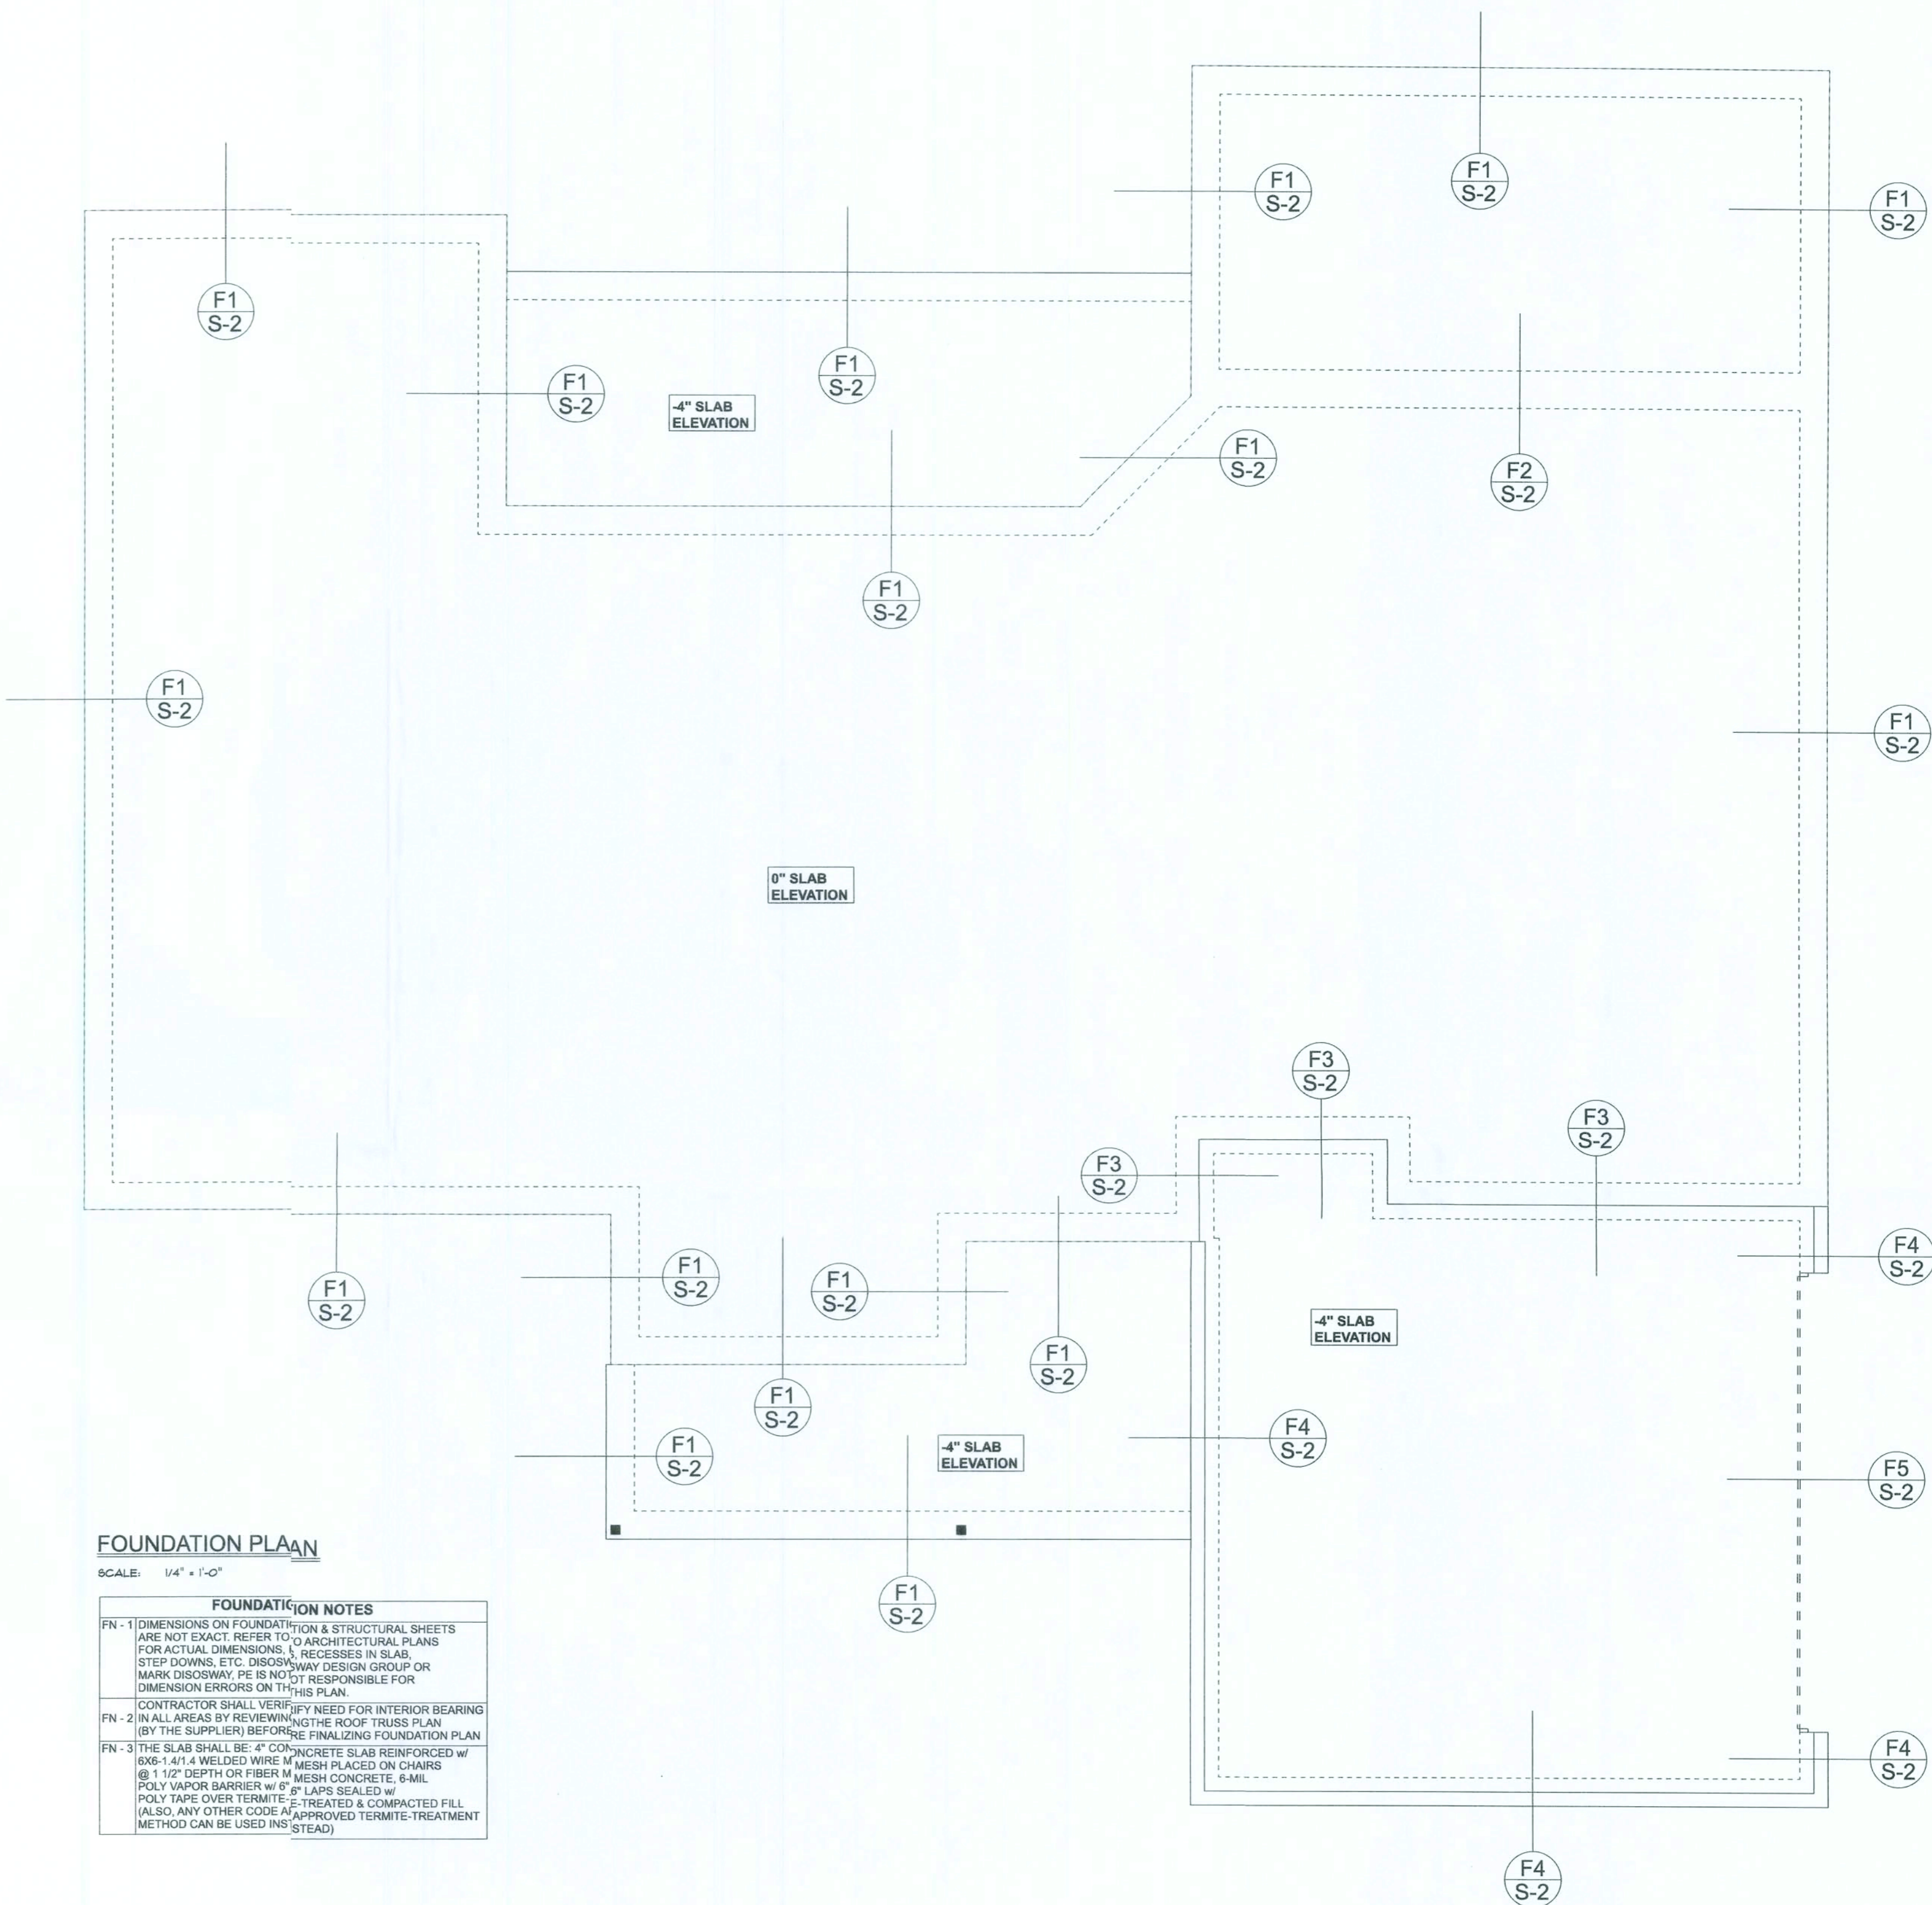

Woodman Park Builders, Inc.

Charles Wanj Res.

PROJECT ADDRESS:
Columbia County, Florida

DIMENSIONS:
 Stated dimensions supersede scaled dimensions. Refer all locations to Mark Disoway, P.E. If resolution, Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
 Mark Disoway, P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code (Residential) (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.


MARK DISOWAY P.E. 53915



Mark Disoway P.E.
 163 SW Midtown Place
 Suite 103
 Lake City, Florida 32025
 386.754.5419
 disowaydesign@gmail.com

JOB NUMBER:
210100

S-2
 OF 3 SHEETS

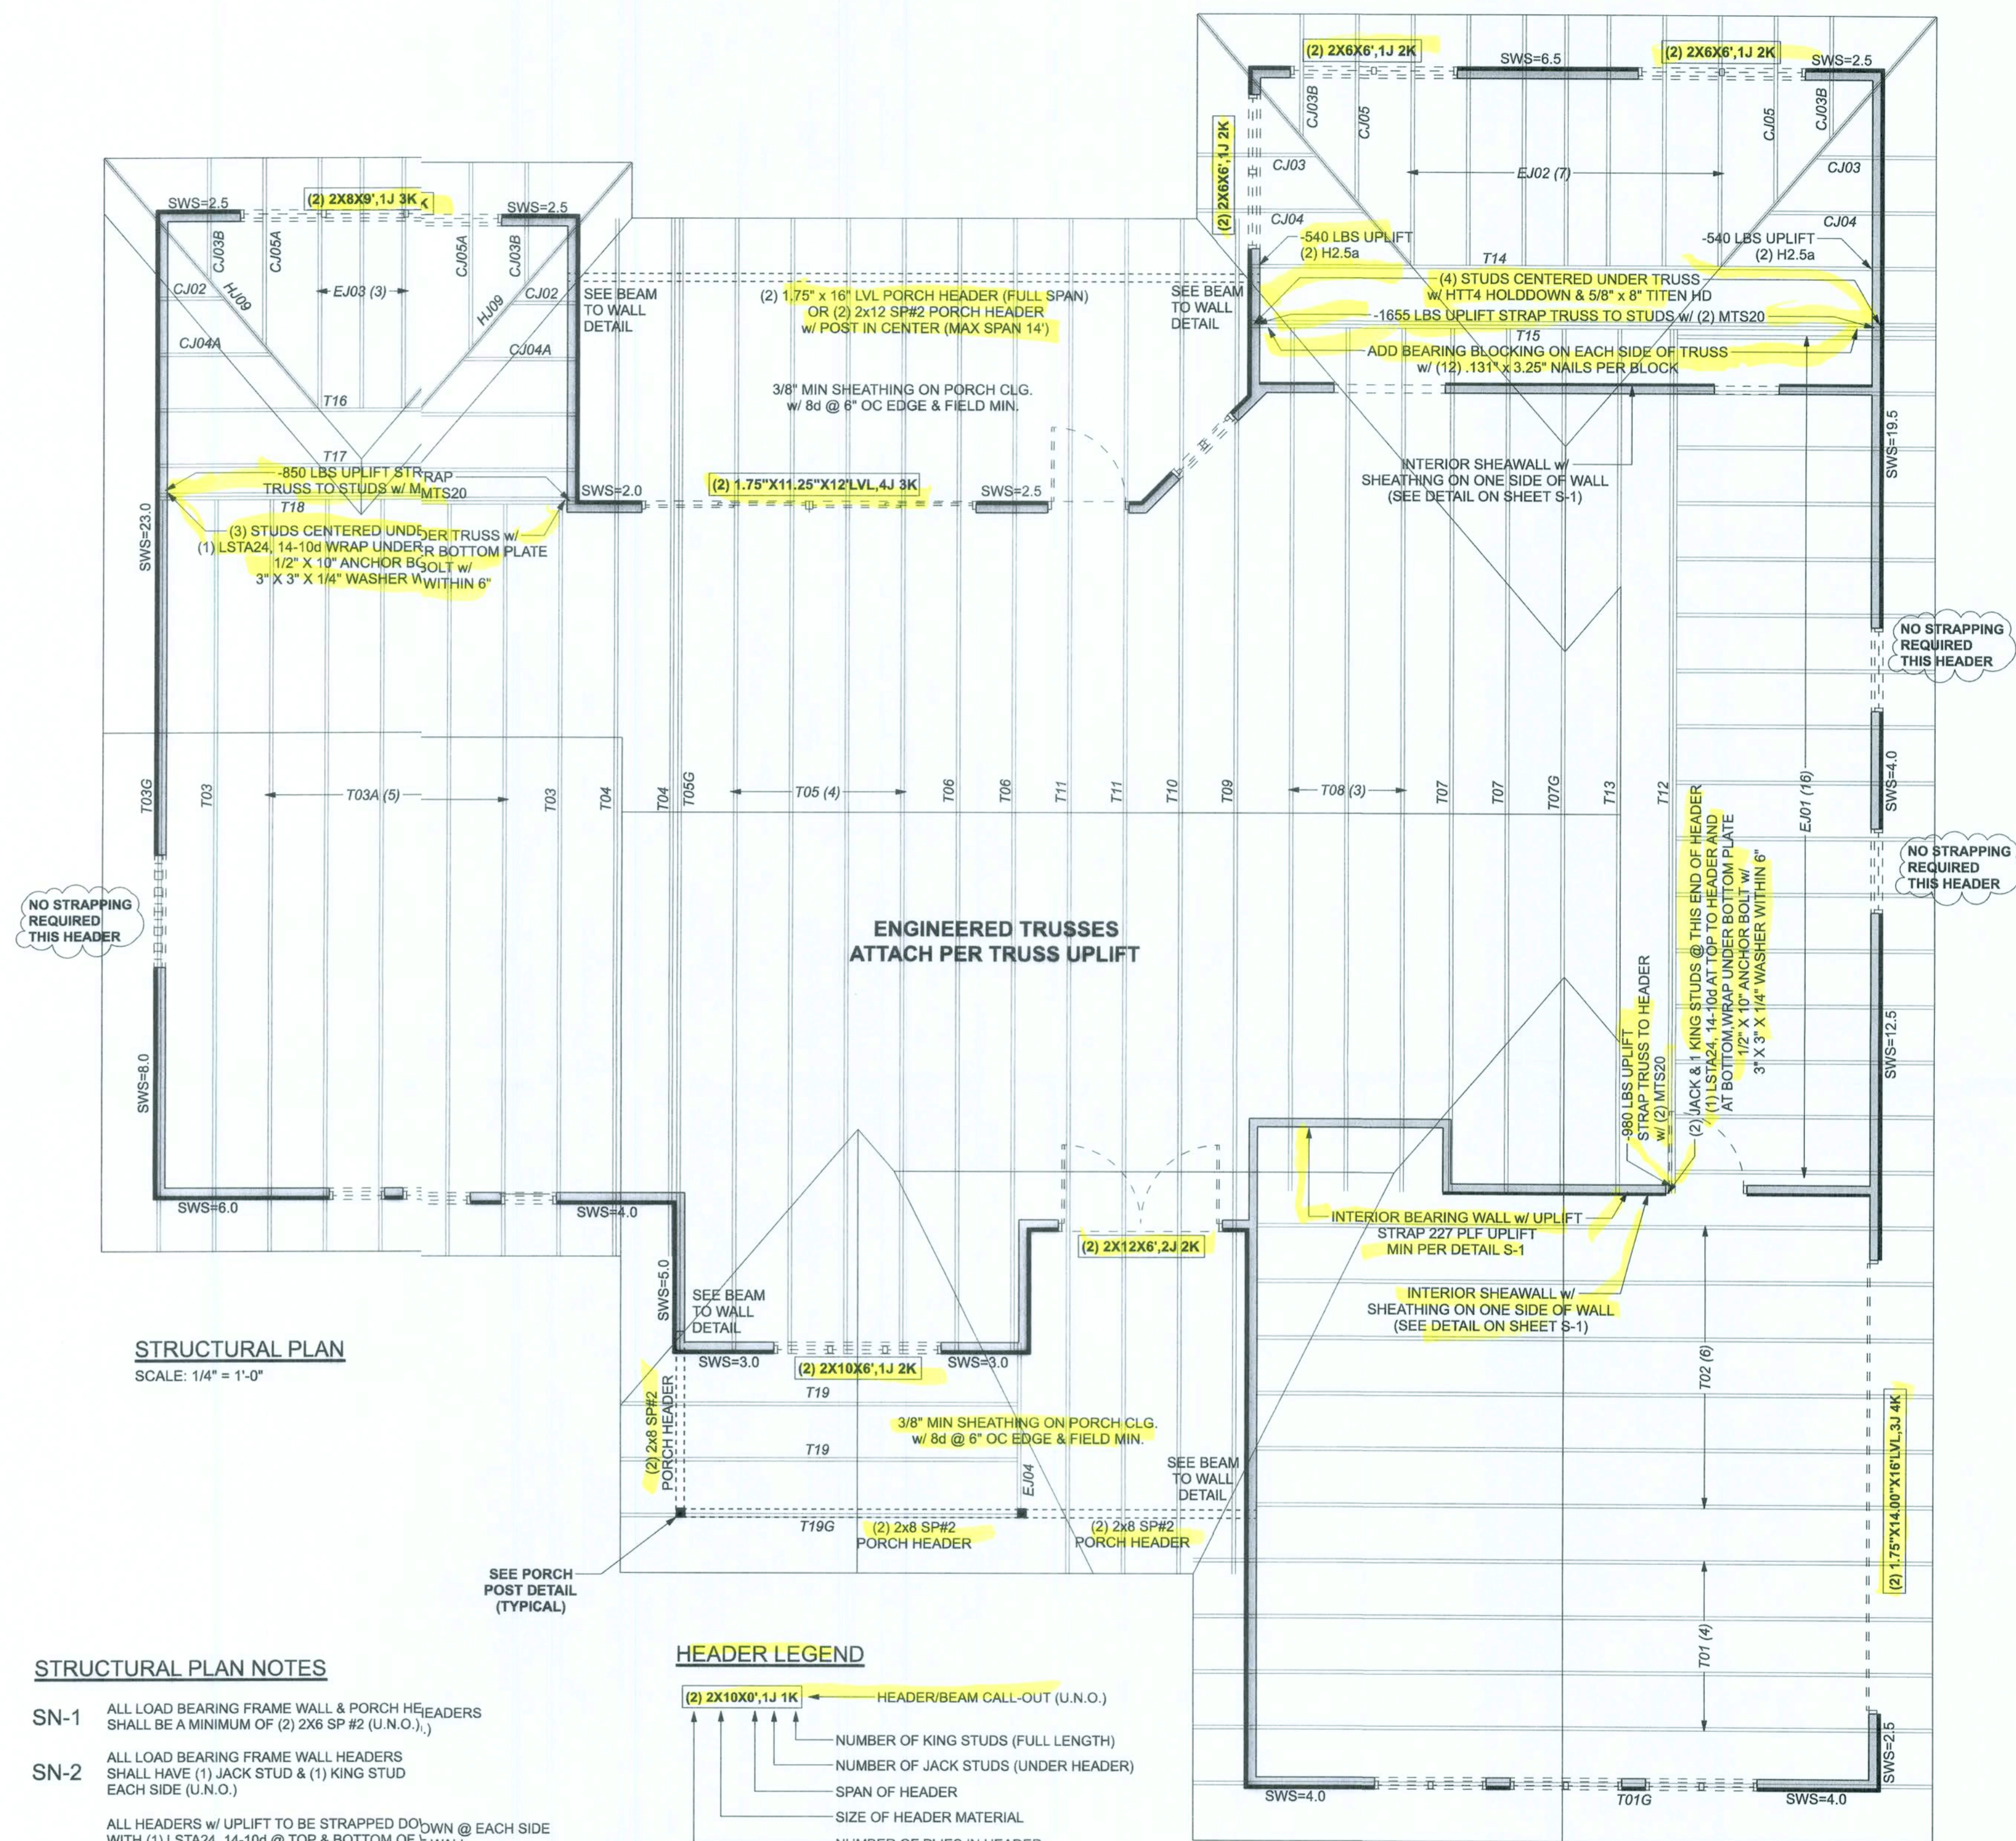


STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (U.N.O.).
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.).
- SN-3 ALL HEADERS w/ UPLIFT TO BE STRAPPED DOWN @ EACH SIDE WITH (1) LSTA24, 14-10d @ TOP & BOTTOM OF WALL WRAP UNDER BOTTOM PLATE & OVER TOP PLATE 1/2" X 10" ANCHOR BOLT w/ 3" X 3" X 1/4" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.).
- SN-4 USE ONE JACK STUD GIRDER SUPPORT PER 2 2500 LB LOAD
- SN-5 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-6 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCS11-03, BCS11-01, BCS11-02 & BCS11-03. BCS11-01, BCS11-02 & BCS11-03 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND

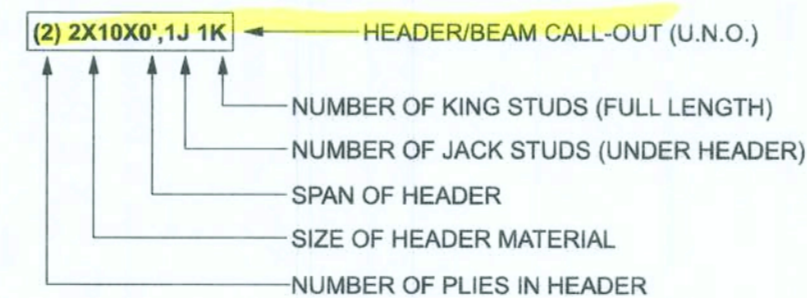

ACTUAL vs REQUIRED SHEARWALL

	TRANSVERSE	LONGITUDINAL
ACTUAL	29502 LBF	27522 LBF
REQUIRED	18339 LBF	22566 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. BUILDERS FIRST SOURCE JOB #2623537

Woodman Park Builders, Inc.

Craines wato Res.

PROJECT ADDRESS:
Columbia County, Florida


DIMENSIONS:
Stated dimensions surround scaled dimensions. Refer all questions to Mark Disoway, P.E. in resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY P.E. 53915

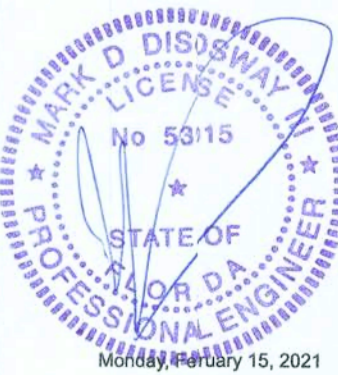

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
211100

S-3
OF 3 SHEETS