

TYPICAL WALL SECTION
SCALE: 1" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"



FRONT ELEVATION
SCALE: 1/4" = 1'-0"

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS



REVISIONS	DATE
February 15, 2022	


SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

FRONT & REAR ELEVATIONS
SCALE: 1/4" = 1'-0"

TYPICAL WALL SECTION
SCALE: 1" = 1'-0"

MODEL 1880 FOR: Lot 50, Emerald Cove
Glen and Tavia Weatherly
Property Address: 265 SW Fieldstone Court, Lake City Florida 32025
GIBALTAR CONTRACTING, LLC.
LIC# 1259633 HIGH SPRINGS, FLORIDA

© Wm DESIGN & ASSOCIATES, INC.
426 SW COMMERCE DR. STE 130
LAKE CITY, FL 32025
(386) 758-8406
will@willmyers.net

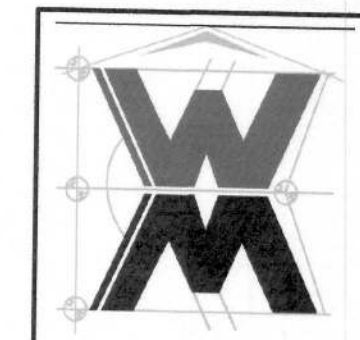

JOB NUMBER
20220216

SHEET NUMBER

A.1
OF 4 SHEETS



LEFT ELEVATION
SCALE: 1/4" = 1'-0"



RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

Wm C Myers


REVISIONS
February 15, 2022



LEFT & RIGHT ELEVATIONS
SCALE: 1/4" = 1'-0"


MODEL 1880 FORlot 50, Emerald Cove
Glen and Tavia Weatherly
Property Address: 2 SW Fieldstone Court, Lake City Florida 32025
GIBRALTR CONTRACTING, LLC.
LIC# 1259633 HH SPRINGS, FLORIDA

© WM DESIGN & ASSOCIATES, INC.
426 SW COMMERCE DR, STE 130
LAKE CITY, FL 32025
(386) 758-8406
wll@gwillmyers.net

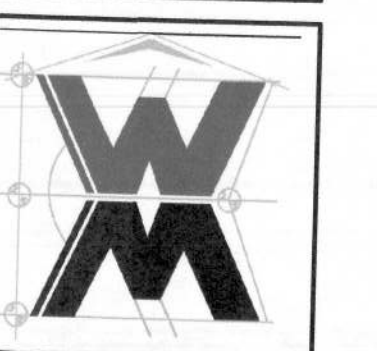

JOB NUMBER
20220216

SHEET NUMBER
A.2
OF 4 SHEETS

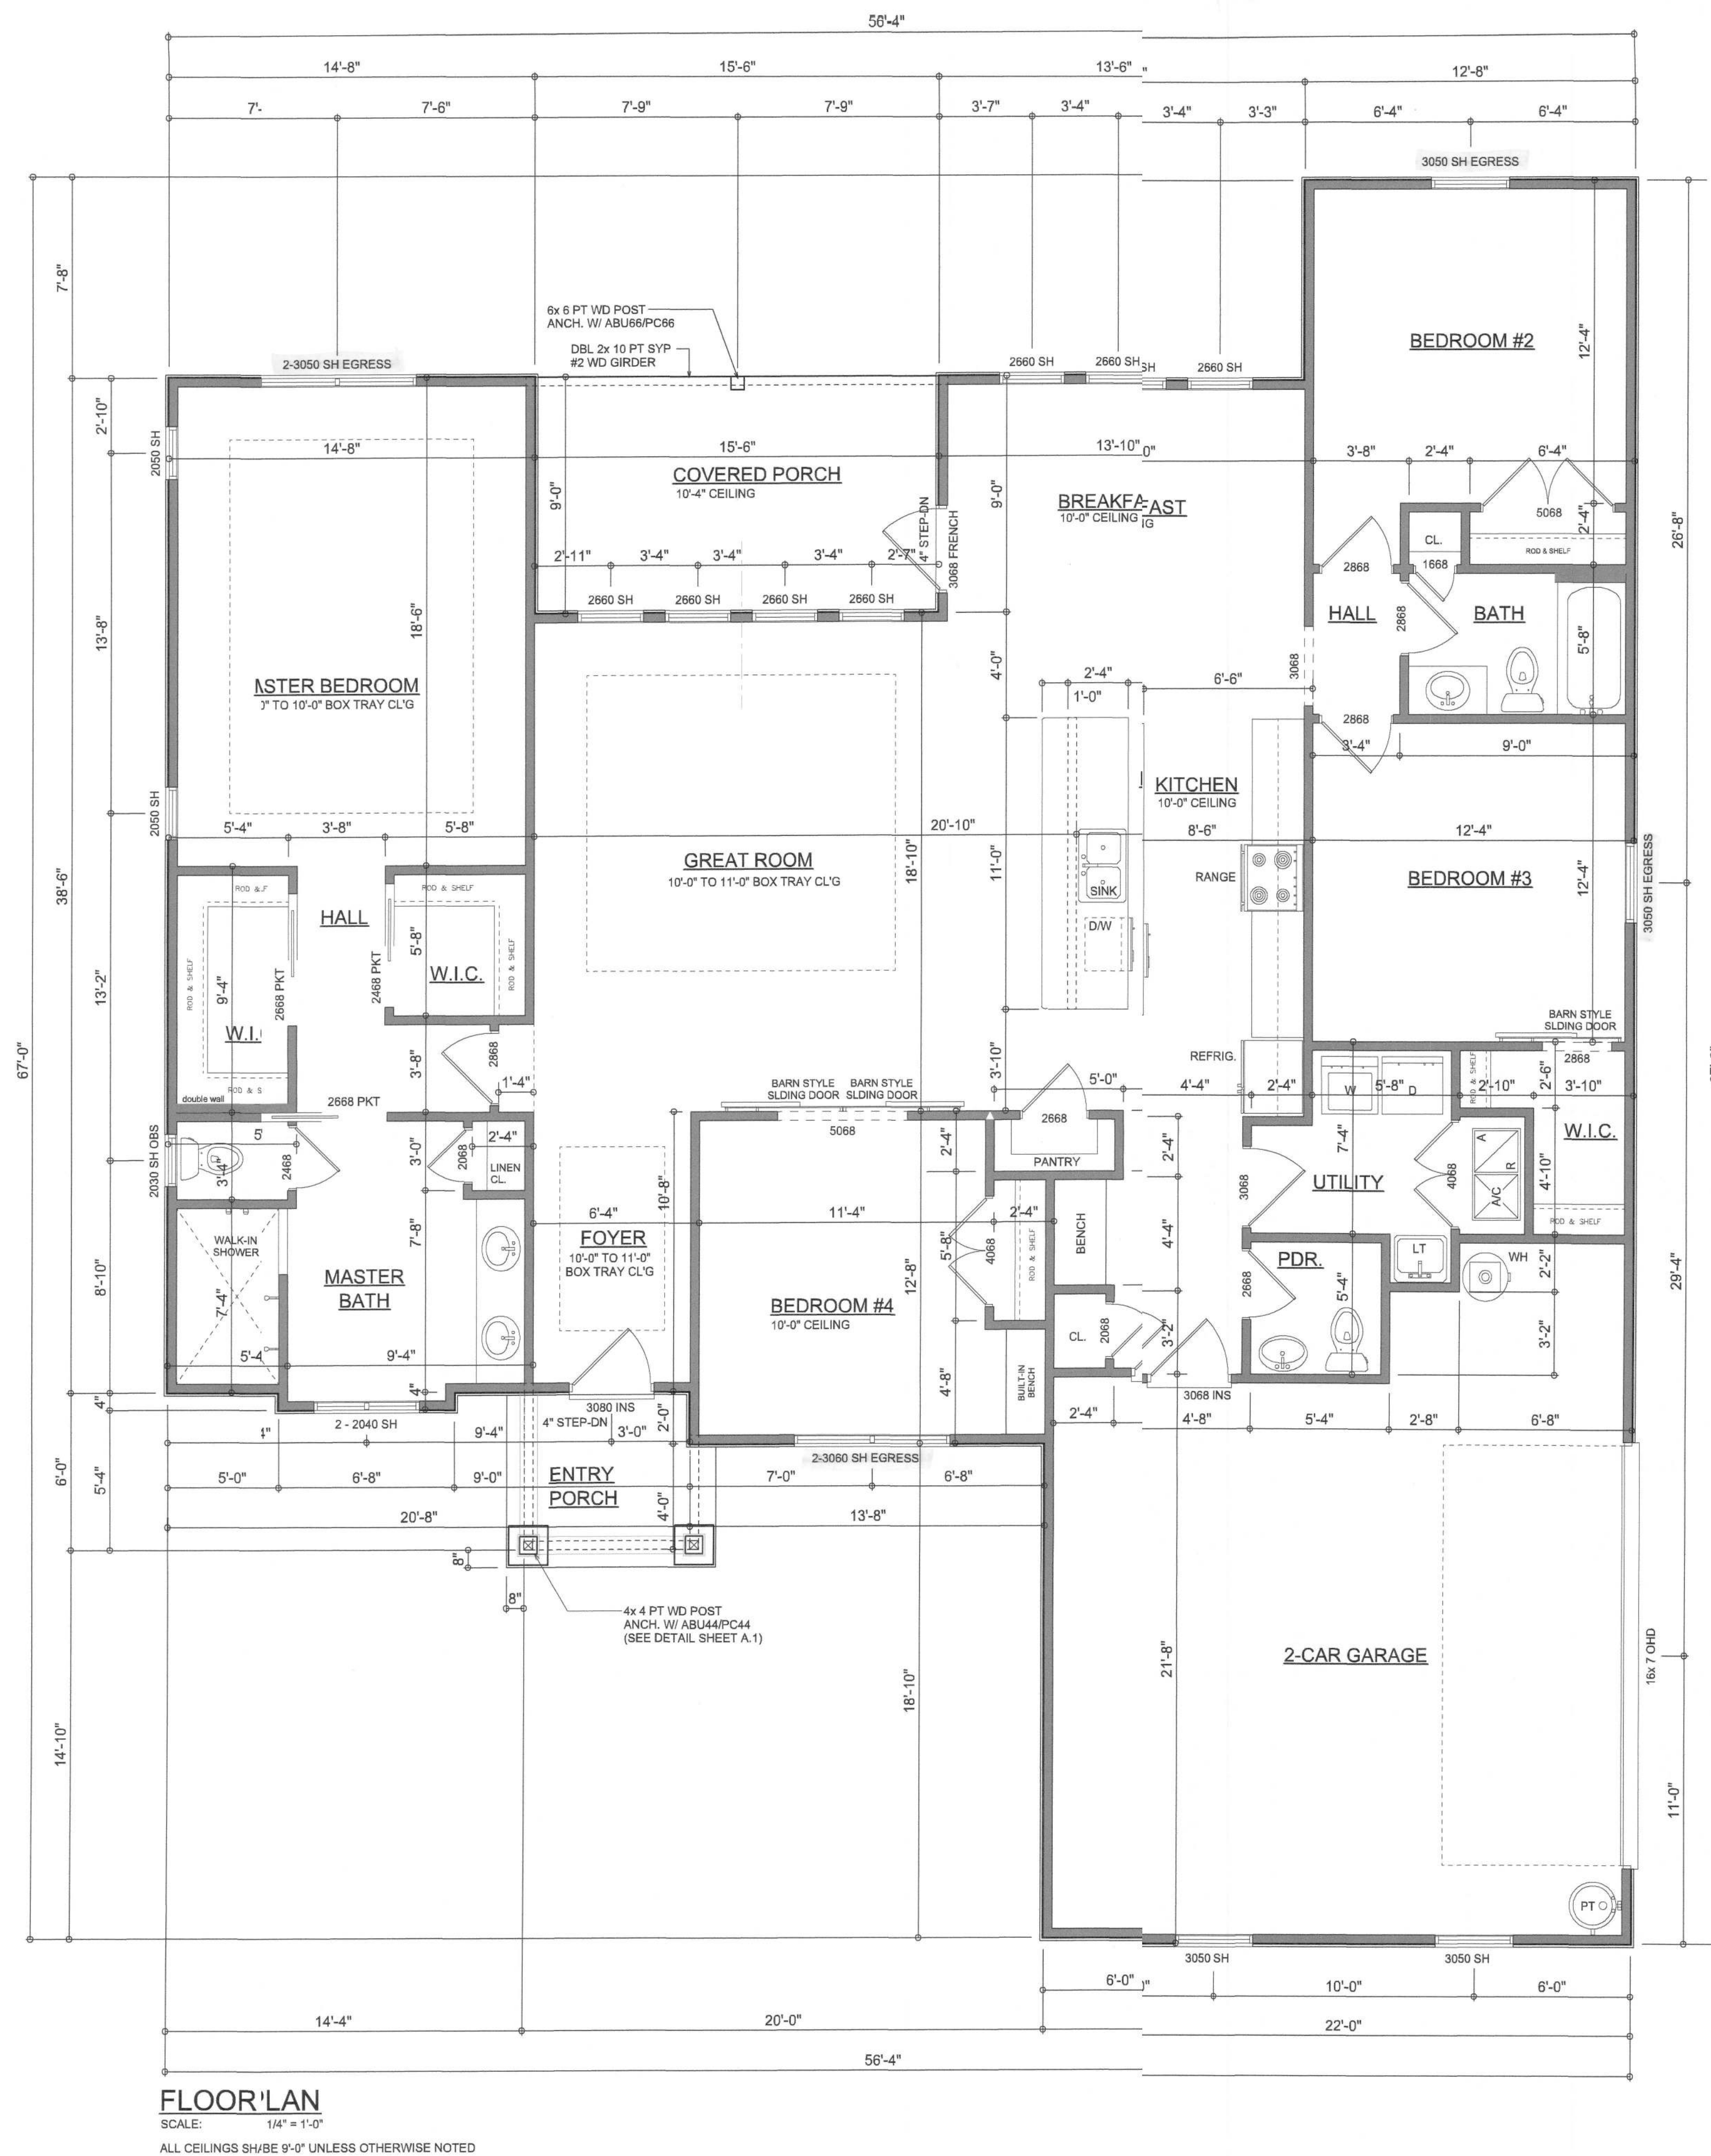

FLOOR PLAN

SCALE: 1/4" = 1'-0"

ALL CEILINGS SH/BE 9'-0" UNLESS OTHERWISE NOTED

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

Garage fire separations shall comply with the following:

1. The private garage shall be separated from the dwelling unit and its attic area by means of a minimum 1/2-inch (12.7 mm) gypsum board applied to the garage side. Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8-inch Type X gypsum board or equivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or solid or honeycomb core steel doors not less than 13/8 inches (34.9 mm) thick, or doors in compliance with Section 715.3.3. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted.
2. Ducts in a private garage and ducts penetrating the walls or ceilings separating the dwelling unit from the garage shall be constructed of a minimum 0.019-inch (0.48 mm) sheet steel and shall have no openings into the garage.
3. A separation is not required between a Group R-3 and U carport provided the carport is entirely open on two or more sides and there are not enclosed areas above.
4. When installing an attic access and/or pull-down stair unit in the garage, devise shall have a minimum 20 min. fire rating.

AREA SUMMARY

LIVING AREA	2,105	S.F.
GARAGE AREA	512	S.F.
ENTRY PORCH AREA	50	S.F.
COVERED PORCH AREA	140	S.F.
TOTAL AREA	2,807	S.F.

REVISIONS
April 28, 2022

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

DIMENSIONED FLOOR PLAN
SCALE: 1/4" = 1'-0"


MODEL 1880 FOR: Lot 50, Emerald Cove

Glen and Tavia Weatherly

Property Address: 265 SW Fieldstone Court, Lake City, Florida 32025

GIBALTAR CONTRACTING, LLC.
LIC# 1259633 HIGH SPRINGS, FLORIDA

© W.M. DESIGN & ASSOCIATES, INC.
426 SW COMMERCE DR., STE. 130
LAKE CITY, FL 32025
(386) 758-8406
wm@willmyers.net

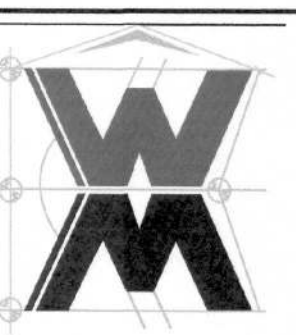

JOB NUMBER
20220216

SHEET NUMBER

A.3
OF 4 SHEETS

Will C. Myers

ELECTRICAL LEGEND	
	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	RECESSED CAN LIGHT
	BATH EXHAUST FAN
	LIGHT FIXTURE
	DUPLEX OUTLET (AFCI & TAMPER RESISTANT)
	220v OUTLET
	GFI DUPLEX OUTLET (PER NEC 406.8)
	TELEVISION JACK
	CIRCUIT FOR MINI-SPLIT A/C UNIT
	SMOKE / CARBON MONOXIDE DETECTOR (see note below)
	WALL SWITCH
	3 WAY WALL SWITCH
	WATER PROOF GFI OUTLET
	2 OR 4 TUB FLUORESCENT FIXTURE


NOTE:
ALL INTERIOR RECEPTACLES SHALL BE AFCI
(ARC FAULT CIRCUIT INTERRUPT) PER NEC 210.12 & TAMPER RESISTANT PER
NEC 406.11

ALL INTERIOR & EXTERIOR LIGHTING SHALL MEET OR EXCEED THE MIN. 75% HIGH-EFFICIENCY
LIGHTING PER FBC-ENERGY CONSERVATION R404.

ALL SMOKE DETECTORS BE A COMBO SMOKE & CARBON MONOXIDE DETECTOR
AND SHALL HAVE BATTERY BACKUP POWER
AND ALL WIRED TOGETHER SO IF ANY ONE UNIT IS ACTUATED THEY
ALL ACTIVATE.

THE ELECTRICAL SERVICE OVERCURRENT PROTECTION DEVICE SHALL BE
INSTALLED ON THE EXTERIOR OF STRUCTURES TO SERVE AS A DISCONNECT MEANS.
CONDUCTORS USED FROM THE EXTERIOR DISCONNECTING MEANS TO A PANEL OR SUB
PANEL SHALL HAVE FOUR-WIRE CONDUCTORS, OF WHICH ONE CONDUCTOR
SHALL BE USED AS AN EQUIPMENT GROUND.

IT IS THE LICENSED ELECTRICAL CONTRACTORS RESPONSIBILITY TO INSURE THAT ALL
WORK PERFORMED AND EQUIPMENT INSTALLED MEETS OR EXCEEDS THE 2017 (NFPA-70) NATIONAL
ELECTRIC CODE AND ALL OTHER LOCAL CODES AND ORDINANCES.

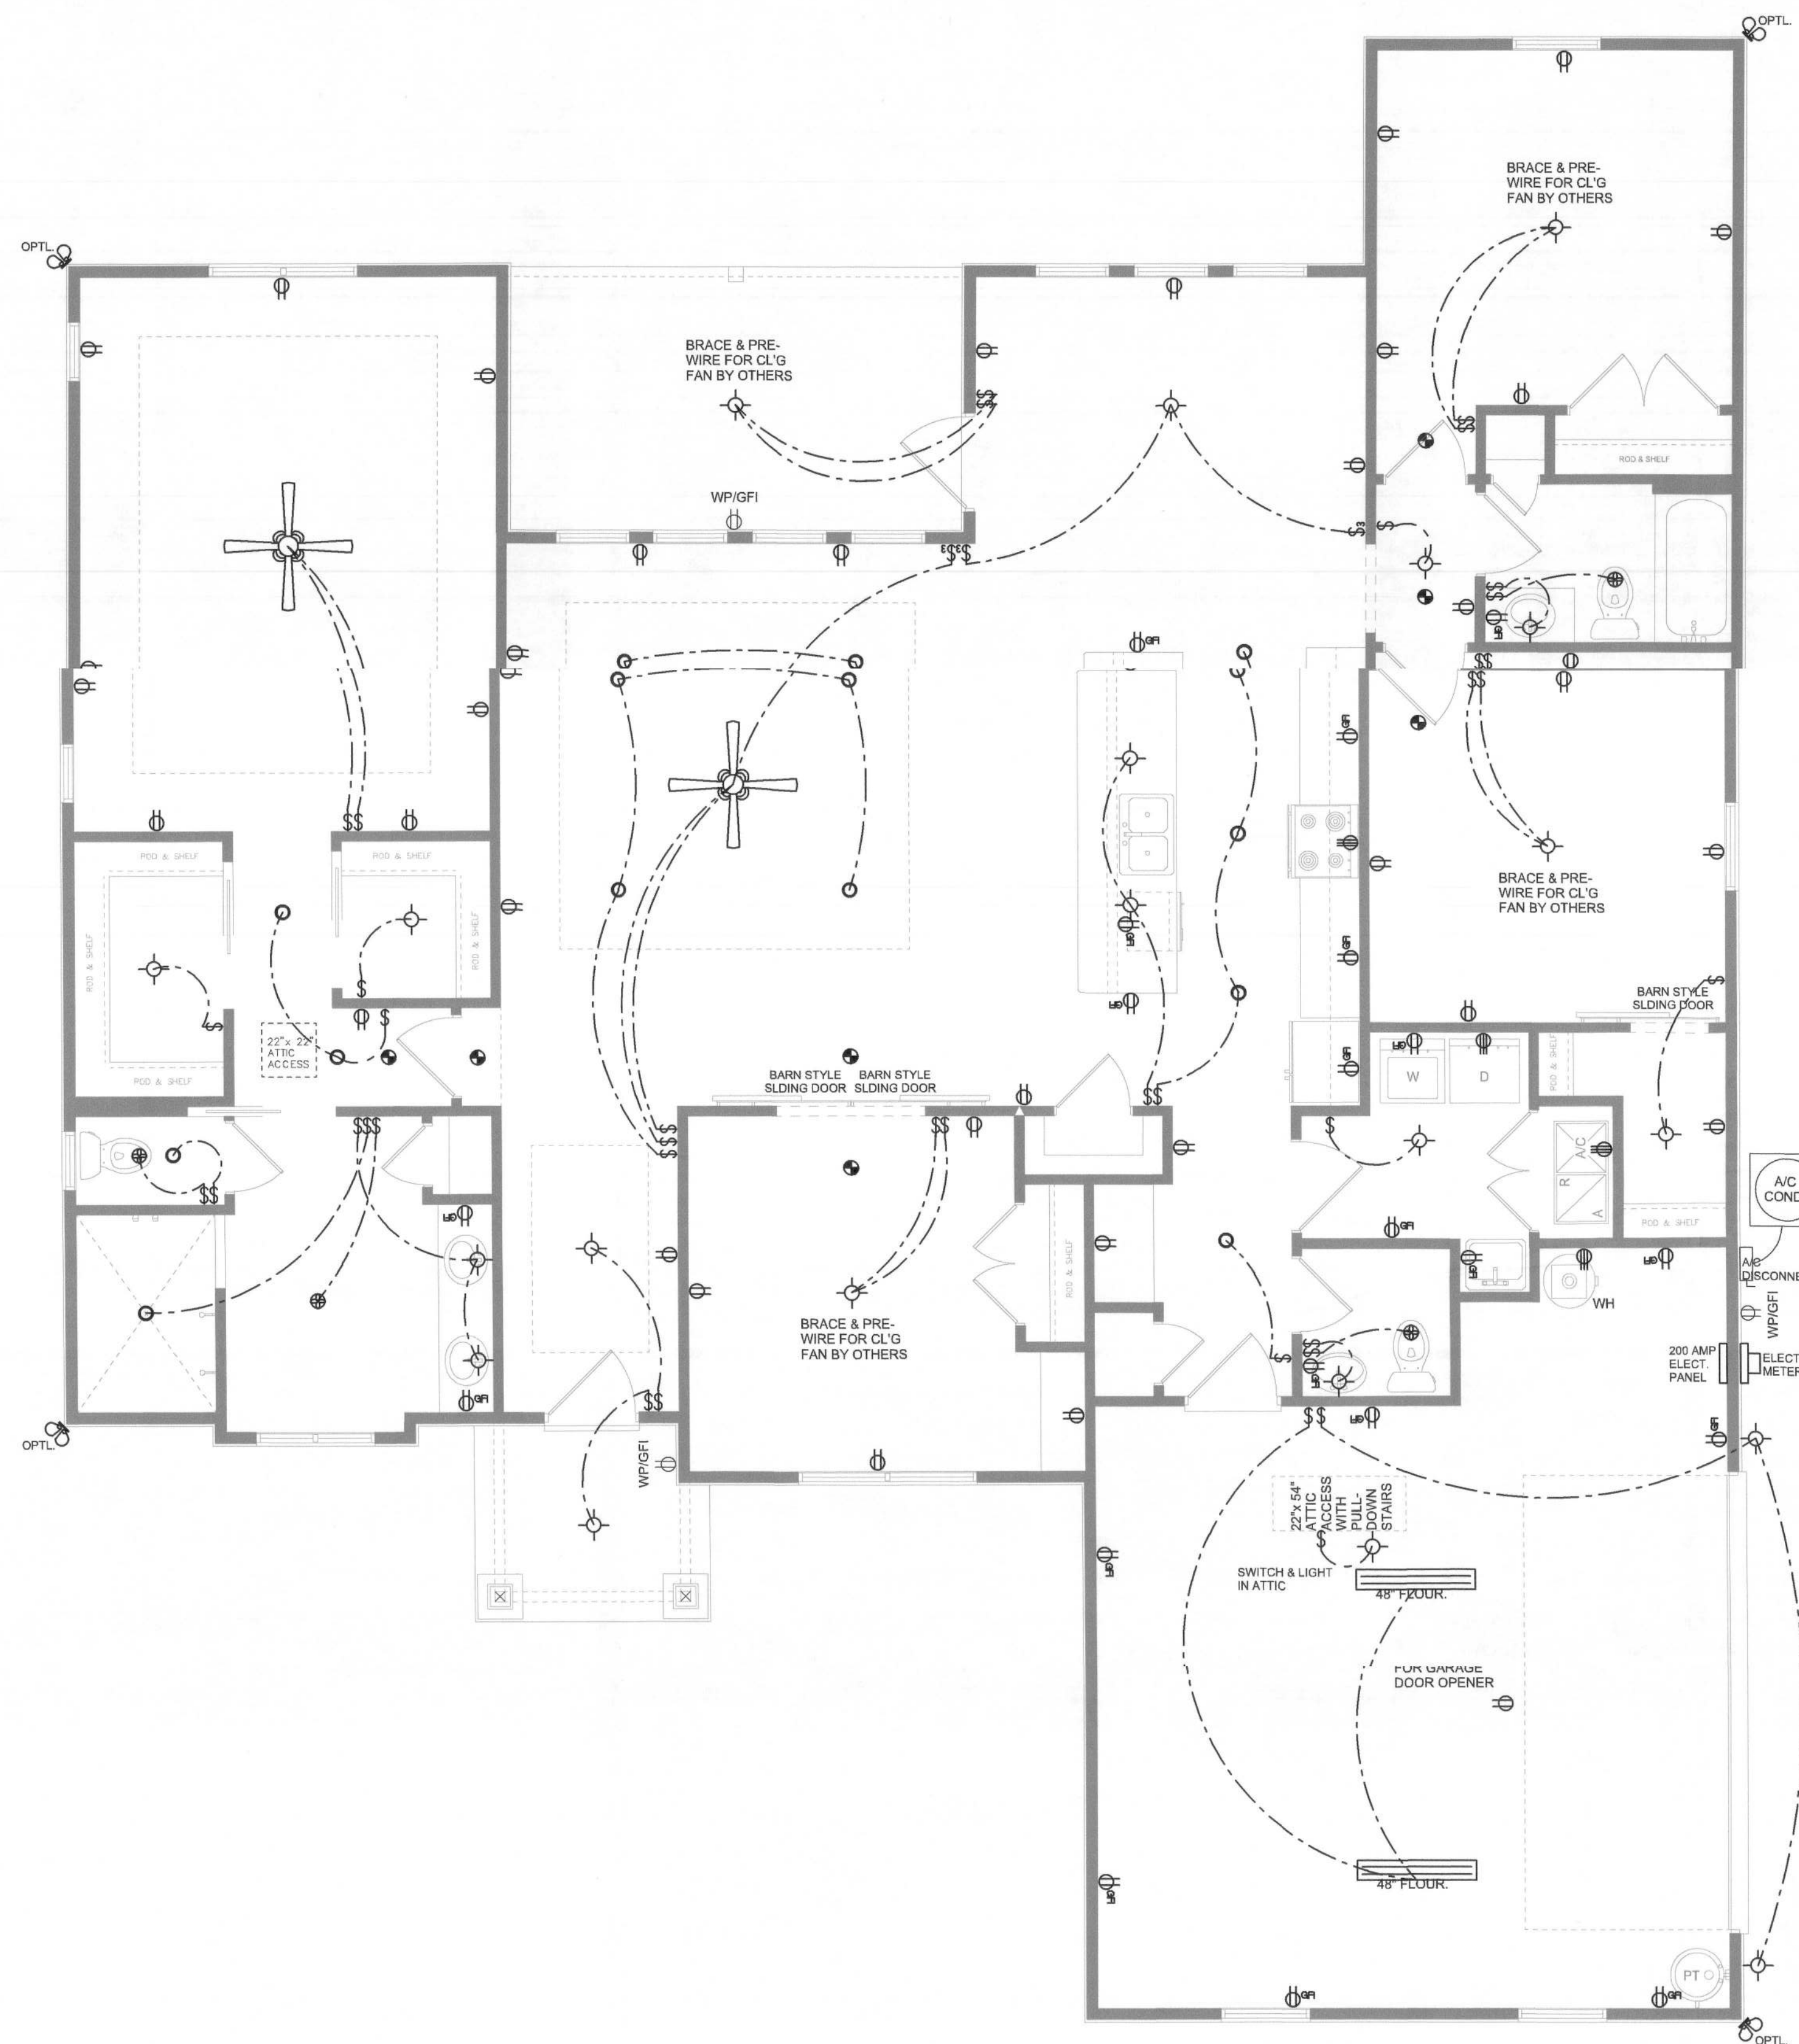

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS


REVISIONS
April 28, 2022

SOFTPLAN
ARCHITECTURAL RENDERING SOFTWARE

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

MODELER FOR: Lori 50, Emerald Cove
Glin and Tava Weatherly
Property Address: 285 SW Fieldstone Court, Lake City, Florida 32025
GIRALTAR CONTRACTING, LLC.
LIC# 98633 HIGH SPRINGS, FLORIDA


© WM DESIGN & ASSOCIATES, INC.
426 SW COMMERCE DR, STE 130
LAKE CITY, FL 32025
(386) 758-8406
wm@wmymyers.net

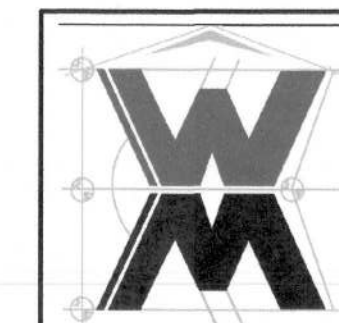


JOB NUMBER
20220216

SHEET NUMBER
A.4
OF 4 SHEETS


Wm C. Myers

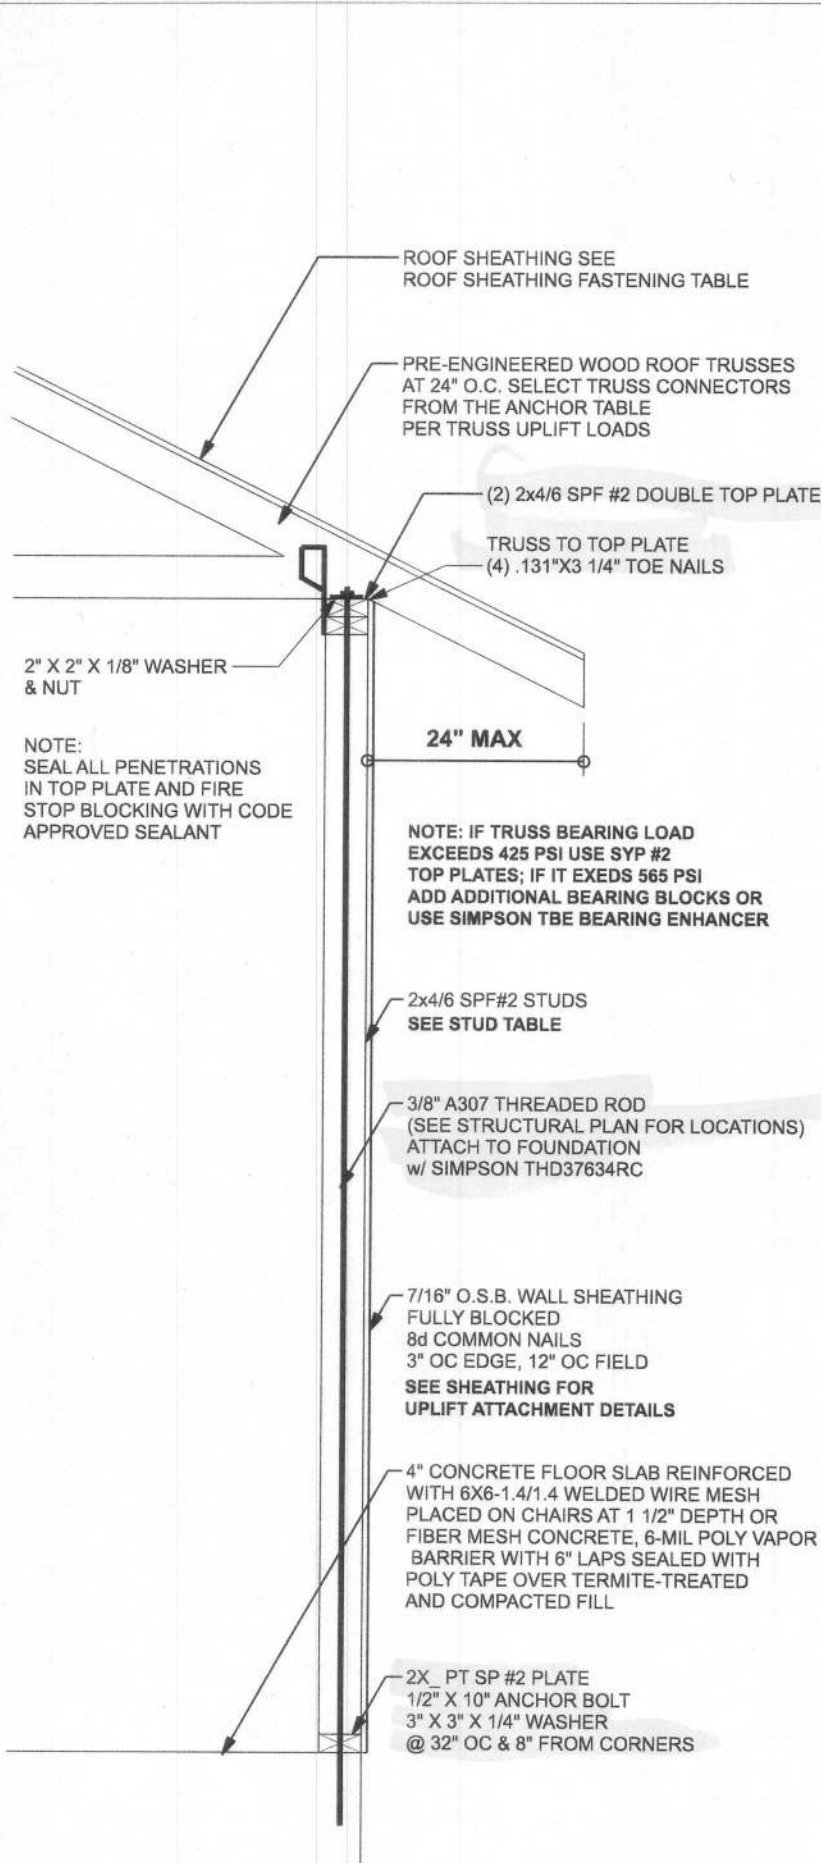

ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

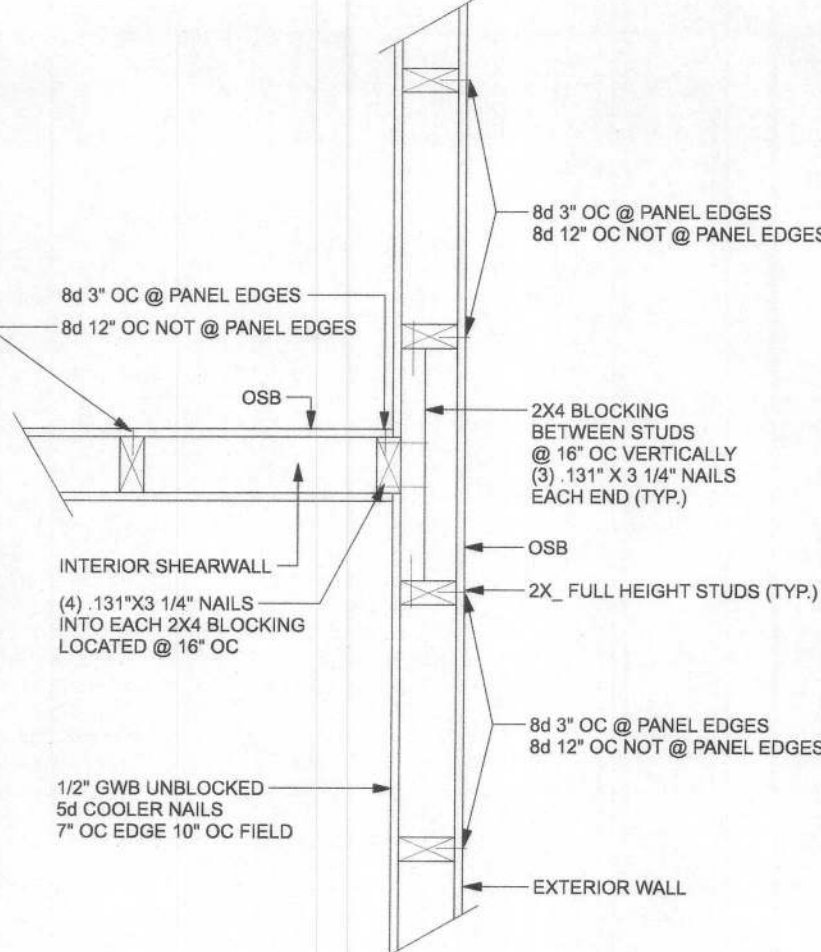

(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

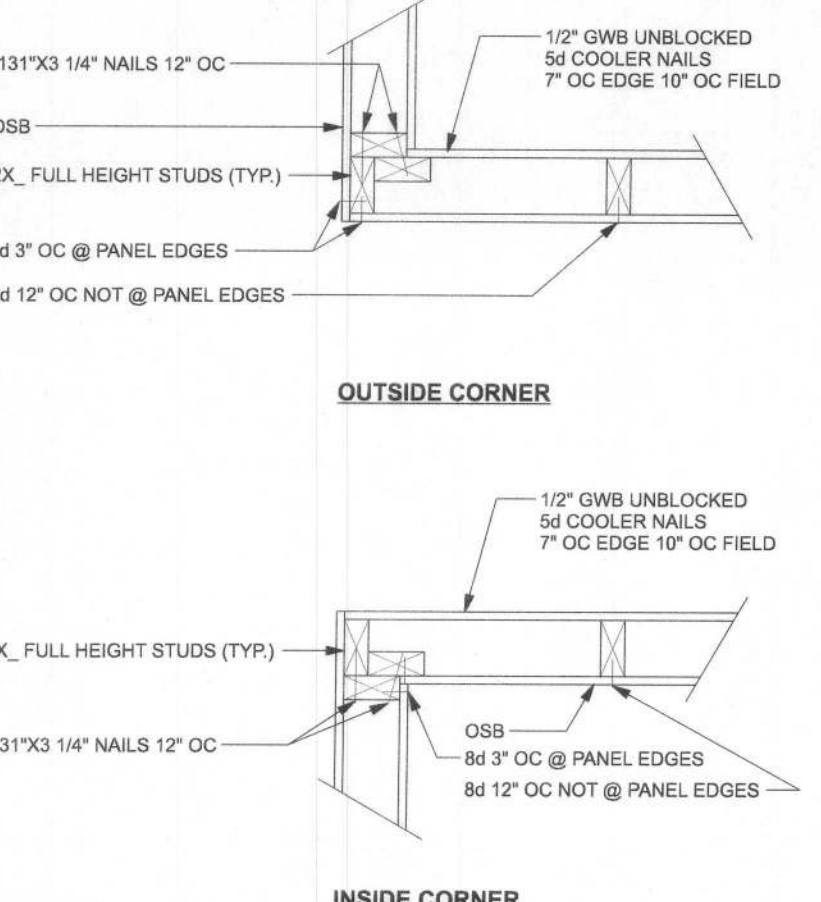


(TYP.) CORNER FRAMING
WOOD FRAME


ROOF SHEATHING FASTENING TABLE (RAFTER / TSS SG = 0.49)

Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RSR-S-01 (2 3/8" x 0.113")	6" oc	6" oc
120 mph Exp. C	7/16"	ASTM F1667 RSR-S-01 (2 3/8" x 0.113")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RSR-S-03 (2 1/2" x 0.131") or ASTM F1667 RSR-S-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RSR-S-01 (2 3/8" x 0.113")	6" oc	6" oc
130 mph Exp. C	15/32"	ASTM F1667 RSR-S-01 (2 3/8" x 0.113")	6" oc	6" oc
130 mph Exp. D	19/32"	ASTM F1667 RSR-S-03 (2 1/2" x 0.131") or ASTM F1667 RSR-S-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RSR-S-01 (2 3/8" x 0.113")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RSR-S-03 (2 1/2" x 0.131") or ASTM F1667 RSR-S-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RSR-S-03 (2 1/2" x 0.131") or ASTM F1667 RSR-S-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RSR-S-03 (2 1/2" x 0.131") or ASTM F1667 RSR-S-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RSR-S-03 (2 1/2" x 0.131") or ASTM F1667 RSR-S-04 (3" x 0.120")	6" oc	6" oc


Note: For sheathing located a minimum of 4 feet from the perimeter edge of a roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 8 inches on center along intermediate supports in the panel field. Notes table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

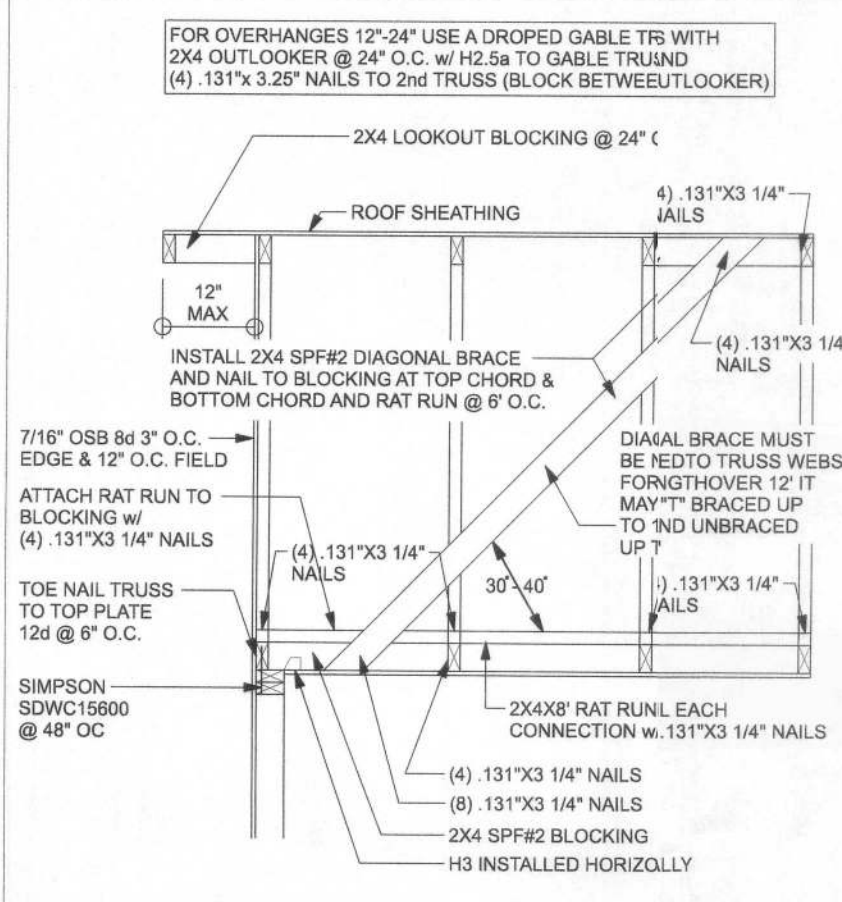


SPACE RAT RUN & DIAGONAL BRACE 6'-0" O.C. FOR GABLE HEIGHT UP TO 25'-0" 130 MPH, EXP. C, ENOSED

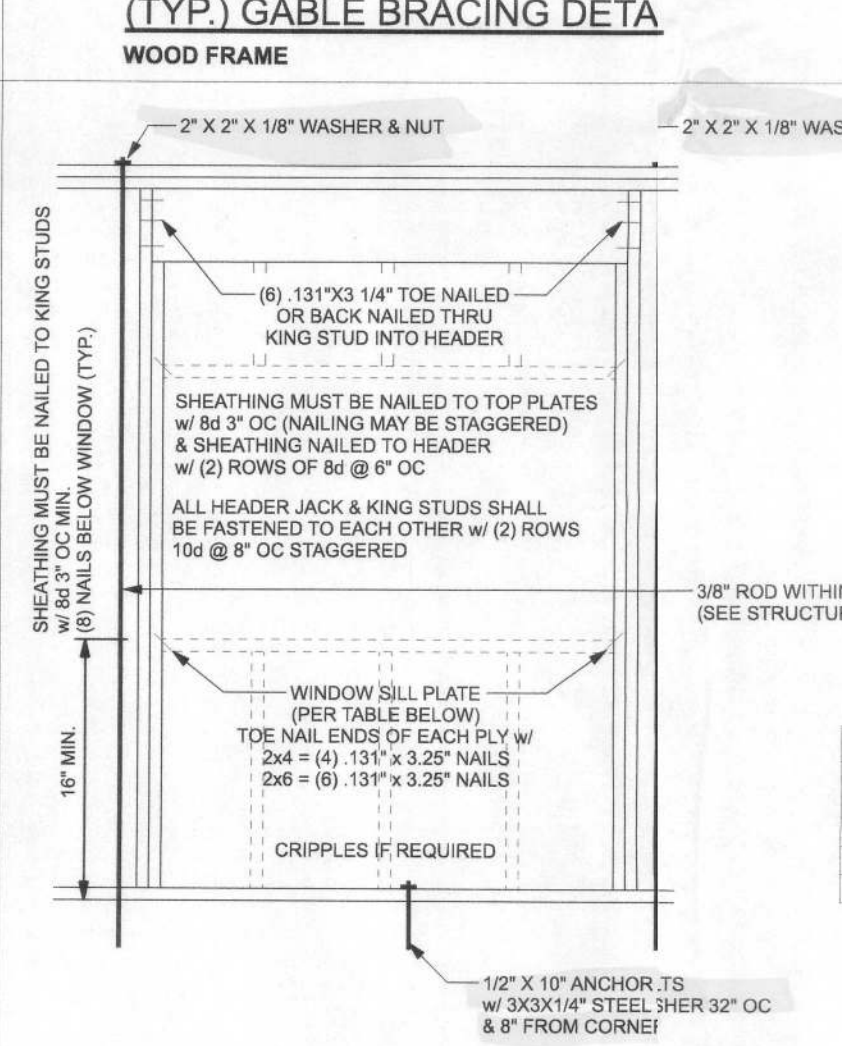


(TYP.) GABLE BRACING DETAIL
WOOD FRAME

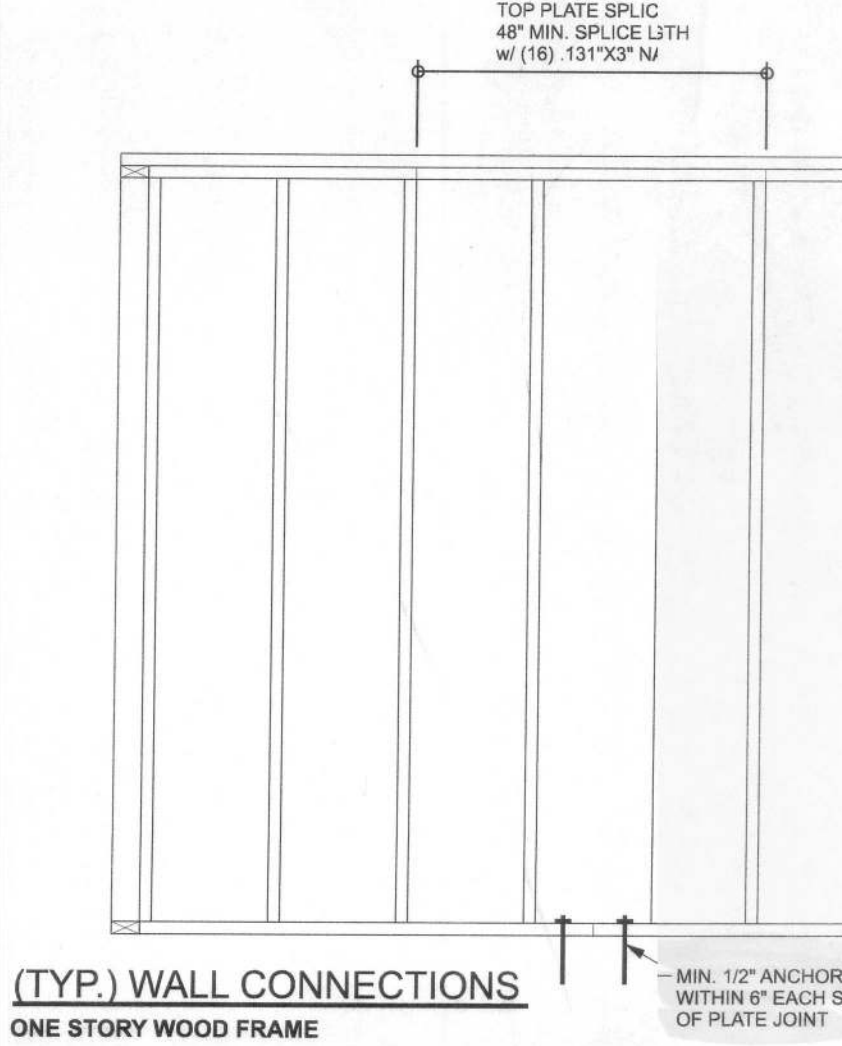

(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

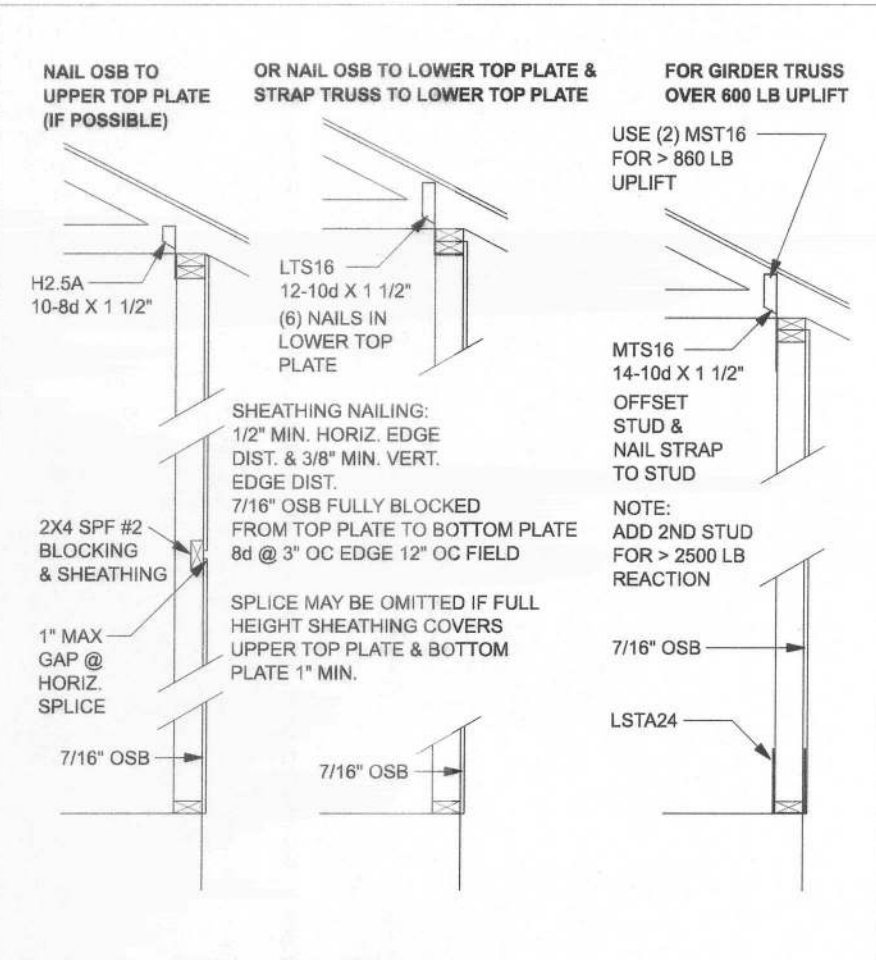

SHEATHING FOR UPLIFT ATTACHMENT DETAILS
ONE STORY WOOD FRAME

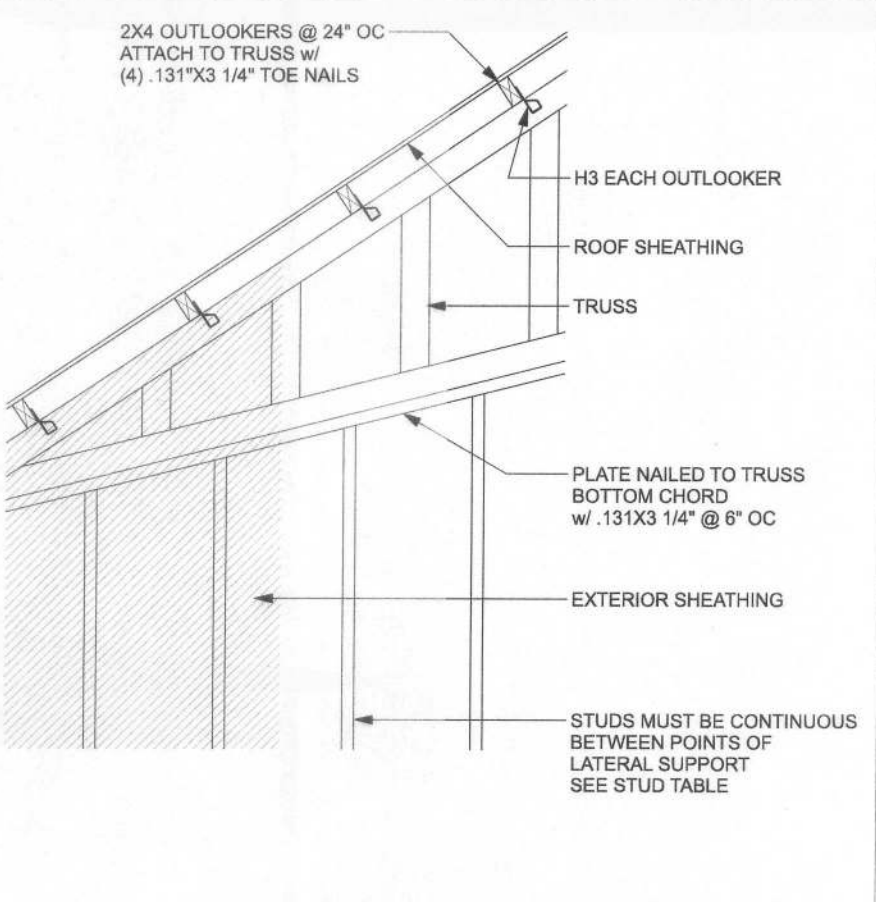

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME


SILL PLATE SPANS FOR 10'-0" WALL HEIGHT

DESIGN WIND SPEED	MAX. SPANS FOR SYP #2	MAX. SPANS FOR SYP #2	MAX. SPANS FOR SYP #2
	(1) 2x4	(2) 2x4	(2) 2x6
130 MPH EXP. C	5'-2"	7'-9"	7'-7"
			11'-3"


BASED ON WFCM TABLE A-3.238

FOR OTHER WALL HEIGHTS (9) SILL SPAN SHALL BE DIVIDED BY (9/10)


(TYP.) BEAM TO WALL
WOOD FRAME w/ RODS

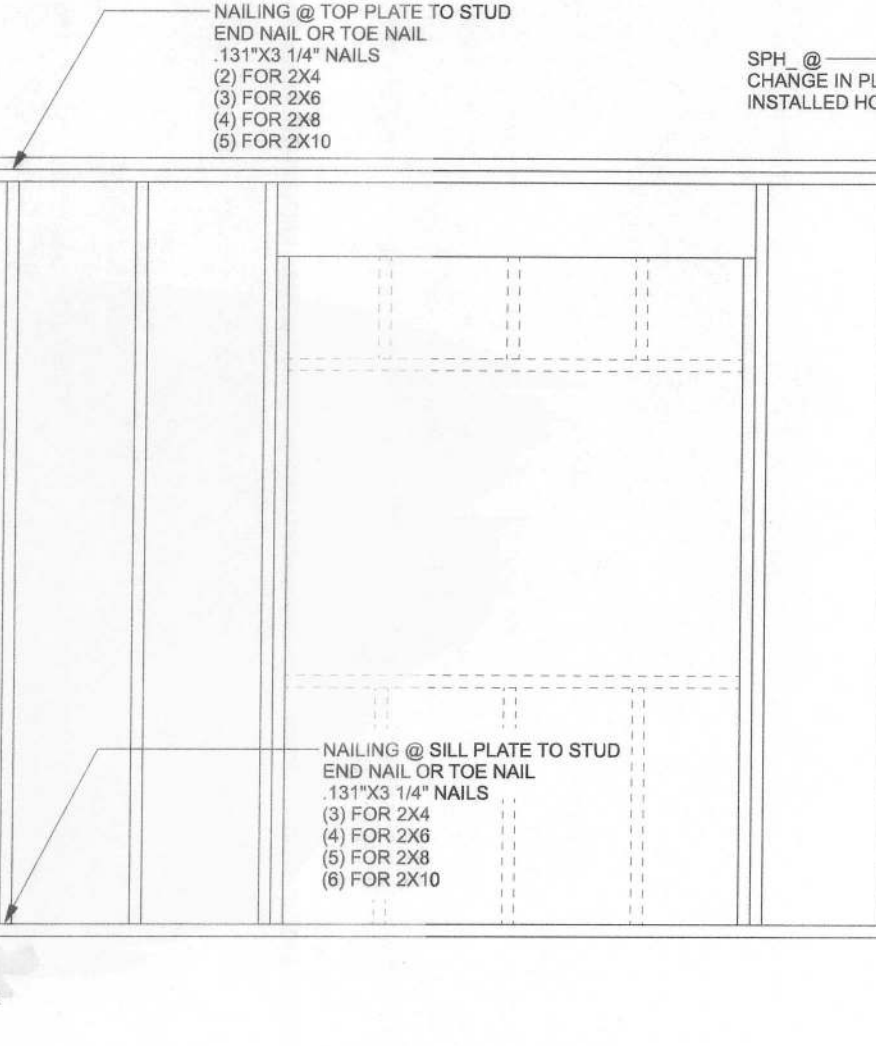


(TYP.) BEAM TO WALL
WOOD FRAME w/ RODS

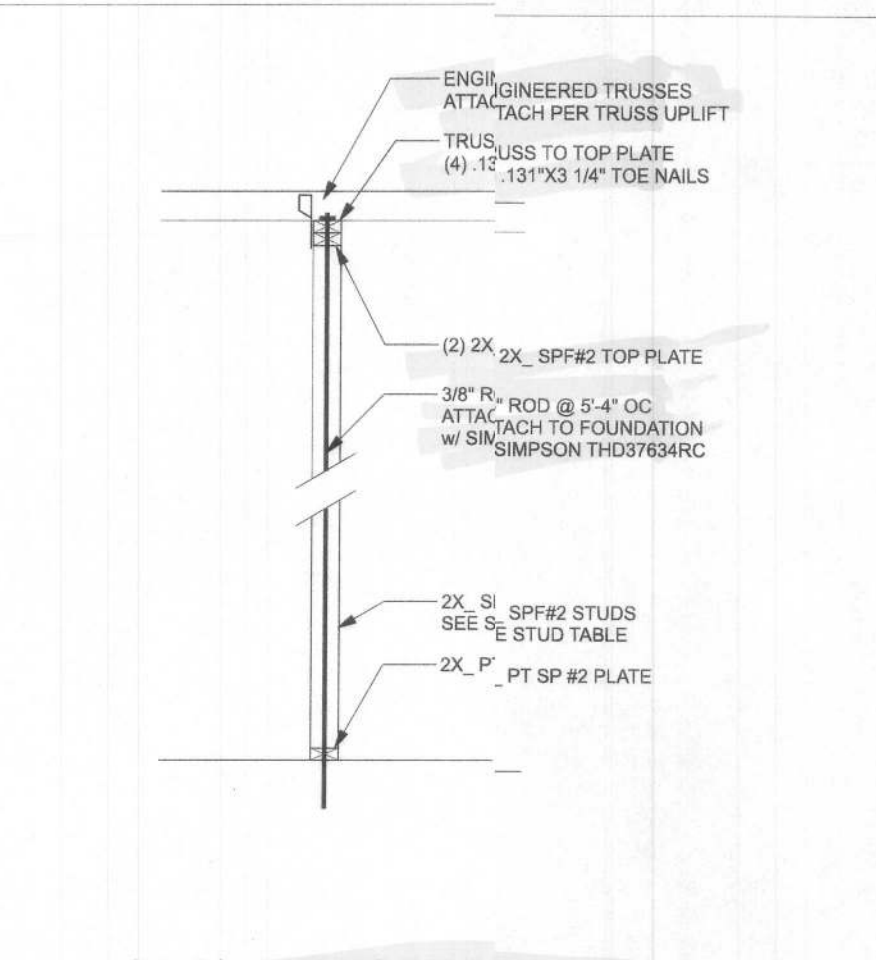


(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ RODS

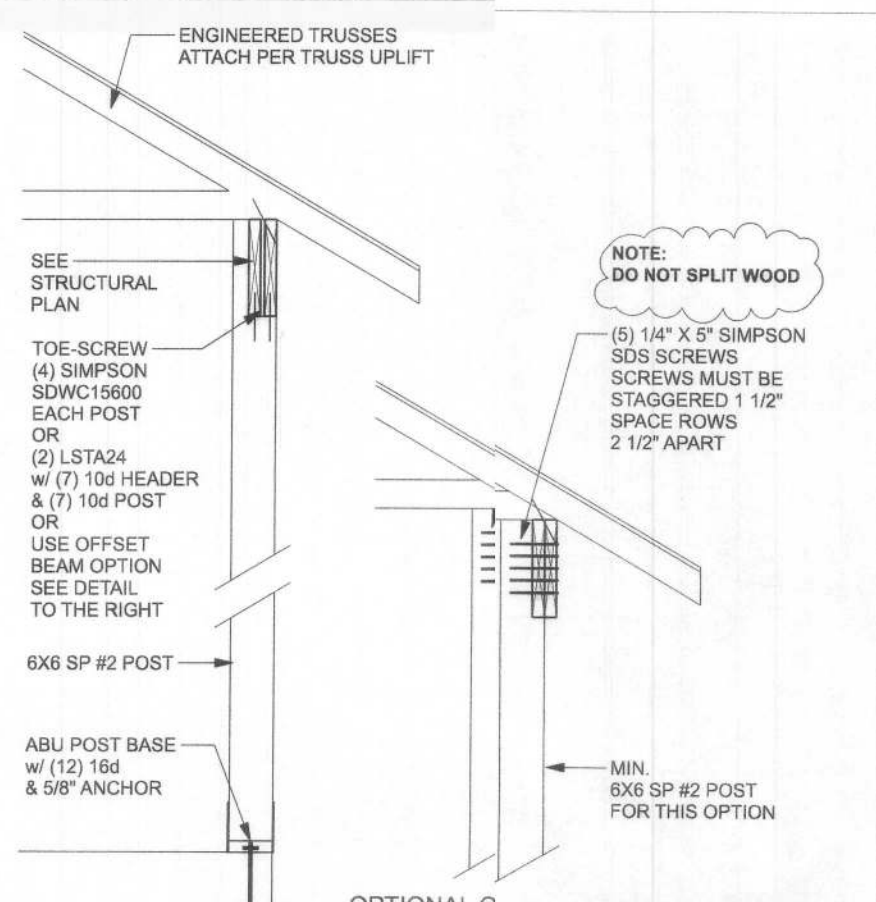

(TYP.) PORCH POST
ONE STORY WOOD

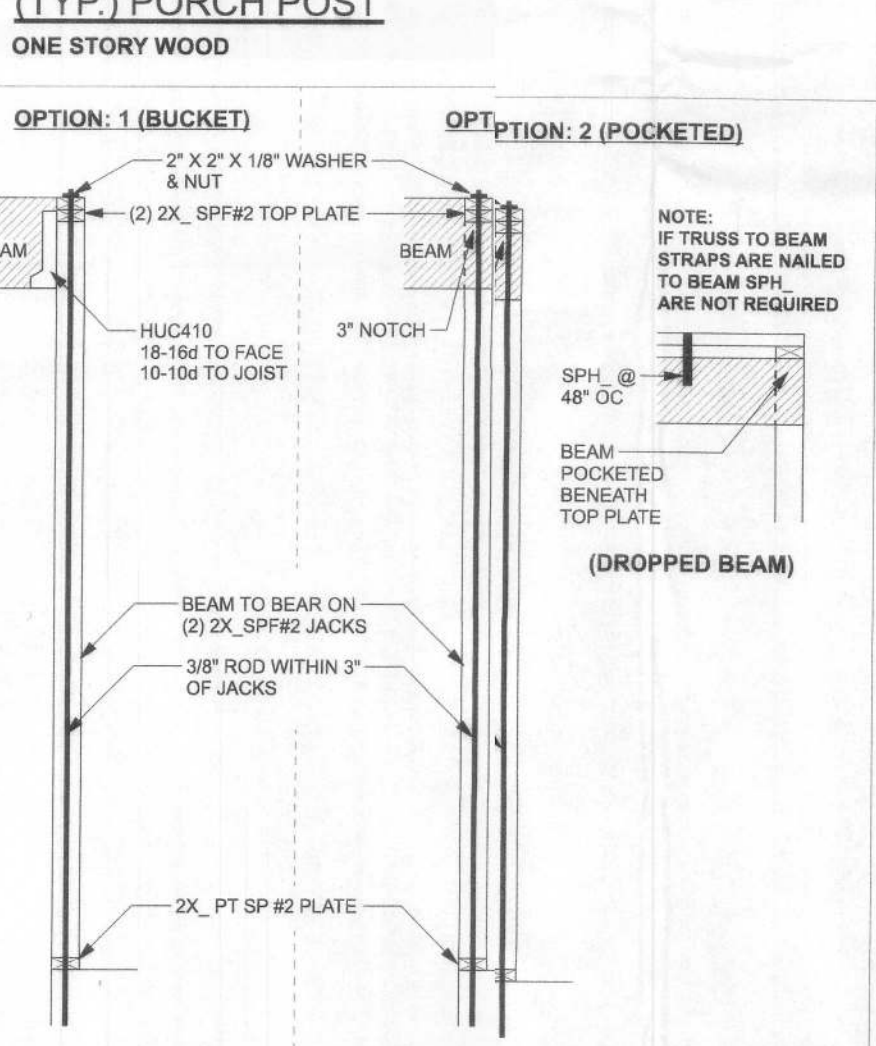

(TYP.) BEAM TO WALL
WOOD FRAME w/ RODS

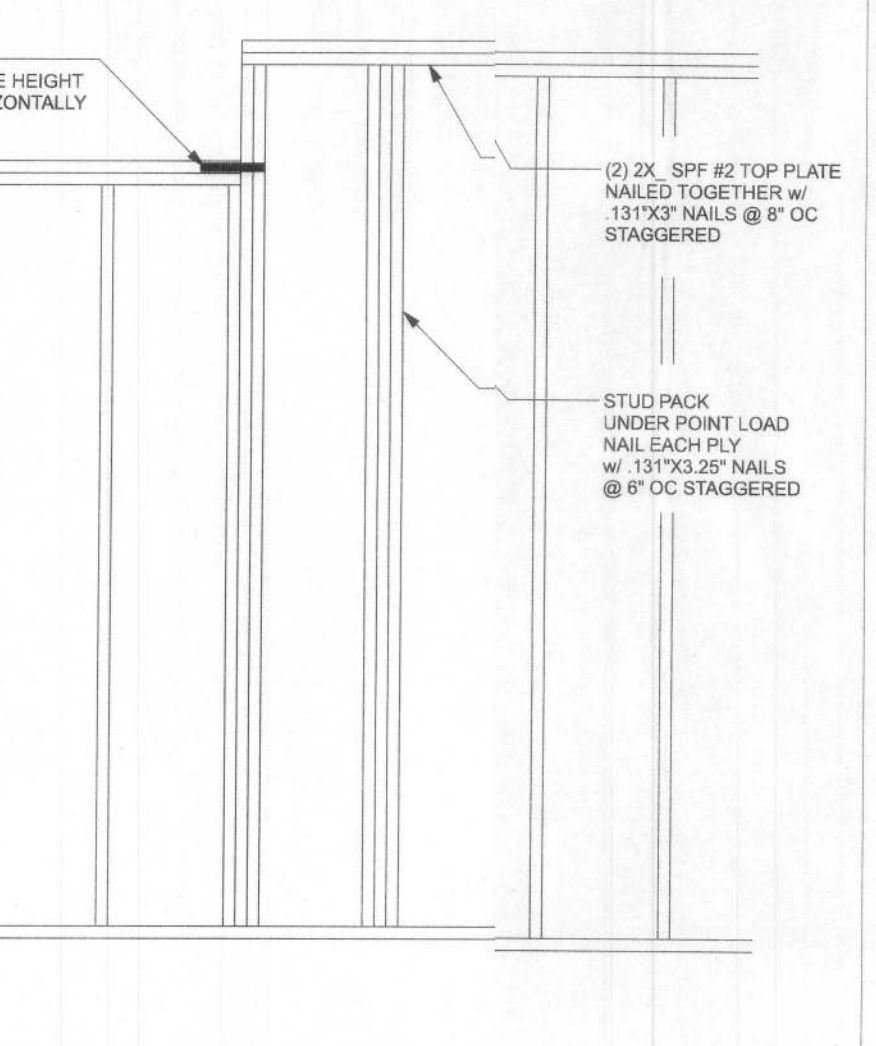

(TYP.) BEAM TO WALL
WOOD FRAME w/ RODS

CONNECTOR TABLE

Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
415	485	SDWC15600	-	-
415	290	H2.5A	4-8dX1 1/2"	4-8dX1 1/2"
575	495	H2.5A	5-8dX1 1/2"	5-8dX1 1/2"
1340	1015	H10A	9-10dX1 1/2"	9-10dX1 1/2"
720	620	LTS12-20	6-10dX1 1/2"	6-10dX1 1/2"
1000	860	MTS12-30	7-10dX1 1/2"	7-10dX1 1/2"
1450	1245	HTS20-30	12-10dX1 1/2"	12-10dX1 1/2"
1235	1235	LSTA24	9-10d	9-10d
1640	1455	MSTA24	9-10d	9-10d
1030	1030	CS20	7-10d	7-10d
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate
585	535	SP1	6-10d	4-10d
1085	695	SP2	6-10d	4-10d
771	771	LSTA24	10-10d	wrap under or over plate
1235	1235	LSTA24	14-10d	wrap under or over plate
Uplift SP	Uplift SPF	Holdowns @ Stenwall	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	1840	HTT4	18-16dX2 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x8" Titen HD
4235	1840	HTT4	18-16dX2 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Post Bases @ Stenwall	To Stud	Anchor
2200	ABU44	12-16d	5/8"x12" Drill & Epoxy	
2300	ABU68	12-16d	5/8"x12" Drill & Epoxy	
Uplift SP	Uplift SPF	Post Bases @ Mono	To Stud	Anchor
2200	ABU44	12-16d	5/8"x7" Drill & Epoxy	
2300	ABU68	12-16d	5/8"x7" Drill & Epoxy	

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:

EXTERIOR LOAD BEARING & NON LOAD BEARING STUD LENGTHS FOR WALLS WITH OSB EXTERIOR AND 1/2" GYP INTERIOR

RESISTING INTERIOR ZONE WINDLOADS, 130 MPH, EXPOSURE C, STUD DEFLECTION LIMIT H/240 (NOT OK FOR BRITTLE FINISH).

STUD SPRINGS SHALL BE MULTIPLIED BY 0.8 FOR FRAMING LOCATED WITHIN 4 FEET OF CORNERS FOR END ZONE LOADING.

(END ZONE EXAMPLE 16" O.C. x 0.8 = 12.8" O.C.)


(1) 2x4 @ 16" OC	TO 10'-1" STUD HEIGHT
(1) 2x4 @ 12" OC	TO 11'-2" STUD HEIGHT
(1) 2x6 @ 16" OC	TO 15'-7" STUD HEIGHT
(1) 2x6 @ 12" OC	TO 17'-3" STUD HEIGHT

GRADE & SPECIES TABLE

	SP #2	Fb	E
2x8		925	1.4
2x10		800	1.4
2x12		750	1.4
GLB	24F-V3 SP	2600	1.9
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PSL	PARALAM	2900	2.0

ROOF SYSTEM DESIGN:

THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBRCR IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBRCR REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER. A SO DESIGN RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

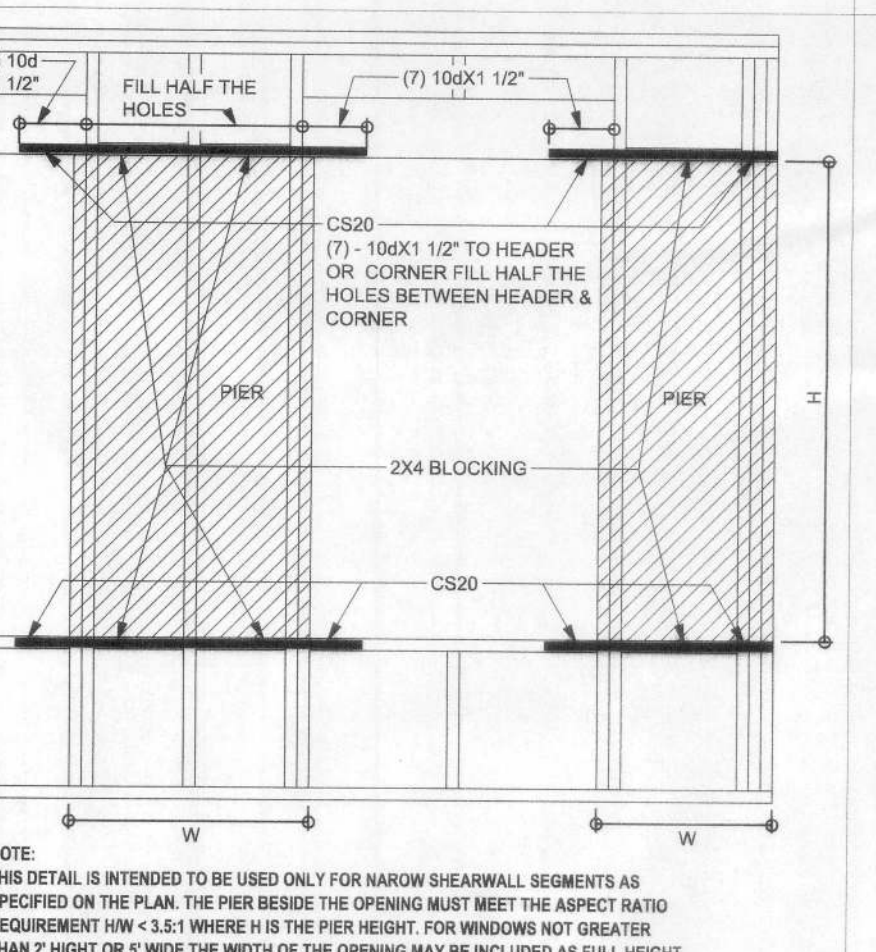

(TYP.) GARAGE DOOR BUCK ATTACHMENT
WOOD FRAME

2X6 SP #2 GARAGE DOOR BUCK ATTACHMENT

ATTACH GARAGE DOOR BUCK TO STUD PACK AT EACH SIDE OF DOOR OPENING WITH 3/8" X 4" LAG SCREWS w/ 1" WASHER LAG SCREWS MAY BE COUNTERSUNK. HORIZONTAL JAMBS DO NOT TRANSFER LOAD. CENTER LAG SCREWS OR STAGGER 16d NAILS OR (2) ROWS OF 131" X 3 1/4" ON PER TABLE BELOW.

DOOR WIDTH	3/8" X 4" LAG	16d STAGGER	(2) ROWS OF 131" X 3 1/4" NAILS
8'-10"	24" OC	5" OC	5" OC
11'-15"	18" OC	4" OC	4" OC
16'-18"	18" OC	3" OC	3" OC

2X6 SP #2 DOOR BUCK

BRACKET

(TYP.) GARAGE DOOR BUCK INSTALLATION
WOOD FRAME

GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBRCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER'S FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 41LB EACH END, 2X8 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN.

FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVIDES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F_c = 2500 PSI.

WELDED WIRE REINFORCED SLAB: 6" x 6" W1.4 x W1.4, F_y = 80KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.M.) CONFORMING TO ASTM A188 LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT, FIBER LENGTH 1/2" INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. TRUSSES TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB TYPICAL SPACING OF CUTS TO BE 1FT. DO NOT CUT WMM OR REINFORCING STEEL (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE).

REBAR: ASTM A615, GRADE 40, DEFORMED BARS, F_y = 40 KSI. ALL LAP SPLICES 40" DB (25" FOR #6 BARS). UNCL. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 318-08, U.N.C.

ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL. DIAPHRAGMS, SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURERS' INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NOT LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 12" IN GROVED CMU.

BUILDER'S RESPONSIBILITY:

THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.

CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.


PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBRCR REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.

PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMTS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.

VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

DESIGN CRITERIA & LOADS:

BUILDING CODE	7TH EDITION FLORIDA BUILDING CODE RESIDENTIAL (2020)
CODE FOR DESIGN LOADS	ASCE 7-16
BASIC WIND SPEED (BUILDER MUST FIELD VERIFY)	120 MPH
WIND EXPOSURE (BUILDER MUST FIELD VERIFY)	C
TOPOGRAPHIC FACTOR (BUILDER MUST FIELD VERIFY)	I



TALL STEM WALL TABLE:

The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16"OC, vertically or a horizontal bond beam with 2" continuous mid height. For tier parts of the wall 12" CMU may be used with reinforcement as shown in the table below.

STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48


<p>MASONRY NOTE:</p> <p>ALL MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 308-1) (ACI 308-102) AND THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530-1-6 AND THESE DESIGN DRAWINGS.</p> <p>ANY EXCEPTIONS TO ACI 530-1-6E MUST BE APPROVED BY THE ENGINEER IN WRITING.</p>		
	ACI/ISO-1:2 Section	Specific Requirements
1.4A	Compressive strength	8" block bearing walls (F _m = 1500 psi)
1.4B	Mortar	ASTM C 270, Type N, UNO
2.1	Grout	ASTM C 478, structural grout, requires approval
2.2	CMU standard	ASTM C 90-2, Normal weight, Hollow, medium surface finish, 16"x8"x16" running bond and 12"x12"x16" column block
3.1	Gray brick standard	ASTM C 216-02, Grade SW, Type FBS, S-2 (2 1/2" x 7 1/2" x 3 1/2")
4.1	Reinforcing bars, C8 - #11	ASTM A615, Grade 60, 40 bar dia. (25" for #8)
4.2	Coating for corrosion protection	ASTM A615, Grade 60, 40 bar dia. (25" for #8) ASTM A615, Grade 60, 40 bar dia. (25" for #8) Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal fasteners not completely embedded in mortar or grout, ASTM A305, Class G60, 50 and 60, 304SS
4.3	Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal fasteners not completely embedded in mortar or grout, ASTM A305, Class B2, 150 and 202, 304SS
3.3.2	Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.7	Movement joints	Contractor assumes responsibility for type and location of movement joints not installed on crooked drawings.

**BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF
12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL**



FOUNDATION PLAN

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT: REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB STEP DOWNS, ETC. DISCREPANCY DESIGN GROUP OR FIELD DISCREPANCY PER THE DESIGN GROUP FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING IN ALL AREAS BY REVIEWING/TO THE ROOF TRUSS PLAN BY THE SUPPLIER. SEE FOUNDATION PLAN FOR DETAILS.
FN - 3	THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ #6X-1/4 L WELDED WIRE MESH PLACED ON CHAIRS @ 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLYESTER BARRIER, 1/2" POLYURETHANE SEALED W/ POLY TAP DEPTH OVER TERMITE-TREATED & COMPACTED FILL.

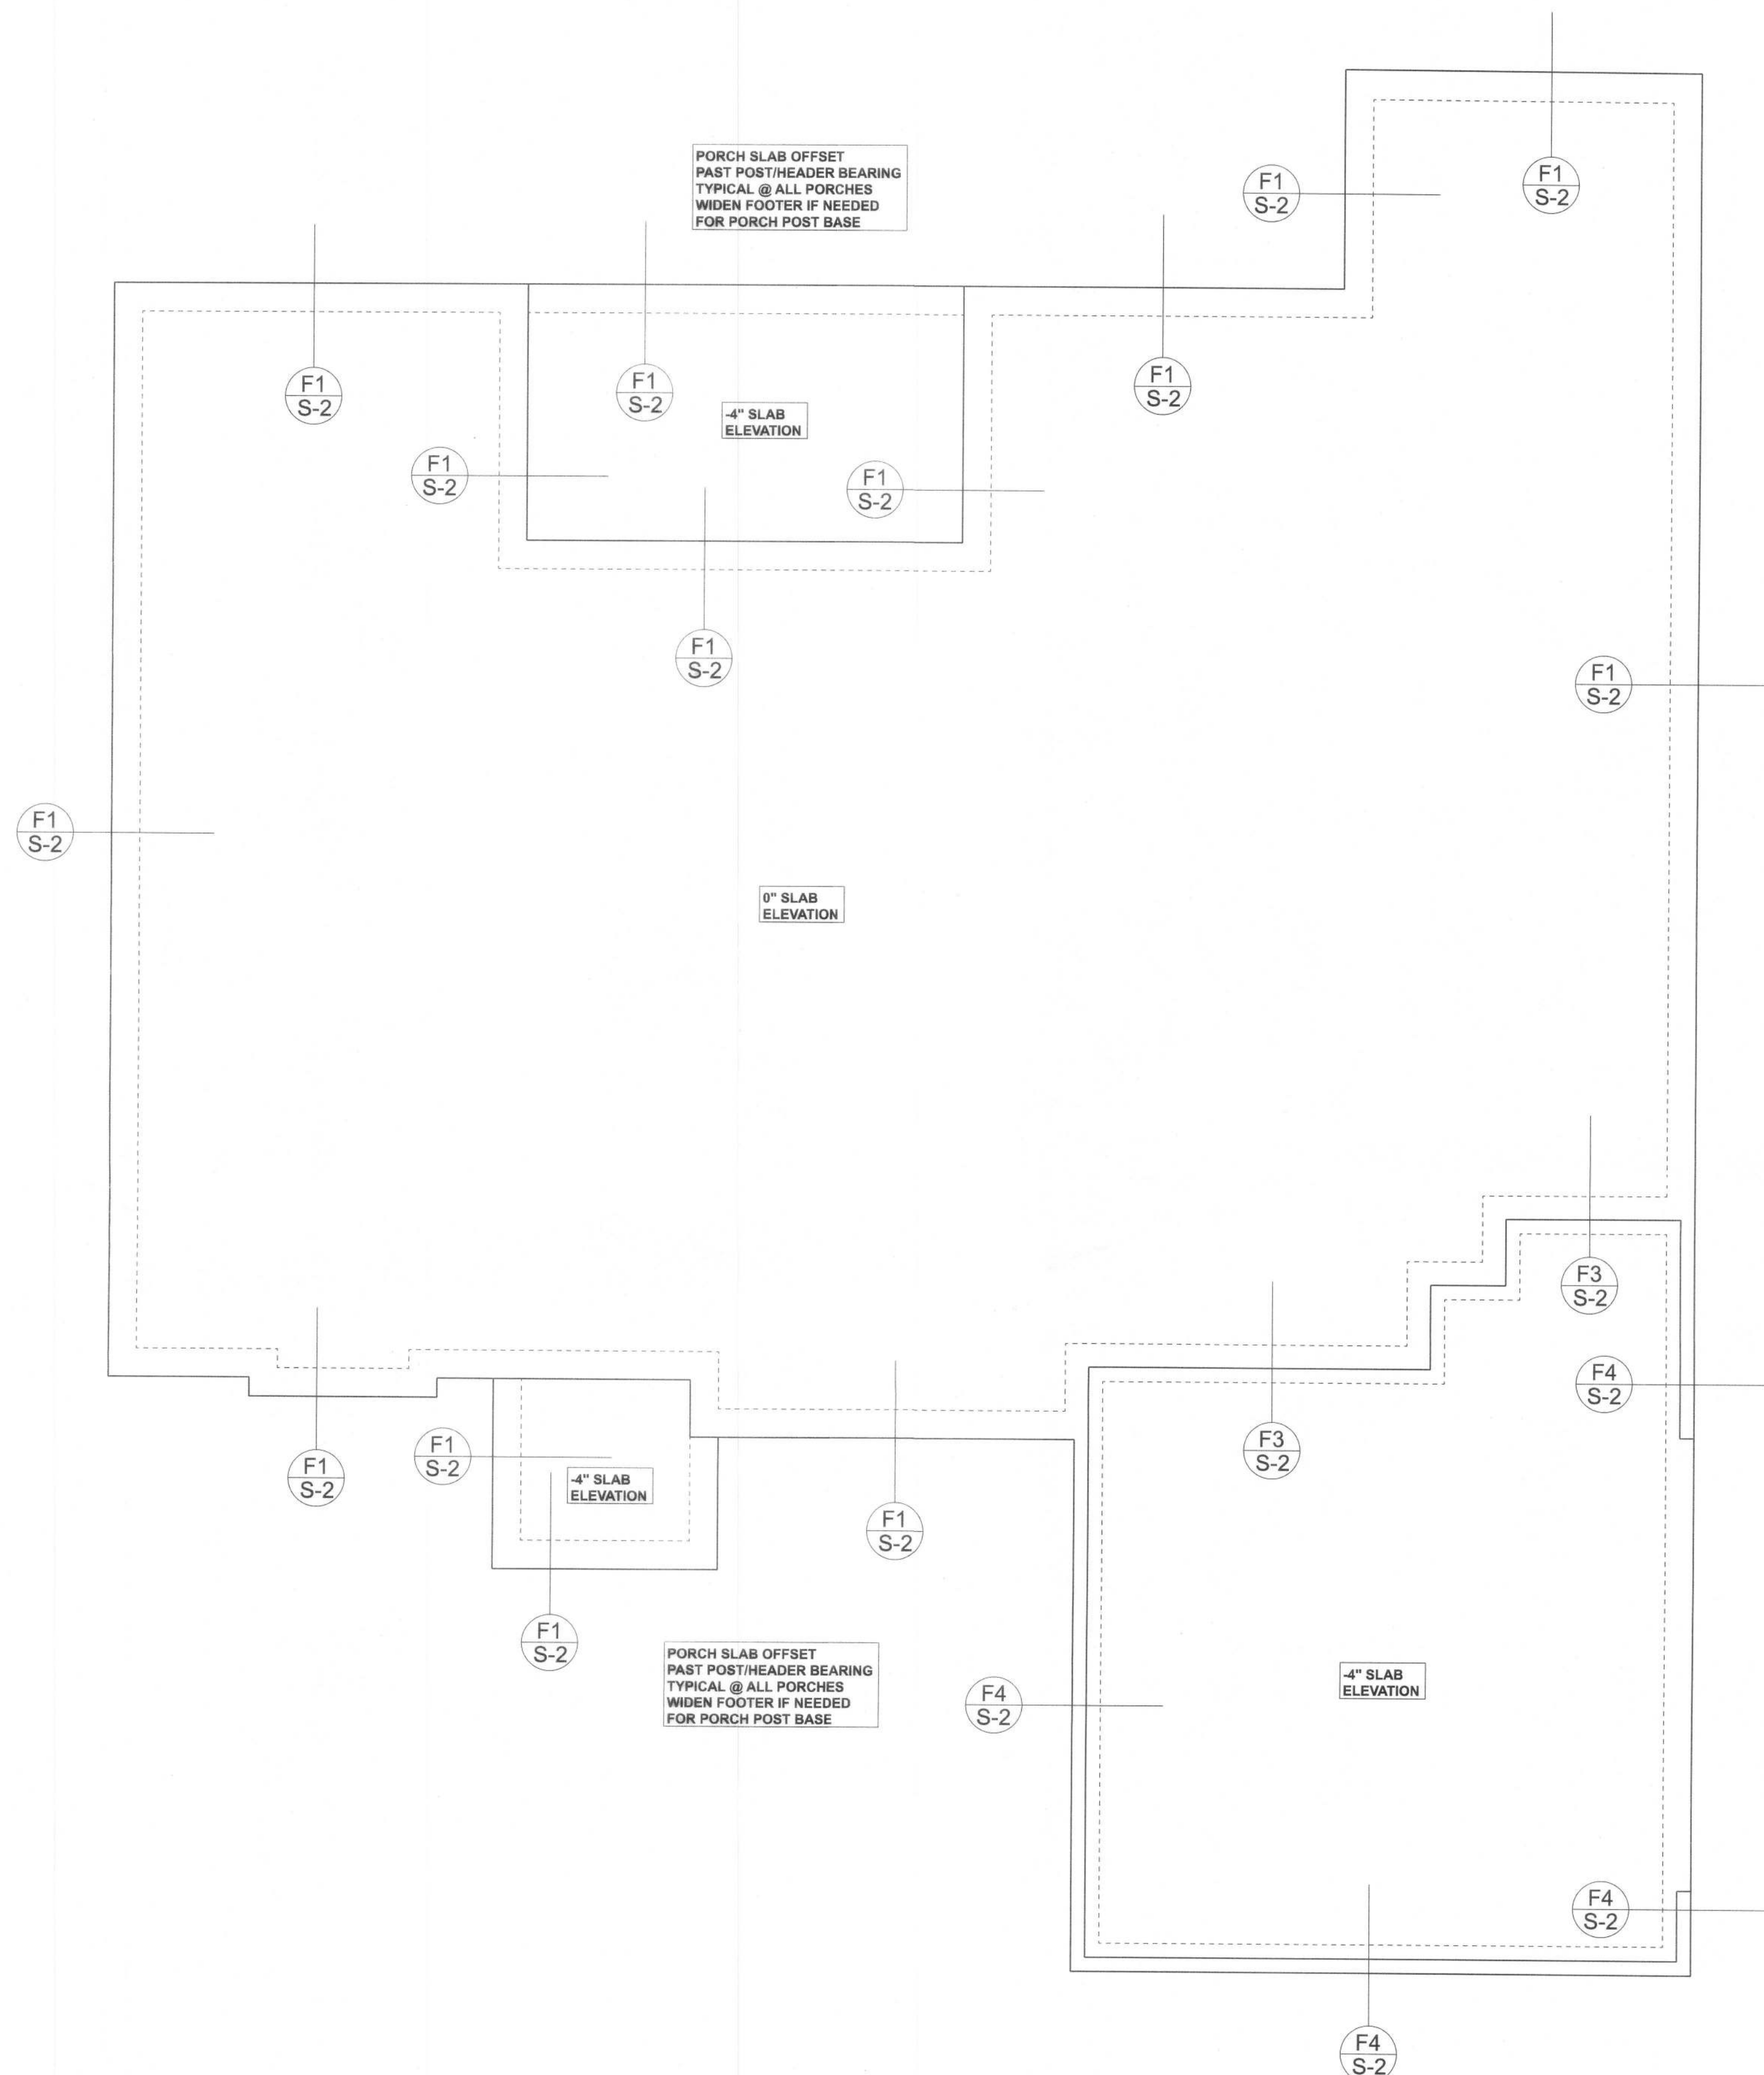

Gibraltar Contracting, LLC
1880 Model - Lot 50 Emerald Cove
PROJECT ADDRESS:
Lot 50 Emerald Cove
Columbia County, FL

DIMENSIONS:
 Stated dimensions supersede scaled dimensions. Refer all questions to Mark Dioway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
 Mark Dioway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Dioway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building at specified location.

MARK DISOSWAY P.E. 53915

MARK D. DISOSWAY
LICENSE
NO. 53915
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Tuesday, May 3, 2022

Mark Disosway P.E.
16 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
220531

S-2
OF 3 SHEETS

CS20 TENSION STRAPSM w/ 8 - 5d
OR Z44 COLLAR TIE 3 - 16d OR 4 - 131 4"

1

2

3

Z44 VALLEY RAFTER

4

Z44 RIDGE BOARD

5

6

SEE CRIPPLE, BRACING
& BLOCKING NOTES

4'-0" MAX SPACING

4'-0" (TYP)

GRIPPLERS

OPTION 1P



OPTION 2P

EXISTING ROOF
FRAMING 2x 8TP @ 24" O.C.

Z44 BLOCKING

Z44 PURLINS
(WHERE)

SECTION CUT PARALLEL

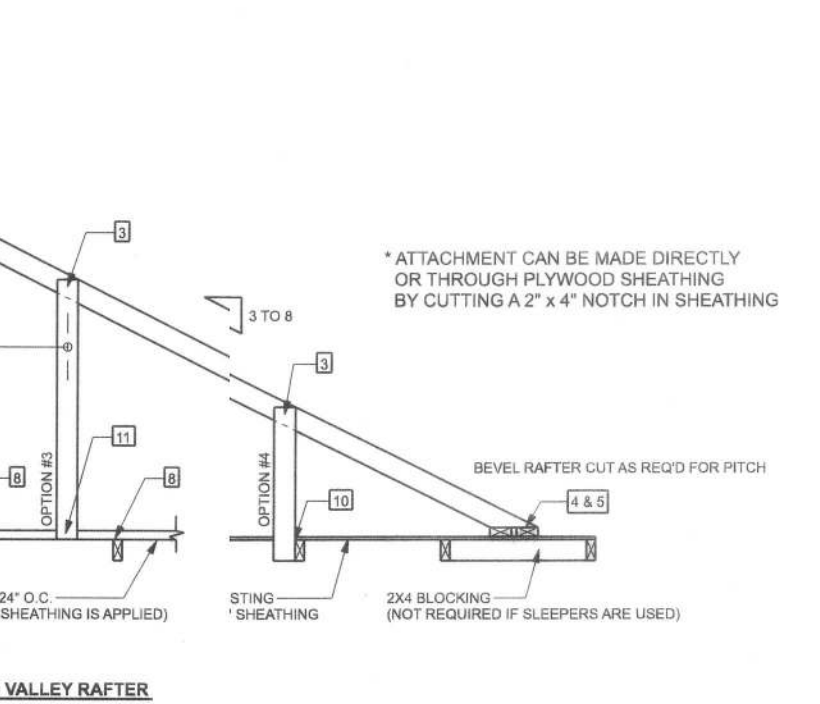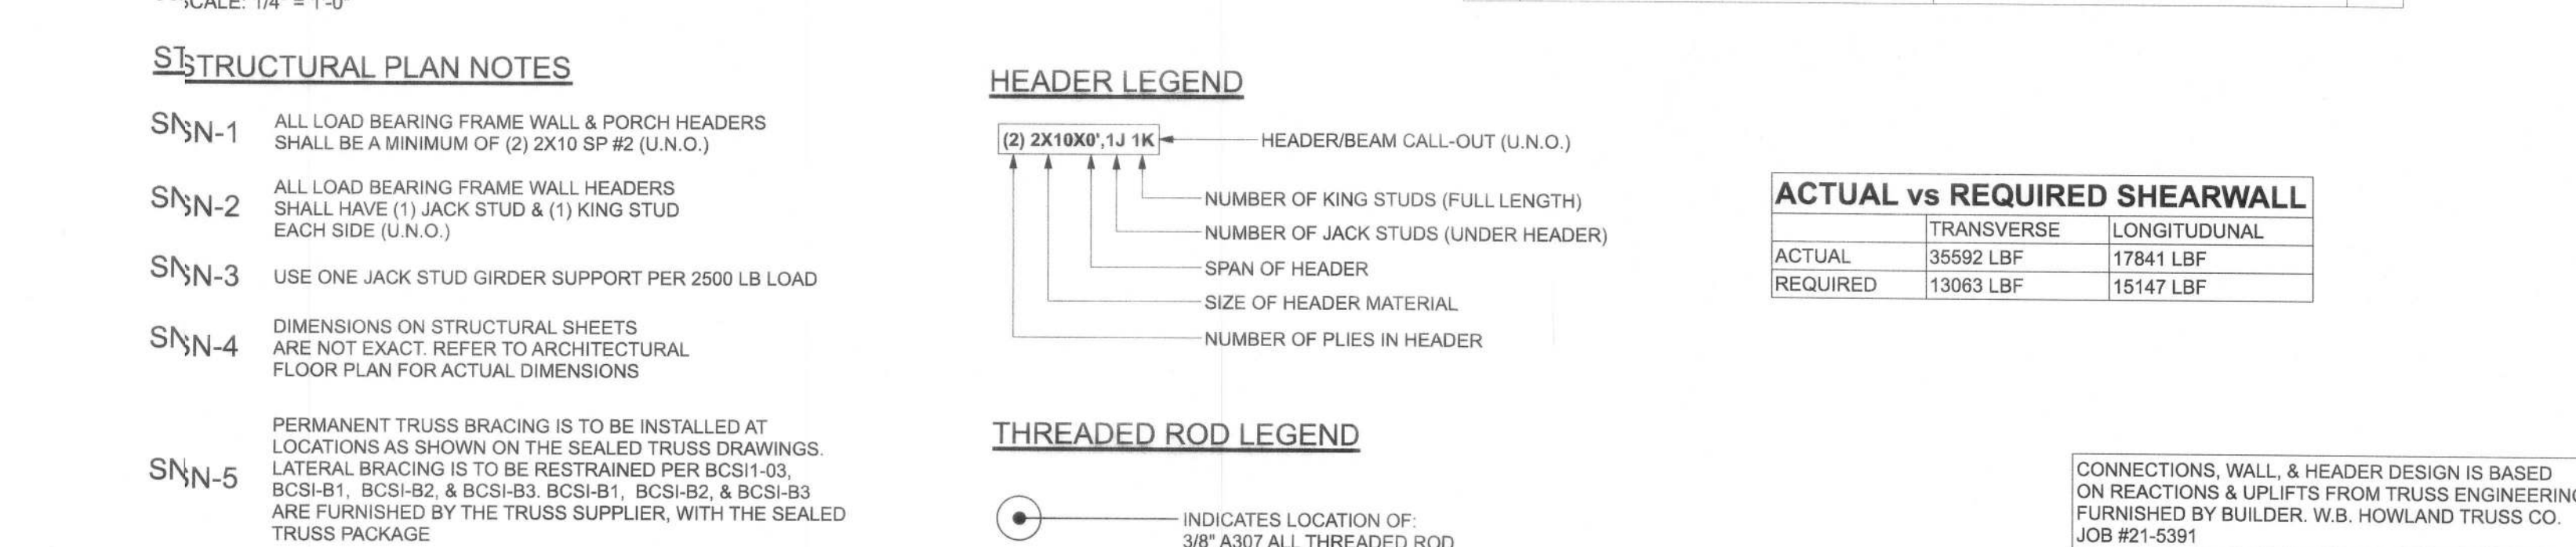[illegible]

STRUCTURAL PLAN

S _N -1	ALL LOAD BEARING SHALL BE A MINIMUM
S _N -2	ALL LOAD BEARING SHALL HAVE (1) JACK EACH SIDE (U.N.O.)
S _N -3	USE ONE JACK STUD
S _N -4	DIMENSIONS ON STAIRS ARE NOT EXACT. REF. FLOOR PLAN FOR ALL

S _N -1	ALL LOAD BEARING FRAME WALLS SHALL BE A MINIMUM OF (2) 2X10
S _N -2	ALL LOAD BEARING FRAME WALLS SHALL HAVE (1) JACK STUD & (1) EACH SIDE (U.N.O.)
S _N -3	USE ONE JACK STUD GIRDER S
S _N -4	DIMENSIONS ON STRUCTURAL S ARE NOT EXACT. REFER TO ARCH FLOOR PLAN FOR ACTUAL DIMEN

(2) 2X10X0, 1J 1K

- NUMBER OF KING STUDS (FULL LENGTH)
- NUMBER OF JACK STUDS (UNDER HEADER)
- SPAN OF HEADER
- SIZE OF HEADER MATERIAL
- NUMBER OF PLIES IN HEADER

INDICATES LOCATION OF:
3/8" A307 ALL THREADED ROD

CONNECTIONS, WALL, &
ON REACTIONS & UPLIFT
FURNISHED BY BUILDER.
JOB #21-5391

5

COPYRIGHTS AND PROPERTY RIGHTS
Mark Disoway, P.E. hereby expressly assigns all his common law copyrights and property rights in these instruments of service. This document shall not be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915

DISC

Mark Disosway P.E.

JOB NUMBER:

JOB NUMBER:	220531
S-3	OF 3 SHEETS