


TANNER WARNER
COLUMBIA COUNTY, FLORIDA

40' x 72' OPEN POLE
BARN STRUCTURE

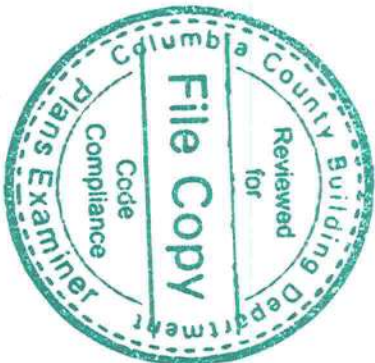

RIDGEPOINT
DESIGN
566 SW ARLINGTON BLVD, STE 101, LAKE CITY, FL 32025
P: 386-288-1188
E: RIDGEPOINTDESIGN@GMAIL.COM

1. ALL CONSTRUCTION SHALL COMPLY WITH 2020 FLORIDA BUILDING CODE 7th EDITION

ULTIMATE WIND SPEED: 130
NOMINAL WIND SPEED: 101
WIND EXPOSURE CATEGORY: B
RISK CATEGORY 2
INTERNAL PRESSURE COEFFICIENT G_{opi} = +/- 0.0
DESIGN PRESSURE PER FBC CHAPTER 16
DESIGN ROOF LIVE LOAD = 20 PSF
DESIGN ROOF DEAD LOAD = 3.5 PSF
MIN SOIL BEARING 2500 PSF
TRUSS BEARING LOAD EACH END = 4600 LBS
TRUSS UPLIFT @ POST = 2880 LBS

1. WOOD FRAMING AND FASTENERS TO MEET NDS-2018 REQUIREMENTS
2. FASTER REQUIREMENTS: (1) ALL NAILS ARE COMMON GALVANIZED; (2) ALL BOLTS ARE TO BE GALVANIZED STEEL AND INCLUDE NUTS AND WASHERS; AND (3) ALL OTHER HARDWARE (SIMPSON, ETC.) IS TO BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS. NAILING (SIZE AND NUMBER) SHALL SATISFY TABLES 2306.2, (1) AND 2306.3(4) FBC UNLESS OTHERWISE INDICATED. NOTE: FASTERERS EXPOSED TO THE WEATHER ARE TO BE TREATED FOR WEATHER RESISTANCE AND COMPATIBLE WITH THE TYPE OF PRESSURE TREATED WOOD USED (CONNECTORS, NAILS, BOLTS, NUTS AND WASHERS)

2. CONCRETE CONSTRUCTION NOTES:

1. CONCRETE WORK SHALL CONFORM TO "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" (ACI-318) AND "SPECIFICATIONS FOR STRUCTURAL CONCRETE" (ACI-301), LATEST EDITION
2. CONCRETE MIX SHALL CONFORM TO THE FOLLOWING SPECIFICATIONS. ALL CONCRETE MIXES SHALL CONTAIN A WATER-REDUCING ADMIXTURE CONFORMING TO ASTM C-494. AIR-ENTRAINING ADMIXTURE SHALL CONFORM TO ASTM C-260

CONCRETE MIX A

ULTIMATE COMPRESSIVE STRENGTH @ 28 DAYS 3000 PSI
SLUMP RANGE 4" +/- 1"
MAXIMUM AGGREGATE SIZE 1"
ENTRAINED AIR NONE
DRY WEIGHT PER CUBIC FOOT 150 #

3. SHOTCRETE MIX
4. ALL CONCRETE SHALL BE CURED FOR A MINIMUM OF 28 DAYS. IF FORMS FOR VERTICAL SURFACES ARE REMOVED PRIOR TO THE END OF THE CURING PERIOD, SPRAY SURFACES WITH LIQUID MEMBRANE CURING COMPOUND
5. REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 40 (F_y=40 ksi). LAP CONTINUOUS BARS FOR TENSION LAP SPLICE PER ACI-318, UNLESS OTHERWISE NOTED. PROVIDE CORNER BARS OF SAME SIZE AND SPACING AS HORIZONTAL WALL REINFORCEMENT. COVER FOR CONCRETE REINFORCING STEEL SHALL BE IN ACCORDANCE WITH ACI-318, PARAGRAPH 7.7
6. WELDED WIRE FABRIC (WWF) SHALL CONFORM TO ASTM A186. LAP SHEETS TWO MESH SPACES AND WIRE TIE ADJACENTS SHEETS TOGETHER SECURELY. CUT ALTERNATE REINFORCEMENT AT CONTROL JOINTS
7. ALL SLABS ON GRADE SHALL HAVE CONSTRUCTION OR CONTROL JOINTS NOT TO EXCEED 15'-0" SPACING, UNLESS OTHERWISE NOTED.
8. ELECTRICAL CONDUIT AND OTHER PIPES TO BE EMBEDDED IN STRUCTURAL CONCRETE FLOOR SLABS OR WALLS SHALL BE PLACED IN ACCORDANCE WITH THE REQUIREMENTS OF ACI-318, PARAGRAPH 6.3

BUILDING COMPONENTS & CLADDING LOADS MEAN BUILDING HEIGHT = 30.0', EXPOSURE "B" ROOF ANGLE 7° TO 27°					
ZONE	AREA	W _{ult} 110 MPH	W _{ult} 120 MPH	W _{ult} 130 MPH	W _{ult} 140 MPH
1	10	12.0 / -19.9	14.9 / -23.7	17.5 / -27.8	20.3 / -32.3
1	20	11.4 / -18.4	13.8 / -23.0	16.0 / -27.0	18.6 / -31.4
1	50	10.0 / -16.6	11.9 / -22.2	13.9 / -26.0	16.1 / -30.2
2	10	12.5 / -34.7	14.9 / -41.3	17.5 / -48.4	20.3 / -56.2
2	20	11.4 / -31.9	13.6 / -38.0	16.0 / -44.6	18.5 / -51.7
2	50	10.0 / -28.2	11.9 / -33.6	13.9 / -38.4	16.1 / -46.7
3	10	12.5 / -51.3	14.9 / -61.0	17.5 / -71.6	20.3 / -83.1
3	20	11.4 / -47.9	13.6 / -57.1	16.0 / -67.0	18.5 / -77.7
3	50	10.0 / -43.5	11.9 / -51.8	13.9 / -60.8	16.1 / -70.5
4	10	21.6 / -23.6	25.9 / -34.7	30.4 / -33.0	35.3 / -38.2
4	20	20.8 / -22.6	24.1 / -26.9	28.0 / -31.6	33.7 / -36.7
4	50	19.5 / -21.3	23.2 / -25.4	27.2 / -29.8	31.6 / -34.6
5	10	21.6 / -29.1	25.9 / -34.7	30.4 / -40.7	35.3 / -47.2
5	20	20.8 / -27.2	24.7 / -32.4	29.0 / -36.0	33.7 / -44.0
5	50	19.5 / -24.6	23.2 / -28.3	27.2 / -34.3	31.6 / -38.6

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS FOR BUILDING COMPONENTS & CLADDING				
BLDG HEIGHT	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"	EXPOSURE
15	1.00	1.21	1.47	
20	1.00	1.29	1.55	
25	1.00	1.35	1.61	
30	1.00	1.40	1.66	

PAGE INDEX & REVISIONS SCHEDULE:			
DATE:	PAGE #	PAGE DESCRIPTION	REVISION DATE:
Tuesday, September 12, 2023	1	WINDLOAD & SPECS	
Tuesday, September 12, 2023	2	FOUNDATION	
Tuesday, September 12, 2023	3	ROOF FRAMING	
Tuesday, September 12, 2023	4	BUILDING SECTION	
Tuesday, September 12, 2023	5	TRUSS SECTION	
Tuesday, September 12, 2023	6	TRUSS DETAILS	



NICHOLAS
PAUL
GEISLER
ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Rd.
Lake City, FL 32055

TANNER WARNER

COLUMBIA COUNTY, FLORIDA

40' x 72' OPEN POLE
BARN STRUCTURE

72'-0"

12'-0"

12'-0"

12'-0"

12'-0"

12'-0"

12'-0"

39'-1"

8x8 pressure treated
wood posts (ground contact)

18" round x 48" deep
footing w/ #5 rebar
drilled thru post each way
at 4" o.c. in bottom of post.
Post will be set on 4" bed
of #5 gravel rock.


FOUNDATION PLAN VIEW

SCALE:

NOT TO SCALE

Tuesday, September 12, 2023

2



**NICHOLAS
PAUL
GEISLER
ARCHITECT**
N.C.A.R.B. Certified

1758 NW Brown Rd.
Lake City, FL 32055



13 SEP 2023

AR0007005




**RIDGEPOINT
DESIGN**

566 SW ARLINGTON BLVD, STE 101, LAKE CITY, FL 32025
P: 386-288-1188
E: RIDGEPOINTDESIGN@GMAIL.COM

TANNER WARNER

COLUMBIA COUNTY, FLORIDA

40' x 72' OPEN POLE
BARN STRUCTURE

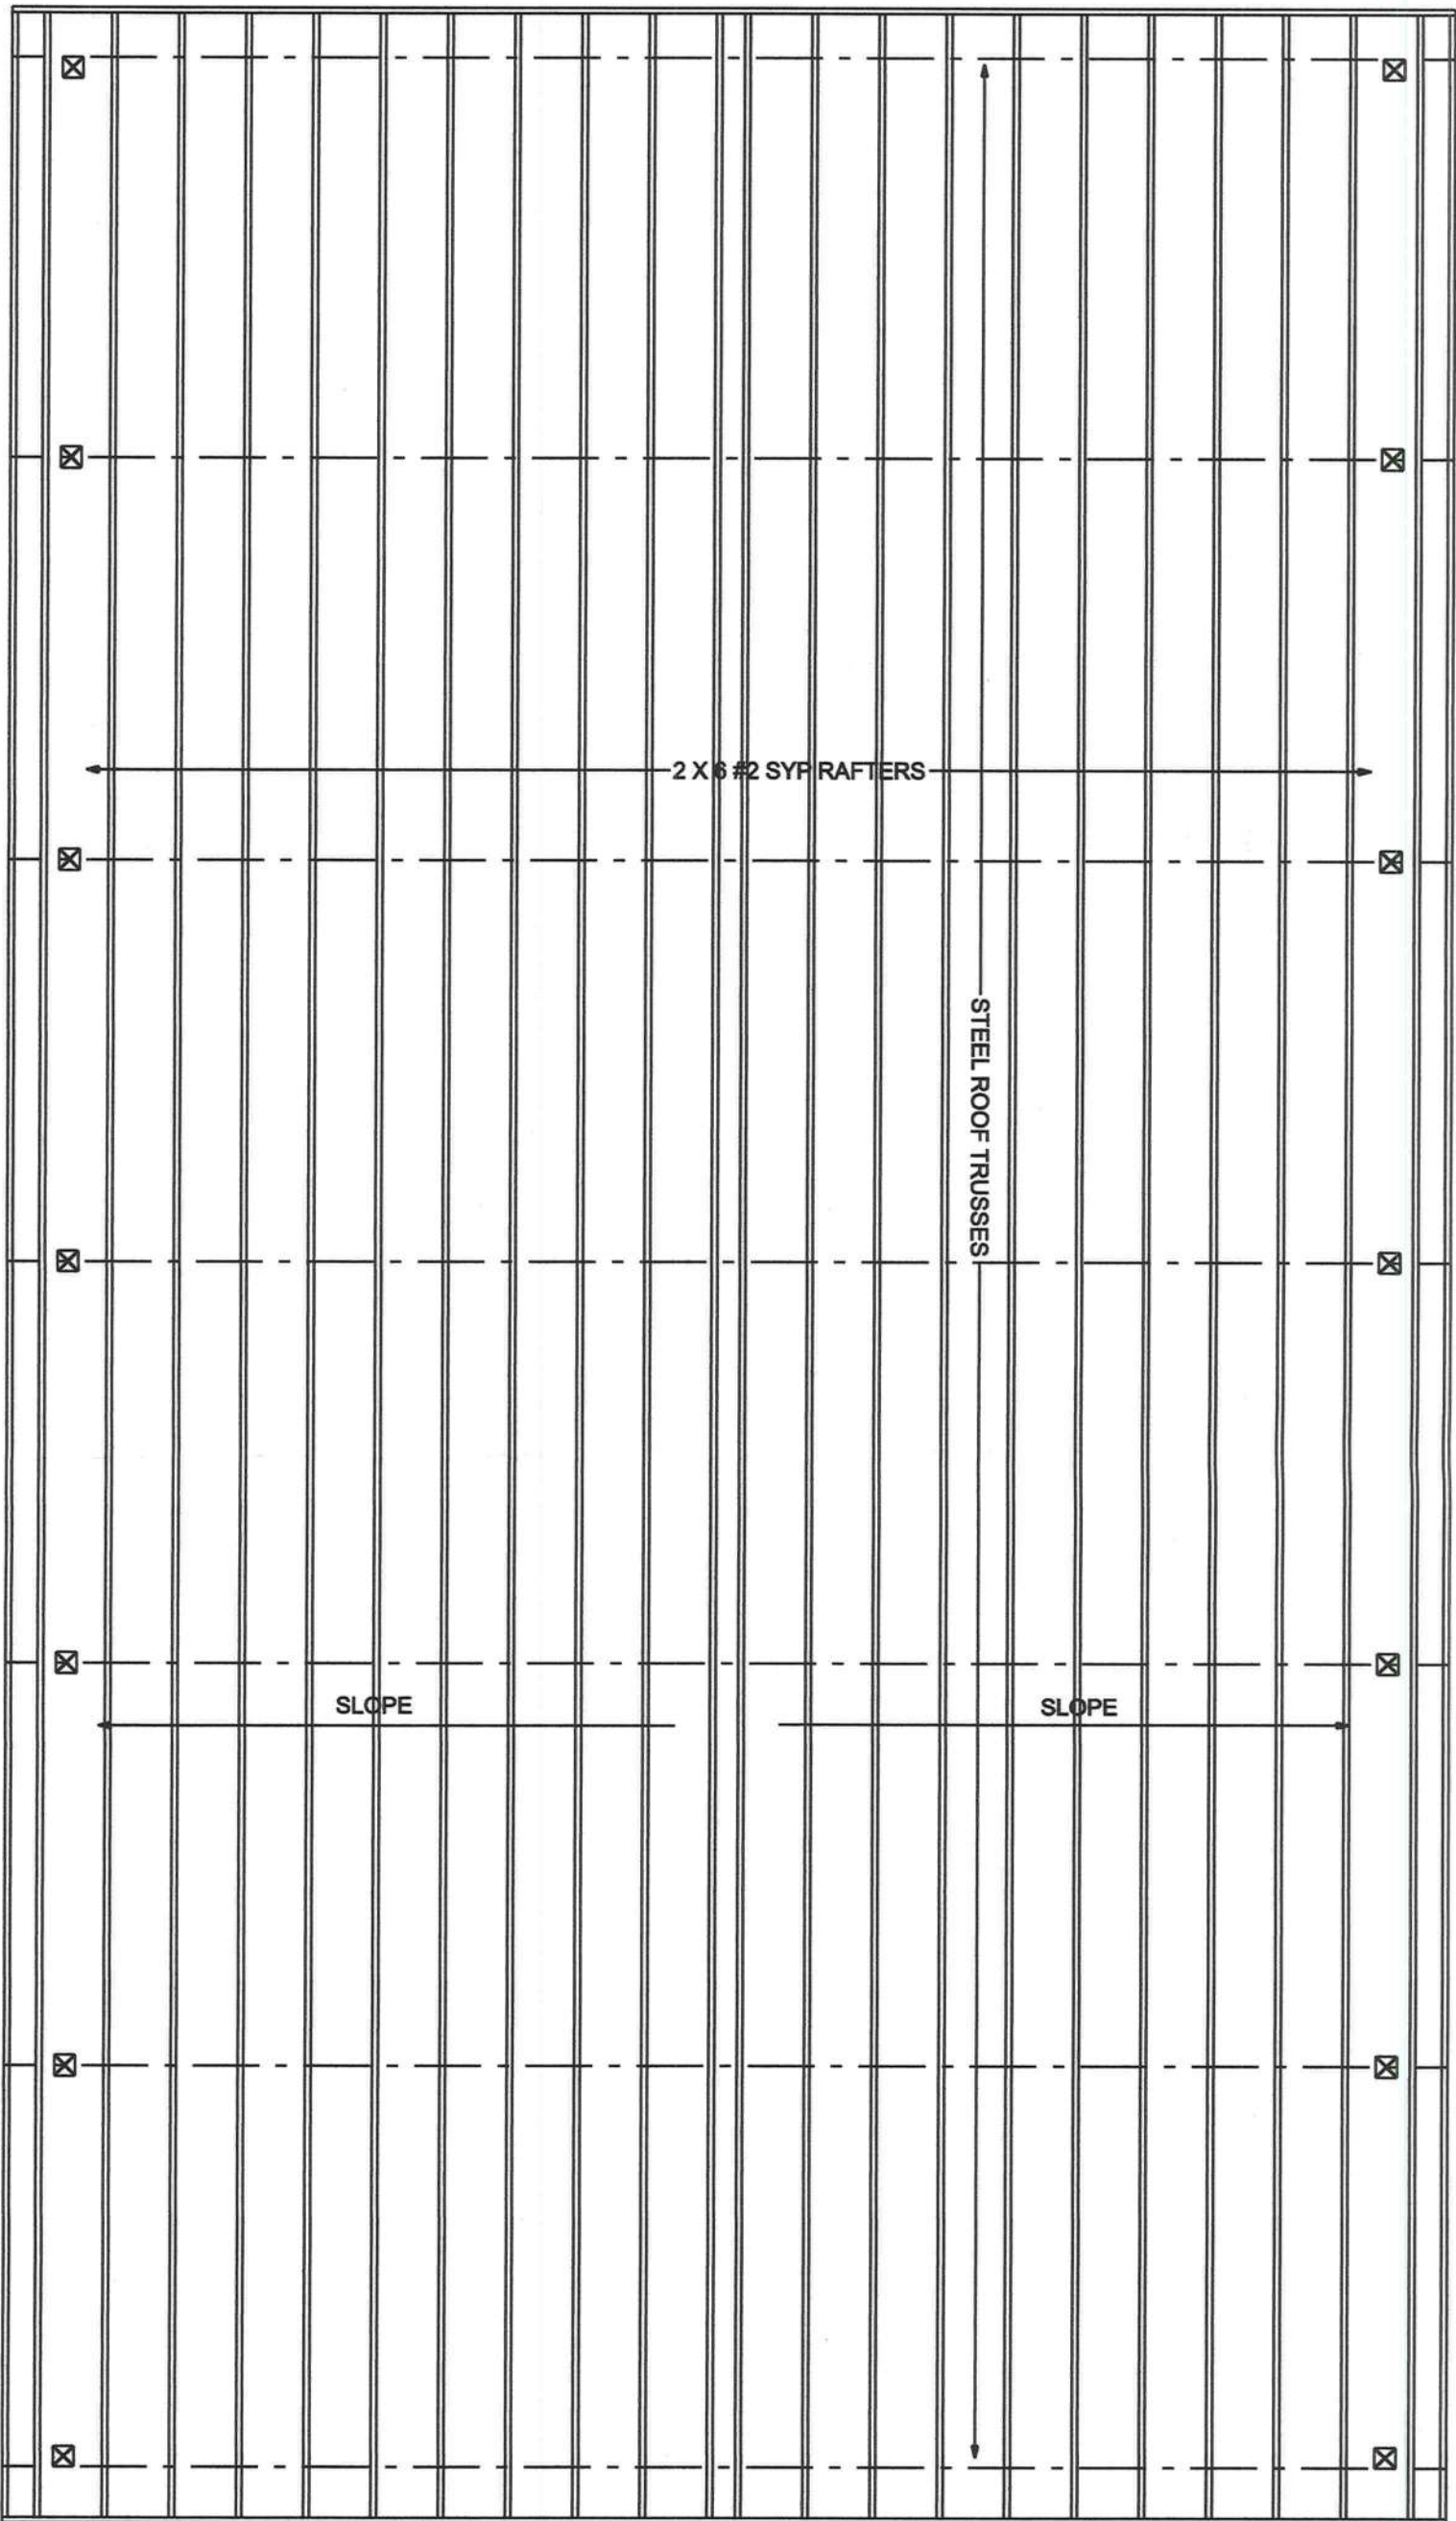

RAFTER FRAMING PLAN
SCALE: NOT TO SCALE

Tuesday, September 12, 2023

3

NICHOLAS PAUL GEISLER ARCHITECT
N.C.A.R.B. Certified

1758 NW Brown Rd.
Lake City, FL 32055


WJG
13 Sep 2023

AR0007005

RIDGEPOINT DESIGN
566 SW ARLINGTON BLVD, STE 101, LAKE CITY, FL 32025
P: 386-288-1188
E: RIDGEPOINTDESIGN@GMAIL.COM

TANNER WARNER
COLUMBIA COUNTY, FLORIDA

40' x 72' OPEN POLE
BARN STRUCTURE

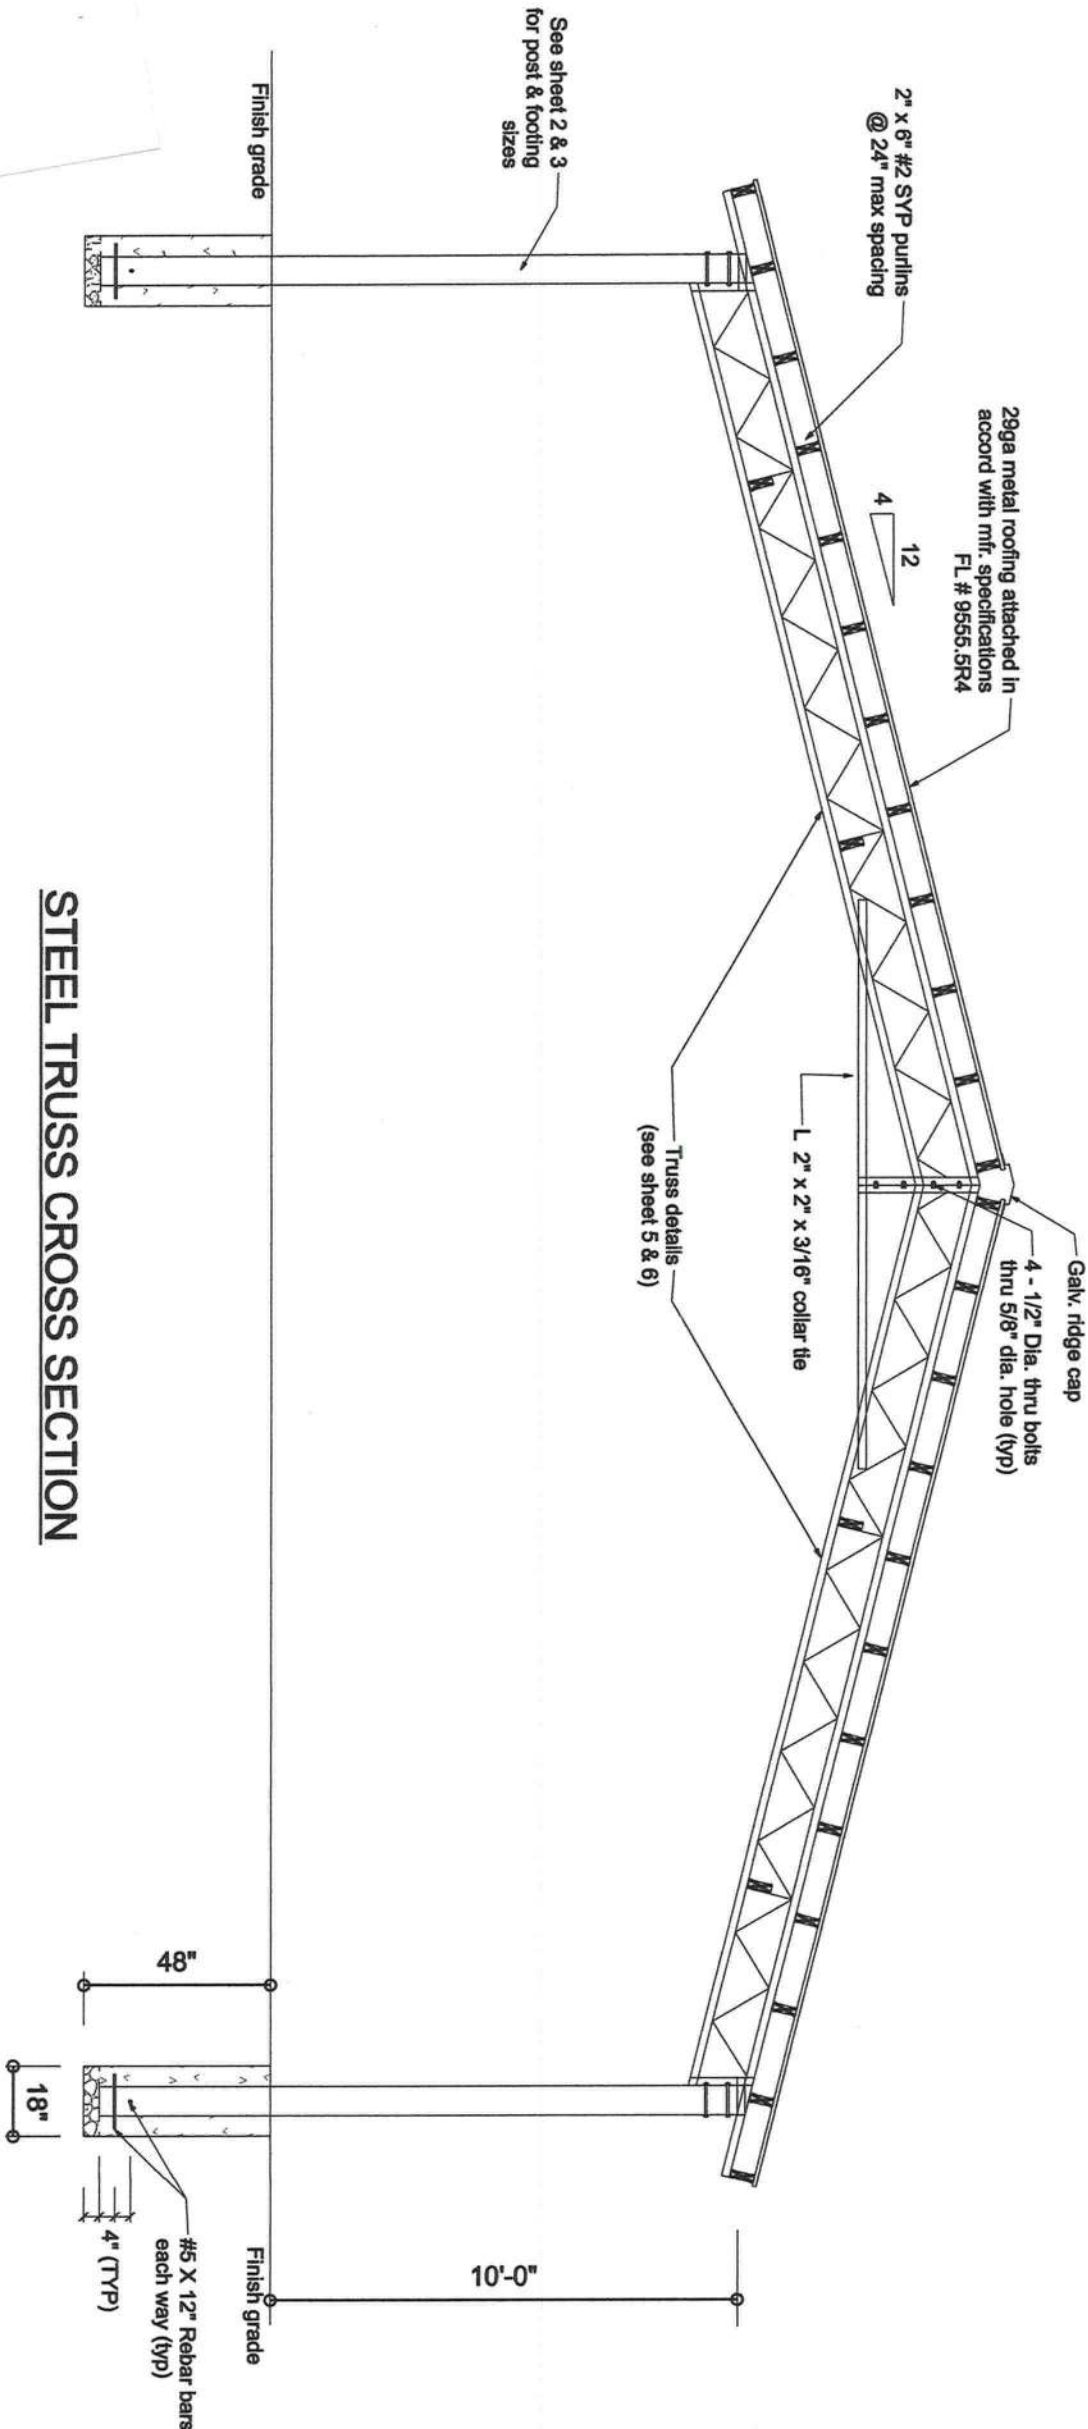


STEEL TRUSS CROSS SECTION

Handwritten signature and date: 13 Sep 2023
AR0007005




RIDGEPOINT
DESIGN
566 SW ARLINGTON BLVD, STE 101, LAKE CITY, FL 32025
P: 386-288-1188
E: RIDGEPOINTDESIGN@GMAIL.COM



NICHOLAS
PAUL
GEISLER
ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Rd.
Lake City, FL 32055

TANNER WARNER
COLUMBIA COUNTY, FLORIDA

40' x 72' OPEN POLE
BARN STRUCTURE

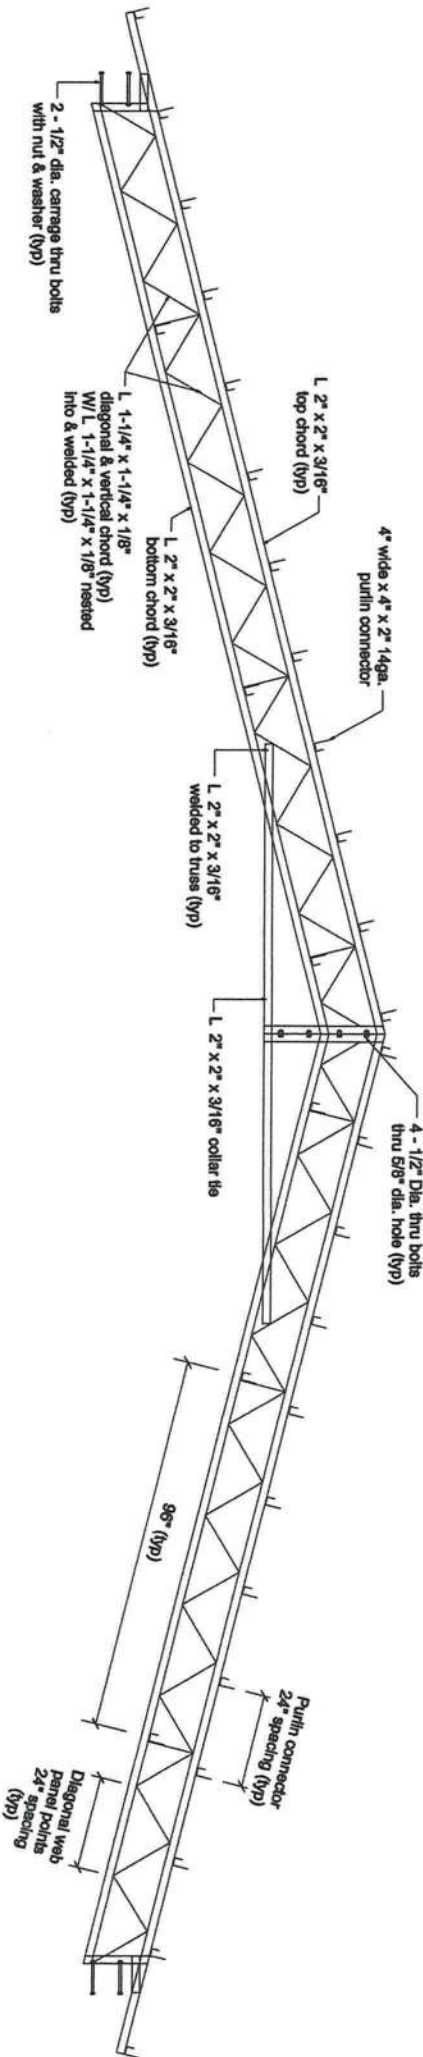


STEEL TRUSS CROSS SECTION

NOTES:

1. MATERIALS SHALL CONFORM TO STEEL ASTM 513
2. ALL STEEL SHALL BE 50KSI IN ACCORD WITH CURRENT AISC MANUAL.
3. WELDING ELECTRODES TYPE E70XX
4. ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWWA REQUIREMENTS
5. ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
6. BOLTS SHALL BE ASTM A325, W/ NUTS & WASHERS (TYP)
7. WELD STRENGTH 70 KSI MIN.
8. ALL POST SHALL BE PRESSURE TREATED GROUND CONTACT.
9. PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
10. MIN EDGE DISTANCE FOR BOLTS HOLES SHALL BE 3/4" MIN.
11. MAX TRUSS SPACING SHALL NOT EXCEED 12'-0"
12. THE DESIGNER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBILITY OR EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.



RIDGEPOINT
DESIGN
566 SW ARLINGTON BLVD, STE 101, LAKE CITY, FL 32025
P: 386-288-1188
E: RIDGEPOINTDESIGN@GMAIL.COM





NICHOLAS
PAUL
GEISLER
ARCHITECT
N.C.A.R.B. Certified


1758 NW Brown Rd.
Lake City, FL 32055

TANNER WARNER
COLUMBIA COUNTY, FLORIDA


40' x 72' OPEN POLE
BARN STRUCTURE

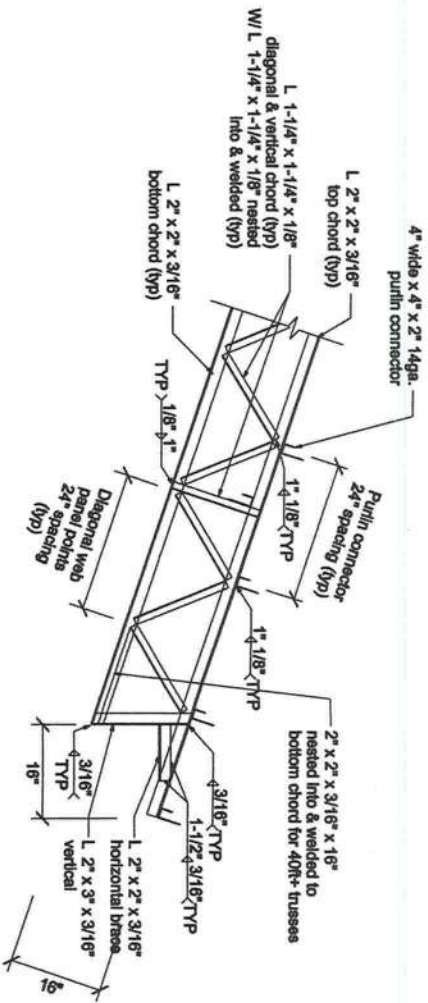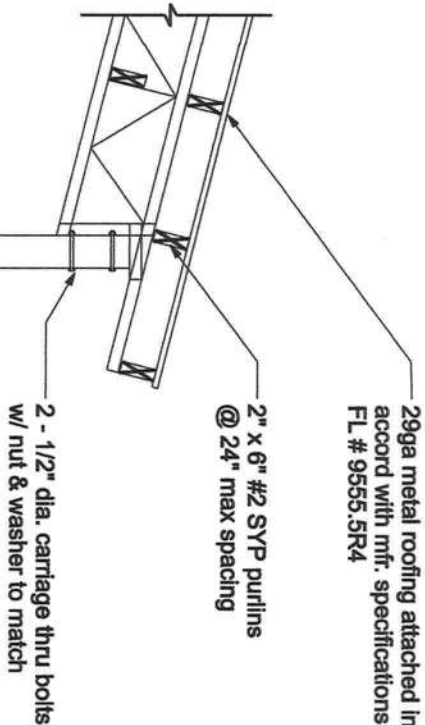


TRUSS END SECTION

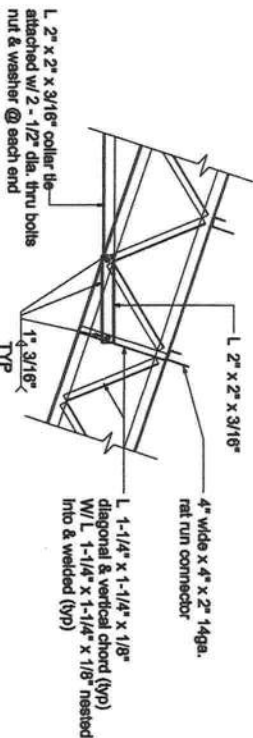


COLLAR TIE SECTION

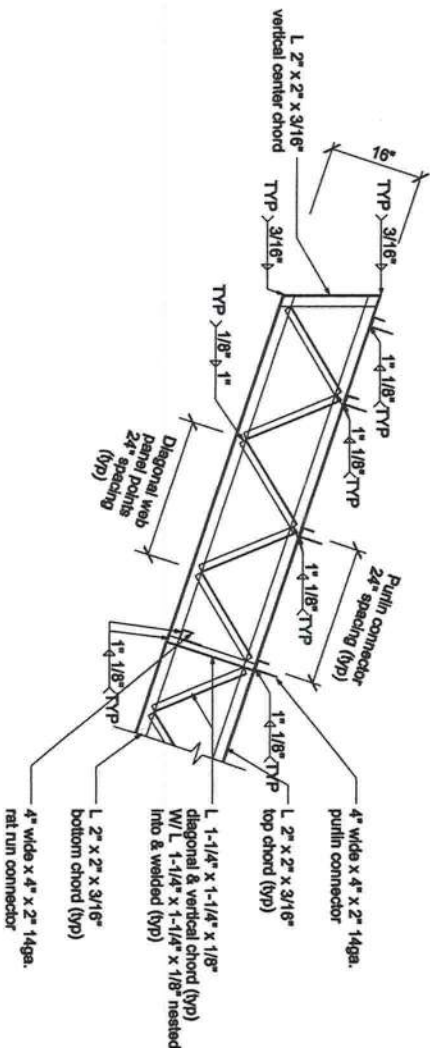


TRUSS CENTER SECTION

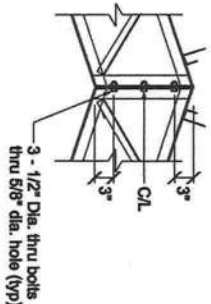


CENTER RIDGE SECTION

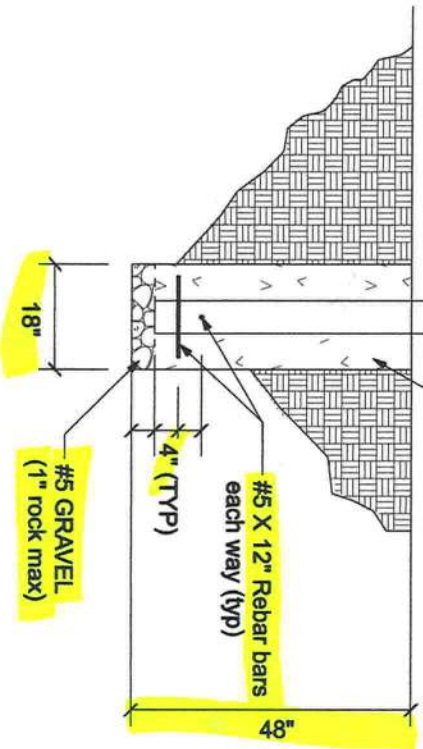

POST & FOOTING SECTION

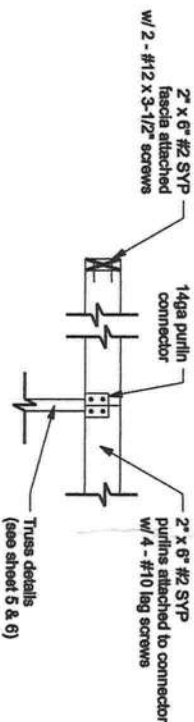

PURLIN CONNECTION SECTION

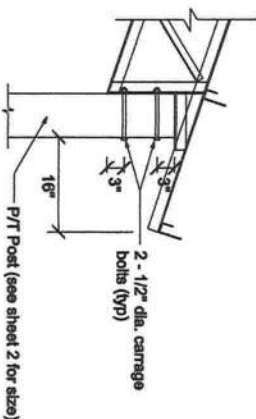

POST TO TRUSS CONNECTION



RIDGEPOINT
DESIGN
566 SW ARLINGTON BLVD, STE 101, LAKE CITY, FL 32025
P: 386-288-1188
E: RIDGEPOINTDESIGN@GMAIL.COM



NICHOLAS
PAUL
GEISLER
ARCHITECT
N.C.A.R.B. Certified
1756 NW Brown Rd.
Lake City, FL 32055