

DATE 05/24/2010

Columbia County Building Permit
This Permit Must Be Prominently Posted on Premises During Construction

PERMIT
000028593

APPLICANT REBECCA THOMAS PHONE 623-5084
ADDRESS 547 SW DYAL AVE. LAKE CITY FL 32024
OWNER MIKE ROBERTS PHONE
ADDRESS 256 SW CHESTERFIELD CIRCLE LAKE CITY FL 32024
CONTRACTOR REBECCA THOMAS PHONE 623-5084
LOCATION OF PROPERTY 441S, TR 47S, TR CR 242,TR ON ARROWHEAD RD, TL CHESTERFIELD
CIRCLE, TL CHESTERFIELD TO 3RD LOT ON RIGHT
TYPE DEVELOPMENT SFD, UTILITY ESTIMATED COST OF CONSTRUCTION 101100.00
HEATED FLOOR AREA 1508.00 TOTAL AREA 2022.00 HEIGHT STORIES 1
FOUNDATION CONC WALLS FRAMED ROOF PITCH 6/12 FLOOR SLAB
LAND USE & ZONING RSF-2 MAX. HEIGHT
Minimum Set Back Requirments: STREET-FRONT 25.00 REAR 15.00 SIDE 10.00
NO. EX.D.U. 0 FLOOD ZONE X DEVELOPMENT PERMIT NO.

PARCEL ID 24-4S-16-03117-131 SUBDIVISION CROSSWINDS
LOT 31 BLOCK PHASE UNIT TOTAL ACRES 0.50

000001820 CBC1256094
Culvert Permit No. Culvert Waiver Contractor's License Number Applicant/Owner/Contractor
CULVERT 10-0182 BK HD Y
Driveway Connection Septic Tank Number LU & Zoning checked by Approved for Issuance New Resident

COMMENTS: ONE FOOT ABOVE THE ROAD, NOC ON FILE

Check # or Cash 2520

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power date/app. by Foundation date/app. by Monolithic date/app. by
Under slab rough-in plumbing date/app. by Slab date/app. by Sheathing/Nailing date/app. by
Framing date/app. by Insulation date/app. by
Rough-in plumbing above slab and below wood floor date/app. by Electrical rough-in date/app. by
Heat & Air Duct date/app. by Peri. beam (Lintel) date/app. by Pool date/app. by
Permanent power date/app. by C.O. Final date/app. by Culvert date/app. by
Pump pole date/app. by Utility Pole date/app. by M/H tie downs, blocking, electricity and plumbing date/app. by
Reconnection date/app. by RV date/app. by Re-roof date/app. by

BUILDING PERMIT FEE \$ 510.00 CERTIFICATION FEE \$ 10.11 SURCHARGE FEE \$ 10.11
MISC. FEES \$ 0.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ 0.00 WASTE FEE \$
FLOOD DEVELOPMENT FEE \$ FLOOD ZONE FEE \$ 25.00 CULVERT FEE \$ 25.00 TOTAL FEE 630.22
INSPECTORS OFFICE CLERKS OFFICE

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

EVERY PERMIT ISSUED SHALL BECOME INVALID UNLESS THE WORK AUTHORIZED BY SUCH PERMIT IS COMMENCED WITHIN 180 DAYS AFTER ITS ISSUANCE, OR IF THE WORK AUTHORIZED BY SUCH PERMIT IS SUSPENDED OR ABANDONED FOR A PERIOD OF 180 DAYS AFTER THE TIME THE WORK IS COMMENCED. A VALID PERMIT RECIEVES AN APPROVED INSPECTION EVERY 180 DAYS. WORK SHALL BE CONSIDERED NOT SUSPENDED, ABANDONED OR INVALID WHEN THE PERMIT HAS RECIEVED AN APPROVED INSPECTION WITHIN 180 DAYS OT THE PREVIOUS INSPECTION.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

18.50
175.00
\$25,000.00

THIS INSTRUMENT WAS PREPARED BY:

TERRY McDAVID
POST OFFICE BOX 1328
LAKE CITY, FL 32056-1328

RETURN TO:

TERRY McDAVID
POST OFFICE BOX 1328
LAKE CITY, FL 32056-1328
File No. 10-61
Property Appraiser's
Parcel Identification No.
03117-131

Inst:201012005399 Date:4/7/2010 Time:8:14 AM
Doc Stamp-Deed:175.00
DC, P. DeWitt Cason, Columbia County Page 1 of 2 B:1192 P:347

WARRANTY DEED

THIS INDENTURE, made this 6th day of April 2010, between DELTA OMEGA PROPERTIES, INC., a corporation existing under the laws of the State of Florida, whose post office address is 3454 SW CR 242, Lake City, FL 32024, and having its principal place of business in the County of Columbia, State of Florida, party of the first part, and MIKE W. ROBERTS, whose post office address is 657 SW Catherine Lane, Lake City, FL 32025, of the County of Columbia, State of Florida, party of the second part,

WITNESSETH: that the said party of the first part, for and in consideration of the sum of Ten Dollars (\$10.00), to it in hand paid, the receipt whereof is hereby acknowledged, has granted, bargained, sold, aliened, remised, released, conveyed and confirmed, and by these presents doth grant, bargain, sell, alien, remise, release, convey and confirm unto the said party of the second part, and their heirs and assigns forever, all that certain parcel of land lying and being in the County of Columbia and State of Florida, more particularly described as follows:

Lot 31, CROSSWINDS PHASE ONE, a subdivision according to the plat thereof recorded in Plat Book 8, Pages 79-82 of the public records of Columbia county, Florida.

SUBJECT TO: Restrictions, easements and outstanding mineral rights of record, if any, and taxes for the current year.

TOGETHER with all the tenements, hereditaments and appurtenances, with every privilege, right, title, interest and estate, reversion, remainder and easement thereto belong or in anywise appertaining:

TO HAVE AND TO HOLD the same in fee simple forever.

And the said party of the first part doth covenant with said party of the second part that it is lawfully seized of said premises; that they are free of all encumbrances, and that it has good right and lawful authority to sell the same; and the said party of the first part does hereby fully warrant the title to said land, and will defend the same against the lawful claims of all persons whomsoever.

IN WITNESS WHEREOF, the party of the first part has caused these presents to be signed in its name by its President, and its corporate seal to be affixed, the day and year above written.

Signed, sealed and delivered
in our presence:




Terry McDavid

(Print or Type Name)

DELTA OMEGA PROPERTIES, INC.

By: 
James Rhett Smitley
President




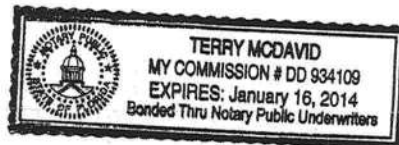
DeEtte F. Brown

(Print or Type Name)

STATE OF FLORIDA
COUNTY OF COLUMBIA

The foregoing instrument was acknowledged before me this 6th day of April 2010, by James Rhett Smitley, President of DELTA OMEGA PROPERTIES, INC., a State of Florida corporation, on behalf of the corporation. He is personally known to me and did not take an oath.


Notary Public
My Commission Expires: _____



C.H.

FORM 1100A-08

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Community Affairs Residential Performance Method A

Project Name: New Project Roberts
 Street:
 City, State, Zip: , fl ,
 Owner:
 Design Location: FL, Gainesville

Builder Name: wind tech / mike roberts
 Permit Office: Columbia
 Permit Number: 28593
 Jurisdiction: 221006

1. New construction or existing	New (From Plans)	
2. Single family or multiple family	Single-family	
3. Number of units, if multiple family	1	
4. Number of Bedrooms	3	
5. Is this a worst case?	No	
6. Conditioned floor area (ft ²)	1508	
7. Windows	Description	Area
a. U-Factor:	Dbl, U=0.40	122.00 ft ²
SHGC:	SHGC=0.28	
b. U-Factor:	N/A	ft ²
SHGC:		
c. U-Factor:	N/A	ft ²
SHGC:		
d. U-Factor:	N/A	ft ²
SHGC:		
e. U-Factor:	N/A	ft ²
SHGC:		
8. Floor Types	Insulation	Area
a. Slab-On-Grade Edge Insulation	R=0.0	1508.00 ft ²
b. N/A	R=	ft ²
c. N/A	R=	ft ²

9. Wall Types	Insulation	Area
a. Frame - Wood, Exterior	R=13.0	1184.00 ft ²
b. Frame - Wood, Adjacent	R=13.0	160.00 ft ²
c. N/A	R=	ft ²
d. N/A	R=	ft ²
10. Ceiling Types	Insulation	Area
a. Under Attic (Vented)	R=30.0	1508.00 ft ²
b. N/A	R=	ft ²
c. N/A	R=	ft ²
11. Ducts		
a. Sup: Attic Ret: Attic AH: Garage Sup. R= 6, 301.6 ft ²		
12. Cooling systems		
a. Central Unit	Cap: 28 kBtu/hr	SEER: 13
13. Heating systems		
a. Electric Heat Pump	Cap: 29 kBtu/hr	HSPF: 7.7
14. Hot water systems		
a. Electric	Cap: 40 gallons	EF: 0.92
b. Conservation features	None	
15. Credits	None	

Glass/Floor Area: 0.081

Total As-Built Modified Loads: 28.00

Total Baseline Loads: 33.93

PASS

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.

SUNCOAST INSULATORS
 825 NW 283rd Terrace
 Newberry, FL 32869
 (352) 472-3033
 Fax: (352) 472-3033

PREPARED BY: *[Signature]*

DATE: 1/5/10

I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.

OWNER/AGENT: _____

DATE: _____

Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.



BUILDING OFFICIAL: _____

DATE: _____

PROJECT

Title:	New Project Roberts	Bedrooms:	3	Address Type:	Street Address
Building Type:	FLAsBuilt	Bathrooms:	0	Lot #	
Owner:		Conditioned Area:	1508	SubDivision:	
# of Units:	1	Total Stories:	1	PlatBook:	
Builder Name:	wind tech / mike roberts	Worst Case:	No	Street:	
Permit Office:		Rotate Angle:	0	County:	columbia
Jurisdiction:		Cross Ventilation:		City, State, Zip:	fl,
Family Type:	Single-family	Whole House Fan:			
New/Existing:	New (From Plans)				
Comment:					

CLIMATE

✓	Design Location	TMY Site	IECC Zone	Design Temp 97.5 %	Design Temp 2.5 %	Int Design Temp Winter	Int Design Temp Summer	Heating Degree Days	Design Moisture	Daily Temp Range
✓	FL, Gainesville	FL_GAINESVILLE_REGI	2	32	92	75	70	1305.5	51	Medium

FLOORS

✓	#	Floor Type	Perimeter	R-Value	Area	Tile	Wood	Carpet
✓	1	Slab-On-Grade Edge Insulation	168 ft	0	1508 ft²	0	0	1

ROOF

✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Solar Absor.	Tested	Deck Insul.	Pitch
✓	1	Hip	Composition shingles	1633 ft²	0 ft²	Medium	0.96	No	2	22.6 deg

ATTIC

✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
✓	1	Full attic	Vented	300	1508 ft²	N	N

CEILING

✓	#	Ceiling Type	R-Value	Area	Framing Frac	Truss Type
✓	1	Under Attic (Vented)	30	1508 ft²	0.11	Wood

WALLS

✓	#	Omt	Adjacent To	Wall Type	Cavity R-Value	Area	Sheathing R-Value	Framing Fraction	Solar Absor.
✓	1	N	Exterior	Frame - Wood	13	304 ft²		0.23	0.75
✓	2	N	Garage	Frame - Wood	13	160 ft²		0.23	0.01
✓	3	E	Exterior	Frame - Wood	13	208 ft²		0.23	0.75
✓	4	S	Exterior	Frame - Wood	13	464 ft²		0.23	0.75
✓	5	W	Exterior	Frame - Wood	13	208 ft²		0.23	0.75

DOORS

✓	#	Omnt	Door Type	Storms	U-Value	Area
✓	1	N	Insulated	None	0.46	20 ft²
✓	2	N	Insulated	None	0.46	17.78 ft²
✓	3	E	Insulated	None	0.46	13.33 ft²

WINDOWS

Window orientation below is as entered. Actual orientation is modified by rotate angle shown in "Project" section above.

✓	#	Omnt	Frame	Panes	NFRC	U-Factor	SHGC	Storms	Area	Overhang Depth Separation	Int Shade	Screening
✓	1	N	Metal	Double (Clear)	Yes	0.4	0.28	N	6 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None
✓	2	N	Metal	Double (Clear)	Yes	0.4	0.28	N	25 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None
✓	3	N	Metal	Double (Clear)	Yes	0.4	0.28	N	20 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None
✓	4	N	Metal	Double (Clear)	Yes	0.4	0.28	N	30 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None
✓	5	E	Metal	Double (Clear)	Yes	0.4	0.28	N	6 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None
✓	6	E	Metal	Double (Clear)	Yes	0.4	0.28	N	15 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None
✓	7	E	Metal	Double (Clear)	Yes	0.4	0.28	N	20 ft²	2 ft 0 in 6 ft 0 in	HERS 2006	None

INFILTRATION & VENTING

✓	Method	SLA	CFM 50	ACH 50	ELA	EqLA	— Forced Ventilation — Supply CFM Exhaust CFM		Run Time Fraction	Fan Watts
✓	Default	0.00036	1424	7.08	78.2	147.0	0 cfm	0 cfm	0	0

GARAGE

✓	#	Floor Area	Ceiling Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
✓	1	384 ft²	384 ft²	64 ft	8 ft	11

COOLING SYSTEM

✓	#	System Type	Subtype	Efficiency	Capacity	Air Flow	SHR	Ductless
✓	1	Central Unit	None	SEER: 13	28 kBtu/hr	840 cfm	0.75	False

HEATING SYSTEM

✓	#	System Type	Subtype	Efficiency	Capacity	Ductless
✓	1	Electric Heat Pump	None	HSPF: 7.7	29 kBtu/hr	False

HOT WATER SYSTEM

✓	#	System Type	EF	Cap	Use	SetPnt	Conservation
✓	1	Electric	0.92	40 gal	60 gal	120 deg	None

SOLAR HOT WATER SYSTEM

✓	FSEC											
	Cert #	Company Name			System Model #	Collector Model #	Collector Area	Storage Volume	FEF			
	None	None					ft²					

DUCTS

✓	#	— Supply —			— Return —			Air Handler	CFM 25	Percent Leakage	QN	RLF
	1	Attic	6	301.6 ft²	Attic	75.4 ft²	Default Leakage	Garage				

TEMPERATURES

Programmable Thermostat: None				Ceiling Fans:																					
Cooling	<input checked="" type="checkbox"/>	Jan	<input checked="" type="checkbox"/>	Feb	<input checked="" type="checkbox"/>	Mar	<input checked="" type="checkbox"/>	Apr	<input checked="" type="checkbox"/>	May	<input checked="" type="checkbox"/>	Jun	<input checked="" type="checkbox"/>	Jul	<input checked="" type="checkbox"/>	Aug	<input checked="" type="checkbox"/>	Sep	<input checked="" type="checkbox"/>	Oct	<input checked="" type="checkbox"/>	Nov	<input checked="" type="checkbox"/>	Dec	
Heating	<input checked="" type="checkbox"/>	Jan	<input checked="" type="checkbox"/>	Feb	<input checked="" type="checkbox"/>	Mar	<input checked="" type="checkbox"/>	Apr	<input checked="" type="checkbox"/>	May	<input checked="" type="checkbox"/>	Jun	<input checked="" type="checkbox"/>	Jul	<input checked="" type="checkbox"/>	Aug	<input checked="" type="checkbox"/>	Sep	<input checked="" type="checkbox"/>	Oct	<input checked="" type="checkbox"/>	Nov	<input checked="" type="checkbox"/>	Dec	
Venting	<input checked="" type="checkbox"/>	Jan	<input checked="" type="checkbox"/>	Feb	<input checked="" type="checkbox"/>	Mar	<input checked="" type="checkbox"/>	Apr	<input checked="" type="checkbox"/>	May	<input checked="" type="checkbox"/>	Jun	<input checked="" type="checkbox"/>	Jul	<input checked="" type="checkbox"/>	Aug	<input checked="" type="checkbox"/>	Sep	<input checked="" type="checkbox"/>	Oct	<input checked="" type="checkbox"/>	Nov	<input checked="" type="checkbox"/>	Dec	
Thermostat Schedule:		HERS 2006 Reference												Hours											
Schedule Type			1	2	3	4	5	6	7	8	9	10	11	12											
Cooling (WD)	AM		78	78	78	78	78	78	78	78	78	78	78	78											
	PM		78	78	78	78	78	78	78	78	78	78	78	78											
Cooling (WEH)	AM		78	78	78	78	78	78	78	78	78	78	78	78											
	PM		78	78	78	78	78	78	78	78	78	78	78	78											
Heating (WD)	AM		68	68	68	68	68	68	68	68	68	68	68	68											
	PM		68	68	68	68	68	68	68	68	68	68	68	68											
Heating (WEH)	AM		68	68	68	68	68	68	68	68	68	68	68	68											
	PM		68	68	68	68	68	68	68	68	68	68	68	68											

FORM 1100A-08

Code Compliance Checklist

Residential Whole Building Performance Method A - Details

ADDRESS: _____, fl.	PERMIT #: _____
---------------------	-----------------

INFILTRATION REDUCTION COMPLIANCE CHECKLIST

COMPONENTS	SECTION	REQUIREMENTS FOR EACH PRACTICE	CHECK
Exterior Windows & Doors	N1106.AB.1.1	Maximum: .3 cfm/sq.ft. window area; .5 cfm/sq.ft. door area.	
Exterior & Adjacent Walls	N1106.AB.1.2.1	Caulk, gasket, weatherstrip or seal between: windows/doors & frames, surrounding wall; foundation & wall sole or sill plate; joints between exterior wall panels at corners; utility penetrations; between wall panels & top/bottom plates; between walls and floor. EXCEPTION: Frame walls where a continuous infiltration barrier is installed that extends from, and is sealed to, the foundation to the top plate.	
Floors	N1106.AB.1.2.2	Penetrations/openings > 1/8" sealed unless backed by truss or joint members. EXCEPTION: Frame floors where a continuous infiltration barrier is installed that is sealed to the perimeter, penetrations and seams.	
Ceilings	N1106.AB.1.2.3	Between walls & ceilings; penetrations of ceiling plane to top floor; around shafts, chases, soffits, chimneys, cabinets sealed to continuous air barrier; gaps in gyp board & top plate; attic access. EXCEPTION: Frame ceilings where a continuous infiltration barrier is installed that is sealed at the perimeter, at penetrations and seams.	
Recessed Lighting Fixtures	N1106.AB.1.2.4	Type IC rated with no penetrations, sealed; or Type IC or non-IC rated, installed inside a sealed box with 1/2" clearance & 3" from insulation; or Type IC with < 2.0 cfm from conditioned space, tested.	
Multi-story Houses	N1106.AB.1.2.5	Air barrier on perimeter of floor cavity between floors.	
Additional Infiltration reqts	N1106.AB.1.3	Exhaust fans vented to outdoors, dampers; combustion space heaters comply with NFPA, have combustion air.	

OTHER PRESCRIPTIVE MEASURES (must be met or exceeded by all residences.)

COMPONENTS	SECTION	REQUIREMENTS	CHECK
Water Heaters	N1112.AB.3	Comply with efficiency requirements in Table N112.ABC.3. Switch or clearly marked circuit breaker (electric) or cutoff (gas) must be provided. External or built-in heat trap required.	
Swimming Pools & Spas	N1112.AB.2.3	Spas & heated pools must have covers (except solar heated). Non-commercial pools must have a pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%. Heat pump pool heaters shall have a minimum COP of 4.0.	
Shower heads	N1112.AB.2.4	Water flow must be restricted to no more than 2.5 gallons per minute at 80 PSIG.	
Air Distribution Systems	N1110.AB	All ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of Section N1110.AB. Ducts in unconditioned attics: R-6 min. insulation.	
HVAC Controls	N1107.AB.2	Separate readily accessible manual or automatic thermostat for each system.	
Insulation	N1104.AB.1 N1102.B.1.1	Ceilings-Min. R-19. Common walls-frame R-11 or CBS R-3 both sides. Common ceiling & floors R-11.	

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 83

The lower the EnergyPerformance Index, the more efficient the home.

1. New construction or existing	New (From Plans)		9. Wall Types	Insulation	Area
2. Single family or multiple family	Single-family		a. Frame - Wood, Exterior	R=13.0	1184.00 ft ²
3. Number of units, if multiple family	1		b. Frame - Wood, Adjacent	R=13.0	160.00 ft ²
4. Number of Bedrooms	3		c. N/A	R=	ft ²
5. Is this a worst case?	No		d. N/A	R=	ft ²
6. Conditioned floor area (ft ²)	1508		10. Ceiling Types	Insulation	Area
7. Windows**	Description	Area	a. Under Attic (Vented)	R=30.0	1508.00 ft ²
a. U-Factor:	Dbl, U=0.40	122.00 ft ²	b. N/A	R=	ft ²
SHGC:	SHGC=0.28		c. N/A	R=	ft ²
b. U-Factor:	N/A	ft ²	11. Ducts		
SHGC:			a. Sup: Attic Ret: Attic AH: Garage Sup. R= 6, 301.6 ft ²		
c. U-Factor:	N/A	ft ²	12. Cooling systems		
SHGC:			a. Central Unit	Cap: 28 kBtu/hr	SEER: 13
d. U-Factor:	N/A	ft ²	13. Heating systems		
SHGC:			a. Electric Heat Pump	Cap: 29 kBtu/hr	HSPF: 7.7
e. U-Factor:	N/A	ft ²	14. Hot water systems		
SHGC:			a. Electric	Cap: 40 gallons	EF: 0.92
8. Floor Types	Insulation	Area	b. Conservation features		
a. Slab-On-Grade Edge Insulation	R=0.0	1508.00 ft ²	None		
b. N/A	R=	ft ²	15. Credits		None
c. N/A	R=	ft ²			

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: _____



Department of Community Affairs at (850) 487-1824.

**Label required by Section 13-104.4.5 of the Florida Building Code, Building, or Section B2.1.1 of Appendix G of the Florida Building Code, Residential, if not DEFAULT.

Columbia County Building Department Culvert Permit

Culvert Permit No.
000001820

DATE 05/24/2010 PARCEL ID # 24-4S-16-03117-131
APPLICANT REBECCA THOMAS PHONE 623-5084
ADDRESS 547 SW DYAL AVE. LAKE CITY FL 32024
OWNER MIKE ROBERTS PHONE _____
ADDRESS 256 SW CHESTERFIELD CIRCLE LAKE CITY FL 32024
CONTRACTOR REBECCA THOMAS PHONE 623-5084
LOCATION OF PROPERTY 441S, TR 47S, TR CR 242, TR ON ARROWHEAD RD, TL CHESTERFIELD
CIRCLE, TL CHESTERFIELD TO 3RD LOT ON RIGHT, 5TH FROM CORNER
SUBDIVISION/LOT/BLOCK/PHASE/UNIT CROSSWINDS 31

SIGNATURE Rebecca Thomas

INSTALLATION REQUIREMENTS



Culvert size will be 18 inches in diameter with a total length of 32 feet, leaving 24 feet of driving surface. Both ends will be mitered 4 foot with a 4 : 1 slope and poured with a 4 inch thick reinforced concrete slab.

INSTALLATION NOTE: Turnouts will be required as follows:

- a) a majority of the current and existing driveway turnouts are paved, or;
- b) the driveway to be served will be paved or formed with concrete.

Turnouts shall be concrete or paved a minimum of 12 feet wide or the width of the concrete or paved driveway, whichever is greater. The width shall conform to the current and existing paved or concreted turnouts.



Culvert installation shall conform to the approved site plan standards.



Department of Transportation Permit installation approved standards.



Other _____

**ALL PROPER SAFETY REQUIREMENTS SHOULD BE FOLLOWED
DURING THE INSTALLATION OF THE CULVERT.**

135 NE Hernando Ave., Suite B-21
Lake City, FL 32055
Phone: 386-758-1008 Fax: 386-758-2160

Amount Paid 25.00



NOTICE OF COMMENCEMENT

Inst 201012006031 Date 4/16/2010 Time 2:34 PM
DC P DeWitt Cason, Columbia County Page 1 of 1 B 1192 P 2139

Tax Parcel Identification Number 24-45-16-03117-131

County Clerk's Office Stamp or Seal

THE UNDERSIGNED hereby gives notice that improvements will be made to certain real property, and in accordance with Section 713.13 of the Florida Statutes, the following information is provided in this NOTICE OF COMMENCEMENT.

1. Description of property (legal description):

a) Street (job) Address: 256 CHESTERFIELD Cir.

2. General description of improvements: NEW HOUSE

3. Owner Information

a) Name and address: Mike Roberts 657 S.W. Catherine Ln. h. C.F.

b) Name and address of fee simple titleholder (if other than owner)

c) Interest in property

4. Contractor Information

a) Name and address: Thomas Construction

b) Telephone No.: 623-5084 Fax No. (Opt.)

5. Surety Information

a) Name and address:

b) Amount of Bond:

c) Telephone No.: Fax No. (Opt.)

6. Lender

a) Name and address: None

b) Phone No.

7. Identity of person within the State of Florida designated by owner upon whom notices or other documents may be served:

a) Name and address: None

b) Telephone No.: Fax No. (Opt.)

8. In addition to himself, owner designates the following person to receive a copy of the Lienor's Notice as provided in Section 713.13(1)(b). Florida Statutes:

a) Name and address: Donna Boyett

b) Telephone No.: 755-0855 Fax No. (Opt.)

9. Expiration date of Notice of Commencement (the expiration date is one year from the date of recording unless a different date is specified):

WARNING TO OWNER: ANY PAYMENTS MADE BY THE OWNER AFTER THE EXPIRATION OF THE NOTICE OF COMMENCEMENT ARE CONSIDERED IMPROPER PAYMENTS UNDER CHAPTER 713, PART I, SECTION 713.13, FLORIDA STATUTES, AND CAN RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY; A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT YOUR LENDER OR AN ATTORNEY BEFORE COMMENCING WORK OR RECORDING YOUR NOTICE OF COMMENCEMENT.

STATE OF FLORIDA
COUNTY OF COLUMBIA

10. Mike Roberts
Signature of Owner or Owner's Authorized Office/Director/Partner/Manager

Mike Roberts
Print Name

The foregoing instrument was acknowledged before me, a Florida Notary, this 16th day of April, 20 10, by:

Mike Roberts as owner (type of authority, e.g. officer, trustee, attorney

fact) for (name of party on behalf of whom instrument was executed).

Personally Known ☒ OR Produced Identification ☐ Type

Notary Signature Gale Tedder Notary Stamp or Seal:



—AND—

11. Verification pursuant to Section 92.525, Florida Statutes. Under penalties of perjury, I declare that I have read the foregoing and that the facts stated in it are true to the best of my knowledge and belief.

Signature of Natural Person Signing (in line #10 above.)

LYNCH WELL DRILLING, INC.

173 SW Tustenuggee Ave

Lake City, FL 32025

Phone 386-752-6677

Fax 386-752-1477

Building Permit # _____ Owner's Name _____

Well Depth _____ Ft. Casing Depth _____ Ft. Water Level _____ Ft.

Casing Size 4 inch Steel Pump Installation: Deep Well Submersible

Pump Make Schaefer Pump Model T1L4X18X10S2 HP 1

System Pressure (PSI) _____ On 30 Off 50 Average Pressure 40

Pumping System GPM at average pressure and pumping level 20 (GPM)

Tank Installation: Bladder Galvanized Make Challenger
Model PC244 Size 81

Tank Draw-down per cycle at system pressure 25.1 gallons

I HEREBY VERIFY THAT THIS WATER WELL SYSTEM HAS BEEN
INSTALLED AS PER THE ABOVE INFORMATION.

Linda Newcomb
Signature

Linda Newcomb
Print Name

2609
License Number

Date

10-0182



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ON-SITE SEWAGE DISPOSAL SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 960569
DATE PAID: 4/9/10
FEE PAID: 310.00
RECEIPT #: 125136

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Delta Omega Properties (Michael Roberts)

AGENT: Robert Ford NFST inc TELEPHONE: 755-6372

MAILING ADDRESS: 580 NW Guerdon Rd Lake City Fla 32055

=====

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES.

=====

PROPERTY INFORMATION

LOT: 31 BLOCK: / SUBDIVISION: Crosswinds P-1 PLATTED: 420-06

PROPERTY ID #: 24-45-16-03117-131 ZONING: SF I/M OR EQUIVALENT: (Y N)

PROPERTY SIZE: 0.500 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ <=2000GPD ☐ >2000GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y N DISTANCE TO SEWER: NA FT.

PROPERTY ADDRESS: 256 SW Chesterfield Circle

DIRECTIONS TO PROPERTY: Hwy 47 SOUTH to 242 TR Go to
Arrow Head Rd TR Follow to Chesterfield + L
DEAN END TR 2nd Lot Right

BUILDING INFORMATION

☒ RESIDENTIAL ☐ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sq Ft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	<u>House</u>	<u>3</u>	<u>1508</u>	
2				
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify) _____

SIGNATURE: Robert W. J. W. DATE: 4/8/10




STATE OF FLORIDA
DEPARTMENT OF HEALTH

APPLICATION FOR ONSITE SEWAGE DISPOSAL SYSTEM CONSTRUCTION PERMIT

Permit Application Number 10-0182

PART II - SITE PLAN

Scale: Each block represents 5 feet and 1 inch = 50 feet.

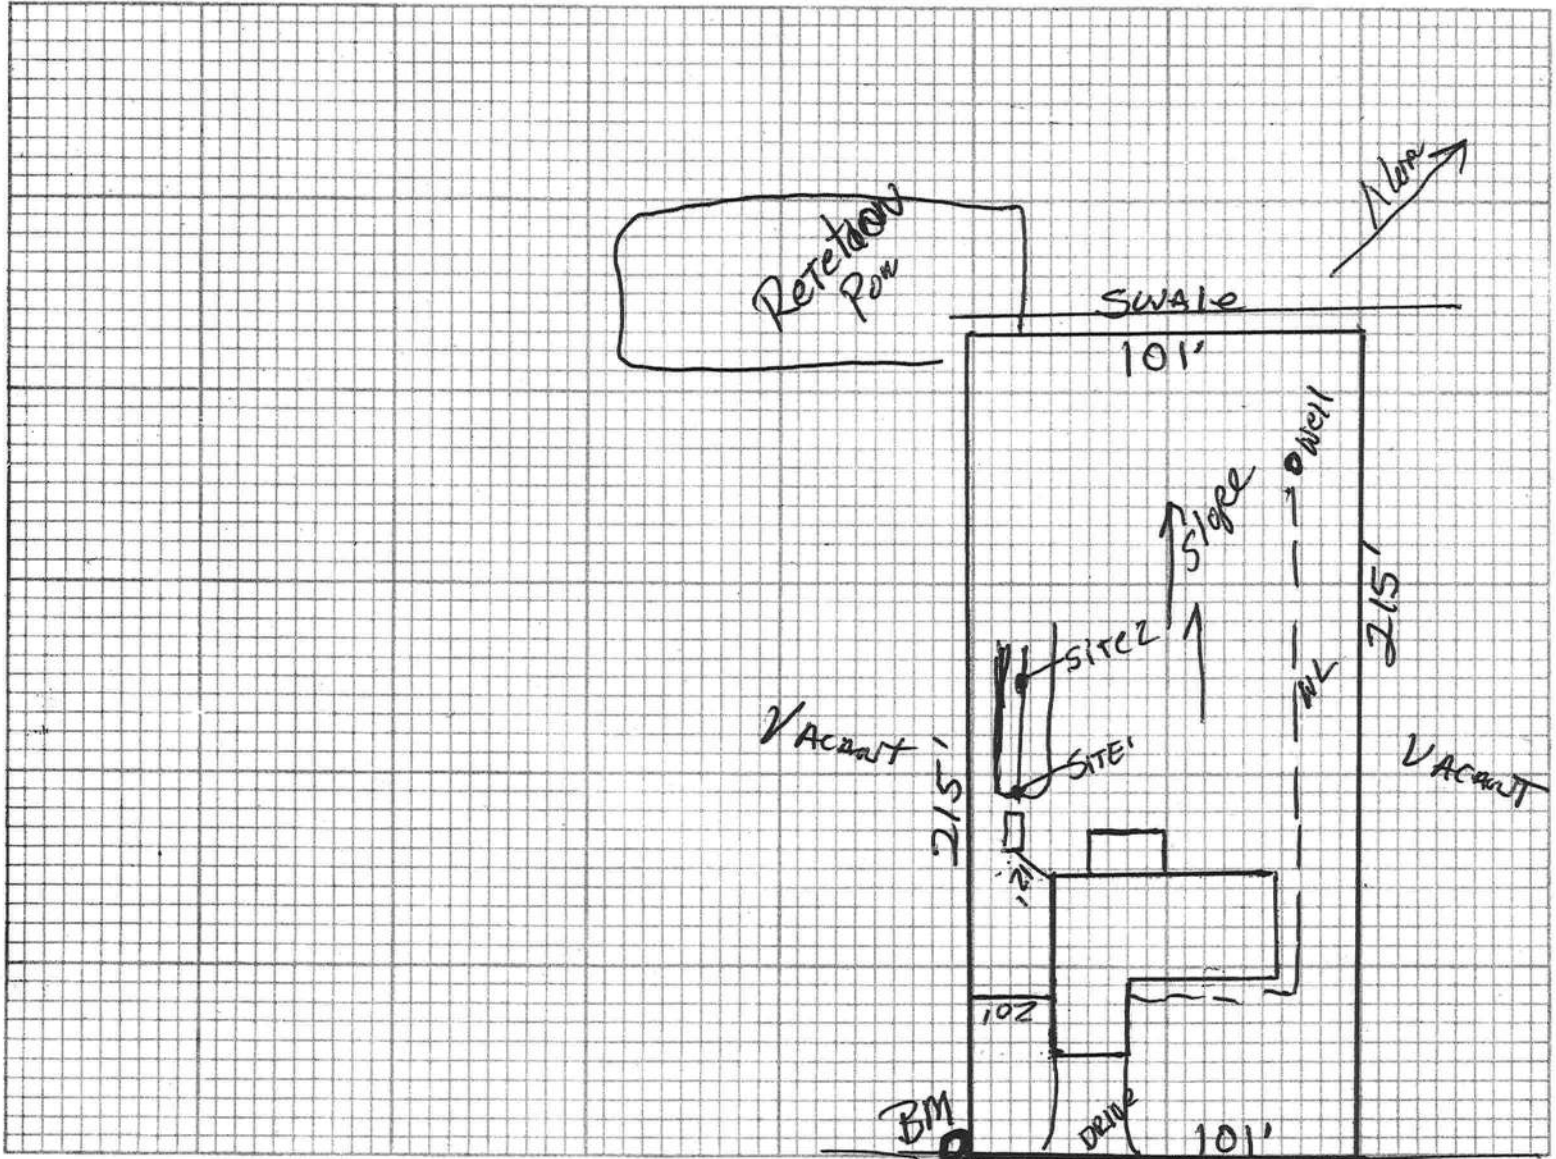

Notes: Delta Omega Properties
(Michael Roberts)

Lot 31 Crosswinds

03H7-131

Site Plan submitted by: Robert Ford Jr

Signature

Agent

Title

Plan Approved X

Not Approved

Date 4-21-10

By Salli Ford - EH Director

Columbia CHD

County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

4/15/2010 15:57 **Property Maintenance** Columbia County
 Year T Property Sel 16200 Land 001
 2010, R 24-4S-16-03117-131 AG 000
 Owner ROBERTS, MIKE W Conf Bldg 000
 Addr 657 SW CATHERINE LN Xfea 000
 16200 TOTAL B
 .500 Total Acres
 -Cap?- SOH 10% ApYr ERnwl ARnwl Notc
 City, St LAKE CITY FL Zip 32025 N Y
 Country (PUD1) (PUD2) (PUD3) MKTA 06
 Splt/Co JVChgCd pud4 pud5 pud6
 Appr By RP Date 11/04/2009 AppCode UseCd 000000 **VACANT**
 TxDist Nbhd MktA ExCode Exemption/% TxCode Units Tp
 002 24416.00 06
DIST 3
 House# 256 Street CHESTERFIELD MD CIR Dir SW #
 City Zip
 Subd N/A Condo .00 N/A
 Sect 24 Twn 4S Rnge 16 Subd Blk Lot
 Legals LOT 31 CROSSWINDS S/D PHASE 1. QC 1152-452, WD 1192-347
 Map# Mnt 4/14/2010 **THRESA**
F1=Task F2=ExTx F3=Exit F4=Prompt F11=Docs F10=GoTo PgUp/PgDn F24=More




STATE OF FLORIDA
DEPARTMENT OF HEALTH

APPLICATION FOR ONSITE SEWAGE DISPOSAL SYSTEM CONSTRUCTION PERMIT

Permit Application Number _____

PART II - SITE PLAN

Scale: Each block represents 5 feet and 1 inch = 50 feet.

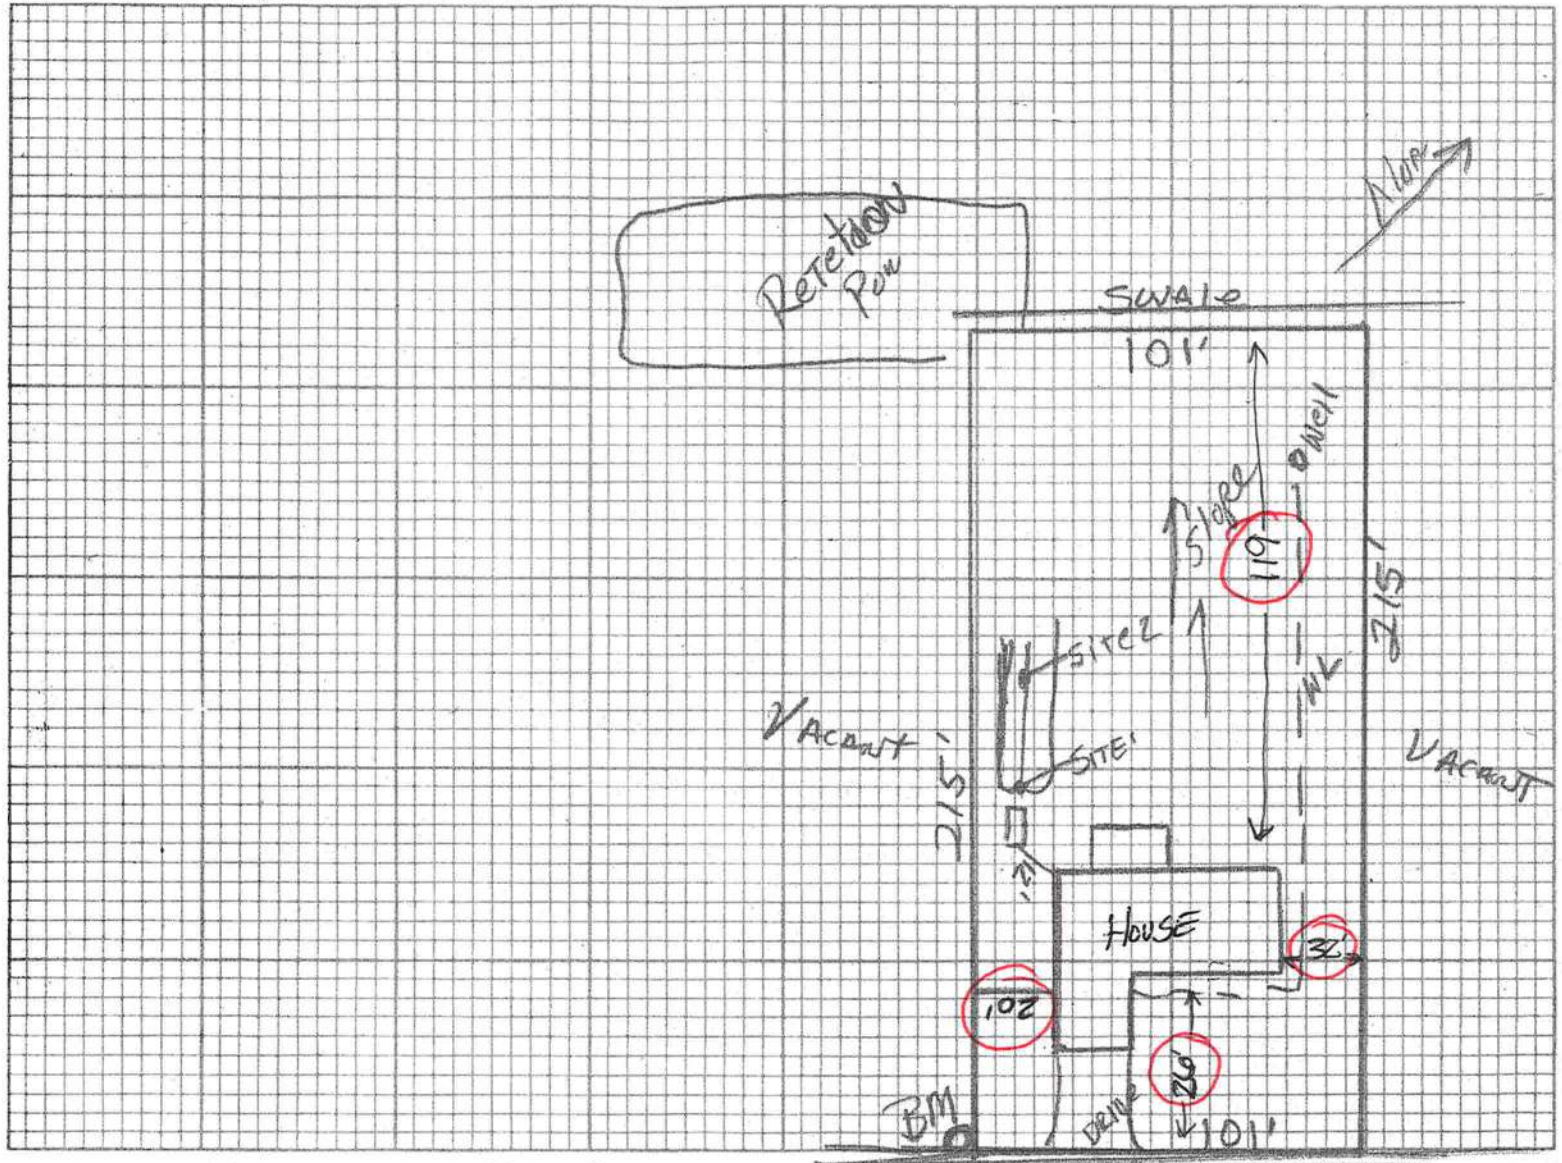

Notes: Delta Omega Properties
(Michael Roberts)
Lot 31 Crosswinds
03H7-131

Site Plan submitted by: Robert W. Ford h

Signature

Agent h

Title

Plan Approved _____

Not Approved _____

Date _____

By _____ County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

SUBCONTRACTOR VERIFICATION FORM

APPLICATION NUMBER _____ CONTRACTOR _____ PHONE _____

THIS FORM MUST BE SUBMITTED PRIOR TO THE ISSUANCE OF A PERMIT

In Columbia County one permit will cover all trades doing work at the permitted site. It is **REQUIRED** that we have records of the subcontractors who actually did the trade specific work under the permit. Per Florida Statute 440 and Ordinance 89-6, a contractor shall require all subcontractors to provide evidence of workers' compensation or exemption, general liability insurance and a valid Certificate of Competency license in Columbia County.

Any changes, the permitted contractor is responsible for the corrected form being submitted to this office prior to the start of that subcontractor beginning any work. Violations will result in stop work orders and/or fines.

ELECTRICAL ⁷⁶ OK	Print Name <u>MATTHEWS ELECTRIC INC</u> License #: <u>ER-004352</u>	Signature <u>[Signature]</u> Phone #: <u>386-344-2029</u>
MECHANICAL/ A/C ¹³ OK	Print Name <u>D.L. Williams</u> License #: <u>BA13067384</u>	Signature <u>[Signature]</u> Phone #: <u>386-754-1987</u>
PLUMBING/ GAS ²⁹⁸ OK	Print Name <u>HomeTown Plumbing</u> License #: <u>RE11067418</u>	Signature <u>[Signature]</u> Phone #: <u>386-454-6140</u>
ROOFING ³⁸⁵ OK	Print Name <u>Wm L Tich Contracting</u> License #: <u>CC029270</u>	Signature <u>[Signature]</u> Phone #: <u>755-8699</u>
SHEET METAL	Print Name _____ License #: <u>None</u>	Signature _____ Phone #: _____
FIRE SYSTEM/ SPRINKLER	Print Name _____ License #: <u>None</u>	Signature _____ Phone #: _____
SOLAR	Print Name _____ License #: <u>None</u>	Signature _____ Phone #: _____

Specialty License	License Number	Sub-Contractors Printed Name	Sub-Contractors Signature
MASON	<u>N.A</u>		
CONCRETE FINISHER OK	<u>000025</u>	<u>Gary W Moore Jr</u>	<u>[Signature]</u>
FRAMING OK	<u>000101</u>	<u>Mike Roberts</u>	<u>[Signature]</u>
INSULATION OK	<u>000743</u>	<u>Bruce Spicer</u>	<u>[Signature]</u>
STUCCO	<u>no</u>		
DRYWALL	<u>no</u>		
PLASTER OK	<u>CBC1256094</u>	<u>Rebecca Thomas</u>	<u>[Signature]</u>
CABINET INSTALLER OK	<u>CBC1256094</u>	<u>Rebecca Thomas</u>	<u>[Signature]</u>
PAINTING OK	<u>000848</u>	<u>Mike Roberts</u>	<u>[Signature]</u>
ACOUSTICAL CEILING	<u>no</u>		
GLASS OK	<u>000618</u>	<u>Lake City Glass - Carl Bullard</u>	<u>[Signature]</u>
CERAMIC TILE OK	<u>000849</u>	<u>Mike Roberts</u>	<u>[Signature]</u>
FLOOR COVERING	<u>00</u>		
ALUM/VINYL SIDING	<u>no</u>		
GARAGE DOOR OK	<u>000619</u>	<u>Lake City Glass - Carl Bullard</u>	<u>[Signature]</u>
METAL BLDG ERECTOR	<u>no</u>		

F. S. 440.103 Building permits; identification of minimum premium policy.--Every employer shall, as a condition to applying for and receiving a building permit, show proof and certify to the permit issuer that it has secured compensation for its employees under this chapter as provided in ss. 440.10 and 440.38, and shall be presented each time the employer applies for a building permit.



COLUMBIA COUNTY

911 ADDRESSING / GIS DEPARTMENT

P. O. Box 1787, Lake City, FL 32056-1787
Telephone: (386) 758-1125 * Fax: (386) 758-1365 * Email: ron_croft@columbiacountyfla.com



ADDRESS ASSIGNMENT DATA

The Columbia County Board of County Commissioners has passed Ordinance 2001-9, which provides for a uniform numbering system. A copy of this ordinance is available in the Clerk of Court records, located in the courthouse. This new numbering system will increase the efficiency of POLICE, FIRE AND EMERGENCY MEDICAL vehicles responding to calls within Columbia County by immediately identifying the location of the caller.

A Residential or Other Structure(s) on Parcel Number:

24-4S-16-03117-131 (LOT 31 CROSSWINDS S/D PHASE 1)

Address Assignment(s):

256 SW CHESTERFIELD CIR, LAKE CITY, FL, 32024

Any questions concerning this information should be referred to the Columbia County 911 Addressing / GIS Department at the address or telephone number above.

20

C/C 2520

Columbia County Building Permit Application

For Office Use Only Application # 1005-19 Date Received 5/11/10 By GF Permit # 1820/28593
Zoning Official BLK Date 4-05-10 Flood Zone X Land Use Res Low Density Zoning RSF-2
FEMA Map # N/A Elevation N/A MFE 1840000 River N/A Plans Examiner HD Date 5-20-1
Comments _____
☒ NOC ☒ EH ☒ Deed or PA ☒ Site Plan ☐ State Road Info ☐ Parent Parcel # _____
☐ Dev Permit # _____ ☐ In Floodway ☐ Letter of Auth. from Contractor ☐ F W Comp. letter
IMPACT FEES: EMS _____ Fire _____ Corr _____ Road/Code _____
School _____ = TOTAL N/A - Suspended

Septic Permit No. 10082 Fax _____
Name Authorized Person Signing Permit Rebecca G. Thomas Phone (386) 623-5084
Address 547 SW Dyal Avenue Lake City FL 32024
Owners Name MIKE ROBERTS Phone _____
911 Address 256 SW Chesterfield CR, Lake City FL 32024
Contractors Name Rebecca G. Thomas Phone (386) 623-5084
Address 547 SW Dyal Avenue Lake City FL 32024
Fee Simple Owner Name & Address _____
Bonding Co. Name & Address N/A
Architect/Engineer Name & Address Mark Disosway PO Box 828 Lake City FL 32056
Mortgage Lenders Name & Address N/A

Circle the correct power company - FL Power & Light - Clay Elec. - Suwannee Valley Elec. - Progress Energy

Property ID Number 24-45-116-03117-131 Estimated Cost of Construction \$100,000
Subdivision Name Crosswinds Subdivision Lot 31 Block _____ Unit _____ Phase I
Driving Directions South 441 to Hwy 47 South to CR-242 make right, Right turn onto Arrowhead Rd. to Crosswinds Sub. 1 1/2 miles on left. 256 SW Chesterfield Circle Lake City 32024
Number of Existing Dwellings on Property 0

Construction of Residential House Total Acreage .5 Lot Size 215' x 101'
Do you need a - Culvert Permit or Culvert Waiver or Have an Existing Drive Total Building Height 11' 4 3/4"
Actual Distance of Structure from Property Lines - Front 21' Side 20' Side 32' Rear 119'
Number of Stories 1 Heated Floor Area 1508 sqft Total Floor Area 2022 sqft Roof Pitch 6/12

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.

left message
5/20/10 to Rebecca

Columbia County Building Permit Application

TIME LIMITATIONS OF APPLICATION : An application for a permit for any proposed work shall be deemed to have been abandoned 180 days after the date of filing, unless such application has been pursued in good faith or a permit has been issued; except that the building official is authorized to grant one or more extensions of time for additional periods not exceeding 90 days each. The extension shall be requested in writing and justifiable cause demonstrated.

TIME LIMITATIONS OF PERMITS: Every permit issued shall become invalid unless the work authorized by such permit is commenced within 180 days after its issuance, or if the work authorized by such permit is suspended or abandoned for a period of 180 days after the time work is commenced. A valid permit receives an approved inspection every 180 days. Work shall be considered not suspended, abandoned or invalid when the permit has received an approved inspection within 180 days of the previous approved inspection.

FLORIDA'S CONSTRUCTION LIEN LAW: Protect Yourself and Your Investment: According to Florida Law, those who work on your property or provide materials, and are not paid-in-full, have a right to enforce their claim for payment against your property. This claim is known as a construction lien. If your contractor fails to pay subcontractors or material suppliers or neglects to make other legally required payments, the people who are owed money may look to your property for payment, even if you have paid your contractor in full. This means if a lien is filed against your property, it could be sold against your will to pay for labor, materials or other services which your contractor may have failed to pay.

NOTICE OF RESPONSIBILITY TO BUILDING PERMITEE: YOU ARE HEREBY NOTIFIED as the recipient of a building permit from Columbia County, Florida, you will be held responsible to the County for any damage to sidewalks and/or road curbs and gutters, concrete features and structures, together with damage to drainage facilities, removal of sod, major changes to lot grades that result in ponding of water, or other damage to roadway and other public infrastructure facilities caused by you or your contractor, subcontractors, agents or representatives in the construction and/or improvement of the building and lot for which this permit is issued. No certificate of occupancy will be issued until all corrective work to these public infrastructures and facilities has been corrected.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

OWNERS CERTIFICATION: I CERTIFY THAT ALL THE FOREGOING INFORMATION IS ACCURATE AND THAT ALL WORK WILL BE DONE IN COMPLIANCE WITH ALL APPLICABLE LAWS REGULATING CONSTRUCTION AND ZONING.

NOTICE TO OWNER: There are some properties that may have deed restrictions recorded upon them. These restrictions may limit or prohibit the work applied for in your building permit. It may be to your advantage to check and see if your property is encumbered by any restrictions.

Mich Kh

(Owners Must Sign All Applications Before Permit Issuance.)

Owners Signature

****OWNER BUILDERS MUST PERSONALLY APPEAR AND SIGN THE BUILDING PERMIT.**

CONTRACTORS AFFIDAVIT: By my signature I understand and agree that I have informed and provided this written statement to the owner of all the above written responsibilities in Columbia County for obtaining this Building Permit including all application and permit time limitations.

Rebecca S Thomas

Contractor's Signature (Permittee)

Contractor's License Number CBC1256094
Columbia County
Competency Card Number _____

Affirmed under penalty of perjury to by the Contractor and subscribed before me this 1st day of May 2010.

Personally known ☒ or Produced Identification _____

Renee Faulkner

State of Florida Notary Signature (For the Contractor)

SEAL:





- Engineering
 - Geotechnical
 - Environmental
- Laboratories

Cal-Tech Testing, Inc.

P.O. Box 1625 • Lake City, FL 32056-1625 • Tel(386)755-3633 • Fax(386)752-5456

4784 Rosselle St., Jacksonville, FL 32254 • Tel(904)381-8901 • Fax(904)381-8902

#28593

REPORT OF IN-PLACE DENSITY TEST

JOB NO.: 10-00181-01

DATE TESTED: 5/7/10

DATE REPORTED: 5/17/10

PROJECT:	Crosswind Subdivision Lot #31, Lake City, FL
CLIENT:	Mike Roberts Framing 657 SW Catherine Lane, Lake City, FL 32025
GENERAL CONTRACTOR:	Mike Roberts Framing
EARTHWORK CONTRACTOR:	Mike Roberts Framing
INSPECTOR:	Daryn Wimpy
ASTM METHOD	SOIL USE
(D-2922) Nuclear	BUILDING FILL
SPECIFIED REQUIREMENTS: 95%	

TEST NO.	TEST LOCATION	TEST DEPTH	WET DENSITY (lb/ft ³)	MOISTURE PERCENT	DRY DENSITY (lb/ft ³)	PROCTOR TEST NO.	PROCTOR VALUE	MAXIMUM DENSITY
1	From NE Corner of Building 10' South x 6'	12"	104.7	3.3	101.4	1	100.0	101%
2	From NE Corner of Building 15' South x 30'	12"	105.9	3.1	102.7	1	100.0	103%
3	From SW Corner of Building 12' North x 12'	12"	105.1	3.5	101.5	1	100.0	102%

REMARKS:

The Above Tests Meet Specified Requirements.

PROCTORS				
PROCTOR NO.	SOIL DESCRIPTION	MAXIMUM DRY UNIT WEIGHT (lb/ft ³)	OPT. MOIST.	TYPE
1	Tan Fine Sand	100.0	11.0	MODIFIED (ASTM D-1557)

Respectfully Submitted,
CAL-TECH TESTING, INC.

Linda Creamer, CEO, DBE
Linda M. Creamer
President - CEO

Reviewed By:

[Signature]
Date: 5/18/2010
Licensed, Florida No: 57842

The test results presented in this report are specific only to the samples tested at the time of testing. The tests were performed in accordance with generally accepted methods and standards. Since material conditions can vary between test locations and change with time, sound judgement should be exercised with regard to the use and interpretation of the data.

New Construction Subterranean Termite Service Record

OMB Approval No. 2502-0525
(exp. 02/29/2012)

This form is completed by the licensed Pest Control Company.

Public reporting burden for this collection of information is estimated to average 15 minutes per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. This information is required to obtain benefits. HUD may not collect this information, and you are not required to complete this form, unless it displays a currently valid OMB control number.

Section 24 CFR 200.926d(b)(3) requires that the sites for HUD insured structures must be free of termite hazards. This information collection requires the builder to certify that an authorized Pest Control company performed all required treatment for termites, and that the builder guarantees the treated area against infestation for one year. Builders, pest control companies, mortgage lenders, homebuyers, and HUD as a record of treatment for specific homes will use the information collected. The information is not considered confidential, therefore, no assurance of confidentiality is provided.

This report is submitted for informational purposes to the builder on proposed (new) construction cases when treatment for prevention of subterranean termite infestation is specified by the builder, architect, or required by the lender, architect, FHA, or VA.

All contracts for services are between the Pest Control Company and builder, unless stated otherwise.

#25593

Section 1: General Information (Pest Control Company Information)

Company Name Aspen Pest Control, Inc.
Company Address P.O. Box 1795 City Lake City State FL Zip 32056
Company Business License No. JB109476 Company Phone No. 386-755-3611
FHA/VA Case No. (if any) _____

Section 2: Builder Information

Company Name Mike Roberts Phone No. _____

Section 3: Property Information

Location of Structure(s) Treated (Street Address or Legal Description, City, State and Zip) Crosswinds S/D
Lot # 31
256 SW Chesterfield Cir.
Lake City, FL 32024

Section 4: Service Information

Date(s) of Service(s) 5/26/10
Type of Construction (More than one box may be checked) ☒ Slab ☐ Basement ☐ Crawl ☐ Other _____

Check all that apply:

- ☒ A. Soil Applied Liquid Termiticide
Brand Name of Termiticide: MaxxThor EPA Registration No. 83923-6
Approx. Dilution (%): 0.6% Approx. Total Gallons Mix Applied: 202 Treatment completed on exterior: ☐ Yes ☒ No
- ☐ B. Wood Applied Liquid Termiticide
Brand Name of Termiticide: _____ EPA Registration No. _____
Approx. Dilution (%): _____ Approx. Total Gallons Mix Applied: _____
- ☐ C. Bait System Installed
Name of System: _____ EPA Registration No. _____ Number of Stations Installed: _____
- ☐ D. Physical Barrier System Installed
Name of System: _____ Attach installation information (required) _____

Service Agreement Available? ☒ Yes ☐ No

Note: Some state laws require service agreements to be issued. This form does not preempt state law.

Attachments (List) _____

Comments _____

Name of Applicator(s) C. Lacey Certification No. (if required by State law) JF104376

The applicator has used a product in accordance with the product label and state requirements. All materials and methods used comply with state and federal regulations.

Authorized Signature [Signature] Date 5/26/10

Warning: HUD will prosecute false claims and statements. Conviction may result in criminal and/or civil penalties. (18 U.S.C. 1001, 1010, 1012; 31 U.S.C. 3729, 3802)

Form NPCA-99-B may still be used

form HUD-NPMA-99-B

CHESTERFIELD OR COLUMBIA

OCCUPANCY

COLUMBIA COUNTY, FLORIDA

Department of Building and Zoning Inspection

This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.

Parcel Number 24-4S-16-03117-131

Building permit No. 000028593

Use Classification SFD, UTILITY

Fire: 6.42

Permit Holder REBECCA THOMAS

Waste: 16.75

Owner of Building MIKE ROBERTS

Total: 23.17

Location: 256 SW CHESTERFIELD CIRCLE, LAKE CITY, FL

Date: 09/27/2010

for



Building Inspector

POST IN A CONSPICUOUS PLACE
(Business Places Only)



COLUMBIA COUNTY BUILDING DEPARTMENT RESIDENTIAL CHECK LIST REQUIRMENTS

MINIMUM PLAN REQUIREMENTS FOR THE FLORIDA BUILDING CODE RESIDENTIAL 2007 ONE (1) AND TWO (2) FAMILY DWELLINGS

ALL REQUIREMENTS ARE SUBJECT TO CHANGE

ALL BUILDING PLANS MUST INDICATE COMPLIANCE with the Current 2007 FLORIDA BUILDING CODES RESIDENTIAL. ALL PLANS OR DRAWINGS SHALL PROVIDE CALCULATIONS AND DETAILS THAT HAVE THE SEAL AND SIGNATURE OF A CERTIFIED ARCHITECT OR ENGINEER REGISTERED IN THE STATE OF FLORIDA, OR ALTERNATE METHODOLOGIES, APPROVED BY THE STATE OF FLORIDA BUILDING COMMISSION FOR ONE-AND-TWO FAMILY DWELLINGS.

FOR DESIGN PURPOSES THE FOLLOWING BASIC WIND SPEEDS ARE PER FIGURE R301.2(4) of the FLORIDA BUILDING CODES RESIDENTIAL (Florida Wind speed map) SHALL BE USED.

WIND SPEED LINE SHALL BE DEFINED AS FOLLOWS: THE CENTERLINE OF INTERSTATE 75.

ALL BUILDINGS CONSTRUCTED EAST OF SAID LINE SHALL BE ----- 100 MPH

ALL BUILDINGS CONSTRUCTED WEST OF SAID LINE SHALL BE -----110 MPH

NO AREA IN COLUMBIA COUNTY IS IN A WIND BORNE DEBRIS REGION

**GENERAL REQUIREMENTS:
APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL**

Items to Include-
Each Box shall be
Circled as
Applicable

			Yes	No	N/A
1	Two (2) complete sets of plans containing the following:		✓		
2	All drawings must be clear, concise, drawn to scale, details that are not used shall be marked void		✓		
3	Condition space (Sq. Ft.)	Total (Sq. Ft.) under roof			

Designers name and signature shall be on all documents and a licensed architect or engineer, signature and official embossed seal shall be affixed to the plans and documents as per the FLORIDA BUILDING CODES RESIDENTIAL R101.2.1

Site Plan information including:

4	Dimensions of lot or parcel of land	✓		
5	Dimensions of all building set backs	✓		
6	Location of all other structures (include square footage of structures) on parcel, existing or proposed well and septic tank and all utility easements.	✓		
7	Provide a full legal description of property.	✓		

Wind-load Engineering Summary, calculations and any details required

GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL		Items to Include- Each Box shall be Circled as Applicable		
8	Plans or specifications must show compliance with FBCR Chapter 3	IIIII	IIII	IIIII
		YES	NO	N/A
9	Basic wind speed (3-second gust), miles per hour	✓		
10	(Wind exposure – if more than one wind exposure is used, the wind exposure and applicable wind direction shall be indicated)	✓		
11	Wind importance factor and nature of occupancy	✓		
12	The applicable internal pressure coefficient, Components and Cladding	✓		
13	The design wind pressure in terms of psf (kN/m ²), to be used for the design of exterior component, cladding materials not specifically designed by the registered design professional.	✓		

Elevations Drawing including:

14	All side views of the structure	✓		
15	Roof pitch	✓	✓	
16	Overhang dimensions and detail with attic ventilation	✓		
17	Location, size and height above roof of chimneys	✓		✓
18	Location and size of skylights with Florida Product Approval	✓		✓
18	Number of stories	✓		
20A	Building height from the established grade to the roofs highest peak	✓		

Floor Plan including:

20	Dimensioned area plan showing rooms, attached garage, breeze ways, covered porches, deck, balconies	✓		
21	Raised floor surfaces located more than 30 inches above the floor or grade			✓
22	All exterior and interior shear walls indicated	✓		
23	Shear wall opening shown (Windows, Doors and Garage doors)	✓		
24	Emergency escape and rescue opening shown in each bedroom (net clear opening shown)	✓		
25	Safety glazing of glass where needed	✓		
26	Fireplaces types (gas appliance) (vented or non-vented) or wood burning with Hearth (see chapter 10 of FBCR)	✓		
27	Stairs with dimensions (width, tread and riser and total run) details of guardrails, Handrails (see FBCR SECTION 311)			✓
28	Identify accessibility of bathroom (see FBCR SECTION 322)	✓		

All materials placed within opening or onto/into exterior walls, soffits or roofs shall have Florida product approval number and mfg. installation information submitted with the plan (see Florida product approval form)

GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL		Items to Include- Each Box shall be Circled as Applicable		
---	--	--	--	--

FBCR 403: Foundation Plans

		YES	NO	N/A
29	Location of all load-bearing walls footings indicated as standard, monolithic, dimensions, size and type of reinforcing.	✓		
30	All posts and/or column footing including size and reinforcing	✓		
31	Any special support required by soil analysis such as piling.	✓		
32	Assumed load-bearing value of soil _____ Pound Per Square Foot			
33	Location of horizontal and vertical steel, for foundation or walls (include # size and type)	✓		

FBCR 506: CONCRETE SLAB ON GRADE

34	Show Vapor retarder (6mil. Polyethylene with joints lapped 6 inches and sealed)	✓		
35	Show control joints, synthetic fiber reinforcement or welded fire fabric reinforcement and Supports	✓		

FBCR 320: PROTECTION AGAINST TERMITES

36	Indicate on the foundation plan if soil treatment is used for subterranean termite prevention or submit other approved termite protection methods. Protection shall be provided by registered termiticides	✓		
----	--	---	--	--

FBCR 606: Masonry Walls and Stem walls (load bearing & shear Walls)

37	Show all materials making up walls, wall height, and Block size, mortar type			✓
38	Show all Lintel sizes, type, spans and tie-beam sizes and spacing of reinforcement			✓

Metal frame shear wall and roof systems shall be designed, signed and sealed by Florida Prof. Engineer or Architect

Floor Framing System: First and/or second story

39	Floor truss package shall including layout and details, signed and sealed by Florida Registered Professional Engineer	⓪		✓
40	Show conventional floor joist type, size, span, spacing and attachment to load bearing walls, stem walls and/or piers			✓
41	Girder type, size and spacing to load bearing walls, stem wall and/or piers	⓪		✓
42	Attachment of joist to girder			✓
43	Wind load requirements where applicable			✓
44	Show required under-floor crawl space			✓
45	Show required amount of ventilation opening for under-floor spaces			✓
46	Show required covering of ventilation opening			✓
47	Show the required access opening to access to under-floor spaces			✓
	Show the sub-floor structural panel sheathing type, thickness and fastener schedule on the edges &			✓

48	intermediate of the areas structural panel sheathing			✓
49	Show Draftstopping, Fire caulking and Fire blocking			✓
50	Show fireproofing requirements for garages attached to living spaces, per FBCR section 309			✓
51	Provide live and dead load rating of floor framing systems (psf).			✓

FBCR CHAPTER 6 WOOD WALL FRAMING CONSTRUCTION

GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL		Items to Include- Each Box shall be Circled as Applicable		
		YES	NO	N/A
52	Stud type, grade, size, wall height and oc spacing for all load bearing or shear walls	✓		
53	Fastener schedule for structural members per table FBCR 602.3 are to be shown	✓		
54	Show Wood structural panel's sheathing attachment to studs, joist, trusses, rafters and structural members, showing fastener schedule attachment on the edges & intermediate of the areas structural panel sheathing	✓		
55	Show all required connectors with a max uplift rating and required number of connectors and oc spacing for continuous connection of structural walls to foundation and roof trusses or rafter systems	✓		
56	Show sizes, type, span lengths and required number of support jack studs, king studs for shear wall opening and girder or header per FBCR Table 502.5 (1)	✓		
57	Indicate where pressure treated wood will be placed	✓		
58	Show all wall structural panel sheathing, grade, thickness and show fastener schedule for structural panel sheathing edges & intermediate areas	✓		
59	A detail showing gable truss bracing, wall balloon framing details or/ and wall hinge bracing detail	✓		

FBCR :ROOF SYSTEMS:

60	Truss design drawing shall meet section FBCR 802.10 Wood trusses	✓		
61	Include a layout and truss details, signed and sealed by Florida Professional Engineer	✓		
62	Show types of connector's assemblies' and resistance uplift rating for all trusses and rafters	✓		
63	Show gable ends with rake beams showing reinforcement or gable truss and wall bracing details	✓		
64	Provide dead load rating of trusses	✓		

FBCR 802:Conventional Roof Framing Layout

65	Rafter and ridge beams sizes, span, species and spacing			✓
66	Connectors to wall assemblies' include assemblies' resistance to uplift rating			✓
67	Valley framing and support details			✓
68	Provide dead load rating of rafter system			✓

FBCR Table 602,3(2) & FBCR 803 ROOF SHEATHING

69	Include all materials which will make up the roof decking, identification of structural panel sheathing, grade, thickness	✓		
70	Show fastener Size and schedule for structural panel sheathing on the edges & intermediate areas	✓		

FBCR ROOF ASSEMBLIES FRC Chapter 9

71	Include all materials which will make up the roof assembles covering	✓		
72	Submit Florida Product Approval numbers for each component of the roof assembles covering	✓		

FBCR Chapter 11 Energy Efficiency Code for residential building

Residential construction shall comply with this code by using the following compliance methods in the FBCR chapter 11 Residential buildings compliance methods. *Two of the required forms are to be submitted, showing dimensions condition area equal to the total condition living space area*

GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL		Items to Include- Each Box shall be Circled as Applicable		
		YES	NO	N/A
73	Show the insulation R value for the following areas of the structure	✓		
74	Attic space	✓		
75	Exterior wall cavity	✓		
76	Crawl space	✓		

HVAC information

77	Submit two copies of a Manual J sizing equipment or equivalent computation study	✓		
78	Exhaust fans locations in bathrooms	✓		
79	Show clothes dryer route and total run of exhaust duct	✓		

Plumbing Fixture layout shown

80	All fixtures waste water lines shall be shown on the foundation plan	✓		
81	Show the location of water heater	✓		

Private Potable Water

82	Pump motor horse power	✓		✓
83	Reservoir pressure tank gallon capacity	✓		✓
84	Rating of cycle stop valve if used	✓		✓

Electrical layout shown including

85	Switches, outlets/receptacles, lighting and all required GFCI outlets identified	✓		
86	Ceiling fans	✓		
87	Smoke detectors & Carbon dioxide detectors	✓		
88	Service panel, sub-panel, location(s) and total ampere ratings	✓		
89	On the electrical plans identify the electrical service overcurrent protection device for the main electrical service. This device shall be installed on the exterior of structures to serve as a disconnecting means for the utility company electrical service. Conductors used from the exterior disconnecting means to a panel or sub panel shall have four-wire conductors, of which one conductor shall be used as an equipment ground. Indicate if the utility company service entrance cable will be of the overhead or underground type.	✓		

90	Appliances and HVAC equipment and disconnects	✓		
91	Arc Fault Circuits (AFCI) in bedrooms	✓		

Disclosure Statement for Owner Builders *If you as the applicant will be acting as an owner/builder under section 489.103(7) of the Florida Statutes, submit the required owner builder disclosure statement form.*

Notice Of Commencement

A notice of commencement form **recorded** in the Columbia County Clerk Office is required to be filed with the building department Before Any Inspections can be preformed.

GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL		Items to Include- Each Box shall be Circled as Applicable
---	--	--

THE FOLLOWING ITEMS MUST BE SUBMITTED WITH BUILDING PLANS

		YES	NO	N/A
92	Building Permit Application A current Building Permit Application form is to be completed and submitted for all residential projects			
93	Parcel Number The parcel number (Tax ID number) from the Property Appraiser (386) 758-1084 is required. A copy of property deed is also requested	✓		
94	Environmental Health Permit or Sewer Tap Approval A copy of a approved Columbia County Environmental Health (386) 758-1058			
95	City of Lake City A permit showing an approved waste water sewer tap			✓
96	Toilet facilities shall be provided for all construction sites	✓		
97	Town of Fort White (386) 497-2321 If the parcel in the application for building permit is within the Corporate city limits of Fort White an approval land use development letter issued by the Town of Fort is required to be submitted with the application for a building permit.			✓
98	Flood Information: All projects within the Floodway of the Suwannee or Santa Fe Rivers shall require permitting through the Suwannee River Water Management District, before submitting a application to this office. Any project located within a flood zone where the base flood elevation (100 year flood) has been established shall meet the requirements of Section 8.5.2 of the Columbia County Land Development Regulations. Any project located within a flood zone where the base flood elevation has not been established (Zone A) shall meet the requirements of Section 8.5.3 of the Columbia County Land Development Regulations	✓		
99	CERTIFIED FINISHED FLOOR ELEVATIONS will be required on any project where the base flood elevation (100 year flood) has been established			✓
100	A development permit will also be required. Development permit cost is \$50.00			✓
101	Driveway Connection: If the property does not have an existing access to a public road, then an application for a culvert permit (\$25.00) must be made. If the applicant feels that a culvert is not needed, they may apply for a culvert waiver (\$50.00). All culvert waivers are sent to the Columbia County Public Works Department for approval or denial.	✓		✗
102	911 Address: If the project is located in an area where a 911 address has not been issued, then application for a 911 address must be applied for and received through the Columbia County Emergency Management Office of 911 Addressing Department (386) 758-1125	✓		

Section R101.2.1 of the Florida Building Code Residential:

The provisions of Chapter 1, Florida Building Code, Building shall govern the administration and enforcement of the Florida Building Code, Residential.

Section 105 of the Florida Building Code defines the:

Time limitation of application.

An application for a permit for any proposed work shall be deemed to have been abandoned 180 days after the date of filing, unless such application has been pursued in good faith or a permit has been issued; except that the building official is authorized to grant one or more extensions of time for additional periods not exceeding 90 days each. The extension shall be requested in writing and justifiable cause demonstrated.

Single-family residential dwelling.

Section 105.3.4 A building permit for a single-family residential dwelling must be issued within 30 working days of application therefor unless unusual circumstances require a longer time for processing the application or unless the permit application fails to satisfy the Florida Building Code or the enforcing agency's laws or ordinances.

Permit intent.

Section 105.4.1: A permit issued shall be constructed to be a license to proceed with the work and not as authority to violate, cancel, alter or set aside any of the provisions of the technical codes, nor shall issuance of a permit prevent the building official from thereafter requiring a correction of errors in plans, construction or violations of this code. Every permit issued shall become invalid unless the work authorized by such permit is commenced within six months after its issuance, or if the work authorized by such permit is suspended or abandoned for a period of six months after the time the work is commenced.

If work has commenced.

Section 105.4.1.1: If work has commenced and the permit is revoked, becomes null and void, or expires because of lack of progress or abandonment, a new permit covering the proposed construction shall be obtained before proceeding with the work.

New Permit.

Section 105.4.1.2: If a new permit is not obtained within 180 days from the date the initial permit became null and void, the building official is authorized to require that any work which has been commenced or completed be removed from the building site. Alternately, a new permit may be issued on application, providing the work in place and required to complete the structure meets all applicable regulations in effect at the time the initial permit became null and void and any regulations which may have become effective between the date of expiration and the date of issuance of the new permit.

Work Shall Be:

Section 105.4.1.3: Work shall be considered to be in active progress when the permit has received an approved inspection within 180 days. This provision shall not be applicable in case of civil commotion or strike or when the building work is halted due directly to judicial injunction, order or similar process.

The Fee:

Section 105.4.1.4: The fee for renewal reissuance and extension of a permit shall be set forth by the administrative authority.

When the submitted application is approved for permitting the applicant will be notified by phone as to the date and time a building permit will be prepared and issued by the Columbia County Building & Zoning Department

PRODUCT APPROVAL SPECIFICATION SHEET

Project Name: _____

Location: _____

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and the product approval number(s) on the building components listed below if they will be utilized on the construction project for which you are **applying for a building permit on or after April 1, 2004**. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. More information about statewide product approval can be obtained at www.floridabuilding.org

Category/Subcategory	Manufacturer	Product Description	Approval Number(s)
A. EXTERIOR DOORS			
1. Swinging	General Amer.	Exterior Doors	FL4090
2. Sliding	Gen. American	Exterior Doors	FL4090
3. Sectional	Gen. American	Exterior Doors	FL4090
4. Roll up	CHI	Gauge Door	FL10201
5. Automatic			
6. Other			
B. WINDOWS			
1. Single hung	Alenco	Single Hung Windows	FL1214-R1
2. Horizontal Slider			
3. Casement			
4. Double Hung			
5. Fixed			
6. Awning			
7. Pass-through			
8. Projected			
9. Mullion			
10. Wind Breaker			
11 Dual Action			
12. Other			
C. PANEL WALL			
1. Siding			
2. Soffits			
3. EIFS			
4. Storefronts			
5. Curtain walls			
6. Wall louver			
7. Glass block			
8. Membrane			
9. Greenhouse			
10. Other			
D. ROOFING PRODUCTS			
1. Asphalt Shingles	EIK	Raised Profile	Specifications Attached
2. Underlayments			
3. Roofing Fasteners			
4. Non-structural Metal Rf			
5. Built-Up Roofing			
6. Modified Bitumen			
7. Single Ply Roofing Sys			
8. Roofing Tiles			
9. Roofing Insulation			
10. Waterproofing			
11. Wood shingles /shakes			
12. Roofing Slate			

Category/Subcategory (cont.)	Manufacturer	Product Description	Approval Number(s)
13. Liquid Applied Roof Sys			
14. Cements-Adhesives – Coatings			
15. Roof Tile Adhesive			
16. Spray Applied Polyurethane Roof			
17. Other			
E. SHUTTERS			
1. Accordion			
2. Bahama			
3. Storm Panels			
4. Colonial			
5. Roll-up			
6. Equipment			
7. Others			
F. SKYLIGHTS			
1. Skylight			
2. Other			
G. STRUCTURAL COMPONENTS			
1. Wood connector/anchor			
2. Truss plates			
3. Engineered lumber			
4. Railing			
5. Coolers-freezers			
6. Concrete Admixtures			
7. Material			
8. Insulation Forms			
9. Plastics			
10. Deck-Roof			
11. Wall			
12. Sheds			
13. Other			
H. NEW EXTERIOR ENVELOPE PRODUCTS			
1.			
2.			

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) the performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufacturers installation requirements.

I understand these products may have to be removed if approval cannot be demonstrated during inspection.

Contractor or Contractor's Authorized Agent Signature

Print Name

Date

Permit # (FOR STAFF USE ONLY)

FLORIDA DEPARTMENT OF Community Affairs



[DCA HOME](#) [ABOUT DCA](#) [DCA PROGRAMS](#)

[BCIS Home](#) | [Log In](#) | [Hot Topics](#) | [Submit Surcharge](#) | [Stats & Facts](#) | [Publications](#) | [FBC Staff](#) | [BCIS Site Map](#) | [L](#)



Product Approval

USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

COMMUNITY PLANNING

HOUSING & COMMUNITY DEVELOPMENT

EMERGENCY MANAGEMENT

OFFICE OF THE SECRETARY

FL # FL1214-R1
Application Type Revision
Code Version 2004
Application Status Approved
Comments
Archived ☐

Product Manufacturer Alenco
Address/Phone/Email 615 Carson
Bryan, TX 77802
(979) 779-7770 ext 343
mkoppers@alenco.com

Authorized Signature Martin Koppers
mkoppers@alenco.com

Technical Representative Martin Koppers
Address/Phone/Email 615 Carson St.
Bryan, TX 77802
mkoppers@alenco.com

Quality Assurance Representative
Address/Phone/Email

Category Windows
Subcategory Single Hung

Compliance Method Certification Mark or Listing

Certification Agency National Accreditation & Management Institute,

Referenced Standard and Year (of **Standard**

Standard)

AAMA/NWWDA 101/I.S.2

Equivalence of Product Standards
Certified By

Sections from the Code

1707.4.2.1

Product Approval Method

Method 1 Option A

Date Submitted

06/08/2005

Date Validated

08/04/2005

Date Pending FBC Approval

06/18/2005

Date Approved

08/05/2005

Summary of Products

FL #	Model, Number or Name	Description
1214.1	1111	Vinyl Tilt Single Hung
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: 1111: 48X72 R(35) Tested with DS annealed, 44X72 R(40) Tested with SS annealed. For smaller window sizes, glass to comply with ASTM E1300-02.		Certification Agency Certificate Installation Instructions PTID 1214 R1 I FL INSTALLATION INSTRUCTIONS - Aluminum B.pdf PTID 1214 R1 I INSTALLATION INSTRUCTIONS - Vinyl B.pdf Verified By:
1214.2	3753	Aluminum Tilt Single Hung
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: 3753: 44X72 R(40) Tested with Tested with DS annealed. For smaller window sizes, glass to comply with ASTM E1300-02.		Certification Agency Certificate Installation Instructions Verified By:
1214.3	4710F	Aluminum Single Hung
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: 4710F: 48X72 R(40)/DP(50), Tested with DS annealed glass. For smaller window sizes, glass to comply with ASTM E1300-02.		Certification Agency Certificate Installation Instructions Verified By:

Back

Next

DCA Administration

**Department of Community Affairs
Florida Building Code Online
Codes and Standards**

2555 Shumard Oak Boulevard
Tallahassee, Florida 32399-2100

(850) 487-1824, Suncom 277-1824, Fax (850) 414-8436

© 2000-2005 The State of Florida. All rights reserved. Copyright and Disclaimer

Product Approval Accepts:



C.H.

Project Information

For: Mike Roberts
Lake City, FL

Design Information

	Htg	Clg	Infiltration	Simplified
Outside db (°F)	33	92	Method	Average
Inside db (°F)	70	75	Construction quality	0
Design TD (°F)	37	17	Fireplaces	
Daily range	-	M		
Inside humidity (%)	-	50		
Moisture difference (gr/lb)	-	52		

HEATING EQUIPMENT

Make Tempstar
Trade NHP Series
Model NHP230A(G)KC*
Efficiency 7 HSPF
Heating input 29000 Btuh @ 47°F
Heating output 28 °F
Temperature rise 933 cfm
Actual air flow 0.036 cfm/Btuh
Air flow factor 0.10 in H2O
Static pressure
Space thermostat

COOLING EQUIPMENT

Make Tempstar
Trade NHP Series
Cond NHP230A(G)KC*
Coil EX*36F****+MV12F19****
Efficiency 13 SEER
Sensible cooling 19600 Btuh
Latent cooling 8400 Btuh
Total cooling 28000 Btuh
Actual air flow 933 cfm
Air flow factor 0.043 cfm/Btuh
Static pressure 0.10 in H2O
Load sensible heat ratio 0.66

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
master bed	210	4255	3989	152	171
master bath	79	2445	959	87	41
master closet	74	826	353	30	15
kitchen	130	1394	2299	50	99
dinning rm	130	2574	3098	92	133
living rm	338	5415	5184	194	223
bedrm 2	204	4342	2727	155	117
bedrm 3	167	3928	2549	140	109
bath	41	720	264	26	11
core	136	195	309	7	13

Printout certified by ACCA to meet all requirements of Manual J 8th Ed.

Entire House	d	1508	26093	21731	933	933
Other equip loads			8897	4088		
Equip. @ 0.97 RSM				25044		
Latent cooling				13016		
TOTALS		1508	34990	38060	933	933

Printout certified by ACCA to meet all requirements of Manual J 8th Ed.



wrightsoft

Right-Suite Residential 6.0.22 RSR29811


2010-Jan-07 08:27:53

C:\My Documents\Wrightsoft HVAC\Template\default.rtf Calc = MJ8 Orientation = N

Page 2

**ELK**

ROOFING PRODUCTS SPECIFICATIONS — TUSCALOOSA, AL

**PRESTIQUE®
HIGH DEFINITION®****RAISED PROFILE®****Prestique Plus High Definition
and Prestique Gallery Collection™**

Product size _____ 13¼" x 39"
 Exposure _____ 5"
 Pieces/Bundle _____ 16
 Bundles/Square _____ 4/98.5 sq.ft.
 Squares/Pallet _____ 11

50-year limited warranty period:
 5-7**years non-prorated coverage for
 shingles and application labor with
 prorated coverage for remainder of
 limited warranty period, plus an
 option for transferability*. 5-year
 limited wind warranty*. Wind
 Coverage: standard 80 mph, extended
 110 mph***

Raised Profile

Product size _____ 13¼" x 38"
 Exposure _____ 5"
 Pieces/Bundle _____ 22
 Bundles/Square _____ 3/100 sq.ft.
 Squares/Pallet _____ 16

30-year limited warranty period:
 5-7**years non-prorated coverage for
 shingles and application labor with
 prorated coverage for remainder of
 limited warranty period, plus an
 option for transferability*. 5-year
 limited wind warranty*. Wind
 Coverage: standard 70 mph.

Prestique I High Definition

Product size _____ 13¼" x 39"
 Exposure _____ 5"
 Pieces/Bundle _____ 16
 Bundles/Square _____ 4/98.5 sq.ft.
 Squares/Pallet _____ 14

40-year limited warranty period:
 5-7**years non-prorated coverage for
 shingles and application labor with
 prorated coverage for remainder of
 limited warranty period, plus an
 option for transferability*. 5-year
 limited wind warranty*. Wind
 Coverage: standard 80 mph, extended
 90 mph***

HIP AND RIDGE SHINGLES**Seal-A-Ridge® w/FLX™**

Size: 12" x 12"
 Exposure: 6"
 Pieces/Bundle: 45
 Coverage: 4 Bundles =
 100 linear feet

Vented RidgeCrest™ w/FLX®

Size: 13" x 13"
 Exposure: 9"
 Pieces/Box: 26
 Coverage: 5 boxes =
 100 linear feet

Prestique High Definition

Product size _____ 13¼" x 38"
 Exposure _____ 5"
 Pieces/Bundle _____ 22
 Bundles/Square _____ 3/100 sq.ft.
 Squares/Pallet _____ 16

30-year limited warranty period:
 5-7**years non-prorated coverage for
 shingles and application labor with
 prorated coverage for remainder of
 limited warranty period, plus an
 option for transferability*. 5-year
 limited wind warranty*. Wind
 Coverage: standard 80 mph.

Elk Starter Strip

52 Bundles/Pallet
 18 Pallets/Truck
 936 Bundles/Truck
 19 Pieces/Bundle
 1 Bundle = 120.33 linear feet

Available Colors (Check Availability): Antique Slate, Weatheredwood, Shakeswood, Sablewood, Hickory, Barkwood, Forest Green, Wedgewood, Birchwood, Sandalwood.
 Gallery Collection: Balsam Forest®, Weathered Sage®, Sienna Sunset®.

All Prestique, Raised Profile and Seal-A-Ridge, and Prestique Starter Strip roofing products contain sealant which activates with the sun's heat, bonding shingles into a wind and weather resistant cover that resists blow-offs and leaks.

Check for availability with built-in StainGuard® treatment to inhibit the discoloration of roofing granules caused by the growth of certain types of algae.

All Prestique and Raised Profile shingles meet UL® Wind Resistant (UL 997) and Class "A" Fire Ratings (UL 790);
 and ASTM Specifications D 3918, Type-I; D 3161, Type-I; E 108 and the requirements of ASTM D 3462.

All Prestique and Raised Profile shingles have approval from the Florida Building Code Commission, Metro-Dade County, ICBO, and Texas Department of Insurance.

*See actual limited warranty for conditions and limitations.

** Effective January 1, 2004, the seven year non-prorated Umbrella Coverage Period applies only when a full Elk Roof System is installed with the original installation of the Elk shingles, all in accordance with Elk's application instructions for such products. A full Elk roof system includes Elk Hip and Ridge shingles on all hips and ridges, Elk Starter Strip along all rake and eave edges, an Elk ventilation system, and Elk All-Climate Self-Adhering Underlayment in all valleys. Additionally, Elk All-Climate Self-Adhering Underlayment is required along the rake and eave edges of the roof in and north of the states of VA, KY, MO, KS, CO, UT, NV, & OR.

***For a limited Wind Warranty up to 110 mph for Prestique Gallery Collection, Prestique Plus, or 90 mph for Prestique I or Grandé, at least six (6) properly placed NAILS and Elk Starter Strip shingles are required. See application instructions printed on the shingle wrapper for additional requirements.

SPECIFICATIONS

SCOPE: Work includes furnishing all labor, materials and equipment necessary to complete installation of (name) shingles specified herein. Color shall be (name of color). Hip and ridge type to be Elk Seal-A-Ridge with formula FLX.

All exposed metal surfaces (flashing, vents, etc.) to be painted with matching Elk roof accessory paint.

PREPARATION OF ROOF DECK: Roof deck to be dry, well-seasoned 1" x 6" (25.4mm x 152.4mm) boards; exterior-grade plywood (exposure 1 rated sheathing) at least 3/8" (9.525mm) thick conforming to the specifications of the American Plywood Association; 7/16" (11.074mm) oriented strandboard; or chipboard. Most fire retardant plywood decks are NOT approved substrates for Elk shingles. Consult Elk Field Service for application specifications over other decks and other slopes.

Materials: Underlayment for standard roof slopes, 4" per foot (101.6/304.8mm) or greater; apply non-perforated No. 15 or 30 asphalt-saturated felt underlayment. For Low slopes[4" per foot (101.6/304.8mm) to a minimum of 2" per foot (50.8/304.8mm)], use two plies of underlayment overlapped a minimum of 19". Fasteners shall be of sufficient length and holding power for securing material as required by the application instructions printed on shingle wrapper.

For areas where algae is a problem, shingles shall be (name) with StainGuard treatment, as manufactured by the Elk Tuscaloosa plant. Hip and ridge type to be Seal-A-Ridge with formula FLX with StainGuard treatment.

Complete application instructions are published by Elk and printed on the back of every shingle bundle. All warranties are contingent upon the correct installation as shown on the instructions. These instructions are the minimum required to meet Elk application requirements. In some areas, building codes may require additional application techniques or methods beyond our instructions. In these cases, the local code must be followed. Under no circumstances will Elk accept application requirements less than those contained in its application instructions.

For specifications in CSI format, call 800.354.SPEC (7732) or e-mail specinfo@elkcorp.com.

**SOUTHEAST &
ATLANTIC OFFICE:**
800.945.5551


CORPORATE HEADQUARTERS:
800.354.7732

PLANT LOCATION:
800.945.5545

ELK
The Premium Choice®
www.elkcorp.com
SS00T 06/04

DIRECTIONS FOR APPLICATION

Please read carefully. Failure to follow these instructions may void the product warranty. (Typical construction; for illustration purposes only)

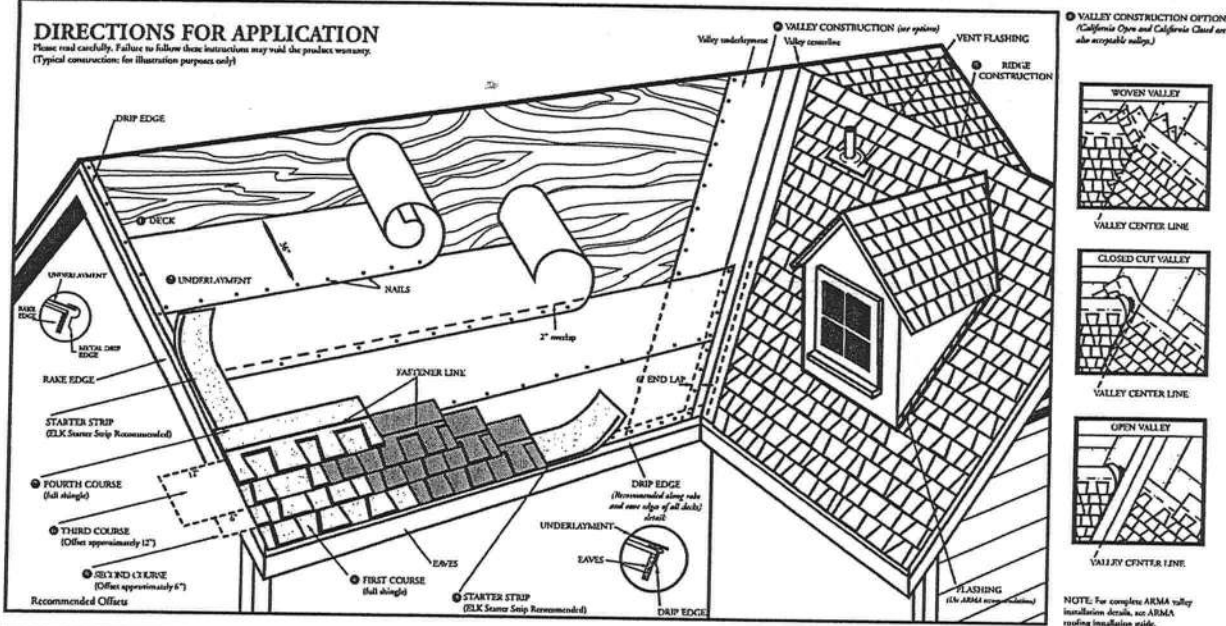

DIRECTIONS FOR APPLICATION

These application instructions are the minimum required to meet Elk's application requirements. Your failure to follow these instructions may void the product warranty. In some areas, the building codes may require additional application techniques or methods beyond our instructions. In these cases, the local code must be followed. Under no circumstances will Elk accept application requirements that are less than those printed here. Shingles should not be jammed tightly together. All attics should be properly ventilated. Note: It is not necessary to remove tape on back of shingle.

1 DECK PREPARATION

Roof decks should be dry, well-seasoned 1" x 6" boards or exterior grade plywood minimum 3/8" thick and conform to the specifications of the American Plywood Association or 7/16" oriented strandboard, or 7/16" chipboard.

2 UNDERLAYMENT

Apply underlayment (Non-Perforated No. 15 or 30 asphalt saturated felt, Elk Versashield® or self adhering underlayment is also acceptable. Cover drip edge at eaves only.

For low slope (2/12 up to 4/12), completely cover the deck with two plies of underlayment overlapping a minimum of 19". Begin by fastening a 19" wide strip of underlayment placed along the eaves. Place a full 36" wide sheet over the starter, horizontally placed along the eaves and completely overlapping the starter strip.

EAVE FLASHING FOR ICE DAMS (ASK A ROOFING CONTRACTOR, REFER TO ARMA MANUAL OR CHECK LOCAL CODES)

For standard slope (4/12 to less than 21/12), use coated roll roofing of no less than 50 pounds over the felt underlayment extending from the eave edge to a point at least 24" beyond the inside wall of the living space below or one layer of a self-adhered eave and flashing membrane.

For low slope (2/12 up to 4/12), use a continuous layer of asphalt plastic cement between the two plies of underlayment from the eave edge up roof to a point at least 24" beyond the inside wall of the living space below or one layer of a self-adhered eave and flashing membrane.

Consult the Elk Technical Services Department for application specifications over other decks and other slopes.

3 STARTER SHINGLE COURSE

USE AN ELK STARTER STRIP OR THE HEADLAP OF A STRIP SHINGLE WITH THE ADHESIVE STRIP POSITIONED AT THE EAVE EDGE. With at least 3" trimmed from the end of the first shingle, start at the rake edge overhanging the eave and rake edges 1/2" to 3/4". Fasten 2" from the lower edge and 1" from each side.

4 FIRST COURSE

Start at rake and continue course with full shingles laid flush with the starter course. Shingles may be applied with a course alignment of 45° on the roof.

5 SECOND COURSE

Offset the second course of shingles with respect to the first by approximately 6". Other offsets are approved if greater than 4".

6 THIRD COURSE

Offset the next course by 6" with respect to the second course, or consistent with the original offset.

7 FOURTH COURSE

Start at the rake and continue with full shingles across roof.

FIFTH AND SUCCEEDING COURSES.

Repeat application as shown for second, third, and fourth courses. Do not rack shingles straight up the roof. Offsets may be adjusted around valleys and penetrations.

8 VALLEY CONSTRUCTION

Open, woven and closed cut valleys are acceptable when applied by Asphalt Roofing Manufacturing Association (ARMA) recommended procedures. For metal valleys, use 36" wide vertical underlayment prior to applying metal flashing (secure edge with nails). No nails are to be within 6" of valley center.

9 RIDGE CONSTRUCTION

For ridge construction Elk recommends Class "A" Z-Ridge or Seal-A-Ridge® with formula FLX™ or RidgeCrest™ with FLX (See ridge package for installation instructions). Vented RidgeCrest or 3-tab shingles are also approved.

FASTENERS

While nailing is the preferred method for Elk shingles, Elk will accept fastening methods according to the following instructions.

Using the fastener line as a reference, nail or staple the shingle in the double thickness common bond area. For shingles without a fastener line, nails or staples must be placed between and/or in the sealant dots.

NAILS: Corrosive resistant, 3/8" head, minimum 12-gauge roofing nails. Elk recommends 1-1/4" for new roofs and 1-1/2" for re-roofs. In cases where you are applying shingles to a roof that has an exposed overhang, for new roofs only, 3/4" ring shank nails are allowed to be used from the eave's edge to a point up the roof that is past the outside wall line. 1" ring shank nails allowed for re-roof.

STAPLES: Corrosive resistant, 16-gauge minimum, crown width minimum of 15/16". Note: An improperly adjusted staple gun can result in raised staples that can cause a fish-mouthed appearance and can prevent sealing.

Fasteners should be long enough to obtain 3/4" deck penetration or penetration through deck, whichever is less. This product meets the requirements of the IRC 2003 code when fastened with 4 nails.

MANSARD APPLICATIONS


Correct fastening is critical to the performance of the roof. For slopes exceeding 60° (or 21/12) use six fasteners per shingle. Locate fasteners in the fastener area 1" from each side edge with the remaining four fasteners equally spaced along the length of the double thickness (laminated) area. Only fastening methods according to the above instructions are acceptable.

LIMITED WIND WARRANTY

- For a Limited Wind Warranty, all Prestique and Raised Profile™ shingles must be applied with 4 properly placed fasteners, or in the case of mansard applications, 6 properly placed fasteners per shingle.
- For a Limited Wind Warranty up to 110 MPH for Prestique Gallery Collection or Prestique Plus or 90 MPH for Prestique I, shingles must be applied with 6 properly placed NAILS per shingle. SHINGLES APPLIED WITH STAPLES WILL NOT QUALIFY FOR THIS ENHANCED LIMITED WIND WARRANTY. Also, Elk Starter Strip shingles must be applied at the eaves and rake edges to qualify Prestique Plus, Prestique Gallery Collection and Prestique I shingles for this enhanced Limited Wind Warranty. Under no circumstances should the Elk Shingles or the Elk Starter Strip overhang the eaves or rake edge more than 3/4" of an inch.

HELP STOP BLOW-OFFS AND CALL-BACKS

A minimum of four fasteners must be driven into the DOUBLE THICKNESS (laminated) area of the shingle. Nails or staples must be placed along – and through – the "fastener line" or on products without fastener lines, nail or staple between and in line with sealant dots. CAUTION: Do not use fastener line for shingle alignment.

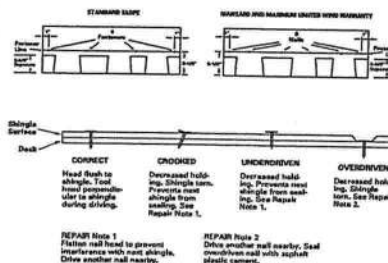


Refer to local codes which in some areas may require specific application techniques beyond those Elk has specified.

All Prestique and Raised Profile shingles have a U.L.® Wind Resistance Rating when applied in accordance with these instructions using nails or staples on re-roofs as well as new construction.


CAUTION TO WHOLESALER: Careless and improper storage or handling can harm fiberglass shingles. Keep these shingles completely covered, dry, reasonably cool, and protected from the weather. Do not store near various sources of heat. Do not store in direct sunlight until applied. DO NOT DOUBLE STACK. Systematically rotate all stock so that the material that has been stored the longest will be the first to be moved out.

ELK
The Premium Choice®
www.elkcorp.com

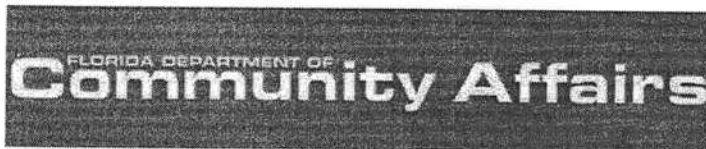
[DCA HOME](#) | [ABOUT DCA](#) | [DCA PROGRAMS](#) | [CONTACT DCA](#)

[BCIS Home](#) | [Log In](#) | [Hot Topics](#) | [Submit Surcharge](#) | [Stats & Facts](#) | [Publications](#) | [FBC Staff](#) | [BCIS Site Map](#) | [Links](#) | [Search](#)
**Product Approval**

USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**


FL #	FL4090
Application Type	New
Code Version	2004
Application Status	Approved
Comments	
Archived	<input type="checkbox"/>
Product Manufacturer	General American Door
Address/Phone/Email	5050 Baseline Rd Montgomery, IL 60538 (630) 859-3000 ext 175 j.campbell@hoermann-gadco.com
Authorized Signature	James Campbell j.campbell@hoermann-gadco.com
Technical Representative	
Address/Phone/Email	
Quality Assurance Representative	
Address/Phone/Email	
Category	Exterior Doors
Subcategory	Sectional Exterior Door Assemblies
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer <input checked="" type="checkbox"/> Evaluation Report - Hardcopy Received
Florida Engineer or Architect Name who developed the Evaluation Report	Naser R. Keyvan
Florida License	PE- 53774
Quality Assurance Entity	Intertek Testing Services NA Inc
Validated By	John E. Scates, PE
Certificate of Independence	
Referenced Standard and Year (of Standard)	Standard ANSI / DASMA 108-2002
	Year 2002
Equivalence of Product Standards Certified By	
Sections from the Code	1707.4

Product Approval Method	Method 1 Option D
Date Submitted	02/21/2005
Date Validated	03/03/2005
Date Pending FBC Approval	03/07/2005
Date Approved	03/16/2005

Summary of Products

Go to Page



Page 1 / 2



FL #	Model, Number or Name	Description
4090.1	7100 and 7200	up to 16' wide, dwg J18242 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-42.2psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports PTID 4090 T evaluation.pdf PTID 4090 T install 4324 4420 4520 4616 4726 7624.pdf PTID 4090 T install 7100.pdf PTID 4090 T install 7400.pdf PTID 4090 T install 7926 7825 7524 4126.pdf PTID 4090 T install 9001.pdf PTID 4090 T install post.pdf PTID 4090 T install PRESIDENTIAL.pdf PTID 4090 T J15350.pdf PTID 4090 T J15434.pdf PTID 4090 T J15542.pdf PTID 4090 T J15654.pdf PTID 4090 T J15755.pdf PTID 4090 T J15855.pdf PTID 4090 T J15960.pdf PTID 4090 T J16035.pdf PTID 4090 T J16137.pdf PTID 4090 T J16255.pdf PTID 4090 T J16350.pdf PTID 4090 T J16434.pdf PTID 4090 T J16565.pdf PTID 4090 T J16642.pdf PTID 4090 T J16755.pdf PTID 4090 T J16850.pdf PTID 4090 T J16961.pdf PTID 4090 T J17034.pdf PTID 4090 T J17122.pdf PTID 4090 T J17242.pdf PTID 4090 T J17342.pdf PTID 4090 T J17442.pdf PTID 4090 T J17542.pdf PTID 4090 T J17637.pdf PTID 4090 T J17737.pdf PTID 4090 T J17820.pdf PTID 4090 T J17920.pdf PTID 4090 T J18037.pdf PTID 4090 T J18142.pdf PTID 4090 T J18242.pdf PTID 4090 T label door.pdf PTID 4090 T label post.PDF
4090.2	7100 and 7200	up to 10' wide, dwg J18142 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-42.2psf, not for use in high		Installation Instructions Verified By: Evaluation Reports

velocity hurricane zones		
4090.3	7100 and 7200	up to 10' wide, dwg J18037 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-37psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.4	7100 and 7200	up to 16' wide, dwg J17920 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-20psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.5	7825, 7624, 7524, 7400, 4726, 4420, 4324, and 4126	up to 16' wide, dwg J17034 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +34.8/-37.1psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.6	7825, 7624, 7524, 7400, 4726, 4420, 4324, and 4126	up to 18' wide, dwg J15855 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +55/-57psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.7	7825, 7624, 7524, 7400, 4726, 4420, 4324, and 4126	up to 9' wide, dwg J15654 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-54psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.8	Freedom	up to 18' wide, dwg J17542 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-42.2psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.9	Freedom	up to 16' wide, dwg J17442 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-42.2psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports

4090.10	Freedom	up to 10' wide, dwg J17342 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-42.2psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.11	Freedom	up to 8' wide, dwg J17242 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-42.2psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.12	Freedom	up to 10' wide, dwg J17637 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-37psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.13	Freedom	up to 8' wide, dwg J17737 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-37psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.14	Freedom	up to 16' wide, dwg J17122 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-22.5psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.15	Freedom	up to 16' wide, dwg J17820 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-20psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.16	Presidential	up to 10' wide, dwg J16565 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +/-66psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.17	Presidential	up to 9' wide, dwg J16961 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant:		Installation Instructions Verified By: Evaluation Reports

Design Pressure: +/- Other: up to +61/-67psf, not for use in high velocity hurricane zones		
4090.18	Presidential	up to 10' wide, dwg J15960 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +60/-64psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.19	Presidential	up to 16' wide, dwg J16255 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +55/-61psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
4090.20	Presidential	up to 16' wide, dwg J15755 rev -
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: up to +55/+61psf, not for use in high velocity hurricane zones		Installation Instructions Verified By: Evaluation Reports
Go to Page <input type="text"/> <input type="button" value="GO"/>		
Page 1 / 2		

[Back](#)[Next](#)

DCA Administration

Department of Community Affairs
Florida Building Code Online
Codes and Standards

2555 Shumard Oak Boulevard
Tallahassee, Florida 32399-2100

(850) 487-1824, Suncom 277-1824, Fax (850) 414-8436

© 2000-2005 The State of Florida. All rights reserved. [Copyright and Disclaimer](#)

Product Approval Accepts:

ITW Building Components Group, Inc.

1950 Marley Drive Haines City, FL 33844
Florida Engineering Certificate of Authorization Number: 0 278
Florida Certificate of Product Approval # FL1999
Page 1 of 1 Document ID: 1U108228Z0316155426

Truss Fabricator: Anderson Truss Company
Job Identification: 10-090--Fill in later MIKE ROBERTS -- , **
Truss Count: 30
Model Code: Florida Building Code 2007 and 2009 Supplement
Truss Criteria: FBC2007Res/TPI-2002(STD)
Engineering Software: Alpine Software, Version 9.05.
Structural Engineer of Record: The identity of the structural EOR did not exist as of
Address: the seal date per section 61G15-31.003(5a) of the FAC
Minimum Design Loads: Roof - 40.0 PSF @ 1.25 Duration
Floor - N/A
Wind - 110 MPH ASCE 7-05 -Closed

Notes:

1. Determination as to the suitability of these truss components for the structure is the responsibility of the building designer/engineer of record, as defined in ANSI/TPI 1
2. The drawing date shown on this index sheet must match the date shown on the individual truss component drawing.
3. As shown on attached drawings; the drawing number is preceded by: HCUSR8228

Details: BRCLBSUB-A1101505-GBLLETIN-




Seal Date: 04/16/2010

-Truss Design Engineer-
James F. Collins Jr.
Florida License Number: 52212
1950 Marley Drive
Haines City, FL 33844

#	Ref	Description	Drawing#	Date
1	78103--H7A		10106029	04/16/10
2	78104--H9A		10106020	04/16/10
3	78105--H11A		10106026	04/16/10
4	78106--A		10106027	04/16/10
5	78107--HM7A		10106017	04/16/10
6	78108--HM9A		10106002	04/16/10
7	78109--HS11A		10106011	04/16/10
8	78110--HS13A		10106004	04/16/10
9	78111--HS15A		10106014	04/16/10
10	78112--AS1		10106028	04/16/10
11	78113--AS2		10106012	04/16/10
12	78114--AS3		10106003	04/16/10
13	78115--AS4		10106013	04/16/10
14	78116--AS5		10106016	04/16/10
15	78117--AV1		10106022	04/16/10
16	78118--AV		10106004	04/16/10
17	78119--BGE		10106015	04/16/10
18	78120--B		10106018	04/16/10
19	78121--B1		10106019	04/16/10
20	78122--B5H		10106024	04/16/10
21	78123--B3H		10106021	04/16/10
22	78124--H7C		10106008	04/16/10
23	78125--C		10106005	04/16/10
24	78126--EJ3		10106023	04/16/10
25	78127--CJ1		10106006	04/16/10
26	78128--HJ7		10106010	04/16/10
27	78129--HJ3		10106025	04/16/10
28	78130--CJ3		10106007	04/16/10
29	78131--CJ5		10106001	04/16/10
30	78132--EJ7		10106009	04/16/10



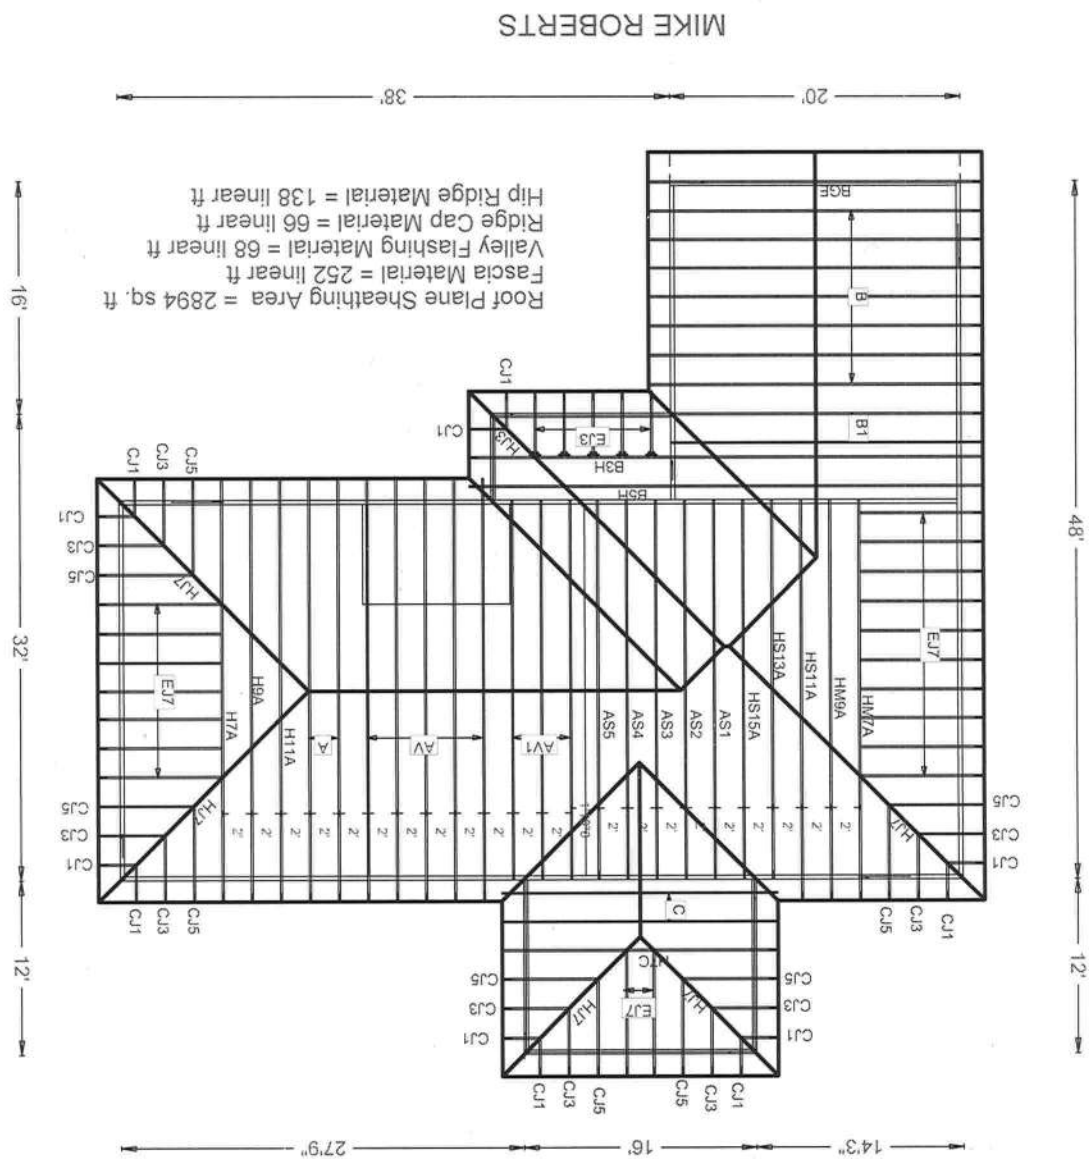

In lieu of structural panels use purlins to brace all flat TC @ 24" OC.

Wind reactions based on MMFRS pressures.
#1 hip supports 7-0-0 jacks with no webs.
Deflection meets L/240 live and L/180 total load.



Design Crit: FBC2007Res/TPI-2002(STD)
FT/RT=20%(0%)/0(0)

$$FT/RT=20\%(0\%)/0(0)$$

9.05.00.


QTY:1

FL/-/4/-/-/R/-/

Scale = .25"/Ft.


WARNING: ALL FRAMES BEHIND EXTERIOR GLASS IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND OPERATING MUST BE KEPT IN THE FOLLOWING CONDITION (SEE THE FOLLOWING INFORMATION). PUBLISHED BY IFI (FRASS PLATE INSTITUTE), 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND NICH (GOOD TRUSS COUNCIL OF AMERICA), 65000 INTERSTATE LANE, MIDDLETON, WI, 53517 FOR SAFETY PRACTICES PLEASE REFER TO PERFORMING THE CORRECTIONS. INFORMATION INDICATED FOR GOOD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PARTS AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED CHORD CEILING.

ALPINE



ALPINE

Haines City, FL 33844
FL COA #0278

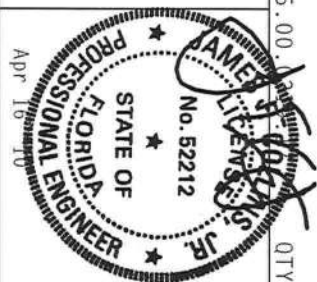

TC LL	20.0 PSF	REF R8228- 78103
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUR8228 10106029
BC LL	0.0 PSF	HC-ENG SSB/AP
TOT.LD.	40.0 PSF	SEQN- 104071
DUR.FAC.	1.25	
SPACING	24.0"	JREF - 1U108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, closed bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI(+/-)=0.18

Wind reactions based on MFRS pressures.

Bottom chord checked for 10.00 psf non-concurrent live load.

Deflection meets L/240 live and L/180 total load.




QTY:1 FL/-/4/-/-/R/-/

Scale = .25" / Ft.

ITW Building Components Group Inc.

Haines City, FL 33844

FL COA #0 278

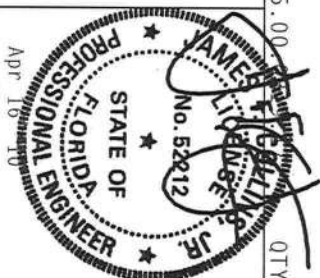

TC LL	20.0 PSF	REF	R8228- 78104
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCU8R8228 10106020
BC LL	0.0 PSF	HC-ENG	SSB/AP *
TOT.LD.	40.0 PSF	SEQN-	104081
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	IU108228Z03

110 mph wind, 15.00 ft mean hgt., ASCE 7-05, closed bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, $I_w=1.00$ GCFI(+/-)=0.18

Wind reactions based on MMFRS pressures.

Bottom chord checked for 10.00 psf non-concurrent live load.

Deflection meets L/240 live and L/180 total load.

~~9.05.06.73~~

QTY: 1

$$FL / - / 4 / - / - / R / -$$

Scale = .25" / ft.

QTY: 1

TC LL	20.0 PSF
TC DL	10.0 PSF
BC DL	10.0 PSF

REF	R8228 - 78105
DATE	04/16/10
DBM	HCU8R8228 10106026


TC LL	20.0 PSF	REF	R8228 - 78105
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106026
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN -	104090
DUR.FAC.	1.25		
SPACING	24.0"	JREF -	1U108228Z03

THIS WORK PREPARED FROM COMPUTER INPUT (LUAUS & DIMENSIONS) SUBMITTED BY IKUZO MTK.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, $I_w=1.00$ Gcpi (+/-)=0.18

Wind reactions based on MWFRS pressures.

Bottom chord checked for 10.00 psf non-concurrent live load.
Deflection meets L/240 live and L/180 total load.



****IMPORTANT*** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT

FI 70A #0 778




110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT 11, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ gcpi (+/-)=0.18

Wind reactions based on MMFRS pressures.

Right end vertical not exposed to wind pressure.

Bottom chord checked for 10.00 psf non-concurrent live load.

MMFRS loads based on trusses located at least 7.50 ft. from roof edge



Design Crit: FBC2007Res/TP1-2002(STD)
FT/RT=20%(0%)/0(0)

Q1Y:1

$$\frac{1}{L} \left(\frac{1}{4} - \frac{1}{R} \right)$$
$$\text{Scale} = .25 / \text{Fl.}$$

WARNING: THESE PRODUCTS REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND DRIPPING. REFER TO GC51 (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY THE FIBREGLASS PANEL INSTITUTE, 210 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND GC60 (DROPPING CONDUCT) OF AMERICA, 6100 ENTERPRISE LANE, MOULTON, MI 48157 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP COVER SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM COVER SHALL HAVE PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITM BCG, INC. SHALL NOT**


TP1; OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF MDS (NATIONAL DESIGN SPEC., BY AREA) AND U.P.I., THE BOARD OF TECHNICAL EDUCATION HAS MADE AN ATTEMPT TO BRING THE DESIGN OF THE STRUCTURE INTO LINE WITH THE REQUIREMENTS OF THE NATIONAL DESIGN SPECIFICATION FOR STEEL STRUCTURES.

ANY INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PER ANNEX A3 OF TP11-2002 SEC.3. A SEAL ON THIS PLATES TO EACH PAIR OF HOLES AND, UNLESS OTHERWISE SPECIFIED ON THE DRAWING, 2-28 FROM THE CENTERLINE OF THE HOLES.

DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE

BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

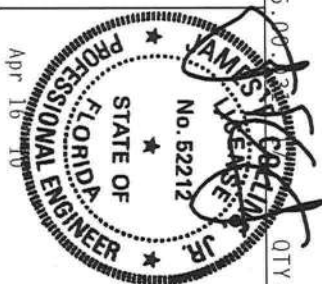

TC LL	20.0 PSF	REF	R8228- 78108
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106002
BC LL	0.0 PSF	HC-ENG	SSB/AP *
TOT.LD.	40.0 PSF	SEQN-	104163
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1U108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCP(+)=0.18

Wind reactions based on MMF-RS pressures.

Right end vertical not exposed to wind pressure.

Bottom chord checked for 10.00 psf non-concurrent live load.

MMFRS loads based on trusses located at least 7.50 ft. from roof edge.



Design Crit: FBC2007Res/TPI-2002(Std)
FT/RT=20%(0%)/0(0)

9.05.00

QTY: 10

$$t_L / - / 4 / - / - / R / -$$

Scale = .25'/ft.

WARNING: THESE PRODUCTS REQUIRE CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. SEE THE INSTRUCTIONS FOR EACH PRODUCT. IF YOU DO NOT HAVE THE NECESSARY SKILLS, EXPERIENCE OR TOOLS, REFER TO DCSP (BUILDING CONSTRUCTION SAFETY IN THE OCEANOGRAPHY), PUBLISHED BY THE U.S. COAST GUARD, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA. 22314, (800) 468-6000. TRUSS COMPANY OF AMERICA, INC. 6500 INTERSTATE 4E, SALT SPRING, FL 32189. FOR SAFETY PRACTICES, PLEASE REFER TO THE SAFETY MANUALS OF THE U.S. COAST GUARD. THE FOLLOWING INFORMATION IS NOT INTENDED TO BE A SUBSTITUTE FOR THE INSTRUCTIONS INDICATED FOR EACH PRODUCT. ALL PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED RIGID CEILING.

TC LL	20.0 PSF
TC DL	10.0 PSF
BC DL	10.0 PSF

REF	R8228 - 78109
DATE	04/16/10
DRW	HCUISR8228 101060

TC LL	20.0 PSF	REF R8228 - 78109
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUR8228 101060
BC LL	0.0 PSF	HC-ENG SSB/AP
TOT.LD.	40.0 PSF	SEON- 104173
DUR.FAC.	1.25	
SPACING	24.0"	JREF - 1U108228Z03


110 mph wind, 15.00 ft mean hgt, ASCE 7-05, closed bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI(+/-)=0.18

Wind reactions based on MMFRS pressures.

Right end vertical not exposed to wind pressure.

Bottom chord checked for 10.00 psf non-concurrent live load.

MMFRS loads based on trusses located at least 7.50 ft. from roof edge.



9.05.00

QTY:1

FL/-/4/-/-/R/-

Scale = .3125" / Ft.

WARNING: PRIORS TO THE REQUIRE CASE IN REFORMATION, HANDLING, SHOOTING, INSTALLING AND BRACING REFER TO BEST (BUILDING CONSTRUCTION SAFETY INFORMATION), PUBLISHED BY THE (FIBREGLASS INSTITUTE), 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND WICK (WOOD TRUSS COMPANY), 65000 AMERICA ENTERPRISE LANE, MIDDLETON, WI 53219 FOR SAFETY PRACTICES TO PREVENTING THE USE OF FIBERGLASS. THE SAFETY PRACTICES INDICATED FOR CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PAGES AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED RIGID CLIPPING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT

IFY; OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

CONNECTOR PLATES ARE MADE OF 20/10/1000 (H, 11/33/6) WITHIN A033 UNDER A0300 (H, 6/11/33) ONLY. SEE: OTHER PLATES TO EACH FACE OF THUS AND UNLESS OTHERWISE LOCATED ON THIS DESIGN. POSITION PER DRAWINGS 160A-2

DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT

BUILDING DESIGNER PER ANSI/TP1 1 SEC. 2.

FL/-/4/-/-/R/-		Scale=.3125"/Ft.
TC LL	20.0 PSF	REF R8228- 78110
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUR8228 10106004
BC LL	0.0 PSF	HC-ENG SSB/AP *
TOT.LD.	40.0 PSF	SEON- 104180
DUR.FAC.	1.25	
SPACING	24.0"	JREF- 1U108228203

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

(A) Continuous lateral bracing equally spaced on member.

In lieu of structural panels use purlins to brace all flat TC @ 24" OC.

Deflection meets L/240 live and L/180 total load.


110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, lw=1.00 gcpi (+/-) -0.18

Wind reactions based on MWFRS pressures.

Right end vertical not exposed to wind pressure.

Bottom chord checked for 10.00 psf non-concurrent live load.

MWFRS loads based on trusses located at least 15.00 ft. from roof edge.

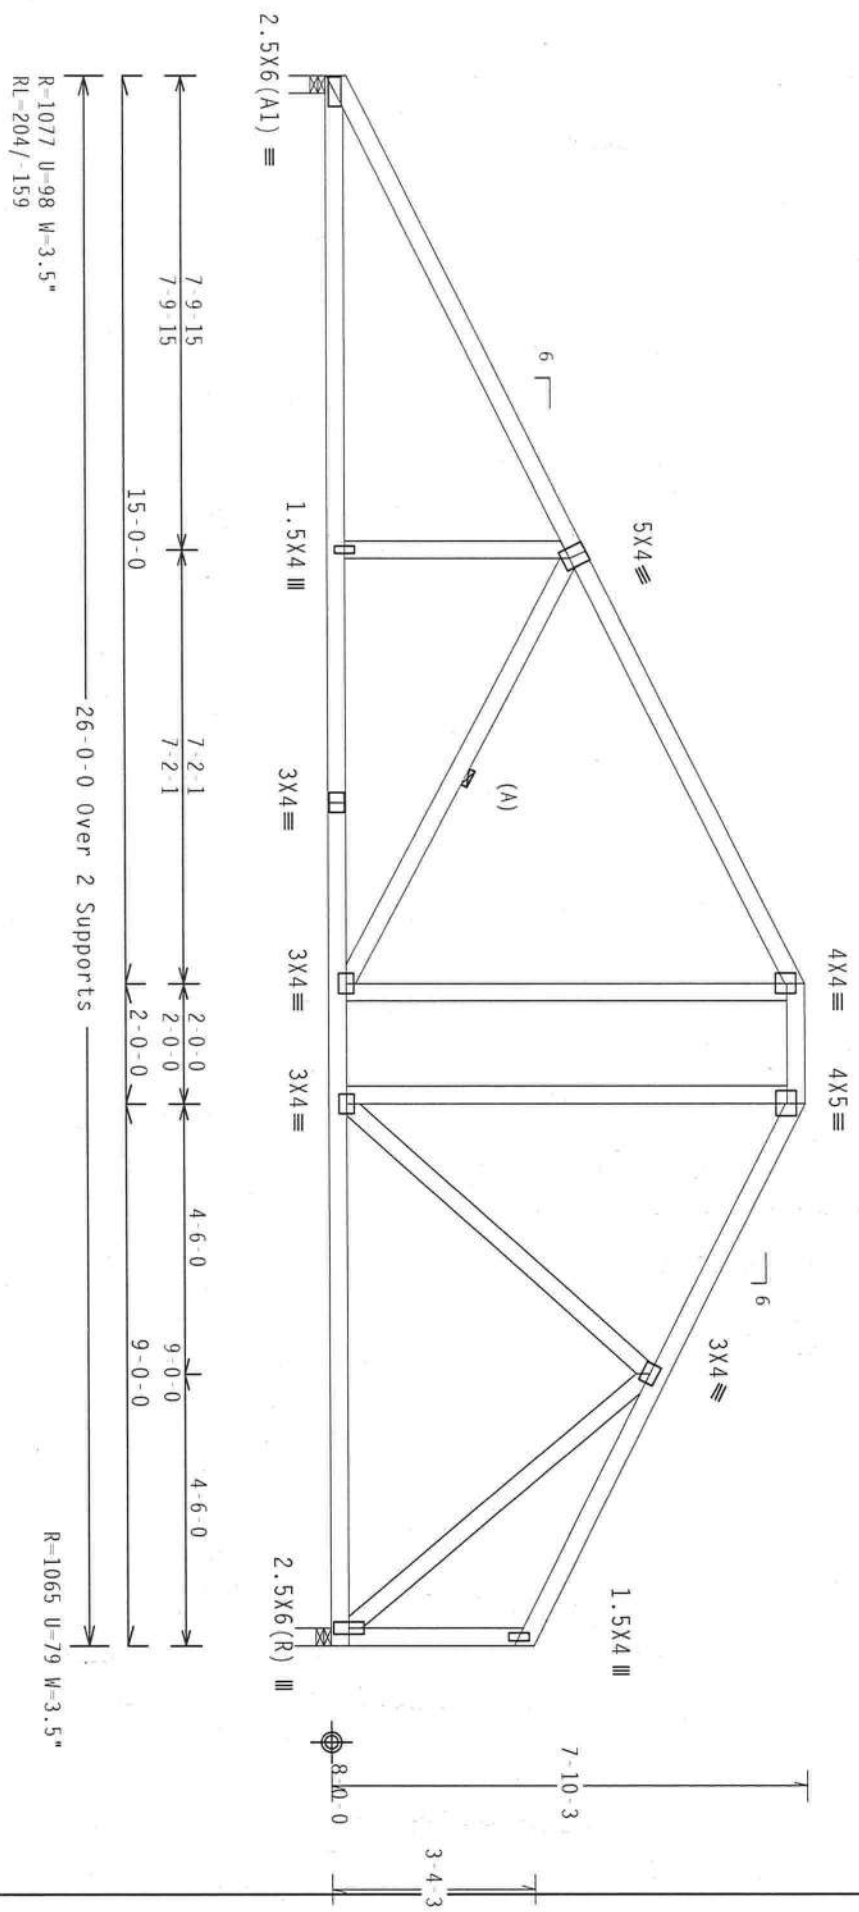

PLT TYP. Wave

Design Crit: FBC2007Res/TP1-2002(STD)
FT/RT=20%(0)/0(0)

9.05.00

QTY:1

FL/-/4/-/-/R/-

Scale = .3125"/ft.

ALPINE		No. 62212		STATE OF FLORIDA		JAMES W. COLLINS, JR.		Professional Engineer	
ITW Building Components Group Inc.		Haimes City, FL 33844		FL 7704 #0 778		TC LL		20.0 PSF	
						TC DL		10.0 PSF	
						BC DL		10.0 PSF	
						BC LL		0.0 PSF	
						TOT. LD.		40.0 PSF	
						DUR. FAC.		1.25	
						SPACING		24.0"	
						JREF - 1U108228Z03			

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, $I_w=1.00$ Gcpl(+)=0.18

Wind reactions based on MWFRS pressures.

Right end vertical not exposed to wind pressure.

Bottom chord checked for 10.00 psf non-concurrent live load.

MMFRS loads based on trusses located at least 15.00 ft. from roof edge.



9.05.00

QTY:1

FL/-/4/-/-/R/-/

Scale = .3125"/ft.

"WARNING" TRUCKS, BEARING EXTERIOR CHAIN IN EMBROIDERY, HANDLING, SHIPPING, INSTALLING AND DRIVING, REFER TO GCST (GOLDING COMPANY IN SAFETY INFORMATION), PUBLISHED BY THE CROSS PLANT INSTITUTE, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314, AND WICK (GOOD TRUSS COMPANY) OF AMERICA, 6500 MONROE AVENUE, RANDOLPH, VA, 22130, FOR SAFETY PRACTICES PERTAINING TO REPAIRING THESE CONDUITS. UNLESS OTHERWISE INDICATED FOR CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PARTS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED CHORD CEILING.

James S. Jr.
No. 52212

TC LL	20.0 PSF	REF R8228- 78112
TC DL	10.0 PSF	DATE 04/16/10
RC DI	10.0 PSF	DPW ucuse8228 1010602

[illegible]

TC LL	20.0 PSF	REF R8228 - 78112
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUSR8228 10106020
BC LL	0.0 PSF	HC-ENG SSB/AP
TOT.LD.	40.0 PSF	SEQN- 104200
DUR.FAC.	1.25	
SPACING	24.0"	JREF - 1U108228Z03

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

In lieu of structural panels use purlins to brace all flat TC @ 24" OC.

Bottom chord checked for 10.00 psf non-concurrent live load.


MMFRS loads based on trusses located at least 15.00 ft. from roof edge.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. Iw=1.00 Gcpi(+/-)-0.18

Wind reactions based on MMFRS pressures.

Right end vertical not exposed to wind pressure.

Deflection meets L/240 live and L/180 total load.

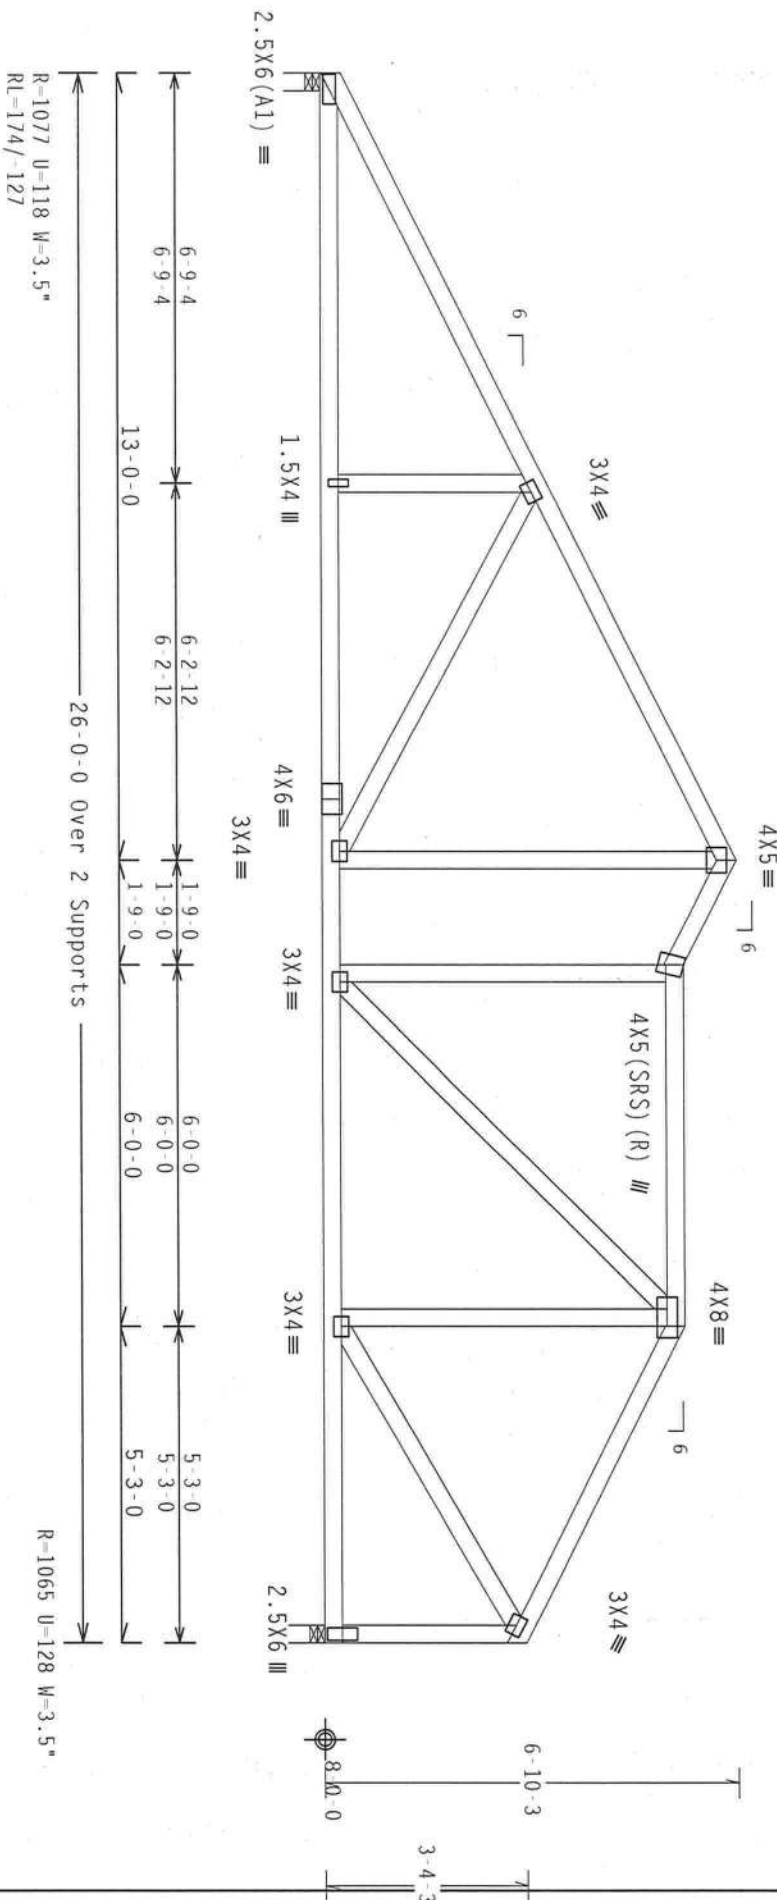

PLT TYP. Wave

Design Crit: FBC2007Res/TPI-2002(STD)
FT/RT=20%(0)/0(0)

9.05.09

QTY:1


FL/-/4/-/-/R/-

Scale = .3125"/ft.

WARNING TRUSSES REQUIRE EXTENSIVE CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST BUILDING COMPONENT SAFETY INFORMATION. PROVIDED BY TPI TRUSS PLATE INSTITUTE, 210 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314, AND WICA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED FIELD CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE RCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

DESIGN CONTRACTORS WITH APPLICABLE PROTECTIONS OF NON-CONTRACTORS, DESIGNERS, ENGINEERS, ARCHITECTS, PLUMBERS, ELEC. & MECHANICAL CONTRACTORS, AND OTHERS, SHALL BE RESPONSIBLE FOR THE PROTECTION OF THE TRUSS. THE TRUSS SHALL BE PROTECTED FROM DAMAGE TO EACH FACE OF TRUSS AND/OR WEBS OTHERWISE LOCATED ON THIS DESIGN. POSITION PER DRAWINGS 1604-2. ANY INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PER ANNEX A3 OF TPI 2002 SEC. 3. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.



TC LL	20.0 PSF	REF	R8228- 78114
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCSUR8228 10106003
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT. LD.	40.0 PSF	SEGN-	104220
DUR. FAC.	1.25		
SPACING	24.0"	JREF-	IU108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, $I_w=1.00$ $G_{CPI}(+)=0.18$

Wind reactions based on MWFRS pressures.

Right end vertical not exposed to wind pressure.

Deflection meets L/240 live and L/180 total load.

Deflection meets L/240 live and L/180 total load.



Design Crit: FBC2007Res/TPI-2002(STD)
FT/RT=20%(0%)/0(0)

QTY:1

FL/-/4/-/1/-/R/-/

Scale = .3125" / ft.

WARNING: ALL FIBERS ROUTING EXTERIOR CABLE IN INSTALLATION, HANDLING, SHIPPING, INSTALLING AND BROKING REFER TO OCS1 (OCCUPATIONAL SAFETY INFORMATION), PUBLISHED BY THE FIBERS PASTE INSTITUTE, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 (800) 785-6000. THESE CONTROL OR AMERICAS, 65000 ENTERPRISE LANE, MADISON, WI 53719 FOR SAFETY PRACTICES AND PLEA TO RECOVERING THESE PRODUCTS. UNLESS OTHERWISE INDICATED, TOP CORDS SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CORD SHALL HAVE PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT


TP1: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

CONNECTION PLATES ARE MADE OF 20/10/166A (H, M/SS/K) ASIM A653 GRADE 40/50 (H, K/M, SS) GALV., STEEL, APPLICABLE TO EACH CASE OF JOINT AND WELD JOINTS LOCATED ON THIS DESIGN POSITION PER DRAWINGS 160A-2

DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT

BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

BUILDING DESIGNER PER ANSI/HP1 1 SEC. 2.

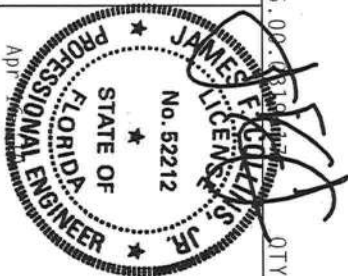

TC LL	20.0 PSF	REF	R8228- 78115
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106013
BC LL	0.0 PSF	HC-ENG	SSB/AP *
TOT.LD.	40.0 PSF	SEQN-	104227
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	IU108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, $I_w=1.00$ Gcpi(+/-)=0.18

Wind reactions based on MMFRS pressures.

Right end vertical not exposed to wind pressure.

Deflection meets $L/240$ live and $L/180$ total load.

Deflection meets $L/240$ live and $L/180$ total load.



Design Crit: FBC2007Res/TPI-2002(STD)
FT/RT=20%(0%)/0(0)

QTY: 1

FL/-/4/-/-/R/-

Scale = .3125" / ft.

* **"WARNING"** - BUILDERS BEHOLD: EXTENSIVE CASE IN FORTIFICATION. MASONRY, SHIPMENT, INSTALLING, AND BRACING NEED TO BE SET. (QUOTING COMPONENT IN SAFETY INFORMATION). PUBLISHED BY FBI (FEDERAL BUREAU OF INVESTIGATION), 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND WFO (WORLDWIDE FREE PRESS COUNCIL OF AMERICA), 62500 ENTERPRISE LANE, MANSION, MI, 48150 FOR SAFETY PRACTICES, PLEASE TO PERFORMING THE SET FORTIFICATIONS. UNDESIRABLE INDICATED (THE CHORD) SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED CHORD CEILING.

9.05.08
QTY: 1

JAMES R. POLK & CO.
LICENSED
No. 52212

HQ,
21B
6300
E.E.SS
HAYE

FL/-/4/-/-/R/-	
TC LL	20.0
TC DL	10.0
BC DL	10.0

Scale = .3125"/ft.
REF R8228- 78116
DATE 04/16/10
DWG UCSP8228 1010601

****IMPORTANT****FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITM BCG, INC. SHALL NOT

NOT

DC	10.0
DL	

DRM 100300Z 101000

BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TP1; OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

STATE OF

0.0 BC LL

HC-ENG 55B/AP

ITW Building Components Group Inc.

Haines City, FL 33844

FI COA #0 278

BUILDING DESIGNER PER ANSI/HP 1 SEC. 2-

APR 10 1910

SPACING 24.0

ORDER - 10100660603

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. Iw=1.00 Gcpi(+/-)=0.18

Wind reactions based on MFRS pressures.

Bottom chord checked for 10.00 psf non concurrent live load.

MMERS toads based on trusses located at least 15.00 ft. from roof edge.



Design Crit: FBC2007Res/TP1-2002(STD)
FT/RT=20%(0%)/0(0)

QTY:3	TL	/	-	/	4	/	-	/	-	/	R	/	-
-------	----	---	---	---	---	---	---	---	---	---	---	---	---

Scale = .3125 / ft.

WARNING: THESE ROUTING EXTERIOR CASES IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND REACTING TO BECAUSE OF THE ROUTING COMPONENTS IN THE FABRICATION, PUBLISHED BY THE CRUISE PLATE INSTITUTE, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND MYR GOOD CROSS COUNTRY OF AMERICA, 6100 ENTERPRISE AVE., MONTGOMERY, AL 36117 FOR SAFETY PRACTICES, PLEASE FOLLOW THESE INSTRUCTIONS. DRISSEZ OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT

TP1: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

CONNECTION PLATES ARE MADE ON 20/10/16mm (H.M./S.S/B.) MAIN AND JOINT ROJOV (IN PLYWOOD) WORK - EXACTLY IN ACCORDANCE TO EACH FACT OF TRUSS AND UNLESS OTHERWISE LOCATED ON THIS DESIGN- POSITION PER DRAWINGS 16DA-7

DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT

BUILDING DESIGNER PER ANSI/ISO 1 SEC. 2.

BUILDING DESIGNER P/LN ANSI/111.1 SEC. 6.

TC LL	20.0 PSF	REF R8228- 78117
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUR8228 10106022
BC LL	0.0 PSF	HC-ENG SSB/AP *
TOT.LD.	40.0 PSF	SEQN- 104119
DUR.FAC.	1.25	
SPACING	24.0"	JREF- 1U108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT 11, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI (+/-)=0.18

Wind reactions based on MWRS pressures.

Bottom chord checked for 10.00 psf non concurrent live load.

Deflection meets L/240 live and L/180 total load.

~~9.05.00~~

Scale = .25" / ft.

SALES, JR.
LICENSE
No. 52212

REF	R8228 - 78118
DATE	04/16/10
DRW	HCUSP8228 10106000

BC LL	0.0 PSF	HC-ENG KD/DF
TOT.LD.	40.0 PSF	SEQN- 83284
DUR.FAC.	1.25	
SPACING	24.0"	JREF- 1U108228Z03

Top Chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

:Stack Chord SC1 2x4 SP #2 Dense::Stack Chord SC2 2x4 SP #2 Dense:

Roof overhang supports 2.00 psf soffit load.

See DWGS A11015050109 & GBLETT10109 for more requirements.

Stacked top chord must NOT be notched or cut in area (NML). Dropped top chord braced at 24" o.c. intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" o.c. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI(+/-)=0.18


Wind reactions based on MWFRS pressures.

Truss spaced at 24.0" OC designed to support 1-0-0 top chord outlookers. Cladding load shall not exceed 10.00 PSF. Top chord must not be cut or notched.

In lieu of structural panels use purlins to brace TC @ 24" OC.

Bottom chord checked for 10.00 psf non-concurrent live load.

Deflection meets L/240 live and L/180 total load.

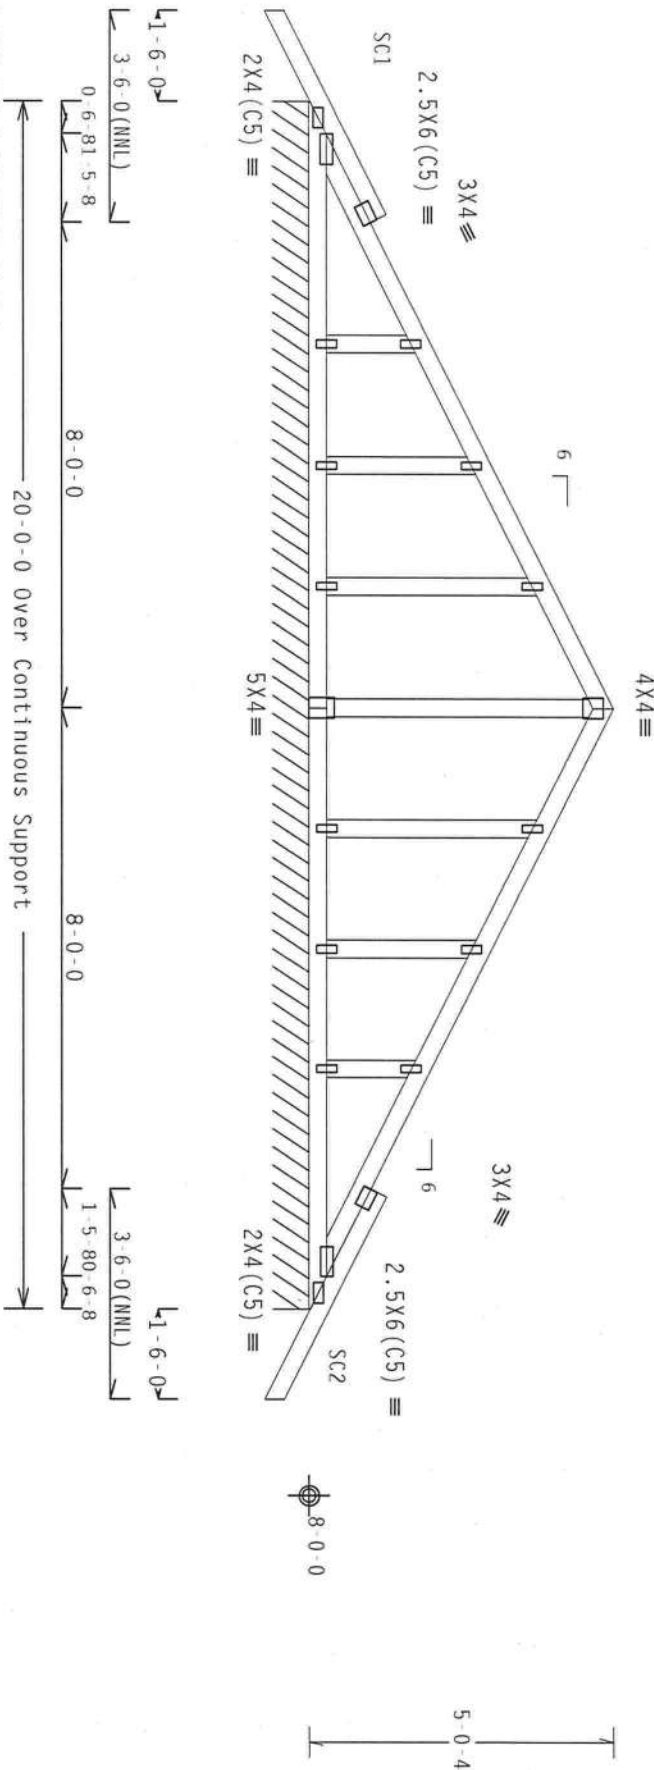

Note: All Plates Are 1.5X4 Except As Shown.

PLT TYP. Wave

Design Crit: FBC2007Res/TPI-2002(STD)
FT/RT=20%(0%)/0(0)

9.05.00

QTY:1



FL/-/4/-/-/R/-

Scale = .3125"/ft.

****WARNING**** BRUSSES ROUTINE EXISTING CASE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST BUILDING COMPONENT SAFETY INFORMATION. PUBLISHED BY TPI (TRUSS PLATE INSTITUTE, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314) AND WICA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

DESIGN COMPLIES WITH APPLICABLE PROVISIONS OF 2005 NATIONAL DESIGN SPEC. BY AERIAL AND TPI. THE BCG TRUSS COMPANY, 1000 W. 10TH AVE., SUITE 312, ALEXANDRIA, VA 22314, IS THE DESIGNER OF RECORD FOR THIS TRUSS. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY. A SEAL ON THIS BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

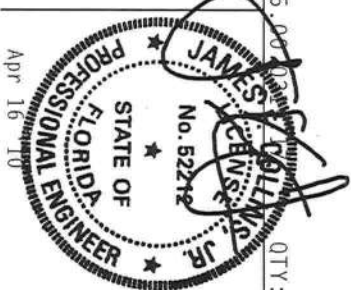

TC LL	20.0 PSF	REF	R8228- 78119
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106015
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT. LD.	40.0 PSF	SEON-	103947
DUR. FAC.	1.25		
SPACING	24.0"	JREF-	1U108228203

THIS WORK PREPARED FROM COMPUTER INPUT (LOADS & DIMENSIONS) SUBMITTED BY KRUSO MR.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, $I_w=1.00$ Gcpl (+/-)=0.18

Wind reactions based on MWFRS pressures.

Deflection meets $L/240$ live and $L/180$ total load.


$$FT/RT=20\%(0\%)/0(0)$$

QTY: 7


FL/-/4/-/-/R/-

Scale = .3125" / ft.

ALPINE

ITW Building Components Group Inc.

Haines City, FL 33844

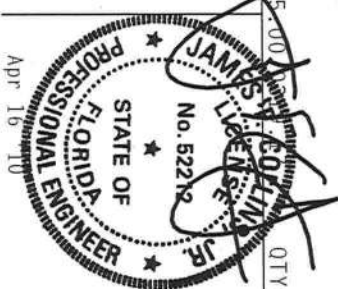

TC LL	20.0 PSF	REF	R8228 - 78120
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106018
BC LL	0.0 PSF	HC-ENG	SSB/AP *
TOT.LD.	40.0 PSF	SEQN-	103955
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1U108228Z03

THIS WORK PREPARED FROM COMPUTER INPUT (LUAUS & DIMENSIONS) SUBMITTED BY KRUSZ MKK.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, lw=1.00 gcpi (+/-)=0.18

Wind reactions based on MMFRS pressures.

Deflection meets $L/240$ live and $L/180$ total load.


$$\overline{9.05.00}$$

Scale = .375"/Ft.

JAMES A. JOHNSON, JR.
No. 52213

REF	R8228 - 78121
DATE	04/16/10
DPW	UCUSP8228 10106019


TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCSR8228 10106019
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEON-	103966
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1U108228203

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. [w=1.00 GCPI (+/-)=0.18

Wind reactions based on MWRFS pressures.

Bottom chord checked for 10.00 psf non-concurrent live load.

Deflection meets L/240 live and L/180 total load.



Scale = .1875"/Ft.



ITW Building Components Group Inc

Haines City, FL 33844

Professional Engineer Seal for James F. Hollings, Jr., State of Florida, No. 52212, Exp. 01/01/07.

TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	MCUSR8228 10106024
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	103998
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1U108228203


JREF- 1U108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located anywhere in roof, CAT 11, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI (+/-)=0.18

Wind reactions based on MWFRS pressures.

Girder supports 3-0-0 span to TC/BC split one face and 2-0-0 span to TC/BC split opposite face.

Deflection meets L/240 live and L/180 total load.



Design Crit: FBC2007Res/TPI-2002(STD)

$$FT/RT=20\%(0\%)/0(0)$$

9.05.00.0315 QTY:1


QTY:1	FL/-/4/-/-/R/-/-
-------	------------------

Scale = .1875" / Ft.

ALPINE

ITW Building Components Group Inc

Haines City, FL 33844

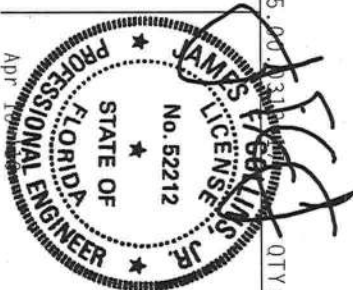[illegible]

TC LL	20.0 PSF	REF	R8228- 78123
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106021
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	104022
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	IU108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, lw=1.00 GCPI (+/-)=0.18

Wind reactions based on MMRS pressures.

#1 hip supports 7-0-0 jacks with no webs.
Deflection meets L/240 live and L/180 total load


$$FT/RT=20\%(0\%)/0(0)$$

QTY: 1

FL/-/4/-/-/R/-


Scale = .315" / ft.

WARNING: THESE RIGGING EQUIPMENT CASES IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND DRIVING REFER TO DCSEI (BOULDERING COMPONENT IN SAFETY INFORMATION), PUBLISHED BY THE FIBREGLASS PLASTIC INSTITUTE, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND NRC (6500) RULES, COUNCIL OF AMERICA, ONE EIGHT SEVEN, CREEPERIS LANE, MADISON, WI, 53719 TO PERFORMING THESE PROCEDURES. ONE EIGHT SEVEN, CREEPERIS LANE, MADISON, WI, 53719 TO PERFORMING THESE PROCEDURES. A PROPERLY ATTACHED RIGGING EQUIPMENT, AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED RIGGING EQUIPMENT.

ALPINE

ITW Building Components Group Inc.

Haines City, FL 33844
Tel: 800-451-7376

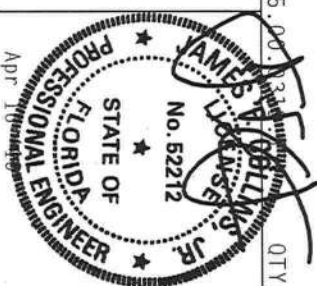

FL/-/4/-/R/-		Scale=.3/5"/ft.
TC LL	20.0 PSF	REF R8228- 78124
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUSR8228 10106008
BC LL	0.0 PSF	HC-ENG SSB/AP
TOT.LD.	40.0 PSF	SEON- 104054
DUR.FAC.	1.25	
SPACING	24.0"	JREF- 1U108228Z03

THIS WORK PREPARED FROM COMPUTER INPUT (LOADS & DIMENSIONS) SUBMITTED BY RUSS MFK.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCP1 (+/-)=0.18

Wind reactions based on MFRS pressures.

Deflection meets $L/240$ live and $L/180$ total load.

Deflection meets $L/240$ live and $L/180$ total load.


$$FT/RT=20\%(0\%)/0(0)$$

QTY:2

FL/-/4/-/-/R/-/

Scale = .375" / ft.


****IMPORTANT****—WITHIN A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR, THE BCG, INC., SHALL NOT BE LIABLE FOR ANY VIOLATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE: OR FABRICATING, HANDLING, SHIPPING, INSTALLING BRACING OF HOUSES.

TC LL	20.0 PSF	REF	R8228- 78125
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106005
BC LL	0.0 PSF	HC-ENG	SSB/AP *
TOT.LD.	40.0 PSF	SEQN-	104057
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	IU108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, lw=1.00 gcpi (+/-)=0.18

Wind reactions based on MWFRS pressures.

Deflection meets L/240 live and L/180 total load.

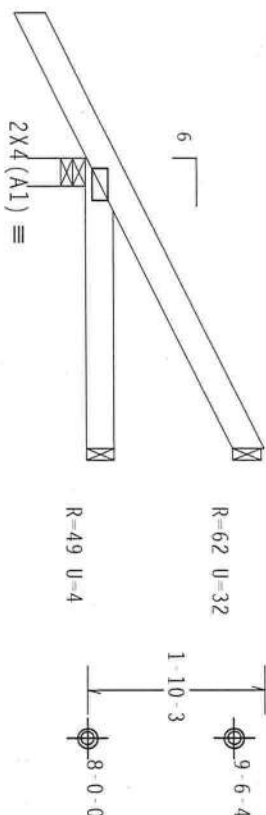

$\overbrace{\hspace{1.6in}}^{1-6-0}$
 $\underbrace{\hspace{3.0in}}_{\text{Over 3 Supports}}$
 $R=262 \quad U=64 \quad W=3.5''$
 $RL=76/-40$

Design Crit: FBC2007Res/TP1-2002(STD,
FT/RT=20%(0%)/0(0)


~~9.05.00~~

QTY:5	FL/-/4/-/-/R/-
-------	----------------

Scale = .5" / ft.

WARNING: THESE BROTHER EXTREME CASE FABRICATION, MANDRILL, SHIPPIING, INSTALLING AND DRILLING
RETURN TO DESI (BROUDEM COMPANY) SAFETY INFORMATION, PUBLISHED BY THE FIBRE PASTE INSTITUTE, 218
MORTON LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314 AND WICA (GOOD TRUSS COMPANY) OF AMERICA, 6300
ENTERPRISE BLVD., MANSION #1, 53170 FOR SAFETY PRACTICES PERTAINING TO PERFORMING THESE FUNCTIONS. UNLESS
OTHERWISE INDICATED FOR CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE
A PROPERLY ATTACHED RIGID CELLING.

*** IMPORTANT ***
 PLEASE PRINT A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE BCG, INC., SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE: OR FABRICATING, WELDING, SHIPPING, INSTALLING A BRACING OF TRUSSES. (THE BCG, INC. AND THE

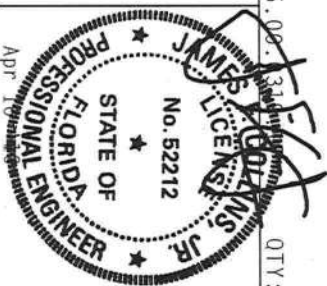[illegible]

TC LL	20.0 PSF	REF	R8228- 78126
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106023
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	103975
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1UI08228Z03

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense

Roof overhang supports 2.00 psf soffit load.



Bottom chord checked for 10.00 psf non-concurrent live load.

Provide { 2 } 16d common nails(0.162"x3.5"), toe nailed at Top chord.
Provide { 2 } 16d common nails(0.162"x3.5"), toe nailed at Bot chord.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located
anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0
psf. $I_w=1.00$ GCPI(+/-)=0.18

Wind reactions based on MWFRS pressures.

Deflection meets L/240 live and L/180 total load.

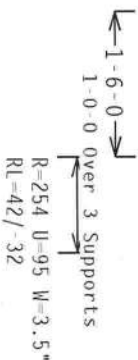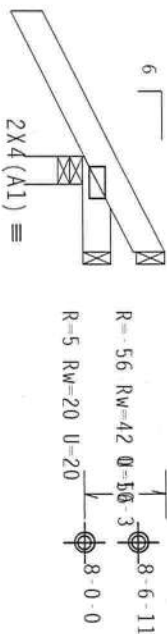

PLT TYP. Wave

Design Crit: FBC2007Res/TPI-2002(STD)
FT/RT=10%(0%)/0(0)

9.02.00



QTY:12 FL/-/4/-/-/R/-

Scale =.5"/Ft.

****WARNING**** TRUSSES BEING ERECTED IN CONFORMANCE WITH THE DESIGN SPECIFICATIONS OF THE NATIONAL TRUSS INSTITUTE, 210
NORTH LEE STREET, SUITE 112, ALEXANDRIA, VA, 22304 AND WEA-6000 TRUSS COUNCIL OF AMERICA, 6300
ENTERPRISE LANE, MANASSAS, VA 20108 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS
OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE
A PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE BCG, INC. SHALL NOT
BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH
TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING A BRACING OF TRUSSES.

DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF 2005 NATIONAL DESIGN SPEC. BY AIA/NSI AND TPI. THE BCG
PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, LOCATION FOR BRACING ON THIS
TRUSS INDICATES THE LOCATION OF BRACING. THE DESIGNER SHALL BE RESPONSIBLE FOR THE TRUSS COMPONENT
DESIGN, ANALYSIS, AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE
BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

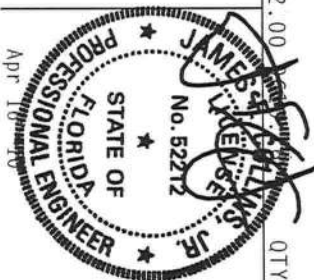


TC LL	20.0 PSF	REF R8228-78127
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUR8228 10106006
BC LL	0.0 PSF	HC-ENG DLJ/DLJ
TOT. LD.	40.0 PSF	SEQN- 82773
DUR. FAC.	1.25	
SPACING	24.0"	JREF- 1U108228Z03

Hipjack supports 7-0-0 setback jacks with no webs
Deflection meets L/240 live and L/180 total load.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, closed bldg, located anywhere in roof, CAT II, EXP C, wind TC DL-5.0 psf, wind BC DL-5.0 psf, 1w-1.00 GCPI (+/-) -0.18

Wind reactions based on MMRS pressures.

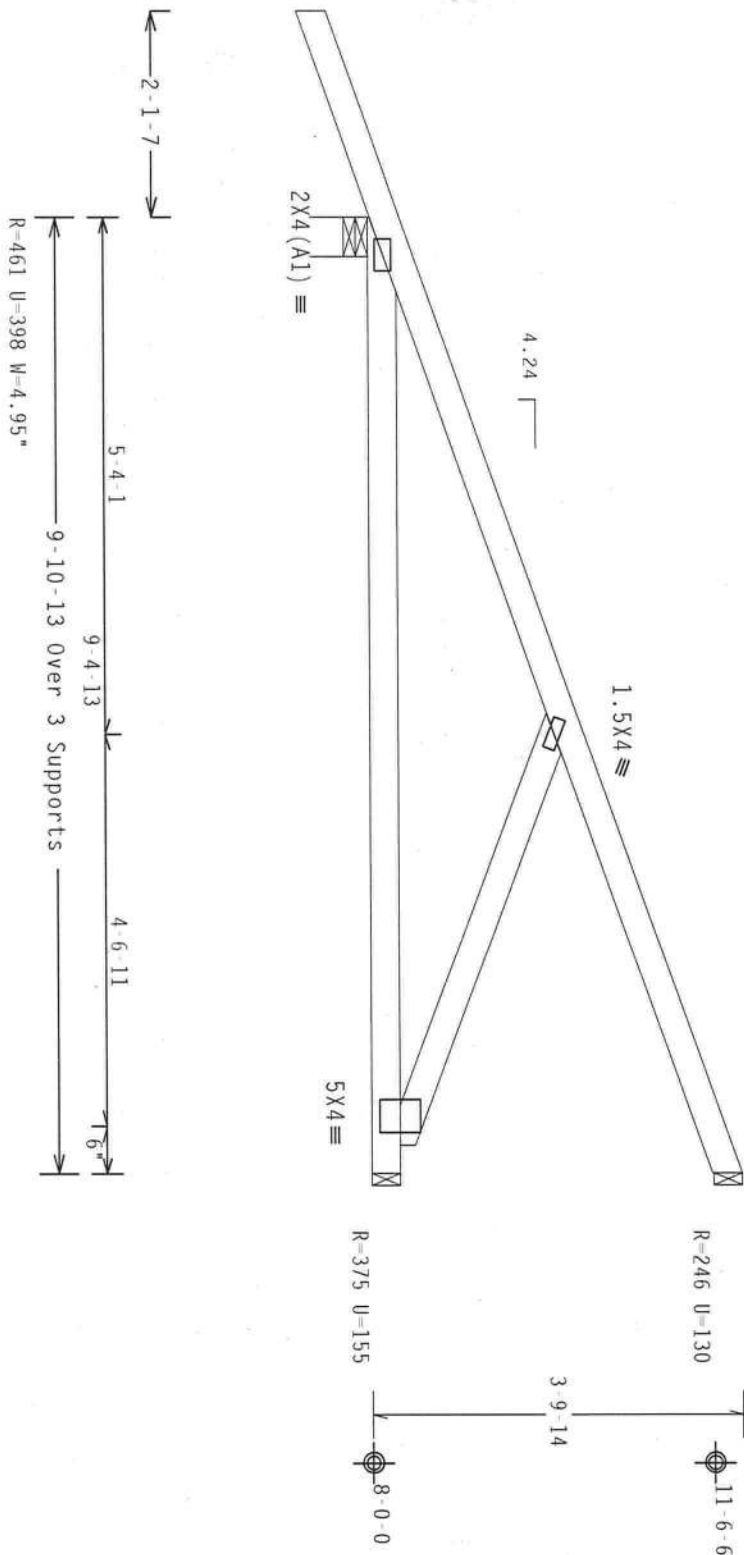

PLT TYP. Wave

Design Crit: FBC2007Res/TP1-2002(STD)

$$FT/RT=20\%(0\%)/0(0)$$
$$9.05 \cdot 10^{-6}$$

Q1Y:5	FL/-/4/-/-/R/-
-------	----------------


Scale = .5" / Ft.

[illegible]

ALPINE

ITW Building Components Group Inc

Haines City, FL 33844

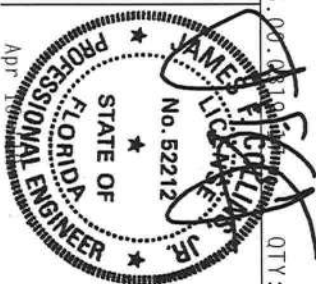


TC LL	20.0 PSF	REF	R8228- 78128
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106010
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	104039
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	IUI08228Z03

THIS WORK PREPARED FROM COMPUTER INPUT (LUNDS & DIMENSIONS) SUBMITTED BY IRUSS MRK.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, lw=1.00 gcpl (+/-) -0.18

Wind reactions based on MIFRS pressures.

Provide (2)	16d common nails (0.162"x3.5"), toe nailed at Top chord.
Provide (2)	16d common nails (0.162"x3.5"), toe nailed at Bot chord.

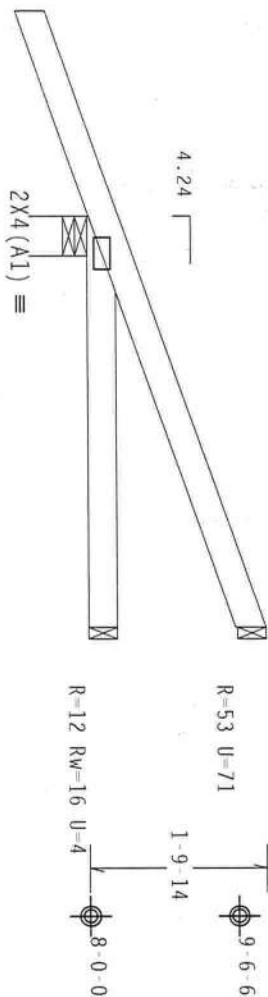


2-1-7

← 4-2-15 Over 3 Supports →

R=218 U=240 W=4.95"

PLT TYP. Wave

[illegible]

****IMPORTANT****FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE THISS IN CONFORMANCE WITH IP1; OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

[illegible]

Design Crit: FBC2007Res/TP1-2002(STD)
FT/RT=20%(0%)/0(0)


9.05.08.0319 QTY:1

QTY: 1

FL/-/4/-/-/R/-

Scale = .5" / Ft.

TC LL	20.0 PSF	REF	R8228- 78129
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106025
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	103986
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1U108228Z03

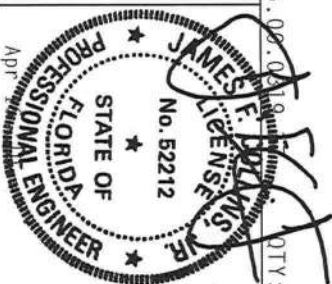

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense

Roof overhang supports 2.00 psf soffit load.



Bottom chord checked for 10.00 psf non-concurrent live load.

Provide (2) 16d common nails(0.162"x3.5"), toe nailed at Top chord.
Provide (2) 16d common nails(0.162"x3.5"), toe nailed at Bot chord.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, located
anywhere in roof, CAT II, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0
psf. Iw=1.00 GCPI(+/-)=0.18

Wind reactions based on MMFRS pressures.

Deflection meets L/240 live and L/180 total load.

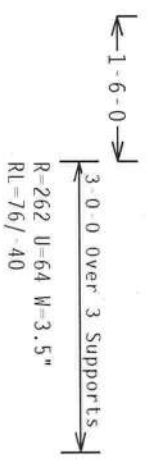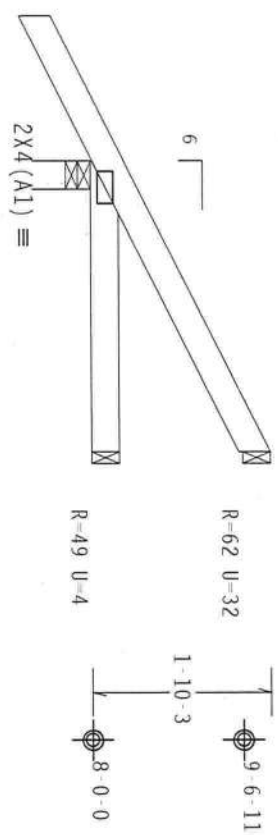

PLT TYP. Wave

Design Cmt: FBC2007Res/TP1-2002(STD)
FT/RT=20%(0)/0(0)



9.05.00

QTY:10 FL/-/4/-/-/R/-

Scale =.5"/Ft.

****WARNING**** TRUSSES BEHIND EXTERIOR CLAD IN FABRICATION, HANDLING, SHIPPING, INSTALLING & BRACING. REFER TO DESIGN (INCLUDING COMPROMISES) AND MATERIALS. PROVIDE THE TRUSS PLATE INSTITUTE, 2100 ENTERPRISE LANE, HOUSTON, TX 77059 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES. DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC., BY AIA/P) AND TPI. THE BCG PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWING. APPLY ANY INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE THE INSPECTION RESPONSIBILITY FOR THE TRUSS CONTRACTOR. DESIGN INDICATES ACCEPTABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER AMI/TPI 1 SEC. 2.

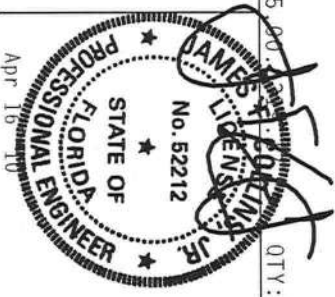


TC LL	20.0 PSF	REF	R8228- 78130
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106007
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT. LD.	40.0 PSF	SEQN-	104027
DUR. FAC.	1.25		
SPACING	24.0"	JREF-	1U108228Z03

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located within 4.50 ft from roof edge, CAT 1I, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf, Iw=1.00 Gcpi (+/-)=0.18


Wind reactions based on MWFRS pressures.

Deflection meets L/240 live and L/180 total load.

Deflection meets L/240 live and L/180 total load.

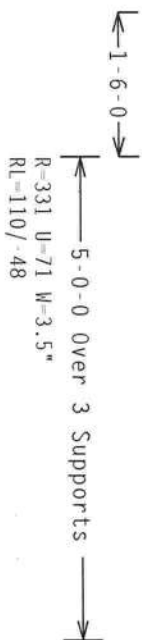

Scale = .5" / Ft.

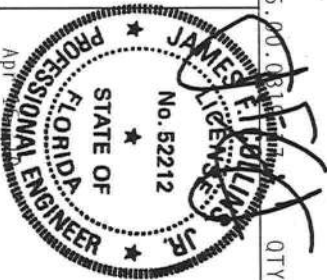

TC LL	20.0 PSF	REF	R8228- 78131
TC DL	10.0 PSF	DATE	04/16/10
BC DL	10.0 PSF	DRW	HCUSR8228 10106001
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	104031
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	IUI08228Z03

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense

Roof overhang supports 2.00 psf soffit load.


Bottom chord checked for 10.00 psf non-concurrent live load.

Provide { 2 } 16d common nails(0.162"x3.5"), toe nailed at Top chord.
Provide { 2 } 16d common nails(0.162"x3.5"), toe nailed at Bot chord.

110 mph wind, 15.00 ft mean hgt, ASCE 7-05, CLOSED bldg, not located
within 4.50 ft from roof edge, CAT II, EXP C, wind TC DL=5.0 psf, wind
BC DL=5.0 psf, IW=1.00 GCPI(+/-)-0.18

Wind reactions based on MMFRS pressures.

Deflection meets L/240 live and L/180 total load.

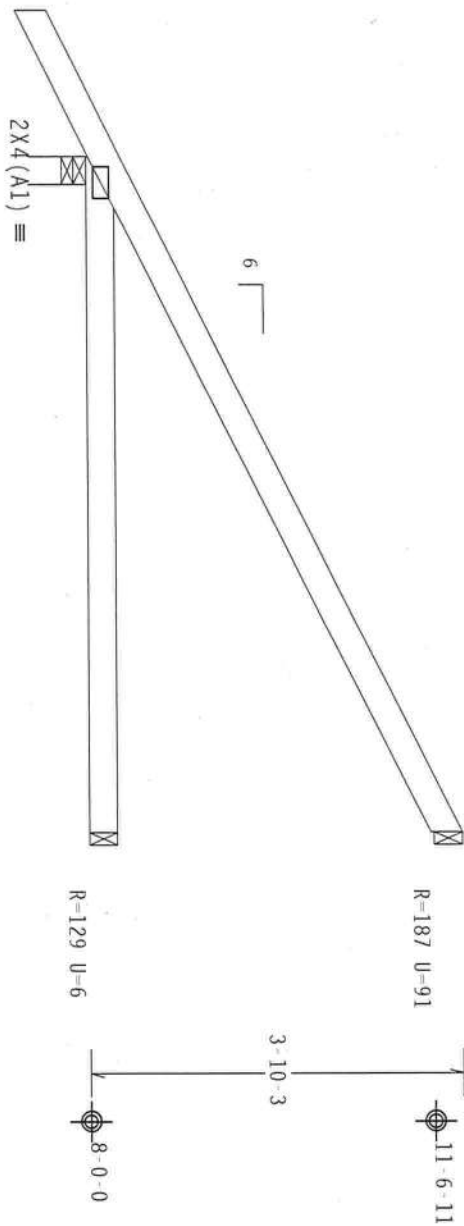

PLT TYP. Wave

Design Crit: FBC2007Res/TP1-2002(STD)

FT/RT=10%(0%)/0(0)

9.02.00


QTY:19 FL/-/4/-/-/R/-

Scale =.5"/Ft.


****WARNING**** BRUSSES RIGIDITE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. THE TRUSS IS A PRE-ENGINEERED MEMBER AND MUST BE INSTALLED EXACTLY AS SHOWN. ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FOLLOWING INSTRUCTIONS, OR ANY FAILURE TO FOLLOW THE INSTRUCTIONS OF THE TRUSS MANUFACTURER, SHALL BE THE RESPONSIBILITY OF THE USER. THE TRUSS IS A PRE-ENGINEERED MEMBER AND MUST BE INSTALLED EXACTLY AS SHOWN. ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FOLLOWING INSTRUCTIONS, OR ANY FAILURE TO FOLLOW THE INSTRUCTIONS OF THE TRUSS MANUFACTURER, SHALL BE THE RESPONSIBILITY OF THE USER.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. THE BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FOLLOWING INSTRUCTIONS, OR ANY FAILURE TO FOLLOW THE INSTRUCTIONS OF THE TRUSS MANUFACTURER, SHALL BE THE RESPONSIBILITY OF THE USER. THE TRUSS IS A PRE-ENGINEERED MEMBER AND MUST BE INSTALLED EXACTLY AS SHOWN. ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FOLLOWING INSTRUCTIONS, OR ANY FAILURE TO FOLLOW THE INSTRUCTIONS OF THE TRUSS MANUFACTURER, SHALL BE THE RESPONSIBILITY OF THE USER.

THE TRUSS IS A PRE-ENGINEERED MEMBER AND MUST BE INSTALLED EXACTLY AS SHOWN. ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FOLLOWING INSTRUCTIONS, OR ANY FAILURE TO FOLLOW THE INSTRUCTIONS OF THE TRUSS MANUFACTURER, SHALL BE THE RESPONSIBILITY OF THE USER. THE TRUSS IS A PRE-ENGINEERED MEMBER AND MUST BE INSTALLED EXACTLY AS SHOWN. ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FOLLOWING INSTRUCTIONS, OR ANY FAILURE TO FOLLOW THE INSTRUCTIONS OF THE TRUSS MANUFACTURER, SHALL BE THE RESPONSIBILITY OF THE USER.

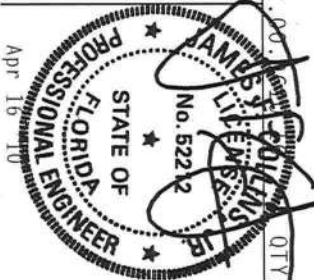

TC LL	20.0 PSF	REF R8228-78132
TC DL	10.0 PSF	DATE 04/16/10
BC DL	10.0 PSF	DRW HCUR8228 10106009
BC LL	0.0 PSF	HC-ENG DLJ/DLJ
TOT. LD.	40.0 PSF	SEQN- 82782
DUR. FAC.	1.25	
SPACING	24.0"	JREF- 1U108228Z03



THIS DETAIL IS TO BE USED WHEN CONTINUOUS LATERAL BRACING (CLB) IS SPECIFIED ON A TRUSS DESIGN BUT AN ALTERNATIVE WEB BRACING METHOD IS DESIRED.

THIS DETAIL IS ONLY APPLICABLE FOR CHANGING THE SPECIFIED
CLB SHOWN ON SINGLE PLY SEALED DESIGNS TO T-BRACING OR SCAB
BRACING.


ALTERNATIVE BRACING SPECIFIED IN CHART BELOW MAY BE CONSERVATIVE.
FOR MINIMUM ALTERNATIVE BRACING, RE-RUN DESIGN WITH APPROPRIATE
BRACING.

WEB MEMBER SIZE	SPECIFIED CLB BRACING	ALTERNATIVE T OR L-BRACE	BRACING SCAB BRACE
2X3 OR 2X4	1 ROW	2X4	1-2X4
2X3 OR 2X4	2 ROWS	2X6	2-2X4
2X6	1 ROW	2X4	1-2X6
2X6	2 ROWS	2X6	2-2X4(*)
2X8	1 ROW	2X6	1-2X8
2X8	2 ROWS	2X6	2-2X6(*)


T-BRACE, L-BRACE AND SCAB BRACE TO BE SAME SPECIES AND GRADE OR BETTER THAN WEB MEMBER UNLESS SPECIFIED OTHERWISE ON ENGINEER'S SEALED DESIGN.

(*) CENTER SCAB ON WIDE FACE OF WEB. APPLY (1) SCAB TO EACH FACE OF WEB.

APPLY TO EITHER SIDE OF WEB NARROW FACE.
ATTACH WITH 10d BOX OR GUN
(0.126" x 3." MIN) NAILS.
AT 6" O.C.
BRACE IS A
MINIMUM 80% OF WEB
MEMBER LENGTH

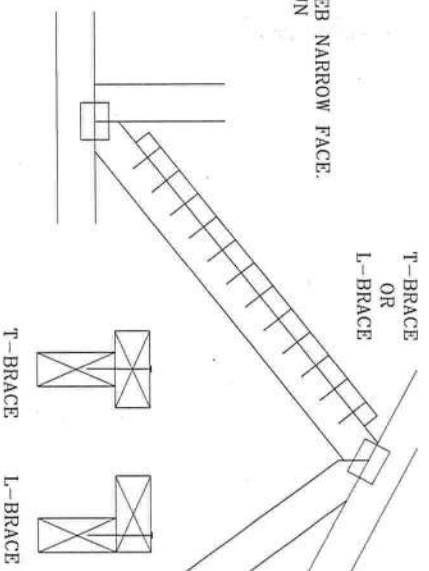

APPLY SCAB(S) TO WIDE FACE OF WEB.
NO MORE THAN (1) SCAB PER FACE.
ATTACH WITH 10d BOX OR GUN
(0.128" x 3". MIN) NAILS.
AT 6" O.C.
BRACE IS A MINIMUM
80% OF WEB MEMBER LENGTH

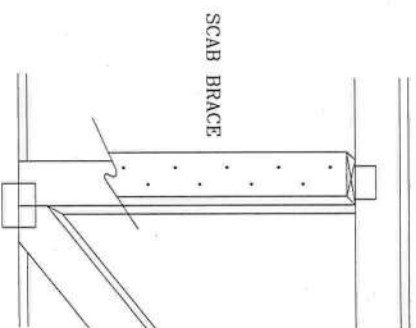

Building Components Group Inc.

Building Components Group Inc.

Earth City, MO 63045

WARNING READ AND FOLLOW ALL NOTES ON THIS SHEET.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow BCSI (Building Component Safety) information, by TPI and WCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural panels and bottom chord shall have a properly attached lateral field bracing. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3 & B7. See this job's general notes page for more information.

••IMPORTANT•• FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR.

THE Building Components Group Inc. (TBBCG) shall not be responsible for any deviation from this design. Any failure to build the truss in conformance with TP, or fabricating, handling, shipping, installing & bracing of trusses. TBBCG connector plates are made of 20/10/1053 (W/H/S) ASTM A653 grade 57/40/60 (K/M/S) adv. steel. Apply plates on each face of truss, positioned as shown above and on Joint Details. A seal on this drawing or cover page indicates acceptance and professional engineering responsibility solely for the truss component design shown. The suitability and use of this component for any building is the responsibility of the Building Designer per ANSI/TPI Inc. 2.

responsibility of the Building Designer per ANST/TPI 1 Sec. 2.
ITW-BGC: www.itwbc.com; TPI: www.tpinet.com; WTCA: www.sbcindustry.com; ICC: www.iccsafe.org




TC LL	PSF	REF	CLB SUBST.
TC DL	PSF	DATE	1/1/09
BC DL	PSF	DRWG	BRCLBSUB0109
BC LL	PSF		
TOT. LD.	PSF		
DUR. FAC.			
SPACING			

ASCE 7-05: 110 MPH WIND SPEED, 15' MEAN HEIGHT, ENCLOSED, 1 = 1.00, EXPOSURE C, Kzt = 1.00

GABLE STUD REINFORCEMENT DETAIL

MAX GABLE VERTICAL LENGTH		BRACE		NO BRACES		(1) 1X4 "L" BRACE *		(1) 2X4 "L" BRACE *		(2) 2X4 "L" BRACE *		(1) 2X6 "L" BRACE *		(2) 2X6 "L" BRACE *	
GABLE VERTICAL SPECIES	BRACE GRADE	SPACING	BRACES	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
24" O.C.	SPF	#1 / #2	3' 10"	6' 8"	6' 10"	7' 11"	8' 1"	9' 5"	9' 8"	12' 5"	12' 9"	14' 0"	14' 0"	14' 0"	14' 0"
	SPF	#3	3' 9"	6' 0"	6' 0"	7' 11"	9' 5"	9' 5"	12' 4"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STUD	3' 9"	6' 0"	6' 0"	7' 11"	9' 5"	9' 5"	12' 3"	12' 3"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	STANDARD	4' 3"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	10' 2"	12' 5"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
16" O.C.	SPF	#1	4' 2"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	10' 2"	12' 5"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
	SPF	#2	4' 0"	6' 1"	6' 1"	7' 11"	8' 0"	9' 5"	9' 11"	12' 5"	12' 6"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STUD	4' 0"	6' 1"	6' 1"	7' 11"	8' 0"	9' 5"	9' 11"	12' 5"	12' 6"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	STANDARD	4' 5"	7' 4"	7' 4"	9' 1"	9' 4"	10' 10"	11' 4"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
12" O.C.	SPF	#1 / #2	4' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SPF	#3	4' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STUD	4' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	STANDARD	4' 10"	7' 8"	8' 3"	9' 1"	9' 9"	10' 10"	11' 8"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"

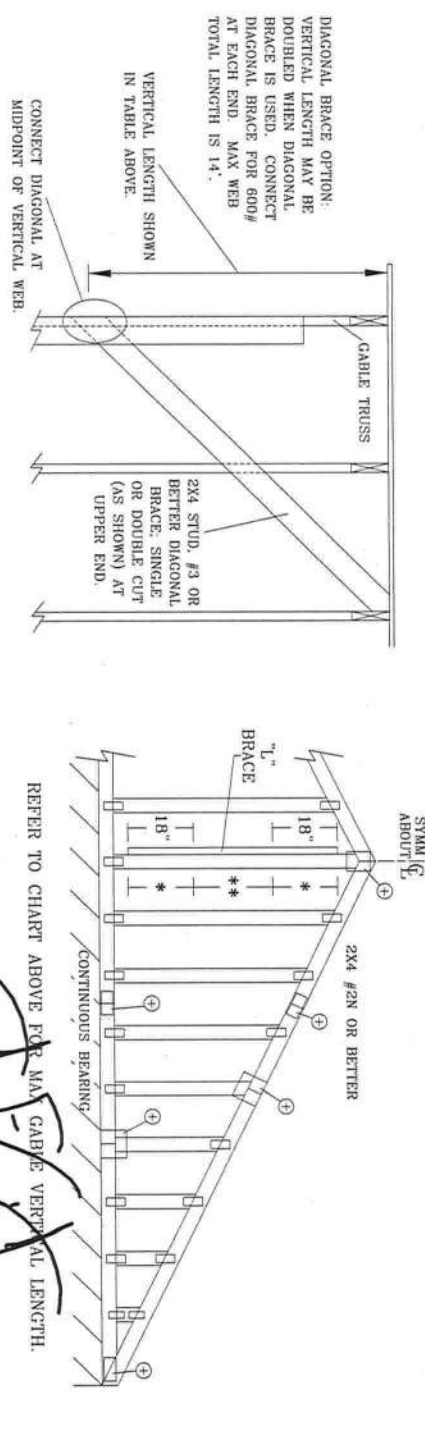


REFER TO CHART ABOVE FOR MAX GABLE VERTICAL LENGTH.



Building Components Group Inc.

Earth City, MO 63045



GABLE VERTICAL PLATE SIZES	
VERTICAL LENGTH	NO SPLICE
LESS THAN 4' 0"	1X4 OR 2X3
GREATER THAN 4' 0" BUT LESS THAN 11' 6"	2.5X4
GREATER THAN 11' 6"	3X4

ATTACH EACH "L" BRACE WITH 10d NAILS.
 * FOR (1) "L" BRACE: SPACE NAILS AT 2' 0" O.C. IN 18" END ZONES AND 4' 0" O.C. BETWEEN ZONES.
 ** FOR (2) "L" BRACES: SPACE NAILS AT 3' 0" O.C. IN 18" END ZONES AND 6' 0" O.C. BETWEEN ZONES.
 "L" BRACING MUST BE A MINIMUM OF 80% OF WEB MEMBER LENGTH.


GABLE TRUSS DETAIL NOTES:

LIVE LOAD DEFLECTION CRITERIA IS L/240.
 PROVIDE UPLIFT CONNECTIONS FOR 60 PLF OVER CONTINUOUS BEARING (5 PSF TC DEAD LOAD).
 GABLE END SUPPORTS LOAD FROM 4' 0" OUTLOOKERS WITH 2' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.

BRACING GROUP SPECIES AND GRADES:			
GROUP A:		GROUP B:	
SPRUCE-PINE-FIR	HEM-FIR	SPRUCE-PINE-FIR	HEM-FIR
#1 / #2 STANDARD	#2 STUD	#1 / #2 STANDARD	#2 STUD
#3 STUD	STANDARD	#3 STUD	STANDARD
DOUGLAS FIR-LARCH		DOUGLAS FIR-LARCH	
#3 STUD	STANDARD	#3 STUD	STANDARD
SOUTHERN PINE		SOUTHERN PINE	
#1 & BTR	#1	#1 & BTR	#1
#2	#2	#2	#2

MAX. SPACING	24.0"
MAX. TOT. LD.	60 PSF
REF	ASCE7-05-CAB11015
DATE	1/1/09
DRWG	A11015050109

GABLE DETAIL FOR LET-IN VERTICALS

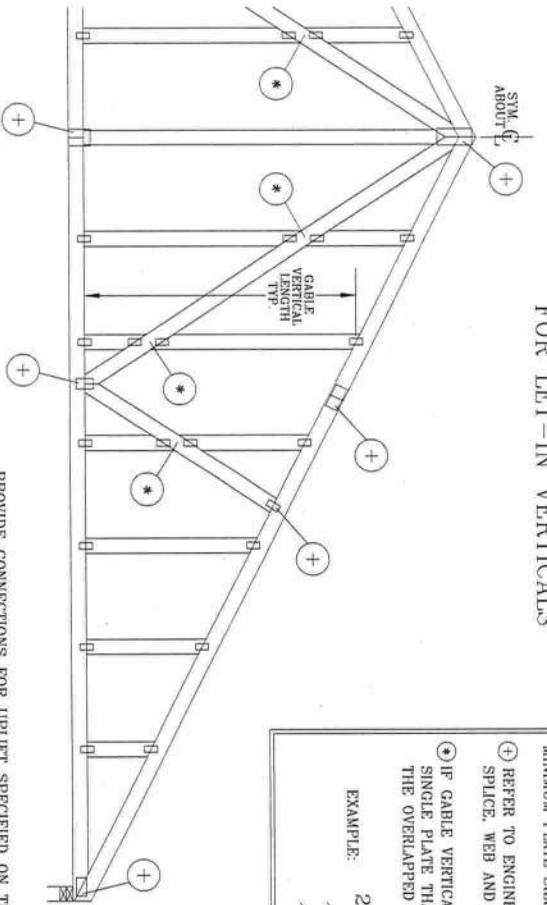


GABLE TRUSS PLATE SIZES

REFER TO APPROPRIATE ITW GABLE DETAIL FOR MINIMUM PLATE SIZES FOR VERTICAL STUDS.


⊕ REFER TO ENGINEERED TRUSS DESIGN FOR PEAK, SPLICE, WEB AND HEEL PLATES.

⊙ IF GABLE VERTICAL PLATES OVERLAP, USE A SINGLE PLATE THAT COVERS THE TOTAL AREA OF THE OVERLAPPED PLATES TO SPAN THE WEB.

EXAMPLE:



"T" REINFORCEMENT ATTACHMENT DETAIL

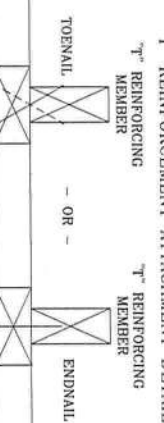

TO CONVERT FROM "L" TO "T" REINFORCING MEMBERS, MULTIPLY "T" INCREASE BY LENGTH (BASED ON APPROPRIATE ITW GABLE DETAIL).


MAXIMUM ALLOWABLE "T" REINFORCED GABLE VERTICAL LENGTH IS 14' FROM TOP TO BOTTOM CHORD.

WEB LENGTH INCREASE W/ "T" BRACE

WIND SPEED AND MRH	"T" REINFORCING MEMBER SIZE	"T" INCREASE
140 MPH	2x4	10 %
15 FT	2x6	50 %
140 MPH	2x4	10 %
30 FT	2x6	50 %
130 MPH	2x4	10 %
15 FT	2x6	50 %
130 MPH	2x4	10 %
30 FT	2x6	50 %
120 MPH	2x4	10 %
15 FT	2x6	50 %
120 MPH	2x4	10 %
30 FT	2x6	40 %
110 MPH	2x4	10 %
15 FT	2x6	40 %
110 MPH	2x4	10 %
30 FT	2x6	50 %
100 MPH	2x4	20 %
15 FT	2x6	30 %
100 MPH	2x4	10 %
30 FT	2x6	40 %
90 MPH	2x4	20 %
15 FT	2x6	20 %
90 MPH	2x4	20 %
30 FT	2x6	30 %

EXAMPLE:

ASCE WIND SPEED = 100 MPH
MEAN ROOF HEIGHT = 30 FT, $K_{zt} = 1.00$
GABLE VERTICAL = 24" O.C. SP #3
"T" REINFORCING MEMBER SIZE = 2X4
"T" BRACE INCREASE (FROM ABOVE) = 10% = 1.10
(1) 2X4 "T" BRACE LENGTH = 6' 7"
MAXIMUM "T" REINFORCED GABLE VERTICAL LENGTH
1.10 x 6' 7" = 7' 3"

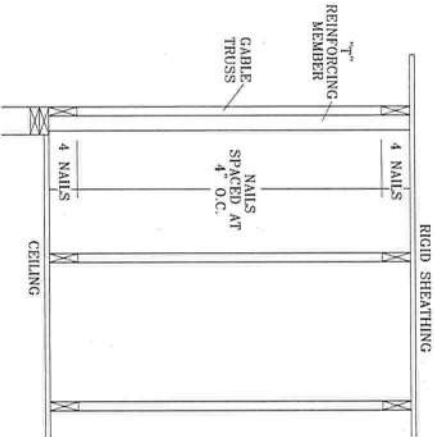

PROVIDE CONNECTIONS FOR UPLIFT SPECIFIED ON THE ENGINEERED TRUSS DESIGN.
ATTACH EACH "T" REINFORCING MEMBER WITH
END DRIVEN NAILS:
10d COMMON (0.148" X 3" MIN) NAILS AT 4" O.C. PLUS
(4) NAILS IN TOP AND BOTTOM CHORD.
TOENAILED NAILS:
10d COMMON (0.148" X 3" MIN) TOENAILS AT 4" O.C. PLUS
(4) TOENAILS IN TOP AND BOTTOM CHORD.

THIS DETAIL TO BE USED WITH THE APPROPRIATE ITW GABLE DETAIL FOR ASCE WIND LOAD.
ASCE 7-98 GABLE DETAIL DRAWINGS
A13015980109, A12015980109, A10015980109,
A13030980109, A12030980109, A10030980109
ASCE 7-02 GABLE DETAIL DRAWINGS
A13015020109, A12015020109, A10015020109, A14015020109,
A13030020109, A12030020109, A10030020109, A14030020109
ASCE 7-05 GABLE DETAIL DRAWINGS
A13015050109, A12015050109, A10015050109, A14015050109,
A13030050109, A12030050109, A10030050109, A14030050109
SEE APPROPRIATE ITW GABLE DETAIL FOR MAXIMUM UNREINFORCED GABLE VERTICAL LENGTH.


WARNING READ AND FOLLOW ALL NOTES ON THIS SHEET.
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the instructions in the ITW Building Components Group Inc. (ITWBCG) Building Component Safety Information, by TPI and WTC, for safety practices prior to performing these functions. Installers shall provide temporary bracing and shoring to maintain the structural integrity of the truss system during installation and bracing. The truss system shall be braced and shored until it is permanently attached to the ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCS1 sections B3 & B7. See this job's general notes page for more information.

IMPORTANT FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR.
ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design and failure to build ITWBCG connector plates are made of 20/16/18GA (N/A/S/N) ASTM A663 grade 37/40/60 (K/W/H/S) galv. steel. Apply plates to each face of truss, positioned as shown above and on joint details. A seal on this drawing or cover page indicates acceptance and professional engineering responsibility solely for the truss component design shown. The suitability and use of this component for any building is the responsibility of the Building Designer per ANSI/TPI 1 Sec. 2.
ITW-BCG: www.itwbcg.com; TPI: www.tpinet.com; WTC: www.steelindustry.com; ICG: www.icgsteel.org



Building Components Group Inc.


Earth City, MO 63046

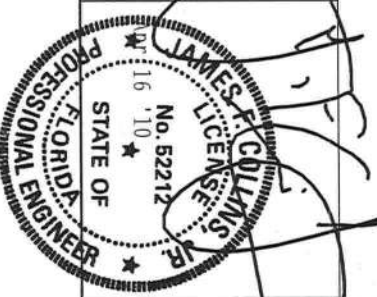

MAX TOT. LD. 60 PSF	REF	LET-IN VERT
DUR. FAC. ANY	DATE	1/1/09
MAX SPACING 24.0"	DRWG	GIBLETIN0109


Door Model	Gauge	Decimal
2250/2251	25	.0185
2240/2241	24	.0225

Window Restriction: Standard window options are available.

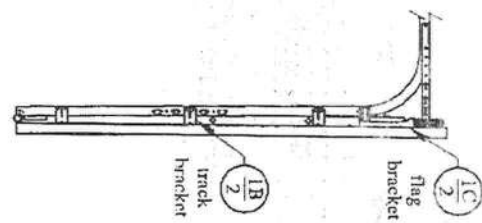

door height	section quantity	strut quantity	trk brkt per side
6'-6" to 7'-0"	4	7	3
7'-6" to 8'-0"	5	9	4
8'-3" to 8'-9"	5	9	4
9'-0" to 10'-6"	6	11	5
10'-9" to 12'-3"	7	13	6
12'-6" to 14'-0"	8	15	7

Refer to Supplemental Instructions for strut placement on doors over 7'-4" high

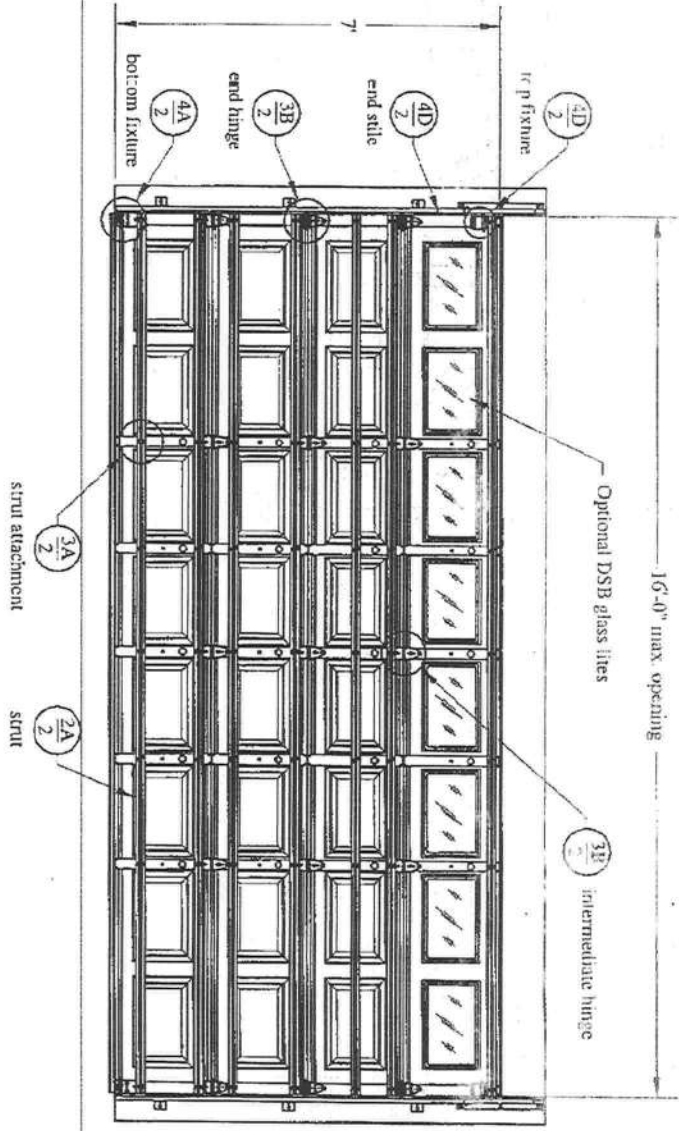

This door has been tested in accordance with ANSI/ASMA 108-2002 & 108-2005
 Design Pressure (DP): 30.1 psf / 33.5 mg
 Test Pressure (TP): 45.2 psf / 50.3 mg
 Per 2004 FBC Table 1609.6E, DP meets or exceeds basic wind speed of:
 $V = 140$ MPH for Exposure B and mean roof height of 30' or less
 $V = 118$ MPH for Exposure C and mean roof height of 30' or less
 Maximum door size: 16'-0" wide by 14'-0" tall
 Glazing and door have not been tested for windborne debris.
 Wood track and supporting structural elements shall be designed by a registered professional engineer for wind loads shown on this drawing.
 If door is not electrically operated, a lock must be installed.

Professional Engineer's seal provided only for verification of windload construction details

John F. Seales, P.E.
 1411 L. May Street #205
 Carrollton, Texas 75007
 Florida P.E. # 51737

FL 10201

Model 2250/51 (16'-0" wide)
 C.H.I. Drawing: Z6-1607-01200

