

DATE 11/01/2004

Columbia County Building Permit

PERMIT

This Permit Expires One Year From the Date of Issue

000022444

APPLICANT VIOLET DAVIS PHONE 386.454.1407

ADDRESS 254 SE HOPPERGRASS GLEN HIGH SPRINGS FL 3264

OWNER DONALD R. DAVIS PHONE 386.454.3387

ADDRESS 166 SW INWOOD COURT LAKE CITY FL 32025

CONTRACTOR DONALD R.DAVIS PHONE 386.454.1407

LOCATION OF PROPERTY 90-W TO SISTERS WELCOME RD., TR ON CREEKSID LANE, TR ON
INWOOD CRT., 3RD LOT ON L IN CREEKSID S/D.

TYPE DEVELOPMENT SFD & UTILITY ESTIMATED COST OF CONSTRUCTION 101650.00

HEATED FLOOR AREA 2033.00 TOTAL AREA 3085.00 HEIGHT 20.00 STORIES 1

FOUNDATION CONC WALLS FRAMED ROOF PITCH 6'12 FLOOR CONC

LAND USE & ZONING A-3 MAX. HEIGHT 35

Minimum Set Back Requirments: STREET-FRONT 25 REAR 15 SIDE 10

NO. EX.D.U. 0 FLOOD ZONE XPP DEVELOPMENT PERMIT NO. _____

PARCEL ID 12-4S-16-02939-130 SUBDIVISION CREEKSID

LOT 30 BLOCK _____ PHASE _____ UNIT _____ TOTAL ACRES .51

000000433 N CBC125897 Violet Davis

Culvert Permit No. Culvert Waiver Contractor's License Number Applicant/Owner/Contractor

18"X32"MITERED 04-0995-N BLK JDK N

Driveway Connection Septic Tank Number LU & Zoning checked by Approved for Issuance New Resident

COMMENTS: NOC ON FILE

1 FOOT ABOVE ROAD

Check # or Cash 5373

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power _____ Foundation _____ Monolithic _____
date/app. by date/app. by date/app. by

Under slab rough-in plumbing _____ Slab _____ Sheathing/Nailing _____
date/app. by date/app. by date/app. by

Framing _____ Rough-in plumbing above slab and below wood floor _____
date/app. by date/app. by

Electrical rough-in _____ Heat & Air Duct _____ Peri. beam (Lintel) _____
date/app. by date/app. by date/app. by

Permanent power _____ C.O. Final _____ Culvert _____
date/app. by date/app. by date/app. by

M/H tie downs, blocking, electricity and plumbing _____ Pool _____
date/app. by date/app. by

Reconnection _____ Pump pole _____ Utility Pole _____
date/app. by date/app. by date/app. by

M/H Pole _____ Travel Trailer _____ Re-roof _____
date/app. by date/app. by date/app. by

BUILDING PERMIT FEE \$ 510.00 CERTIFICATION FEE \$ 15.43 SURCHARGE FEE \$ 15.43

MISC. FEES \$.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ _____ WASTE FEE \$ _____

FLOOD ZONE DEVELOPMENT FEE \$ _____ CULVERT FEE \$ 25.00 TOTAL FEE 615.86

INSPECTORS OFFICE _____ CLERKS OFFICE CH

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

This Permit Must Be Prominently Posted on Premises During Construction

PLEASE NOTIFY THE COLUMBIA COUNTY BUILDING DEPARTMENT AT LEAST 24 HOURS IN ADVANCE OF EACH INSPECTION, IN ORDER THAT IT MAY BE MADE WITHOUT DELAY OR INCONVENIENCE, PHONE 758-1008. THIS PERMIT IS NOT VALID UNLESS THE WORK AUTHORIZED BY IT IS COMMENCED WITHIN 6 MONTHS AFTER ISSUANCE.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

Columbia County Building Permit Application

Revised 9-23-04

For Office Use Only Application # 0410-11 Date Received 10/6/04 By G Permit # 433-CP: 20440
Application Approved by - Zoning Official BLK Date 25.10.04 Plans Examiner _____ Date _____
Flood Zone Xper plot Development Permit N/A Zoning RSF-2 Land Use Plan Map Category Res. Low Den.
Comments EH

Applicants Name Violet Davis High Springs Construction, Inc Phone 386-454-1407
Address 254 SE Hoppergrass Gin, High Springs, FL 32643
Owners Name Donald R DAVIS Phone 386-454-3387
911 Address 166 SW Inwood Court Lake City, FL 32025
Contractors Name Donald R. DAVIS Phone 386-454-3387
Address 19740 S. Hwy 441, High Springs, FL 32643
Fee Simple Owner Name & Address Donald R DAVIS - 19740 S. Hwy 441, High Springs, FL 32643
Bonding Co. Name & Address NA
Architect/Engineer Name & Address Nicolas Paul Geisler, Rt 17 Box 1038 Lake City, FL 32055
Mortgage Lenders Name & Address NA
Circle the correct power company - FL Power & Light - Clay Elec. - Suwannee Valley Elec. - Progressive Energy
Property ID Number 802939-0130 12-45-16 Estimated Cost of Construction 120,000.00
Subdivision Name Creekside Subdivision Lot 30 Block _____ Unit _____ Phase _____
Driving Directions E 90W, turn left Sisters Welcome RD, TR
Creekside Lane, TR on Inwood Court, 3rd lot on left
In Creekside S/D
Type of Construction Home Number of Existing Dwellings on Property 0
Total Acreage .59 Lot Size .59 Do you need a Culvert Permit or Culvert Waiver or Have an Existing Drive
Actual Distance of Structure from Property Lines - Front 35' Side 53' Side 47' Rear 40'
Total Building Height 19.5 1/2" Number of Stories 1 Heated Floor Area 2032.8 Roof Pitch 6/12

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.


OWNERS AFFIDAVIT: I hereby certify that all the foregoing information is accurate and all work will be done in compliance with all applicable laws and regulating construction and zoning.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

Donald R. DAVIS / High Springs Const, Inc
Owner Builder or Agent (Including Contractor)

Contractor Signature Donald R. Davis
Contractors License Number CBC 1251897
Competency Card Number _____
NOTARY STAMP/SEAL

STATE OF FLORIDA
COUNTY OF COLUMBIA

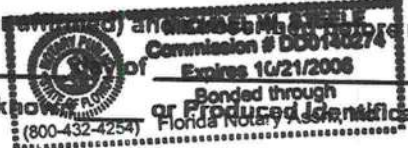Sworn to (or affirmed) and subscribed before me
this _____ day of _____, 20____
Personally known _____ or Produced Identification _____


Michael W. Smith
Notary Signature

NORTH 1 2 3

PROJECT NAME: AND ADDRESS:	166 SW INWOOD COURT L.C. FLA. 32025	BUILDER: DONALD DAVIS	PERMITTING OFFICE: Columbia	CLIMATE ZONE: 1 <input type="checkbox"/> 2 <input type="checkbox"/> 3 <input checked="" type="checkbox"/>
OWNER:	DONALD DAVIS	PERMIT NO.: <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> 22444	JURISDICTION NO.: 221000	

1. New construction including additions which incorporates any of the following features cannot comply using this method: steel stud walls, single assembly roof/ceiling construction, or skylights or other non-vertical roof glass.
2. Choose one of the component packages "A" through "C" from Table 6B-1 by which you intend to comply with the Code. Circle the column of the package you have chosen.
3. Fill in all the applicable spaces of the "To Be Installed" column on Table 6B-1 with the information requested. All "To Be Installed" values must be equal to or more efficient than the required levels.
4. Complete page 1 based on the "To Be Installed" column information.
5. Read "Minimum Requirements for All Packages", Table 6B-2 and check each box to indicate your intent to comply with all applicable items.
6. Read, sign and date the "Prepared By" certification statement at the bottom of page 1. The owner or owner's agent must also sign and date the form.

- | Please Print | | CK |
|--------------|----------------------------|-------------------------------------|
| 1. | <u>Δ</u> | <input checked="" type="checkbox"/> |
| 2. | <u>New</u> | <input checked="" type="checkbox"/> |
| 3. | <u>S.F.</u> | <input checked="" type="checkbox"/> |
| 4. | <u>-</u> | <input type="checkbox"/> |
| 5. | <u>N</u> | <input checked="" type="checkbox"/> |
| 6. | <u>2032.8</u> | <input checked="" type="checkbox"/> |
| 7. | <u>1.5</u> | <input checked="" type="checkbox"/> |
| Single Pane | | Double Pane |
| 8a. | sq. ft. | sq. ft. |
| 8b. | sq. ft. | <u>284.6</u> sq. ft. |
| 9. | <u>14.0</u> % | |
| 10a. | R= <u>0</u> | <u>237.5</u> lin. ft. |
| 10b. | R= | sq. ft. |
| 10c. | R= | sq. ft. |
| 10d. | R= | sq. ft. |
| 10e. | R= | sq. ft. |
| 11a-1 | R= | sq. ft. |
| 11a-2 | R= <u>11</u> | <u>1560.4</u> sq. ft. |
| 11b-1 | R= | sq. ft. |
| 11b-2 | R= <u>11</u> | <u>292.5</u> sq. ft. |
| 12a. | R= <u>30</u> | <u>2032.8</u> sq. ft. |
| 12b. | R= | sq. ft. |
| 13. | R= <u>0</u> | |
| 14a. | Type: <u>Central</u> | |
| 14b. | SEER/EER: <u>12.0</u> | |
| 14c. | Capacity: <u>36.0 KBTU</u> | |
| 15a. | Type: <u>Heat Pump</u> | |
| 15b. | HSPF/COP/AFUE: <u>7.9</u> | |
| 15c. | Capacity: <u>36.0 KBTU</u> | |
| 16a. | Type: <u>Electric</u> | |
| 16b. | EF: <u>88</u> | |

Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.908, F.S.

BUILDING OFFICIAL: _____

DATE: _____

TABLE 6B-1

MINIMUM REQUIREMENTS

Climate Zones 1 2 3

COMPONENTS		PACKAGES FOR NEW CONSTRUCTION				
GLASS	Max. % of glass to Floor Area	A 15%	B 15%	C 20%	D 20%	E 25%
	Type	Double Clear (DC)	Double Clear (DC)	Double Clear (DC)	Double Clear (DC)	Double Tint (DT)
	Overhang	1'4"	2'	2'	2'	2'
WALLS	Masonry	EXTERIOR AND ADJACENT MASONRY WALLS R-5 COMMON MASONRY WALLS R-3 EACH SIDE.				
	Wood Frame	EXTERIOR, ADJACENT, AND COMMON WOOD FRAME WALLS R-11				
CEILING		R-30	R-30	R-30	R-30	R-30
		(NO SINGLE ASSEMBLY CEILINGS ALLOWED)				
FLOORS	Slab-On-Grade	R-0				
	Raised Wood	R-19 (ONLY STEM WALL CONSTRUCTION ALLOWED EXCEPT PACKAGE C)				
	Raised Concrete	R-7				
DUCTS		R-6	R-6	R-6, TESTED	R-6	R-6, TESTED
SPACE COOLING (SEER)		12.0	10.5	12.0	11.0	12.0
HEAT	Elect. (HSPF)	7.9	7.1	7.4	7.4	7.4
	Gas/Oil (AFUE)	MINIMUM OF .73 (Direct heating) or .78 (Central)				
HOT WATER SYSTEM	Electric Resistance**	EF .88	NOT ALLOWED (SEE BELOW)	EF .91	NOT ALLOWED (SEE BELOW)	EF .91
	Gas & Oil **	MINIMUM EF OF .54				NATURAL GAS ONLY (SEE BELOW)
	Other	Any of the following are allowed: dedicated heat pump, heat recovery unit or solar system.				

TO BE INSTALLED	
_____ 14.0 _____ %	
DC: <input type="checkbox"/> DT: <input checked="" type="checkbox"/>	
_____ 1.5 _____ FEET	
EXT: R = _____	
ADJ: R = _____	
COM: R = _____	
EXT: R = 11	
ADJ: R = 11	
COM: R = _____	
UNDER ATTIC: R = 30	
COMMON: R = _____	
R = 0	
R = _____	
R = _____	
R = 4 COND. <input type="checkbox"/>	
SEER = 12.0	
COP = 7.9	
AFUE = _____	
EF = 88	
EF = _____	
DHP: <input type="checkbox"/> EF = _____	
HRU: <input type="checkbox"/> EF = _____	
SOLAR: <input type="checkbox"/> EF = _____	

* Single package units minimum SEER=9.7, HSPF = 6.6.
** Minimum efficiencies for gas and electric hot water systems apply to 40 gallon water heaters. Refer to Table 6-12 for minimum Code efficiencies for oil water heaters and other sizes.


DESCRIPTION OF BUILDING COMPONENTS LISTED

Percent of Glass to Floor Area: This percentage is calculated by dividing the total of all glass areas by the total conditioned floor area.
Overhang: The overhang is the distance the roof or soffit projects out horizontally from the face of the glass. All glass areas shall be under an overhang of at least the prescribed length with the following exceptions:
1) glass on the gabled ends of a house and 2) the glass in the lower stories of a multi-story house.
Wall, Ceiling and Floor Insulation Values: The R-values indicated represent the minimum acceptable insulation level added to the structural components of the wall, ceiling or floor. The R-value of the structural building materials shall not be included in this calculation. "Common" components are those separating conditioned tenancies in a multifamily building. "Adjacent" components separate conditioned space from unconditioned but enclosed space.
"Exterior" components separate conditioned space from unconditioned and unenclosed space.
Floor: Slab-on-grade floors without edge insulation are acceptable. Raised wood floors shall have continuous stem walls with insulation placed on the stem wall or under the floor except Package C.
Ducts: "TESTED" shall mean the ducts have less than 5% leakage based on a certified test report by a State-approved tester.
Space Cooling System: Cooling systems shall have a Seasonal Energy Efficiency Ratio (SEER) for central units or Energy Efficiency Ratio (EER) for room units or PTAC's equal to or greater than the prescribed value.
Electric Space Heating Option: Heat pump systems shall be rated with a Heating Seasonal Performance Factor (HSPF) equal to or greater than the prescribed HSPF. Heat pump systems may contain electric strip backups meeting the criteria of section 606.1 ABC 3.2.1.2. No electric resistance space heat is allowed for these packages.
Electric Resistance Hot Water Option: For packages designated "Not Allowed", an electric resistance hot water system may be installed only in conjunction with one of the "Other Hot Water System Options". See below.
Other Hot Water System Options: Any dedicated heat pump, heat recovery unit, or solar hot water system may be installed. Solar systems must have an EF of 1.5 or higher. Electric resistance systems having an EF of .88 or greater, or natural gas systems with EF .54 or greater may be used in conjunction with these systems.

TABLE 6B-2 MINIMUM REQUIREMENTS FOR ALL PACKAGES			
COMPONENTS	SECTION	REQUIREMENTS	CHECK
Exterior Joints & Cracks	606.1	To be caulked, gasketed, weather-stripped or otherwise sealed.	✓
Exterior Windows & Doors	606.1	Max .3 cfm/sq.ft. window area; .5 cfm/sq.ft. door area.	✓
Sole & Top Plates	606.1	Sole plates and penetrations through top plates of exterior walls must be sealed.	✓
Recessed Lighting	606.1	Type IC rated with no penetrations (two alternatives allowed).	✓
Multi-story Houses	606.1	Air barrier on perimeter of floor cavity between floors.	
Exhaust Fans	606.1	Exhaust fans vented to unconditioned space shall have dampers, except for combustion devices with integral exhaust ductwork.	✓
Water Heaters	612.1	Comply with efficiency requirements in Table 6-12. Switch or clearly marked circuit breaker (electric) or cutoff (gas) must be provided. External or built-in heat trap required for vertical pipe risers.	✓
Swimming Pools & Spas	612.1	Spas & heated pools must have covers (except solar heated). Non-commercial pools must have a pump timer. Gas spa & pool heaters must have minimum thermal efficiency of 78%.	
Hot Water Pipes	612.1	Insulation is required for hot water circulating systems (including heat recovery units).	✓
Shower Heads	612.1	Water flow must be restricted to no more than 2.5 gallons per minute at 80 PSIG.	✓
HVAC Duct Construction, Insulation & Installation	610.1	All ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of Section 610.1. Ducts in attics must be insulated to a minimum of R-6.	✓
HVAC Controls	607.1	Separate readily accessible manual or automatic thermostat for each system.	✓

PART II - SITE PLAN -

Scale: Each block represents 5 feet and 1 inch = 50 feet.

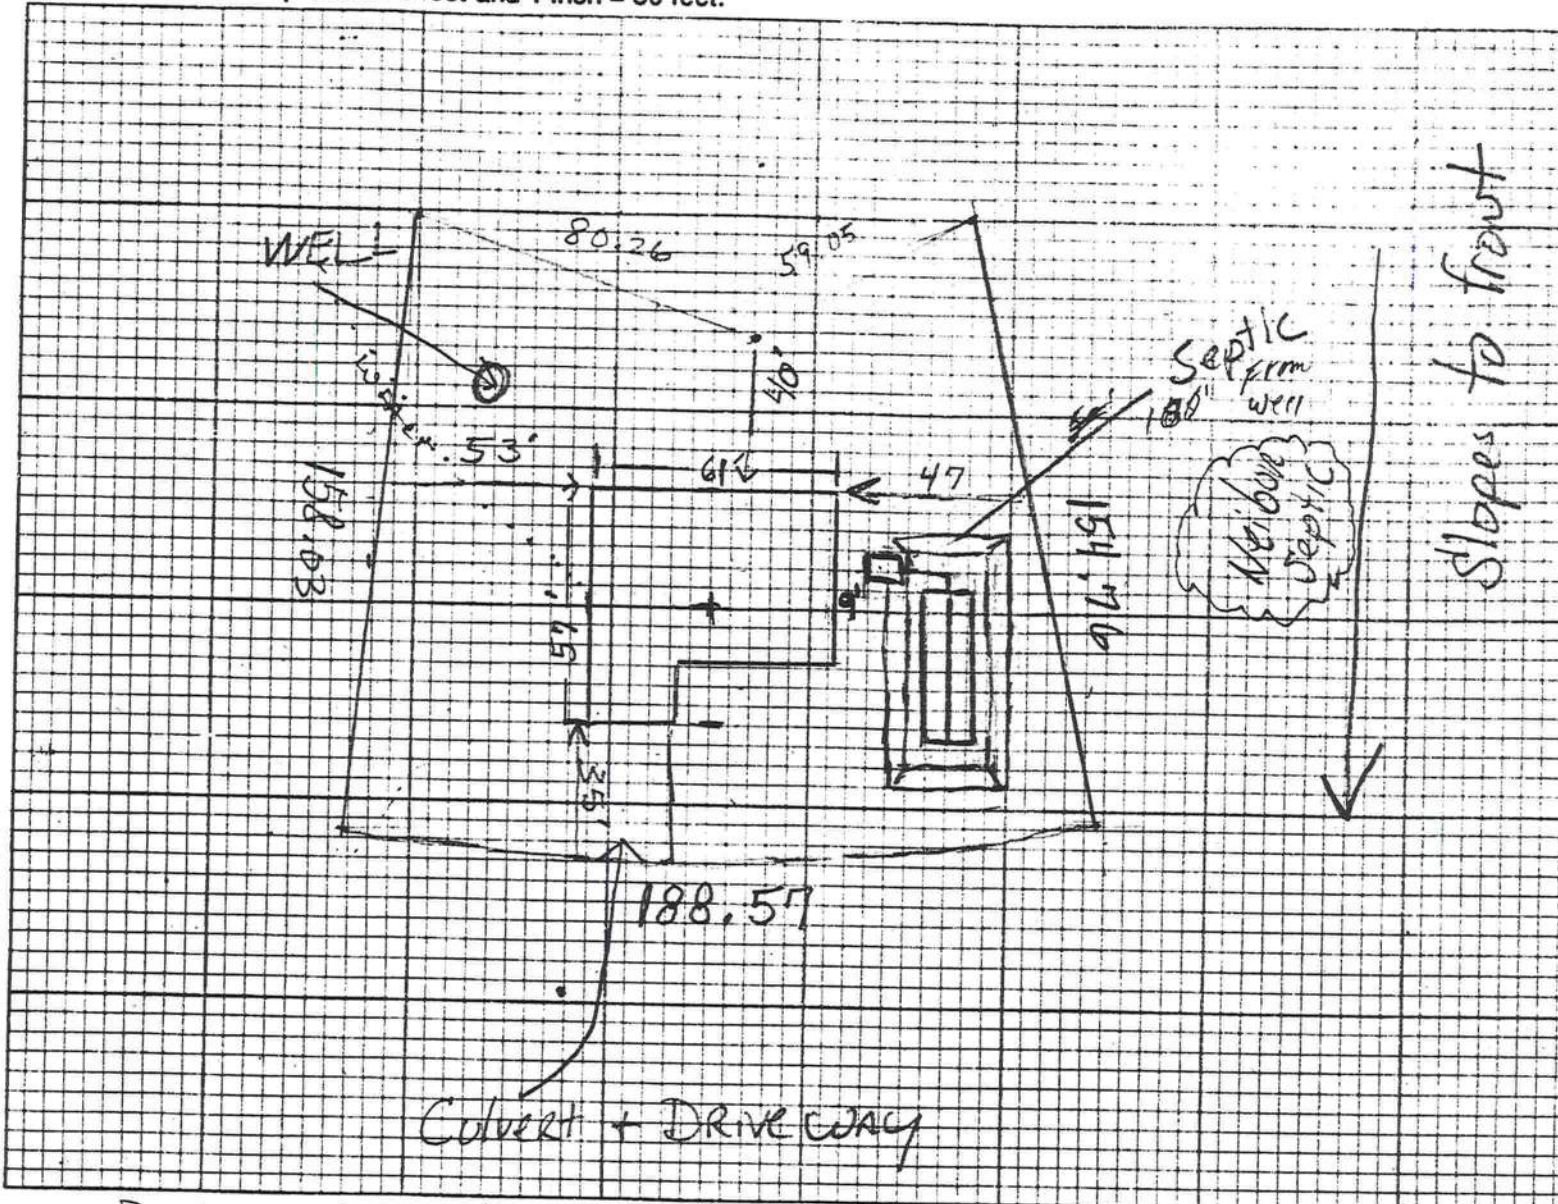

Notes: Distance to well from Septic A good 100'

Site Plan submitted by:

Donald Davis
Signature

Signature

Owner

Title

Plan Approved

Not Approved

Date 10-8-04

By _____

Columbia

County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

Prepared by:
Joyce Wade
Abstract & Title Services, Inc.
382 SW Baya Drive
Lake City, Florida 32025

Warranty Deed

Individual to Individual

THIS WARRANTY DEED made the 30th day of July, 2004 by

Peter W. Giebeig, A Single Person
hereinafter called the grantor, to

High Springs Plumbing & Electric, Inc.
whose post office address is: 19740 S US Hwy 441, High Springs, FL 32643
hereinafter called the grantee:

(Wherever used herein the terms "grantor" and "grantee" include all the parties to this instrument and the heirs, legal representatives and assigns of individuals, and the successors and assigns of corporation)

Witnesseth: That the grantor, for and in consideration of the sum of \$10.00 and other valuable considerations, receipt whereof is hereby acknowledged, hereby grants, bargains, sells, aliens, remises, releases, conveys, and confirms unto the grantee, all that certain land situate in COLUMBIA County, FLORIDA, viz: Parcel ID#

Lot 30, Creekside, a subdivision according to the plat thereof, filed in Plat Book 7, Pages 124-125, of the Public Records of Columbia County, Florida.

The above described property is not the homestead of the Grantor.

TOGETHER with all tenements, hereditaments and appurtenances thereto belonging or in anywise appertaining.

TO HAVE AND TO HOLD, the same in fee simple forever.

AND the grantor hereby covenants with said grantee that the grantor is lawfully seized of said land in fee simple; that the grantor has good right and lawful authority to sell and convey said land; that the grantor hereby fully warrants the title to said land and will defend the same against the lawful claims of all persons whomsoever; and that said land is free of all encumbrances, except taxes accruing subsequent to December 31, 2003.

IN WITNESS WHEREOF, the said grantor has signed and sealed these presents the day and year first above written.

Signed, sealed and delivered in our presence:

Witness

Rhonda B. Green

Peter W. Giebeig


Witness

Sylvia Spivey

STATE OF FLORIDA
COUNTY OF COLUMBIA

The foregoing instrument was acknowledged before me this 30th day of July, 2004 by Peter W. Giebeig, A Single Person personally known to me or, if not personally known to me, who produced Driver's License No. _____ for identification and who did not take an oath.

(SEAL)

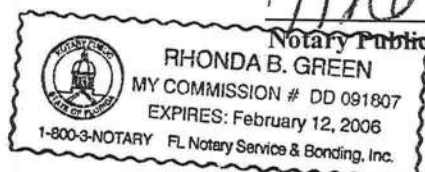

NOTICE OF COMMENCEMENT

STATE OF FL
COUNTY OF Columbia

The undersigned hereby gives notice that improvement will be made to certain real property, and in accordance with Chapter 713, Florida Statutes, the following information is provided in this Notice of Commencement:

1. Description of Property: Lot 30, Creekside, a subdivision according to the plat thereof, filed in Plat Book 7, Pages 124-125, of the Public Records of Columbia County, Florida.
2. General Description of Improvement: Construction of Single Family Residence
3. Owner Information:
 - a. Name and Address: High Springs Plumbing & Electric, Inc.
19740 S US Hwy 441, High Springs, Florida 32643
 - b. Interest in Property: Fee Simple
 - c. Name and Address of Fee Simple titleholder (if other than Owner):
SAME AS ITEM 3a ABOVE
4. Contractor (name and address): High Springs Plumbing & Electric, Inc.
19740 S US Hwy 441
High Springs, Florida 32643
5. Surety:
 - a. Name and Address: N/A Inst:2004018284 Date:08/09/2004 Time:15:49
DC,P.DeWitt Cason,Columbia County B:1022 P:2996
 - b. Amount of Bond:
6. Lender (Name and Address): N/A
7. Persons within the State of Florida designated by Owner upon notices or other documents may be served as provided by 713.13(1)(a)(7), Florida Statutes:

8. In addition to himself, the Owner designates the following person to receive a copy of the Lienor's Notice as provided in 713.13(1)(b), Florida Statutes (Name and Address):
N/A
9. Expiration date of Notice of Commencement (the expiration date is 1 year from the date of recording unless a different date is specified): _____

Donald R. Davis
Type Owner Name: High Springs Plumbing,
& Electric, Inc. by President Donald R. Davis

Donald R. Davis
Type Owner Name: Donald R. Davis

Witness #1

Witness #2

Sworn to and subscribed before me by the Donald R. Davis, President of High Springs Plumbing & Electric, Inc.

**Columbia County Building Department
Culvert Permit**

**Culvert Permit No.
000000433**

DATE 11/01/2004 PARCEL ID # 12-4S-16-02939-130

APPLICANT VIOLET DAVIS PHONE 386.454.1407

ADDRESS 254 SE HOPPERGRASS LAKE CITY FL 3264

OWNER DONALD R. DAVIS PHONE 386.454.3387

ADDRESS 166 SW INWOOD COURT LAKE CITY FL 32025

CONTRACTOR DONALD R. DAVIS PHONE 386.454.3387

LOCATION OF PROPERTY 90-W TO SISTERS WELCOME ROAD, TR ON CREEKSIDE LN, TR ON INWOOD COURT
3RD LOT ON LEFT IN S/D

SUBDIVISION/LOT/BLOCK/PHASE/UNIT CREEKSIDE 30

SIGNATURE *Violet Davis*

INSTALLATION REQUIREMENTS



Culvert size will be 18 inches in diameter with a total length of 32 feet, leaving 24 feet of driving surface. Both ends will be mitered 4 foot with a 4 : 1 slope and poured with a 4 inch thick reinforced concrete slab.

INSTALLATION NOTE: Turnouts will be required as follows:

- a) a majority of the current and existing driveway turnouts are paved, or;
- b) the driveway to be served will be paved or formed with concrete.

Turnouts shall be concrete or paved a minimum of 12 feet wide or the width of the concrete or paved driveway, whichever is greater. The width shall conform to the current and existing paved or concreted turnouts.



Culvert installation shall conform to the approved site plan standards.



Department of Transportation Permit installation approved standards.



Other _____

ALL PROPER SAFETY REQUIREMENTS SHOULD BE FOLLOWED
DURING THE INSTALLATION OF THE CULVERT.

135 NE Hernando Ave., Suite B-21
Lake City, FL 32055
Phone: 386-758-1008 Fax: 386-758-2160

Amount Paid 25.00



CERTIFICATE OF OCCUPANCY

OCCUPANCY

COLUMBIA COUNTY, FLORIDA

Department of Building and Zoning Inspection

This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.

Parcel Number 12-4S-16-02939-130

Building permit No. 000022444

Use Classification SFD & UTILITY

Fire: 5.67

Permit Holder DONALD R.DAVIS

Waste: 12.25

Owner of Building DONALD R. DAVIS

Total: .00

Location: 166 SW INWOOD COURT, CREEKSIDE LOT 30

Date: 08/15/2005



Building Inspector

POST IN A CONSPICUOUS PLACE
(Business Places Only)

Notice of Treatment

Applicator Florida Pest Control & Chemical Co. 11261

Address BAYA Ave

City Lake City **Phone** 752-1703

Site Location **Subdivision** Cypresside S/D

Lot# 30 **Block#** **Permit#** 22444

Address 166 SW Inman Court, Ore

AREAS TREATED

Area Treated	Date	Time	Gal.	Print Technician's Name
Main Body	12/10/04	1400	521	F254
Patio/s #				
Stoop/s #				
Porch/s #				
Brick Veneer				
Extension Walls				
A/C Pad				
Walk/s #				
Exterior of Foundation				
Driveway Apron				
Out Building				
Tub Trap/s				
(Other)				

Name of Product Applied DURS BAN TC 105 %

Remarks BACK & FRONT PORCH NOT FORMED YET

NEED to be TREATED LATER!