


REVISIONS
June 09, 2021

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

FRONT & REAR ELEVATIONS


SCALE: 1" = 1'-0"

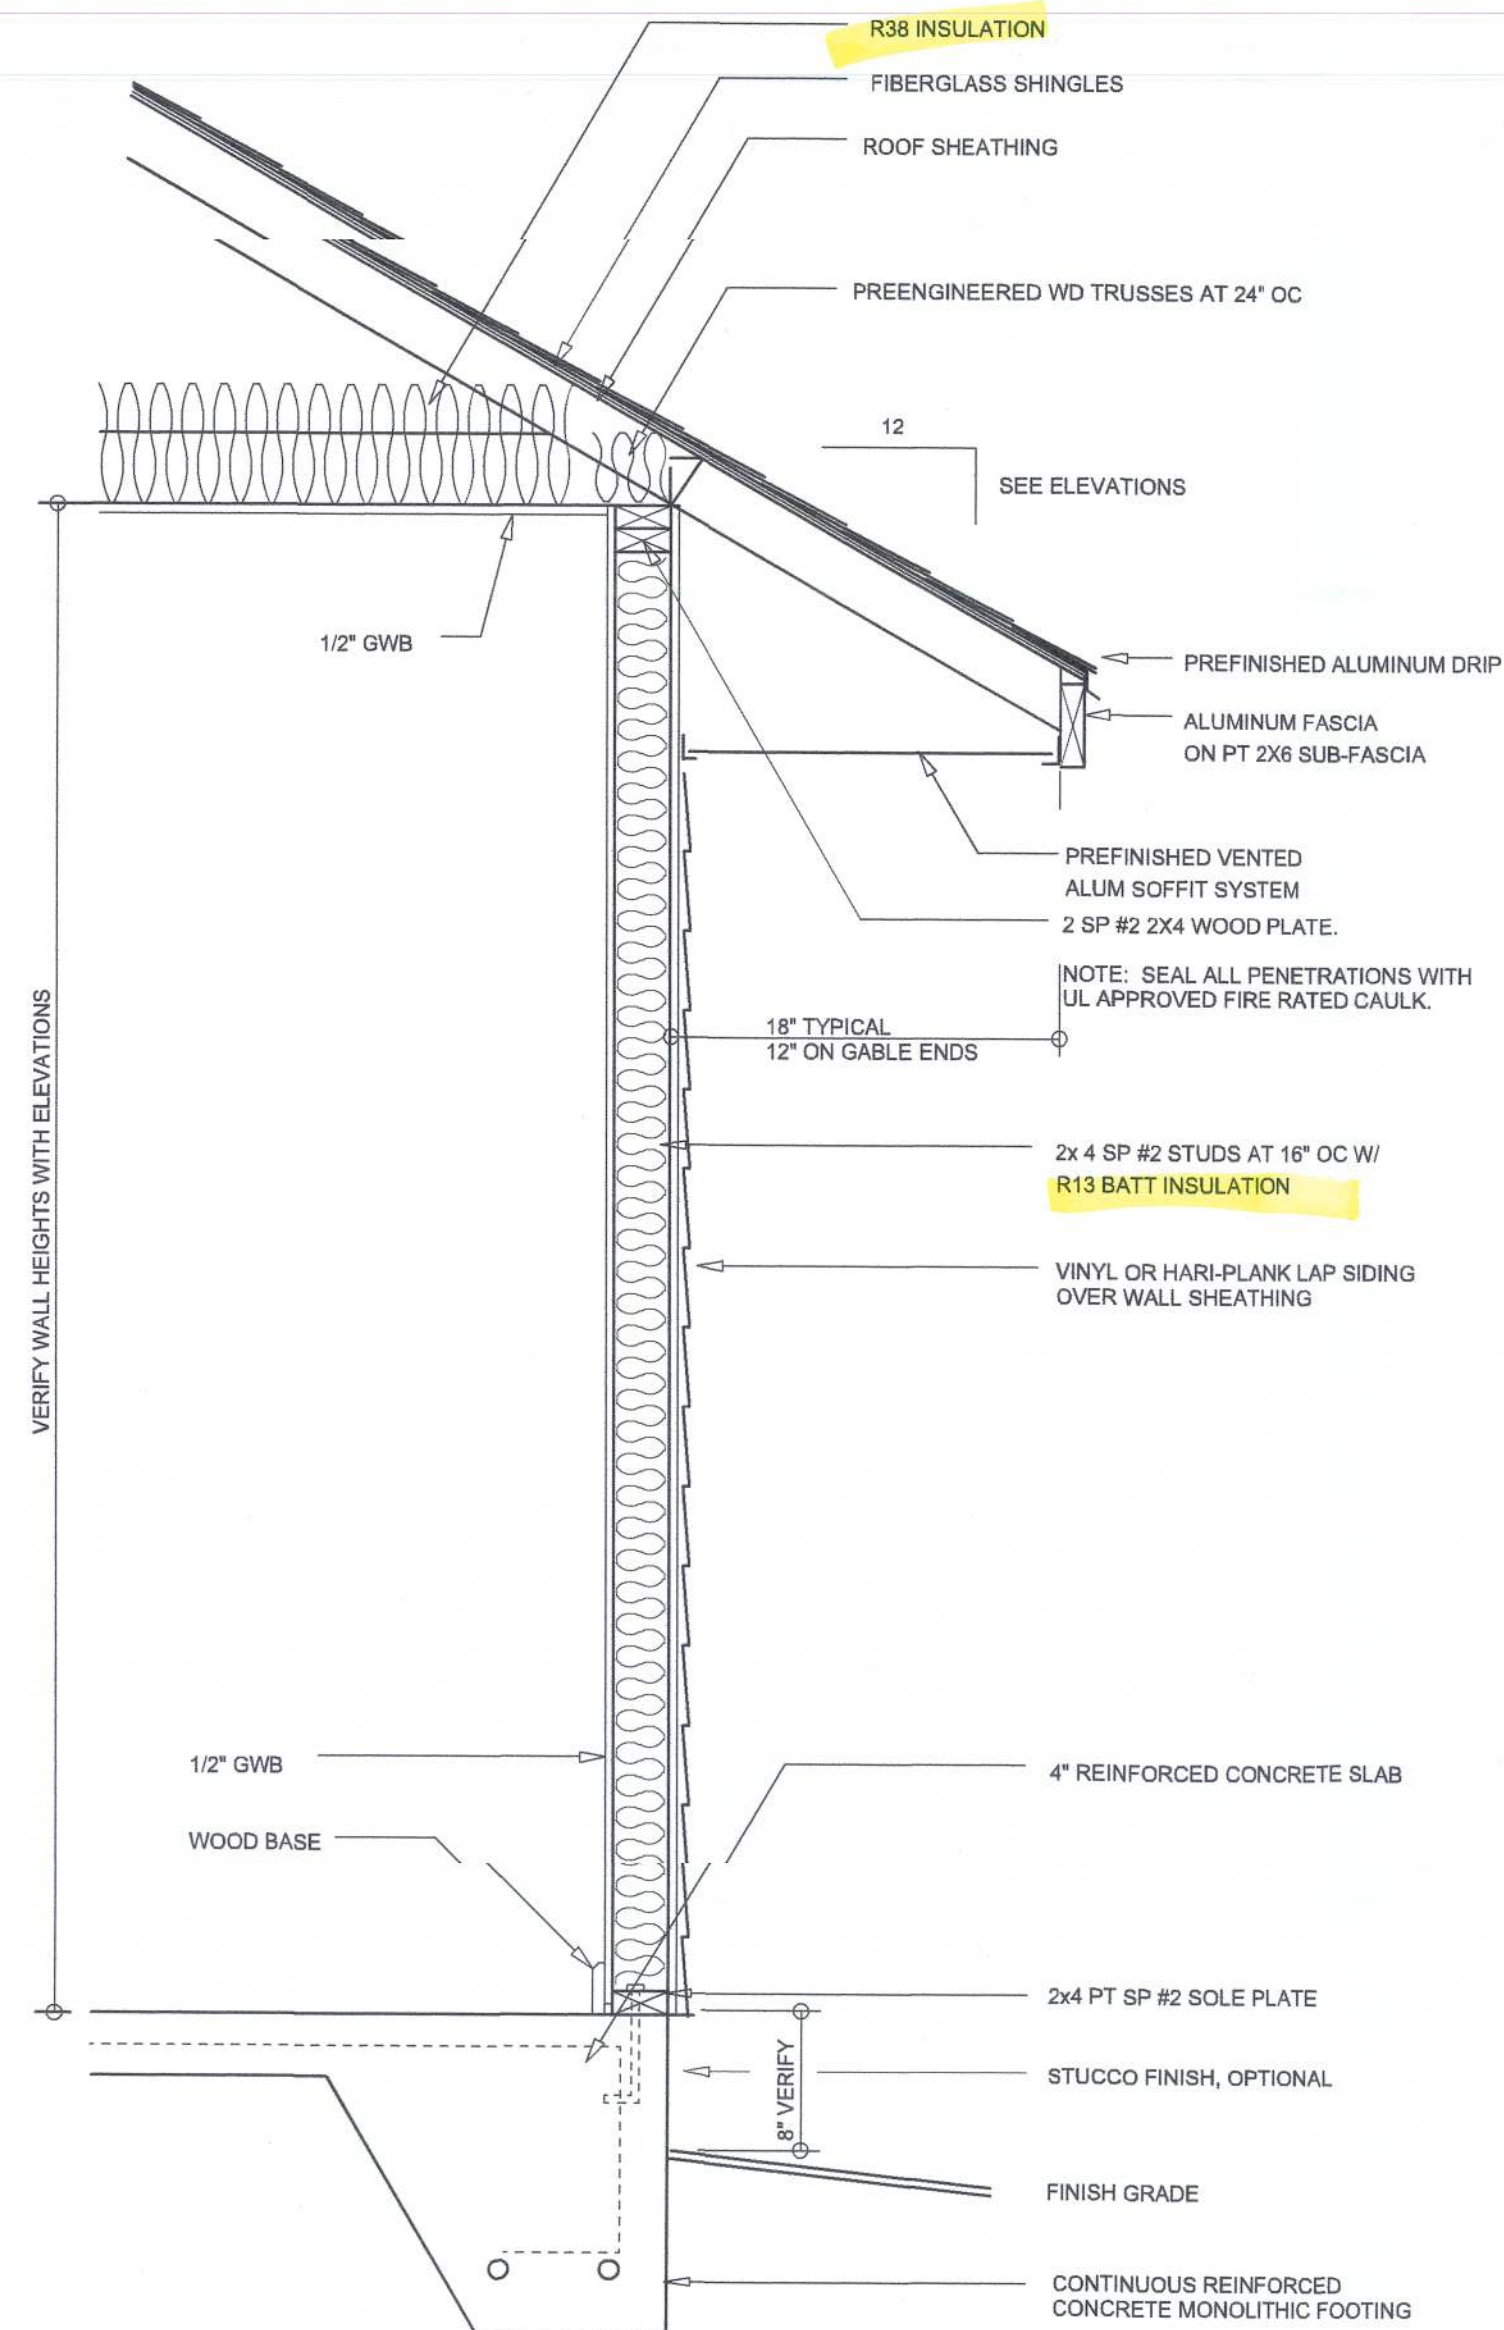

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

THE WESTERN WOOD CUSTOM FOR:
Alvin and Patricia Barnett
PROJECT ADDRESS: Lot, Country Lake in Woodborough, Columbia County, Florida 32055
GIBALTAR CONTRACTING, LLC.
LIC# 1259633 HIGSPRINGS, FLORIDA

© WM DESIGN &
ASSOCIATES, INC.
5 SW COMMERCE DR, STE 130
LAKE CITY, FL 32025
(386) 758-8406
will@willmyers.net

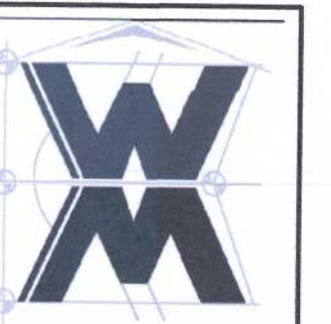

OB NUMBER
20210417

SHEET NUMBER

A.1



Wahl C-777



NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS


REVISIONS
October 06, 2021

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

LEFT & RIGHT ELEVATIONS
SCALE: 1/4" = 1'-0"

THE WESTERN MODL CUSTOM FOR:
Alvin and Patricia Barnett
PROJECT ADDRESS: Lot, Country Lake in Woodborough, Columbia County, Florida 32055
GIBRALTAR CONTRACTING, LLC.
LIC# 1259633 HIGSPRINGS, FLORIDA

© WM DESIGN & ASSOCIATES, INC.
426 SW COMMERCIAL DR. STE 130
LAKE CITY, FL 32025
(386) 758-8406
wm@willmyers.net

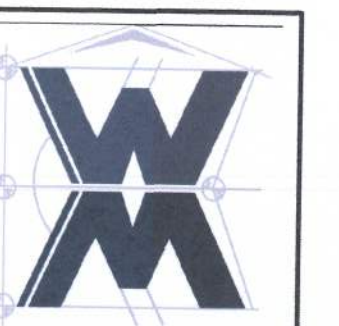

JOB NUMBER
20210417

SHEET NUMBER
A.2

Will C. Myers


Garage fire separations shall comply with the following:

1. The private garage shall be separated from the dwelling unit and its attic area by means of a minimum 1/2-inch (12.7 mm) gypsum board applied to the garage side. Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8-inch Type X gypsum board or equivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or solid or honeycomb core steel doors not less than 13/8 inches (34.9 mm) thick, or doors in compliance with Section 715.3.3. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted.

2. Ducts in a private garage and ducts penetrating the walls or ceilings separating the dwelling unit from the garage shall be constructed of a minimum 0.019-inch (0.48 mm) sheet steel and shall have no openings into the garage.

3. A separation is not required between a Group R-3 and U carport provided the carport is entirely open on two or more sides and there are not enclosed areas above.

4. When installing an attic access and/or pull-down stair unit in the garage, devise shall have a minimum 20 min. fire rating.

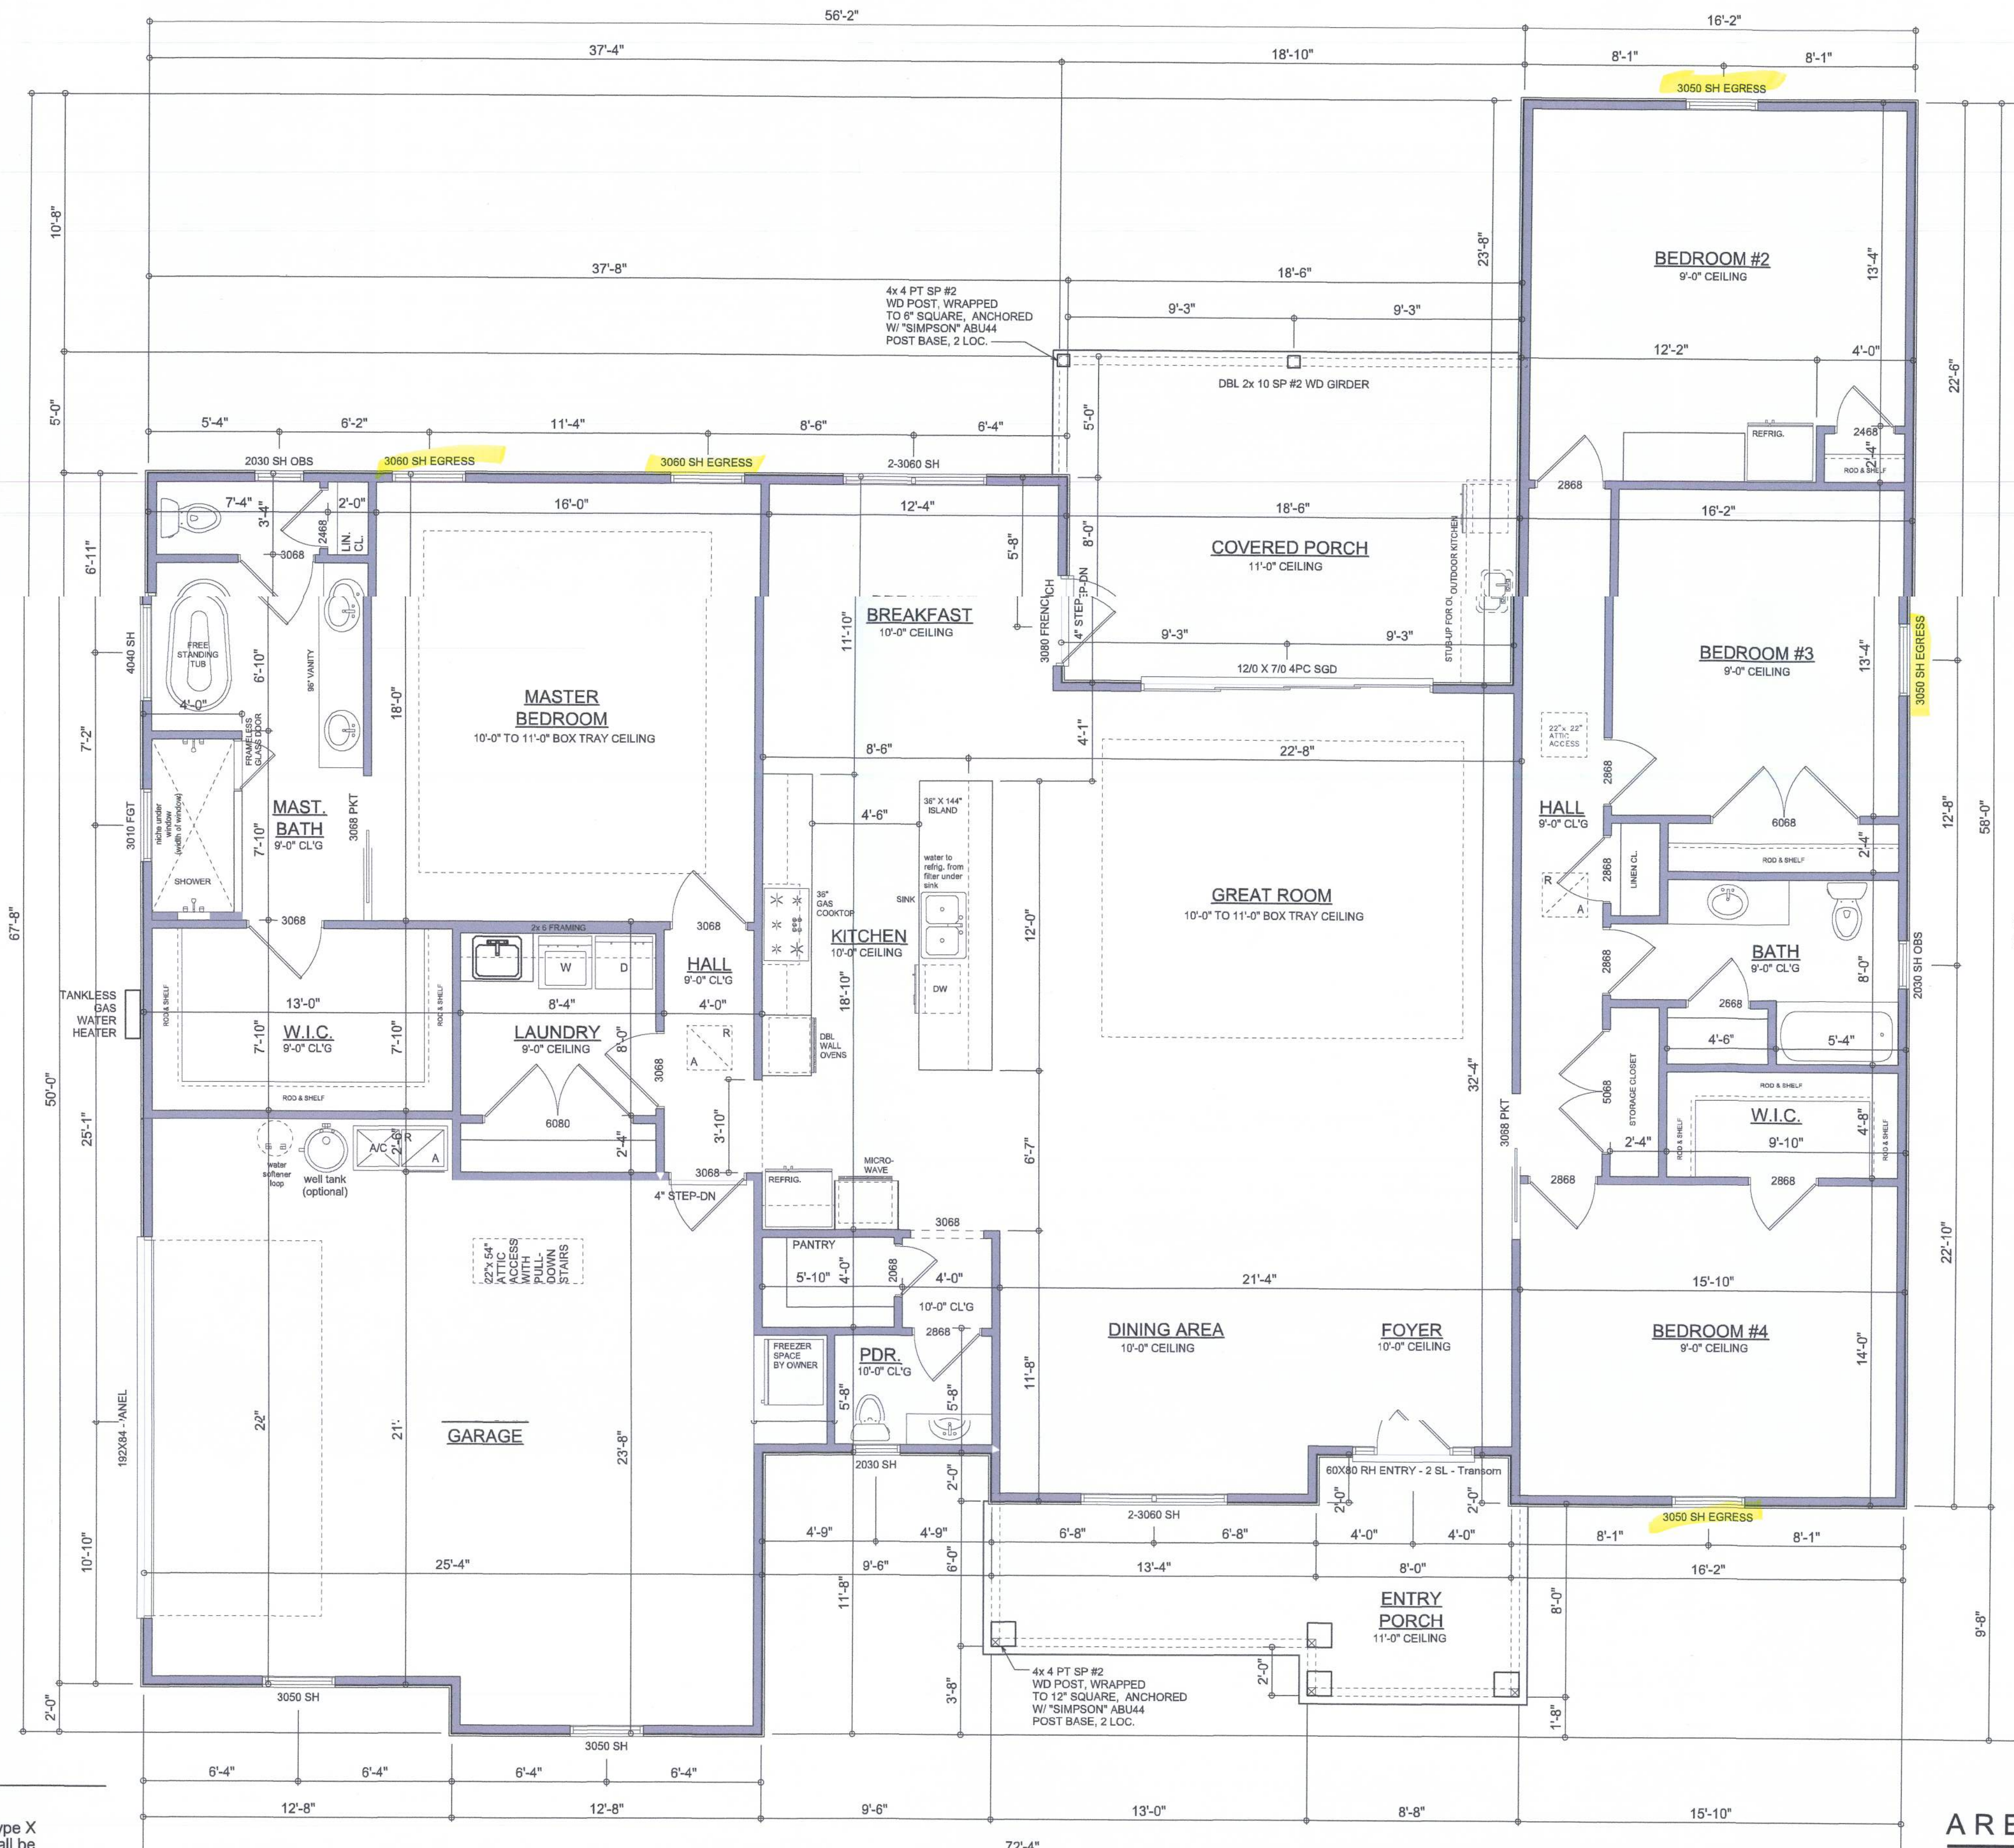

FLOOR PLAN

SCALE: 1/4" = 1'-0"

NOTE: ALL WALLS SHALL BE 9'-0" UNLESS OTHERWISE NOTED.

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

AREA SUMMARY

LIVING AREA	2,742	S.F.
GARAGE AREA	610	S.F.
COVERED PORCH AREA	242	S.F.
ENTRY PORCH AREA	163	S.F.
TOTAL AREA	3,757	S.F.

REVISIONS	DATE
October 06, 2021	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

DIMENSIONED FLOOR PLAN
SCALE: 1/4" = 1'-0"

THE "WESTERN MOEL CUSTOM" FOR:
Alvin and Patricia Barnett
PROJECT ADDRESS: #20, Country Lake in Woodborough, Columbia County, Florida 32055
GIBRALTR CONTRACTING, LLC.
LIC# 1259633 HH SPRINGS, FLORIDA

© WM DESIGN & ASSOCIATES, INC.
426 SW COMMERCE DR, STE 130
LAKE CITY, FL 32025
(386) 758-8406
will@willmymers.net



JOB NUMBER
20210417

SHEET NUMBER

A.3

Will C. Myers

ELECTRICAL LEGEND	
	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	RECESSED CAN LIGHT
	BATH EXHAUST FAN
	LIGHT FIXTURE
	DUPLEX OUTLET (AFCI & TAMPER RESISTANT)
	220v OUTLET
	GFI DUPLEX OUTLET (PER NEC 406.8)
	TELEVISION JACK
	CIRCUIT FOR MINI-SPLIT A/C UNIT
	SMOKE / CARBON MONOXIDE DETECTOR (see note below)
	WALL SWITCH
	3 WAY WALL SWITCH
	WATER PROOF GFI OUTLET
	2 OR 4 TUB FLUORESCENT FIXTURE


NOTE:
ALL INTERIOR RECEPTACLES SHALL BE AFCI
(ARC FAULT CIRCUIT INTERRUPT) PER NEC 210.12 & TAMPER RESISTANT PER
NEC 406.11

ALL INTERIOR & EXTERIOR LIGHTING SHALL MEET OR EXCEED THE MIN. 75% HIGH-EFFICIENCY
LIGHTING PER FBC-ENERGY CONSERVATION R404.

ALL SMOKE DETECTORS BE A COMBO SMOKE & CARBON MONOXIDE DETECTOR
AND SHALL HAVE BATTERY BACKUP POWER
AND ALL WIRED TOGETHER SO IF ANY ONE UNIT IS ACTUATED THEY
ALL ACTIVATE.

INSTALLED ON THE EXTERIOR OF STRUCTURES TO SERVE AS A DISCONNECT MEANS.
CONDUCTORS USED FROM THE EXTERIOR DISCONNECTING MEANS TO A PANEL OR SUB
PANEL SHALL HAVE FOUR-WIRE CONDUCTORS, OF WHICH ONE CONDUCTOR
SHALL BE USED AS AN EQUIPMENT GROUND.

IT IS THE LICENSED ELECTRICAL CONTRACTORS RESPONSIBILITY TO INSURE THAT ALL
WORK PERFORMED AND EQUIPMENT INSTALLED MEETS OR EXCEEDS THE 2017 (NFPA-70) NATIONAL
ELECTRIC CODE AND ALL OTHER LOCAL CODES AND ORDINANCES.

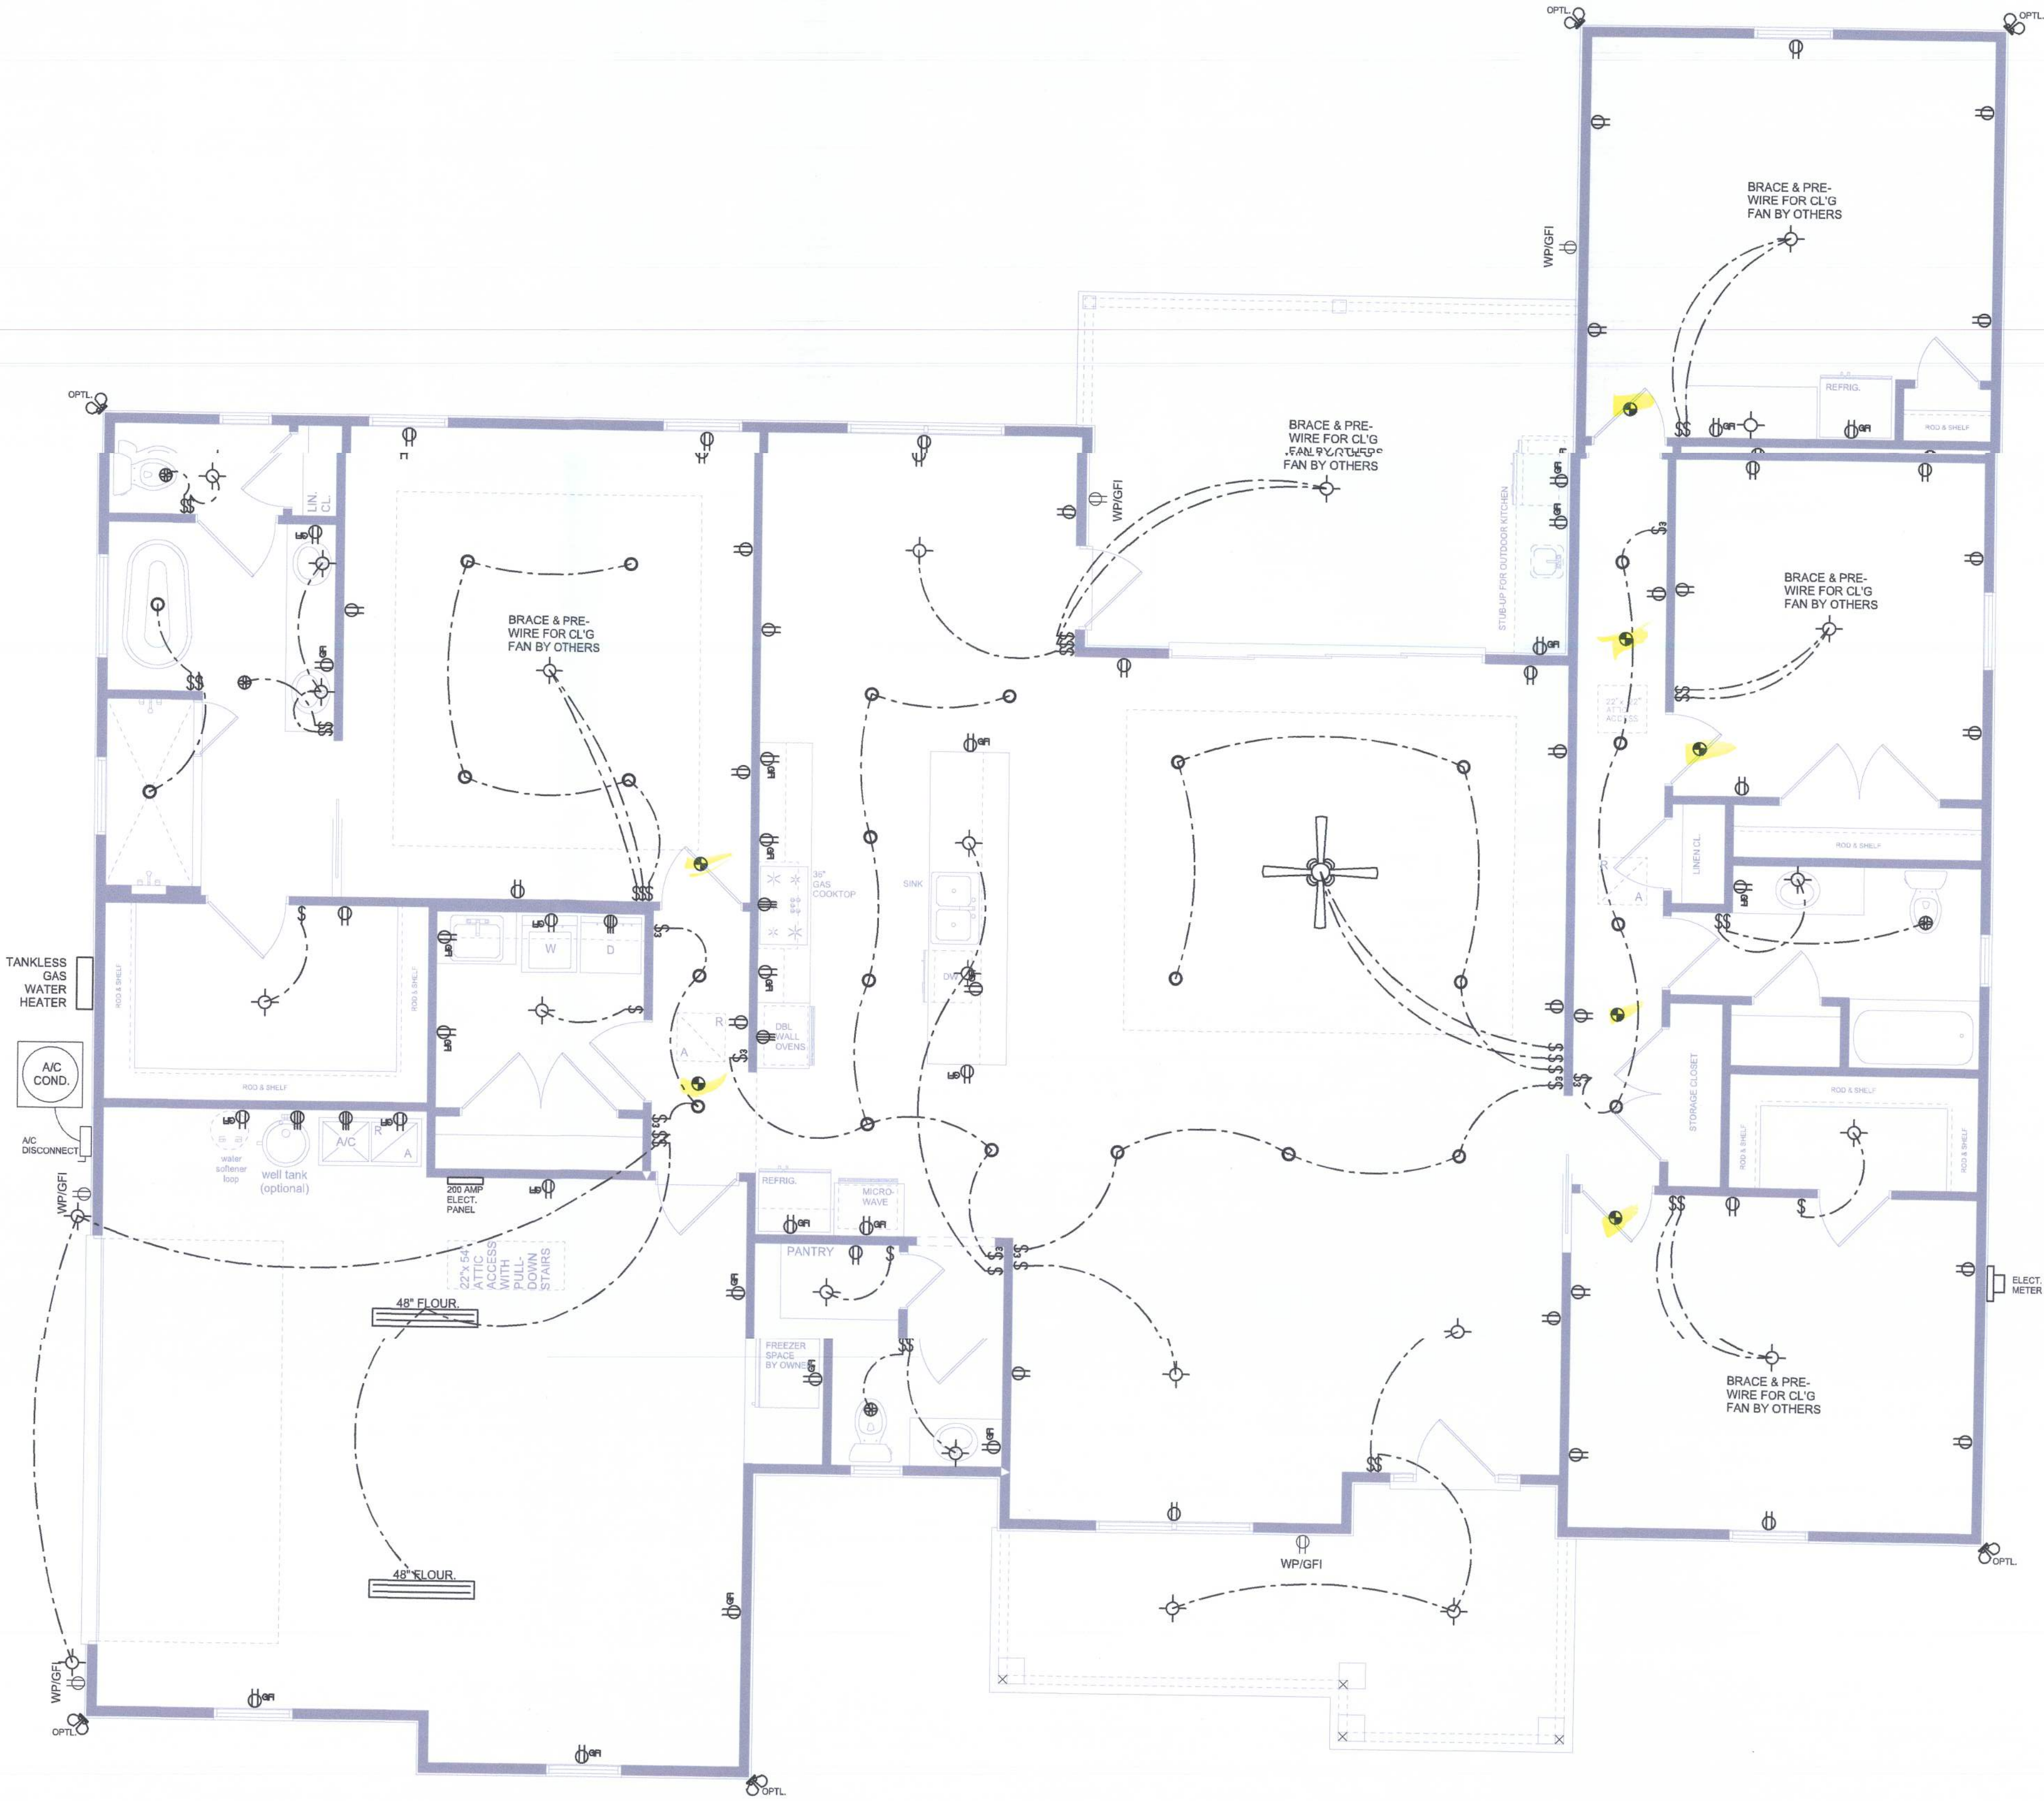

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

Will C. [Signature]

REVISIONS
October 06, 2021

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

THE WESTERN MODELCUSTOM FOR:
Alvin and Patricia Barnett
PROJECT ADDRESS: Lot 2 Country Lake in Woodborough, Columbia County, Florida 32055

GIBALTALTA CONTRACTING, LLC.
LIC# 1259633 HIGH PRINGS, FLORIDA

© WM DESIGN &
ASSOCIATES, INC.
426 SW COMMERCE DR. STE 130
LAKE CITY, FL 32025
(386) 758-8406
wm@wmjens.net



JOB NUMBER 20210417
SHEET NUMBER A.4

1. DESIGN SOIL BEARING PRESSURE: 1000 PSF.
2. EXPANSIVE SOILS: WHERE DIRECTED BY THE SOILS ENGINEER, SOIL AUGMENTATION PER THE SOILS ENGINEER'S SPECIFICATIONS SHALL BE IMPLEMENTED PRIOR TO PLACING ANY FOUNDATIONS - TESTS AS SPECIFIED SHALL BE PERFORMED TO DETERMINE THE SUITABILITY OF THE SUB-GRADE TO SUPPORT THE DESIGN LOADS.
3. CLEAN SAND FILL OVER STRIPPED AND COMPACTED EXISTING GD. SHALL BE PLACED IN 12" LIFTS. BOTH SUB-SOIL AND FILL COMPACTION SHALL BE NOT LESS THAN 98% AS MEASURED BY A MODIFIED PROCTOR TEST AT THE RATE OF ONE TEST FOR EACH 1500 SF OF BUILDING PAD AREA, OR FRACTION THEREOF, FOR EACH 12" LIFT.
4. REINFORCING STEEL SHALL BE GRADE 60 AND MEET THE REQUIREMENTS OF ASTM A615, ALL BENDS SHALL BE MADE COLD.
5. WELDED WIRE MESH SLAB REINFORCING SHALL MEET THE REQUIREMENTS OF ASTM A185 - MIN. YIELD STRESS = 85 KSI.
6. CONCRETE SHALL BE STANDARD MIX $F_c = 3000$ PSI FOR ALL FTGS. SLABS, COLUMNS AND BEAMS OR SHALL BE STANDARD PUMP MIX $F_c = 3000$ PSI. STRENGTH SHALL BE ATTAINED WITHIN 28 DAYS OF PLACEMENT. MIXING, PLACING AND FINISHING SHALL BE AS PER ACI STANDARDS.
7. CONCRETE BLOCK SHALL BE AS PER MANUFACTURER'S PRODUCT GUIDE FOR ASTM C-80 REQUIREMENTS WITH MEDIUM SURFACE FINISH FOR ASTM C-90 REQUIREMENTS WITH MEDIUM SURFACE FINISH - $F_m = 1500$ PSI.
8. MORTAR SHALL BE TYPE "M" OR "N" FOR ALL MASONRY UNITS.
9. STRUCTURAL STEEL SHALL CONFORM TO ASTM A36 STANDARDS FOR STRENGTH, BOLTS SHALL BE ASTM A307 / GRADE 1 OR A325, AS PER PLAN REQUIREMENTS.
10. WELDS SHALL BE AS PER "AMERICAN WELDING SOCIETY" STANDARDS FOR STRUCTURAL STEEL APPLICATIONS.
11. 2X4 P/T WOOD SILL, CONT., ALL AROUND, W/ 5/8" - A.B. W/ 3" SQ. X 1/4" PLATE WASHERS WITHIN 6" FROM EACH CORNER, EA. WAY, & WITHIN 6" FROM ALL WALL OPENINGS - 102" - A.B. W/ 2" SQ. WASHERS ALONG EACH RUN @ 48" O.C. MAX. - ALL ANCHOR BOLTS SHALL HAVE A MINIMUM OF 8" EMBEDMENT INTO THE CONCRETE.

NOTE:
H.V.A.C. CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP
DRAWINGS INDICATING ALL H.V.A.C. WORK, INCLUDING ALL
DUCTWORK LOC., SIZES, LINES, EQUIPMENT SCH. & BALANCING
REPORT - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS
TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

[illegible]


4" CONC. 3000 PSI MIN. W/ 6x6/10:10 WWM ON CHAIRS @ 36" O.C., OVER
6 MIL POLY VAPOR BARRIER W/ JOINTS LAPPED 6" MIN. AND
SEALED W/ POLY VAPOR TAPE, ON TERMITE TREATED SOIL
(TERMITICIDE OR ALTERNATIVE METHOD), COMPACTED
TO 95% MAX DRY DENSITY MOD PROCTOR.

A
S.1


[illegible]

Wall C-779


A.5

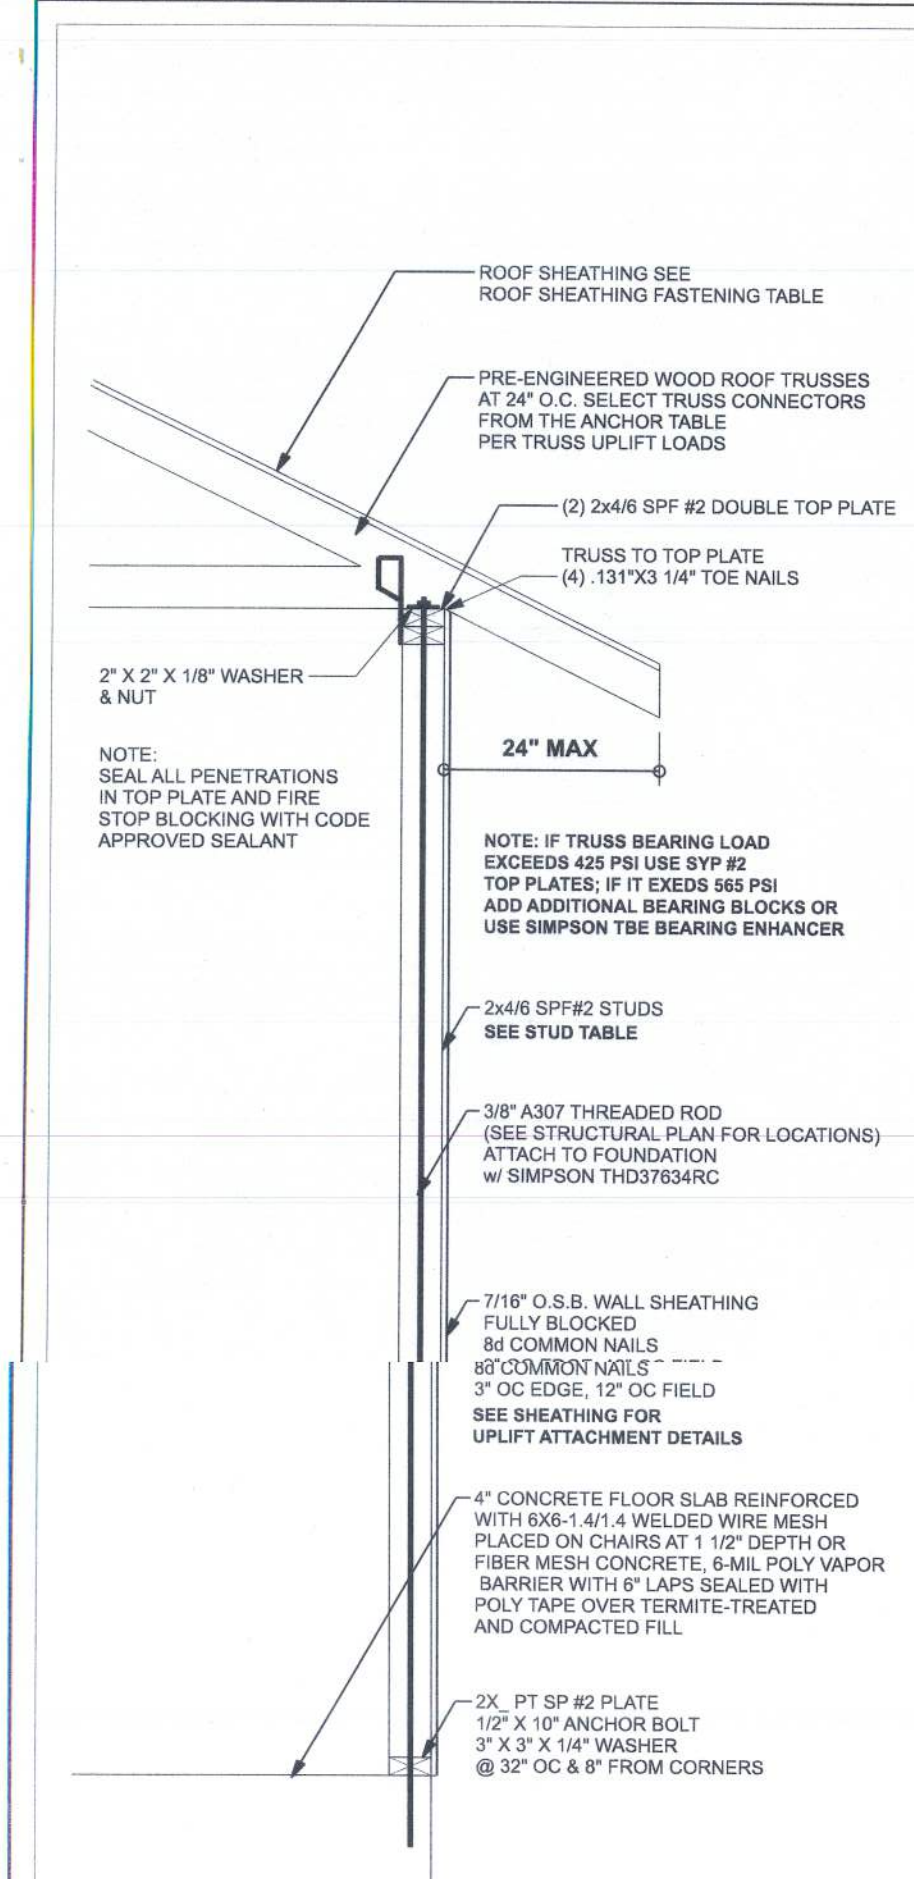

ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

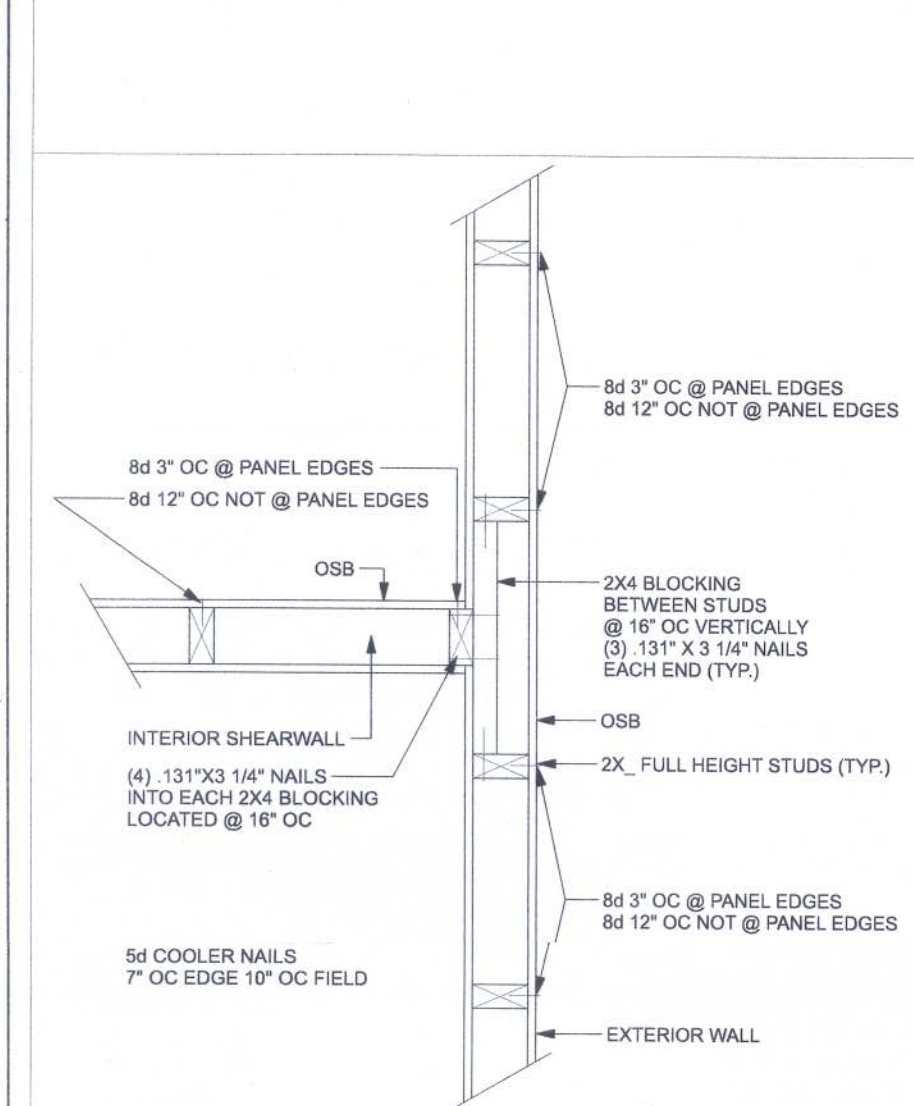

(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

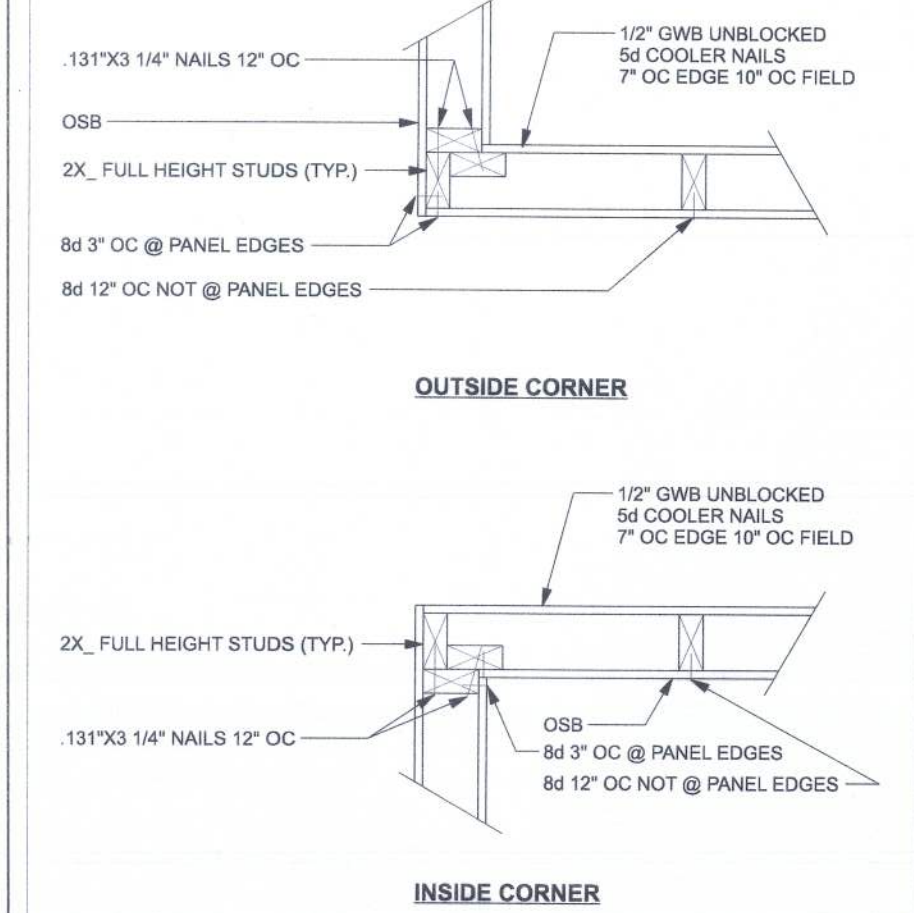


(TYP.) CORNER FRAMING
WOOD FRAME

ROOF SHEATHING FASTENING TABLE (RAFTER / TRUSS SG = 0.40)


Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RRSR-01 (2 3/8" x 0.113")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RRSR-01 (2 3/8" x 0.113")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RRSR-01 (2 3/8" x 0.113")	6" oc	6" oc
130 mph Exp. C	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. D	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RRSR-01 (2 3/8" x 0.113")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RRSR-03 (2 1/2" x 0.131") or ASTM F1667 RRSR-04 (3" x 0.120")	4" oc	4" oc

Note: For sheathing located a minimum of 4 feet from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 8 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based on the type of roofing material being used. See manufacturer Florida product approvals.

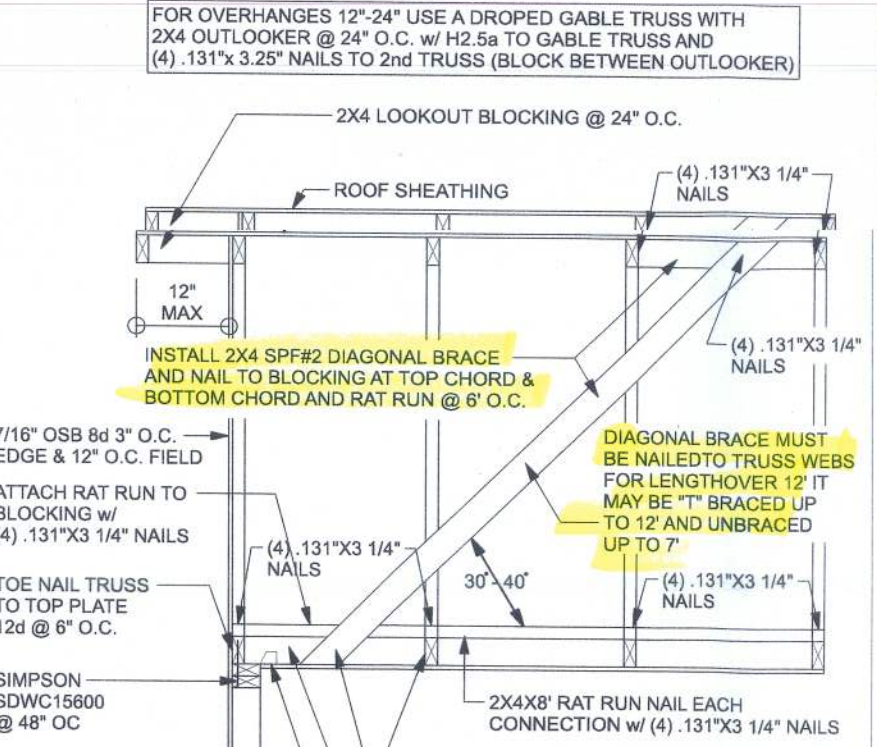


(TYP.) GABLE BRACING DETAIL
WOOD FRAME


SPACE RAT RUN & DIAGONAL BRACE 6'-0" O.C.
FOR GABLE HEIGHT UP TO 25'-0" 130 MPH, EXP. C, ENCLOSED

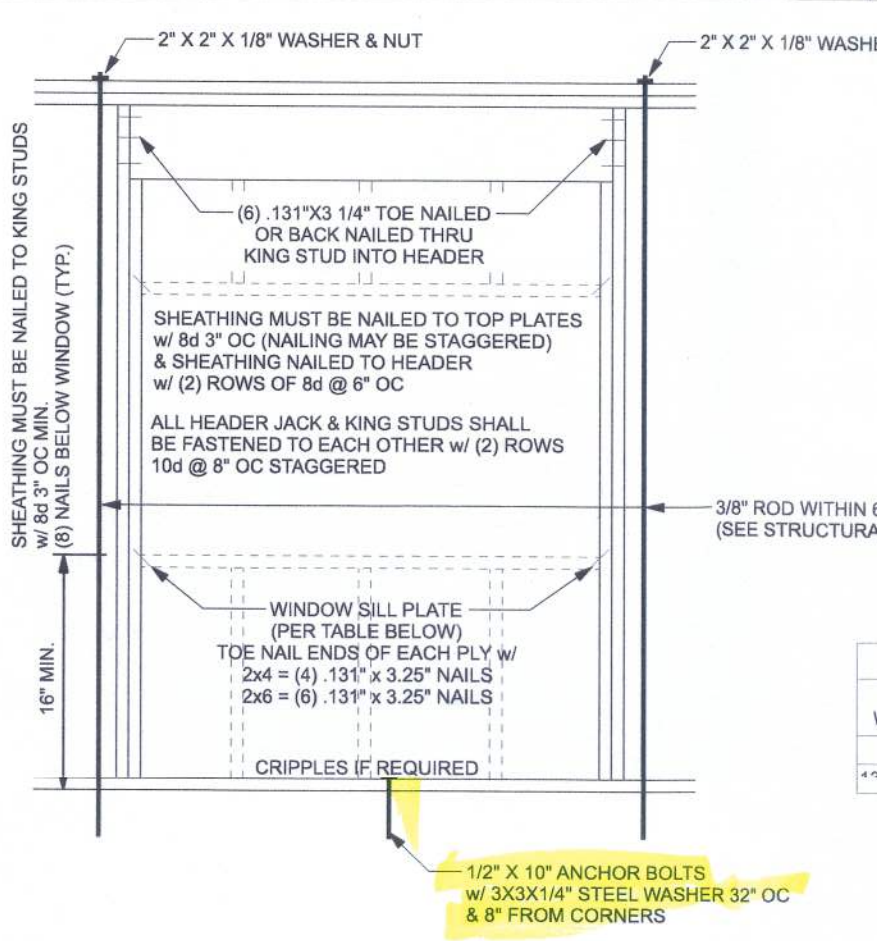


TYPICAL HEADER STRAPPING DETAIL
ONE STORY WOOD FRAME

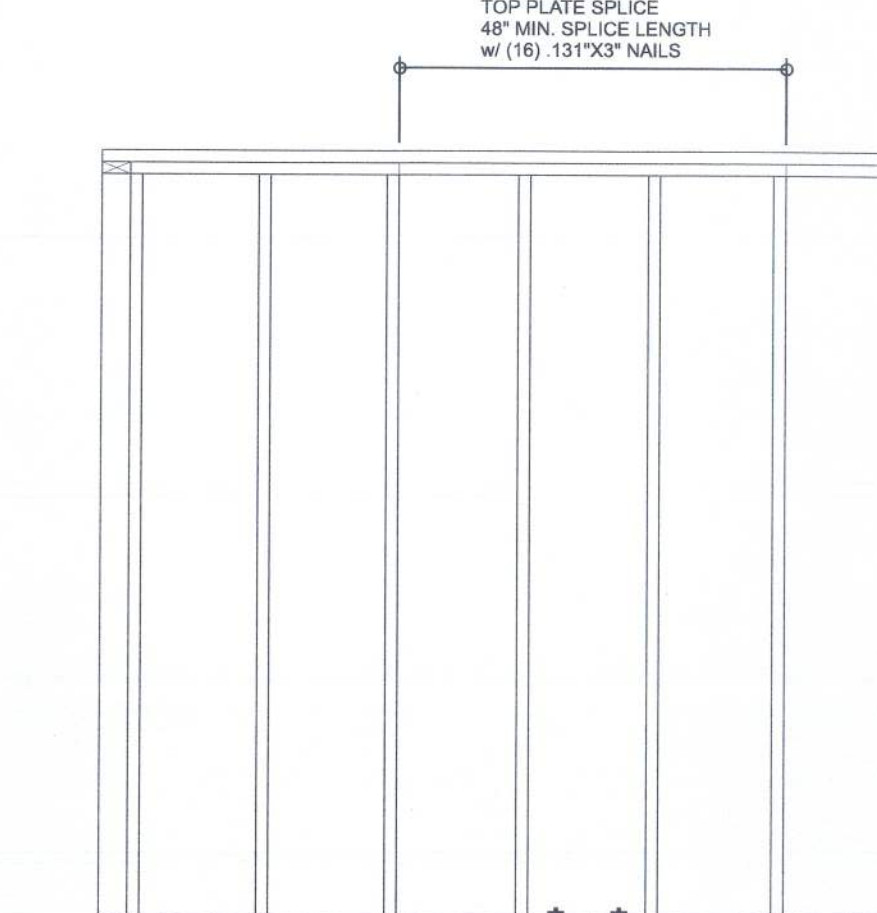


(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

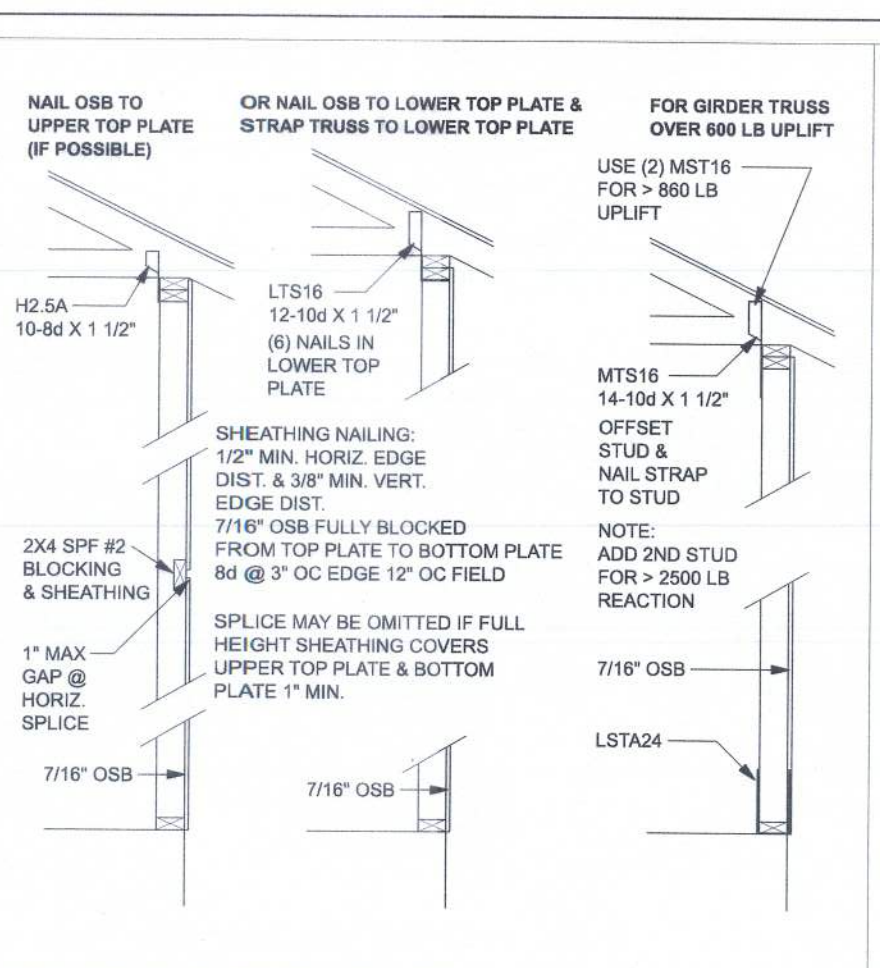


SHEATHING FOR UPLIFT ATTACHMENT DETAILS
ONE STORY WOOD FRAME

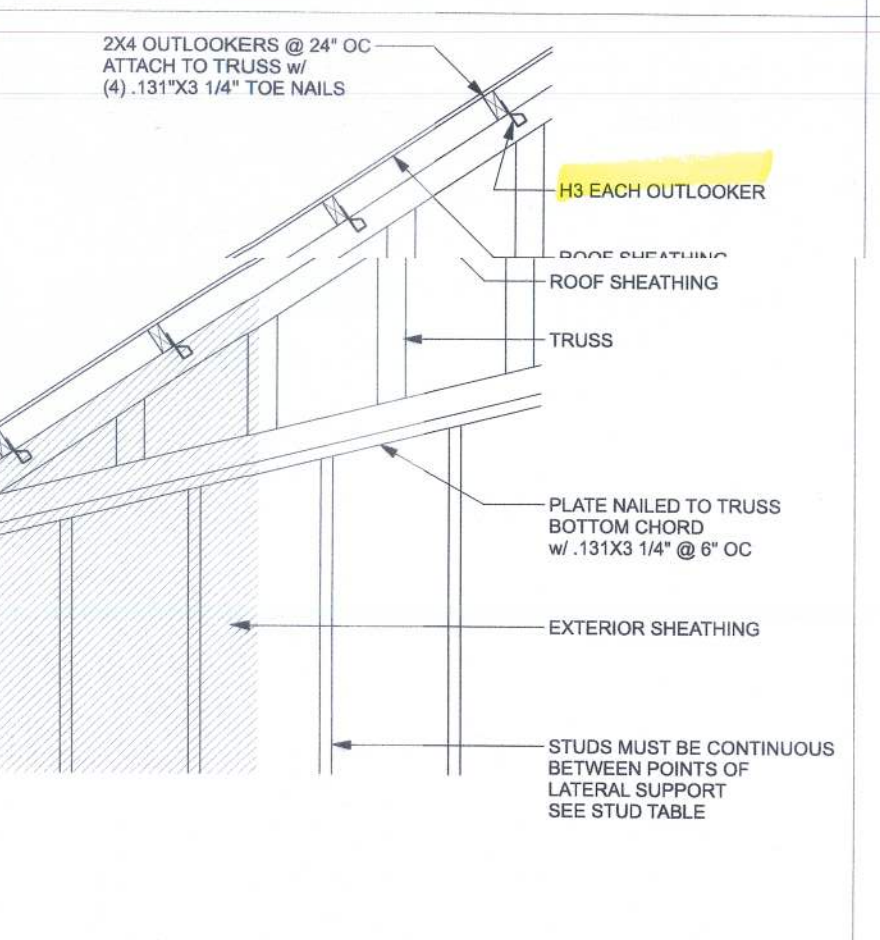


(TYP.) PORCH POST
ONE STORY WOOD

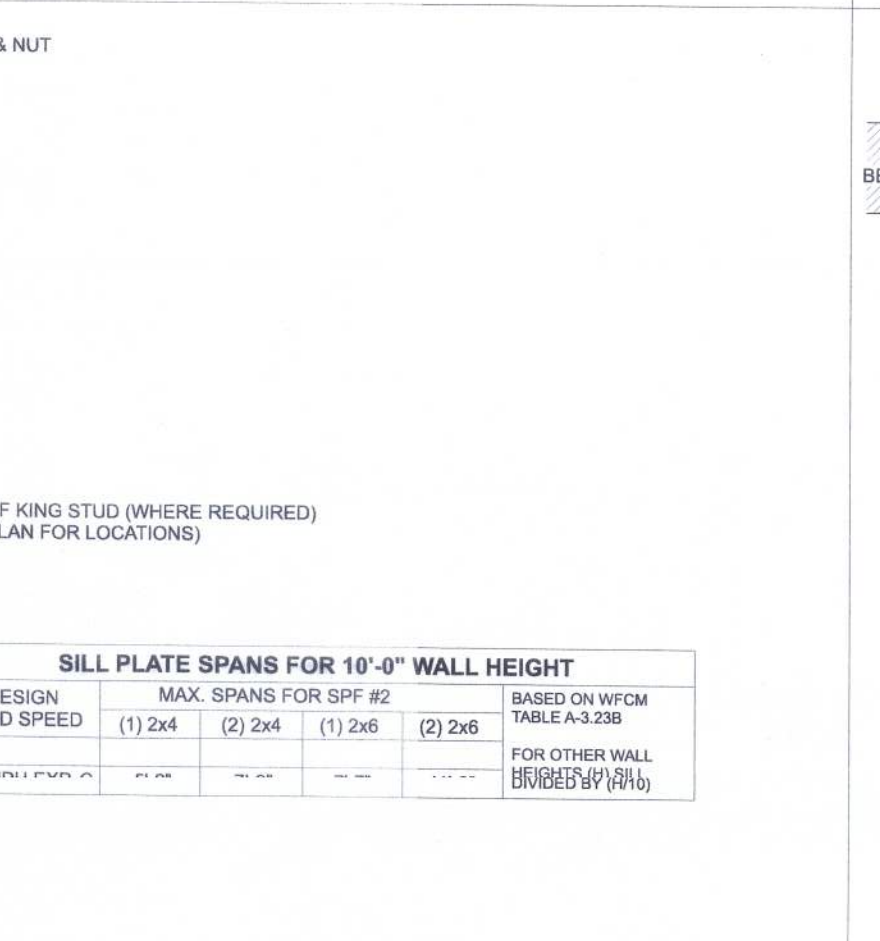


(TYP.) BEAM TO WALL
WOOD FRAME W/ RODS

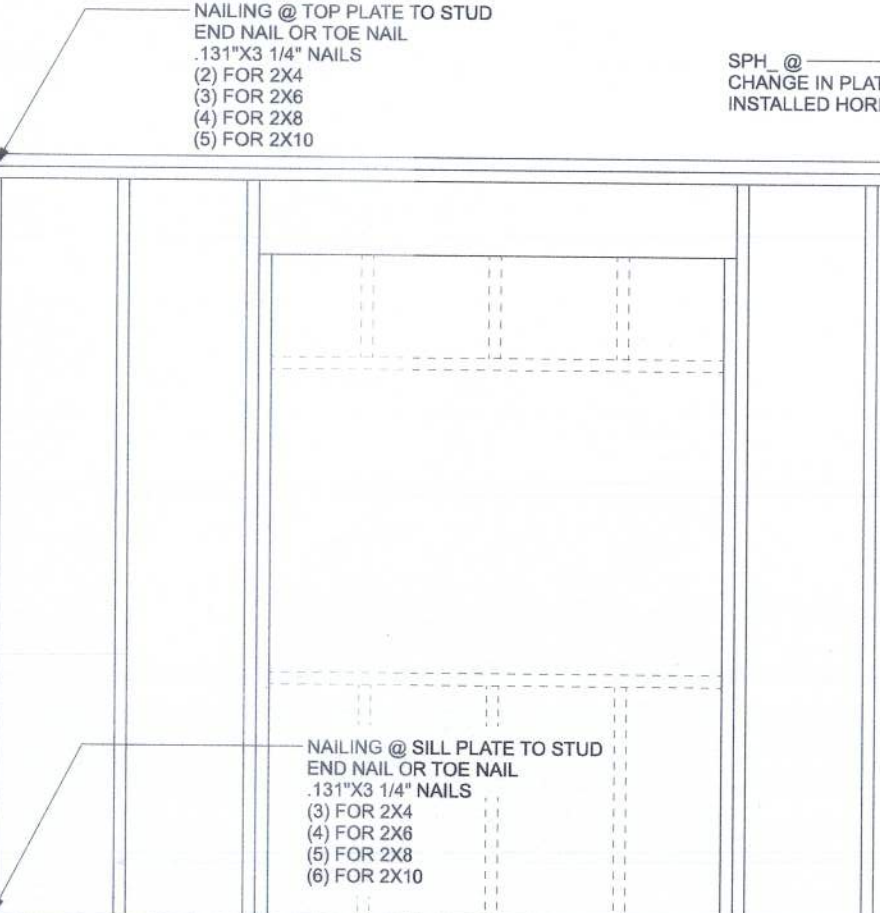


(TYP.) GARAGE DOOR BUCK INSTALLATION
WOOD FRAME

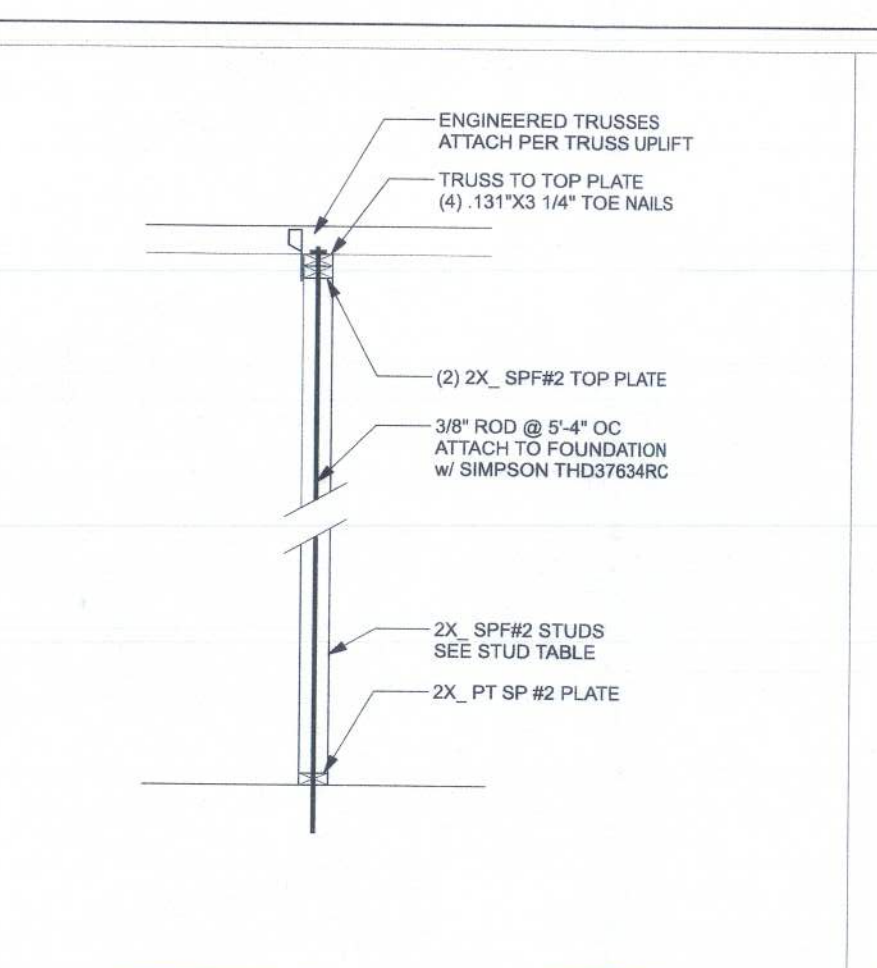


(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME W/ RODS

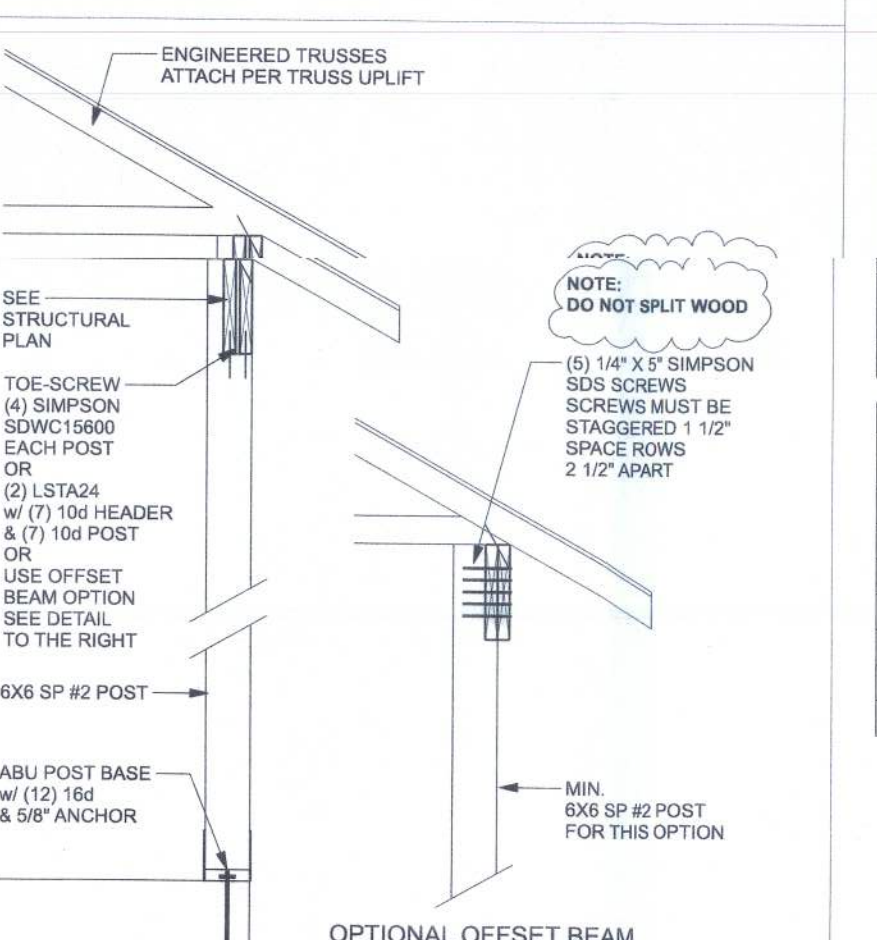

(TYP.) GABLE WALL W/ VAULTED CEILING
WOOD FRAME

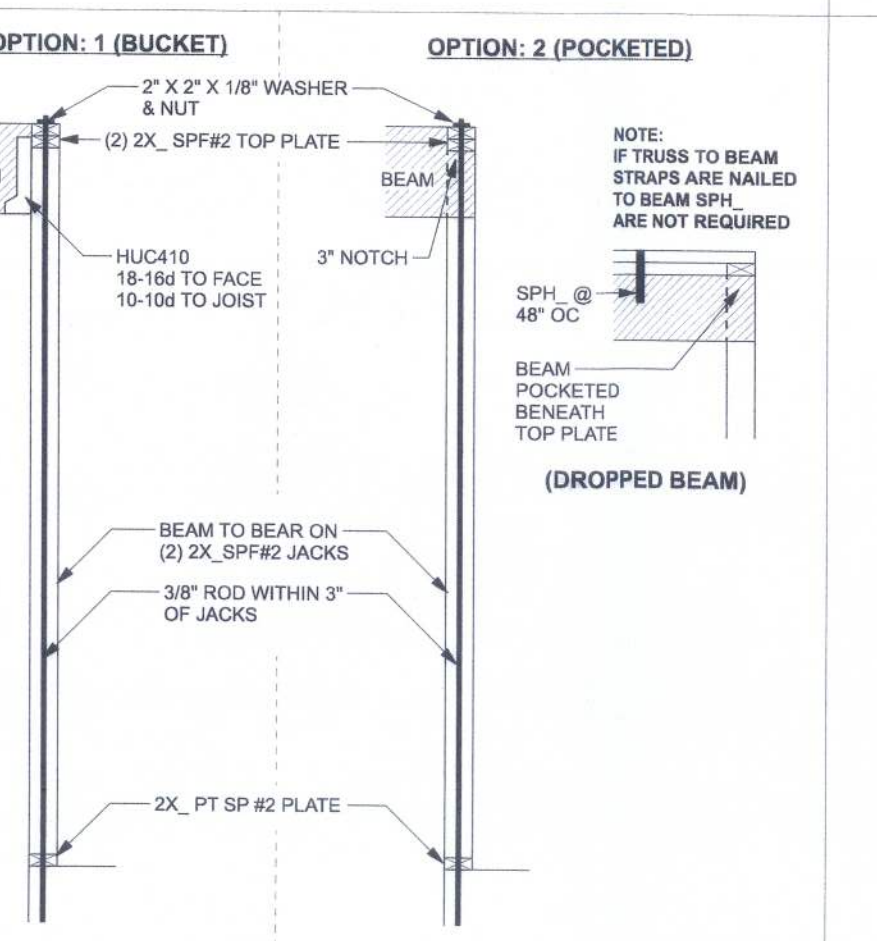

SILL PLATE SPANS FOR 10'-0" WALL HEIGHT

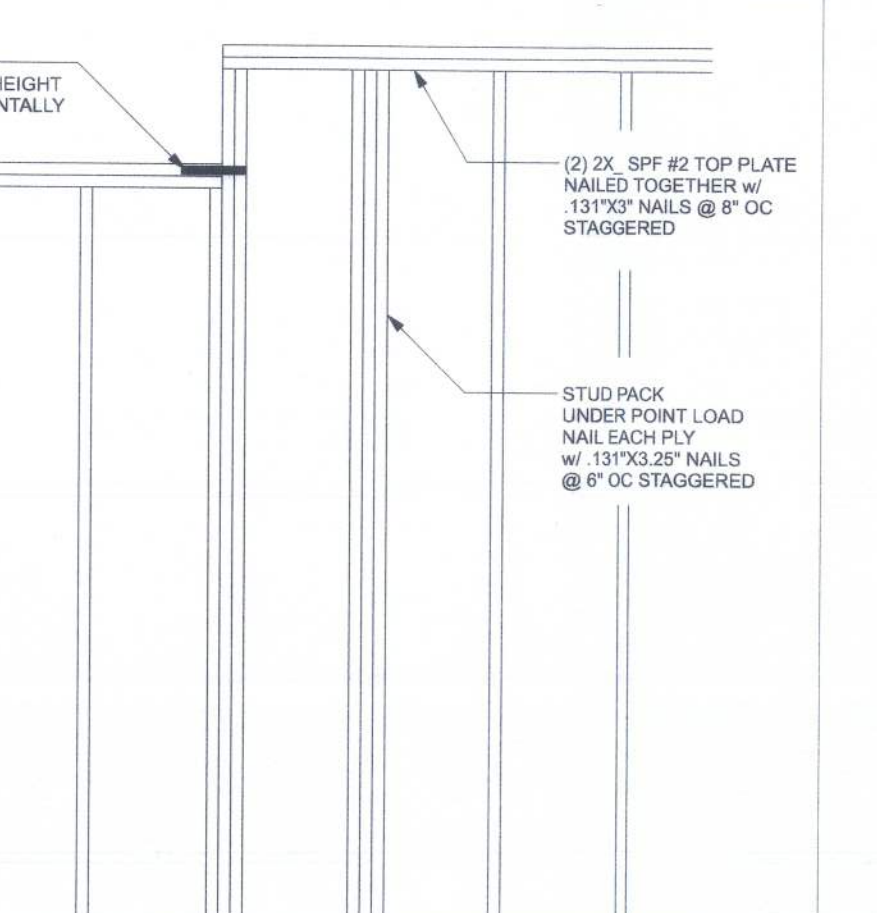

2X6 SPF #2 GARAGE DOOR BUCK ATTACHMENT

CONNECTOR TABLE

Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
615	485	SDWC15600	-	-
415	290	H3	4-8d x 1 1/2"	4-8d x 1 1/2"
575	495	H2.5A	5-8d x 1 1/2"	5-8d x 1 1/2"
1340	1015	H16A	9-10d x 1 1/2"	9-10d x 1 1/2"
720	620	LTS12-20	6-10d x 1 1/2"	6-10d x 1 1/2"
1000	860	MTS12-30	7-10d x 1 1/2"	7-10d x 1 1/2"
1450	1245	MTS20-30	12-10d x 1 1/2"	12-10d x 1 1/2"
Uplift SP	Uplift SPF	Strap Ties	To One Member	To Other Member
1235	1235	LSTA21	9-10d	9-10d
1640	1455	MSTA24	9-10d	9-10d
1000	1000	C520	7-10d	7-10d
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate
585	535	SP1	6-10d	4-10d
1065	605	SP2	6-10d	6-10d
771	771	LSTA24	14-10d	wrap under or over plate
1235	1235	LSTA24	14-10d	wrap under or over plate
Uplift SP	Uplift SPF	Holdowns @ Stenwall	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 14"x1 1/2"	12"x12" Titen HD
4235	3640	HTT4	18-16d x 12"	12"x12" Titen HD
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 14"x1 1/2"	12"x12" Titen HD
4235	3640	HTT4	18-16d x 12"	12"x12" Titen HD
Uplift SP	Uplift SPF	Post Bases @ Stenwall	To Post	Anchor
2200	2200	ABL44	12-16d	5/8"x12" Drill & Epoxy
2300	2300	ABL66	12-16d	5/8"x12" Drill & Epoxy
Uplift SP	Uplift SPF	Post Bases @ Mono	To Post	Anchor
2200	2200	ABL44	12-16d	5/8"x12" Drill & Epoxy
2300	2300	ABL66	12-16d	5/8"x12" Drill & Epoxy

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:

THIS STUD HEIGHT TABLE IS PER 2012 WFCM, TABLE 3.20B5, EXTERIOR LOAD BEARING & NON LOAD BEARING STUD HEIGHTS FOR WALLS WITH OSB EXTERIOR AND 1/2" GYP INTERIOR RESISTING INTERIOR ZONE WINDLOADS, 130 MPH, EXPOSURE C, STUD DEFLECTION LIMIT H/240 (NOT OK FOR BRITTLE FINISH). STUD SPACINGS SHALL BE MULTIPLIED BY 0.8 FOR FRAMING LOCATED WITHIN 4 FEET OF CORNERS FOR END ZONE LOADING. (END ZONE EXAMPLE 16" O.C. x 0.8 = 12.8" O.C.)


STUD HEIGHT	STUD SPACING
10'-0" STUD HEIGHT	16" O.C.
11'-0" STUD HEIGHT	12" O.C.
12'-0" STUD HEIGHT	12" O.C.
13'-0" STUD HEIGHT	12" O.C.
14'-0" STUD HEIGHT	12" O.C.
15'-0" STUD HEIGHT	12" O.C.
16'-0" STUD HEIGHT	12" O.C.
17'-0" STUD HEIGHT	12" O.C.

GRADE & SPECIES TABLE

Grade	Species	Fb	E
2x8	SP #2	925	1.4
2x10	SP #2	800	1.4
2x12	SP #2	750	1.4
GLB	24F-V3 SP	2600	1.9
LVL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PSL	PARALAM	2900	2.0

GENERAL NOTES:
TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCE TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS TO TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END, 2X6 RAFTERS 700 LB EACH END.
SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN.
FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS. ASSUME 1000 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE.
CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, Fc = 2500 PSI.
WELDED WIRE REINFORCED SLAB: 8" x 6" W1.4 x W1.4, FB & BSL WELDED WIRE REINFORCEMENT FABRIC (W.W.R.) CONFORMING TO ASTM A166, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.
FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT: FIBER LENGTH 12 INCH TO 2 INCHES, DOSEAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. REINFORCE TO COMPLY WITH ASTM C 1118. SUPPLY EIT TO PROVIDE ASTM C 1118 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.
CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.8 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT W.W.R. OR REINFORCING STEEL. RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OVERLAP AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.
REBAR: ASTM A615, GRADE 40, DEFORMED BARS, Fy = 40 KSI, ALL LAP SPICES 40" DB (25" FOR #5 BARS), UNO. ALL REINFORCEMENT SHALL BE DETAILLED AND PLACED IN ACCORDANCE WITH ACI 318-08, UNO.C.
ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL. DIAPHRAGMS, SHEATHING, UNLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.
STRUCTURAL CONNECTORS, MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.
ANCHOR BOLTS: 4-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 16" IN GROUTED CMU.
BUILDER'S RESPONSIBILITY:
THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.
CONFIRM SITE CONDITIONS: FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DIRECTION, ZONE, AND FLOOD ZONE.
PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCE REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.
PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMISSIONS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.
VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS TO TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

ROOF SYSTEM DESIGN:
THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCE, IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, SEALED, AND SIGNED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBCE REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

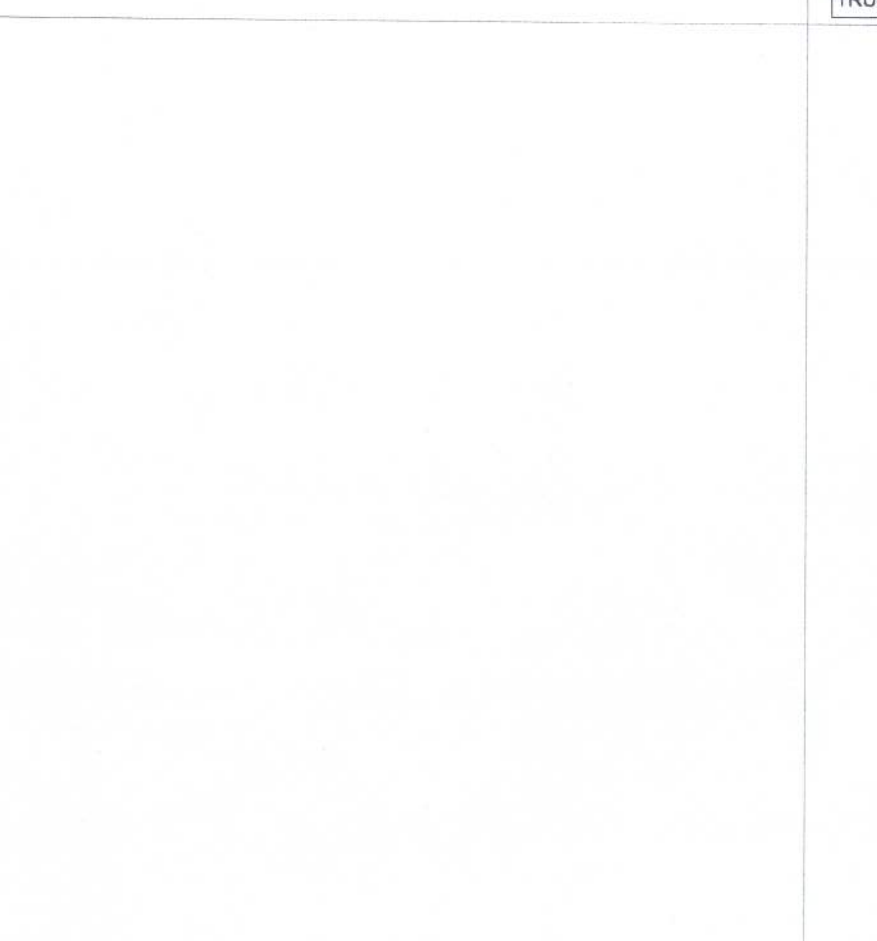

2X6 SPF #2 GARAGE DOOR BUCK ATTACHMENT

DOOR WIDTH 38"x4" LAG

DOOR WIDTH	24" OC	3" OC	5" OC
8' - 10'	24" OC	3" OC	5" OC
11' - 15'	18" OC	4" OC	4" OC
16' - 18'	18" OC	3" OC	3" OC



(TYP.) GARAGE DOOR BUCK INSTALLATION
WOOD FRAME

DESIGN CRITERIA & LOADS:

BUILDING CODE	7TH EDITION FLORIDA BUILDING CODE RESIDENTIAL (2020)
CODE FOR DESIGN LOADS	ASCE 7-16
WINDLOADS	
BASIC WIND SPEED (ASCE 7-16, 3S GUST)	120 MPH
WIND EXPOSURE (BUILDER MUST FIELD VERIFY)	C
TOPOGRAPHIC FACTOR (BUILDER MUST FIELD VERIFY)	1
RISK CATEGORY	II
ENCLOSURE CLASSIFICATION	ENCLOSED
INTERNAL PRESSURE COEFFICIENT	0.18
ROOF ANGLE	7-45 DEGREES
MEAN ROOF HEIGHT	30 FT
C&G DESIGN PRESSURES	SEE TABLE
FLOOR LOADING	
ROOMS OTHER THAN SLEEPING ROOM	40 PSF LIVE LOAD
SLEEPING ROOMS	30 PSF LIVE LOAD
ROOF LOADING	
FLAT OR < 4:12	20 PSF LIVE LOAD
4:12 TO < 12:12	16 PSF LIVE LOAD
12:12 & GREATER	12 PSF LIVE LOAD
SOIL BEARING CAPACITY	1500 PSF
FLOOD ZONE	THIS BUILDING IS NOT IN THE FLOOD ZONE
COMPONENT & CLADDING DESIGN PRESSURES 120 MPH (EXP C)	
EFFECTIVE WIND AREA (F2)	ZONE 4 INTERIOR
0 - 20	+25.6(Vsued) -27.8(Vsued)
0 - 20	+25.6(Vsued) -25.5(Vsued)
GARAGE DOOR DESIGN PRESSURES 120 MPH (EXP C)	
8x7 GARAGE DOOR	+22.6(Vsued) -25.5(Vsued)
16x7 GARAGE DOOR	+21.7(Vsued) -24.1(Vsued)

Gibraltar Contracting, LLC

Alvin & Patricia Barnett Res.

PROJECT ADDRESS:
Lot 30, Country Lake in Ft. Meade
Columbia County, FL 32055

Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves all common law copyright and property rights in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.


MARK DISOWAY, P.E. 53615

FRIDAY, OCTOBER 1, 2021


Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
211352


S-1
OF 3 SHEETS

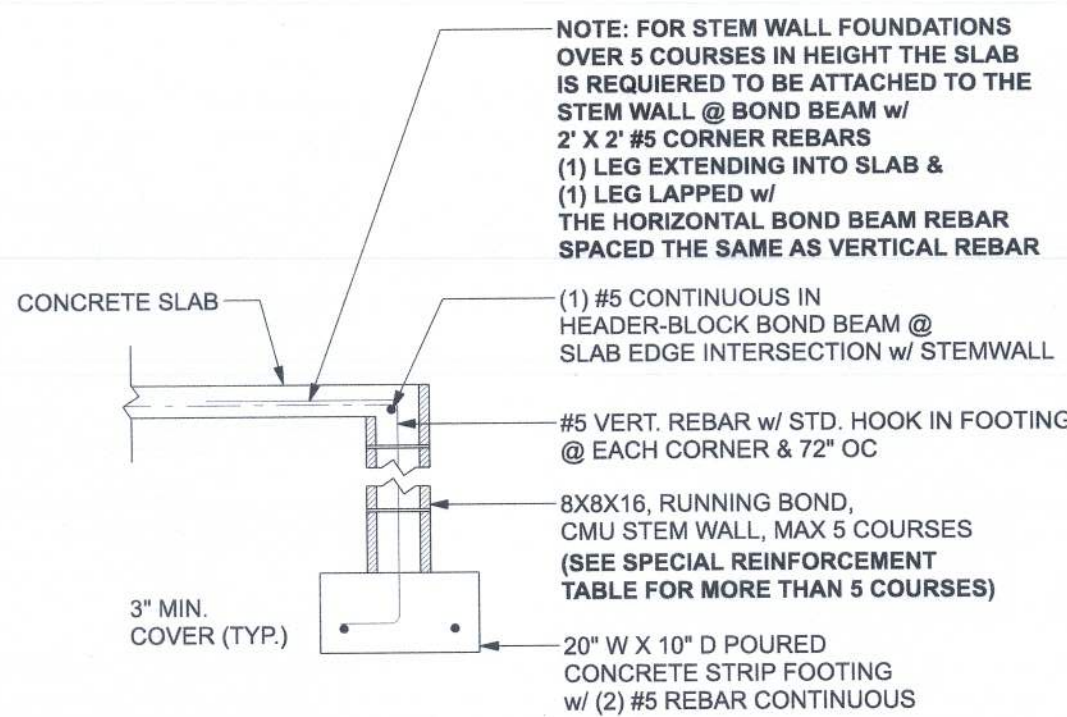


F1 S-2 OPTIONAL STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

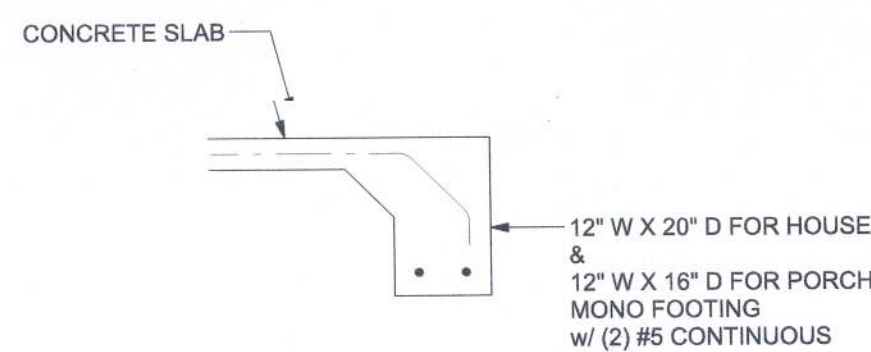


F1 S-2 MONOLITHIC FOOTING
SCALE: 1/2" = 1'-0"

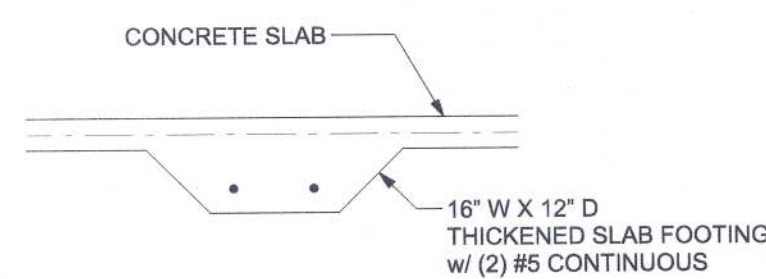


F2 S-2 INTERIOR BEARING FOOTING
SCALE: 1/2" = 1'-0"

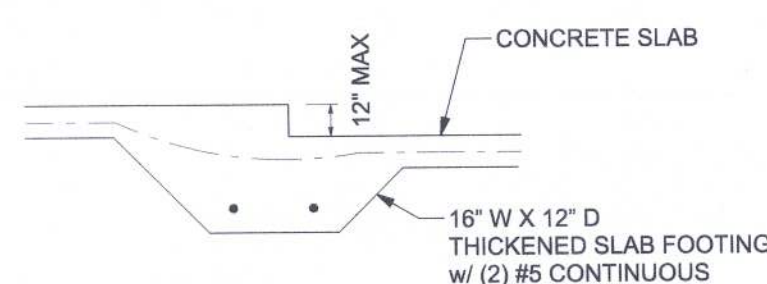

F3 S-2 INTERIOR BEARING STEP FOOTING
SCALE: 1/2" = 1'-0"

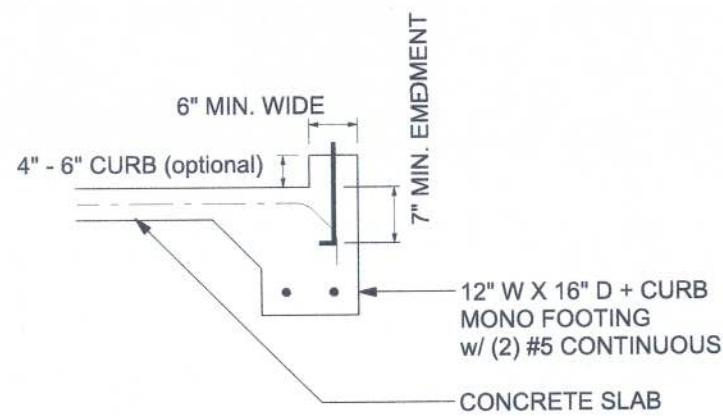

F4 S-2 MONOLITHIC CURB FOOTING
SCALE: 1/2" = 1'-0"

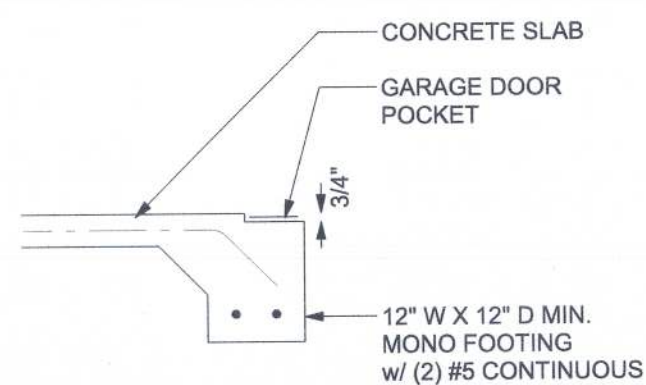

F5 S-2 GARAGE DOOR POCKET FOOTING
SCALE: 1/2" = 1'-0"

TALL STEM WALL TABLE:


The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Duowall ladder reinforcement at 16" OC vertically or a horizontal bond beam with #5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.

STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

MASONRY NOTE:
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

ACI 530.1-02 Section	Specific Requirements
1.4A Compressive strength	8" block bearing walls $F_m = 1500$ psi
1.4N Compressive strength	8" block bearing walls $F_m = 1500$ psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM 615, Grade 40, $F_y = 40$ ksi, Lap splice min 40 bar dia. (25" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A505, Class D60, 0.50 oz/lb or 304SS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/lb or 304SS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.

BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL.

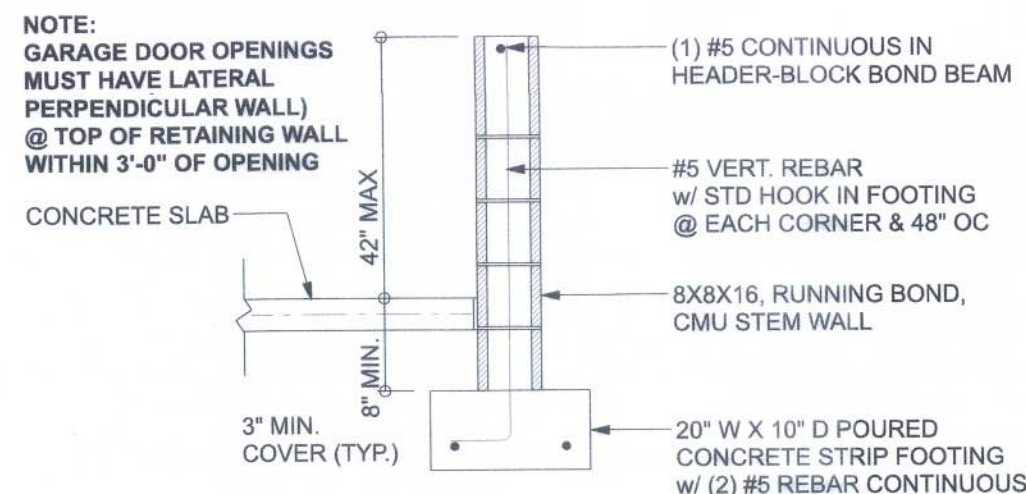


F4 S-2 OPTIONAL STEM WALL CURB FOOTING
SCALE: 1/2" = 1'-0"

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING IN ALL AREAS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
FN - 3	THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ 6X6-14/14 WELDED WIRE MESH PLACED ON CHAIRS @ 1-1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITE-TREATED & COMPACTED FILL.

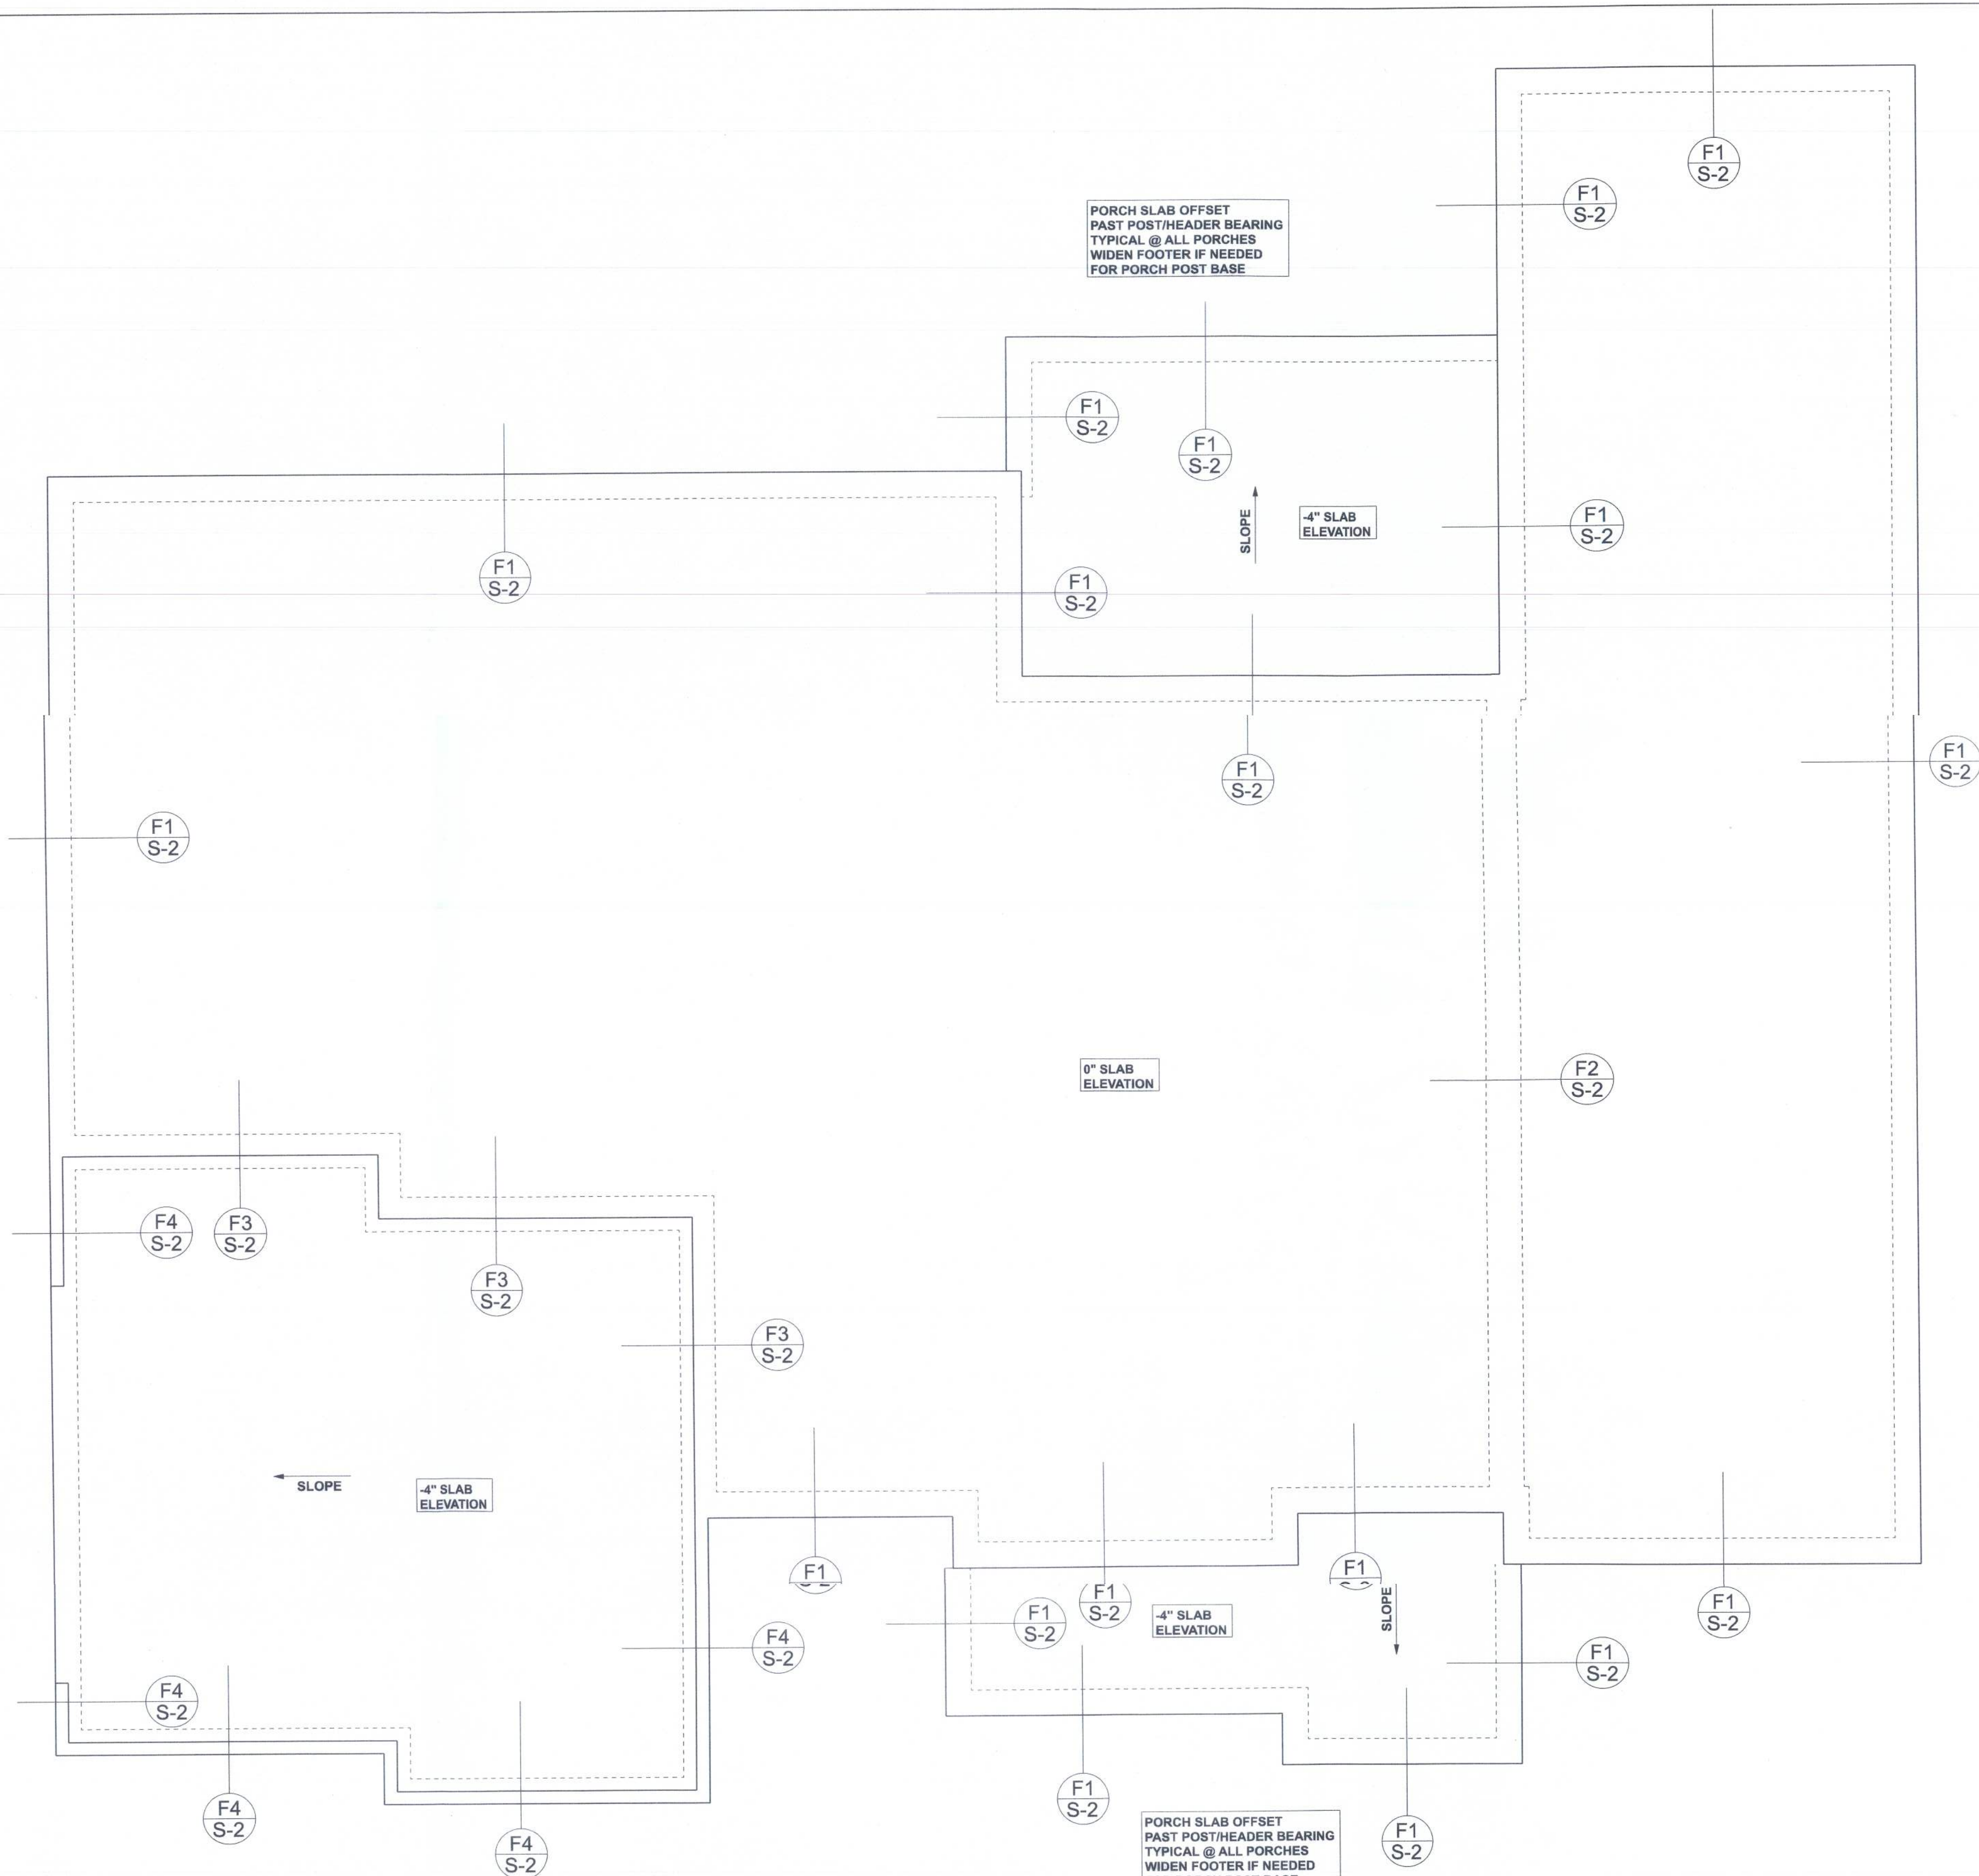

Gibraltar Contracting, LLC

Alvin & Patricia Barnett Res.

PROJECT ADDRESS:
163 SW Midtown Place
Suite 103
Lake City, Florida 32025


DIMENSIONS:
Dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY, P.E. 53915

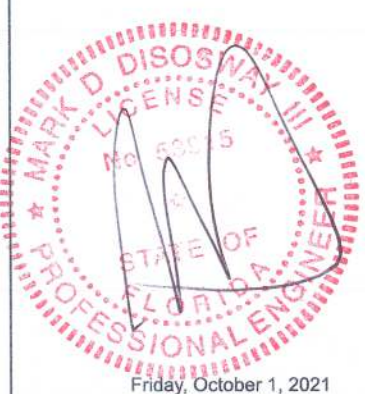

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
211352

S-2
OF 3 SHEETS

VALLEY ROOF PLAN



VALLEY ROOF PLAN MEMBER LEGEND


1. TRUSS
 2. TRUSS UNDER VALLEY FRAMING
 3. VALLEY RAFTER OR RIDGE
 4. CHIMNEY

1. 2x4 TRUSS
 2. 2x6 TRUSS
 3. 2x8 TRUSS
 4. 2x10 TRUSS
 5. 2x12 TRUSS
 6. 2x14 TRUSS
 7. 2x16 TRUSS
 8. 2x18 TRUSS
 9. 2x20 TRUSS
 10. 2x22 TRUSS
 11. 2x24 TRUSS
 12. 2x26 TRUSS
 13. 2x28 TRUSS
 14. 2x30 TRUSS
 15. 2x32 TRUSS
 16. 2x34 TRUSS
 17. 2x36 TRUSS
 18. 2x38 TRUSS
 19. 2x40 TRUSS
 20. 2x42 TRUSS
 21. 2x44 TRUSS
 22. 2x46 TRUSS
 23. 2x48 TRUSS
 24. 2x50 TRUSS
 25. 2x52 TRUSS
 26. 2x54 TRUSS
 27. 2x56 TRUSS
 28. 2x58 TRUSS
 29. 2x60 TRUSS
 30. 2x62 TRUSS
 31. 2x64 TRUSS
 32. 2x66 TRUSS
 33. 2x68 TRUSS
 34. 2x70 TRUSS
 35. 2x72 TRUSS
 36. 2x74 TRUSS
 37. 2x76 TRUSS
 38. 2x78 TRUSS
 39. 2x80 TRUSS
 40. 2x82 TRUSS
 41. 2x84 TRUSS
 42. 2x86 TRUSS
 43. 2x88 TRUSS
 44. 2x90 TRUSS
 45. 2x92 TRUSS
 46. 2x94 TRUSS
 47. 2x96 TRUSS
 48. 2x98 TRUSS
 49. 2x100 TRUSS
 50. 2x102 TRUSS
 51. 2x104 TRUSS
 52. 2x106 TRUSS
 53. 2x108 TRUSS
 54. 2x110 TRUSS
 55. 2x112 TRUSS
 56. 2x114 TRUSS
 57. 2x116 TRUSS
 58. 2x118 TRUSS
 59. 2x120 TRUSS
 60. 2x122 TRUSS
 61. 2x124 TRUSS
 62. 2x126 TRUSS
 63. 2x128 TRUSS
 64. 2x130 TRUSS
 65. 2x132 TRUSS
 66. 2x134 TRUSS
 67. 2x136 TRUSS
 68. 2x138 TRUSS
 69. 2x140 TRUSS
 70. 2x142 TRUSS
 71. 2x144 TRUSS
 72. 2x146 TRUSS
 73. 2x148 TRUSS
 74. 2x150 TRUSS
 75. 2x152 TRUSS
 76. 2x154 TRUSS
 77. 2x156 TRUSS
 78. 2x158 TRUSS
 79. 2x160 TRUSS
 80. 2x162 TRUSS
 81. 2x164 TRUSS
 82. 2x166 TRUSS
 83. 2x168 TRUSS
 84. 2x170 TRUSS
 85. 2x172 TRUSS
 86. 2x174 TRUSS
 87. 2x176 TRUSS
 88. 2x178 TRUSS
 89. 2x180 TRUSS
 90. 2x182 TRUSS
 91. 2x184 TRUSS
 92. 2x186 TRUSS
 93. 2x188 TRUSS
 94. 2x190 TRUSS
 95. 2x192 TRUSS
 96. 2x194 TRUSS
 97. 2x196 TRUSS
 98. 2x198 TRUSS
 99. 2x200 TRUSS
 100. 2x202 TRUSS
 101. 2x204 TRUSS
 102. 2x206 TRUSS
 103. 2x208 TRUSS
 104. 2x210 TRUSS
 105. 2x212 TRUSS
 106. 2x214 TRUSS
 107. 2x216 TRUSS
 108. 2x218 TRUSS
 109. 2x220 TRUSS
 110. 2x222 TRUSS
 111. 2x224 TRUSS
 112. 2x226 TRUSS
 113. 2x228 TRUSS
 114. 2x230 TRUSS
 115. 2x232 TRUSS
 116. 2x234 TRUSS
 117. 2x236 TRUSS
 118. 2x238 TRUSS
 119. 2x240 TRUSS
 120. 2x242 TRUSS
 121. 2x244 TRUSS
 122. 2x246 TRUSS
 123. 2x248 TRUSS
 124. 2x250 TRUSS
 125. 2x252 TRUSS
 126. 2x254 TRUSS
 127. 2x256 TRUSS
 128. 2x258 TRUSS
 129. 2x260 TRUSS
 130. 2x262 TRUSS
 131. 2x264 TRUSS
 132. 2x266 TRUSS
 133. 2x268 TRUSS
 134. 2x270 TRUSS
 135. 2x272 TRUSS
 136. 2x274 TRUSS
 137. 2x276 TRUSS
 138. 2x278 TRUSS
 139. 2x280 TRUSS
 140. 2x282 TRUSS
 141. 2x284 TRUSS
 142. 2x286 TRUSS
 143. 2x288 TRUSS
 144. 2x290 TRUSS
 145. 2x292 TRUSS
 146. 2x294 TRUSS
 147. 2x296 TRUSS
 148. 2x298 TRUSS
 149. 2x300 TRUSS
 150. 2x302 TRUSS
 151. 2x304 TRUSS
 152. 2x306 TRUSS
 153. 2x308 TRUSS
 154. 2x310 TRUSS
 155. 2x312 TRUSS
 156. 2x314 TRUSS
 157. 2x316 TRUSS
 158. 2x318 TRUSS
 159. 2x320 TRUSS
 160. 2x322 TRUSS
 161. 2x324 TRUSS
 162. 2x326 TRUSS
 163. 2x328 TRUSS
 164. 2x330 TRUSS
 165. 2x332 TRUSS
 166. 2x334 TRUSS
 167. 2x336 TRUSS
 168. 2x338 TRUSS
 169. 2x340 TRUSS
 170. 2x342 TRUSS
 171. 2x344 TRUSS
 172. 2x346 TRUSS
 173. 2x348 TRUSS
 174. 2x350 TRUSS
 175. 2x352 TRUSS
 176. 2x354 TRUSS
 177. 2x356 TRUSS
 178. 2x358 TRUSS
 179. 2x360 TRUSS
 180. 2x362 TRUSS
 181. 2x364 TRUSS
 182. 2x366 TRUSS
 183. 2x368 TRUSS
 184. 2x370 TRUSS
 185. 2x372 TRUSS
 186. 2x374 TRUSS
 187. 2x376 TRUSS
 188. 2x378 TRUSS
 189. 2x380 TRUSS
 190. 2x382 TRUSS
 191. 2x384 TRUSS
 192. 2x386 TRUSS
 193. 2x388 TRUSS
 194. 2x390 TRUSS
 195. 2x392 TRUSS
 196. 2x394 TRUSS
 197. 2x396 TRUSS
 198. 2x398 TRUSS
 199. 2x400 TRUSS
 200. 2x402 TRUSS
 201. 2x404 TRUSS
 202. 2x406 TRUSS
 203. 2x408 TRUSS
 204. 2x410 TRUSS
 205. 2x412 TRUSS
 206. 2x414 TRUSS
 207. 2x416 TRUSS
 208. 2x418 TRUSS
 209. 2x420 TRUSS
 210. 2x422 TRUSS
 211. 2x424 TRUSS
 212. 2x426 TRUSS
 213. 2x428 TRUSS
 214. 2x430 TRUSS
 215. 2x432 TRUSS
 216. 2x434 TRUSS
 217. 2x436 TRUSS
 218. 2x438 TRUSS
 219. 2x440 TRUSS
 220. 2x442 TRUSS
 221. 2x444 TRUSS
 222. 2x446 TRUSS
 223. 2x448 TRUSS
 224. 2x450 TRUSS
 225. 2x452 TRUSS
 226. 2x454 TRUSS
 227. 2x456 TRUSS
 228. 2x458 TRUSS
 229. 2x460 TRUSS
 230. 2x462 TRUSS
 231. 2x464 TRUSS
 232. 2x466 TRUSS
 233. 2x468 TRUSS
 234. 2x470 TRUSS
 235. 2x472 TRUSS
 236. 2x474 TRUSS
 237. 2x476 TRUSS
 238. 2x478 TRUSS
 239. 2x480 TRUSS
 240. 2x482 TRUSS
 241. 2x484 TRUSS
 242. 2x486 TRUSS
 243. 2x488 TRUSS
 244. 2x490 TRUSS
 245. 2x492 TRUSS
 246. 2x494 TRUSS

[illegible]

CRIPPLE BRACING & BLOCKING NOTES

2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 8" TO 10" LONG
 NAILED W/ 2 - 10d NAILS OR 2X4 "T" OR SCAB BRACE NAILD TO FLAT EDGE OF CRIPPLE
 WITH 8d NAILS @ 6" O.C. "T" OR SCAB MUST BE 90% OF CRIPPLE LENGTH. CRIPPLES
 OVER 10" LONG REQUIRE TWO CLBs OR BOTH FACES "T" OR SCAB USE LUBBER
 BRACED LUBBER & BOX JOINTS ARE COMMON NAIL
 -NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER,
 AS LONG AS THE PROPER NUMBER OF NAILS ARE
 INSTALLED INTO RIDGE BOARD
 -INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED
 -INSTALL BLOCKING UNDER CRIPPLES IF CRIPPLES FALL BETWEEN
 -LOWER TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED.
 -APPLY ALL NAILING IN ACCORDANCE TO NDS-1997 SECTION 12. NAILS ARE COMMON WIRE
 NAILS UNLESS NOTED OTHERWISE.

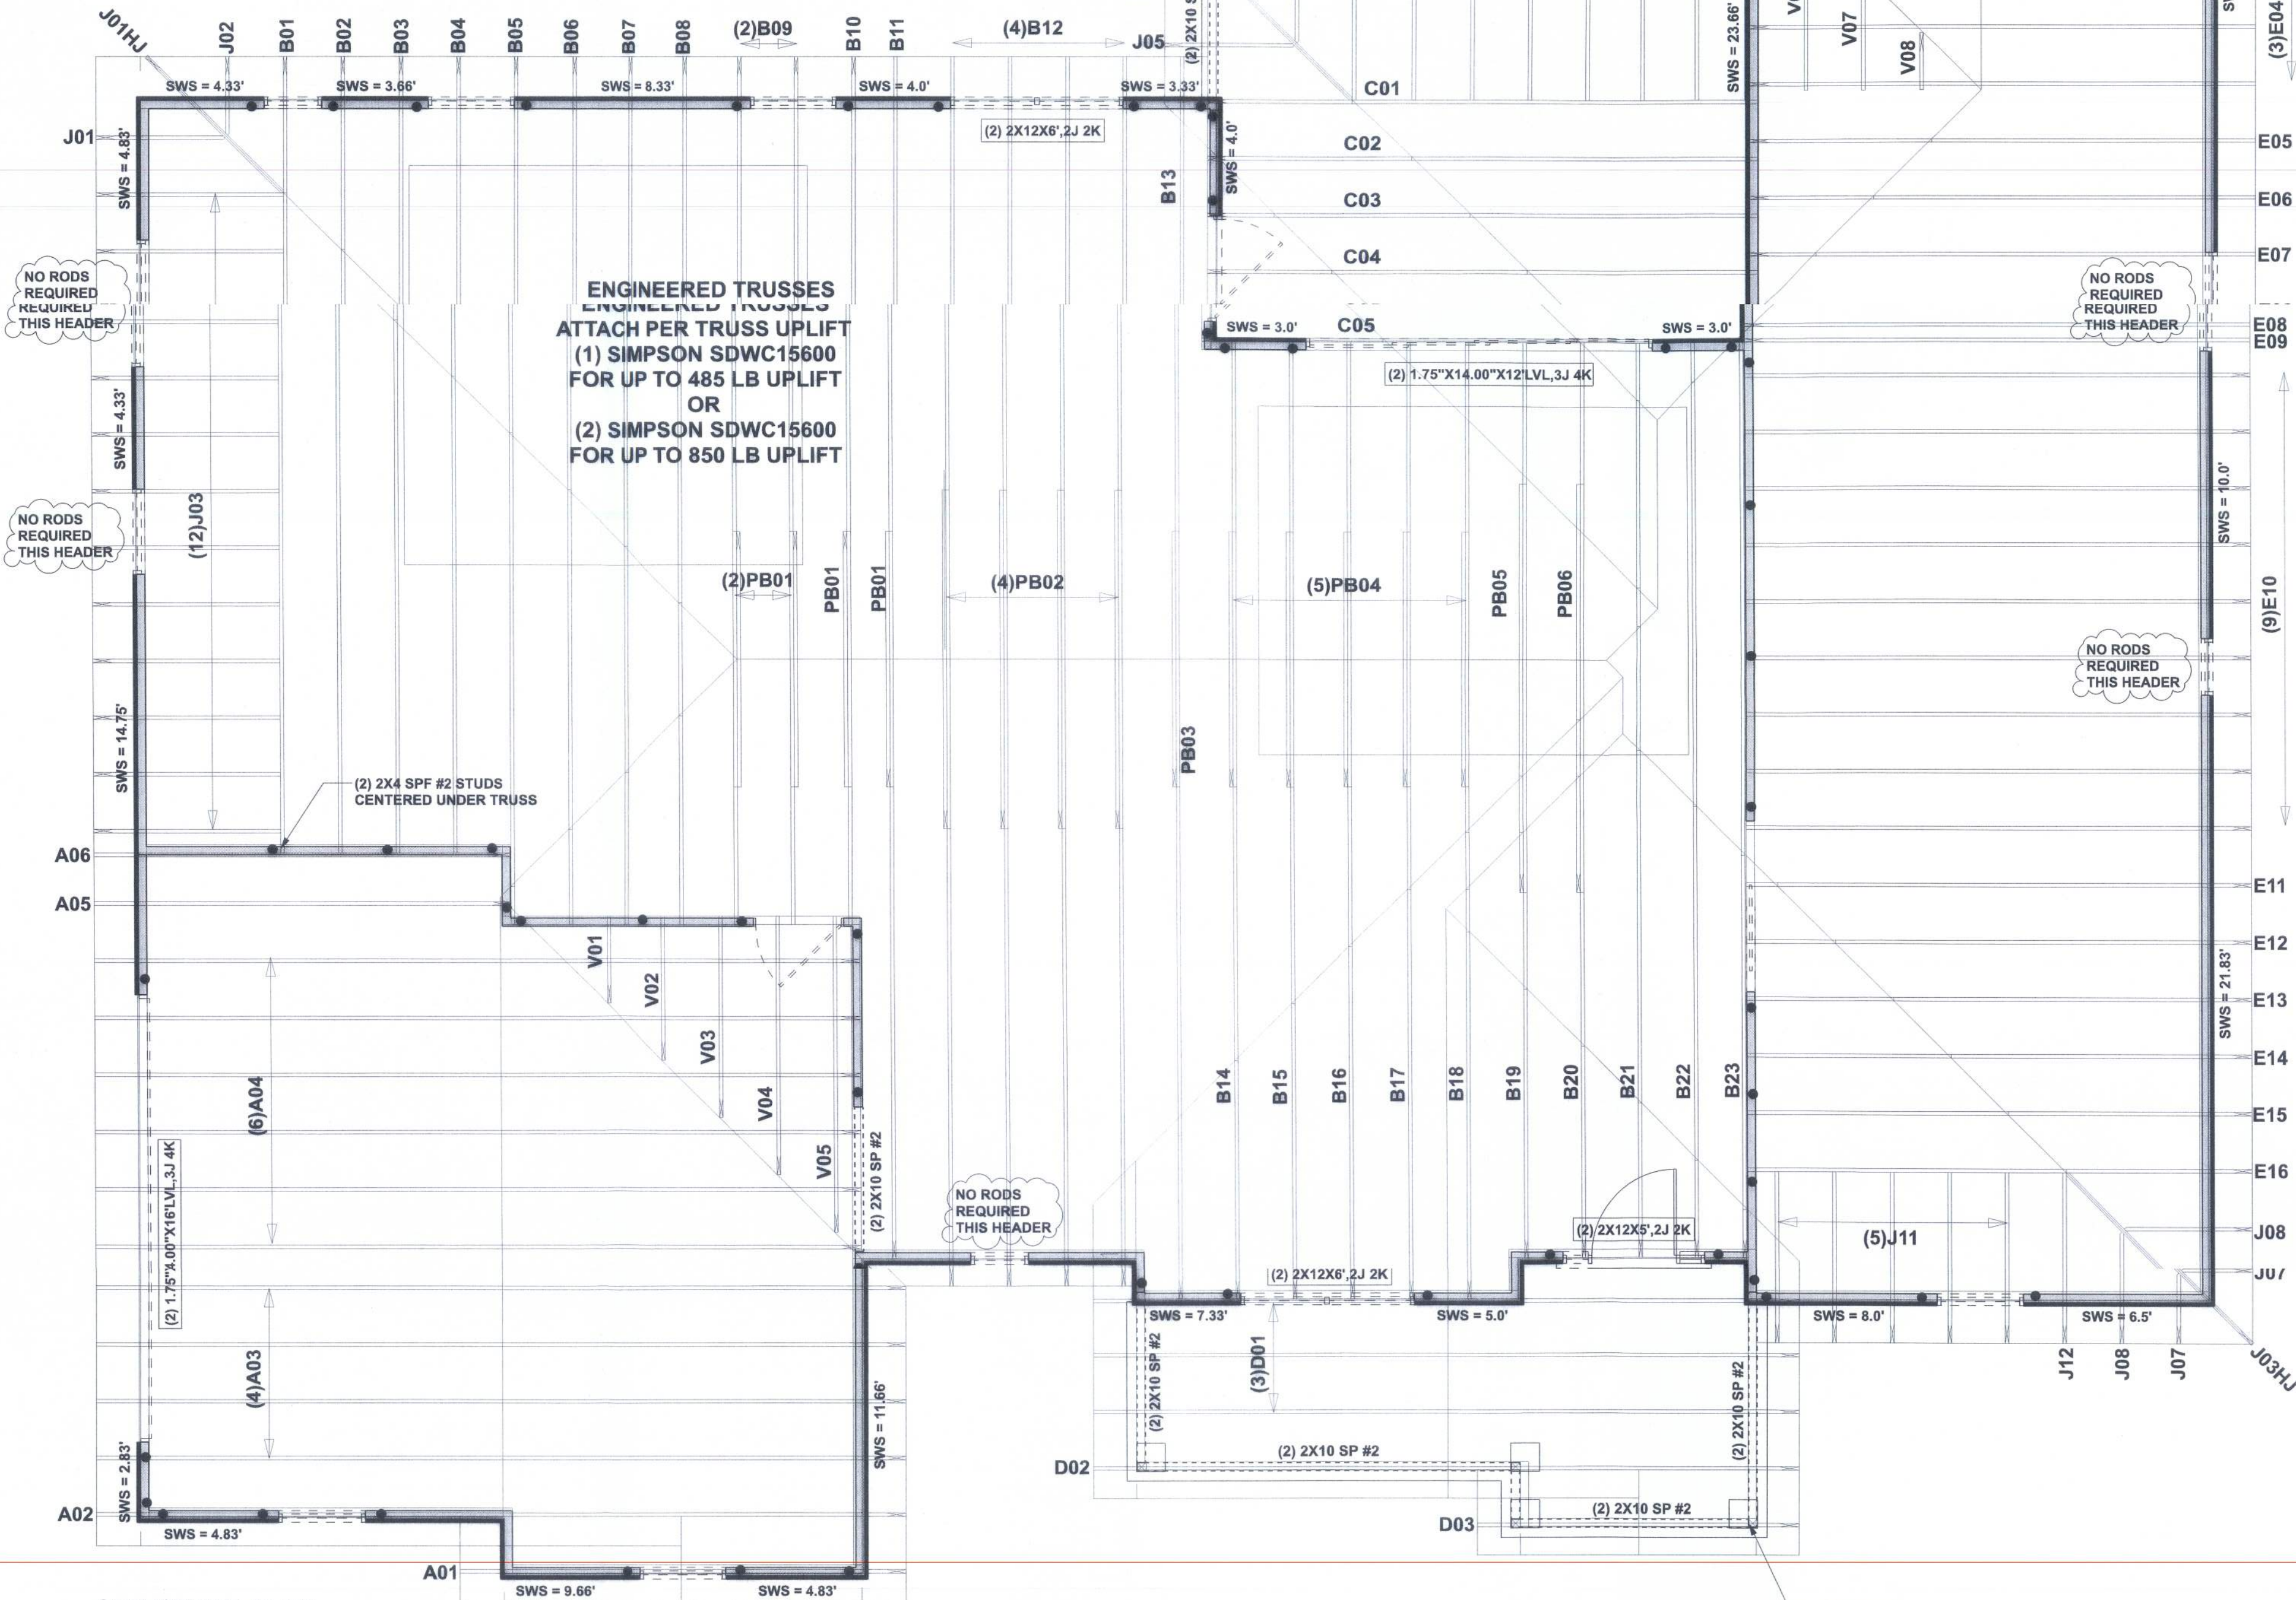

STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

SN-1	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X10 SP #2 (U.N.O.)
SN-2	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
SN-3	USE ONE JACK STUD GIRDER SUPPORT PER 2500 LB LOAD
SN-4	DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
SN-5	PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BC51-03. BC51-81, BC51-82, & BC51-83. BC51-81, BC51-82, & BC51-83 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

The diagram shows a beam call-out label with the text **(2) 2X10X0', 1J 1K**. Arrows point from various parts of the label to descriptive text:

- HEADER/BEAM CALL-OUT (U.N.O.)**: Points to the entire label.
- NUMBER OF KING STUDS (FULL LENGTH)**: Points to the number **2**.
- NUMBER OF JACK STUDS (UNDER HEADER)**: Points to the **0'** (zero feet) part.
- SPAN OF HEADER**: Points to the **0'** (zero feet) part.
- SIZE OF HEADER MATERIAL**: Points to the **2X10** part.
- NUMBER OF PLIES IN HEADER**: Points to the **1J** (one jack) part.

INDICATES LOCATION OF:
3/8" A307 ALL THREADED ROD

ACTUAL vs REQUIRED SHEARWALL		
	TRANSVERSE	LONGITUDINAL
ACTUAL	28533 LBF	22212 LBF
REQUIRED	17792 LBF	15770 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED
ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING
FURNISHED BY BUILDER. W.B. HOWLAND TRUSS CO.
JOB #21-6101

Gibraltar Contracting, LLC

Alvn & Patricia Barnett Res.

PROJECT ADDRESS:
Lot 20 Country Lake in Woodborough
Columbia County, FL 32055

Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering, comply with the 7th Edition Florida Building Code Residential (2020)

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915

MARK DISOSWAY P.E. 53915



Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
211352

S-3
OF 3 SHEETS

OF 3 SHEETS