

YKK AP AMERICA RESIDENTIAL

STYLEVIEW FIXED TRANSOM WINDOW (NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- NAIL FIN: FOR INSTALLATION INTO WOOD FRAMING USE #10 PH WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- NAIL FIN: FOR INSTALLATION INTO METAL STUD USE #10 TEK PH SCREWS THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- THROUGH FRAME: FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- THROUGH FRAME: FOR INSTALLATION INTO METAL STUD USE #10 TEK SCREWS THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- THROUGH FRAME: FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER (7/16 TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT).
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90. MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/1.5.2/A440-17
 - ASTM E283-04(12)
 - ASTM E330-14
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL
 - O: FIXED PANEL
- GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 5 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	ELEVATION & ANCHOR LAYOUT
4	VERTICAL & HORIZONTAL SECTIONS
5	HORIZONTAL SECTION & GLAZING DETAIL
6	VERTICAL & HORIZONTAL SECTIONS

DESIGN PRESSURE TABLE				
CONFIGURATION	DESIGN PRESSURE	MAXIMUM SIZE	INSTALLATION METHOD	MISSILE IMPACT RATING
O	+50 / -50 PSF	79-1/2" x 79-1/2"	NAIL FIN	NON-IMPACT
O	+35 / -35 PSF	71-1/2" x 95-1/2"	THROUGH FRAME	NON-IMPACT
OOO	+50 / -50 PSF	107-1/2" x 23-1/2"	NAIL FIN	NON-IMPACT



INSTALLATION & GENERAL NOTES

STYLEVIEW TRANSOM WINDOW (NON-HVHZ) (NON-IMPACT)

TITLE:

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS

BY

DATE

THIS INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Reason: I am approving this document

Date: 10/20/2018 15:28:47



HERMES F. AGÜERO, P.E.
398 E. DANIA BEACH BLVD., STE. 338
BUILDING DROPS, INC.
FBC CERT. OF AUTHORIZATION No. 25578

FL #: FL7829

DATE: 01.25.17


DWG. BY: LS/LA CHK. BY: HFN/SM

SCALE: NTS

DWG. #: YKK131


SHEET: 1

OF 6

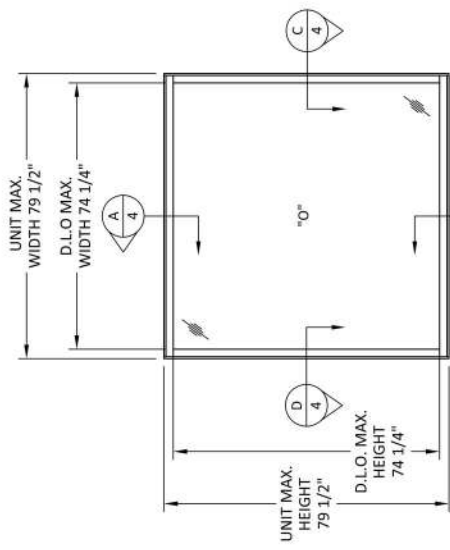


TYPICAL ELEVATION

FIXED WINDOW
 DP +50/-50 PSF

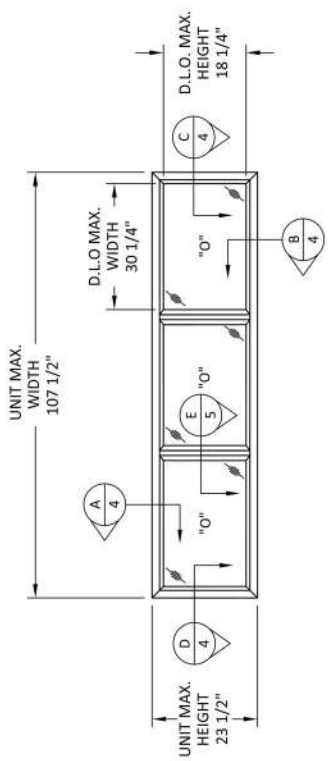

TYPICAL ELEVATION


FIXED TRANSOM WINDOW
 DP +50/-50 PSF

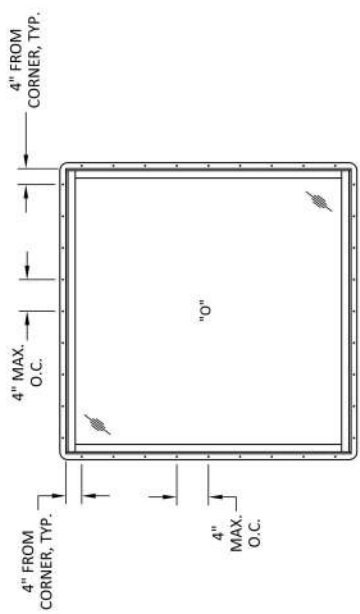

ANCHOR LAYOUT

NAIL FIN INSTALLATION

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	MIN. S.G. = 0.55 WOOD	#10 WOOD SCREW	1.5"	0.75"
	18 GAUGE STEEL, MIN. fy = 33 ksi	#10 TEK SCREW	3 THREADS PENETRATION BEYOND METAL	0.75"

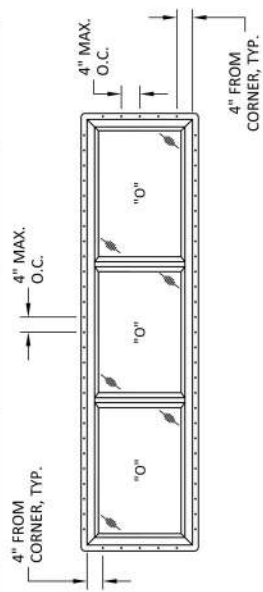

ANCHOR LAYOUT

NAIL FIN INSTALLATION

THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF YKK AP AMERICA, INC. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF YKK AP AMERICA, INC. THIS DOCUMENT IS FOR THE EXCLUSIVE USE OF THE CLIENT AND IS NOT TO BE USED FOR ANY OTHER PROJECT OR FOR ANY OTHER PURPOSE.



HERMES F. NORDEDO, P.E.
 398 E. DANIA BEACH BLVD., STE. 308
 DANIA BEACH, FL 33004
 PHONE CERT. OF AUTHORIZATION No. 25578

YKK

ap

Quality
Inspires[®]

YKK AP AMERICA RESIDENTIAL
4234 CORALGEE BLVD.
MARIETTA, GEORGIA 30137
PH: (800) 348-9001

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 308
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

ELEVATION & ANCHOR LAYOUT

STYLEVIEW TRANSOM WINDOW
(NON-HVHZ) (NON-IMPACT)

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND ARE NOT TO BE USED AS A BASIS FOR ANY SPECIFIC DESIGN OR CONSTRUCTION. THE USER SHALL BE RESPONSIBLE FOR VERIFYING THAT THE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS OUTLINED HEREIN. A LICENSED PROFESSIONAL ENGINEER SHALL REVIEW AND SIGN THESE DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORRERO, P.E.
REGISTERED PROFESSIONAL ENGINEER
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 308
DANIA BEACH, FL 33004
FPEE CERT. OF AUTHORIZATION No. 25578

HERMES F. NORRERO

PROFESSIONAL ENGINEER

STATE OF FLORIDA

License No. 73778

FL #: **FL7829**


DATE: **01.25.17**

DWG. BY: **LS/LA** CHK. BY: **HFN/SM**

SCALE: **NTS**

DWG. #: **YKK131**


SHEET: **3**

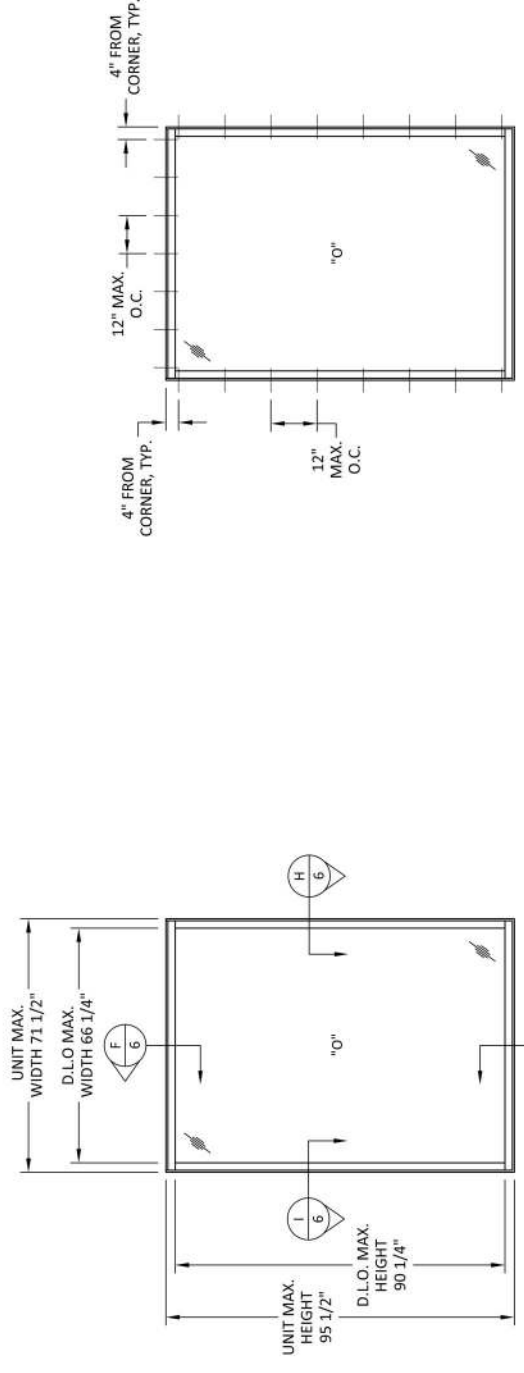


TYPICAL ELEVATION
FIXED WINDOW
DP +35/-35 PSF

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION


ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	MIN. S.G. = 0.55 WOOD	#10 WOOD SCREW	1.5"	0.75"
	18 GAUGE STEEL, MIN fy = 33 ksi	#10 TEK SCREW	.3 THREADS PENETRATION BEYOND METAL	0.75"
	CONCRETE, MIN fc = 3000 psi	3/16" ITW TAPCON	1.25"	2.5"
	CMU per ASTM C90	3/16" ITW TAPCON	1.25"	2.5"

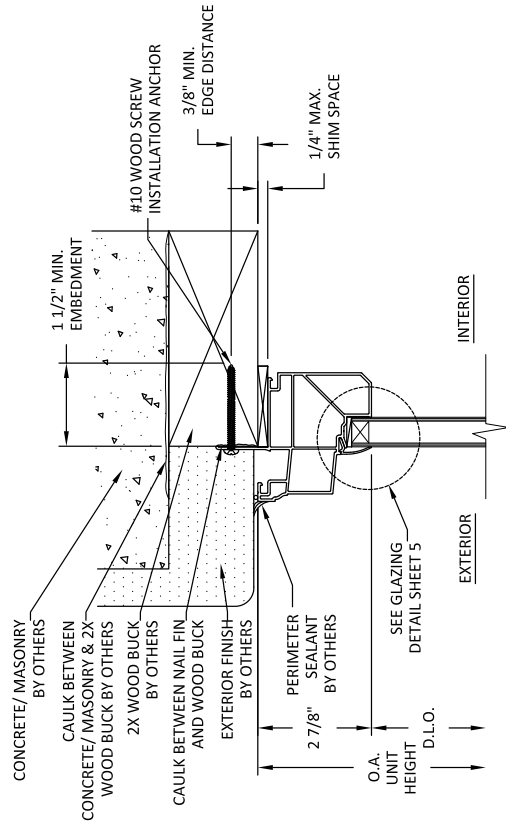


A **VERTICAL SECTION**
HEAD - 2X WOOD BUCK

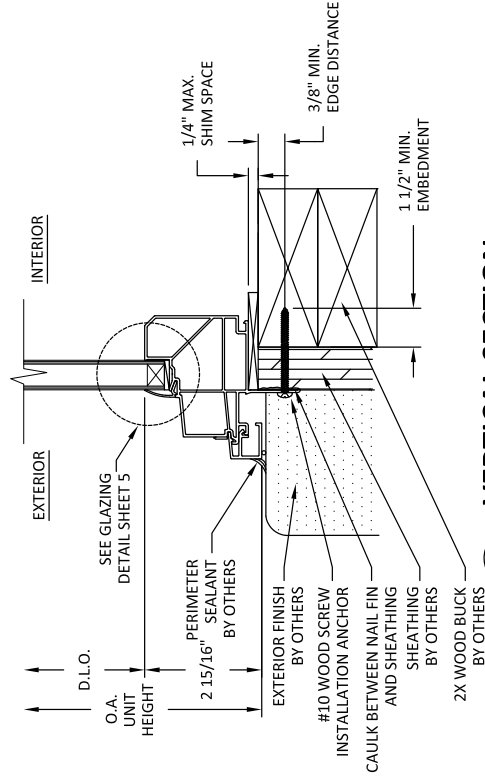

B **VERTICAL SECTION**
4 SILL - 2X WOOD FRAMING

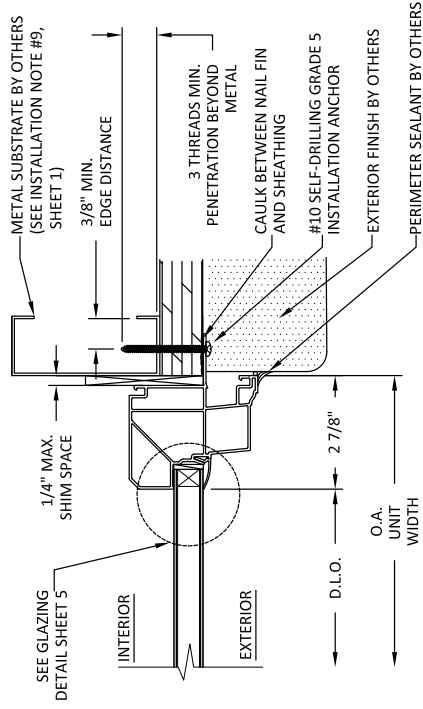

C4 HORIZONTAL SECTION

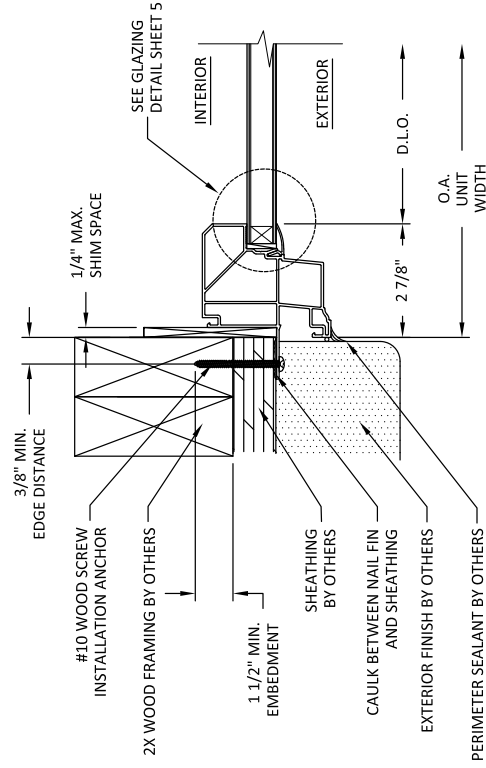

D 4 HORIZONTAL SECTION

JAMB - 2X WOOD FRAMING


REMARKS	BY	DATE
---------	----	------

--	--	--	--

--	--	--	--	--

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: 1-1000

FL7829

DATE: 01.25.17

DWG. BY: 1S/1A	CHK. BY: HEN/CM
-------------------	--------------------


LS/LA	THIN/3MI
SCALE:	NTS

DWG. #: YKK131

SHEET:

4


6
E
C

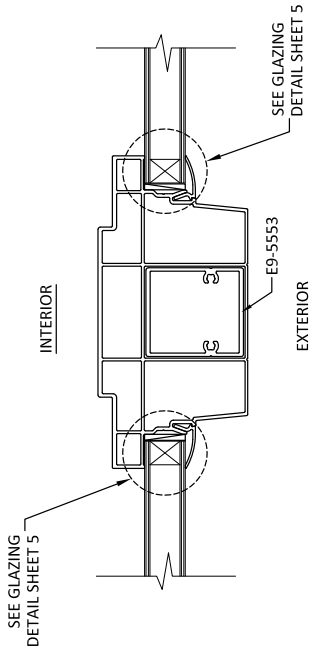

E HORIZONTAL SECTION

INTEGRAL MULLION

5

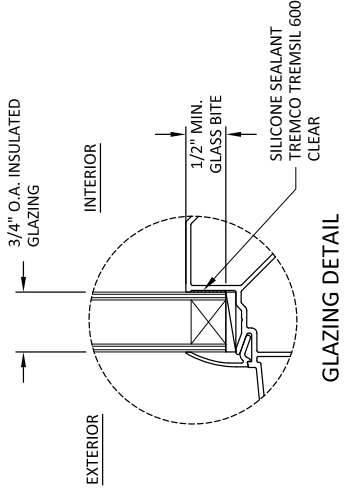

GLAZING NOTES:

1. GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.

INTERCEPT STAINLESS STEEL OR
TIN PLATED SPACER:
AROUND THE PERIMETER OF THE GLASS
PRIMARY SEALANT:
POLYISOBUTYLENE (PIB)
SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR
FABRICATION OF INSULATED GLASS
UNITS.



Quality
Inspires[®]

YKK AP AMERICA RESIDENTIAL

4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (680) 348-3021

STYLE/VIEW TRANSOM WINDOW
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTION &
GLAZING DETAIL


PREPARED BY:



BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com





REMARKS	BY	DATE

THIS INSTALLATION DETAILS DESCRIBED HEREIN HAVE BEEN PREPARED BY THE ENGINEER OR ARCHITECT AND ARE TO BE USED AS A GUIDE ONLY. THE ENGINEER OR ARCHITECT SHALL BE RESPONSIBLE FOR THE PROPER INSTALLATION OF THE PRODUCT. THE ENGINEER OR ARCHITECT SHALL BE RESPONSIBLE FOR THE PROPER INSTALLATION OF THE PRODUCT. THE ENGINEER OR ARCHITECT SHALL BE RESPONSIBLE FOR THE PROPER INSTALLATION OF THE PRODUCT.



HERMES F. NORBERG, P.E.
398 E. DANIA BEACH BLVD., # 338
DANIA BEACH, FL 33004
FBEPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL7829
DATE:	01.25.17
DWG. BY:	LS/LA
CHK. BY:	HFN/SM
SCALE:	NTS
DWG. #:	YKK131
SHEET:	5

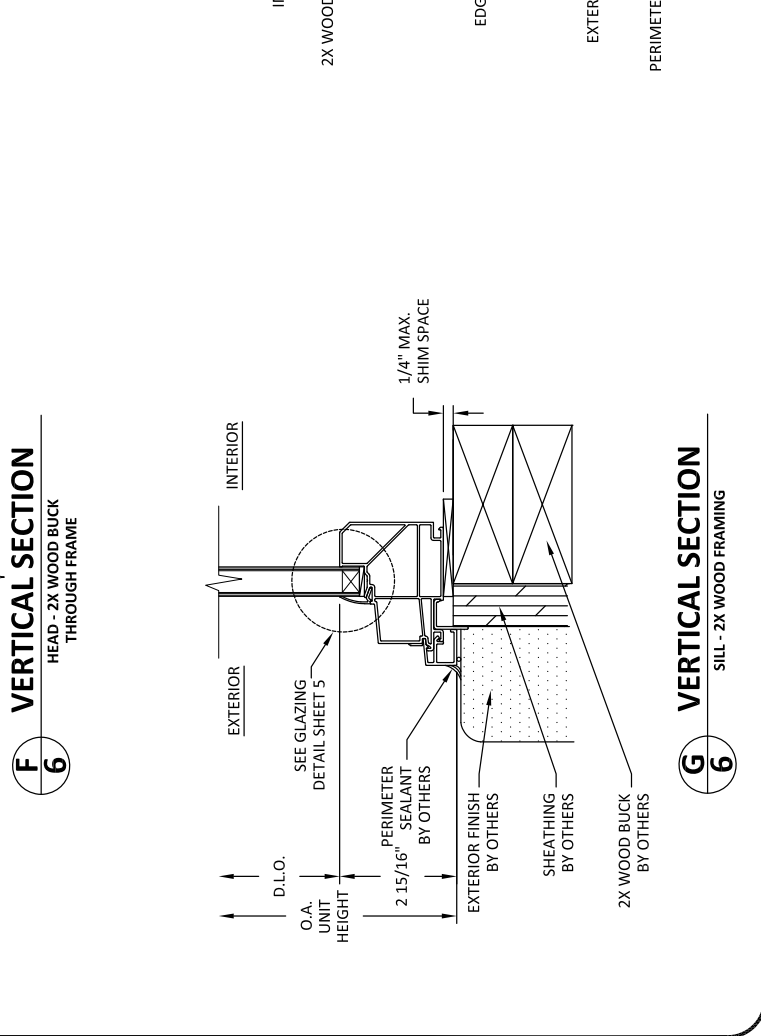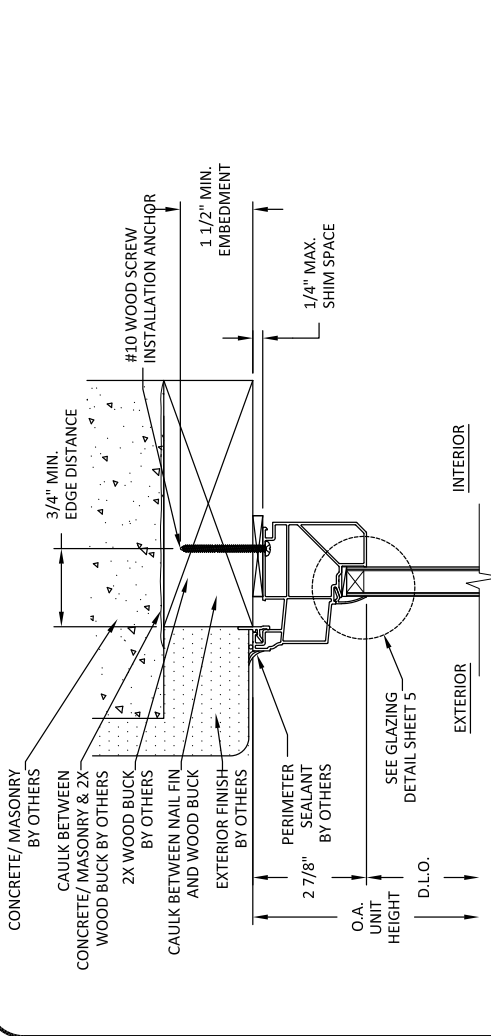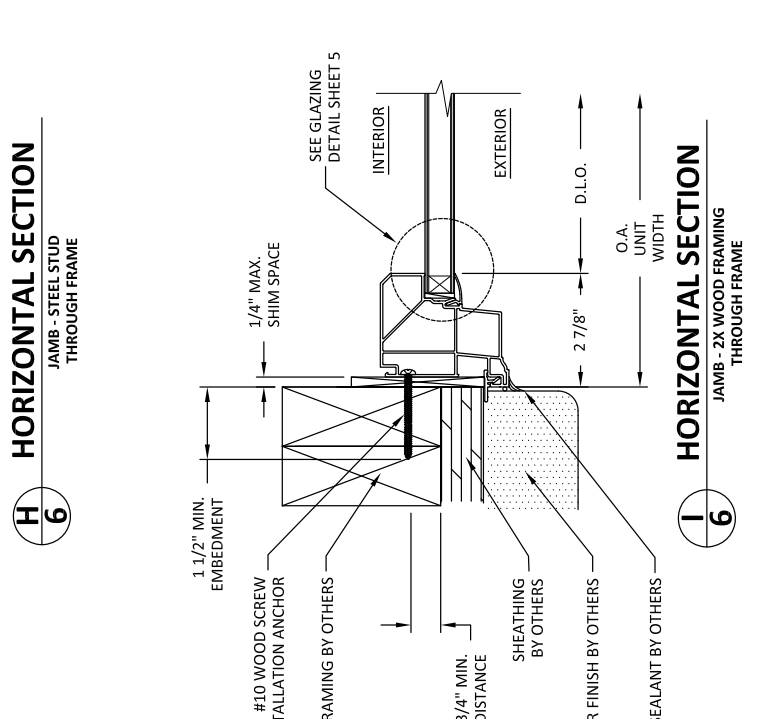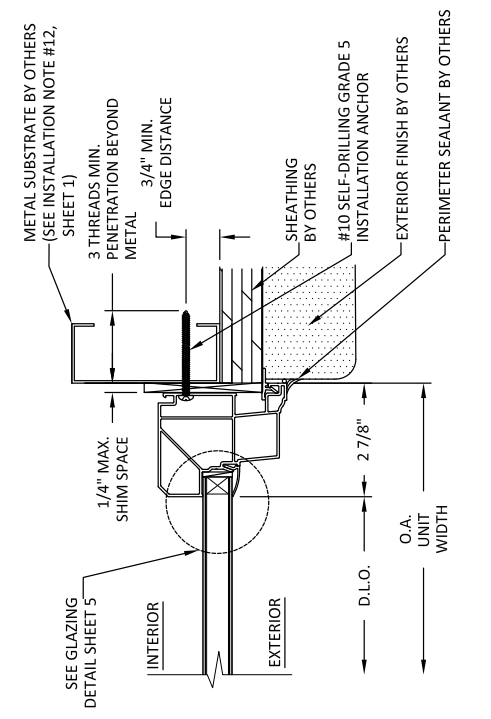

YKK AP AMERICA RESIDENTIAL

STYLEVIEW SINGLE HUNG WINDOW

(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED IN ORDER TO ACHIEVE SQUARE AND PLUMB WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FIN INSTALLATION:** FOR INSTALLATION INTO WOOD FRAMING USE **#8 WOOD SCREWS** OF SUFFICIENT LENGTH TO ACHIEVE 3/4 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FIN INSTALLATION:** FOR INSTALLATION INTO METAL STUD USE **#8 PAN HEAD** THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- FINLESS INSTALLATION:** FOR INSTALLATION INTO WOOD FRAMING USE **#10 WOOD SCREWS** OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FINLESS INSTALLATION:** FOR INSTALLATION INTO METAL STUD USE **#10 TEK SCREWS** THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- FINLESS INSTALLATION:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE **3/16 INCH DIAMETER ITW TAPCONS** OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - ASTM E283-04(12)
 - ASTM E330-02
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL
 - O: FIXED PANEL
- GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 3 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR SCHEDULE
3	VERTICAL SECTION & GLAZING DETAIL
4	HORIZONTAL SECTION
5	VERTICAL SECTION
6	HORIZONTAL SECTION

CONFIGURATION	DESIGN PRESSURE	MAX. FRAME SIZE	MAX. D.L.O.	MISSILE IMPACT RATING	INSTALLATION METHOD
O/X	+50 / -50 PSF	47.5" x 71.5"	41 3/8" x 32 1/2"	NOT RATED	NAIL FIN
O/X	+35 / -35 PSF	48.99" X 72"	42 7/8 " X 32 5/16"	NOT RATED	THROUGH FRAME
O/X	+35 / -35 PSF	52" X 61.5"	45 7/8" X 27 1/16"	NOT RATED	THROUGH FRAME



YKK AP AMERICA RESIDENTIAL
4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (866) 348-9091

TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.09.26 03:15:28 +0200

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL8114

DATE: **06.17.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **YKK123**


SHEET:
1
OF 6

9/24/2020 3:26 PM


s:\projects\ykk ap america, inc\cc-20-0237 residential fbc submittal - fbc 2020 code change\18114-r4\dwgs\ykk123.dwg

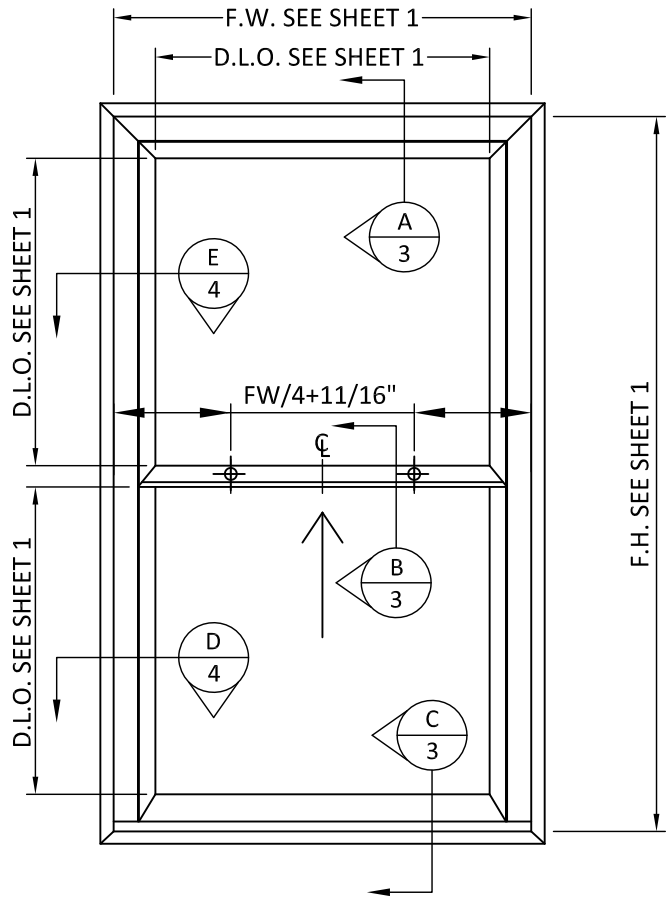


ELEVATION
NAIL FIN

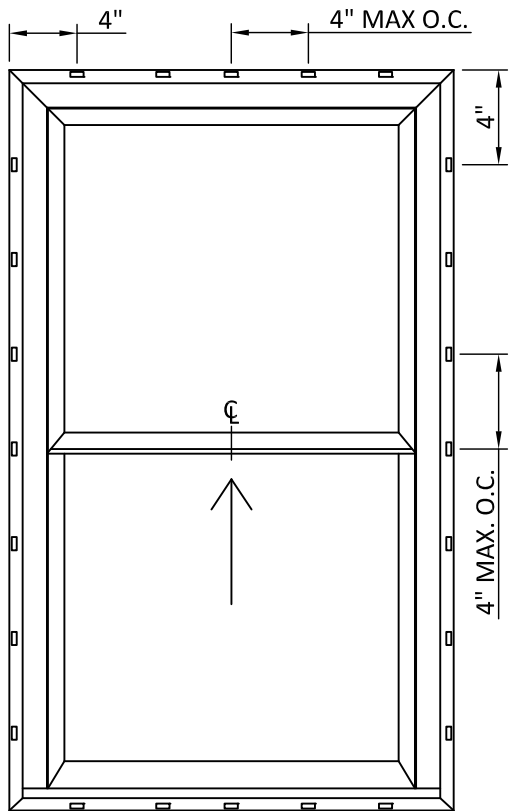

ANCHOR LAYOUT
NAIL FIN

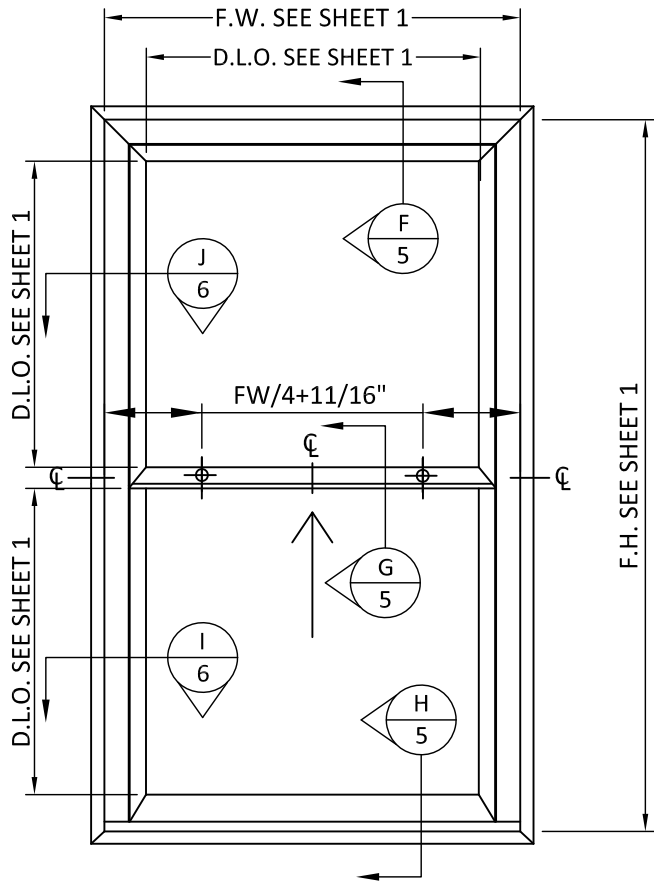

ELEVATION
THROUGH FRAME

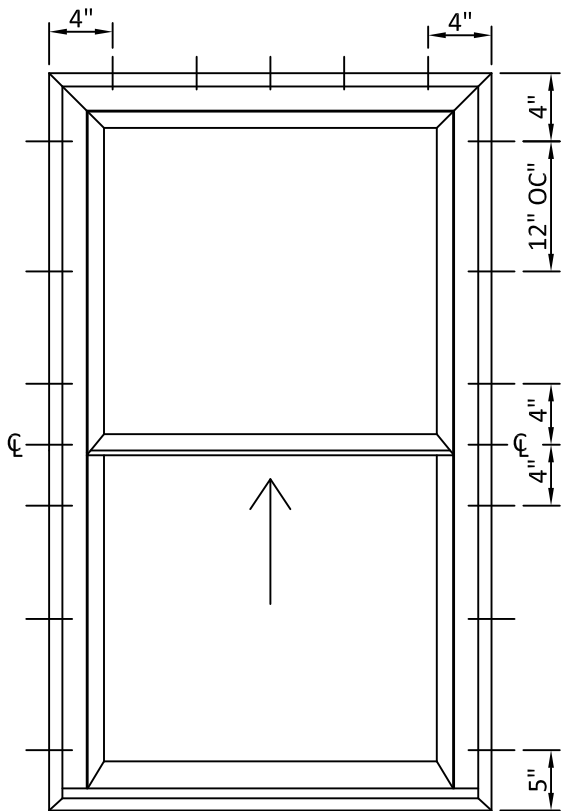

ANCHOR LAYOUT
THROUGH FRAME

⊕ -INDICATES LOCK LOCATION
FW<36" ONE LOCK (CENTER)
FW≥36" TWO LOCK (FW/4+11/16")

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	MIN. S.G. = 0.55 WOOD	#8 WOOD SCREW	1.5"	0.75"
	18 GAUGE STEEL, MIN f _y = 33 ksi	#8 TEK SCREW	3 THREADS PENETRATION BEYOND METAL	0.75"
THROUGH FRAME	MIN. S.G. = 0.55 WOOD	#10 WOOD SCREW	1.5"	0.75"
	18 GAUGE STEEL, MIN f _y = 33 ksi	#10 TEK SCREW	3 THREADS PENETRATION BEYOND METAL	0.75"
	f _c = 3000 psi	3/16" ITW TAPCON	1.25"	2.5"
	CMU PER ASTM C90	CMU	1.25"	2.5"



YKK AP AMERICA RESIDENTIAL
4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (866) 348-9091


TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
ELEVATION & ANCHOR SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

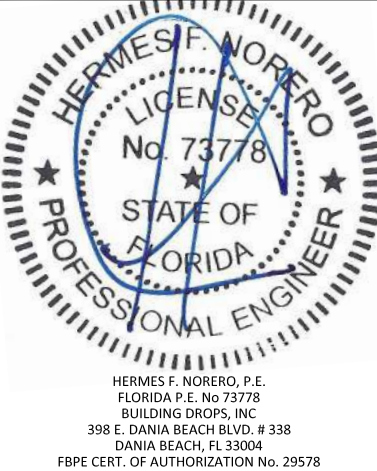


FL #:	FL8114
DATE:	06.17.20
DWG. BY:	NUS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK123
SHEET:	2

NAIL FIN

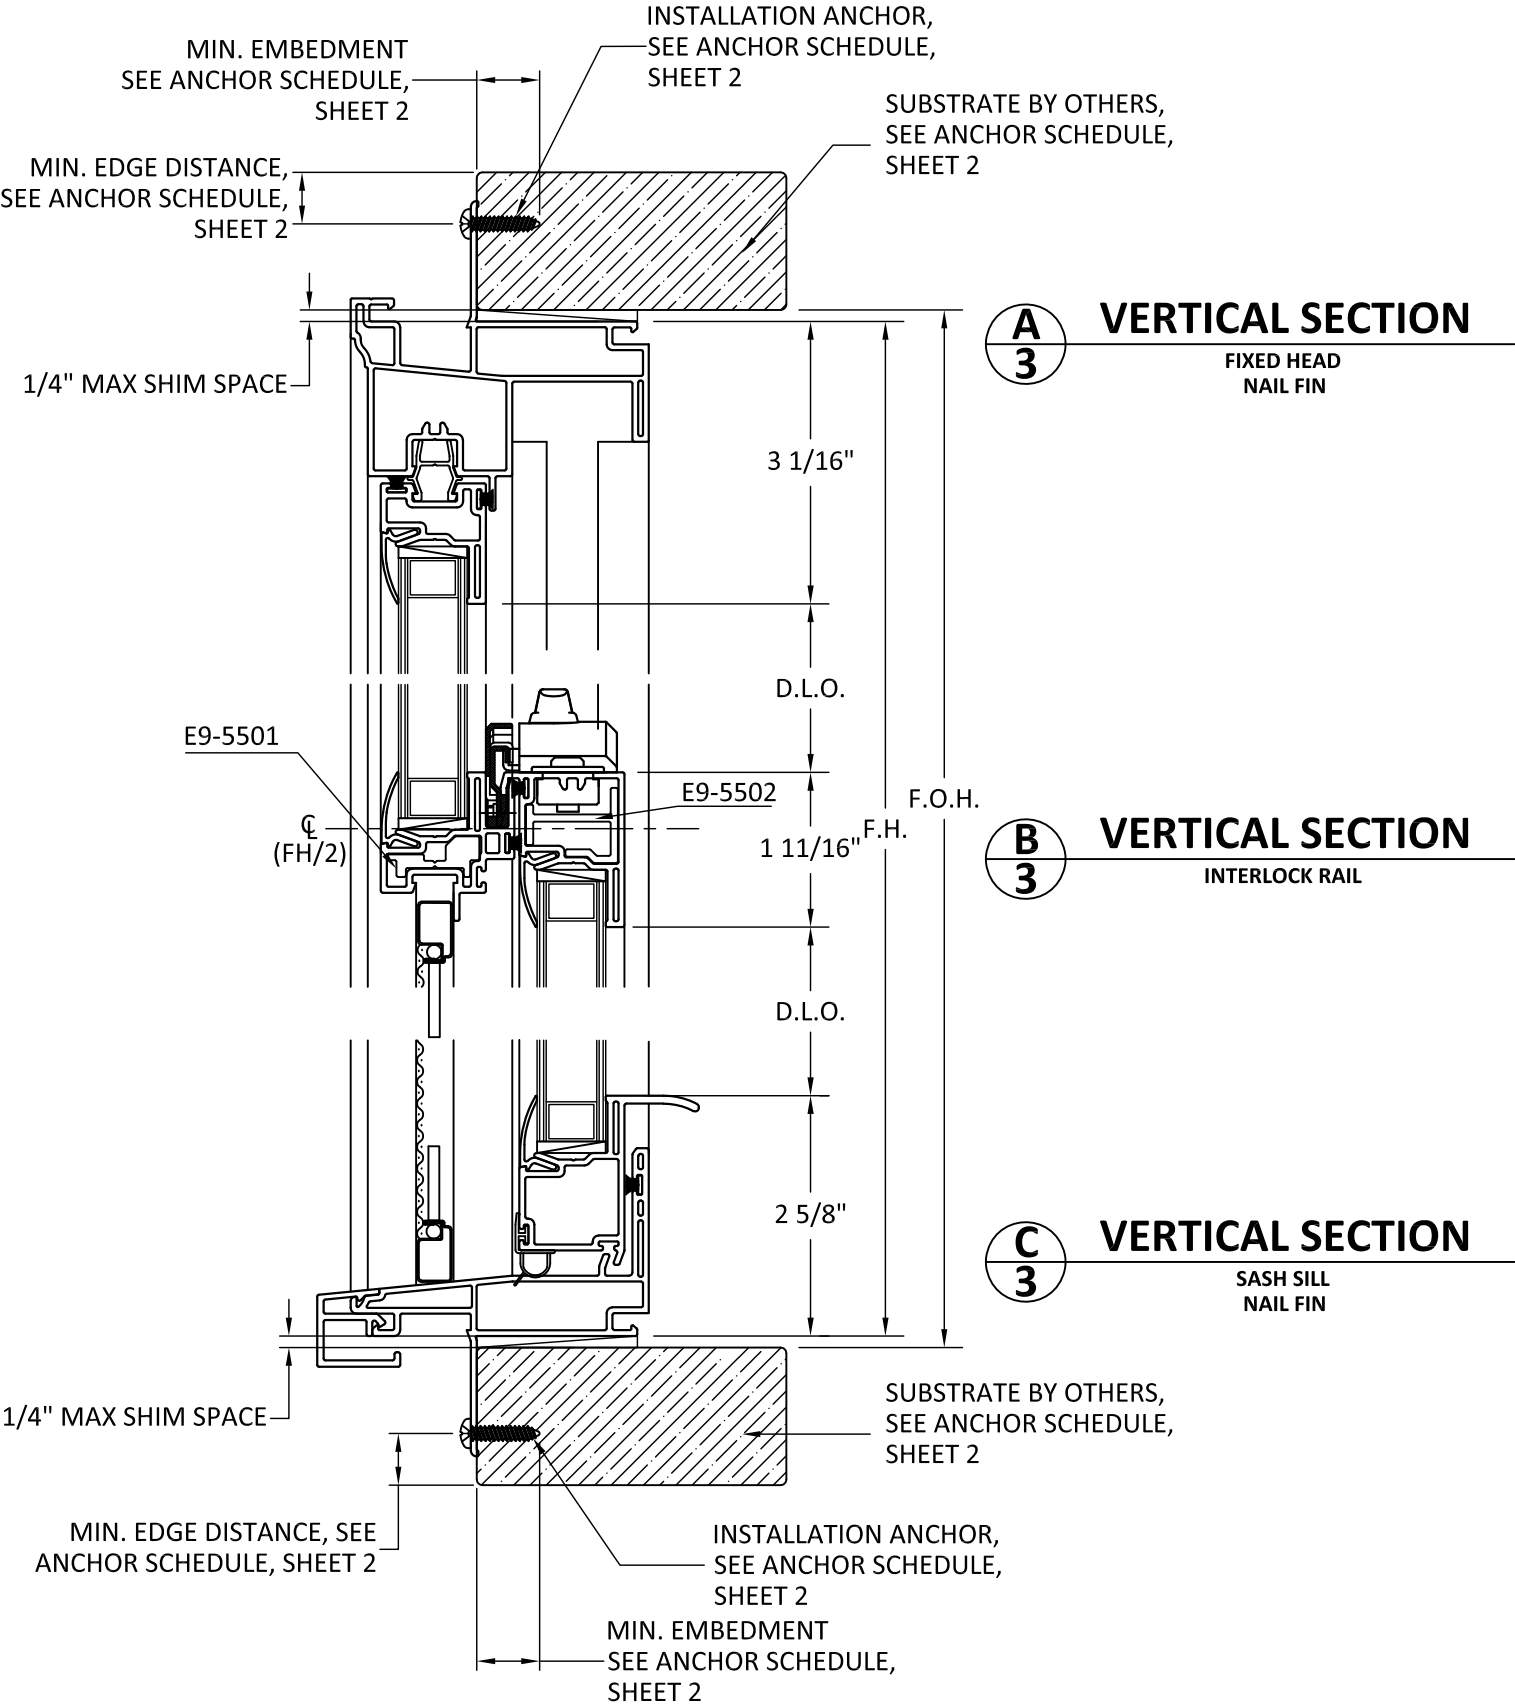

3/4" O.A. INSULATED GLASS

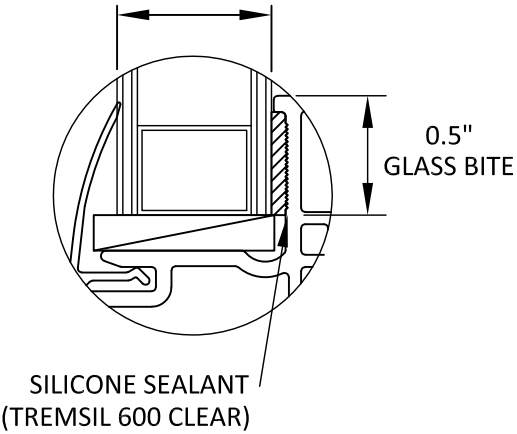

GLAZING DETAIL

GLAZING NOTES:

1. GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCK TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" PER FBC CHAPTER 24.
4. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

INTERCEPT STAINLESS STEEL OR TIN PLATED SPACER:
AROUND THE PERIMETER OF THE GLASS

PRIMARY SEALANT:
POLYISOBUTYLENE (PIB)

SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION
OF INSULATED GLASS UNITS.



YKK AP AMERICA RESIDENTIAL

4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (866) 348-9091

TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
NAIL FIN VERTICAL SECTION
& GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

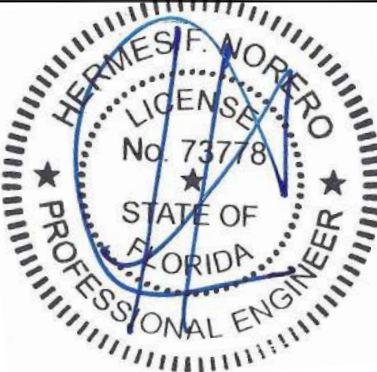

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL8114

DATE: **06.17.20**

DWG. BY:
NUS

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **YKK123**

SHEET:


3

OF 6


9/24/2020 3:26 PM

s:\projects\ykk ap america, inc\cc-20-0237 residential fbc submittal - fbc 2020 code change\18114-r4\dwgs\ykk123.dwg

NAIL FIN

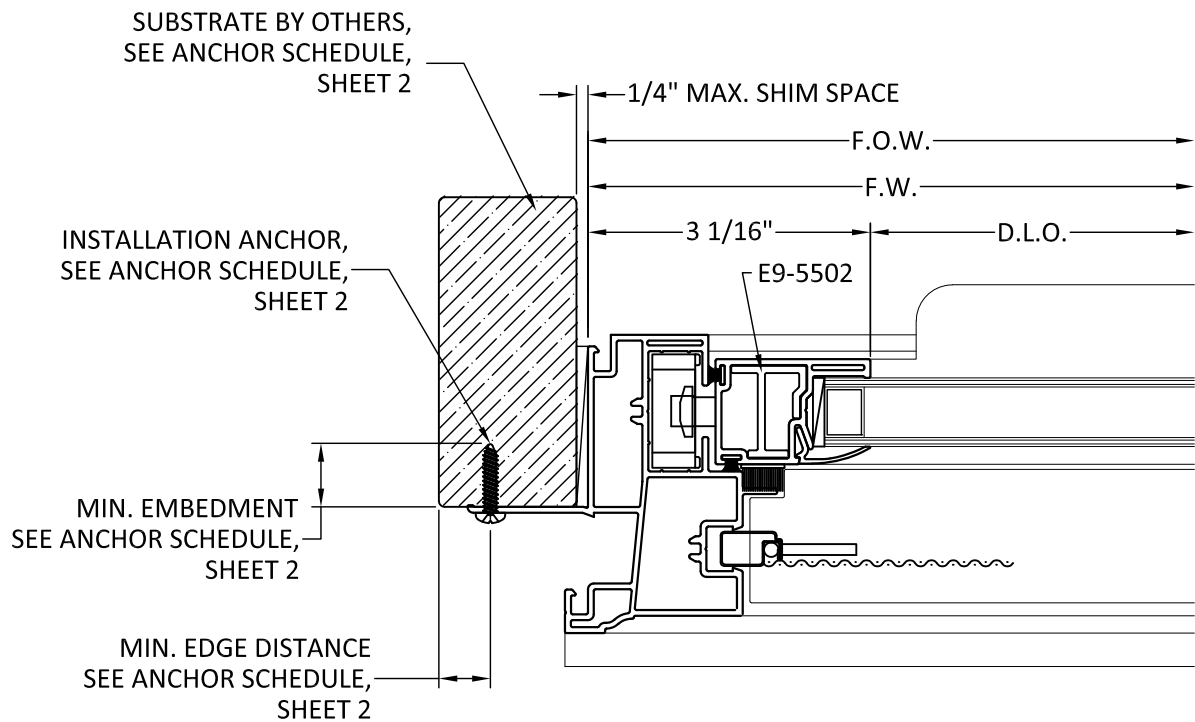

D
4 **HORIZONTAL SECTION**
VENT JAMB
NAIL FIN

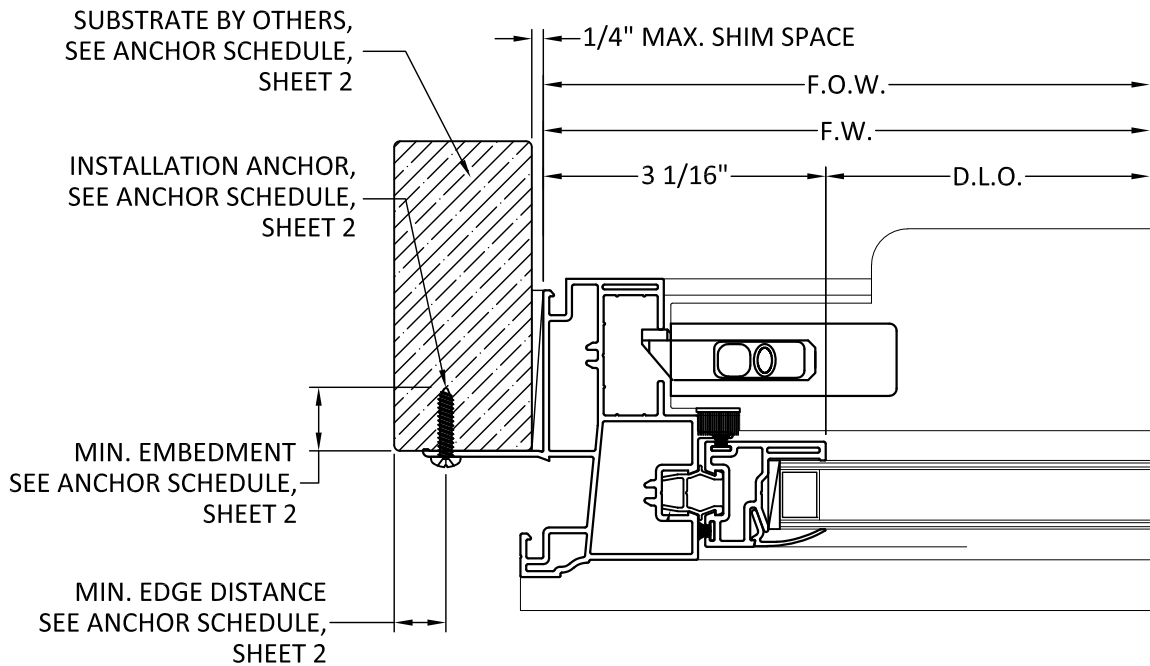

E
4 **HORIZONTAL SECTION**
FIXED JAMB
NAIL FIN



YKK AP AMERICA RESIDENTIAL
4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (866) 348-9091

TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
NAIL FIN
HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL8114

DATE: **06.17.20**

DWG. BY: **NUS** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **YKK123**

SHEET:

9/24/2020 3:26 PM

s:\projects\ykk ap america, inc\cc-20-0237 residential fbc submittal - fbc 2020 code change\18114-r4\dwgs\ykk123.dwg

THROUGH FRAME

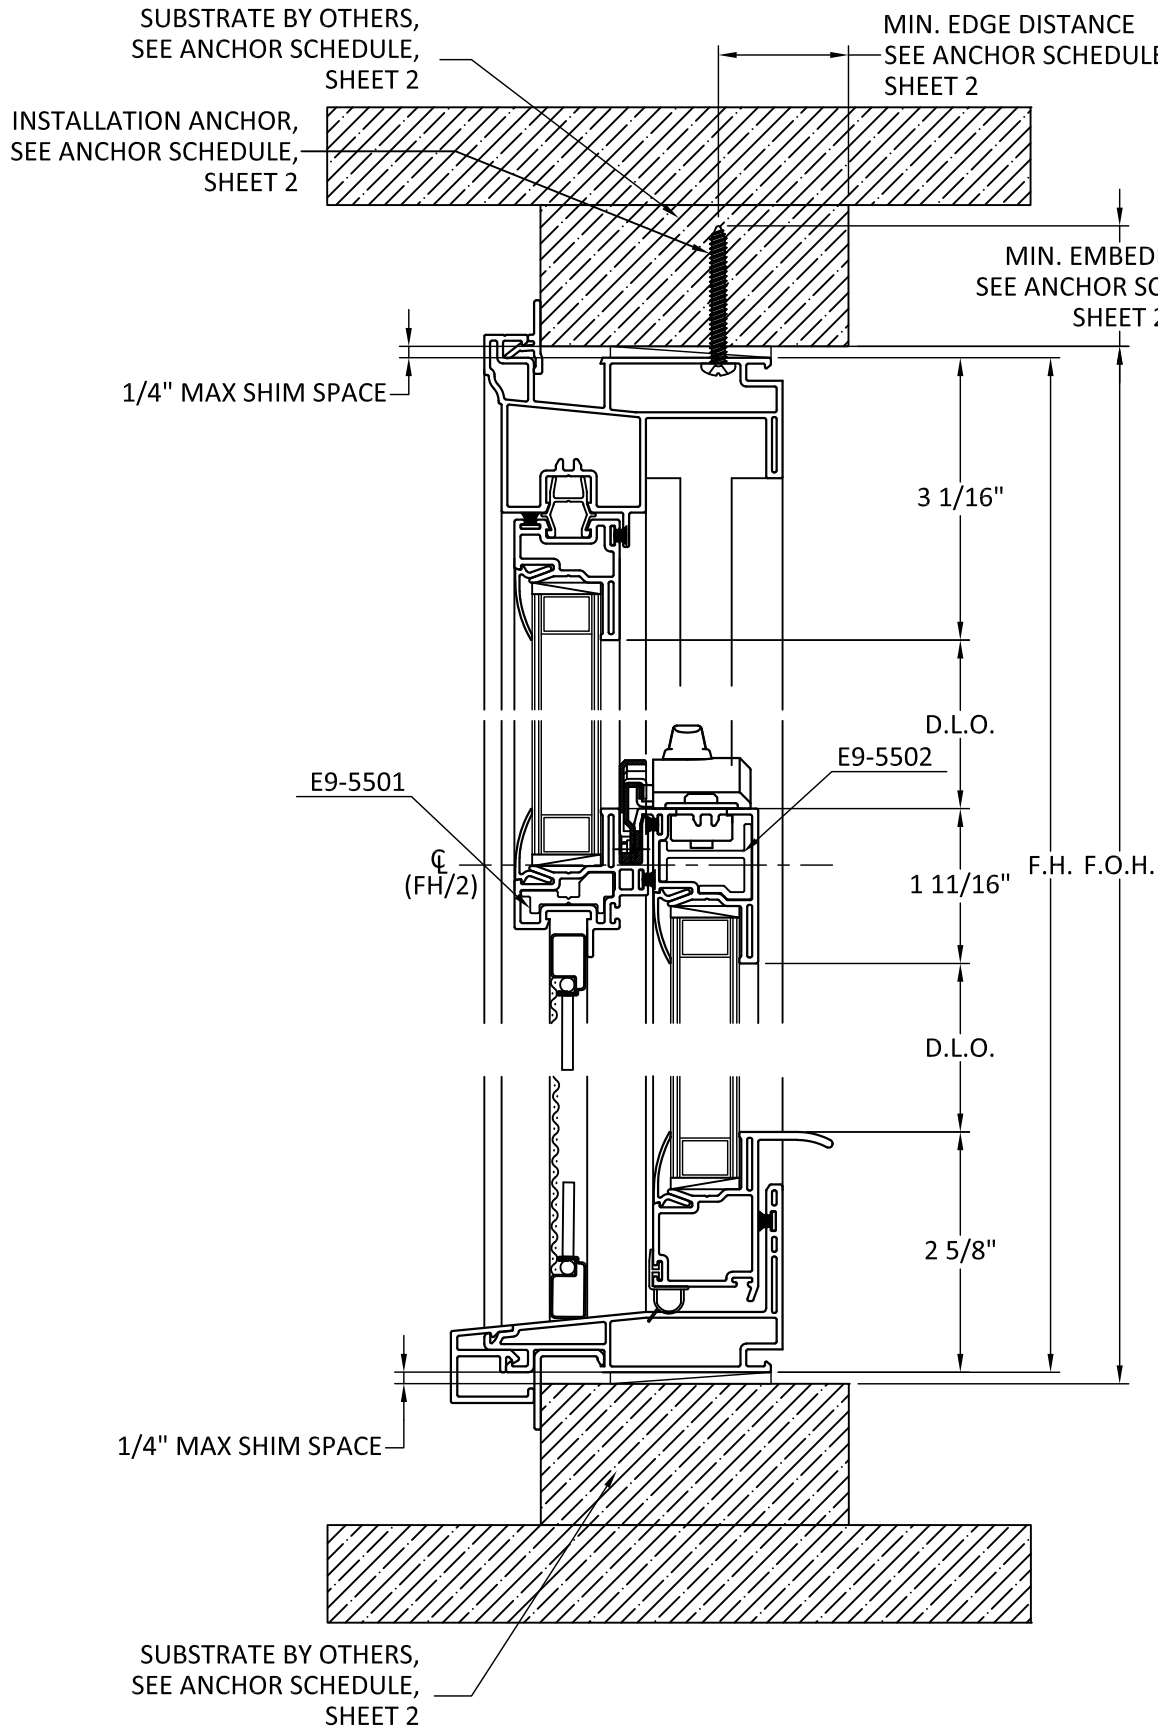

F 5 VERTICAL SECTION
FIXED HEAD
THROUGH FRAME

G 5 VERTICAL SECTION
INTERLOCK RAIL

H 5 VERTICAL SECTION
SASH SILL
THROUGH FRAME



YKK AP AMERICA RESIDENTIAL
4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (866) 348-9091


TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
THROUGH FRAME
VERTICAL SECTION

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

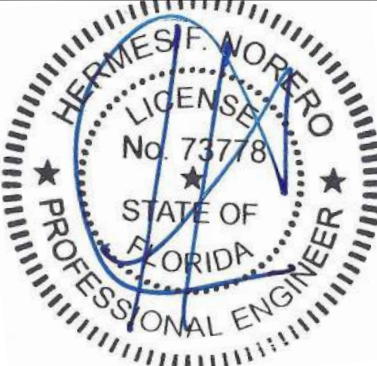


HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL8114
DATE:	06.17.20
DWG. BY:	NUS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK123
SHEET:	5


9/24/2020 3:26 PM

s:\projects\ykk ap america, inc\cc-20-0237 residential fbc submittal - fbc 2020 code change\18114-r4\dwgs\ykk123.dwg

THROUGH FRAME

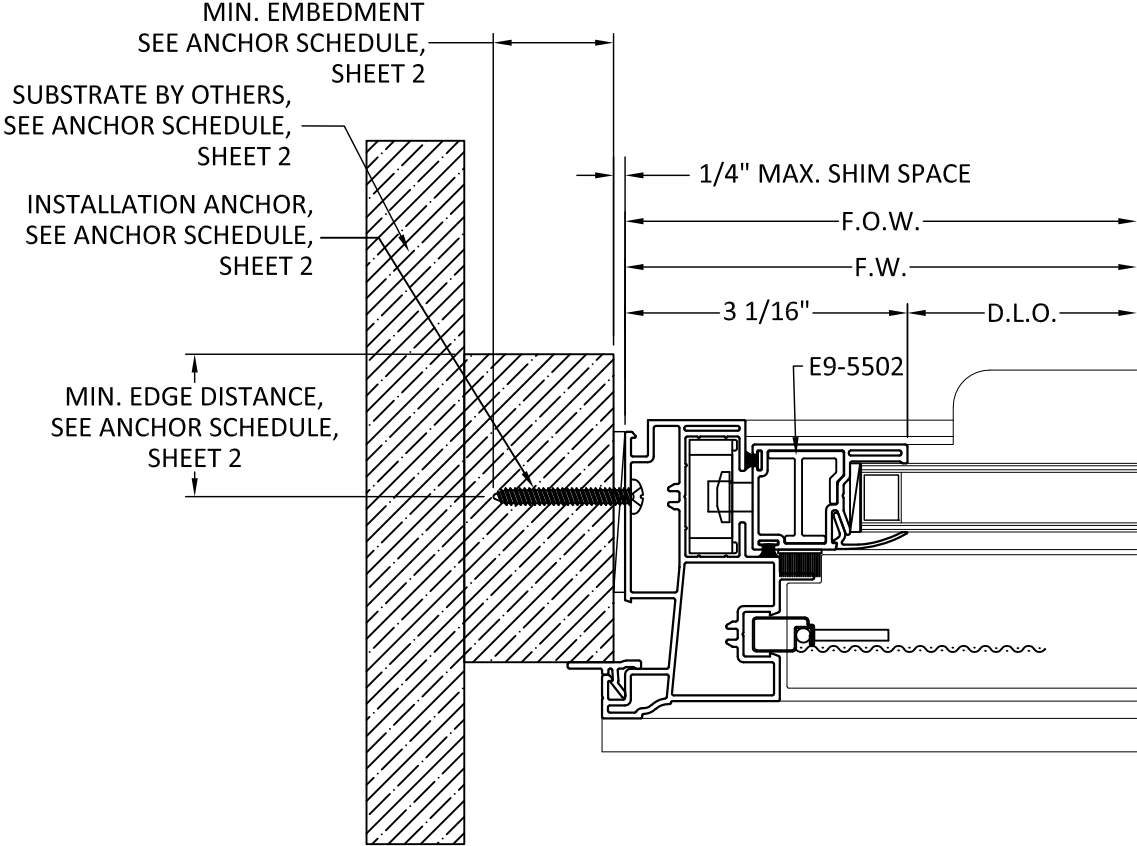

I
6 **HORIZONTAL SECTION**
VENT JAMB
THROUGH FRAME

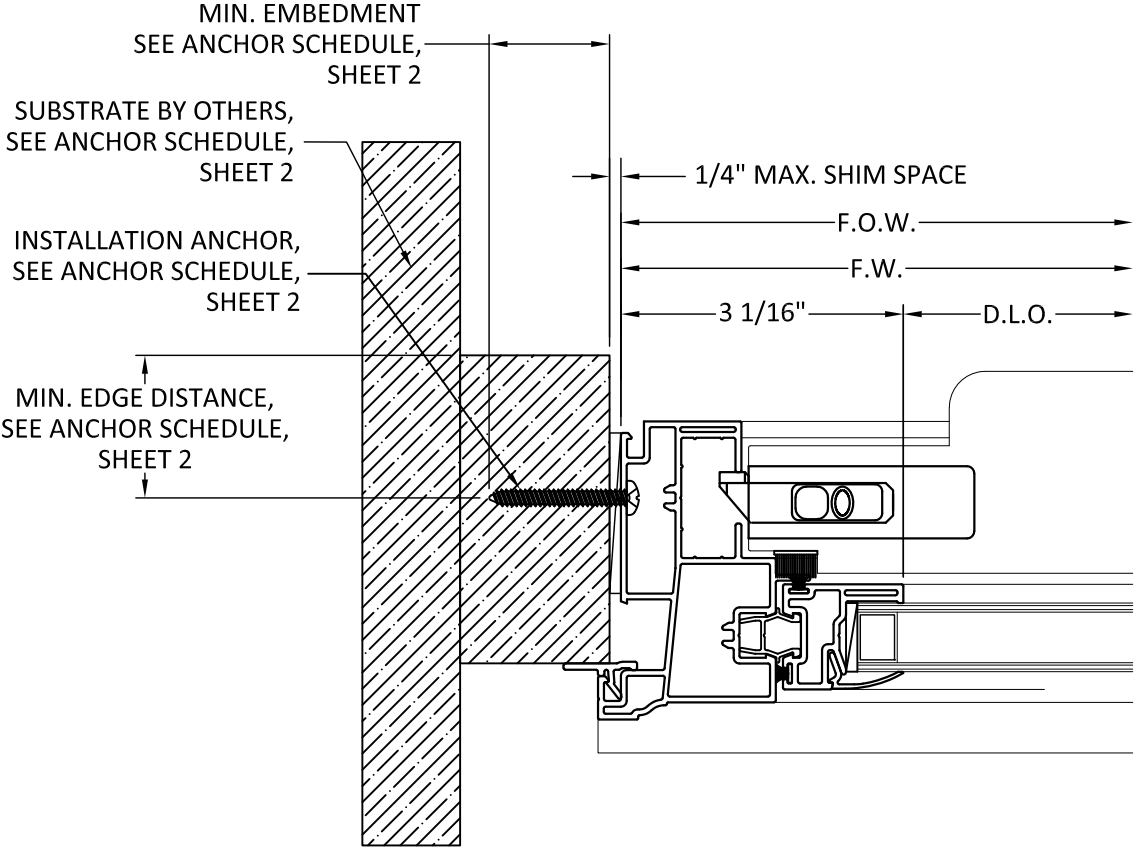

J
6 **HORIZONTAL SECTION**
FIXED JAMB
THROUGH FRAME



YKK AP AMERICA RESIDENTIAL
4234 OCMULGEE BLVD.
MACON, GEORGIA 31217
PH: (866) 348-9091

TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
THROUGH FRAME
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL8114
DATE:	06.17.20
DWG. BY:	NUS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK123
SHEET:	6