

LOCATION
SKETCH

NOT TO
SCALE



GREEN OAK ROAD

COUNTY ROAD

PECAN 1 ANE

[illegible]

PECAN LANE
(A PUBLIC ROAD) (60' R/W)

30' ~~42~~

30' 421

- CONCRETE MONUMENT FOUND
- CONCRETE MONUMENT SET, LS 4708
- IRON PIN OR PIPE FOUND
- 5/8" IRON ROD SET, LS 4708
- X- WIRE FENCE
- E- ELECTRIC UTILITY LINE (OVERHEAD)
- UGE- UNDERGROUND ELECTRIC SERVICE
- CIV- CABLE TV LINE (OVERHEAD)
- C- CHAIN LINK FENCE
- W- WOODEN FENCE
- CMP CORRUGATED METAL PIPE
- RCP REINFORCED CONCRETE PIPE
- LS LAND SURVEYOR
- LB LICENSED BUSINESS
- ORB OFFICIAL RECORD BOOK
- PRM PERMANENT REFERENCE MONUMENT
- PCP PERMANENT CONTROL POINT
- ⊗ UTILITY POLE
- R/W RIGHT-OF-WAY
- N.O.I.D. NO IDENTIFICATION
- FLA. D.O.T. FLA. DEPT. OF TRANSPORTATION

RT. 18 BOX 555
SISTERS WELCOME ROAD
LAKE CITY, FLA. 32025
(904) 758-9831 OFFICE
(904) 752-3605 FAX

FIELD SURVEY DATE 3 JUNE 1996
DATE DRAWN 6 JUNE 1996
FOR JACQUELINE THOMPSON AND
BERYLETTA MORGAN
FIELD BOOK 32 PAGE 18
DRAWN BY MARK DUREN & WAYNE EAKINS

WO# 207-05-96

LOT 4
CONTAINING
4.02 ACRES ±.


LOT 5
NOT A
PART

SURVEYOR'S NOTES:

1. BOUNDARY BASED ON MONUMENTATION FOUND IN ACCORDANCE WITH THE RETRACEMENT OF THE ORIGINAL SURVEY FOR SAID PLAT OF RECORD.
2. BEARINGS BASED ON SAID PLAT OF RECORD USING MONUMENTS FOUND ON THE SOUTH LINE OF SAID PARCEL.
3. THIS PARCEL IS IN ZONE "X" AND IS DETERMINED TO BE OUTSIDE THE 500 YEAR FLOOD PLAIN AS PER FLOOD INSURANCE RATE MAP, DATED JANUARY 6, 1988 COMMUNITY PANEL NO. 120070 0175B.
4. NO EASEMENT FOR DRAINAGE IS SHOWN ON THIS LOT ON SAID PLAT OF RECORD.
5. THE IMPROVEMENTS, IF ANY, INDICATED ON THIS SURVEY DRAWING ARE AS LOCATED ON DATE OF FIELD SURVEY AS SHOWN HEREON.
6. IF THEY EXIST, NO UNDERGROUND ENCROACHMENTS AND/OR UTILITIES WERE LOCATED FOR THIS SURVEY EXCEPT AS SHOWN HEREON.
7. "UNLESS IT BEARS THE SIGNATURE AND THE ORIGINAL RAISED SEAL OF A FLORIDA LICENSED SURVEYOR AND MAPPER THIS DRAWING, SKETCH, PLAT OR MAP IS FOR INFORMATIONAL PURPOSES ONLY AND IS NOT VALID."
8. CLOSURE OF FIELD SURVEY IS 1/38,943.
9. CERTIFIED TO:
 - A. JACQUELINE THOMPSON & BERYLETTA MORGAN
 - B. FIRST NATIONAL BANK OF CENTRAL FLORIDA
 - C. ABSTRACT & TITLE SERVICES, INC.
 - D. CHICAGO TITLE INSURANCE COMPANY
 - E. G.M.A.C. MORTGAGE CORPORATION OF P.A., ITS SUC

CERTIFICATION:
I HEREBY CERTIFY THAT THIS SURVEY WAS MADE UNDER MY RESPONSIBLE CHARGE AND MEETS THE MINIMUM TECHNICAL STANDARDS AS SET FORTH BY THE FLORIDA BOARD OF PROFESSIONAL SURVEYORS AND MAPPERS IN CHAPTER 61G17-6, FLORIDA ADMINISTRATIVE CODE, PURSUANT TO SECTION 472.027, FLORIDA STATUTES.

BY: MARK D. DUREN
MARK D. DUREN, LS 4708

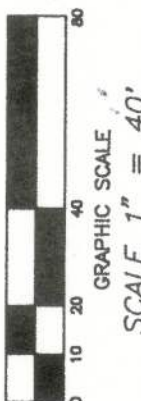

GRAPHIC SCALE
SCALE 1" = 40'


REVISIONS	




TALL STEM WALL TABLE

The table assumes 60 ksi reinforcing bars with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Duowall ladder reinforcement at 16"OC vertically or a horizontal tend beam with 165 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.

STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 6" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

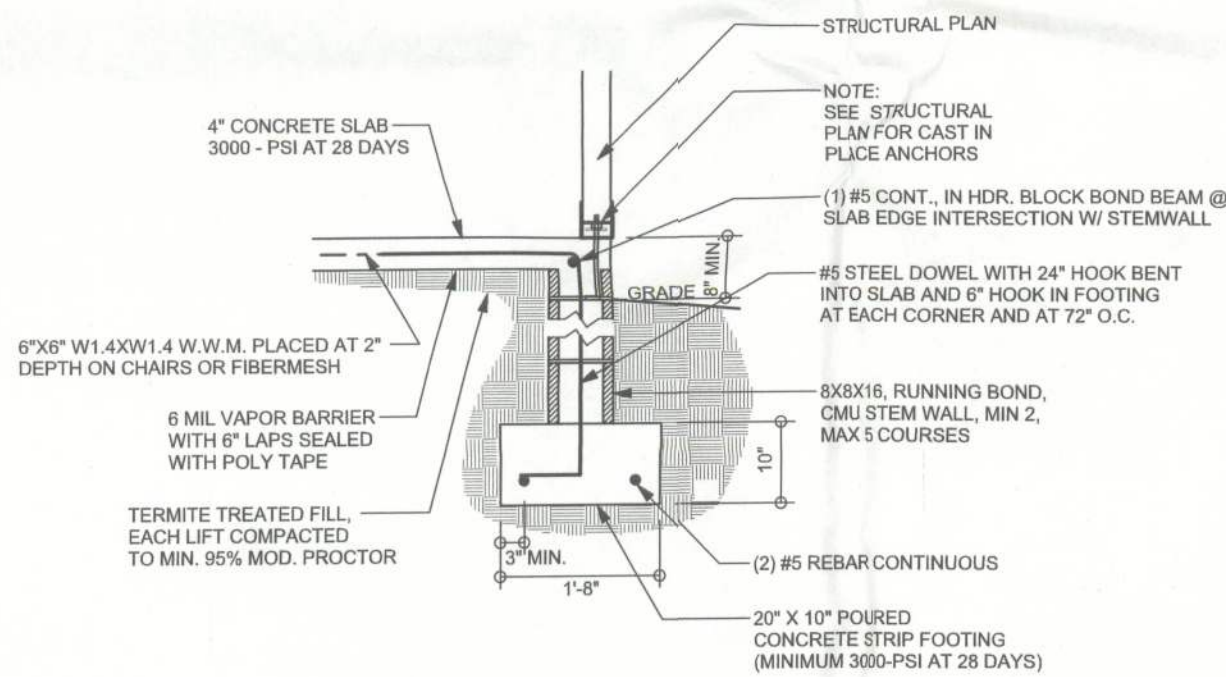

F1 S-2 STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

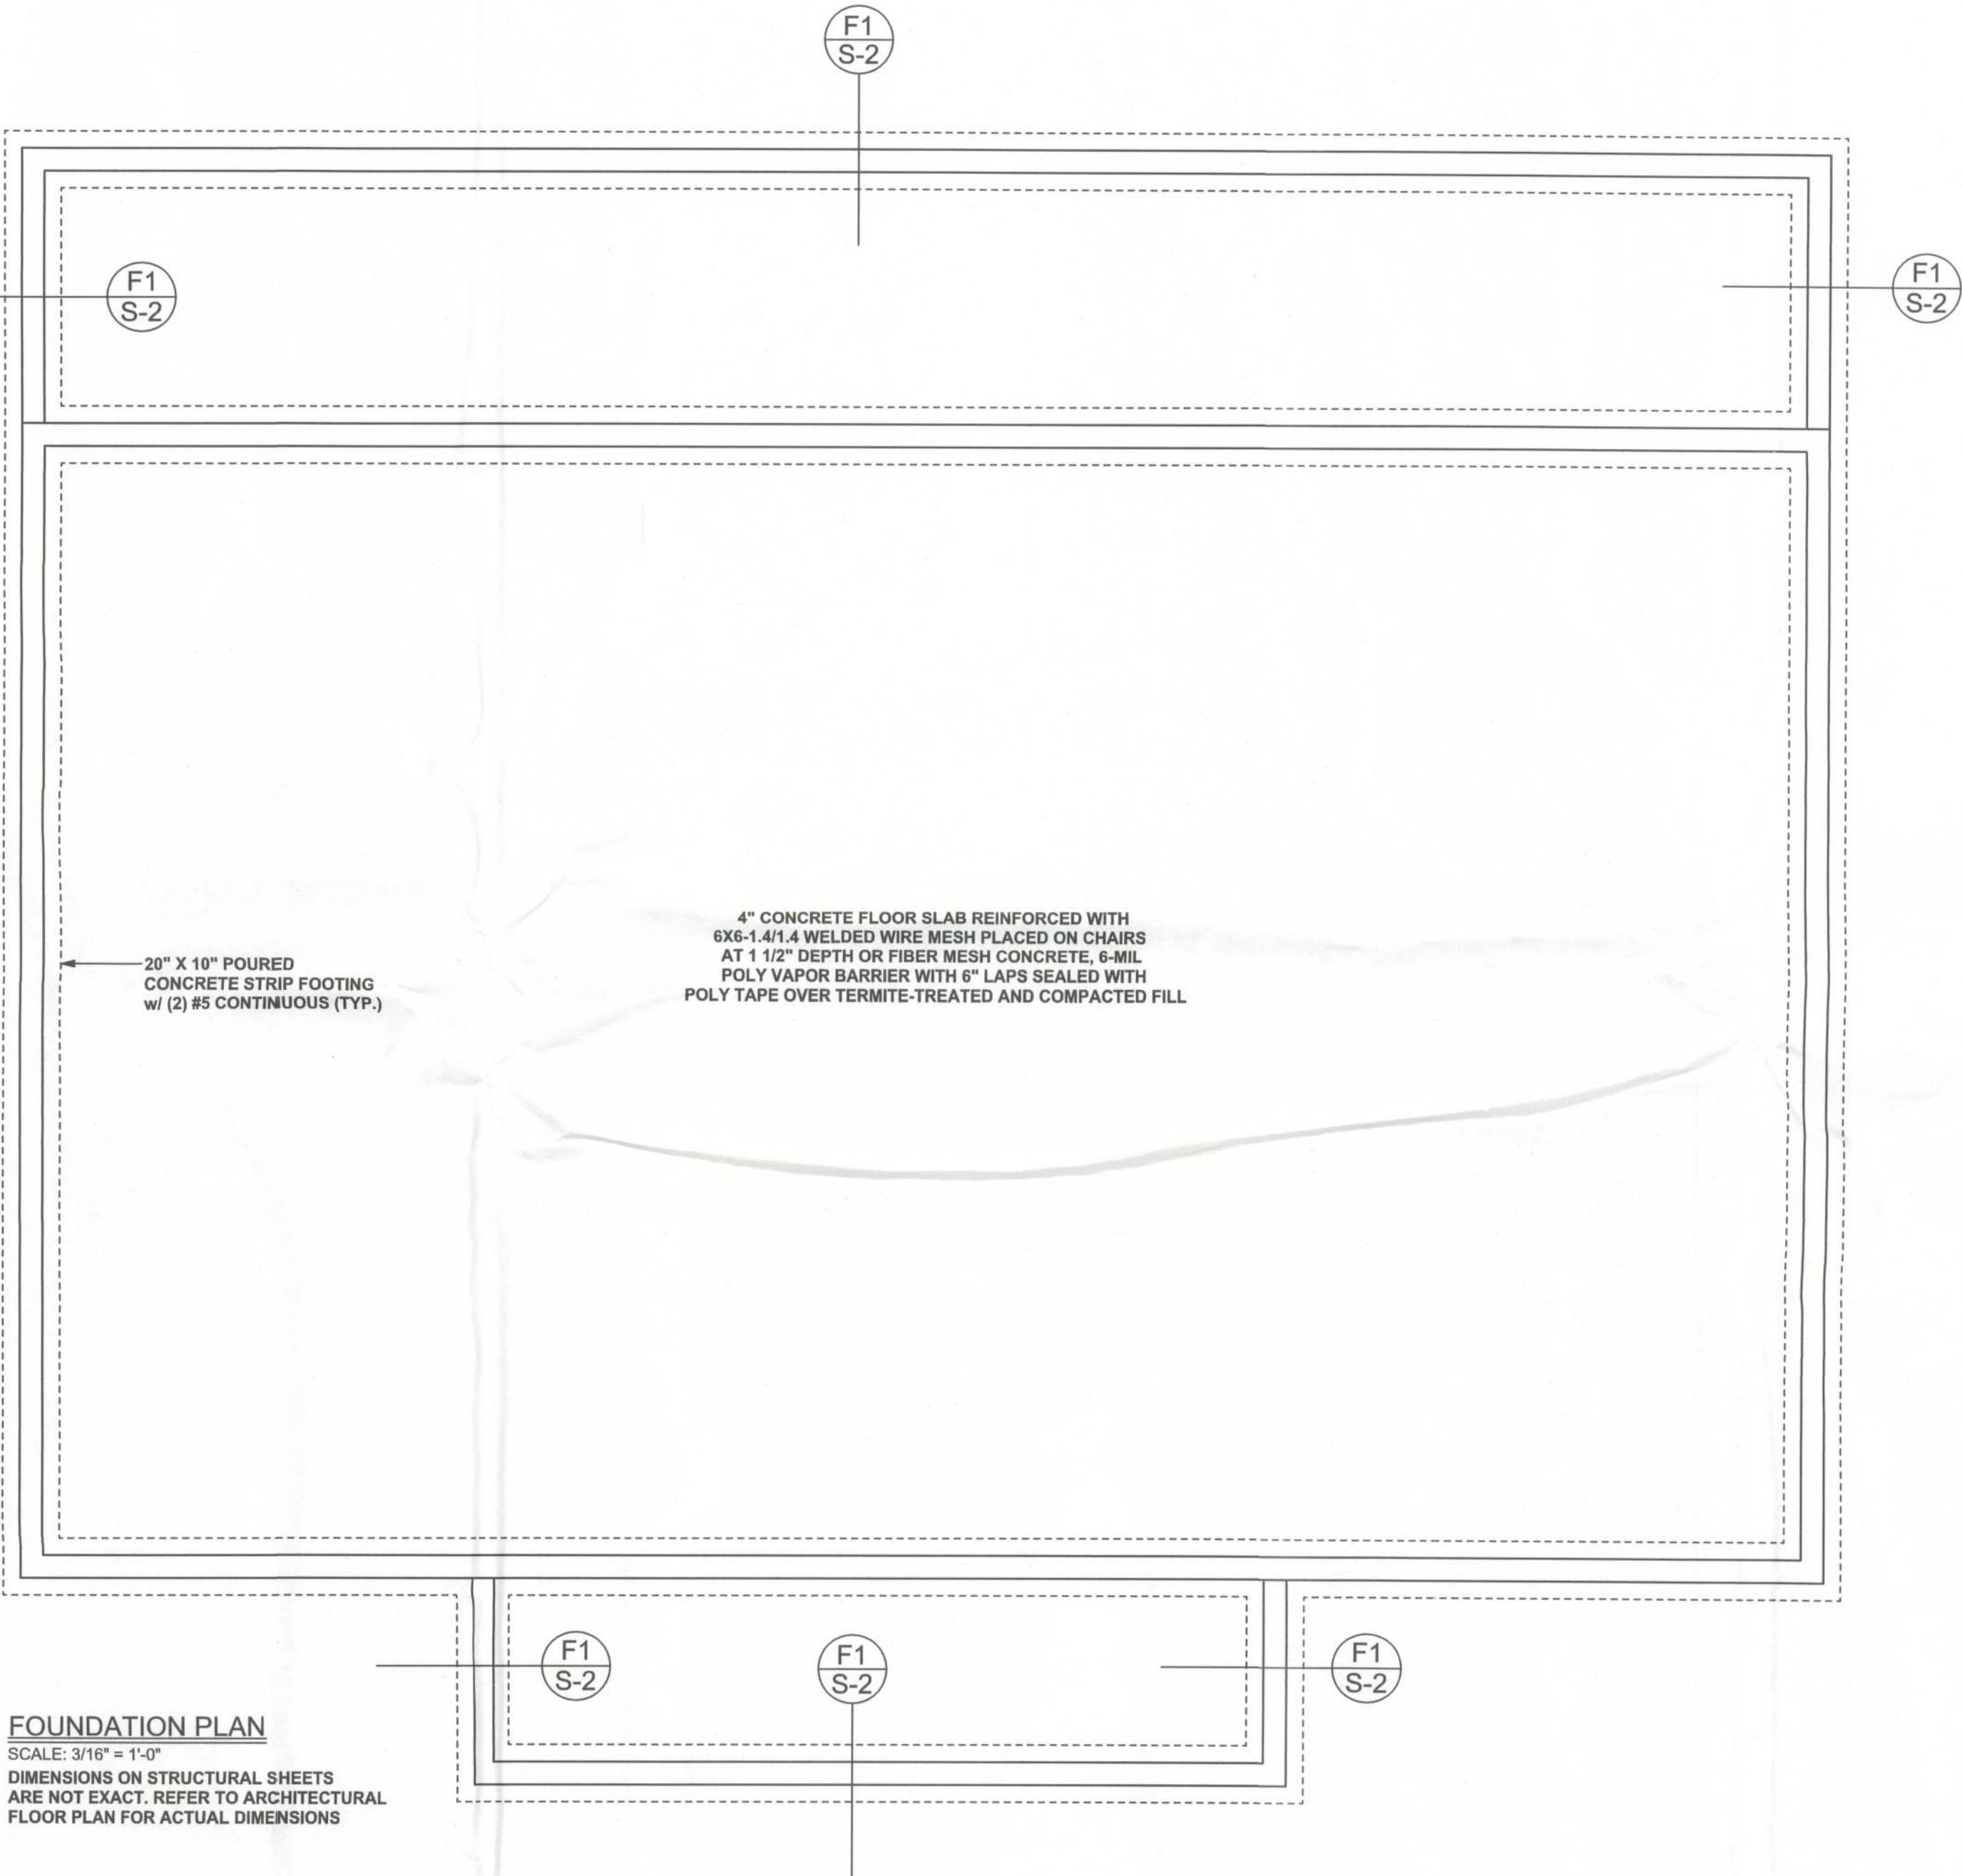

FOUNDATION PLAN
SCALE: 3/16" = 1'-0"
DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS

WINDLOAD ENGINEER: Mark Disosway, P.E. No. 53915, POB 868, Lake City, FL 32056, 386-754-5419

DIMENSIONS: Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with section R301.2.1, 2010 Florida Building Code Residential to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY
P.E. 53915
August 06, 2013

Stephen Crawford Construction

Jacqueline Thompson Residence

ADDRESS:
303 SW Pecan Glen
Lake City, Florida 32024

Mark Disosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
August 06, 2013

DRAWN BY: STRUCTURAL BY:

FINALS DATE:
6Aug13

JOB NUMBER:
1307049

DRAWING NUMBER
S-2
OF 3 SHEETS

MATERIALS


1. 8" precast lintel = 3500 psi
2. 8" precast lintel = 6000 psi
3. Grout per ASTM C476 f_c = 3000 psi w/ maximum 3/8 inch aggregate & 8 to 11 inch slump
4. Concrete Masonry Units (CMU) per ASTM C90 w/minimum net area compressive strength = 1900 psi
5. Rebar per ASTM A615 grade 60
6. Prestressing strand per ASTM A416 grade 270 low relaxation
7. Mortar per ASTM C270 type M or S

GENERAL NOTES

1. Provide full mortar bed and head joints.
2. Shore filled lintels as required.
3. Installation of lintel must comply with the architectural and/or structural documents.
4. U-Intels are manufactured with 5 1/2" long notches at the ends to accommodate vertical cell reinforcing and grouting.
5. All lintels meet or exceed L/360 deflection, except lintels 17'-4" and longer with a nominal height of 8' meet or exceed L/180 deflection.
6. Bottom field added rebar to be located at the bottom of the lintel cavity.
7. 7/32" diameter wire stirrups are welded to the bottom steel for mechanical interchange.
8. Cast-in-place concrete may be provided in composite lintel in lieu of concrete masonry units.
9. Safe load rating based on rational design analysis per ACI 318 and ACI 530
10. Product Approvals: Miami-Dade County, Florida No. 03-0606.05
11. The exterior surface of lintels installed in exterior concrete masonry walls shall have a coating of stucco applied in accordance with ASTM C-296 or other approved coating.
12. Lintels loaded simultaneously with vertical (gravity or uplift) and horizontal (lateral) loads should be checked for the combined loading with the following equation:


$$\frac{\text{Applied vertical load}}{\text{Safe vertical load}} + \frac{\text{Applied horizontal load}}{\text{Safe horizontal load}} \leq 1.0$$
13. Additional lateral load capacity can be obtained by the designer by providing additional reinforced concrete masonry above the lintel. See detail at right.

TYPE DESIGNATION

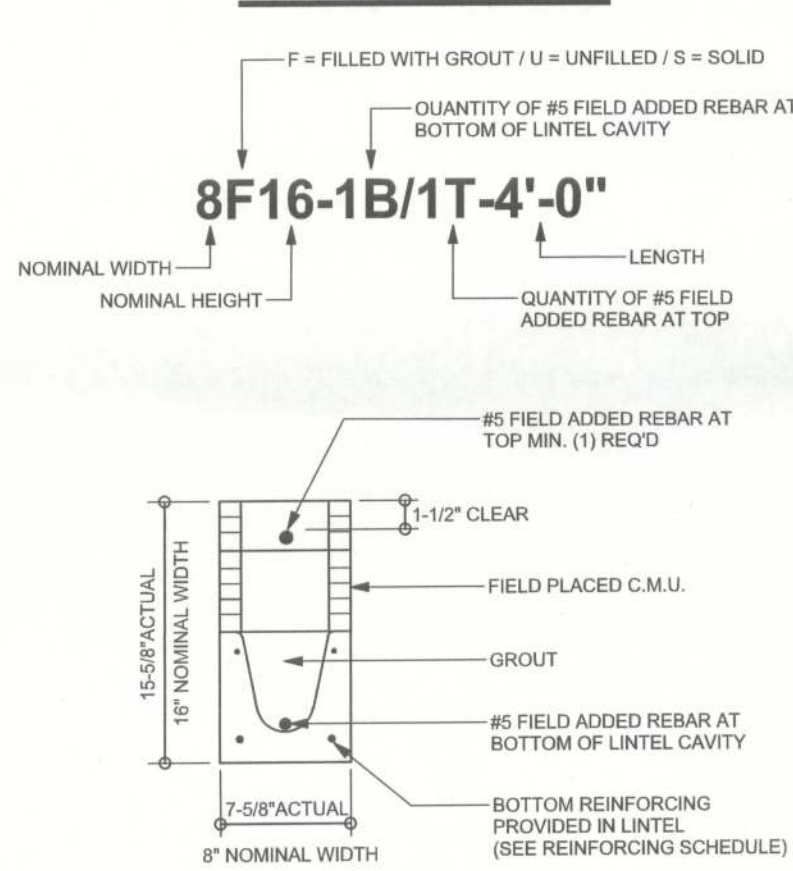

SAFE LOAD TABLE NOTES

1. All values based on minimum 4 inch nominal bearing.
- Exception: Safe loads for unfilled lintels must be reduced by 20% if bearing length is less than 6 1/2 inches.
2. N.R. = Not Rated
3. Safe loads are superimposed allowable loads.
4. Safe loads based on grade 40 or grade 60 field rebar.
5. One #7 rebar may be substituted for two #5 rebars in 8" lintels only
6. The designer may evaluate concentrated loads from the safe load tables by calculating the maximum resisting moment and shear at d-away from face of support.
7. For composite lintel heights not shown, use safe load from next lower height shown.
8. For lintel lengths not shown, use safe load from next longest length shown
9. All safe loads in units of pounds per linear foot
10. All safe loads based on simply supported span.
11. The number in the parenthesis indicates the percent reduction for grade 40 field added rebar.
 Example 7'-6" lintel type 8F32-1B safe gravity load = 6472(40,046)(51)(40,0781); w/ 15% reduction 6472 $\Rightarrow$ (.85) = 5501 plf


SAFE GRAVITY LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS										
		TYPE	SAFE LOAD - POUNDS PER LINEAR FOOT							
			8F8-0B 8F8-1B	8F12-0B 8F12-1B	8F16-0B 8F16-1B	8F20-0B 8F20-1B	8F24-0B 8F24-1B	8F28-0B 8F28-1B	8F32-0B 8F32-1B	
2'-10"	(34")	PRECAST	2231	3069	4605	6113	7547	8974	10394	11809
3'-6"	(42")	PRECAST	2231	3069	4605	6113	7547	8974	10394	11809
4'-0"	(48")	PRECAST	1966	2683	4605	6113	7547	8974	10394	11809
4'-6"	(54")	PRECAST	1599	1969	2110	2391	2753	4576	5400	6224
5'-4"	(64")	PRECAST	1217	1349	1438	1998	2562	3123	3696	4249
5'-10"	(70")	PRECAST	1062	1163	1209	1663	2140	2549	3009	3470
6'-6"	(78")	PRECAST	908	1011	1072	1451	1922	2340	2748	3156
7'-6"	(90")	PRECAST	743	845	899	1179	1561	1947	2335	2723
9'-4"	(112")	PRECAST	554	699	1160	1625	2564	3486	4705	6107
10'-6"	(126")	PRECAST	475	643	1052	1533	2093	2777	3638	4724
11'-4"	(136")	PRECAST	362	582	945	1366	1846	2423	3127	4000
12'-0"	(144")	PRECAST	337	540	873	1254	1684	2193	2805	3552
13'-4"	(160")	PRECAST	296	471	755	1075	1428	1838	2316	2883
14'-0"	(168")	PRECAST	279	424	706	1002	1326	1697	2127	2630
14'-6"	(176")	PRESTRESSED	N.R.	458	783	1370	1902	2245	2517	2712
15'-4"	(184")	PRESTRESSED	N.R.	412	710	1250	1733	2058	2320	2513
17'-4"	(208")	PRESTRESSED	N.R.	300	536	950	1326	1609	1849	2047
19'-4"	(232")	PRESTRESSED	N.R.	235	418	750	1037	1282	1515	1716
21'-4"	(256")	PRESTRESSED	N.R.	NR	NR	NR	NR	NR	NR	NR
22'-0"	(264")	PRESTRESSED	N.R.	185	315	550	784	1047	1268	1399
24'-0"	(288")	PRESTRESSED	N.R.	NR	NR	NR	NR	NR	NR	NR

SAFE UPLIFT LOADS FOR 8" PRECAST & PRESTRESSED U-LINTELS

		SAFE LOAD - POUNDS PER LINEAR FOOT							
LENGTH	TYPE	8F8-1T	8F12-1T	8F16-1T	8F20-1T	8F24-1T	8F28-1T	8F32-1T	
		8F8-2T	8F12-2T	8F16-2T	8F20-2T	8F24-2T	8F28-2T	8F32-2T	
2'-10" (34")	PRECAST	1972	3173	4460	5747	7034	8321	9608	
3'-6" (42")	PRECAST	1599	2524	3547	4569	5591	6613	7636	
4'-0" (48")	PRECAST	1383	2192	3079	3966	4853	5740	6627	
4'-6" (54")	PRECAST	1207	1940	2724	3508	4292	5077	5861	
5'-4" (64")	PRECAST	1016	1632	2290	2949	3607	4265	4924	
5'-10" (70")	PRECAST	909	1492	2093	2694	3295	3897	4498	
6'-6" (78")	PRECAST	835	1340	1880	2419	2959	3498	4038	
7'-6" (90")	PRECAST	727	1161	1634	2102	2571	3039	3508	
9'-4" (112")	PRECAST	591	851	1328	1705	2094	2463	2842	
10'-6" (126")	PRECAST	530	552	914	1185	1458	1732	2007	
11'-4" (136")	PRECAST	474	485	798	1034	1272	1510	1749	
12'-0" (144")	PRECAST	404	599	1028	1422	1738	2053	2369	
13'-4" (160")	PRECAST	470	543	928	1349	1649	1948	2247	
14'-0" (168")	PRECAST	416	417	723	968	1151	1396	1592	
14'-6" (176")	PRESTRESSED	384	428	455	770	1145	1444	1719	
15'-4" (184")	PRESTRESSED	246	302	360	655	958	1324	1625	
15'-4" (184")	PRESTRESSED	224	302	485	626	787	909	1052	
17'-4" (208")	PRESTRESSED	230	364	609	927	1224	1562	1891	
19'-4" (232")	PRESTRESSED	187	256	404	620	872	1124	1376	
21'-4" (256")	PRESTRESSED	162	222	347	478	640	846	1047	
21'-4" (256")	PRESTRESSED	166	261	424	616	831	1057	1225	
22'-0" (264")	PRESTRESSED	142	198	308	511	713	903	1096	
22'-0" (264")	PRESTRESSED	137	192	295	508	681	861	1047	
24'-0" (288")	PRESTRESSED	134	231	354	558	749	941	1097	
24'-0" (288")	PRESTRESSED	124	175	267	341	416	491	566	
24'-0" (288")	PRESTRESSED	124	200	316	450	600	756	875	

SAFE GRAVITY LOADS FOR 8" PRECAST W/ 2" RECESS DOOR U-LINTELS									
		SAFE LOAD - POUNDS PER LINEAR FOOT							
LENGTH	TYPE	8RUG	8RF6-0B	8RF10-0B	8RF14-0B	8RF18-0B	8RF22-0B	8RF26-0B	8RF30-0B
4'-4" (52")	PRECAST	1635	1749	3355	3280	4349	5421	6493	7565
4'-6" (54")	PRECAST	1494	1596	3699	5206	6639	8060	9479	10893
5'-8" (68")	PRECAST	866	1596	3083	2992	3968	4946	5924	6904
5'-10" (70")	PRECAST	810	1756	3698	5206	6639	8060	9479	10893
6'-8" (80")	PRECAST	797	820	1779	1716	2277	2839	3402	3964
7'-6" (90")	PRECAST	669	1167	2481	4567	6389	8060	9717	11381
9'-8" (116")	PRECAST	411	1113	2342	4242	6639	8060	9717	11381
9'-8" (116")	PRECAST	411	901	1625	3120	5048	7747	9448	11141
9'-8" (116")	PRECAST	411	801	1625	3120	5048	7715	9479	10893
9'-8" (116")	PRECAST	411	755	1490	2459	3776	5743	7236	8729
9'-8" (116")	PRECAST	411	466	999	1568	2253	3129	4091	5148
9'-8" (116")	PRECAST	411	526	999	1568	2253	3129	4150	5891


SAFE UPLIFT LOADS FOR 8" PRECAST w/ 2" RECESS DOOR U-LINTELS									
		SAFE LOAD - POUNDS PER LINEAR FOOT							
LENGTH	TYPE	8RF6-1T	8RF10-1T	8RF14-1T	8RF18-1T	8RF22-1T	8RF26-1T	8RF30-1T	
		8RUG	8RF6-1T <td>8RF10-1T<td>8RF14-1T<td>8RF18-1T<td>8RF22-1T<td>8RF26-1T<td>8RF30-1T</td></td></td></td></td></td>	8RF10-1T <td>8RF14-1T<td>8RF18-1T<td>8RF22-1T<td>8RF26-1T<td>8RF30-1T</td></td></td></td></td>	8RF14-1T <td>8RF18-1T<td>8RF22-1T<td>8RF26-1T<td>8RF30-1T</td></td></td></td>	8RF18-1T <td>8RF22-1T<td>8RF26-1T<td>8RF30-1T</td></td></td>	8RF22-1T <td>8RF26-1T<td>8RF30-1T</td></td>	8RF26-1T <td>8RF30-1T</td>	8RF30-1T
4'-4" (52")	PRECAST	905	1748	2635	3522	4409	5296	6183	
4'-6" (54")	PRECAST	867	1675	2525	3374	4224	5074	5924	
5'-8" (68")	PRECAST	675	1301	1960	2618	3277	3935	4594	
5'-10" (70")	PRECAST	655	1262	1900	2538	3176	3815	4453	
6'-8" (80")	PRECAST	570	1012	1651	2204	2758	3312	3865	
7'-6" (90")	PRECAST	506	797	1462	1952	2442	2931	3421	
9'-8" (116")	PRECAST	395	587	1462	1952	2442	2931	3421	
		395	491	931	1231	1640	1980	2322	
		395	587	1435	1514	1683	2272	2532	

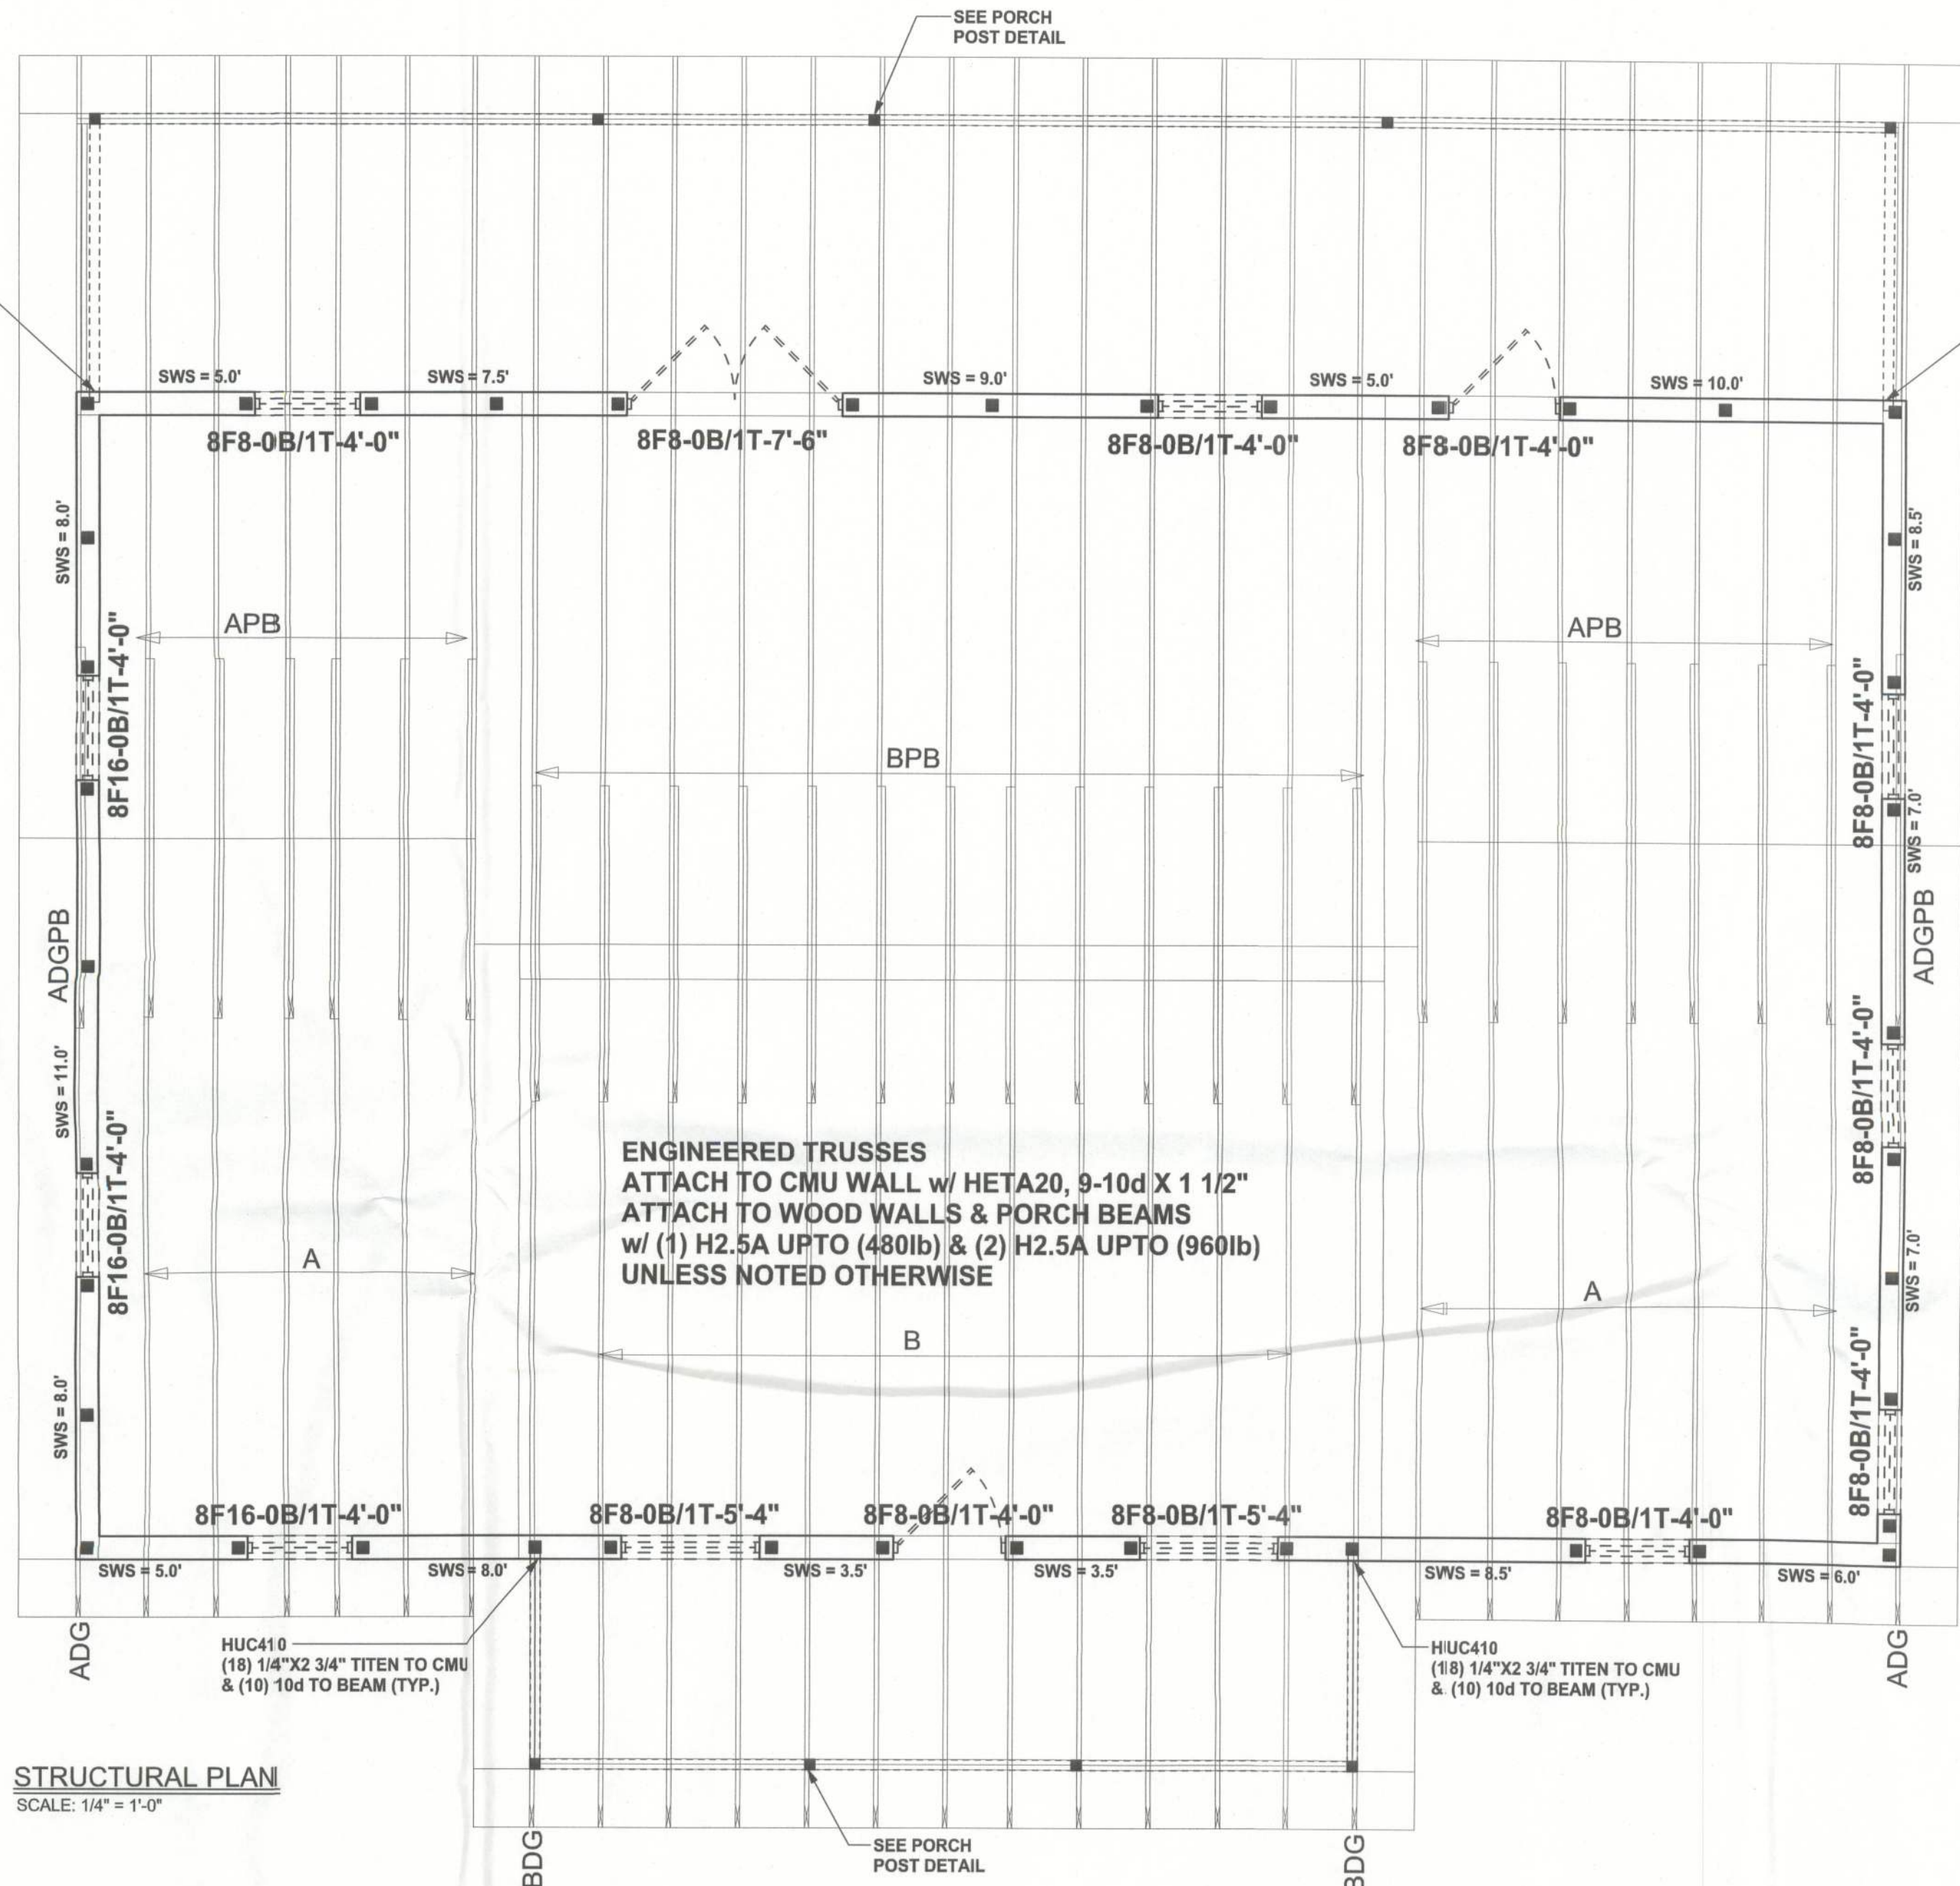


STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X12 SF #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-4 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BC31-03, BC31-B1, BC31-B2, & BC31-B3. BC31-B1, BC31-B2, & BC31-B3 ARE FURNISHED BY THE TRUSS SUPPLIER WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND

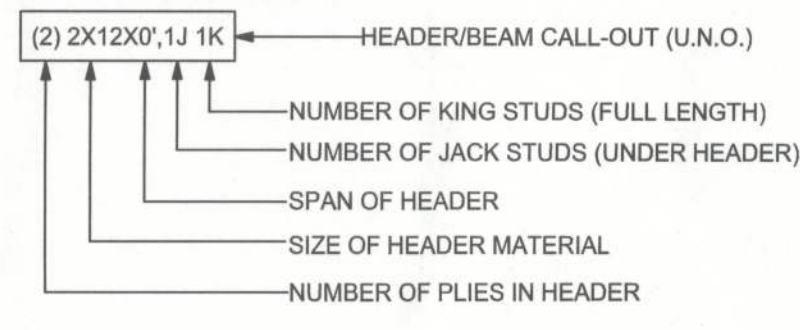

WALL LEGEND

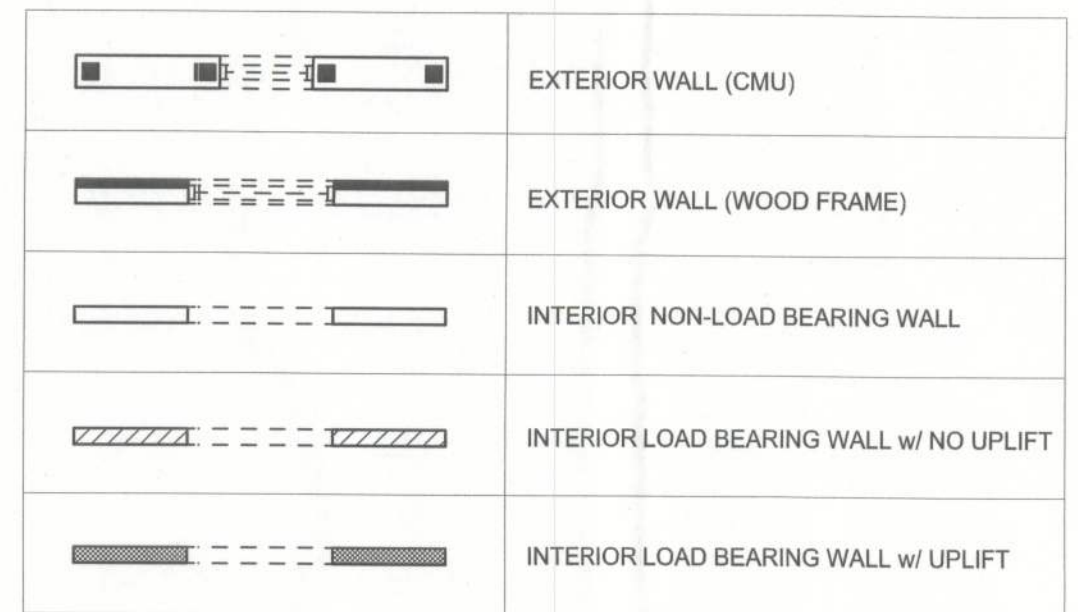

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. ANDERSON TRUSS CO. JOB# 13-208

REVISIONS

NO.	DESCRIPTION	DATE

SOFTWARE
ARCHITECTURAL DESIGN & ENGINEERING

WINDLOAD ENGINEER: Mark Disosway, P.E. No. 53915, PCB 868, Lake City, FL 32056, 386-754-5419
 DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disosway, P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with section F301.2.1, 2010 Florida Building Code Residential to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.
 MARK DISOSWAY
 D. DISOSWAY, P.E.
 LICENSE NO. 53915
 August 06, 2013

Stephen Crawford
 Construction

Jacqueline Thompson
 Residence

ADDRESS:
 303 SW Pecan Glen
 Lake City, Florida 32024
 Mark Disosway P.E.
 P.O. Box 868
 Lake City, Florida 32056
 Phone: (386) 754 - 5419
 Fax: (386) 269 - 4871

PRINTED DATE:
 August 06, 2013


DRAWN BY: STRUCTURAL BY:

FINALS DATE:
 6Aug13


JOB NUMBER:
 1307049

DRAWING NUMBER

S-3
 OF 3 SHEETS

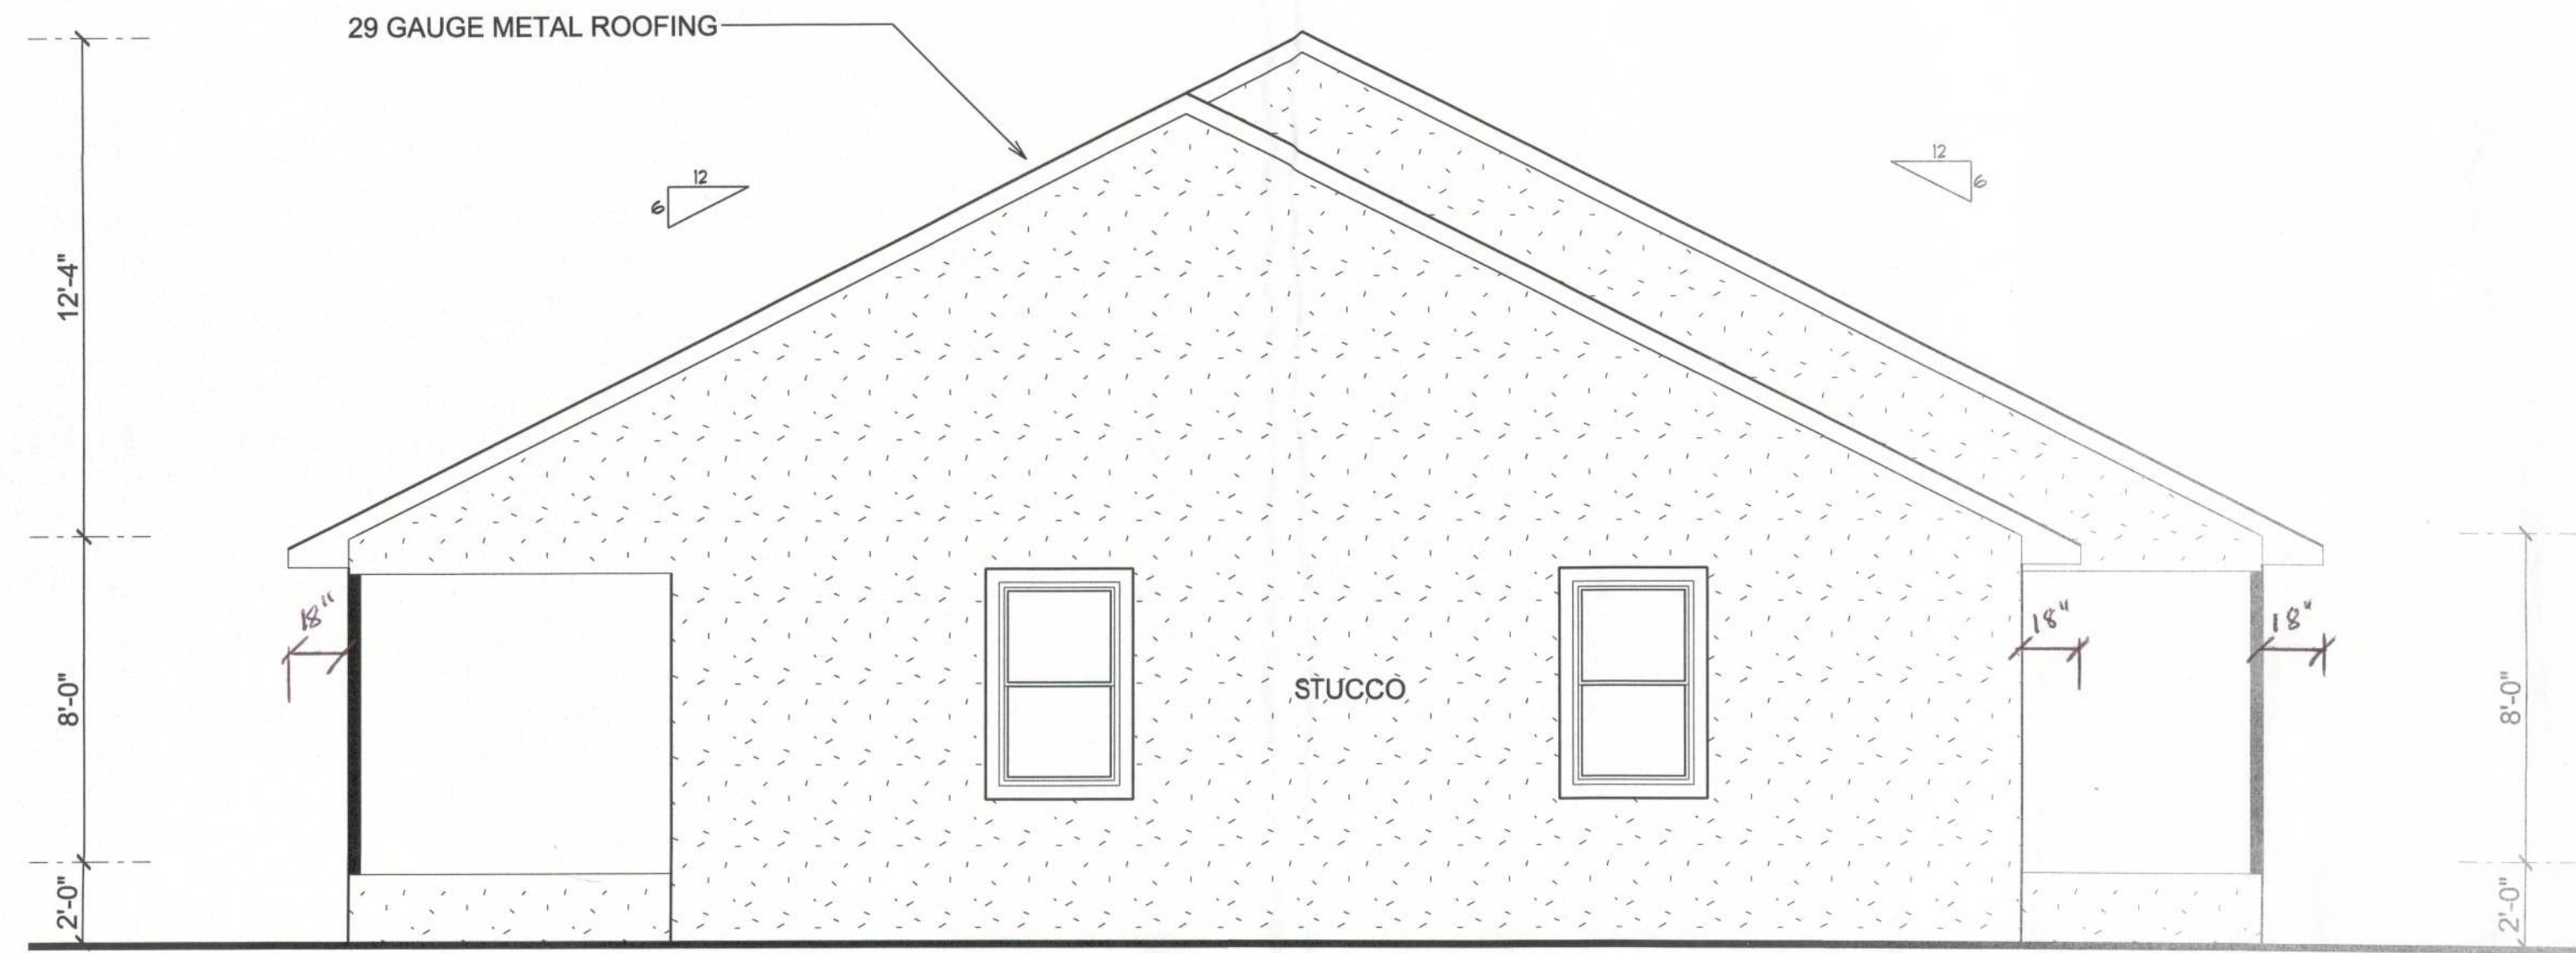


LEFT ELEVATION
SCALE: 1/4" = 1'-0"

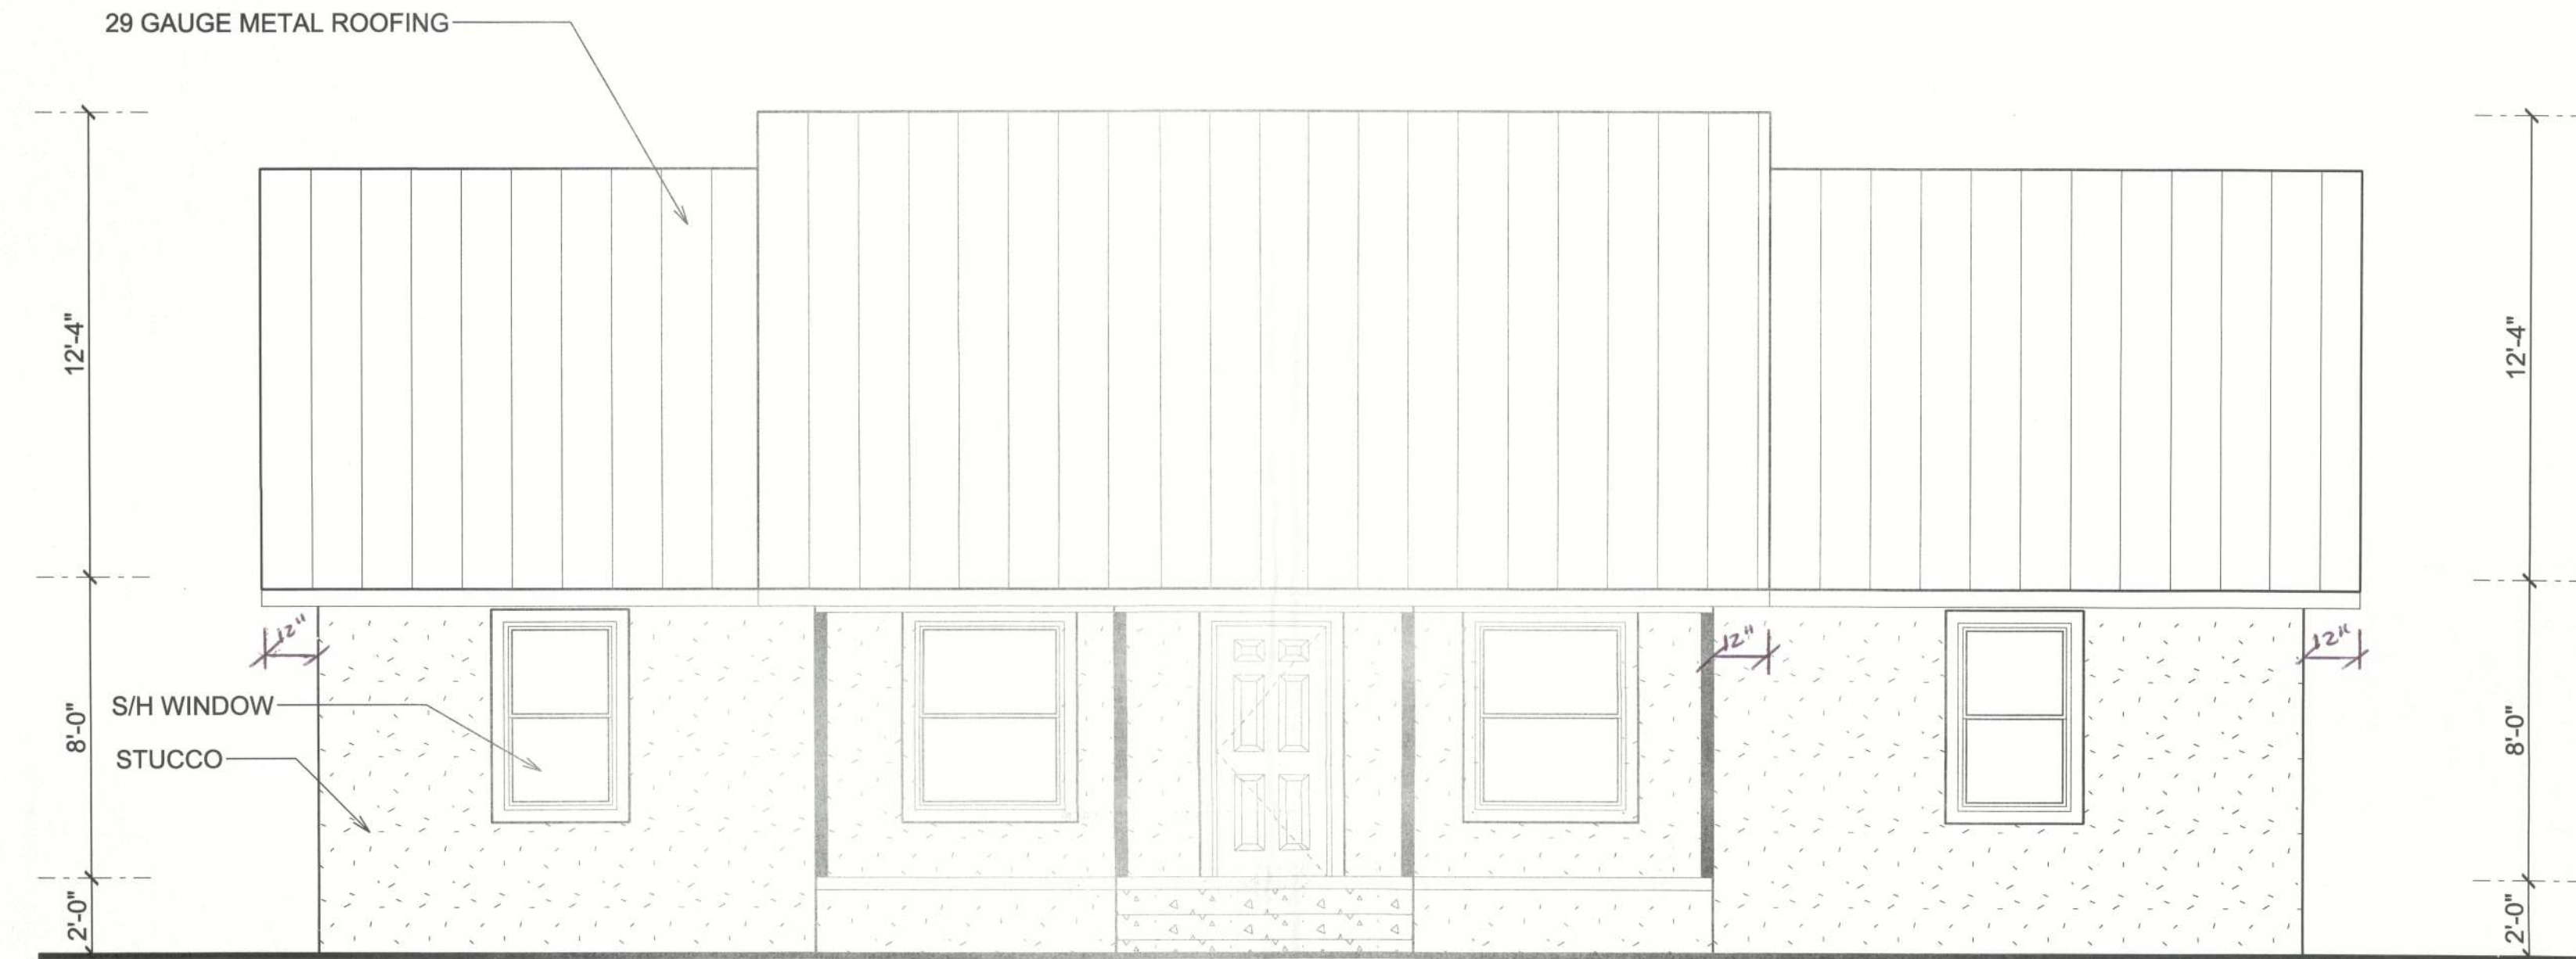

FRONT ELEVATION
SCALE: 1/4" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"

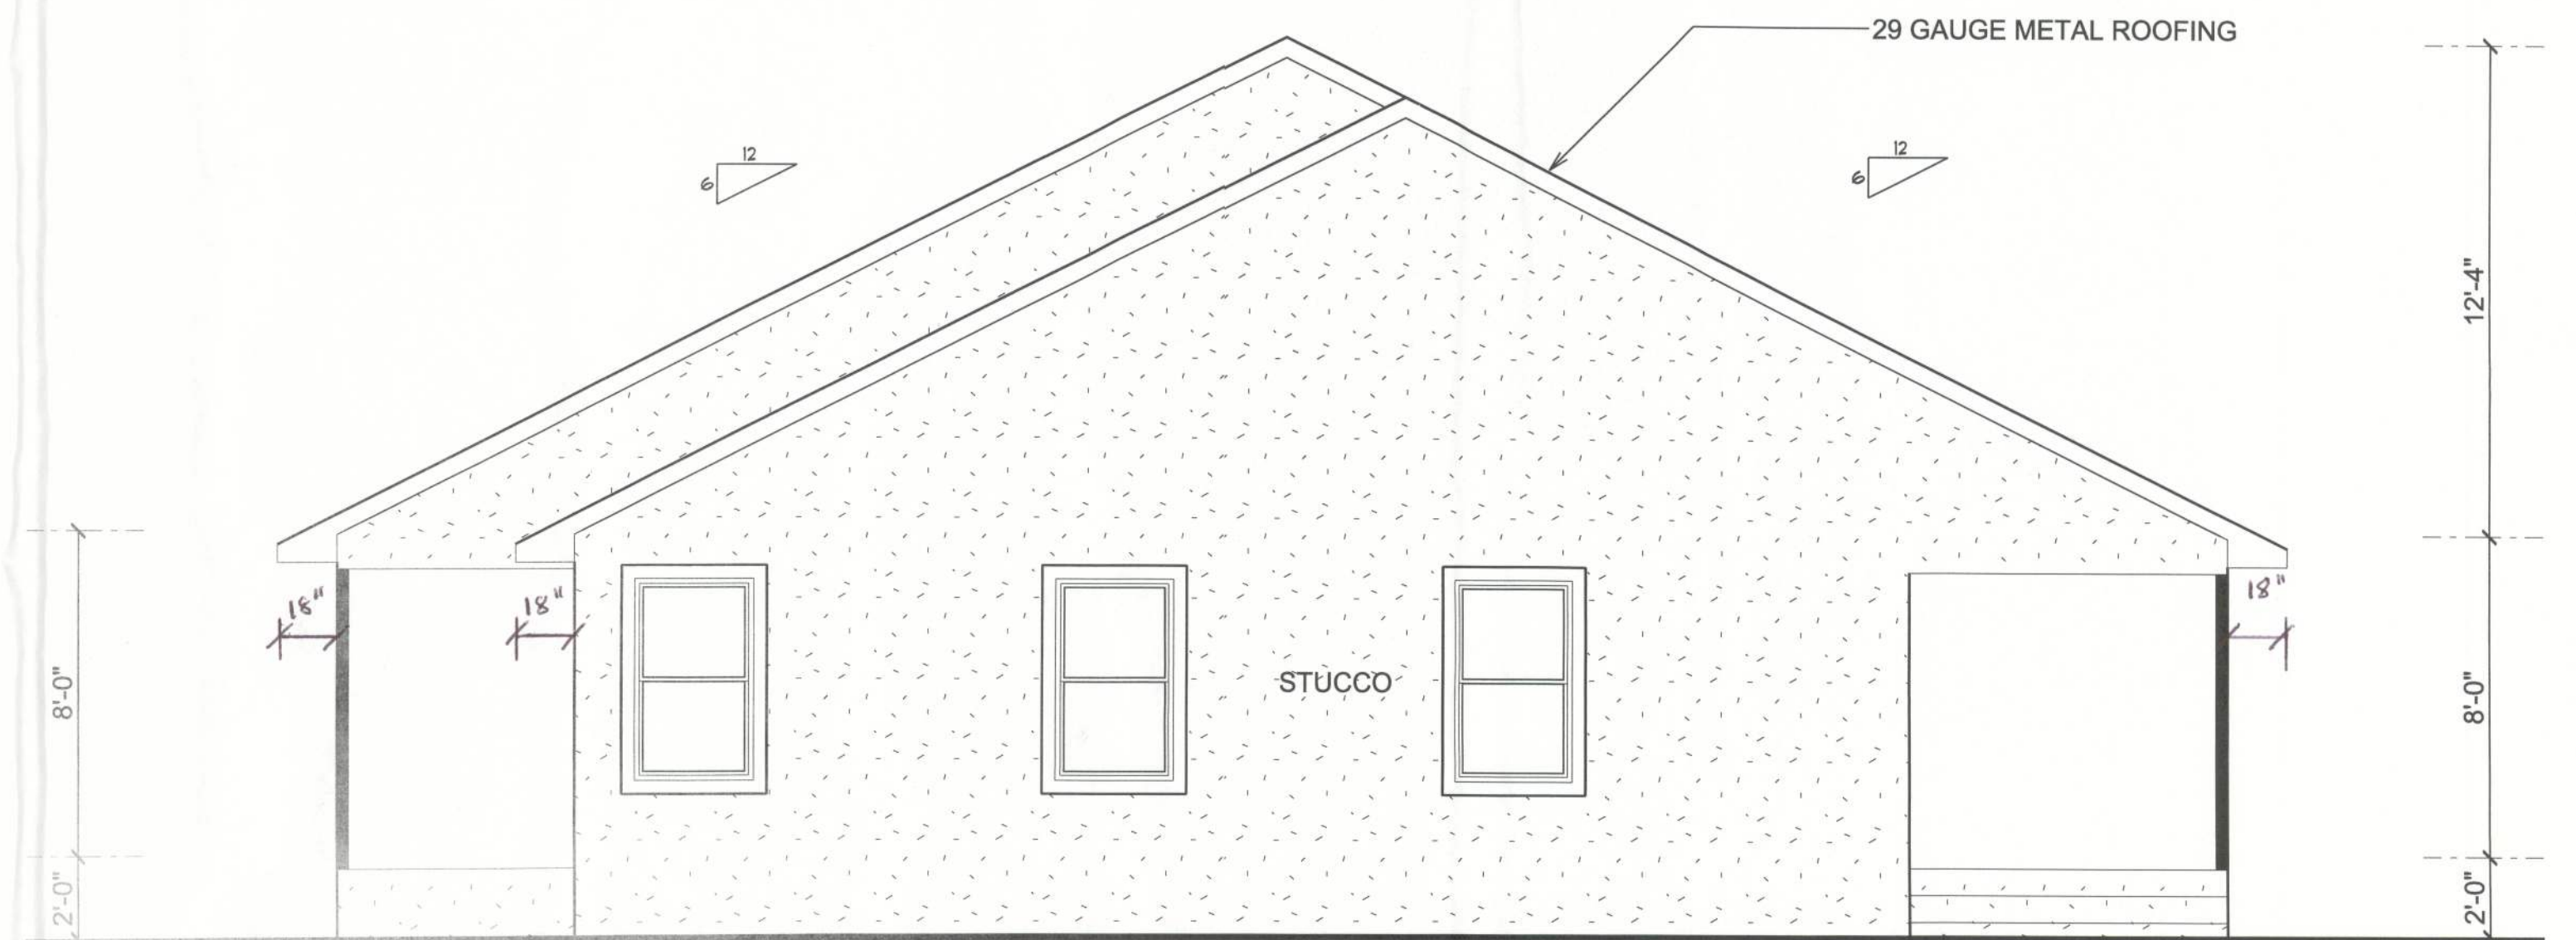

RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

SHEET

#1

OF 5

Exterior Elevations

Design Services By: Stephen Crawford

Jacqueline Thompson Residence

Living Area: 1785 Square Feet

Garage Area: 0.00 Square Feet

Porch Area: 568 Square Feet

Total Area: 2353 Square Feet

Customer:

Lot :

Scale: 1/4" = 1'-0"

Date: 02/16/2013








Notes:



Stephen Crawford Construction, Inc.

11736 S US Hwy 441 Lake City, FL 32025

Phone: (386) 755-5068 Fax: (386) 755-9500



e-mail: scrc@scrcconstruction.com

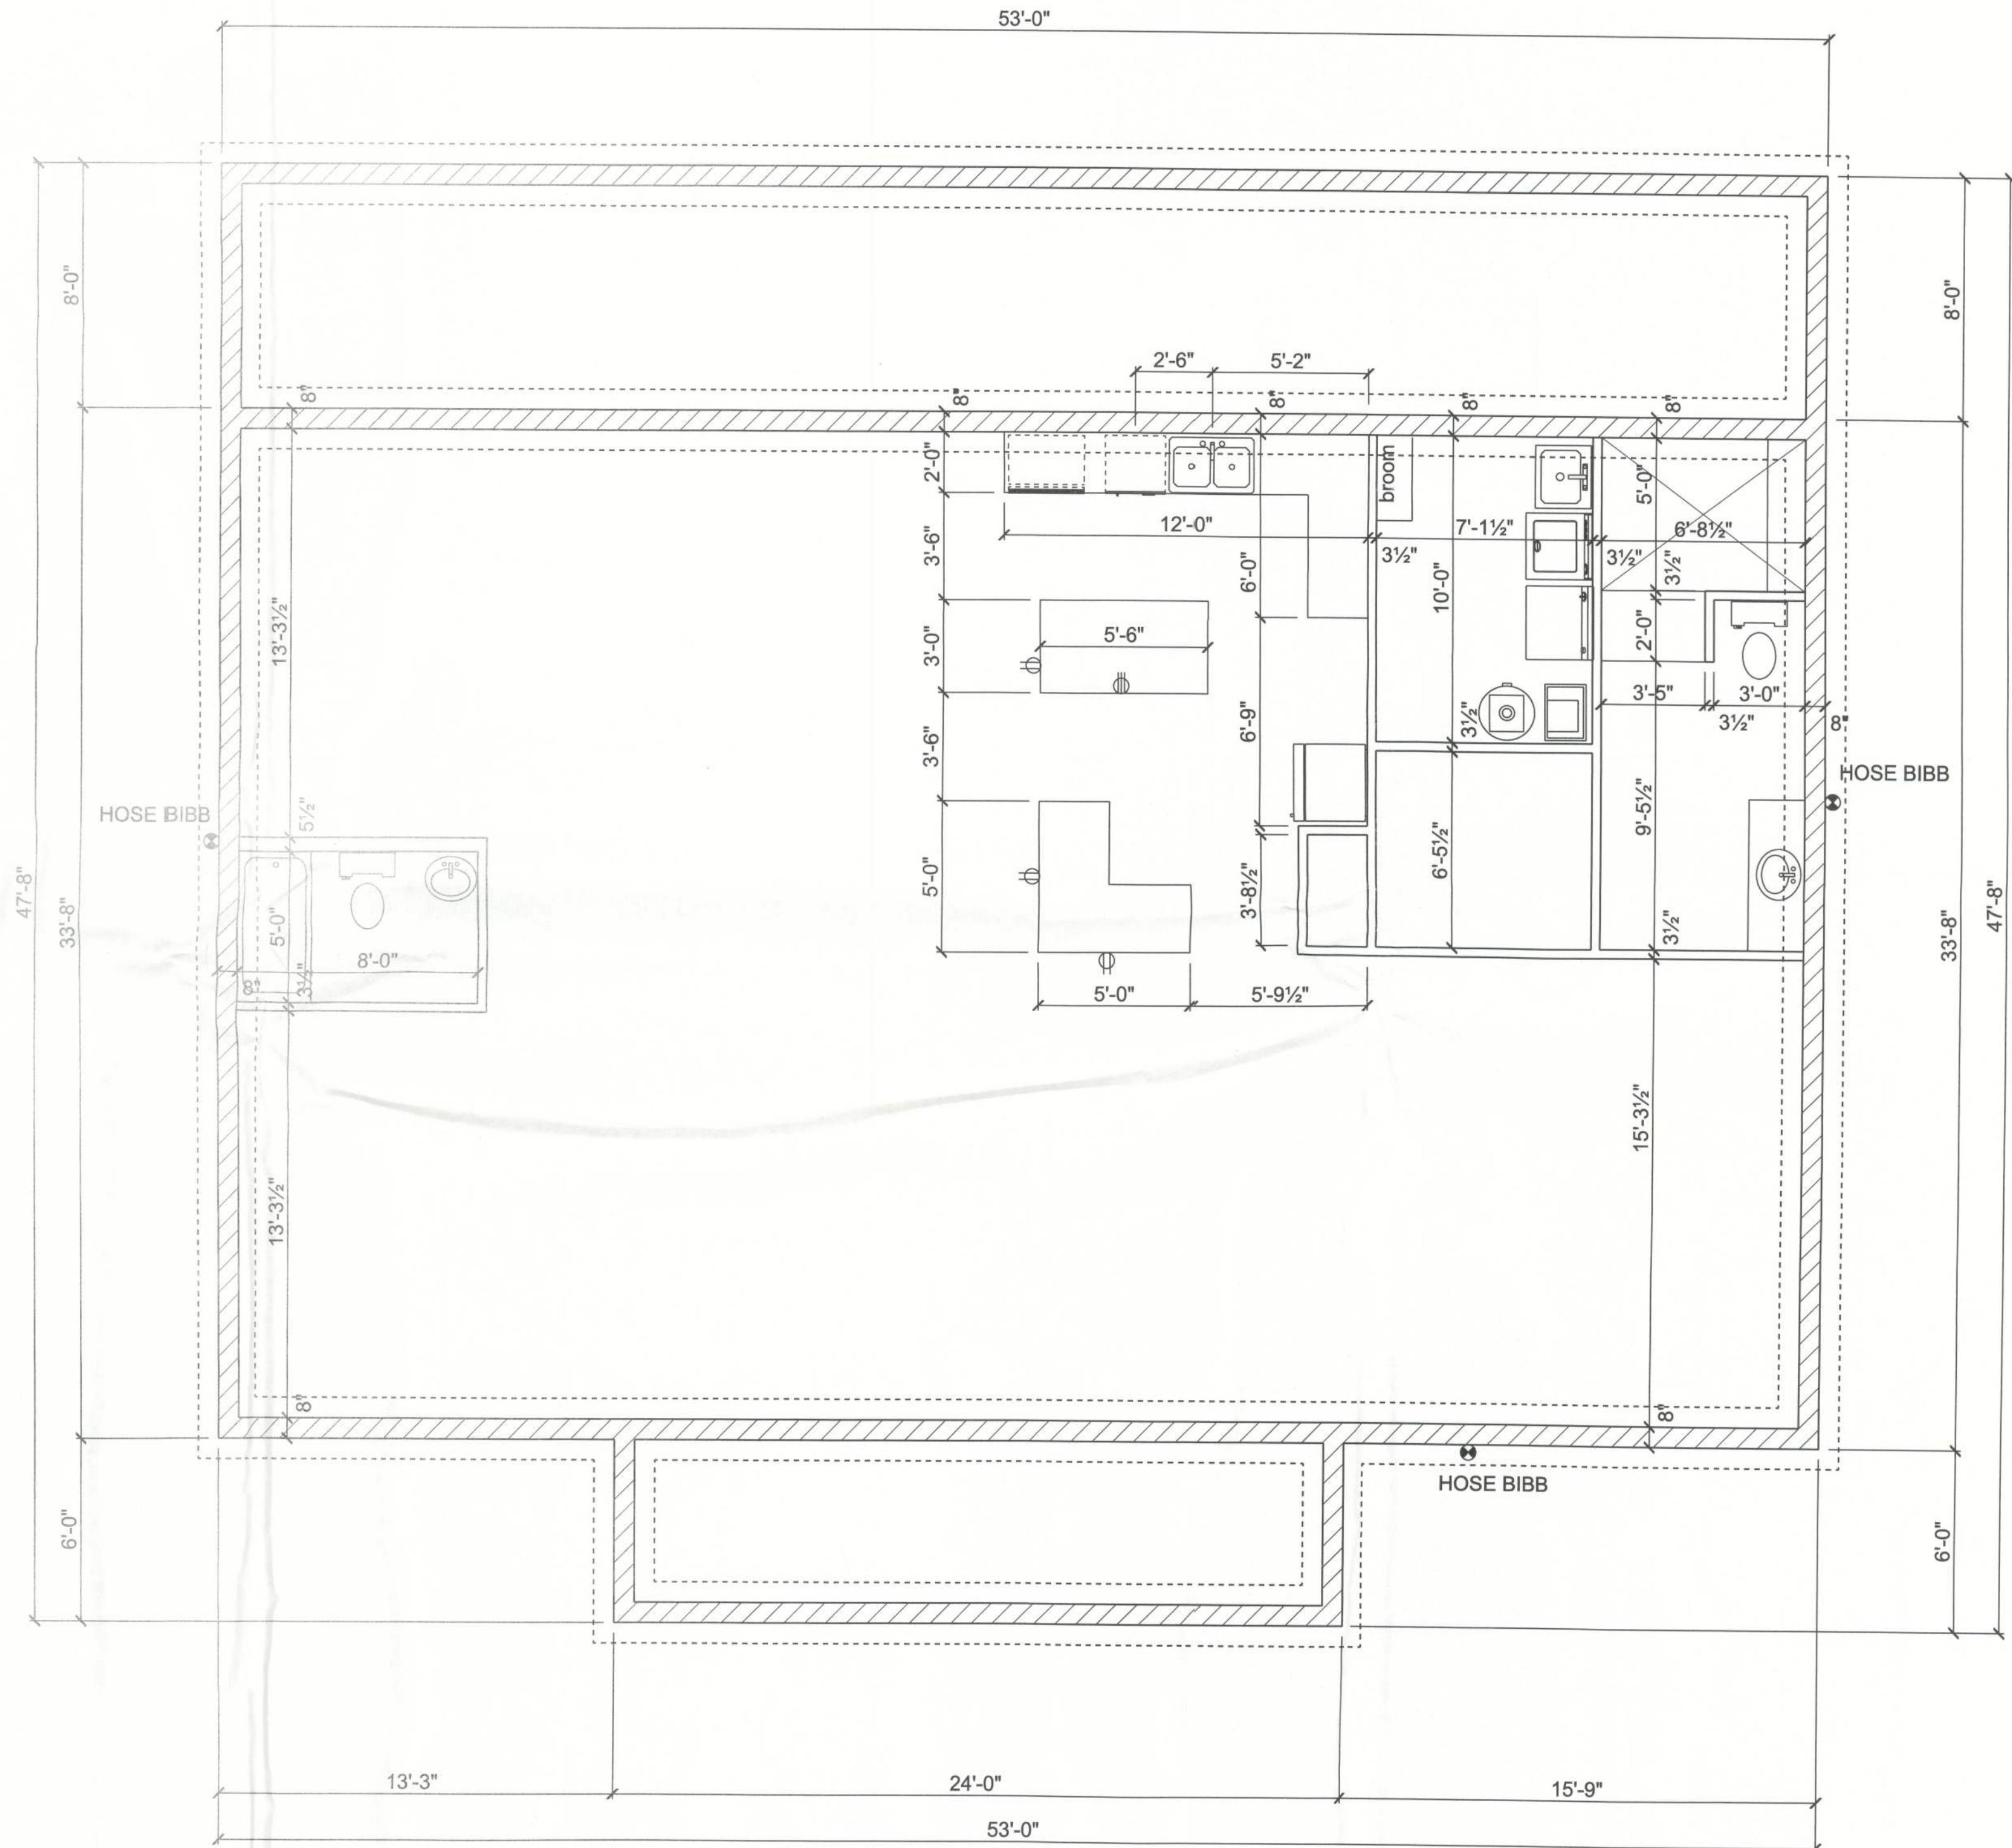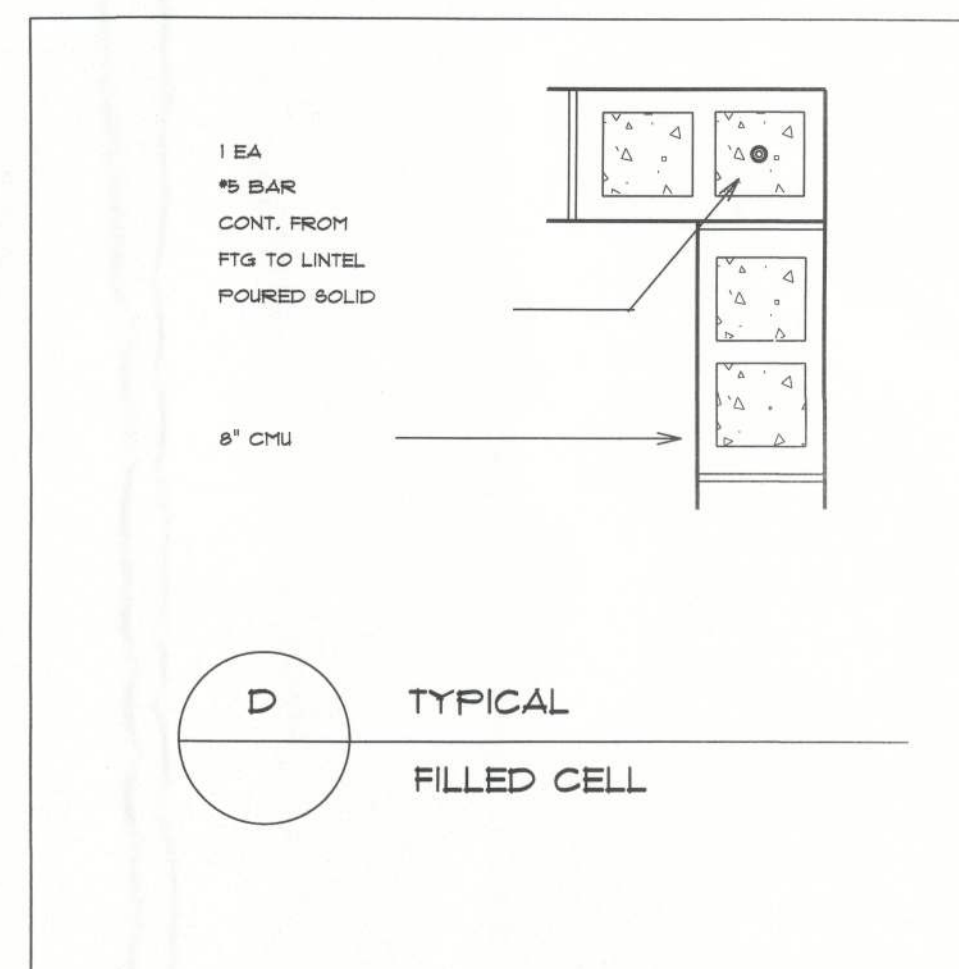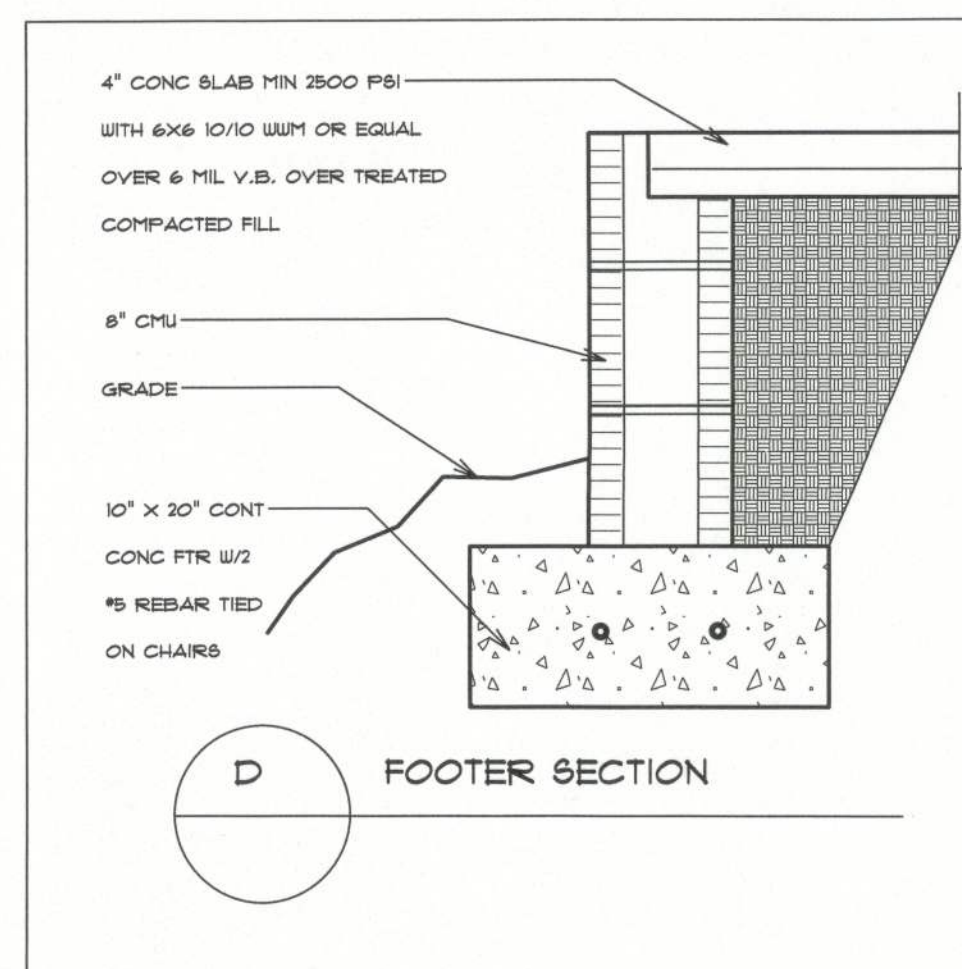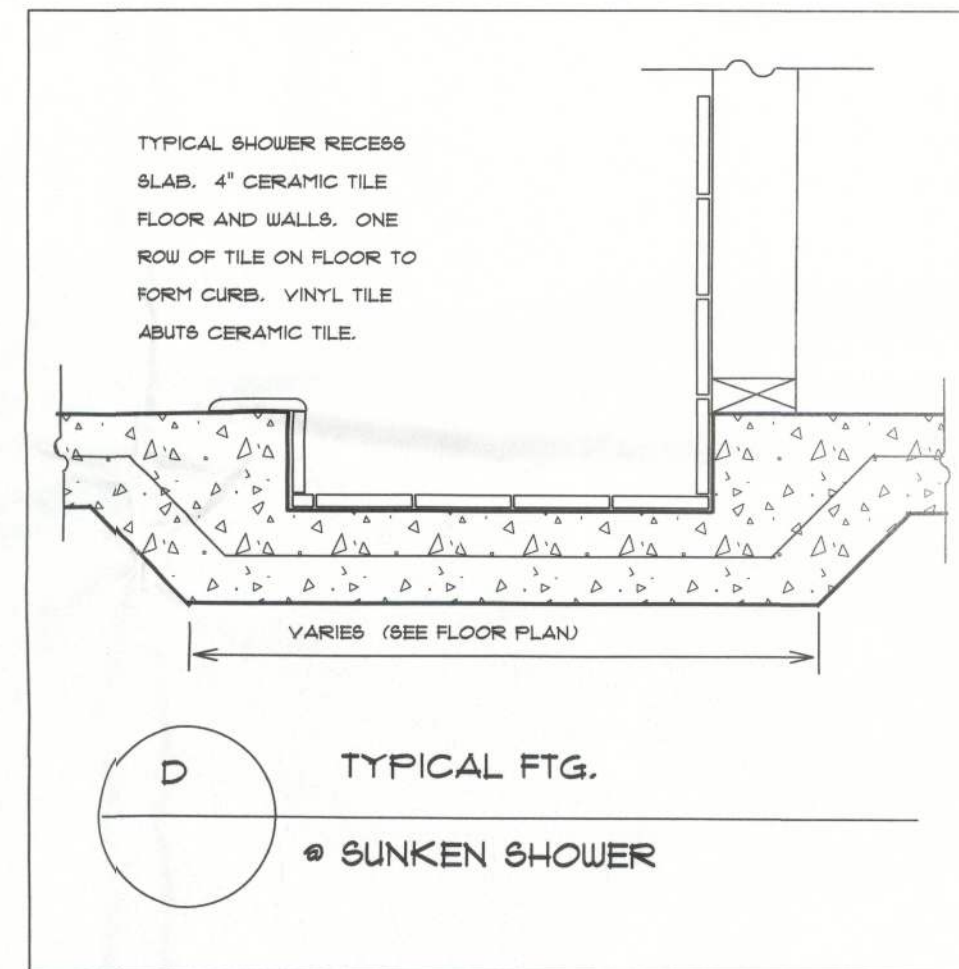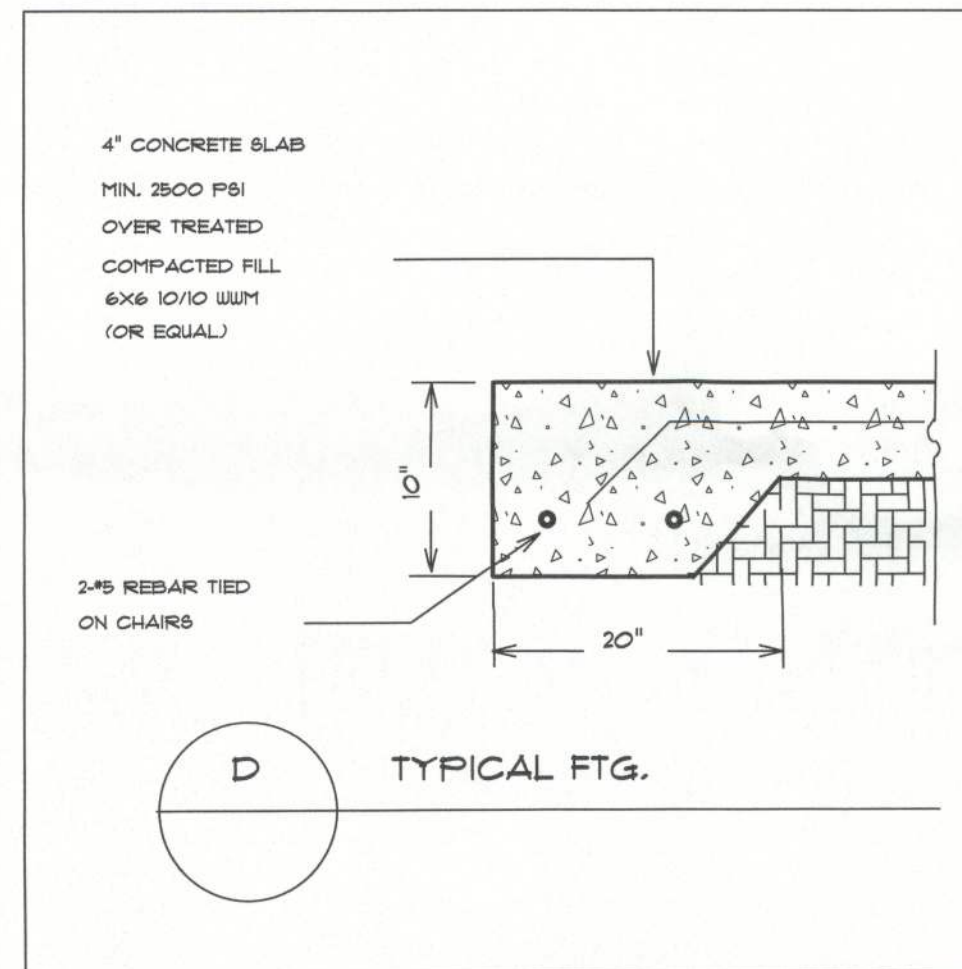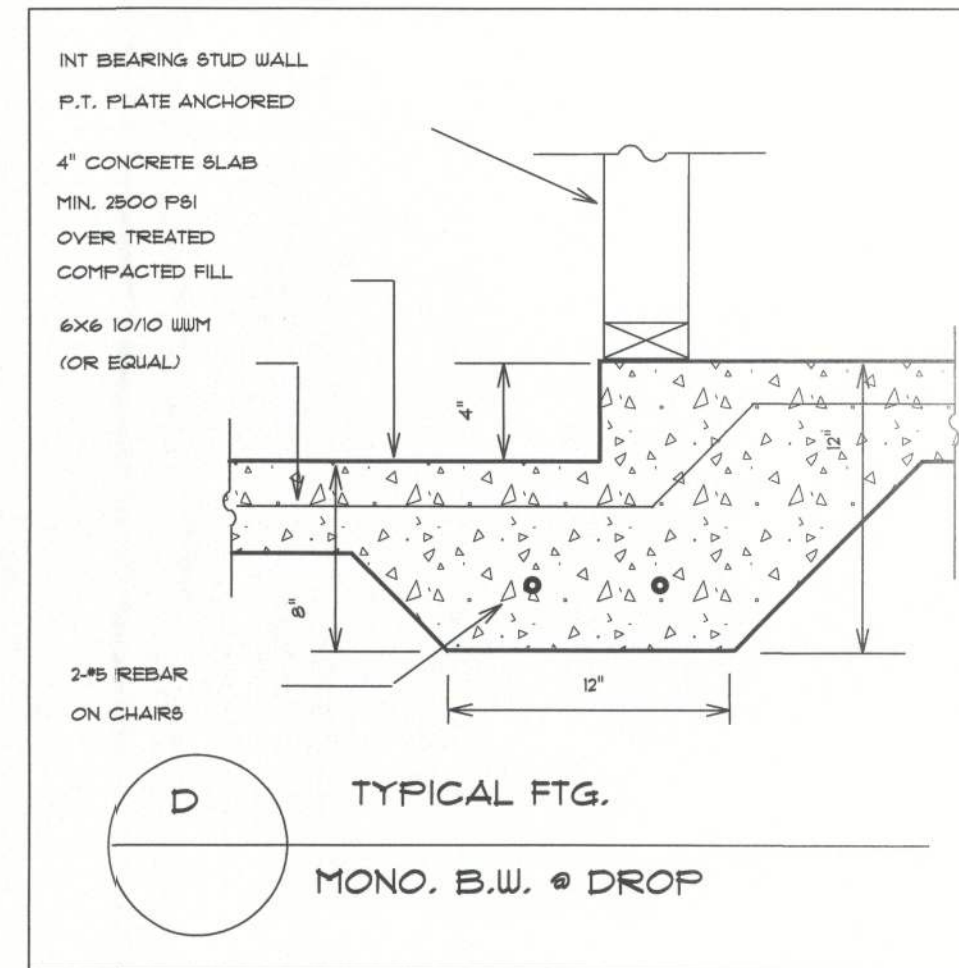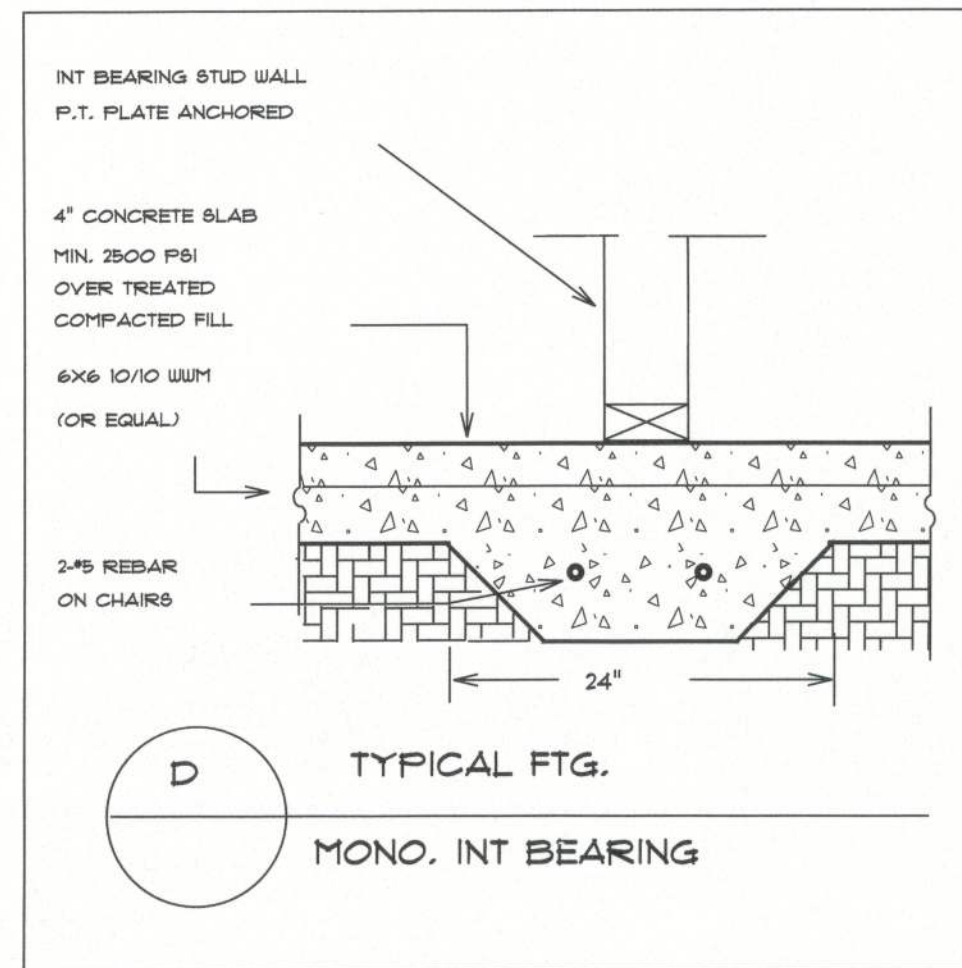

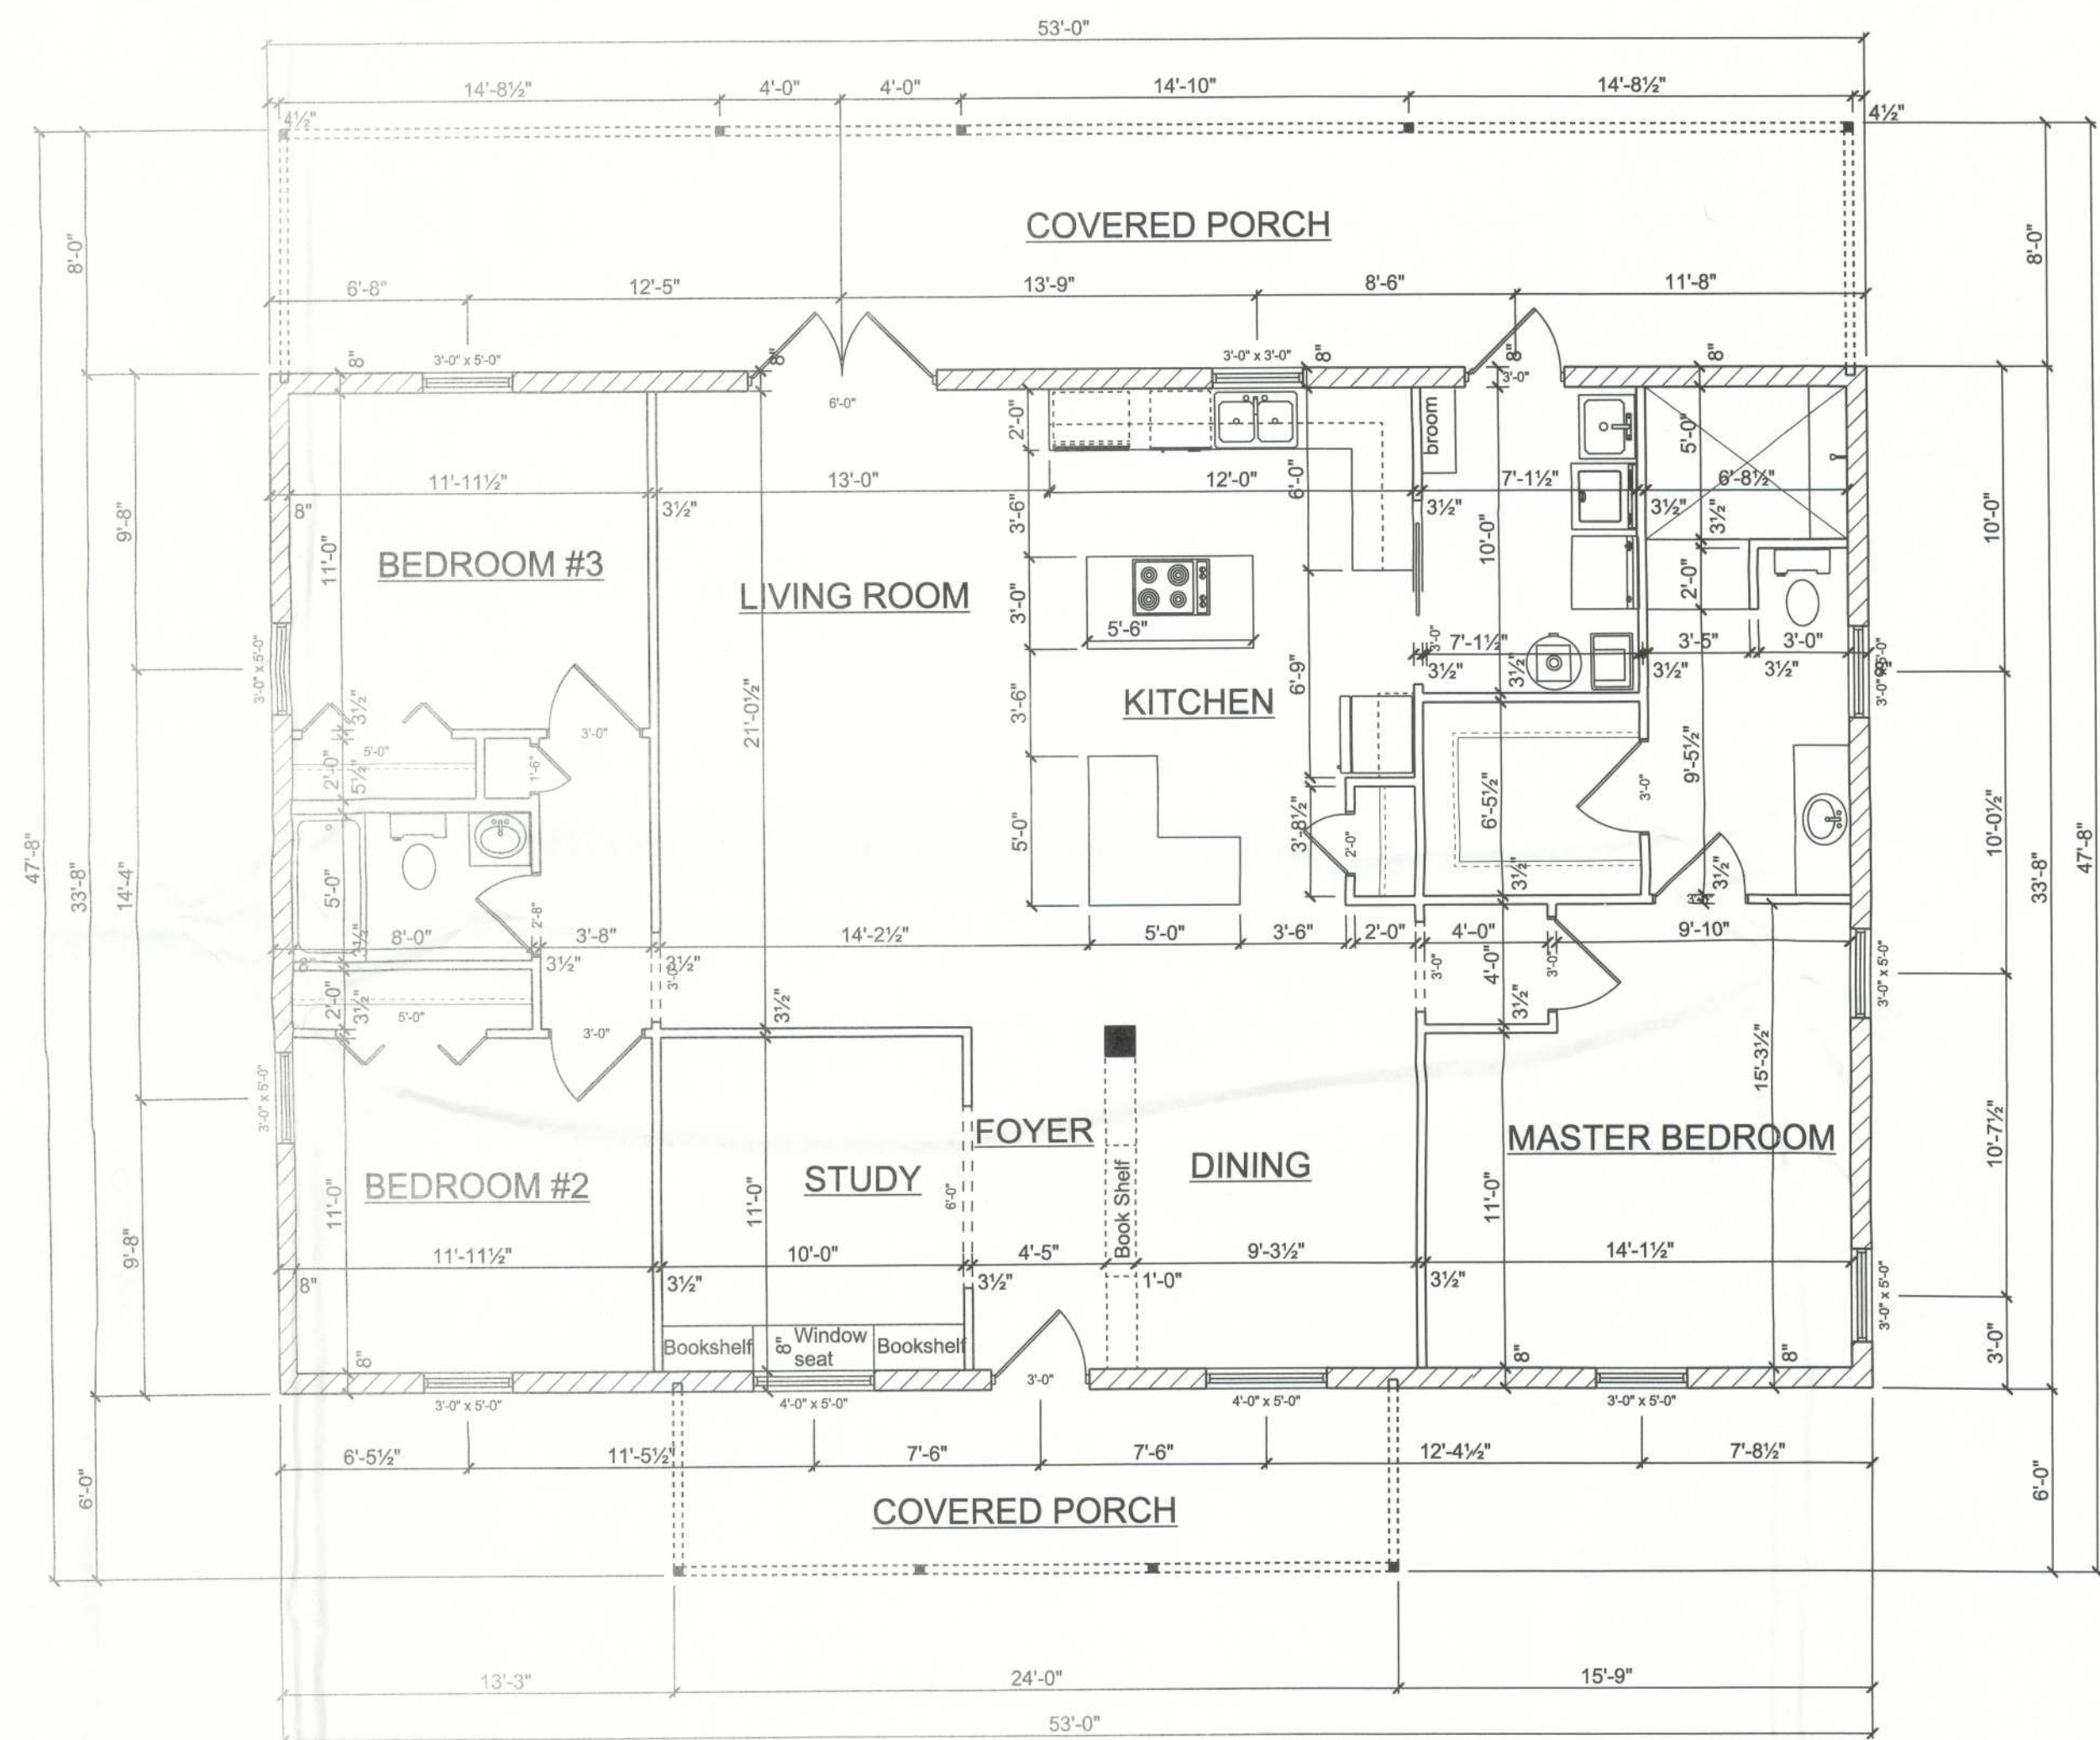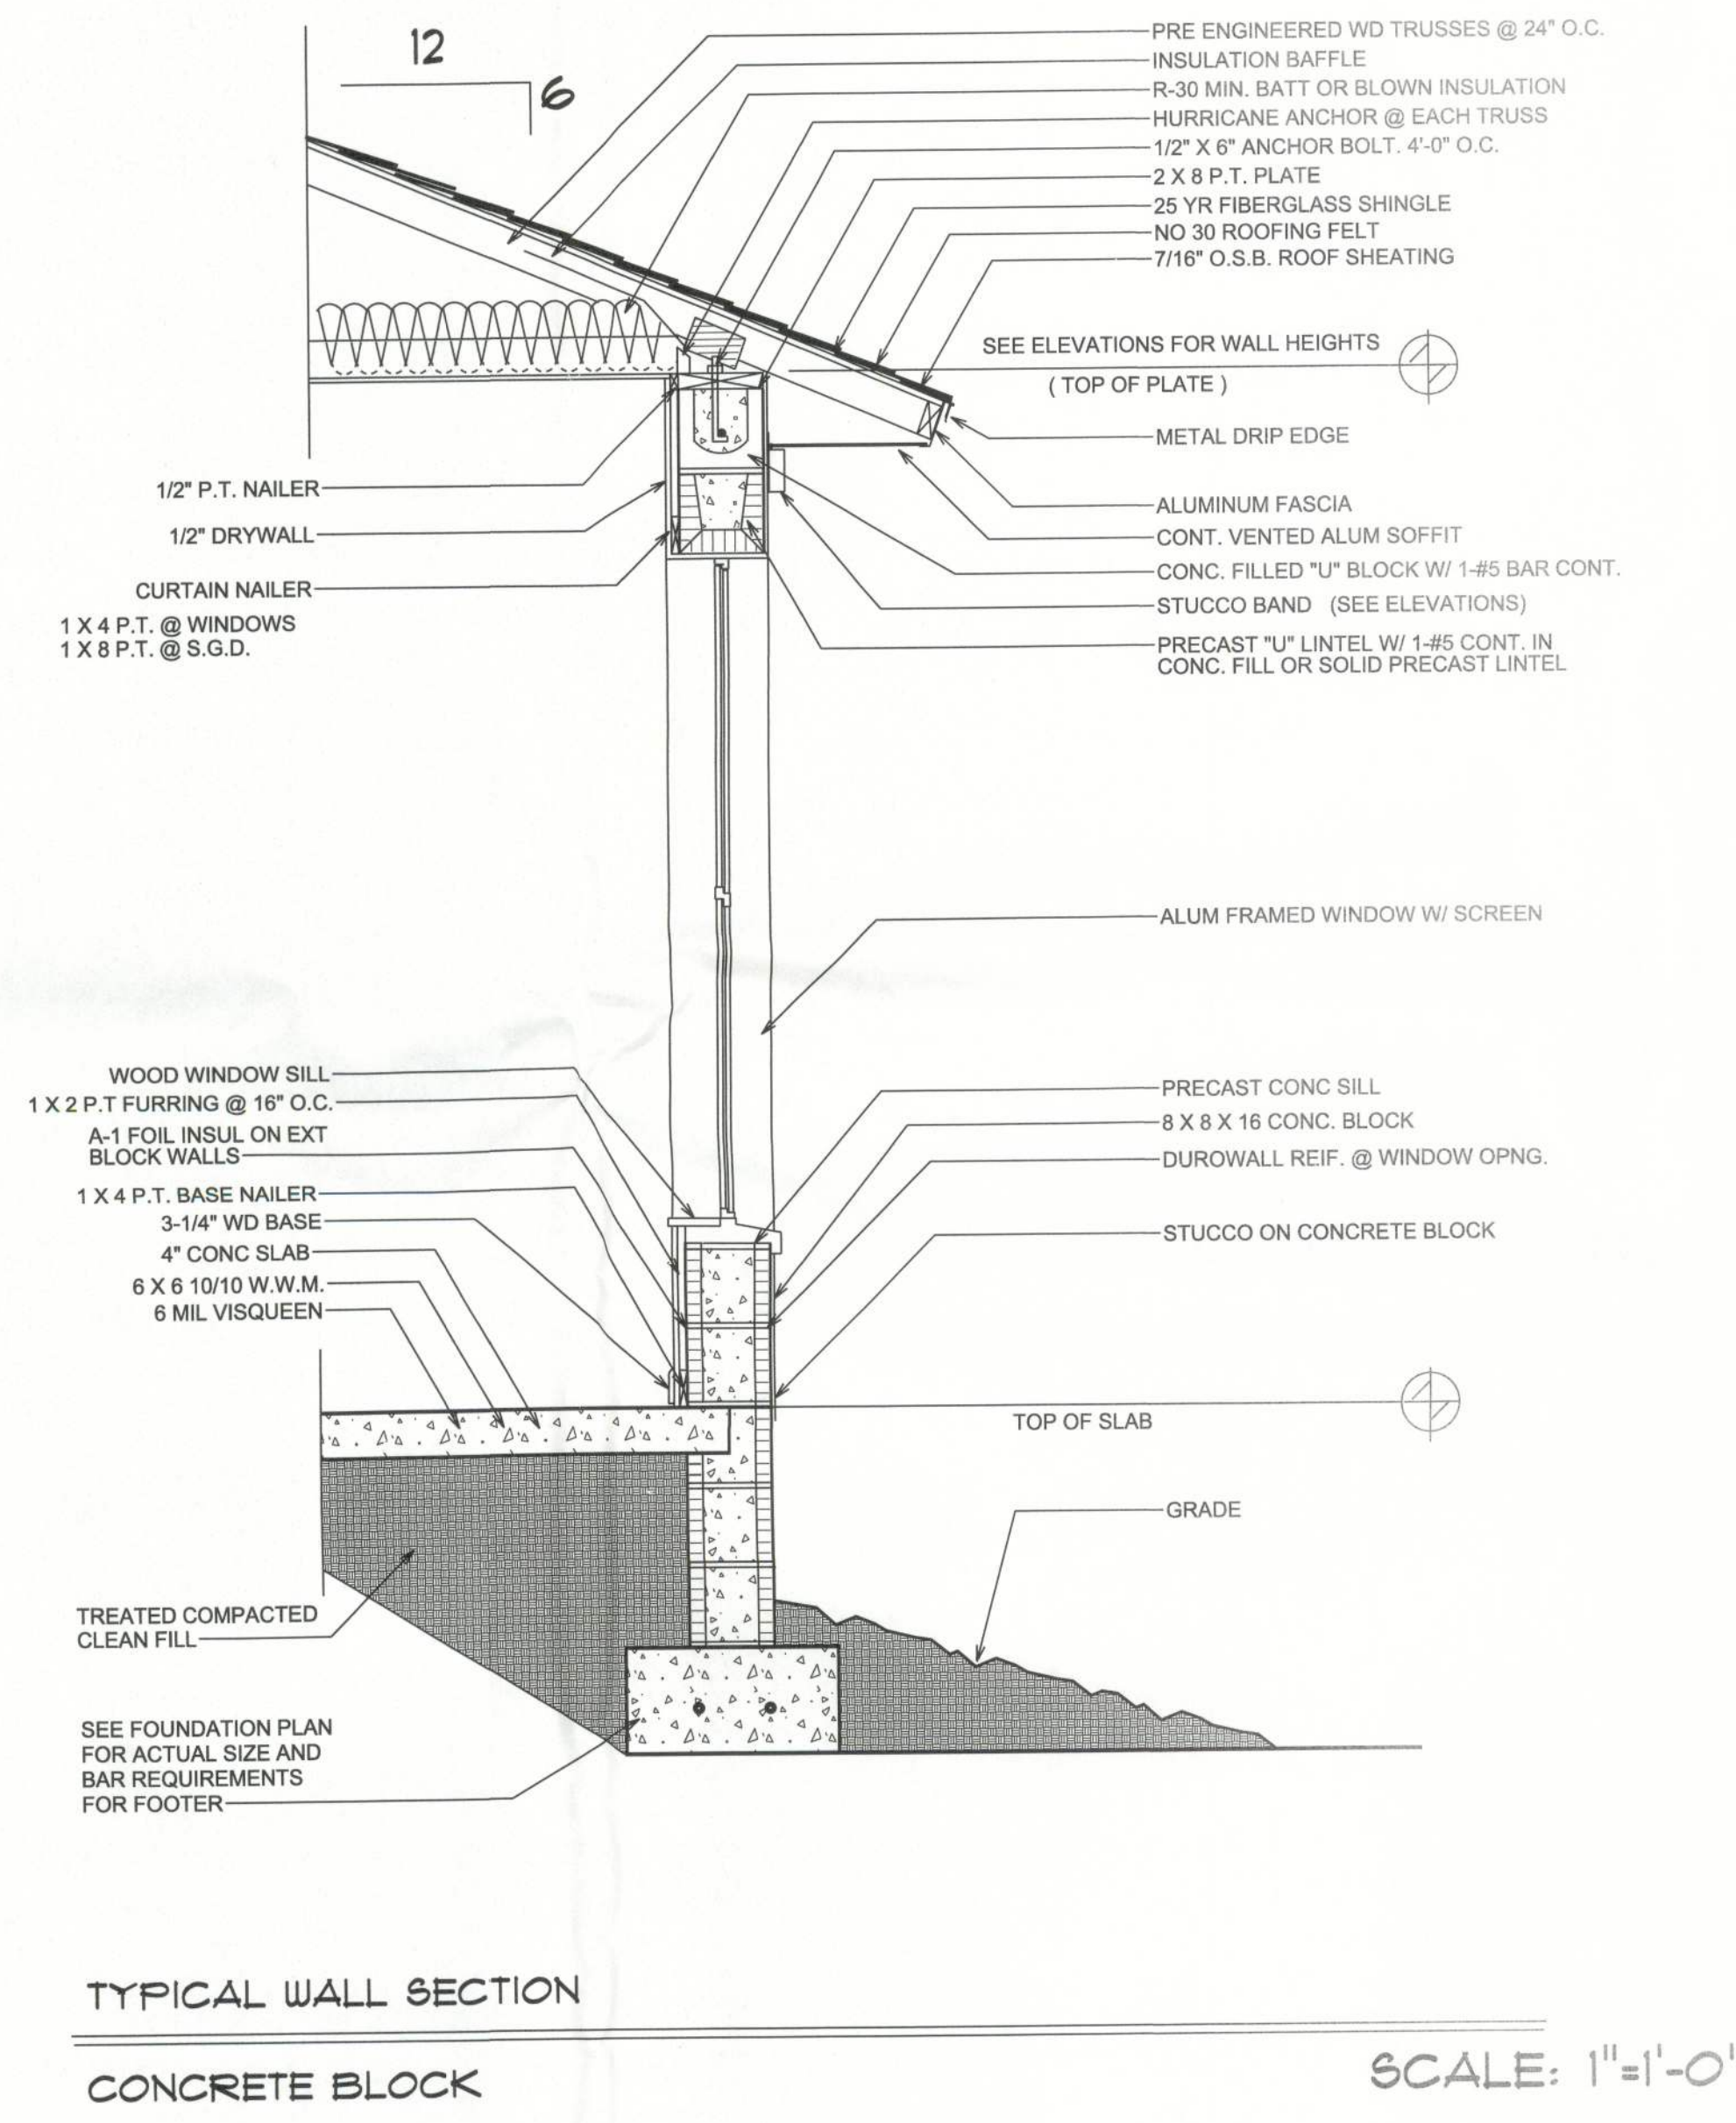

ELECTRICAL PLAN NOTES

- E-1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUFACTOR SPECIFICATIONS.
- E-2 CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.
- E-3 ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
- E-4 ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
- E-5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.
- E-6 ELECTRICAL CONTR SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- E-7 ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
- E-8 ALL BEDROOM RECEPTACLES SHALL BE AFCI. (ARC FAULT CIRCUIT INTERRUPT)
- E-9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION.
- E-10 A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING. SERVICE ENTRANCE CONDUCTORS MAY NOT BE LOCATED INSIDE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL.
- E-11 THE POWER COMPANY IS CLAY ELECTRIC.

ELECTRICAL	COUNT	SYMBOL
ceiling fan light	2	
ceiling fan spotlights 2	5	
can light 6inch	2	
candle light chandelier	2	
fluorescent light 1 x 4	1	
pot light	1	
double spotlight	1	
cable tv outlet	4	
light	10	
outlet	32	
outlet 220v	5	
outlet gfi	6	
outlet wp	4	
smoke detector	6	
switch	24	
switch 3 way	6	
telephone	5	
vanity bar light	1	
wall mount 3	1	

