






REVISIONS
Sep. 29th, 2025

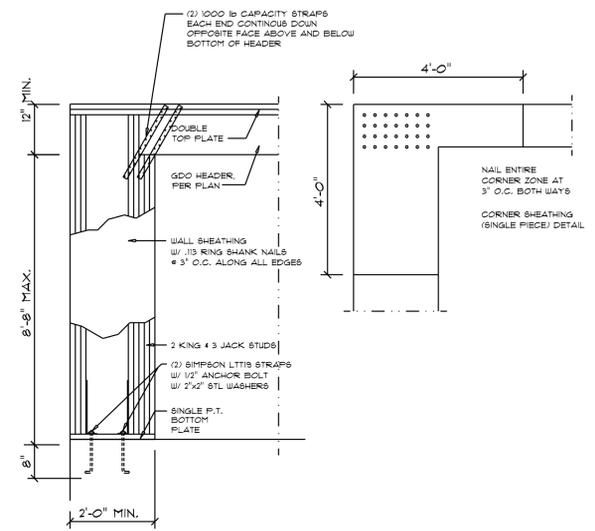


Garage End Wall DETAILS
SCALE: 1/2" = 1'-0" **G**

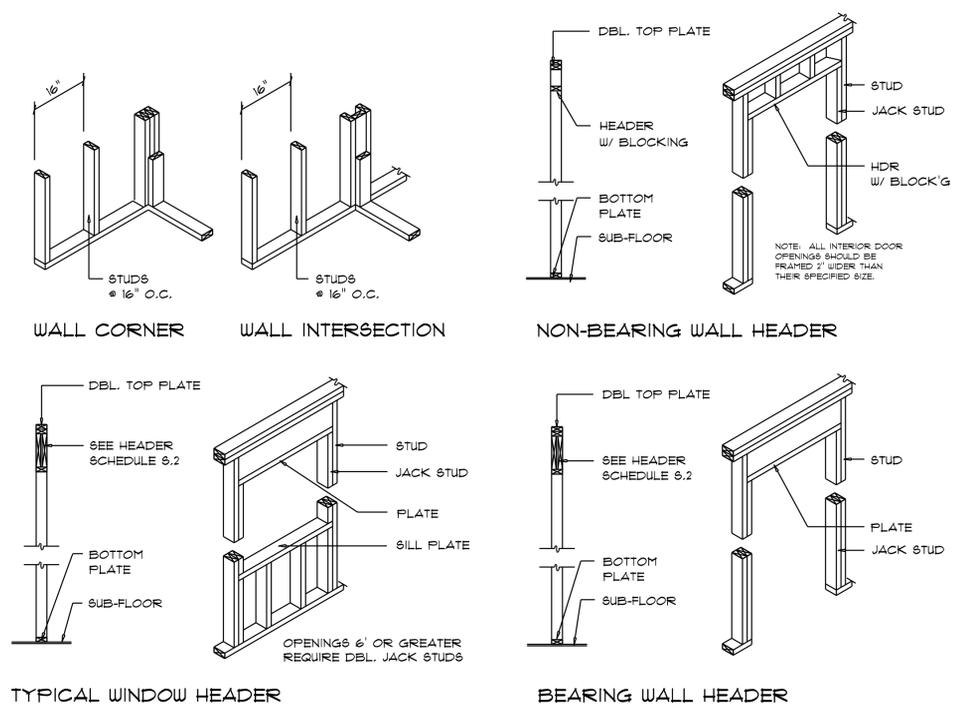


Wall Framing/Header DETAILS
SCALE: NONE **F**

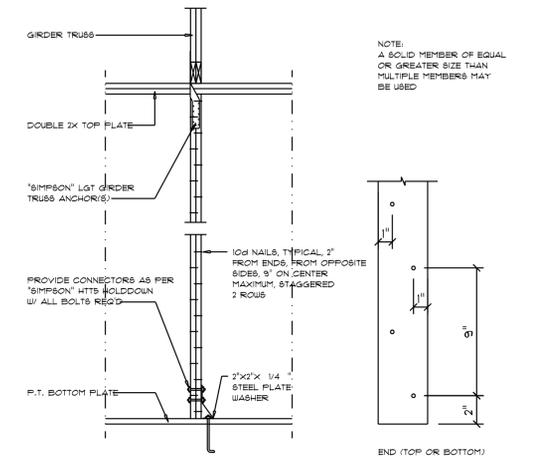

Girder Truss Column DET.
SCALE: 1/2" = 1'-0" **C**

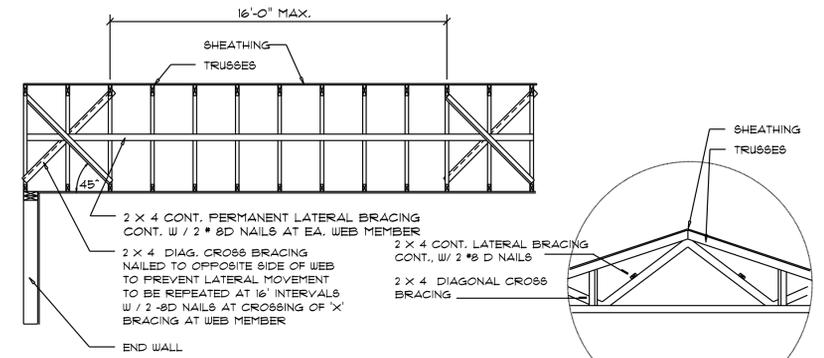


TYP. PERMANENT TRUSS BRACING DIA.
NTS
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE
SCALE: AS NOTED **D**

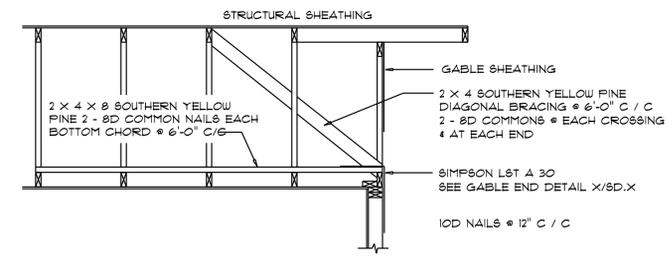


END WALL BRACING FOR CEILING DIAPHRAGM
NTS
(ALTERNATIVE TO BALLOON FRAMING.)
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE **A**

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1		6 in. o.c. EDGE 6 in. o.c. FIELD	
2	1/8" O.S.B. OR 15/32 CDX	2 1/2"x0.131" RING SHANK NAILS OR 3"x0.120" RING SHANK NAILS	6 in. o.c. EDGE 6 in. o.c. FIELD
3		4 in. o.c. GABLE ENDWALL OR GABLE TRUSS 6 in. o.c. EDGE 6 in. o.c. FIELD	

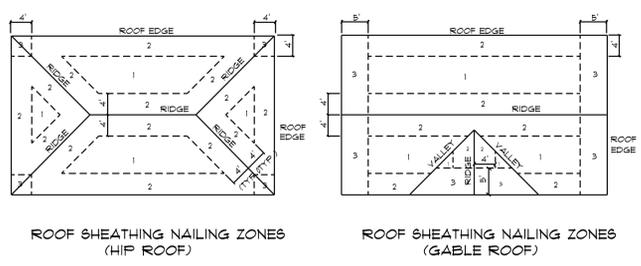

Roof Nail Pattern DET.
SCALE: NONE **B**

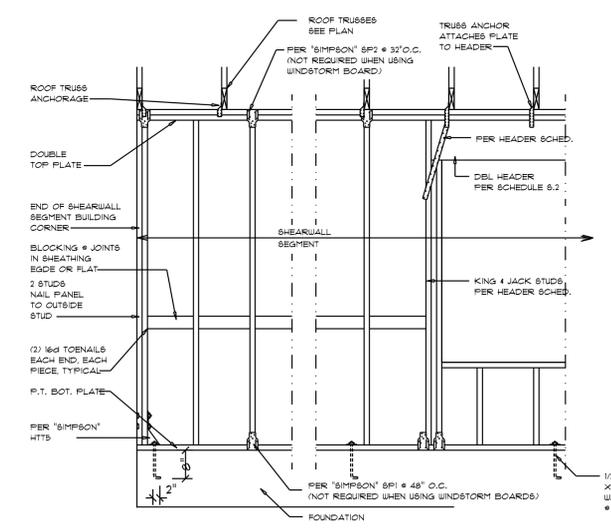

Shear Wall DETAILS
SCALE: NONE **E**

- SHEARWALL NOTES:**
- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS
 - THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" WINDSTORM ED INCLUDING AREAS ABOVE AND BELOW OPENINGS
 - ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
 - NAIL SPACING SHALL BE 4" O.C. EDGES AND 8" O.C. IN THE FIELD.
 - TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHTS.5 FOR 8'-0" WALLS (7'-3").

OPENING WIDTH	BILL PLATES	1/4" TOE NAILS EACH END
UP TO 4'-0"	(1) 2x4 OR (1) 2x6	1
4' TO 8'-0"	(3) 2x4 OR (1) 2x6	2
8' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

CUSTOM HOME FOR
REYES RESIDENCE
COLUMBIA COUNTY, FL

NICHOLAS PAUL GEISLER ARCHITECT
N.C.A.R.B. Certified
1158 NW Eglow Rd.
Lake City, FL 32055
(386) 155-5021

SHEET NUMBER
S.4
OF 4 SHEETS

AR0007005

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES OF THIS DOCUMENT.