



Product Approval
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > [Application Detail](#)

OFFICE OF THE
SECRETARY

FL # FL27402-R2
Application Type Revision
Code Version 2020
Application Status Approved

Comments
Archived

Product Manufacturer Carports Anywhere
Address/Phone/Email 10858 S.E. County Road 221
Starke, FL
(352) 468-1116
bodom@carportsanywhere.com

Authorized Signature Brandie Odom
bodom@carportsanywhere.com

Technical Representative
Address/Phone/Email

Quality Assurance Representative
Address/Phone/Email

Category Structural Components
Subcategory Roof Deck

Compliance Method Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer
Evaluation Report - Hardcopy Received

Florida Engineer or Architect Name who developed the Evaluation Report Johnathan Green
Florida License PE-88223
Quality Assurance Entity PRI Construction Materials Technologies, LLC
Quality Assurance Contract Expiration Date 06/23/2023
Validated By Brian Jaks, P.E.
Validation Checklist - Hardcopy Received

Certificate of Independence [FL27402 R2 COI Letter of Certification-Carports Anywhere sealed.pdf](#)

Referenced Standard and Year (of Standard)	Standard	Year
	ASTM E 1592	2005
	FM 4471	1992

Equivalence of Product Standards
Certified By

Sections from the Code

Product Approval Method Method 1 Option D



Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

**Product Evaluation Report
CARPORTS ANYWHERE**

Hampton Rib Roof Panel over open framing

Florida Product Approval # 27402.1 R2

Florida Building Code 2020

Per Rule 61G20-3

Method: 1 -D

Category: Structural Components

Subcategory: Roof Deck

Compliance Method: 61G20-3.005(1)(d)

NON HVHZ

Product Manufacturer:

Carport Anywhere
10858 S.E. County Road 221
Starke, Florida 32091

Engineer Evaluator:


Johnathan Green, P.E. # 88223
Florida Evaluation ANE ID: 12901

Validator:

Brian Jaks, P.E. #70159

Contents:

Evaluation Report Pages 1-4

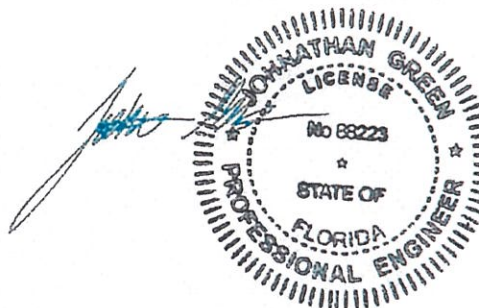

THIS ITEM HAS BEEN
DIGITALLY SIGNED AND
SEALED BY JOHNATHAN
GREEN ON THE DATE
ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED AND
SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.

FL# 27402.1 R2

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

Table "B" 29 Ga. Hampton Rib Roof Panel

Maximum Design Pressure:	-57.3 psf	-150.9 psf	+39.0 psf	+143.1 psf
Fastener Pattern:	6"-3"-6"-3"-6"-3"-6"	6"-3"-6"-3"-6"-3"-6"	6"-3"-6"-3"-6"-3"-6"	6"-3"-6"-3"-6"-3"-6"
Fastener Spacing:	4'-0" O.C.	2'-0" O.C.	4'-0" O.C.	2'-0" O.C.

*Design Pressure Includes a Safety Factor = 2.0.

Code Compliance:

The product described herein has demonstrated compliance with The Florida Building Code 2020, Section 1504.3.2, 1504.7.

Evaluation Report Scope:

The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2020, as relates to Rule 61G20-3.

Performance Standards:

The product described herein has demonstrated compliance with:

- ASTM E 1592-05 (2012) Test method for structural performance of sheet metal roof and siding systems by uniform static air pressure difference
- FM 4471-92 - Foot Traffic Resistance Test

Reference Data:


1. ASTM E 1592-05 (2012) Test
Force Engineering & Testing, Inc. (FBC Organization # TST-5328)
Report No. 667-0060T-18A-E, 667-0061T-18A-D
2. FM 4471-10, Section 4.4 Foot Traffic Resistance Test
Force Engineering & Testing, Inc. (FBC Organization # TST-5328)
Report No. 667-0060T-18F, 667-0061T-18E
3. Certificate of Independence
By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing
(FBC Organization # ANE ID: 12901)

Test Standard Equivalency:

1. The FM 4471-10, Foot Traffic Resistance test standard is equivalent to FM 4471-92.

Quality Assurance Entity:

The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.

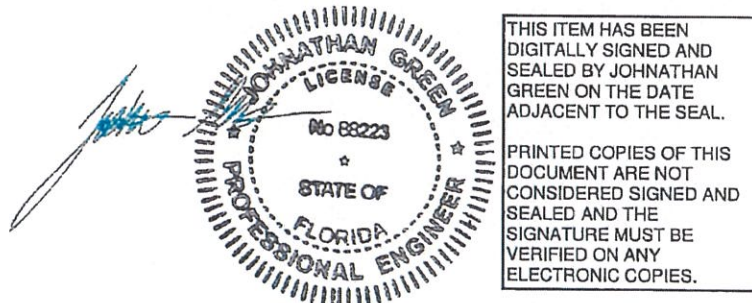

FL# 27402.1 R2



Force Engineering & Testing

19530 Ramblewood Drive

Humble, Texas 77338



Phone: (281) 540-6603 FAX: (281) 540-9966

Website: www.forceengineeringtesting.com

26 GA. HAMPTON RIB FASTENER PATTERN 2-1-2-1



29 GA. HAMPTON RIB FASTENER PATTERN 6"-3"-6"-3"-6"-3"-6"

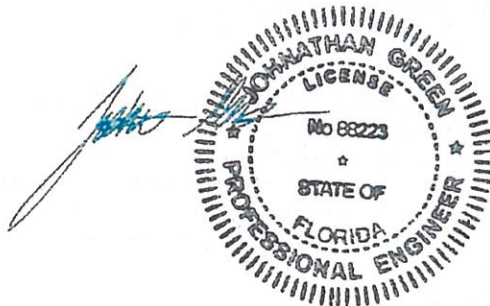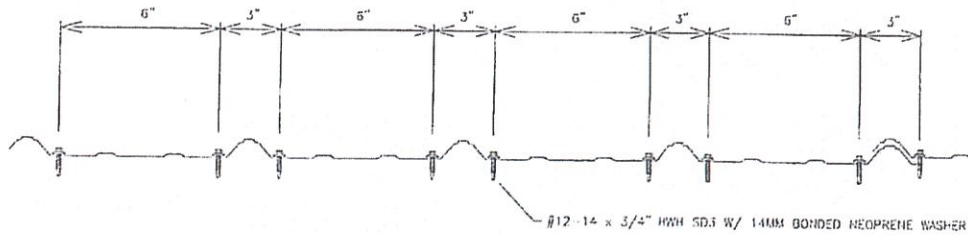

THIS ITEM HAS BEEN
DIGITALLY SIGNED AND
SEALED BY JOHNATHAN
GREEN ON THE DATE
ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED AND
SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.

Date Submitted	08/04/2020
Date Validated	08/10/2020
Date Pending FBC Approval	08/22/2020
Date Approved	10/13/2020

Summary of Products

FL #	Model, Number or Name	Description
27403.1	Hampton Rib Wall Panel	Hampton Rib Wall Panel over open Framing
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: N/A Design Pressure: +46.9 psf/-57.3 psf Other: See Evaluation Report for various Design Pressures. Install per Manufacturer's Details. Not for use in HVHZ Zones.		Installation Instructions FL27403 R2 II Hampton Rib Wall Panel sealed.pdf Verified By: Johnathan E Green, P.E. 88223 Created by Independent Third Party: Yes Evaluation Reports FL27403 R2 AE Hampton Rib Wall Panel sealed.pdf Created by Independent Third Party: Yes
27403.2	Resi-Lap Siding Wall Panel	Resi-Lap Siding Wall Panel over open Framing
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: N/A Design Pressure: +40.0 psf/-37.0 psf Other: +40.0 psf at 4'-0" o.c. -37.0 psf at 4'-0" o.c. Install per Manufacturer's Details. Not for use in HVHZ Zones.		Installation Instructions FL27403 R2 II Resi-Lap Wall Panel DRAFT sealed.pdf Verified By: Johnathan E Green, P.E. 88223 Created by Independent Third Party: Yes Evaluation Reports FL27403 R2 AE Resi-Lap Wall Panel DRAFT sealed.pdf Created by Independent Third Party: Yes

[Back](#) [Next](#)

Contact Us :: 2601 Blair Stone Road, Tallahassee FL 32399 Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. *Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:



Credit Card
Safe

SECURITYMETRICS



Force Engineering & Testing


19530 Rumblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

Compliance Statement:	The product as described in this report has demonstrated compliance with the Florida Building Code 2020, Sections 1709.2.
Product Description:	Hampton Rib 26 Ga. and 29 Ga. Steel Wall Panel, 36" Wide, through fastened structural wall panel. Structural Application.
Panel Material/Standards:	Material: 26 Ga. Steel, ASTM A792 or ASTM A653 G90 Grade 50 29 Ga. Steel, ASTM A792 or ASTM A653 G90 Grade 80 Conforming to Florida Building Code 2020 Section 1405.2.
Panel Dimension(s):	Thickness: 26 Ga.: 0.0185" min. order thickness 29 Ga.: 0.0142" min. order thickness Width: 36" maximum coverage Rib Height: ¾" major rib at 9" O.C. Panel Rollformer: MRS Metal Rollforming Systems
Panel Fastener:	#12-14 x ¾" HWH SD#3 with 14mm neoprene bonded washing or approved equal. Corrosion Resistance: Per Florida Building Code 2020.
Substrate Description:	Minimum 14 Ga. (Grade 50) Steel framing, Minimum 16 Ga. (Grade 50) Steel framing, or Minimum 18 Ga. (Grade 50) Steel framing. See Table A & B for steel gauge. Framing must be designed in accordance w/ Florida Building Code 2020.
Allowable Design Pressures:	

Table "A" 26 Ga. Hampton Rib Wall Panel

Maximum Design Pressure:	-57.3 psf	-72.9 psf	-67.7 psf	+46.9 psf	+54.7 psf
Panel Fastener Pattern:	2-1-2-1	2-1-2-1	2-1-2-1	2-1-2-1	2-1-2-1
Panel Span:	5'-0" O.C.	4'-0" O.C.	4'-0" O.C.	5'-0" O.C.	4'-0" O.C.
Substrate:	Min. 14 Ga. Steel Framing	Min. 14 Ga. Steel Framing	Min. 14 Ga. Steel Framing	Min. 18 Ga. Steel Framing	Min. 18 Ga. Steel Framing

*Design Pressure includes a Safety Factor = 2.0.

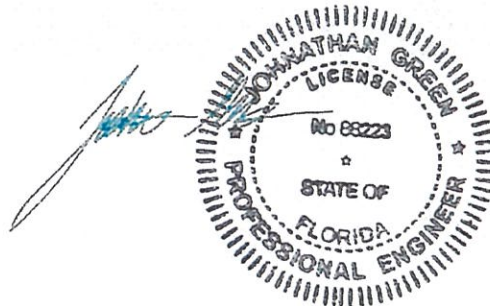

THIS ITEM HAS BEEN
DIGITALLY SIGNED AND
SEALED BY JOHNATHAN
GREEN ON THE DATE
ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED AND
SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.



Force Engineering & Testing

19530 Ramblewood Drive

Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966

Website: www.forceengineeringtesting.com

Quality Assurance Entity:

The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.

Installation:

Install per manufacturer's recommended details.

Insulation:

Manufacturer's approved product (Optional)

Panel Fire Classification:


Fire classification is not part of this acceptance.

Shear Diaphragm:

Shear diaphragm values are outside the scope of this report.

Design Procedure:

Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2020 for wall cladding wind loads. These component wind loads for wall cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2020 Chapter 22 for steel, and Chapter 16 for structural loading.

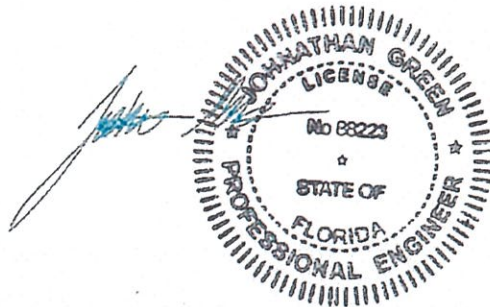

THIS ITEM HAS BEEN
DIGITALLY SIGNED AND
SEALED BY JOHNATHAN
GREEN ON THE DATE
ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED AND
SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.



[BCIS Home](#) |
 [Log In](#) |
 [User Registration](#) |
 [Hot Topics](#) |
 [Submit Surcharge](#) |
 [Stats & Facts](#) |
 [Publications](#) |
 [FBC Staff](#) |
 [BCIS Site Map](#) |
 [Links](#) |
 [Search](#)

Product Approval
 USER: Public User

[Product Approval Menu](#) >
 [Product or Application Search](#) >
 [Application List](#) >
 Application Detail

FL #	FL17996-R1
Application Type	Affirmation
Code Version	2017
Application Status	Approved

Comments
 Archived

Product Manufacturer	Elxlr Door and Metal Company
Address/Phone/Email	1215 Pope Drive Douglas, GA 31533 (912) 493-2215 ryarberry@elxlrmdmc.com

Authorized Signature	Randall Yarberry ryarberry@elxlrmdmc.com
----------------------	---

Technical Representative	PTC Product Design Group
Address/Phone/Email	PO Box 520775 Longwood, FL 32752 (321) 690-1788 info@ptc-corp.com

Quality Assurance Representative
 Address/Phone/Email

Category	Exterior Doors
Subcategory	Swinging Exterior Door Assemblies

Compliance Method	Certification Mark or Listing
-------------------	-------------------------------

Certification Agency	American Architectural Manufacturers Association
Validated By	American Architectural Manufacturers Association

Referenced Standard and Year (of Standard)	<table border="0"> <tr> <td><u>Standard</u></td> <td><u>Year</u></td> </tr> <tr> <td>ASTM E330</td> <td>2002</td> </tr> </table>	<u>Standard</u>	<u>Year</u>	ASTM E330	2002
<u>Standard</u>	<u>Year</u>				
ASTM E330	2002				

Equivalence of Product Standards
 Certified By

I affirm that there are no changes in the new Florida Building Code which affect my product(s) and my product(s) are in compliance with the new Florida Building Code.

Documentation from approved Evaluation or Validation Entity	<table border="0"> <tr> <td>Yes</td> <td>No</td> <td>N/A</td> </tr> </table>	Yes	No	N/A
Yes	No	N/A		

[FL17996 R1 COC Affirmation FL17996 418-1208 ss.pdf](#)

		FL17996 R1 AE PER 1951 Rev1a 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.6	Series 430 W9	Vinyl Steel Out-swinging Regular Door - 9-Lite Window (1'8" x 3'0")
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +33/-40 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR 430-W9 E330 plus5.pdf Quality Assurance Contract Expiration Date 09/14/2020 Installation Instructions FL17996 R1 II FLIX0053 Rev-A OS MODEL 430-W9 ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AE PER 1951 Rev1a 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.7	Series 6400 W9 Cottage	Series 6400-W9 Non-Impact Inswing Painted Steel Door w/Storm Door
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +66/-56 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR 6400 E330 plus5.pdf Quality Assurance Contract Expiration Date 09/16/2019 Installation Instructions FL17996 R1 II FLIX0056 Rev-A IS MODEL 6400-W9 WITH STORM DOOR ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 1954 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.8	Series 7500 Oval	Series 7500 Non-Impact Inswing Vinyl Laminated Steel Door w/Adjustable Threshold
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +34/-50 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR 7500 Oval 21 adjustable threshold E330 plus5.pdf Quality Assurance Contract Expiration Date 09/17/2019 Installation Instructions FL17996 R1 II FLIX0055 Rev-A IS MODEL 7500 OVAL 21 WITH ADJUSTABLE THRESHOLD ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 1955 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.9	Series 7500 Oval	Series 7500 Non-Impact Inswing Vinyl Laminated Steel Door w/Storm Door and PVC Jambs
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +50/-50 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR 7500 Oval 23 E330 plus5.pdf Quality Assurance Contract Expiration Date 09/16/2019 Installation Instructions FL17996 R1 II FLIX0060 Rev-A IS MODEL STR 7500 23 OVAL WITH STORM DOOR ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 1955 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.10	Series 8400 W9 Cottage	Series 8400-W9 Non-Impact Oval Inswing Vinyl Laminated Steel Door w/Storm Door
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +50/-50 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR 8400 E330 plus5.pdf Quality Assurance Contract Expiration Date 09/16/2019 Installation Instructions FL17996 R1 II FLIX0057 Rev-A IS MODEL 8400-W9 OVAL WITH STORM DOOR ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AE PER 1954 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes

		Evaluation Reports FL17996 R1 AF PER 1953 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.17	Series BFIF7N	Series BFIF7N Non-Impact IS Fiberglass Door
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +30/-30 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR BFIF7N E330 plus5.pdf Quality Assurance Contract Expiration Date 09/15/2019 Installation Instructions FL17996 R1 II ELIX0040 AFIF7N-BFIF7N RevA SS.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 1952 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.18	Series BFIF7S	Series BFIF7S Non-Impact IS Fiberglass French Door
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +38/-38 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR BFIF7S E330 plus5.pdf Quality Assurance Contract Expiration Date 09/15/2019 Installation Instructions FL17996 R1 II ELIX0046 BFIF7S RevA ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 1952 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.19	Series BFOF7N	Series BFOF7N Non-Impact OS Fiberglass Door
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +30/-30 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR BFOF7N E330 plus5.pdf Quality Assurance Contract Expiration Date 04/06/2020 Installation Instructions FL17996 R1 II ELIX0047 AFOF7N-BFOF7N RevA ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 1952 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes
17996.20	Series BVI63S	Series BVI63S Non-Impact Single Inswing Door w/Fixed Lite Insert and Outswing Storm Door
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +65/-65 Other:		Certification Agency Certificate FL17996 R1 C CAC EXR BVI63S E330 plus5.pdf Quality Assurance Contract Expiration Date 12/17/2021 Installation Instructions FL17996 R1 II ELIX0061 BVI63S RevA ss.pdf Verified By: Robert J. Amoroso, PE FL PE No. 49752 Created by Independent Third Party: Yes Evaluation Reports FL17996 R1 AF PER 22d4 Rev2 415-0705 ss.pdf Created by Independent Third Party: Yes

Go to Page

Page 1 / 2

Contact Us :: 2601 Blair Stone Road, Tallahassee FL 32309 Phone: 850-487-1024

 The State of Florida is an AVEEO employer. Copyright 2007-2013 State of Florida. :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. *Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:



ELIXIR DOOR & METAL CO.
MODEL 407 NON-IMPACT OUTSWING
VINYL LAMINATED STEEL DOOR
INSTALLATION ANCHORAGE DRAWING

GENERAL NOTES:

1. THE PRODUCT ANCHORAGE SHOWN HEREIN IS DESIGNED FOR USE IN AREAS WHERE WINDBORNE DEBRIS PROTECTION IS REQUIRED PER THE FLORIDA BUILDING CODE (FBC) EXCLUDING HIGH VELOCITY HURRICANE ZONE AND THE DESIGN PRESSURE(S) STATED HEREIN.
2. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORT DALLAS LABORATORIES, INC. 84276 AND ASSOCIATED LABORATORY STAMPED DRAWINGS.
3. ADEQUACY OF THE EXISTING STRUCTURAL 2X FRAMING OR STEEL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
4. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

3. IN AREAS WHERE WINDBORNE DEBRIS PROTECTION IS REQUIRED PER THE FLORIDA BUILDING CODE (FBC) EXCLUDING HIGH VELOCITY HURRICANE ZONE AND THE DESIGN PRESSURE(S) STATED HEREIN.
4. FRAME MATERIAL: ALUMINUM ALLOY 6063-T6 DOOR PANEL MATERIAL: 3041 VINYL LAMINATED GALVANIZED STEEL 015' SMITH UNIFORM FOMI CORE.
7. DESIGNATIONS "X" STAND FOR THE FOLLOWING:
X: OPERABLE PANEL
O: FIXED PANEL
8. HARDWARE:
A. HALL HINGES; (H) 6053-T6 EXTRUDED ALUMINUM
B. HALL DOOR: SINGLE CYLINDER
C. DEAD BOLT: SINGLE CYLINDER
9. SEE SHEET 1 FOR DESIGN PRESSURE CHART.

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION.
2. THE INSTALLATION ANCHORS AT THE SPACINGS SHOWN ARE THE MINIMUM NUMBER OF ANCHORS AND MAXIMUM SPACINGS TO BE USED FOR PRODUCT INSTALLATION.
3. SHALL AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING PHOIDS). MAXIMUM ALLOWABLE OR GREATER OF 1/4" INCH. SHALL WHEN SPACE OF 1/4" INCH OR GREATER BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
4. ANCHORS FOR INSTALLATION INTO WOOD FRAMING OR 1-1/4" MINIMUM STEEL FRAMING SHALL BE AS SHOWN IN "ANCHOR SCHEDULE" THIS SHEET.

5. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.
6. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED IN THE "ANCHOR SCHEDULE" THIS SHEET.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

DESIGN PRESSURE RATING (PSF)		IMPACT RATING
WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
..	+18.0 / -5.0	NONE

**UNIT MUST BE INSTALLED BENEATH AN APPROVED OVERHANG

TABLE OF CONTENT	
SHEET	DESCRIPTION
1	GENERAL AND INSTALLATION NOTES
2	ELEVATION, ANCHORING LAYOUT
3	VERTICAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS

ANCHOR SCHEDULE					
SUBSTRATE	DOOR FRAME TYPE	TYPE	SIZE	MANUFACTURER ANCHOR SPECIFICATION	EMBEDMENT (IN) (1)
SHEET METAL/STEEL TUBING 14 GA. MIN. THICKNESS	FW (2-BAR)	PAN HEAD	NO. 8	ASME B18.6.1 (TAPPING SCREW)	MIN 3 THREADS PAST INSIDE SURFACE OF SUBSTRATE
2X WOOD FRAMING	FW (2-BAR)	PAN HEAD	NO. 8	ASME B18.6.1 (WOOD SCREW) OR ASME B18.6.1 (TAPPING SCREW)	1"


NOTES:

- 1) FOR WOOD OR TAPPING SCREWS IF SPLITTING IS A CONCERN, DRILL 0.031" PLOT HOLE (DRILL SIZE 43).
- 2) EDGE DISTANCE MEASURED FROM CENTER OF ANCHOR TO EDGE OF SUBSTRATE.


ELIXIR DOOR & METAL CO. 1215 POPE DRIVE DOUGLAS, GEORGIA 31503		DATE: 02/25/12 BY: J.H. CHECKED: N.T.S.		PROJECT: MODEL 407 NON-IMPACT OUTSWING VINYL LAMINATED STEEL DOOR GENERAL AND INSTALLATION NOTES	
415-0705		REV. 1 OF 4		REV. 1 OF 4	
DATE: 02/25/12		DATE: 02/25/12		DATE: 02/25/12	
BY: J.H.		BY: J.H.		BY: J.H.	
CHECKED: N.T.S.		CHECKED: N.T.S.		CHECKED: N.T.S.	

Robert J. Anderson, P.E.
PL. No. 10,457-92


Digitally signed by Robert J. Anderson
DN: cn=Robert J. Anderson, o=PTC Product Development, email=robertj@ptc.com, c=US
Date: 2015.08.05 09:56:04 -0400

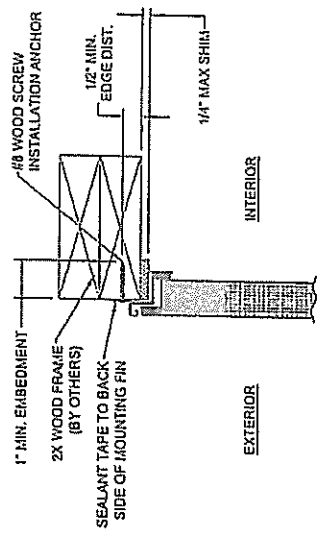


B VERTICAL SECTION
WOOD FRAME SUBSTRATE

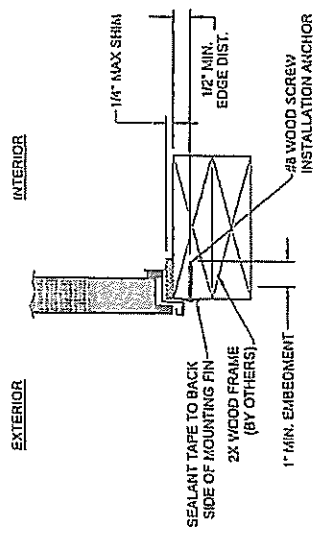

A VERTICAL SECTION
WOOD FRAME SUBSTRATE

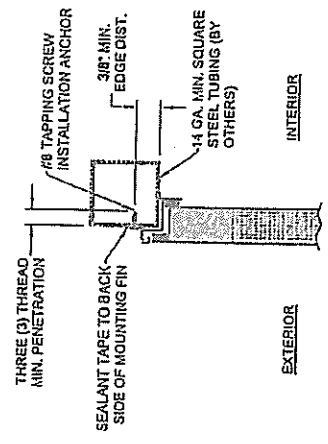

D VERTICAL SECTION
STEEL TUBING SUBSTRATE

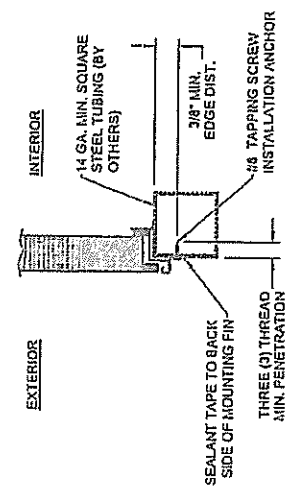

C VERTICAL SECTION
STEEL TUBING SUBSTRATE

ELIXIR DOOR & METAL CO. 1215 POPE DRIVE DOUGLAS, GEORGIA 31533 MODEL 407 NON-IMPACT OUTSWING VINYL LAMINATED STEEL DOOR VERTICAL CROSS SECTIONS		 P.T.C. PRODUCTS COMPANY 10000 W. 10TH AVE., SUITE 100 DENVER, CO 80231 TEL: 303-751-1234 FAX: 303-751-1235
REV	DESCRIPTION	DATE
1	UPDATE TO 5TH EDITION	8/3/15
2		
3		
4		
5		
6		
7		
8		
9		
10		

Robert J. Amoruso, P.E.
 FL P.E. No. 40752
 Digitally signed
 by Robert J.
 Amoruso
 DN: cn=Robert J.
 Amoruso, o=
 P.T.C. Products
 Company, email=ra@ptcprod.com, c=US
 Date: 2015.01.05
 09:56:19 -0500



Product Approval
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > [Application Detail](#)

OFFICE OF THE
SECRETARY

FL #	FL21450-R5								
Application Type	Revision								
Code Version	2020								
Application Status	Approved								
Comments	Archived								
Product Manufacturer	Janus International Group, LLC.								
Address/Phone/Email	135 Janus International Blvd. Temple, GA 30179 (770) 562-6135 Ext 360 curts@janusintl.com								
Authorized Signature	Curtis Schroeder curts@janusintl.com								
Technical Representative	Curtis L. Schroeder								
Address/Phone/Email	134 Janus International Blvd. Temple, GA 30179 (770) 562-2850 Ext 360 curts@janusintl.com								
Quality Assurance Representative	Chris Meyer								
Address/Phone/Email	135 Janus International Blvd Temple, GA 30179 (770) 562-2850 chris.meyer@janusintl.com								
Category	Exterior Doors								
Subcategory	Roll-Up Exterior Door Assemblies								
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer Evaluation Report - Hardcopy Received								
Florida Engineer or Architect Name who developed the Evaluation Report	John E. Scates								
Florida License	PE-51737								
Quality Assurance Entity	National Accreditation and Management Institute								
Quality Assurance Contract Expiration Date	12/31/2021								
Validated By	Kurt Dietrich PE Validation Checklist - Hardcopy Received								
Certificate of Independence	FL21450 R5 COI Cert of Ind Scates 2020s.pdf								
Referenced Standard and Year (of Standard)	<table border="0"> <thead> <tr> <th><u>Standard</u></th> <th><u>Year</u></th> </tr> </thead> <tbody> <tr> <td>ANSI/DASMA 108</td> <td>2012</td> </tr> <tr> <td>ANSI/DASMA 115</td> <td>2012</td> </tr> <tr> <td>ASTM E330</td> <td>2002</td> </tr> </tbody> </table>	<u>Standard</u>	<u>Year</u>	ANSI/DASMA 108	2012	ANSI/DASMA 115	2012	ASTM E330	2002
<u>Standard</u>	<u>Year</u>								
ANSI/DASMA 108	2012								
ANSI/DASMA 115	2012								
ASTM E330	2002								
Equivalence of Product Standards Certified By									

		FL21450 R5 AE EvalRept Model3100-IM r5s.pdf Created by Independent Third Party: Yes
21450.7	Series 750	Series 750 - 26 Gauge Door Assembly Max Size: 3'-0" x 12'-0"
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +35/-45 Other: Not for use in High Velocity Hurricane Zones		Installation Instructions FL21450 R5 II T1000 RevF s.pdf Verified By: John E. Scates, P.E. 51737 Created by Independent Third Party: Yes Evaluation Reports FL21450 R5 AE EvalRept Model750 1100 r5s.pdf Created by Independent Third Party: Yes
21450.8	Series 750	Series 750 - 26 Gauge Door Assembly Max Size: 6'-0" x 12'-0"
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +19.9/-24.4 Other: Design Pressures listed as a test width of 6'-0". For pressures vs. widths, see table, sheet 1 of 2, dwg T1001. Not for use in High Velocity Hurricane Zones.		Installation Instructions FL21450 R5 II T1001 RevF s.pdf Verified By: John E. Scates, P.E. 51737 Created by Independent Third Party: Yes Evaluation Reports FL21450 R5 AE EvalRept Model750 1100 r5s.pdf Created by Independent Third Party: Yes
21450.9	Series 750	Series 750 - 26 Gauge Door Assembly Max Size: 8'-8" x 12'-0"
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +24.4/-27.0 Other: Not for use in High Velocity Hurricane Zones.		Installation Instructions FL21450 R5 II T1002 RevF s.pdf Verified By: John E. Scates, P.E. 51737 Created by Independent Third Party: Yes Evaluation Reports FL21450 R5 AE EvalRept Model750 1100 r5s.pdf Created by Independent Third Party: Yes
21450.10	Series 750	Series 750 - 26 Gauge Door Assembly Max Size: 10'-0" x 12'-0"
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: +19.4/-22.7 Other: Not for use in High Velocity Hurricane Zones.		Installation Instructions FL21450 R5 II T1003 RevF s.pdf Verified By: John E. Scates, P.E. 51737 Created by Independent Third Party: Yes Evaluation Reports FL21450 R5 AE EvalRept Model750 1100 r5s.pdf Created by Independent Third Party: Yes

[Back](#) [Next](#)

Contact Us :: 2601 Blair Stone Road, Tallahassee FL 32399 Phone: 850-487-1824

The State of Florida is an AA/EEO employer. Copyright 2007-2013 State of Florida. :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. *Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:



Credit Card
Safe

securityMETRICS


FBC APPROVED PRODUCT LIST				
CATEGORY	SUBCATEGORY	MANUFACTURER & PRODUCT	APPROVAL NUMBER	MAX ALLOWABLE WINDSPEED (MPH)
STRUCTURAL COMPONENT	ROOF DECK	CARPORTS ANYWHERE, HAMPTON RIB ROOF PANEL	27402.1	180
STRUCTURAL COMPONENT	STRUCTURAL WALL	CARPORTS ANYWHERE, HAMPTON RIB WALL PANEL	27403.1	180
STRUCTURAL COMPONENT	STRUCTURAL WALL	CARPORTS ANYWHERE, RESI-LAP SIDING WALL PANEL	27403.2	180
PANEL WALLS	WALL LOUVER (FLOOD VENT)	FLOOD SOLUTIONS, LLC., FS & FS HEX	17588.1	N/A
EXTERIOR DOOR	SWINGING	ELIXER DOOR & METAL CO., SERIES 230 W9 STEEL O.S DOOR W/ COTTAGE WINDOW	17996.2	180
EXTERIOR DOOR	SWINGING	ELIXER DOOR & METAL CO., SERIES 407 VINYL STEEL OUT-SWINGING REGULAR DOOR – BLANK (NO WINDOW)	17996.5	180
EXTERIOR DOOR	ROLL-UP	ASTA DOOR CORPORATION, 203 WINDLOCK	8888.1	150
EXTERIOR DOOR	ROLL-UP	JANUS INTERNATIONAL GROUP, LLC., SERIES 3100: +40/-40	21450.3	180
EXTERIOR DOOR	ROLL-UP	JANUS INTERNATIONAL GROUP, LLC., SERIES 3100: +42.5/-45	21450.4	180
EXTERIOR DOOR	ROLL-UP	JANUS INTERNATIONAL GROUP, LLC., SERIES 750: MAX 8'x12' +24.4/-27	21450.9	160
EXTERIOR DOOR	ROLL-UP	JANUS INTERNATIONAL GROUP, LLC., SERIES 750: MAX 10'x12' +19.4/-22.7	21450.10	140
WINDOW	SINGLE HUNG	POCAHONTAS ALUMINUM COMPANY, INC., 100 VS VERTICAL SLIDING WINDOW	12940.1	150
WINDOW	SINGLE HUNG	MI WINDOWS AND DOORS, 185 SH	17499.1	180

POST/TRUSS MAXIMUM SPACINGS		
ULTIMATE WINDSPEED (MPH)	STRUCTURE WIDTH (FT)	MAXIMUM POST/TRUSS SPACING (FT)
120-150	6-24	5.0
120-150	>24-30	4.0
>150	ALL	4.0
NOTES: 1. NOT APPLICABLE FOR STRUCTURES WITH A MEAN ROOF HEIGHT OVER 20 FEET AND/OR ROOF PITCH STEEPER THAN 6:12 2. APPLICABLE ONLY FOR ANY MATERIALS LISTED ON THE APPROVED PRODUCTS CHART AND FRAMING INDICATED IN THE GENERAL NOTES AND DETAILS 3. 5" O.C. REQUIRES VERTICAL ROOF.		


GROUND ANCHOR LENGTH				
(ALL BUILDING WIDTHS ≤ 30')	WIND SPEED (MPH)			
SOIL TYPE	≤ 140	145-155	160-170	175-180
VERY DENSE AND/OR CEMENTED SAND, COARSE GRAVEL, COBBLES, PRELOADED SILTS, CLAYS AND CORAL	30"	30"	48"	48"
MEDIUM DENSE COARSE SANDS, SANDY GRAVEL, VERY STIFF SILTS AND CLAYS	30"	48"	48"	60"
LOOSE TO MEDIUM DENSE SANDS, FIRM TO STIFF CLAYS, SILTS AND ALLUVIAL FILL	48"	48"	60"	60"
LOOSE SANDS, FIRM CLAYS, SILTS AND ALLUVIAL FILL	48"	60"	60"	60"

NOTES: SUB-GRADE SOILS: -TO BE TERMITE TREATED AND COVERED WITH 6 MIL VAPOR RETARDANT PER SECTION R318 AND 1816 OF THE 2020 FLORIDA BUILDING CODE, 7TH EDITION CONCRETE: -MINIMUM 2,500 PSI COMPRESSIVE STRENGTH AT 28 DAYS -ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE REINFORCING STEEL (REBAR) REQUIREMENTS: -MINIMUM GRADE 40 STEEL -REBAR MAY BE BENT IN SHOP OR FIELD PROVIDED: -THE REBAR IS BENT COLD -THE DIAMETER OF THE BEND MEASURED ON THE INSIDE DOES NOT EXCEED 6-BAR DIAMETERS; AND -REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT EXCEPT IN CASES WHERE DOWELS NEED TO BE BENT TO ALIGN WITH A VERTICAL CELL. THESE REBAR MAY BE BENT NOT TO EXCEED TO SLOPE OF 1" HORIZONTALLY TO 6" VERTICALLY. -COVER: -3" COVER MINIMUM WHERE THE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH SOIL OR WEATHER, AND 1½" ELSEWHERE. REBAR EMBEDDED IN GROUTED CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1" FOR FINE GROUT, AND 1½" FOR COARSE GROUT BETWEEN REBAR AND ANY FACE OF A CELL. REBAR USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN 2" FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER, AND 1½" FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER. GALVANIZATION: -METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION AND NOT DIRECTLY EXPOSED TO WEATHER SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153, CLASS B-2. METAL PLATE CONNECTORS, SCREWS, BOLTS, AND NAILS EXPOSED DIRECTLY TO WEATHER SHALL BE STAINLESS STEEL OR HOT DIPPED GALVANIZED.
--


THESE PLANS PERTAIN ONLY TO THE STRUCTURE, INCLUDING MAIN WIND FORCE RESISTING SYSTEM, COMPONENTS AND CLADDING, AND BASE RAIL ANCHORAGE. OTHER DESIGN ISSUES, INCLUDING BUT NOT LIMITED TO PLUMBING, ELECTRICAL, INGRESS/EGRESS, PROPERTY SET-BACKS, FINISH FLOOR ELEVATION AND SLOPE, OR OTHER LOCAL ZONING REQUIREMENTS ARE THE RESPONSIBILITY OF OTHERS. THESE STRUCTURES ARE DESIGNED AS NON-HABITABLE UTILITY/STORAGE BUILDINGS (RISK CATEGORY I) CAPABLE OF SUPPORTING DEAD LOAD OF THE STRUCTURE AND APPLICABLE LIVE AND WIND LOADS. IMPROVEMENTS NOT SPECIFICALLY ADDRESSED HEREIN, INCLUDING DOORS, WINDOWS, OR OTHER COMPONENTS NOT LISTED IN THE FBC APPROVED PRODUCTS LIST (THIS SHEET), AND NOT PROVIDED AND INSTALLED BY CARPORTS ANYWHERE, INC., WHICH EXERT ADDITIONAL LOADS ON THE STRUCTURE SHALL BE AT THE OWNER'S RISK. CARPORTS ANYWHERE NOR THE ENGINEERING DESIGN SHALL NOT BE RESPONSIBLE FOR STRUCTURAL DAMAGE OR FAILURE DUE TO THE APPLICATION OF ADDITIONAL LOADS. BASE RAIL GROUND ANCHOR REQUIREMENTS: ONE WITHIN 6" OF EVERY POST LOCATION, AND BOTH SIDES OF OPENINGS WHERE BASE RAIL IS ABSENT. GROUND ANCHORS ARE NOT REQUIRED FOR CONCRETE FOOTING AND/OR CONCRETE SLAB CONSTRUCTION. SEE GROUND ANCHOR SCHEDULE (THIS SHEET) FOR SPECIFIC TYPE GROUND ANCHOR REQUIREMENTS.
--

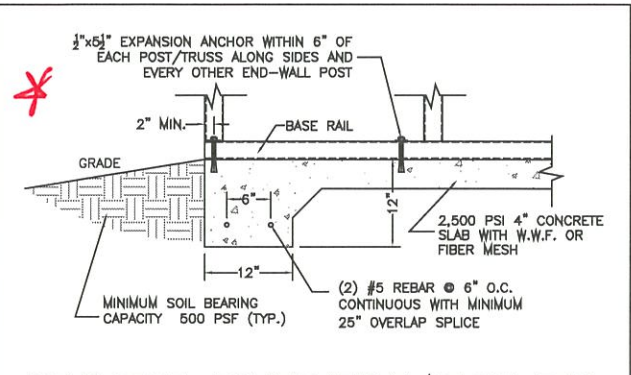


CONCRETE FOUNDATION/BASE RAIL ANCHOR DETAIL

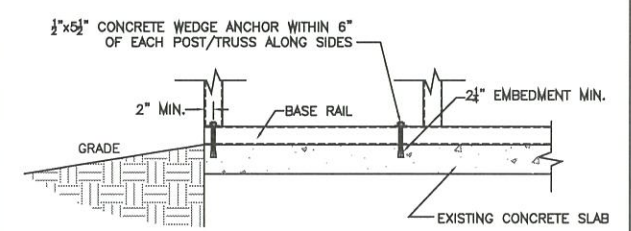

CONCRETE FOUNDATION/BASE RAIL ANCHOR DETAIL (OPEN ONLY)

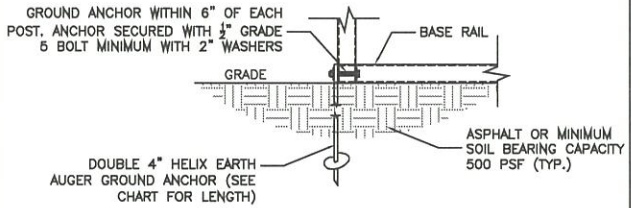

GROUND ANCHOR BASE RAIL DETAIL

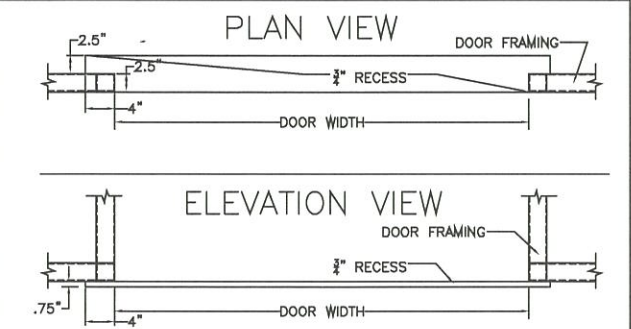

OPTIONAL ROLL-UP DOOR CONCRETE SPLASH-GUARD RECESS

CODE INFORMATION	
CODE VERSION	FBC 2020 7th Edition, ASCE-7-16
MANUFACTURER	CARPORTS ANYWHERE
BUILDING TYPE	UTILITY STRUCTURE
CONSTRUCTION TYPE	II-B
RISK CATEGORY	1
FIRE PROTECTION	NONE
FIRE SUPPRESSION SYSTEM	NONE
OCCUPANCY	UTILITY U
BASIC WIND SPEED	V _{nat} : 120-180mph
EXPOSURE	B/C
ENCLOSURE	ENCLOSED
INTERNAL PRESSURE COEFFICIENT	+/- 0.18
IMPORTANCE FACTOR	1.0
ROOF DEAD LOAD	10PSF
ROOF LIVE LOAD	20PSF OR 300lb POINT LOAD
FLOOR DEAD LOAD	10PSF
FLOOR LIVE LOAD	50PSF
"R" RATING OF WALLS, FLOOR, ROOF	N/A
MODULES PER BUILDING	1
HURRICANE PROTECTION USAGE	NO
HURRICANE SHELTER USAGE	NO
SQUARE FOOTAGE	

REVISIONS			
REV	DESCRIPTION	DATE	BY

Drawn By: MTB

Date: 5/27/20

Location: FLORIDA

Model#: ENCLOSED GENERIC ENGINEERING

GENERAL NOTES


- THIS BUILDING IS EXEMPT FROM THE FBC ENERGY CONSERVATION CODE PER SECTION C101.4.2.
- ALL STEEL TUBING SHALL BE 50 KSI STEEL.
- PLUMBING, ELECTRICAL, INGRESS/EGRESS, PROPERTY SET-BACKS, AND/OR OTHER LOCAL CODE REQUIREMENTS ARE THE RESPONSIBILITY OF THE OWNER.
- ROOF AND WALL SHEATHING SECURED WITH #12-14x1" SELF-DRILLING SCREWS WITH SEAL WASHERS @ 6" O.C. MAX.
- FIELD FRAMING CONNECTIONS SECURED WITH #12-14x3/4" SELF-DRILLING SCREWS.
- ALL SHOP FRAMING CONNECTIONS ARE TO BE WELDED. NO WELDING ON-SITE. ALL WELDING DONE IN SHOP BY A CERTIFIED WELDER.
- CONCRETE EXPANSIONS ANCHORS ARE TO BE MINIMUM 1/2"x3", 2,500LB TENSILE STRENGTH.
- 12 OR 14GA. FRAMING IS 2.5"x2.5" TUBE STEEL. NIPPLES ARE 2.25"x2.25" TUBE STEEL.

12/21/20


Matthew T. Baldwin P.E.
Florida License #64608

Sheet: CA-1 OF 3


PRODUCTS, ANCHORING, SPACING & CONCRETE DETAILS

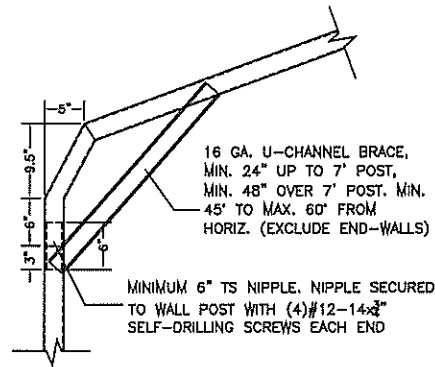


BOW RAFTER TO POST
CONNECTION DETAIL

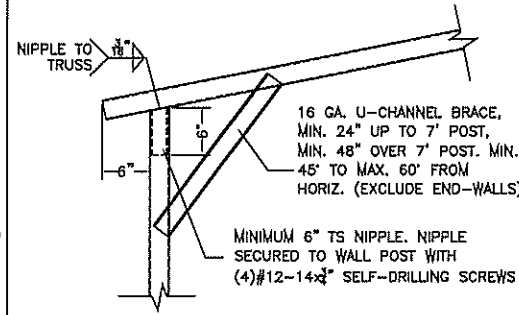


BOX EAVE RAFTER TO
POST CONNECTION DETAIL

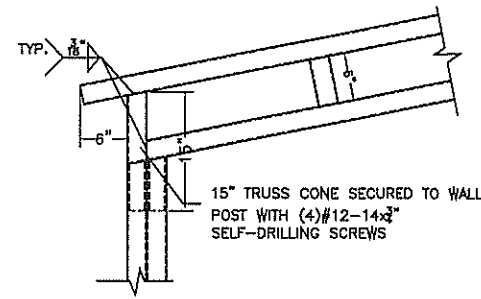


40' BOX EAVE RAFTER TO
POST CONNECTION DETAIL

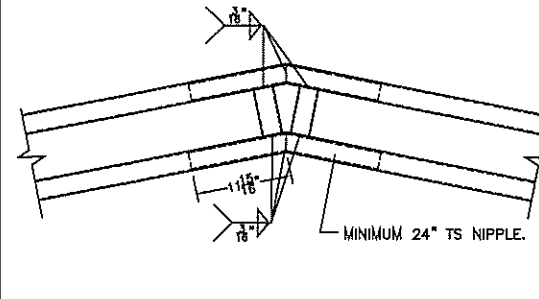


TRUSSED RAFTER
CONNECTION DETAIL

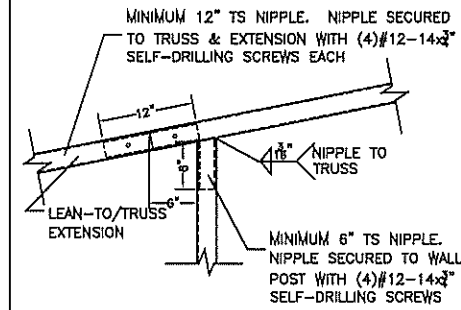


LEAN-TO TO TRUSS
CONNECTION

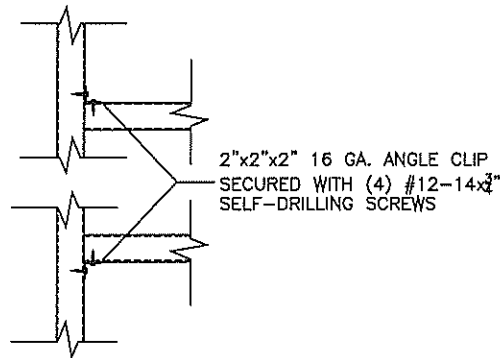


NON-STRUCTURAL HEADER OR
WINDOW RAIL TO POST DETAIL

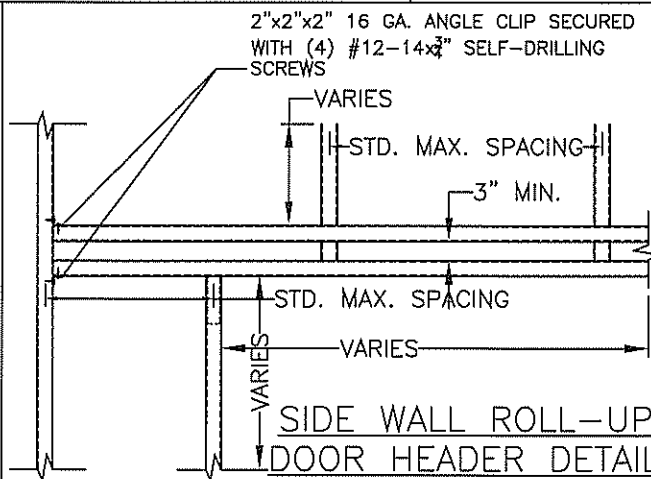


SIDE WALL ROLL-UP
DOOR HEADER DETAIL

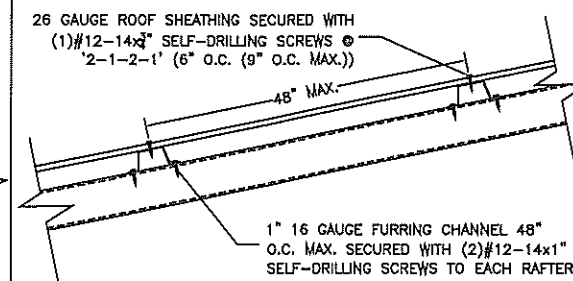


ROOF PANEL CONNECTION
VERTICAL SHEATHING OPTION

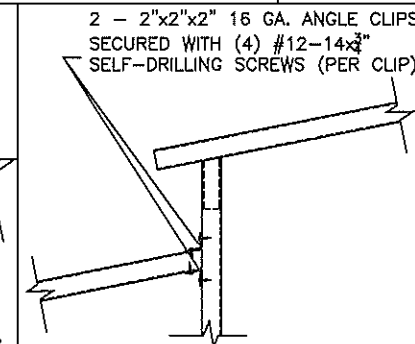


LEAN-TO TO TRUSS
CONNECTION

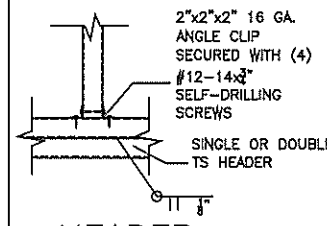


HEADER
CONNECTION
DETAIL
OPTION 1

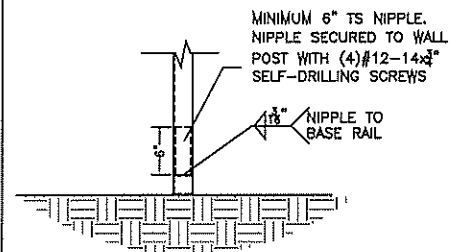


POST TO BASE RAIL
CONNECTION

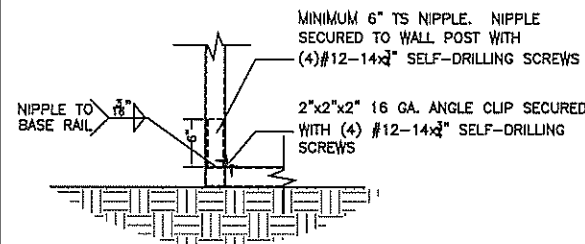


END POST TO BASE RAIL
CONNECTION

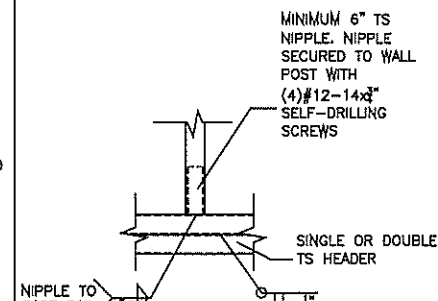


HEADER CONNECTION
DETAIL OPTION 2

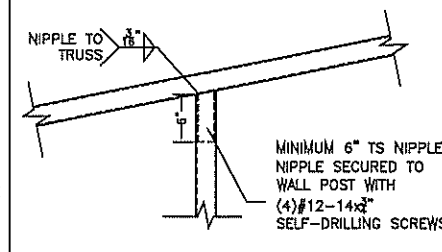


POST TO TRUSS
CONNECTION

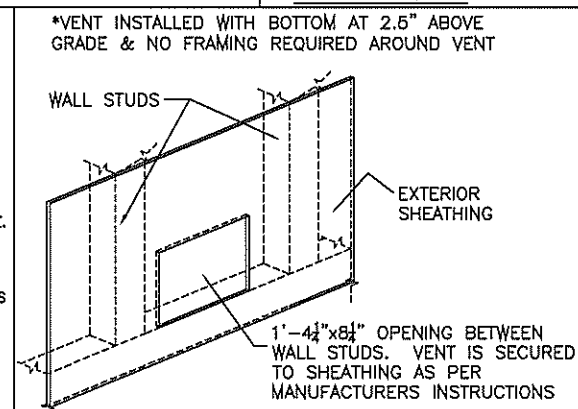


HYDROVENT DETAIL
(OPTIONAL)

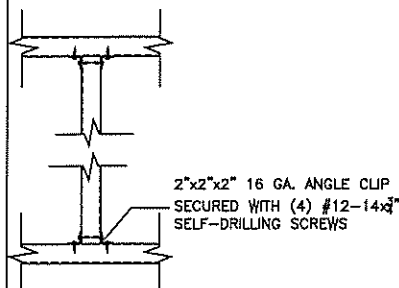


INTERMEDIATE POST TO
HEADER/BASE RAIL/OR
WINDOW RAIL DETAIL

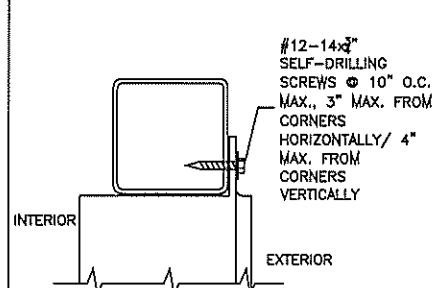

DOOR FRAME TO POST
CONNECTION

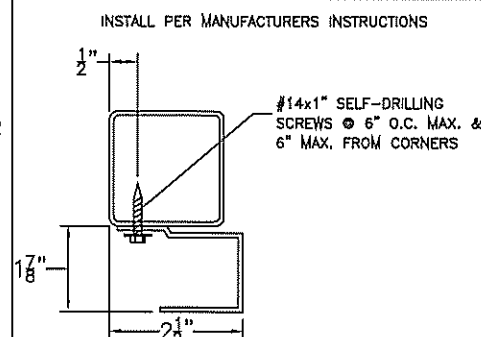

ROLL-UP DOOR TO
POST CONNECTION

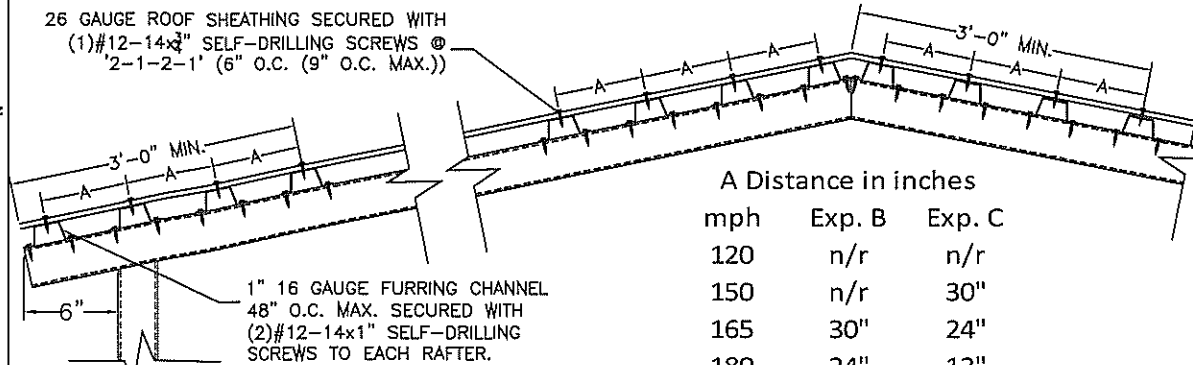

EAVE & RIDGE REINFORCED ROOF PANEL CONNECTION
(RIDGE 3r AND EAVE 3e)

A Distance in inches

mph	Exp. B	Exp. C
120	n/r	n/r
150	n/r	30"
165	30"	24"
180	24"	12"



CODE INFORMATION

CODE VERSION	FBC 2020 7th Edition, ASCE-7-16
MANUFACTURER	CARPORTS ANYWHERE
BUILDING TYPE	UTILITY STRUCTURE
CONSTRUCTION TYPE	II-B
RISK CATEGORY	1
FIRE PROTECTION	NONE
FIRE SUPPRESSION SYSTEM	NONE
OCCUPANCY	UTILITY U
BASIC WIND SPEED	V _W : 120-180mph
EXPOSURE	B/C
ENCLOSURE	ENCLOSED
INTERNAL PRESSURE COEFFICIENT	+/- 0.18
IMPORTANCE FACTOR	1.0
ROOF DEAD LOAD	10PSF
ROOF LIVE LOAD	20PSF OR 300lb POINT LOAD
FLOOR DEAD LOAD	10PSF
FLOOR LIVE LOAD	50PSF
"R" RATING OF WALLS, FLOOR, ROOF	N/A
MODULES PER BUILDING	1
HURRICANE PROTECTION USAGE	NO
HURRICANE SHELTER USAGE	NO
SQUARE FOOTAGE	

REVISIONS

REV	DESCRIPTION	DATE	BY

Drawn By:	MTB
Date:	5/27/20
Location:	FLORIDA
Model:	ENCLOSED GENERIC ENGINEERING


- GENERAL NOTES
- THIS BUILDING IS EXEMPT FROM THE FBC ENERGY CONSERVATION CODE PER SECTION C101.4.2.
 - ALL STEEL TUBING SHALL BE 50 KSI STEEL.
 - PLUMBING, ELECTRICAL, INGRESS/EGRESS, PROPERTY SET-BACKS, AND/OR OTHER LOCAL CODE REQUIREMENTS ARE THE RESPONSIBILITY OF THE OWNER.
 - ROOF AND WALL SHEATHING SECURED WITH #12-14x1" SELF-DRILLING SCREWS WITH SEAL WASHERS @ 6" O.C. MAX.
 - FIELD FRAMING CONNECTIONS SECURED WITH #12-14x3/4" SELF-DRILLING SCREWS.
 - ALL SHOP FRAMING CONNECTIONS ARE TO BE WELDED. NO WELDING ON-SITE. ALL WELDING DONE IN SHOP BY A CERTIFIED WELDER.
 - CONCRETE EXPANSIONS ANCHORS ARE TO BE MINIMUM 1/2"x3", 2,500LB TENSILE STRENGTH.
 - 12 OR 14GA. FRAMING IS 2.5"x2.5" TUBE STEEL. NIPPLES ARE 2.25"x2.25" TUBE STEEL.

12/21/20


Matthew T. Baldwin P.E.
Florida License #64608

Sheet: CA-2 OF 3



TITLE: DETAILS

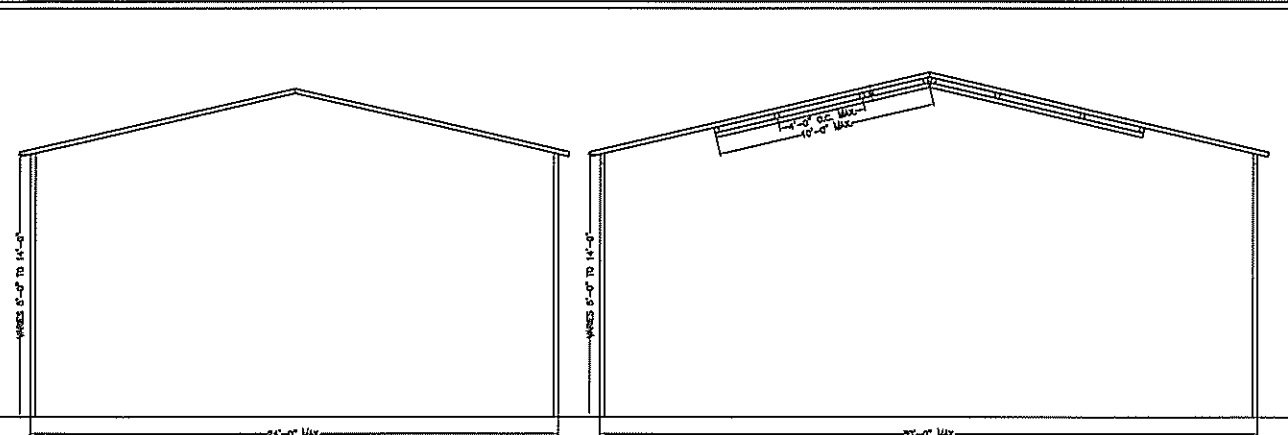


TYPICAL POST/TRUSS FRAMING SECTION –
BOX EAVE, UP TO & INCLUDING 24' WIDE

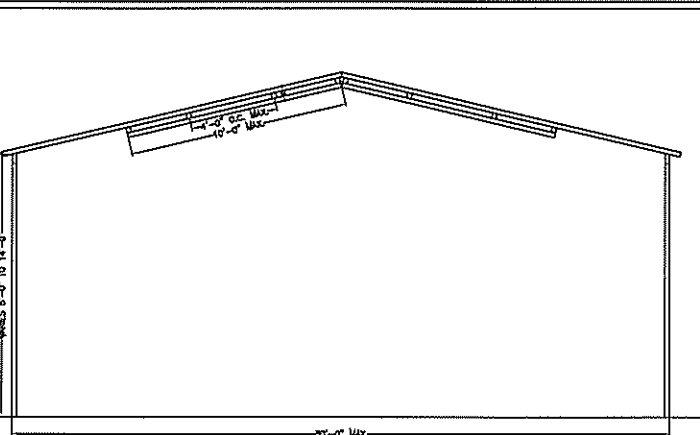



TYPICAL POST/TRUSS FRAMING SECTION –
BOX EAVE, 24'-1\"/>

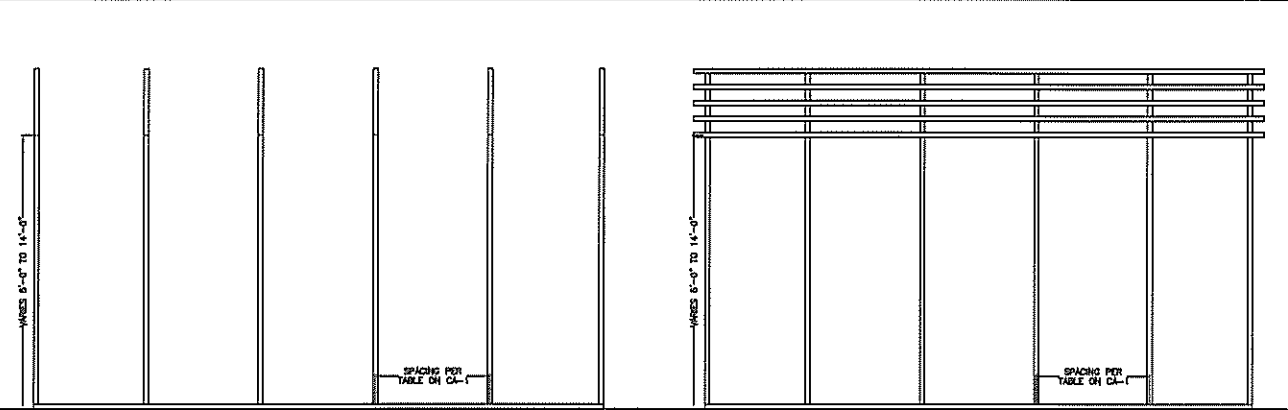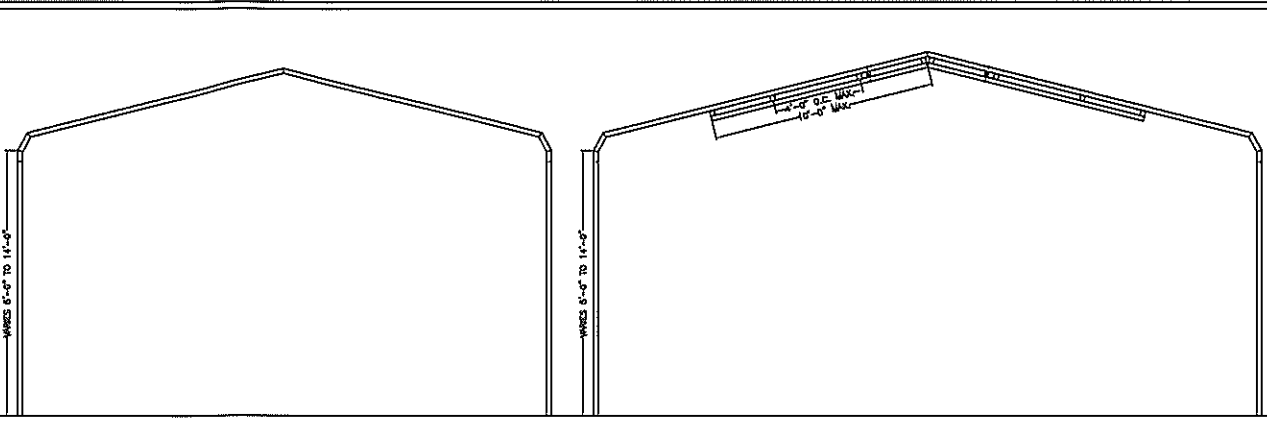


TYPICAL SIDE WALL FRAMING –
BOX EAVE/BOW FRAME, HORIZONTAL ROOF

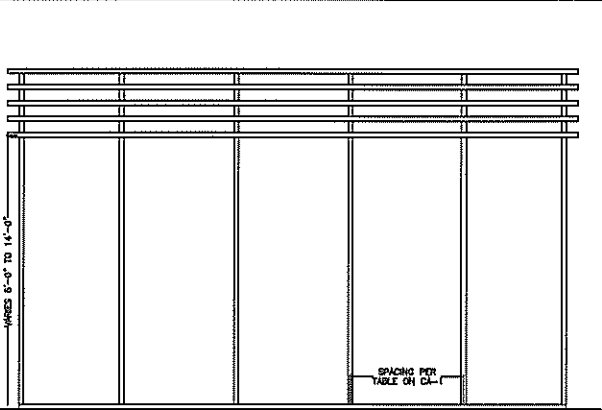


TYPICAL SIDE WALL FRAMING –
BOX EAVE, VERTICAL ROOF

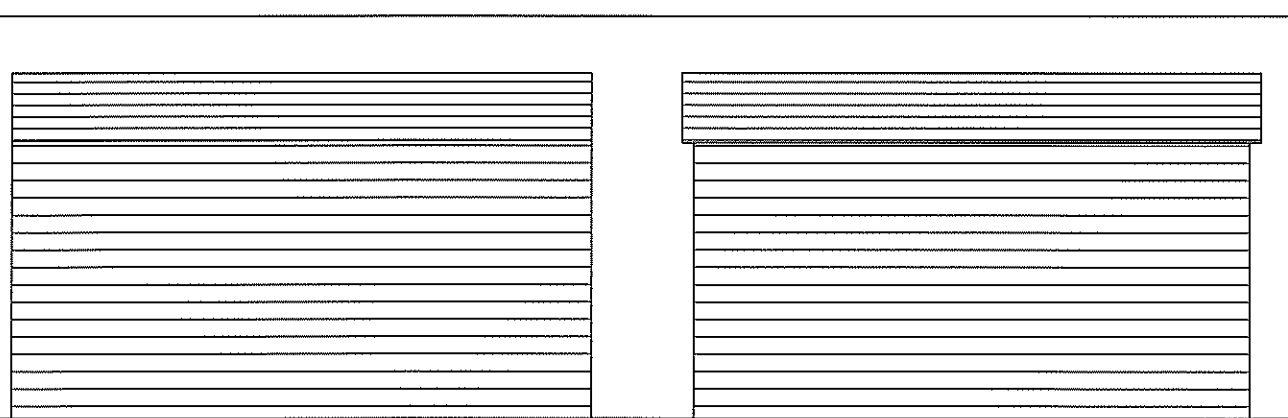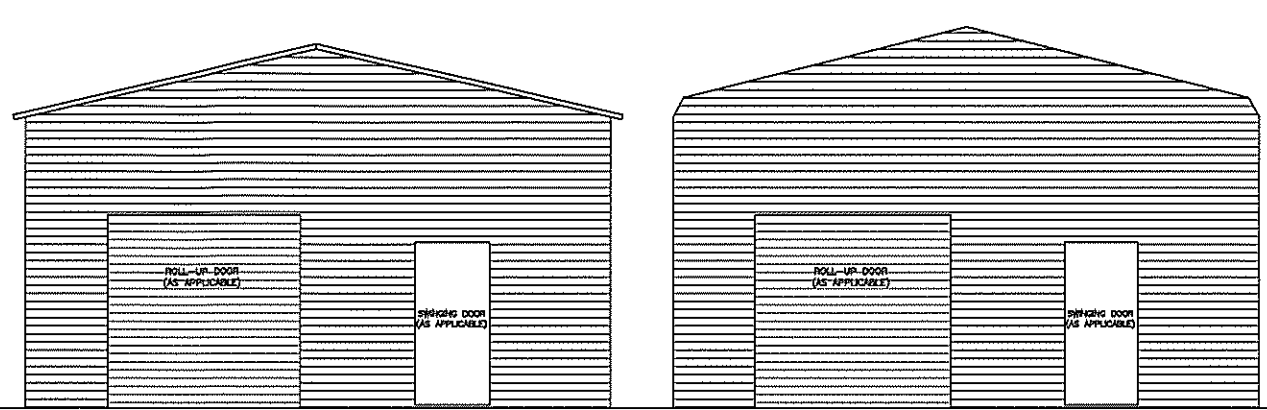


TYPICAL SIDE WALL ELEVATION –
BOW FRAME, HORIZONTAL WALLS & ROOF

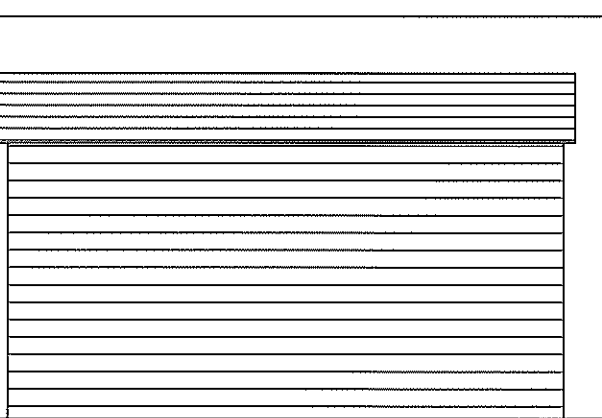

TYPICAL SIDE WALL ELEVATION –
BOX EAVE, HORIZONTAL WALLS (OR LAP) & ROOF

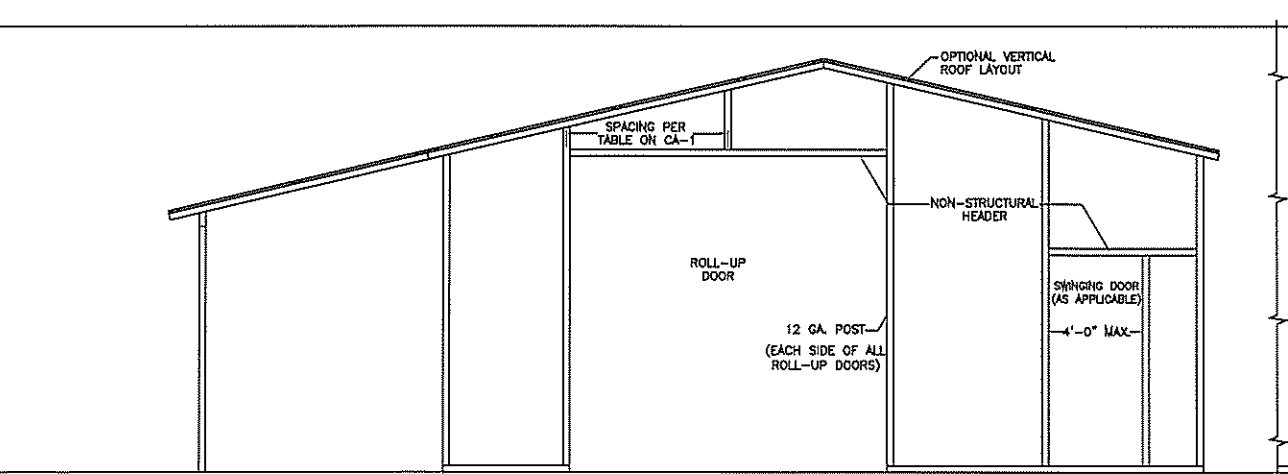

TYPICAL END ELEVATION

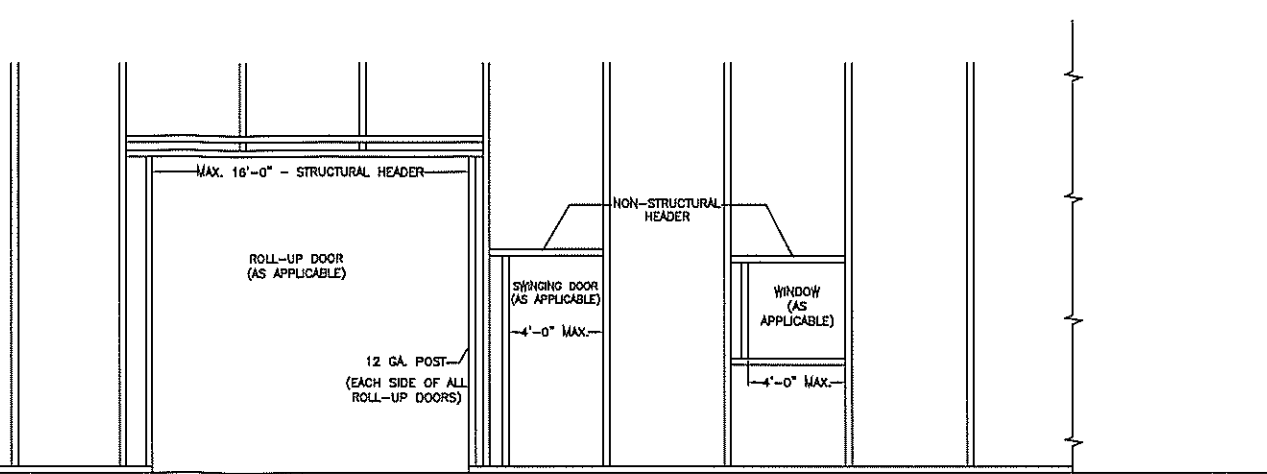

TYPICAL SIDE WALL ELEVATION



CODE INFORMATION	
CODE VERSION	FBC 2020 7th Edition, ASCE-7-16
MANUFACTURER	CARPORTS ANYWHERE
BUILDING TYPE	UTILITY STRUCTURE
CONSTRUCTION TYPE	II-B
RISK CATEGORY	1
FIRE PROTECTION	NONE
FIRE SUPPRESSION SYSTEM	NONE
OCCUPANCY	UTILITY U
BASIC WIND SPEED	V _{ult} 120-180mph
EXPOSURE	B/C
ENCLOSURE	ENCLOSED
INTERNAL PRESSURE COEFFICIENT	+/- 0.18
IMPORTANCE FACTOR	1.0
ROOF DEAD LOAD	10PSF
ROOF LIVE LOAD	20PSF OR 300lb POINT LOAD
FLOOR DEAD LOAD	10PSF
FLOOR LIVE LOAD	50PSF
"R" RATING OF WALLS, FLOOR, ROOF	N/A
MODULES PER BUILDING	1
HURRICANE PROTECTION USAGE	NO
HURRICANE SHELTER USAGE	NO
SQUARE FOOTAGE	

REVISIONS			
REV	DESCRIPTION	DATE	BY

Drawn By:	MTB
Date:	5/27/20
Location:	FLORIDA
Model:	ENCLOSED GENERIC ENGINEERING
GENERAL NOTES	
1. THIS BUILDING IS EXEMPT FROM THE FBC ENERGY CONSERVATION CODE PER SECTION C101.4.2.	
2. ALL STEEL TUBING SHALL BE 50 KSI STEEL.	
3. PLUMBING, ELECTRICAL, INGRESS/EGRESS, PROPERTY SET-BACKS, AND/OR OTHER LOCAL CODE REQUIREMENTS ARE THE RESPONSIBILITY OF THE OWNER.	
4. ROOF AND WALL SHEATHING SECURED WITH #12-14x1" SELF-DRILLING SCREWS WITH SEAL WASHERS @ 6" O.C. MAX.	
5. FIELD FRAMING CONNECTIONS SECURED WITH #12-14x3/4" SELF-DRILLING SCREWS.	
6. ALL SHOP FRAMING CONNECTIONS ARE TO BE WELDED. NO WELDING ON-SITE. ALL WELDING DONE IN SHOP BY A CERTIFIED WELDER.	
7. CONCRETE EXPANSIONS ANCHORS ARE TO BE MINIMUM 1/2"x3", 2,500LB TENSILE STRENGTH.	
8. 12 OR 14GA. FRAMING IS 2.5"x2.5" TUBE STEEL. NIPPLES ARE 2.25"x2.25" TUBE STEEL.	

12/21/20

Matthew T. Baldwin P.E.
Florida License #64608

Sheet: CA-3 OF 3