



254 E 6th Ave
Tallahassee, FL 32303
Monica Bass 850-222-6808 X 2114
FAX 850-575-0454 monica@paulspest.com

DATE: 10/30/2024

NOTICE OF NEW CONSTRUCTION TERMITE TREATMENT

The following home is under contract with Paul's Termite & Pest Control, Inc to protect the home against subterranean and formosan termites with The Sentricon Colony Elimination System. This agreement assures that the installation, maintenance and monitoring of the Sentricon Colony Elimination System is in compliance with chapter 482 of the Florida Statutes.

CONTRACTOR: Chris Mill Homes of Florida

LOCATION: 1847 SE HIGH FALLS RD
LAKE CITY, FL 32025

TYPE OF TREATMENT: SENTRICON COLONY ELIMINATION SYSTEM

TREATMENT TIME: COMPLETION OF CONSTRUCTION

Homeowner/contractor is responsible for notifying Paul's Pest Control when the structure is ready for treatment after final grades complete.



• Engineering
• Geotechnical
Laboratories

Cal-Tech Testing, Inc.

P.O. Box 1625 • Lake City, FL 32056-1625 • Tel(386)755-3633 • Fax(386)752-5456
2907 Spring Glen Road, Jacksonville, FL 32207 • Tel(904)381-8901 • Fax(904)381-8902

JOB NO.: 24-00292-01

REPORT OF IN-PLACE DENSITY TEST

DATE TESTED: 6/18/2024

DATE REPORTED: 6/20/2024

PROJECT:	SW High Falls Rd., Lake City, FL
CLIENT:	North Florida Septic Tank, Inc., 580 NW Guerdon Street, Lake City, FL 32055
GENERAL CONTRACTOR:	North Florida Septic Tank, Inc.
EARTHWORK CONTRACTOR:	North Florida Septic Tank, Inc.
INSPECTOR:	B. Sims
ASTM METHOD	SOIL USE
(D-6938) Nuclear	SUBBASE/STABILIZED SUBGRADE
SPECIFIED REQUIREMENTS: 100%	

TEST NO.	TEST LOCATION	TEST DEPTH	WET DENSITY (lb/ft ³)	MOISTURE PERCENT	DRY DENSITY (lb/ft ³)	PROCTOR TEST NO.	PROCTOR VALUE	% MAXIMUM DENSITY
1	8 ft. from Center of Northeast Corner of Pad	12"	113.2	2.2	110.8	1	105.2	105%
2	Center of Pad	12"	110.4	1.9	108.3	1	105.2	103%
3	7 ft. from Center of Southwest Corner of Pad	12"	112.0	3.5	108.2	1	105.2	103%

REMARKS:

The Above Tests Meet Specified Requirements.


PROCTORS				
PROCTOR NO.	SOIL DESCRIPTION	MAXIMUM DRY UNIT WEIGHT (lb/ft ³)	OPT. MOIST.	TYPE
1	Light Tan Sand [A-3] (Refer to CTI Job No.: 22-00353-01, Sample E002Q)	105.2	13.3	MODIFIED (ASTM D-1557)

Respectfully Submitted,
CAL-TECH TESTING, INC.

Reviewed By:

Date:

Licensed, Florida No: 65550

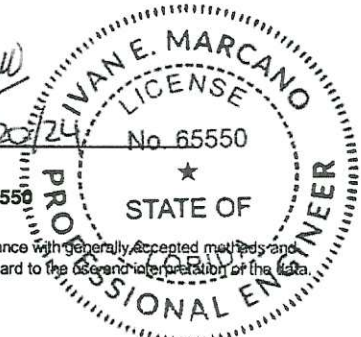

The test results presented in this report are specific only to the samples tested at the time of testing. The tests were performed in accordance with generally accepted methods and standards. Since material conditions can vary between test locations and change with time, sound judgement should be exercised with regard to the use and interpretation of the data. This report shall not be reproduced without prior approval of the author.