



Alpine, an ITW Company
6750 Forum Drive, Suite 305
Orlando, FL 32821
Phone: (800)755-6001
www.alpineitw.com



This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.

Site Information:	Page 1:
Customer: W. B. Howland Company, Inc.	Job Number: 21-5237
Job Description: Fort White Park-Lot 33	
Address: Live Oak, FL	

Job Engineering Criteria:	
Design Code: FBC 7th Ed. 2020 Res	IntelliVIEW Version: 20.01.01A
	JRef #: 1X372150005
Wind Standard: ASCE 7-16 Wind Speed (mph): 130	Design Loading (psf): 40.00
Building Type: Closed	

This package contains general notes pages, 22 truss drawing(s) and 3 detail(s).

Item	Drawing Number	Truss
1	056.21.0802.34911	A1
3	056.21.0802.33973	A11
5	056.21.0802.34035	A13
7	056.21.0802.35207	A15
9	056.21.0802.33927	A3
11	056.21.0802.35098	A5
13	056.21.0802.34848	JC4
15	056.21.0802.34598	JE7
17	056.21.0802.35254	JE8A
19	056.21.0802.34551	PBA1
21	056.21.0802.34566	PBA3
23	A14015ENC160118	
25	PB160160118	

Item	Drawing Number	Truss
2	056.21.0802.34410	A10
4	056.21.0802.34677	A12
6	056.21.0802.34441	A14
8	056.21.0802.35067	A2
10	056.21.0802.34894	A4
12	056.21.0802.34988	JC2
14	056.21.0802.34066	JC6
16	056.21.0802.34832	JE8
18	056.21.0802.34473	JH11
20	056.21.0802.35051	PBA2
22	056.21.0802.34738	PBA4
24	GBLLETIN0118	

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

General Notes (continued)

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

CL = Certified lumber.

Des Ld = total of TCDL, TCCL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.

Max Web CSI = Maximum bending and axial Combined Stress Index for Webs for of all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCCL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 514 Earth City Expressway, Suite 242, Earth City, MO 63045; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpinst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcindustry.com.

2 Complete Trusses Required

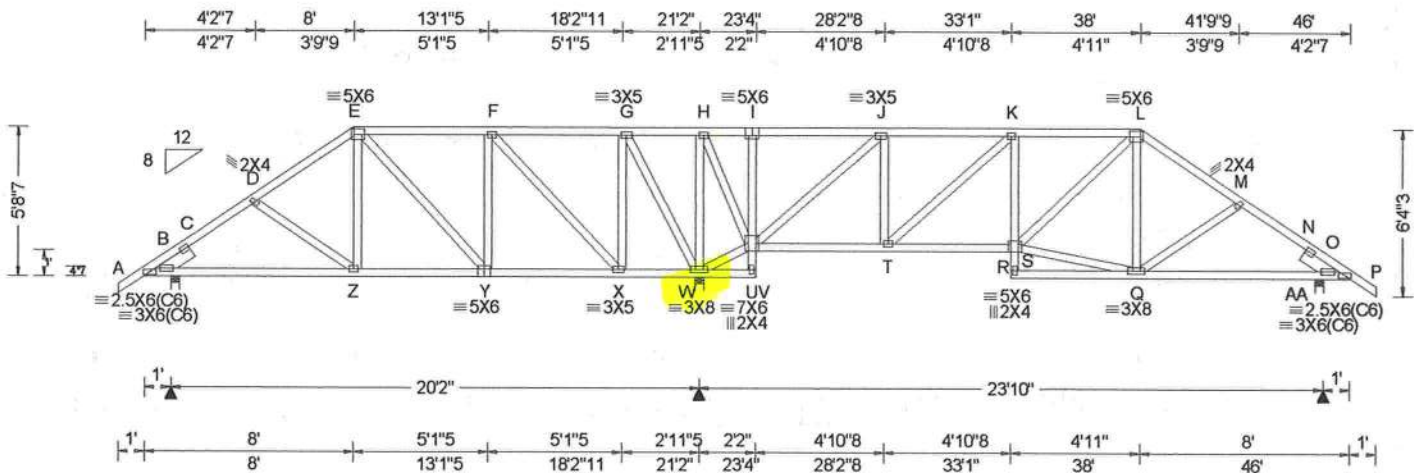

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg, Pf in PSF)		Def/CSI Criteria		Maximum Reactions (lbs)			
TCLL:	20.00	Wind Std:	ASCE 7-16	Pg: NA	Ct: NA	PP Deflection in	loc L/defl L/#	Gravity		Non-Gravity	
TCDL:	10.00	Speed:	130 mph	Pf: NA	Ce: NA	VERT(LL):	0.052 Q 999 240	Loc	R+ / R-	/ Rh	/ Rw / U / RL
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	VERT(CL):	0.109 Q 999 240	B	1086	-/-	-/-
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA	HORZ(LL):	0.044 N - -	W	5349	-/-	-/-
Des Ld:	40.00	EXP: C	Kzt: NA			HORZ(TL):	0.093 N - -	AA	1514	-/-	-/-
NCBCLL:	0.00	Mean Height:	15.00 ft	Building Code:		Creep Factor:	2.0	Wind reactions based on MWFRS			
Soffit:	0.00	TCDL:	5.0 psf	FBC 7th Ed. 2020 Res.		Max TC CSI:	0.907	B	Brg Width = 4.0	Min Req = 1.5	
Load Duration:	1.25	BCDL:	5.0 psf	TPI Std:	2014	Max BC CSI:	0.612	W	Brg Width = 4.0	Min Req = 2.8	
Spacing:	24.0"	MWFRS Parallel Dist:	0 to h/2	Rep Fac:	No	Max Web CSI:	0.696	AA	Brg Width = 4.0	Min Req = 1.5	
		C&C Dist a:	4.60 ft	FT/RT: 20(0)/0(0)				Bearings B, W, & AA are a rigid surface.			
		Loc. from endwall:	not in 6.50 ft	Plate Type(s):				Members not listed have forces less than 375#			
		GCp:	0.18	WAVE		VIEW Ver:	20.01.01A.0724.11	Maximum Top Chord Forces Per Ply (lbs)			
		Wind Duration:	1.25					Chords	Tens.Comp.	Chords	Tens. Comp.

Lumber

Top chord: 2x4 SP #2;
 Bot chord: 2x4 SP #2;
 Webs: 2x4 SP #3;
 Lt Slider: 2x6 SP 2400F-2.0E; block length = 1.500'
 Rt Slider: 2x6 SP 2400F-2.0E; block length = 1.500'

Nailnote

Nail Schedule: 0.131"x3", min. nails
 Top Chord: 1 Row @ 12.00" o.c.
 Bot Chord: 1 Row @ 12.00" o.c.
 Webs: 1 Row @ 4" o.c.
 Use equal spacing between rows and stagger nails in each row to avoid splitting.

Special Loads

(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 64 plf at -1.00 to 64 plf at 8.00
 TC: From 32 plf at 8.00 to 32 plf at 38.00
 TC: From 64 plf at 38.00 to 64 plf at 47.00
 BC: From 20 plf at 0.00 to 20 plf at 8.03
 BC: From 10 plf at 8.03 to 10 plf at 37.97
 BC: From 20 plf at 37.97 to 20 plf at 46.00
 TC: 112 lb Conc. Load at 8.06, 10.06, 12.06, 14.06
 16.06, 18.06, 20.06, 22.06, 33.94, 35.94, 37.94
 TC: 141 lb Conc. Load at 23.94, 25.94, 27.94, 29.94
 31.94
 BC: 453 lb Conc. Load at 8.03, 37.97
 BC: 170 lb Conc. Load at 10.06, 12.06, 14.06, 16.06
 18.06, 20.06, 22.06, 33.94, 35.94
 BC: 148 lb Conc. Load at 23.94, 25.94, 27.94, 29.94
 31.94

Plating Notes

All plates are 3X4 except as noted.

Wind

Wind loads and reactions based on MWFRS.
 Left and right cantilevers are exposed to wind
 Wind loading based on both gable and hip roof types.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 The overall height of this truss, including overhangs, is 5-8.7.



FL REG# 278, Yoonhwak Kim, FL PE #86367
 02/25/2021

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - Z	378 -87	T - R	801 -163
Z - Y	405 -93	Q - O	596 -123
X - W	163 -672		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
B - C	144 -443	W - U	393 -1430
E - Y	54 -379	H - U	675 -138
Y - F	544 -107	U - J	373 -1525
F - X	299 -1046	J - T	736 -151
X - G	971 -265	T - K	217 -742
G - W	401 -1305	R - Q	670 -132
W - H	160 -670	N - O	177 -632

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
 Suite 305
 Orlando FL, 32821

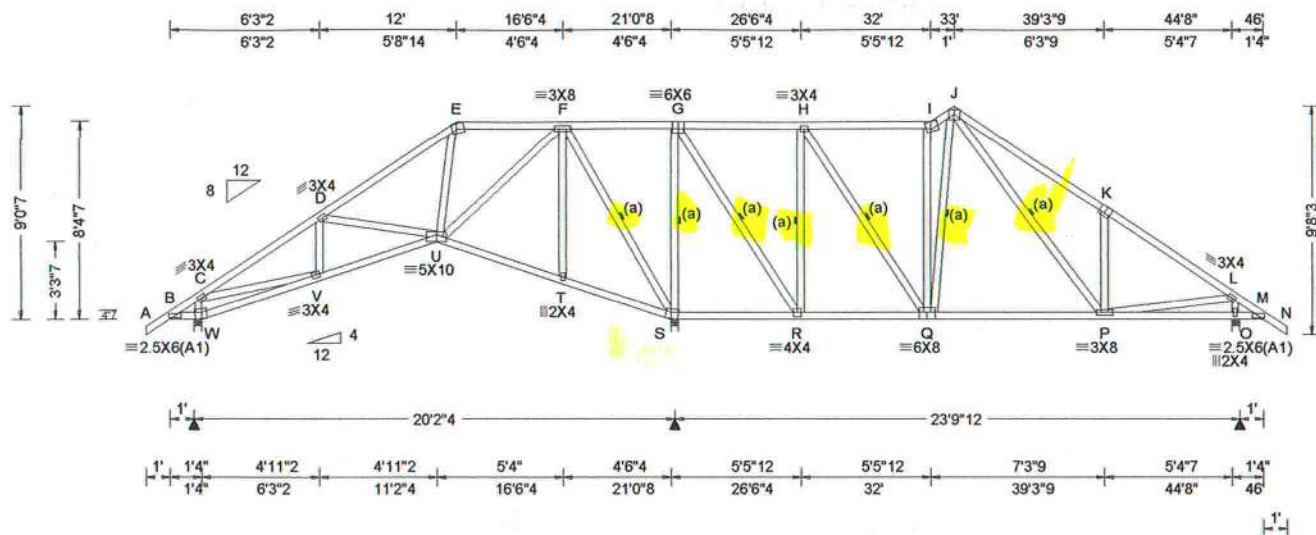

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.60 ft Loc. from endwall: not in 13.00 ft GCp: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.041 I 999 240 VERT(CL): 0.084 I 999 240 HORZ(LL): 0.017 O - - HORZ(TL): 0.036 S - - Creep Factor: 2.0 Max TC CSI: 0.499 Max BC CSI: 0.585 Max Web CSI: 0.816 VIEW Ver: 20.01.01A.0724.11	Gravity Loc R+ / R- / Rh / Rw / U / RL W 753 /- /- /494 /14 /296 S 2629 /- /- /1345 /265 /- O 1117 /- /- /728 /86 /- Wind reactions based on MWFRS W Brg Width = 4.0 Min Req = 1.5 S Brg Width = 3.5 Min Req = 3.1 O Brg Width = 4.0 Min Req = 1.5 Bearings W, S, & O are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.

Plating Notes

All plates are 5X6 except as noted.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.


Left and right cantilevers are exposed to wind

Wind loading based on both gable and hip roof types.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.


The overall height of this truss excluding overhang is 9'-0".

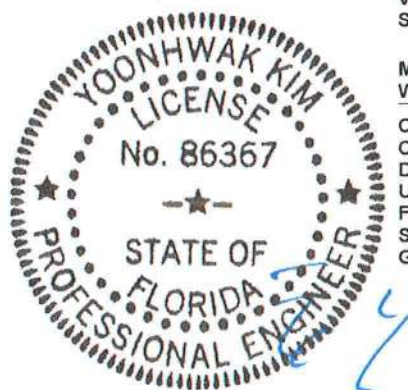

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

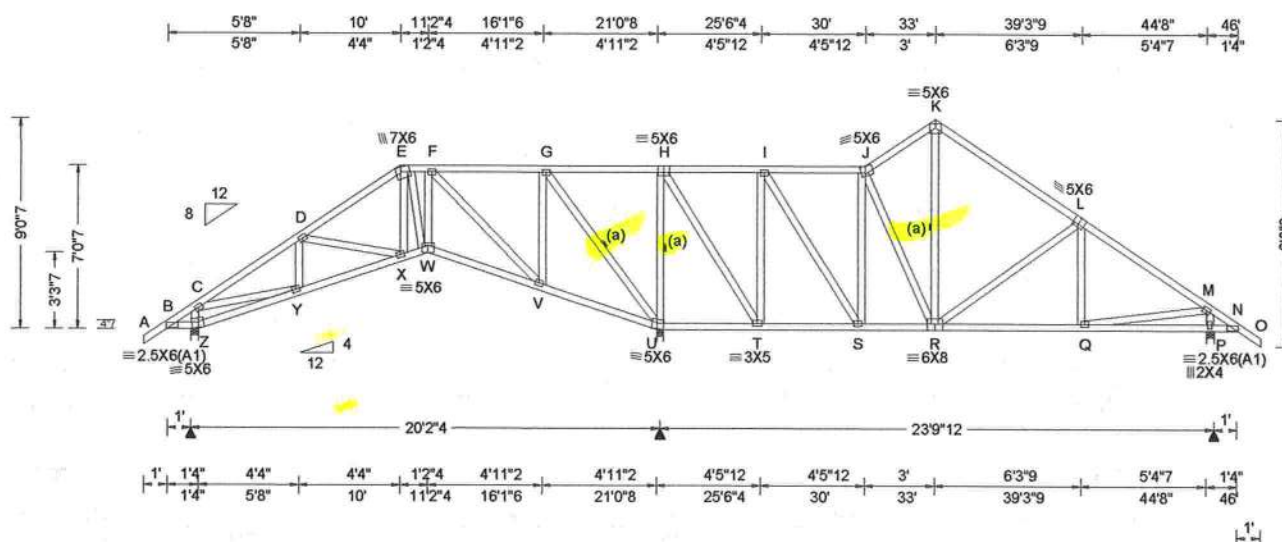

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.60 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.029 X 999 240 VERT(CL): 0.066 X 999 240 HORZ(LL): 0.024 P - - HORZ(TL): 0.054 U - - Creep Factor: 2.0 Max TC CSI: 0.541 Max BC CSI: 0.434 Max Web CSI: 0.828 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL Z 781 -/- /- /493 /13 /296 U 2346 -/- /- /1311 /158 -/- P 1012 -/- /- /714 /49 -/- Wind reactions based on MWFRS Z Brg Width = 4.0 Min Req = 1.5 U Brg Width = 3.5 Min Req = 2.8 P Brg Width = 4.0 Min Req = 1.5 Bearings Z, U, & P are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Plating Notes

All plates are 3X4 except as noted.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left and right cantilevers are exposed to wind

Wind loading based on both gable and hip roof types.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 9'-0".



FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
Y - X	790 -305	U - T	311 -755
X - W	530 -214	S - R	478 -11
W - V	520 -220	R - Q	767 -56

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
C - Z	219 -659	H - T	1190 -336
C - Y	853 -172	T - I	335 -937
W - F	450 -123	I - S	755 -157
F - V	155 -817	S - J	166 -585
V - G	520 -23	R - L	169 -385
G - U	317 -1052	Q - M	712 -130
U - H	482 -1322	M - P	292 -913


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbicaindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

2 Complete Trusses Required

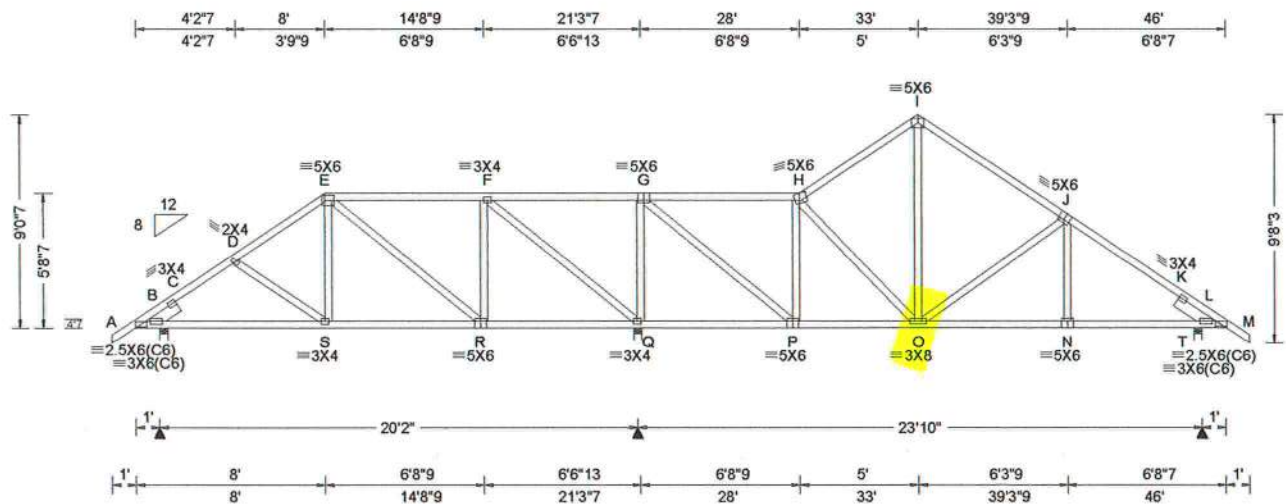

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-16		Pg: NA Ct: NA CAT: NA		PP Deflection in loc L/def L/#		Gravity						
TCDL: 10.00		Speed: 130 mph		Pf: NA Ce: NA		VERT(LL): 0.040 S 999 240		Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
BCLL: 0.00		Enclosure: Closed		Lu: NA Cs: NA		VERT(CL): 0.087 S 999 240		B	1351	-	-	-	/313	-
BCDL: 10.00		Risk Category: II		Snow Duration: NA		HORZ(LL): -0.028 C - -		Q	3705	-	-	-	/886	-
Des Ld: 40.00		EXP: C Kzt: NA		Building Code:		HORZ(TL): 0.062 C - -		T	822	-	-	-	/108	-
NCBCLL: 0.00		Mean Height: 15.00 ft		FBC 7th Ed. 2020 Res.		Creep Factor: 2.0		Wind reactions based on MWFRS						
Soffit: 0.00		TCDL: 5.0 psf		TPI Std: 2014		Max TC CSI: 0.819		B	Brg Width = 4.0			Min Req = 1.5		
Load Duration: 1.25		BCDL: 5.0 psf		Rep Fac: No		Max BC CSI: 0.701		Q	Brg Width = 4.0			Min Req = 1.8		
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		FT/RT:20(0)/0(0)		Max Web CSI: 0.874		T	Brg Width = 4.0			Min Req = 1.5		
		C&C Dist a: 4.60 ft		Plate Type(s):		VIEW Ver: 20.01.01A.0724.11		Bearings B, Q, & T are a rigid surface.						
		Loc. from endwall: not in 13.00 ft		WAVE				Members not listed have forces less than 375#						
		GCpi: 0.18						Maximum Top Chord Forces Per Ply (lbs)						
		Wind Duration: 1.25						Chords Tens.Comp. Chords Tens. Comp.						

Lumber
 Top chord: 2x4 SP #2;
 Bot chord: 2x4 SP #2;
 Webs: 2x4 SP #3;
 Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.500'
 Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.848'

Nailnote
 Nail Schedule: 0.131"x3", min. nails
 Top Chord: 1 Row @12.00" o.c.
 Bot Chord: 1 Row @12.00" o.c.
 Webs : 1 Row @ 4" o.c.
 Use equal spacing between rows and stagger nails in each row to avoid splitting.

Special Loads
 ----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 64 plf at -1.00 to 64 plf at 8.00
 TC: From 32 plf at 8.00 to 32 plf at 21.43
 TC: From 64 plf at 21.43 to 64 plf at 47.00
 BC: From 20 plf at 0.00 to 20 plf at 8.03
 BC: From 10 plf at 8.03 to 10 plf at 20.06
 BC: From 20 plf at 20.06 to 20 plf at 46.00
 TC: 112 lb Conc. Load at 8.06,10.06,12.06,14.06,16.06,18.06
 TC: 200 lb Conc. Load at 20.06
 BC: 453 lb Conc. Load at 8.03
 BC: 170 lb Conc. Load at 10.06,12.06,14.06,16.06,18.06
 BC: 132 lb Conc. Load at 20.06


Wind
 Wind loads and reactions based on MWFRS.
 Left and right cantilevers are exposed to wind
 Wind loading based on both gable and hip roof types.

Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 The overall height of this truss excluding overhang is 9'-0".



FL REG# 278, Yoonhwak Kim, FL PE #86367
 02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

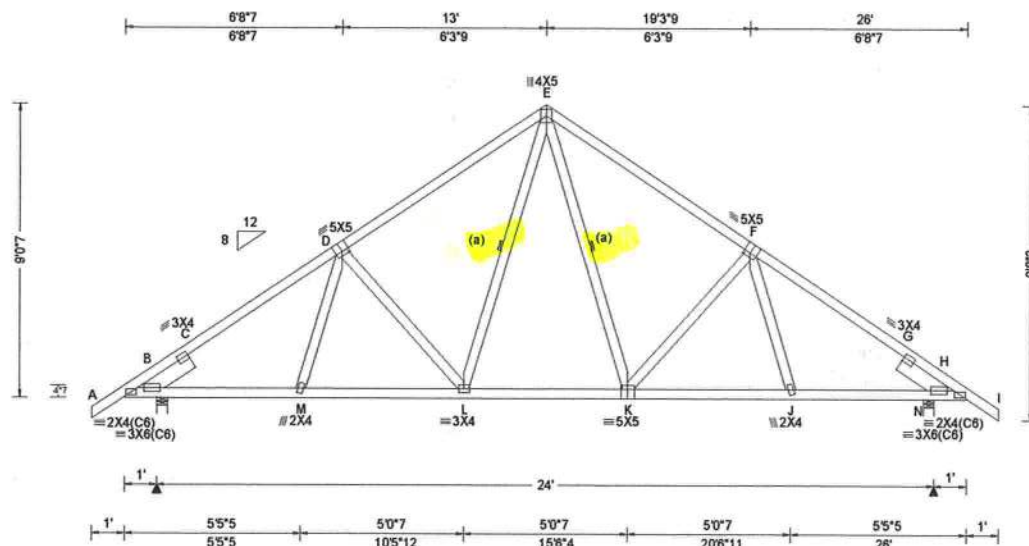

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.090 L 999 240 VERT(CL): 0.177 L 999 240 HORZ(LL): 0.070 G - - HORZ(TL): 0.139 G - - Creep Factor: 2.0 Max TC CSI: 0.801 Max BC CSI: 0.528 Max Web CSI: 0.139 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1213 /- /- /727 /181 /275 N 1213 /- /- /727 /181 /- Wind reactions based on MWFRS B Brg Width = 4.0 Min Req = 1.5 N Brg Width = 4.0 Min Req = 1.5 Bearings B & N are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 0 -621 E - F 411 -1120 C - D 338 -1251 F - G 338 -1251 D - E 411 -1121 G - H 0 -621


Lumber
Top chord: 2x4 SP #2;
Bot chord: 2x4 SP M-31;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.835'
Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.835'

Bracing
(a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.

Loading
Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind
Wind loads based on MWFRS with additional C&C member design.
Left and right cantilevers are exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes
The overall height of this truss excluding overhang is 9'-0-7".

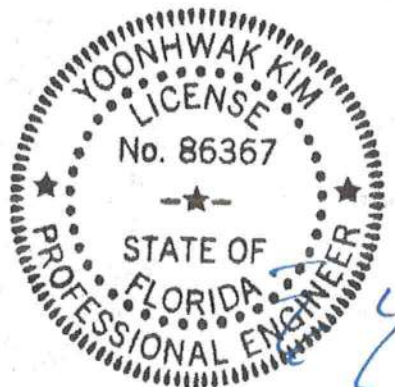


FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 614154 / FROM: CDM	GABL Ply: 1 Qty: 1	Job Number: 21-5237 Fort White Park-Lot 33 Truss Label: A14	Cust: R 215 JRef: 1X372150005 * T5 / DrwNo: 056.21.0802.34441 / YK 02/25/2021
-----------------------------	--------------------------	---	---

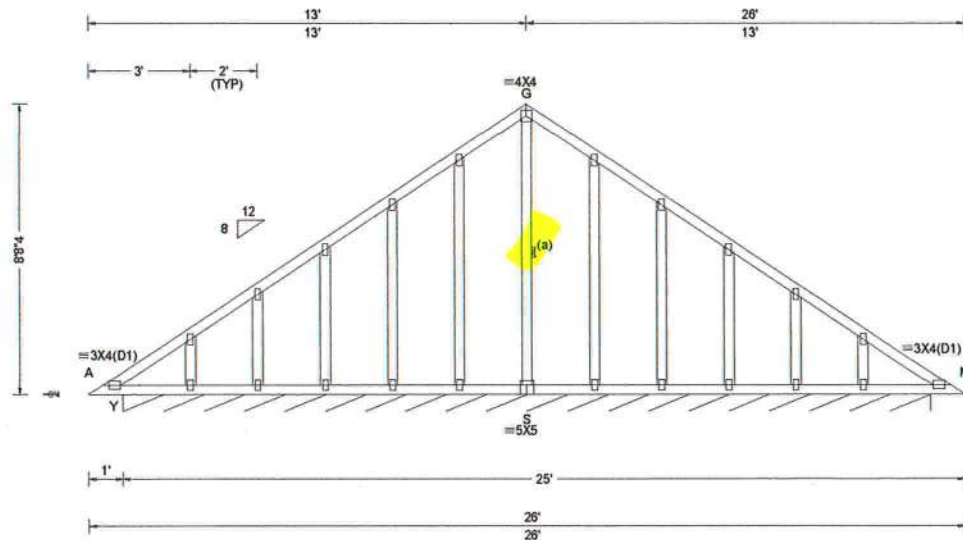

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.005 N 999 240 VERT(CL): 0.011 N 999 240 HORZ(LL): 0.005 I - - HORZ(TL): 0.008 I - - Creep Factor: 2.0 Max TC CSI: 0.144 Max BC CSI: 0.169 Max Web CSI: 0.143 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL Y* 91 /- /- /49 /13 /10 Wind reactions based on MWFRS Y Brg Width = 288 Min Req = - Bearing Y is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.

Plating Notes


All plates are 2X4 except as noted.

Wind

Wind loads based on MWFRS with additional C&C member design.
Left and right cantilevers are exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS A14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.
The overall height of this truss excluding overhang is 8-8-4.

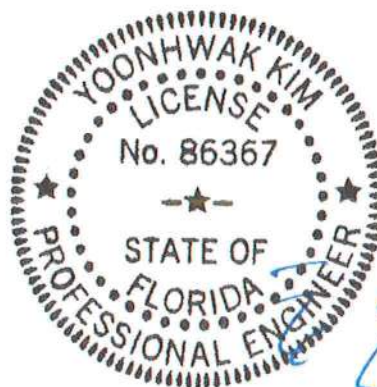

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

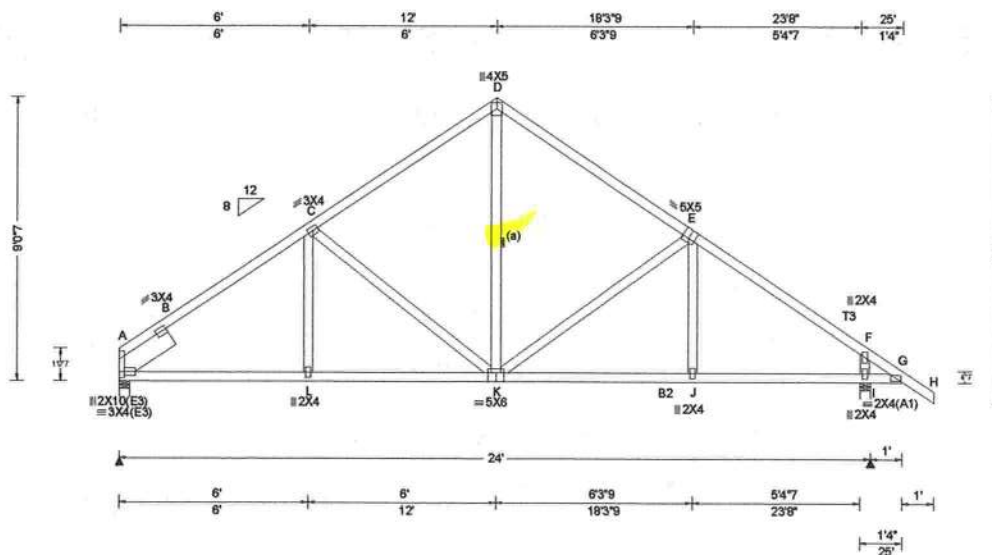


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.084 E 999 240 VERT(CL): 0.175 E 999 240 HORZ(LL): 0.061 F - - HORZ(TL): 0.128 F - - Creep Factor: 2.0 Max TC CSI: 0.525 Max BC CSI: 0.545 Max Web CSI: 0.382 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 998 -/- /- /582 /155 /254 I 1171 -/- /- /734 /184 -/ Wind reactions based on MWFRS A Brg Width = 4.0 Min Req = 1.5 I Brg Width = 4.0 Min Req = 1.5 Bearings A & I are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 232 -1354 D - E 274 -959 B - C 255 -1277 E - F 241 -1249 C - D 279 -957 F - G 103 -986

Lumber
Top chord: 2x4 SP #2; T3 2x4 SP M-31;
Bot chord: 2x4 SP #2; B2 2x4 SP M-31;
Webs: 2x4 SP #3;
Lt Slider: 2x8 SP #2; block length = 1.979'

Bracing
(a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.
Right cantilever is exposed to wind
Wind loading based on both gable and hip roof types.


Additional Notes
The overall height of this truss excluding overhang is 9'-0"-7".

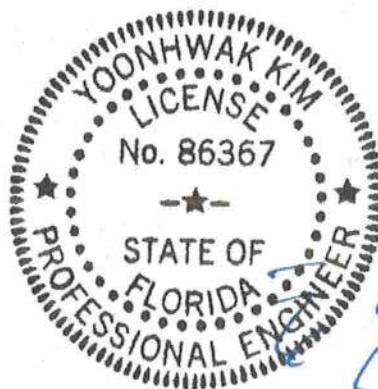

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

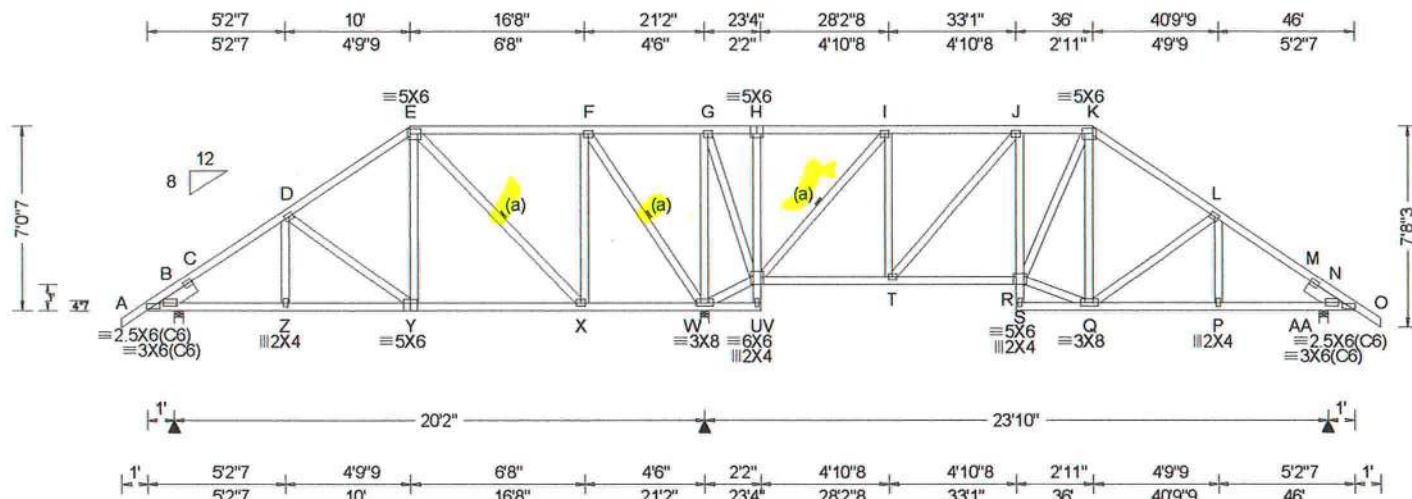

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-16	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	GravityNon-Gravity Loc R+ / R- / Rh / Rw / U / RL
TCDL: 10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.049 L 999 240	B 785 -/- /- /482 /117 /236
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.109 L 999 240	W 2594 -/- /- /1303 /414 -
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.044 M - -	AA 894 -/- /- /625 /152 -
Des Ld: 40.00	EXP: C Kzt: NA		HORZ(TL): 0.096 M - -	
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 0.00	TCDL: 5.0 psf	FBC 7th Ed. 2020 Res.	Max TC CSI: 0.789	B Brg Width = 4.0 Min Req = 1.5
Load Duration: 1.25	BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.823	W Brg Width = 4.0 Min Req = 2.7
Spacing: 24.0 "	MWFRS Parallel Dist: h/2 to h	Rep Fac: Yes	Max Web CSI: 0.724	AA Brg Width = 4.0 Min Req = 1.5
	C&C Dist a: 4.60 ft	FT/RT:20(0)/0(0)		Bearings B, W, & AA are a rigid surface.
	Loc. from endwall: not in 6.50 ft	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE	VIEW Ver: 20.01.01A.0724.11	Maximum Top Chord Forces Per Ply (lbs)
	Wind Duration: 1.25			Chords Tens.Comp. Chords Tens. Comp.

Lumber
 Top chord: 2x4 SP #2;
 Bot chord: 2x4 SP #2;
 Webs: 2x4 SP #3;
 Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.500'
 Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.500'


Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Plating Notes
 All plates are 3X4 except as noted.

Loading
 Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Left and right cantilevers are exposed to wind
 Wind loading based on both gable and hip roof types.


Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 The overall height of this truss excluding overhang is 7-0-7.

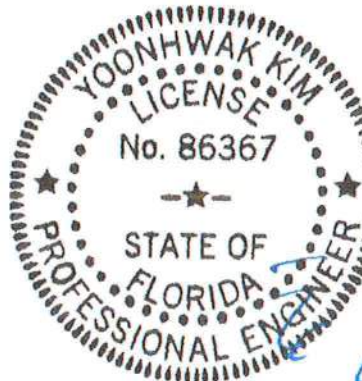

FL REG# 278, Yoonhwak Kim, FL PE #86367
 02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
 AN ITW COMPANY
 6750 Forum Drive
 Suite 305
 Orlando FL, 32821

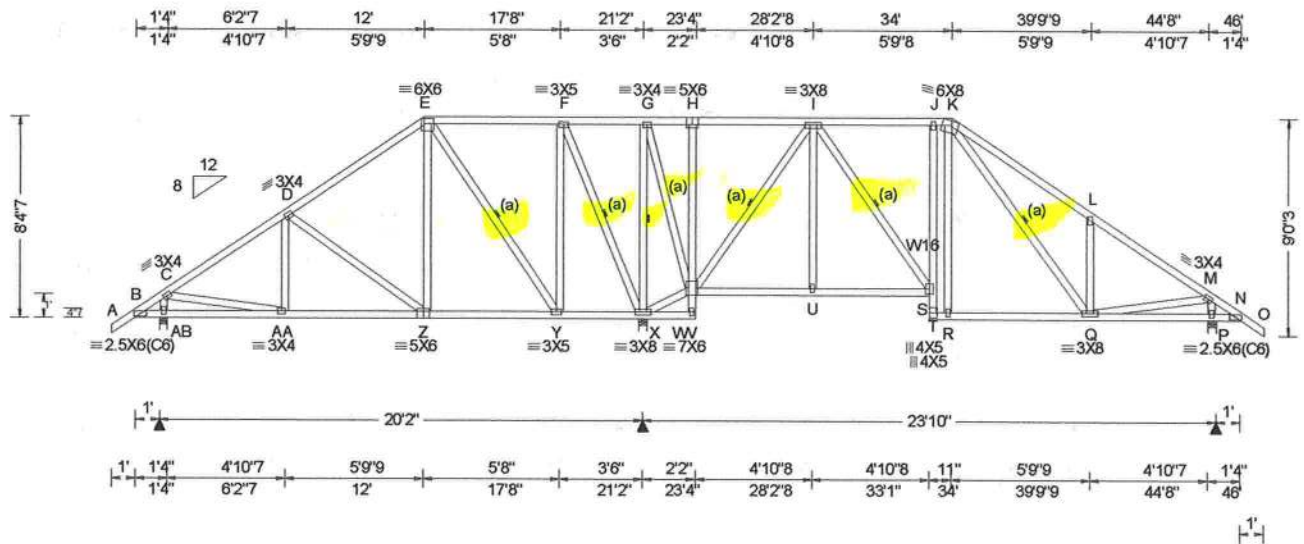

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 4.60 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.084 R 999 240 VERT(CL): 0.163 R 999 240 HORZ(LL): 0.071 Q - - HORZ(TL): 0.136 P - - Creep Factor: 2.0 Max TC CSI: 0.621 Max BC CSI: 0.472 Max Web CSI: 0.886 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL AB 764 /- /- /470 /163 /276 X 2928 /- /- /1364 /322 /- P 897 /- /- /663 /190 /- Wind reactions based on MWFRS AB Brg Width = 4.0 Min Req = 1.5 X Brg Width = 4.0 Min Req = 3.1 P Brg Width = 4.0 Min Req = 1.5 Bearings AB, X, & P are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber
Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3; W16 2x4 SP M-31;

Bracing
(a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.

Plating Notes
All plates are 2X4 except as noted.

Loading
Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind
Wind loads based on MWFRS with additional C&C member design.
Left and right cantilevers are exposed to wind
Wind loading based on both gable and hip roof types.


Additional Notes
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
The overall height of this truss excluding overhang is 8-4-7.



FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCE) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCE: sbceindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

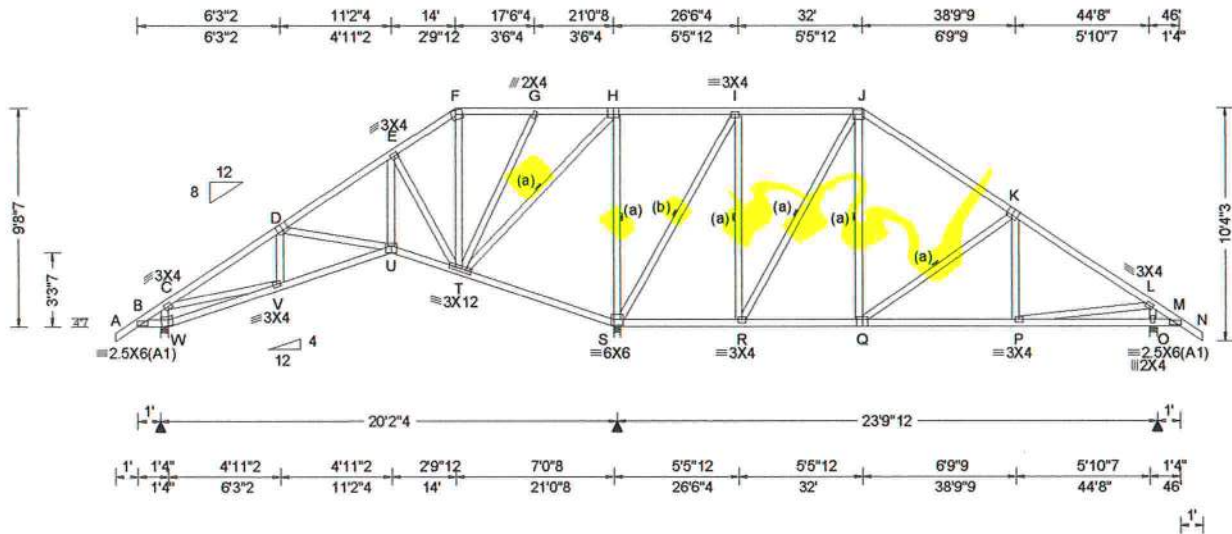

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00	Wind Std: ASCE 7-16	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/def L/#	Gravity			Non-Gravity			
TCDL: 10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.030 Q 999 240	Loc	R+	/R-	/Rh	/Rw	/U	/RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.062 Q 999 240	W	728	-	-	/461	/9	/316
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.024 O - -	S	2604	-	-	/1437	/140	-
	EXP: C Kzt: NA		HORZ(TL): 0.048 O - -	O	1058	-	-	/743	/104	-
Des Ld: 40.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS						
NCBCLL: 10.00	TCDL: 5.0 psf	FBC 7th Ed. 2020 Res.	Max TC CSI: 0.582	W	Brg Width = 4.0			Min Req = 1.5		
Soffit: 0.00	BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.476	S	Brg Width = 3.5			Min Req = 3.1		
Load Duration: 1.25	MWFRS Parallel Dist: h to 2h	Rep Fac: Yes	Max Web CSI: 0.989	O	Brg Width = 4.0			Min Req = 1.5		
Spacing: 24.0 "	C&C Dist a: 4.60 ft	FT/RT:20(0)/0(0)		Bearings W, S, & O are a rigid surface.						
	Loc. from endwall: not in 13.00 ft	Plate Type(s):		Members not listed have forces less than 375#						
	GCpi: 0.18			Maximum Top Chord Forces Per Ply (lbs)						
	Wind Duration: 1.25	WAVE	VIEW Ver: 20.01.01A.0724.11	Chords	Tens.Comp.	Chords	Tens.	Comp.		

Lumber
 Top chord: 2x4 SP #2;
 Bot chord: 2x4 SP #2;
 Webs: 2x4 SP #3;

Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.
 (b) Continuous lateral restraint equally spaced on member. Or 2x4 "T" reinforcement. 80% length of web member. Same species & grade or better, attached with 10d Box or Gun (0.128"x3", min.) nails @ 6" oc.

Plating Notes
 All plates are 5X6 except as noted.

Loading
 Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.


Wind
 Wind loads based on MWFRS with additional C&C member design.
 Left and right cantilevers are exposed to wind
 Wind loading based on both gable and hip roof types.

Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 The overall height of this truss excluding overhang is 9-8-7.



FL REG# 278, Yoonhwak Kim, FL PE #86367
 02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

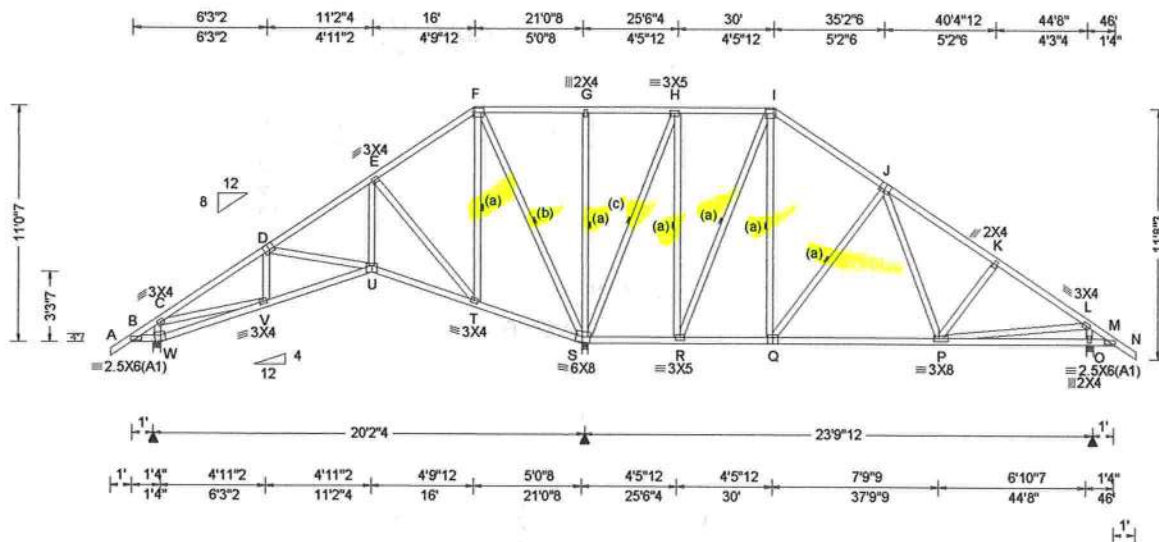

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	Maximum Reactions (lbs)
TCLL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.60 ft Loc: from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.039 Q 999 240 VERT(CL): 0.077 Q 999 240 HORZ(LL): 0.024 L - - HORZ(TL): 0.048 L - - Creep Factor: 2.0 Max TC CSI: 0.563 Max BC CSI: 0.621 Max Web CSI: 0.980 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL W 687 - / - /419 /12 /356 S 2729 - / - /1538 /50 - /- O 1100 - / - /752 /129 - /- Wind reactions based on MWFRS W Brg Width = 4.0 Min Req = 1.5 S Brg Width = 3.5 Min Req = 3.2 O Brg Width = 4.0 Min Req = 1.5 Bearings W, S, & O are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

- (a) Continuous lateral restraint equally spaced on member. Or 1x4 "T" reinforcement. 80% length of web member. Same species & SRB grade or better, attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.
- (b) Continuous lateral restraint equally spaced on member. Or 2x4 "T" reinforcement. 80% length of web member. Same species & grade or better, attached with 10d Box or Gun (0.128"x3", min.) nails @ 6" oc.
- (c) Continuous lateral restraint equally spaced on member. Or 2x6 "T" reinforcement. 80% length of web member. Same species & grade or better, attached with 10d Box or Gun (0.128"x3", min.) nails @ 6" oc.

Plating Notes

All plates are 5X6 except as noted.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.


Left and right cantilevers are exposed to wind

Wind loading based on both gable and hip roof types.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 11'-0".

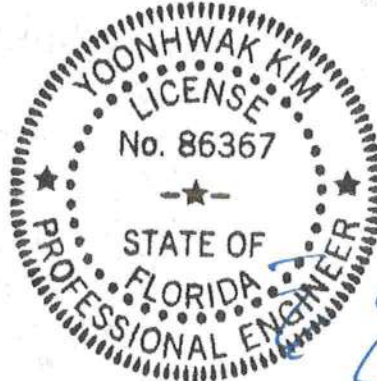

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
W - V	272 -389	R - Q	384 -30
V - U	714 -332	Q - P	683 -50
U - T	426 -280		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
C - W	188 -577	H - R	1015 -83
C - V	637 -58	R - I	131 -921
D - U	174 -389	I - Q	697 -106
U - E	497 -142	Q - J	212 -525
E - T	231 -641	J - P	390 -40
T - F	466 -78	P - L	916 -207
F - S	147 -959	L - O	309 -1002
S - H	318 -1374		

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbicaindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

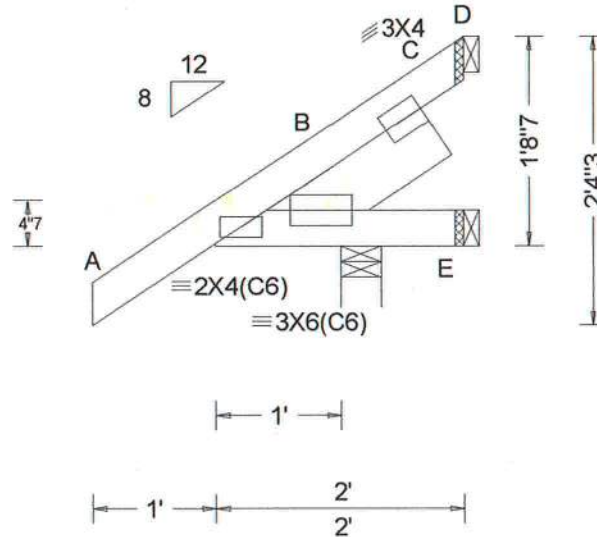

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.005 E 999 240 VERT(CL): 0.011 E 999 240 HORZ(LL): -0.004 C - - HORZ(TL): 0.009 C - - Creep Factor: 2.0 Max TC CSI: 0.175 Max BC CSI: 0.145 Max Web CSI: 0.024 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 394 /- /- /341 /65 /64 E - /-49 /- /21 /47 /- D - /-130 /- /37 /113 /- Wind reactions based on MWFRS B Brg Width = 4.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.500'

Wind

Wind loads based on MWFRS with additional C&C member design.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 1'-8-7.

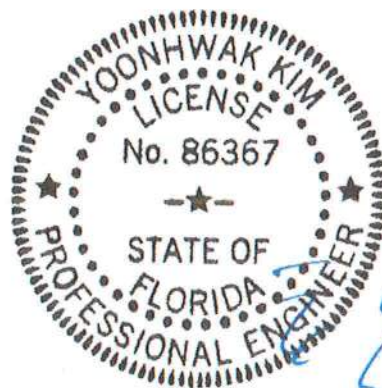

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 614167 / FROM: CDM	JACK Qty: 6	Ply: 1 Qty: 6	Job Number: 21-5237 Fort White Park-Lot 33 Truss Label: JC4	Cust R 215 JRef: 1X372150005 T18 / DrwNo: 056.21.0802.34848 / YK 02/25/2021
-----------------------------	----------------	------------------	---	---

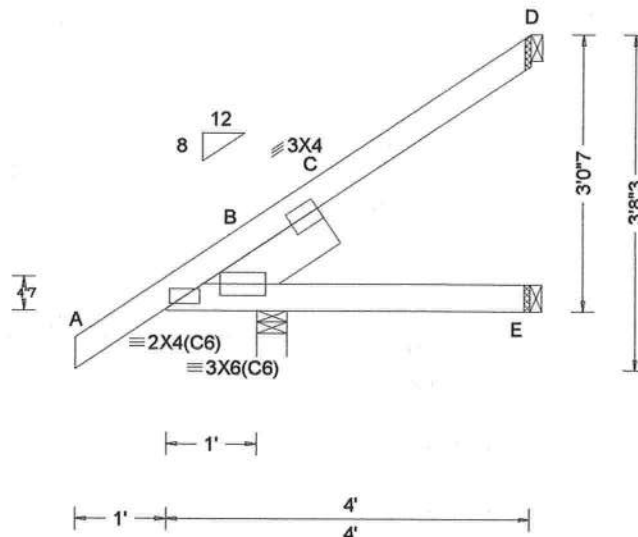

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.009 E 999 240 VERT(CL): 0.023 E 613 240 HORZ(LL): -0.009 C - - HORZ(TL): 0.021 C - - Creep Factor: 2.0 Max TC CSI: 0.192 Max BC CSI: 0.176 Max Web CSI: 0.018 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 339 /- /- /262 /11 /112 E 42 /- /- /31 /3 /- D 69 /- /- /38 /54 /- Wind reactions based on MWFRS B Brg Width = 4.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Lt Slider: 2x6 SP 2400F-2.0E; block length = 1.50'

Wind

Wind loads based on MWFRS with additional C&C member design.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 3-0-7.



FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

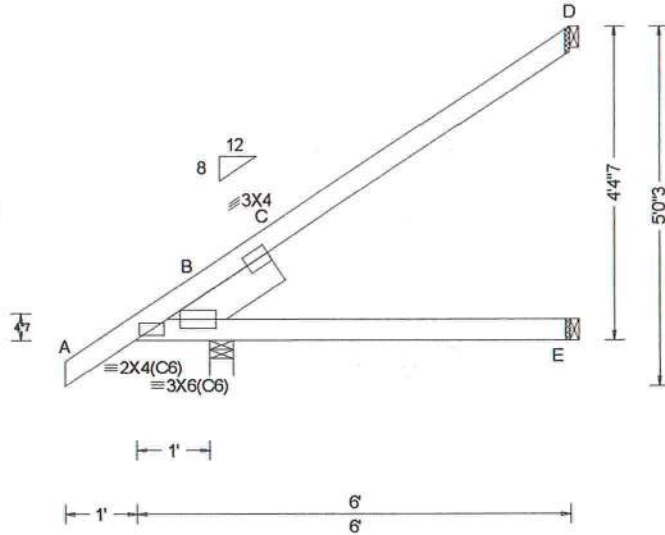


Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)	
TCLL: 20.00		Wind Std: ASCE 7-16		Pg: NA Ct: NA CAT: NA		PP Deflection in loc L/defl L/#		Gravity	
TCDL: 10.00		Speed: 130 mph		Pf: NA Ce: NA		VERT(LL): 0.032 E 431 240		Loc	R+ / R- / Rh
BCLL: 0.00		Enclosure: Closed		Lu: NA Cs: NA		VERT(CL): -0.048 E 999 240		B	399 /- /- /293 /2 /159
BCDL: 10.00		Risk Category: II		Snow Duration: NA		HORZ(LL): -0.035 C - -		E	86 /- /- /52 /- /-
Des Ld: 40.00		EXP: C Kzt: NA				HORZ(TL): 0.052 C - -		D	133 /- /- /92 /88 /-
NCBCLL: 10.00		Mean Height: 15.00 ft		Building Code:		Creep Factor: 2.0		Wind reactions based on MWFRS	
Soffit: 0.00		TCDL: 5.0 psf		FBC 7th Ed. 2020 Res.		Max TC CSI: 0.540		B	Brg Width = 4.0 Min Req = 1.5
Load Duration: 1.25		BCDL: 5.0 psf		TPI Std: 2014		Max BC CSI: 0.493		E	Brg Width = 1.5 Min Req = -
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		Rep Fac: Yes		Max Web CSI: 0.033		D	Brg Width = 1.5 Min Req = -
		C&C Dist a: 3.00 ft		FT/RT:20(0)/0(0)				Bearing B is a rigid surface.	
		Loc. from endwall: not in 4.50 ft		Plate Type(s):				Members not listed have forces less than 375#	
		GCpi: 0.18		WAVE		VIEW Ver: 20.01.01A.0724.11		Maximum Top Chord Forces Per Ply (lbs)	
		Wind Duration: 1.25						Chords Tens.Comp.	

Lumber
Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
LI Slider: 2x6 SP 2400f-2.0E; block length = 1.681'

Wind
Wind loads based on MWFRS with additional C&C member design.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes
The overall height of this truss excluding overhang is 4-4-7.

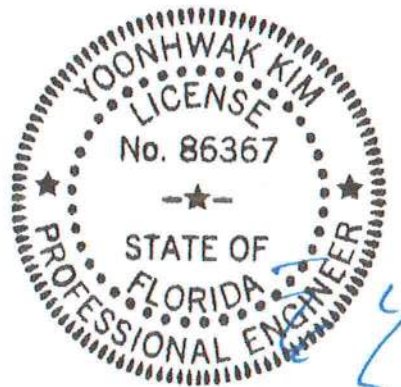


FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 614162 / FROM: CDM	EJAC Qty: 1	Ply: 1 Job Number: 21-5237 Fort White Park-Lot 33 Truss Label: JE7	Cust R 215 JRef: 1X372150005 T6 / DrwNo: 056.21.0802.34598 / YK 02/25/2021
-----------------------------	----------------	---	--

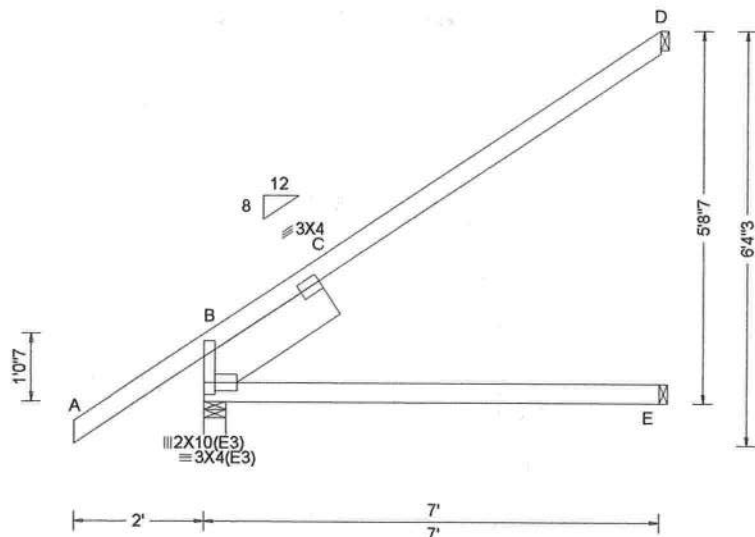

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.097 C - - HORZ(TL): 0.193 C - - Creep Factor: 2.0 Max TC CSI: 0.433 Max BC CSI: 0.543 Max Web CSI: 0.064 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 440 /- /- /310 /- /145 E 132 /- /- /73 /- /- D 200 /- /- /149 /86 /- Wind reactions based on MWFRS B Brg Width = 4.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp.

Lumber

Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP #2;
Lt Slider: 2x8 SP #2; block length = 2.323'

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 5-8-7.



FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

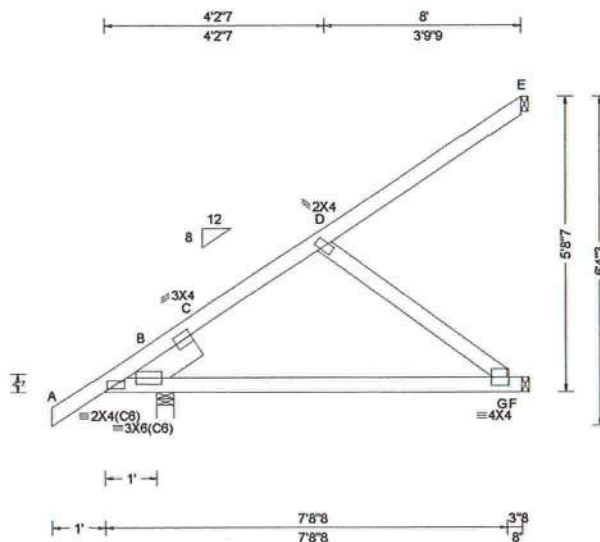

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)			Defl/CSI Criteria		▲ Maximum Reactions (lbs)												
TCLL:	20.00	Wind Std:	ASCE 7-16	Pg:	NA	Ct:	NA	CAT:	NA	Gravity			Non-Gravity								
TCDL:	10.00	Speed:	130 mph	Pf:	NA	Ce:	NA			Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL					
BCLL:	0.00	Enclosure:	Closed	Lu:	NA	Cs:	NA			VERT(LL):	0.011	G	999	240	B	473	/-	/-	/337	/-	/206
BCDL:	10.00	Risk Category:	II	Snow Duration:	NA					VERT(CL):	0.026	G	999	240	F	170	/-	/0	/135	/54	/0
		EXP:	C Kzt: NA							HORZ(LL):	-0.010	C	-	-	E	112	/-	/-	/78	/61	/-
Des Ld:	40.00	Mean Height:	15.00 ft							HORZ(TL):	0.021	C	-	-	Wind reactions based on MWFRS						
NCBCLL:	10.00	TCDL:	5.0 psf	Building Code:						Creep Factor:	2.0				B	Brg Width = 4.0		Min Req = 1.5			
Soffit:	0.00	BCDL:	5.0 psf	FBC 7th Ed. 2020 Res.						Max TC CSI:	0.257				F	Brg Width = 1.5		Min Req = -			
Load Duration:	1.25	MWFRS Parallel Dist:	h/2 to h	TPI Std:	2014					Max BC CSI:	0.451				E	Brg Width = 1.5		Min Req = -			
Spacing:	24.0 "	C&C Dist a:	3.00 ft	Rep Fac:	Yes					Max Web CSI:	0.102				Bearing B is a rigid surface.						
		Loc. from endwall:	not in 9.00 ft	FT/RT:20(0)/0(0)											Members not listed have forces less than 375#						
		GCpi:	0.18	Plate Type(s):																	
		Wind Duration:	1.25	WAVE																	
															VIEW Ver: 20.01.01A.0724.11						

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP 2400F-2.0E; block length = 1.50'

Wind

Wind loads based on MWFRS with additional C&C member design.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 5-8-7.

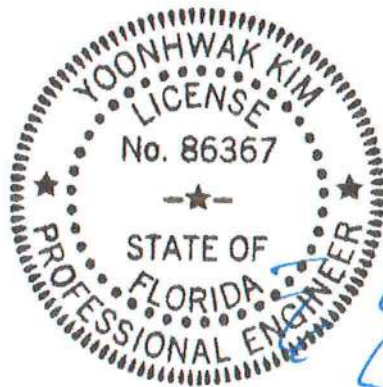

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 614156 / FROM: CDM	EJAC Qty: 5	Ply: 1	Job Number: 21-5237 Fort White Park-Lot 33 Truss Label: JE8A	Cust R 215 JRef: 1X372150005 T10 / DrwNo: 056.21.0802.35254 / YK 02/25/2021
-----------------------------	----------------	--------	--	---

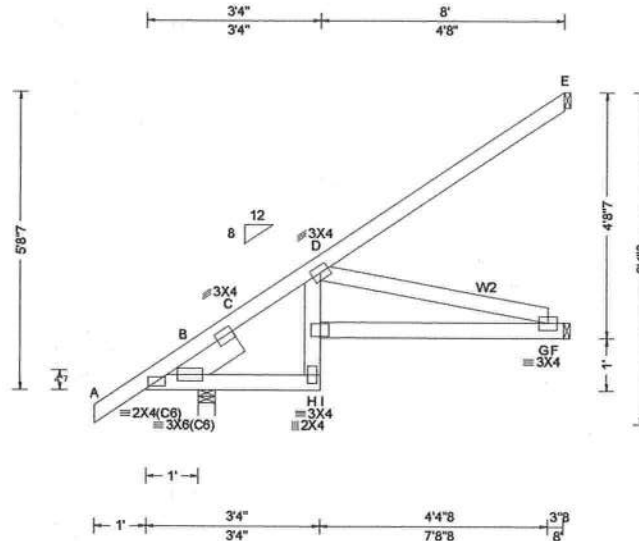

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.025 H 999 240 VERT(CL): 0.053 H 999 240 HORZ(LL): 0.017 G - - HORZ(TL): 0.041 G - - Creep Factor: 2.0 Max TC CSI: 0.420 Max BC CSI: 0.345 Max Web CSI: 0.676 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 473 /- /- /337 /- /149 F 148 /- /0 /111 /15 /0 E 141 /- /- /103 /51 /- Wind reactions based on MWFRS B Brg Width = 4.0 Min Req = 1.5 F Brg Width = 1.5 Min Req = - E Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375# Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp.

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #2; W2 2x4 SP #3;
Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.500'

Wind

Wind loads based on MWFRS with additional C&C member design.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 5-8-7.

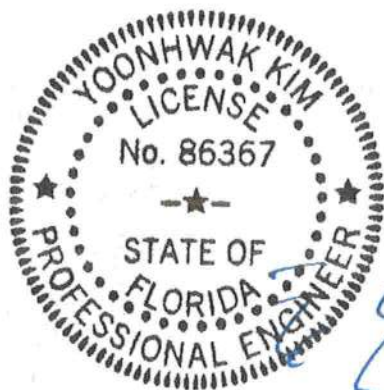


FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 614178 / FROM: CDM	HIP_ Ply: 1 Qty: 3	Job Number: 21-5237 Fort White Park-Lot 33 Truss Label: JH11	Cust R 215 JRef: 1X372150005 T7 / DrwNo: 056.21.0802.34473 / YK 02/25/2021
-----------------------------	-----------------------	--	--

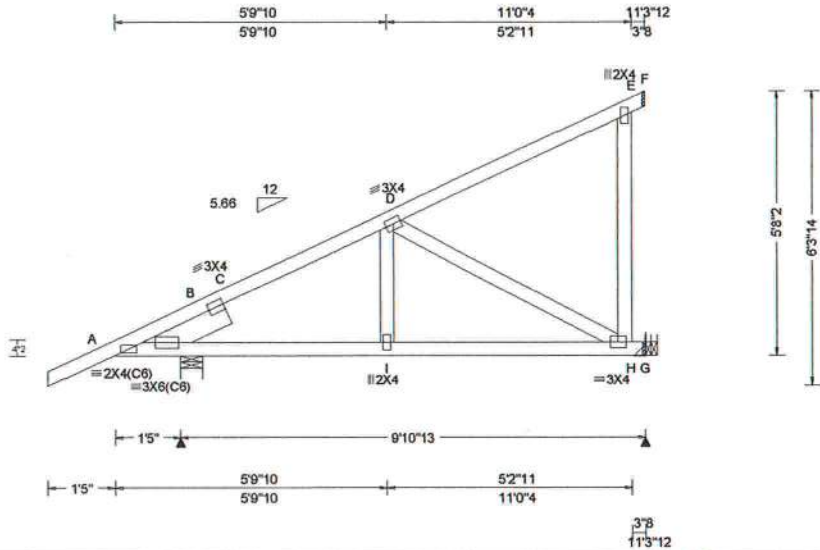

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.021 I 961 240 VERT(CL): 0.067 I 296 240 HORZ(LL): -0.014 C - - HORZ(TL): 0.046 C - - Creep Factor: 2.0 Max TC CSI: 0.368 Max BC CSI: 0.444 Max Web CSI: 0.176 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 450 /- /- /- /8 /- G 284 /- /- /13 /- /- Wind reactions based on MWFRS B Brg Width = 5.7 Min Req = 1.5 G Brg Width = - Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.945'

Wind

Wind loads and reactions based on MWFRS.
Left cantilever is exposed to wind
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 5'-8-2.

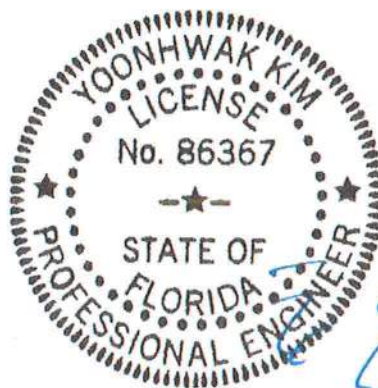

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

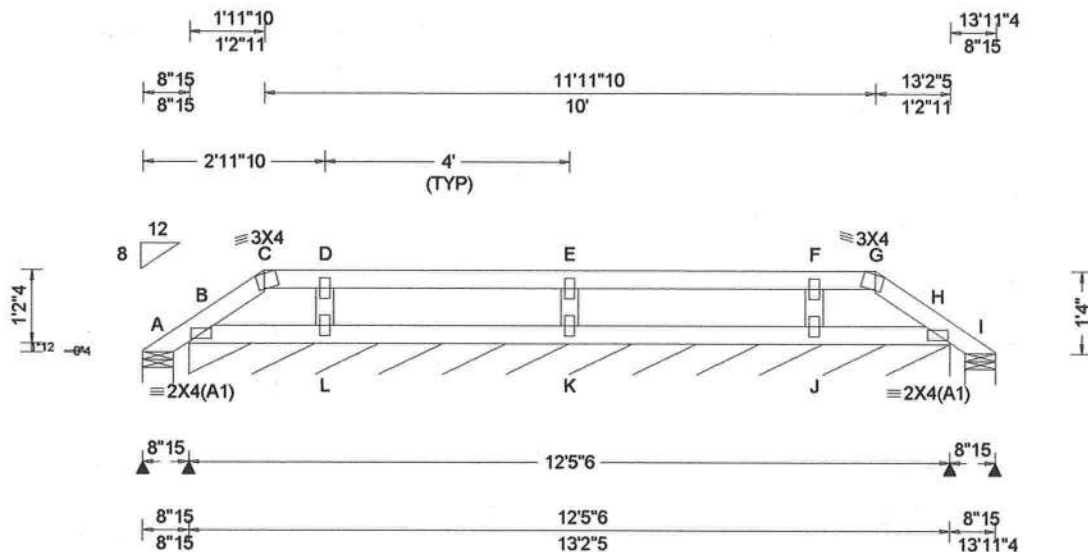

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	Maximum Reactions (lbs), or *PLF
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 19.80 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): -0.001 C 999 240 VERT(CL): -0.002 C 999 240 HORZ(LL): 0.000 J - - HORZ(TL): 0.001 C - - Creep Factor: 2.0 Max TC CSI: 0.340 Max BC CSI: 0.150 Max Web CSI: 0.148 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 18 /- /- /25 /21 /33 B* 87 /- /- /45 /18 /- I 18 /- /- /7 /8 /- L /-258 K /-344 J /-257 Wind reactions based on MWFRS A Brg Width = 5.9 Min Req = 1.5 B Brg Width = 149 Min Req = - I Brg Width = 5.9 Min Req = 1.5 Bearings A, B, & I are a rigid surface. Members not listed have forces less than 375# Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. E - K 388 -275

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 1-4-0.



FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcinstry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

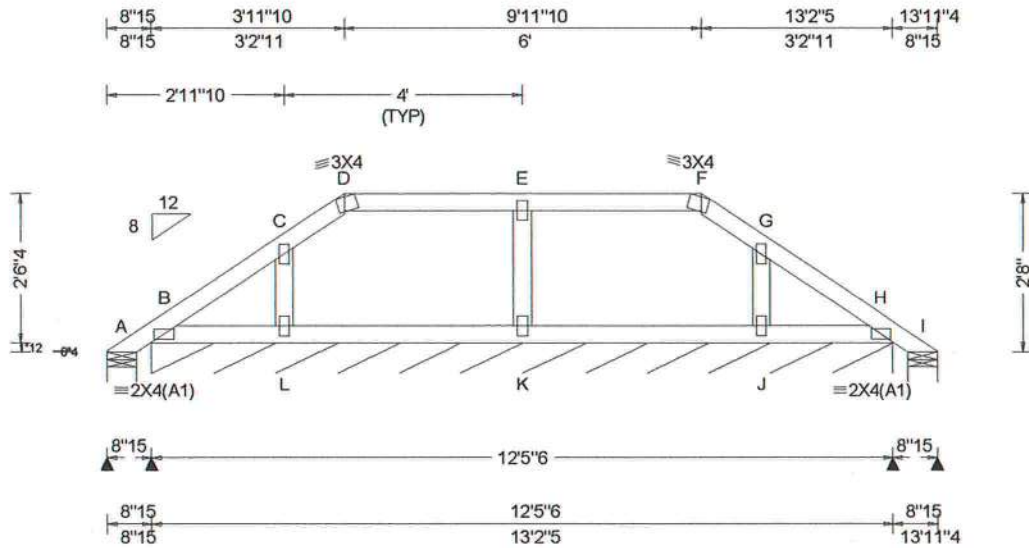

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 20.47 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.004 D 999 240 VERT(CL): 0.012 D 999 240 HORZ(LL): 0.002 D - - HORZ(TL): 0.007 D - - Creep Factor: 2.0 Max TC CSI: 0.238 Max BC CSI: 0.160 Max Web CSI: 0.123 VIEW Ver: 20.01.01A.0724.11	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 21 /- /- /45 /38 /72 B* 86 /- /- /48 /12 /- I 21 /- /- /7 /4 /- B /-134 K /-280 H /-122 Wind reactions based on MWFRS A Brg Width = 5.9 Min Req = 1.5 B Brg Width = 149 Min Req = - I Brg Width = 5.9 Min Req = 1.5 Bearings A, B, & I are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 2-8-0.

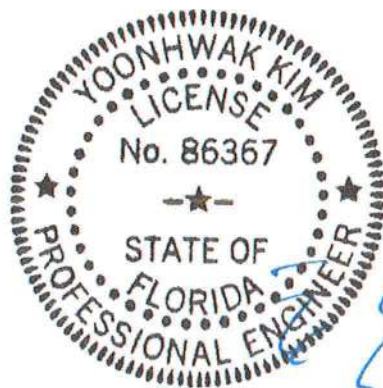

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

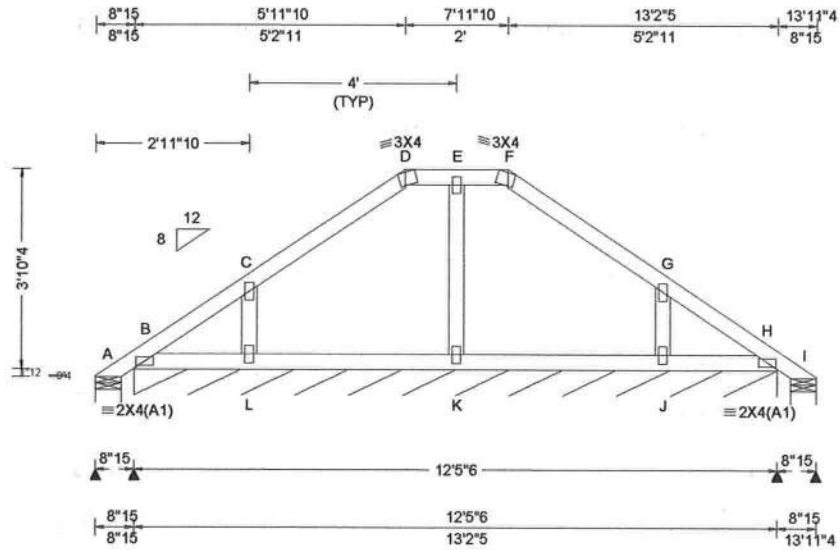

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 21.13 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.005 D 999 240 VERT(CL): 0.016 D 999 240 HORZ(LL): 0.004 F - - HORZ(TL): 0.009 D - - Creep Factor: 2.0 Max TC CSI: 0.168 Max BC CSI: 0.160 Max Web CSI: 0.067 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 26 /- /- /65 /56 /111 B* 85 /- /- /50 /6 /- I 26 /- /- /13 /4 /- L /-140 J /-140 Wind reactions based on MWFRS A Brg Width = 5.9 Min Req = 1.5 B Brg Width = 149 Min Req = - I Brg Width = 5.9 Min Req = 1.5 Bearings A, B, & I are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 4'-0".

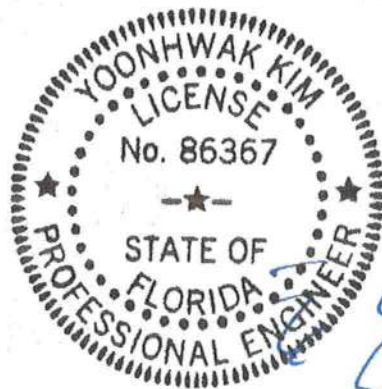

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

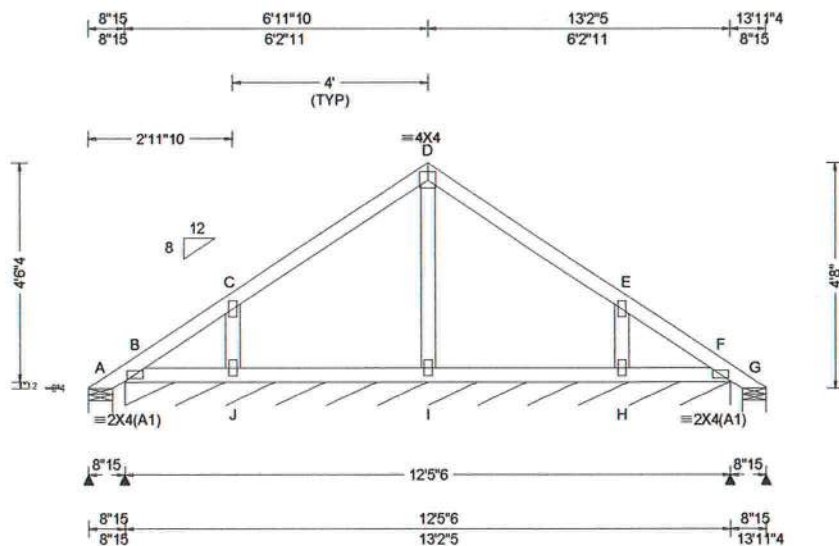

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg, Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 0.00 Load Duration: 1.25 Spacing: 24.0"	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 21.47 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.25	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 D 999 240 VERT(CL): 0.001 D 999 240 HORZ(LL): 0.001 E - - HORZ(TL): 0.002 E - - Creep Factor: 2.0 Max TC CSI: 0.240 Max BC CSI: 0.151 Max Web CSI: 0.087 VIEW Ver: 20.01.01A.0724.11	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 29 /- /- /79 /69 /130 B* 85 /- /- /51 /5 /- G 29 /- /- /16 /8 /- J /-189 H /-189 Wind reactions based on MWFRS A Brg Width = 5.9 Min Req = 1.5 B Brg Width = 149 Min Req = - G Brg Width = 5.9 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 4-8-0.

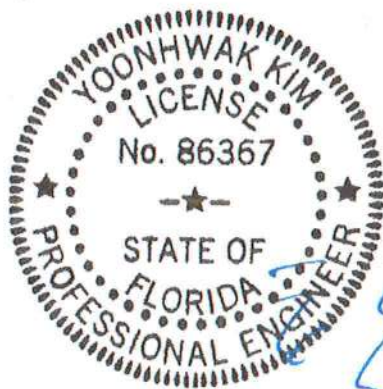

FL REG# 278, Yoonhwak Kim, FL PE #86367
02/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

Gable Stud Reinforcement Detail

Dr	120 mph	Wind Speed, 15'	Mean Height, Enclosed, Exposure D, Kzt = 1.000
Dr	100 mph	Wind Speed, 15'	Mean Height, Enclosed, Exposure D, Kzt = 1.000

Max Gable Vertical Length															
Spacing	2x4 Gable Vertical Species	Brace	No Braces	(1) 1x4 1" Brace				(2) 2x4 1" Brace				(3) 2x6 1" Brace			
				Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B		
24" o.c.	SPF	#1 / #2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"	
		#3	4' 1"	6' 7"	7' 1"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"		
		Standard	4' 1"	5' 8"	6' 0"	7' 7"	8' 1"	10' 1"	10' 6"	11' 10"	12' 8"	14' 0"	14' 0"		
	HF	#1	4' 6"	7' 4"	7' 8"	8' 8"	9' 0"	10' 4"	10' 9"	13' 8"	14' 0"	14' 0"	14' 0"		
		#2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"		
		#3	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"		
	SP	Standard	4' 0"	5' 3"	5' 7"	7' 0"	7' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"		
		#1 / #2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"		
		#3	4' 8"	8' 1"	8' 6"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
	DFL	Standard	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
		#1	5' 1"	8' 5"	8' 9"	9' 11"	10' 4"	11' 10"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"		
		#2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"		
16" o.c.	SPF	#3	4' 8"	7' 1"	8' 6"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
		Standard	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
		#1	5' 1"	8' 5"	8' 9"	9' 11"	10' 4"	11' 10"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"		
	SP	#2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"		
		#3	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
		Standard	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
	DFL	Standard	4' 8"	6' 5"	6' 10"	8' 7"	9' 2"	11' 7"	12' 1"	13' 6"	14' 0"	14' 0"	14' 0"		
		#1 / #2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"		
		#3	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"		
	12" o.c.	SPF	Standard	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"	
			#1	5' 8"	9' 3"	9' 8"	10' 11"	11' 4"	13' 0"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"	
			#2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"	
SP		Standard	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"		
		#1	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"		
		#2	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"		
DFL		Standard	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"		
		#1	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"		
		#2	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"		

Bracing Group Species and Grades:

Group A:	
Service-Pine-Fir	Hem-Fir
#1 / #2 Standard	#2 Stud
#3 Stud	#3 Standard

Douglas Fir-Larch	
#3	
Stud	
Standard	

Southern Pine/ma	
#3	
Stud	
Standard	

Group B1	
Hand-Fin #1 & 3rd #1	Douglas Fir-Larch #1 #2
Southern Pine #1 #2	

1x4 Braces shall be SFD (Stress-Rated Board) or 1x4 So. Pine use only Industrial SS or Industrial 4S Stress-Rated Boards. Group 1 values may be used with these grades.

Gable Truss Detail Notes:

Provide uplift connections for 55 plf over continuous bearing (5 psf TC Dead Load, Gable end supports load from 4' 0" outcrookers with 2' 0" overhang, or 12" plywood overhang

Attach 1st broccers with 10d (0.028x3.0⁰ mm) nails.

* For 4d 1st broccer space nails at 2' o.c.

* In 18" and zones and 4' o.c. between zones.

* For 6d 1st broccer space nails at 3' o.c.


* In 18" and zones and 6' o.c. between zones.

1st bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes	
Vertical Length	No Splice
Less than 4' 0"	1x4 or 2x3
Greater than 4' 0"	3x4

+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for condition not addressed by this detail.

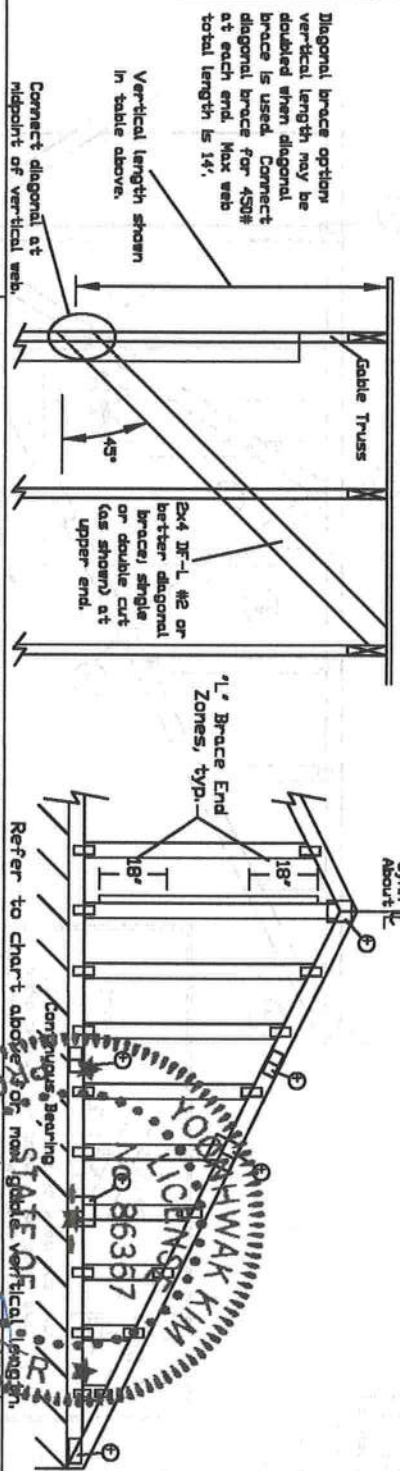

IMPORTANT! READ AND FOLLOW ALL NOTES ON THIS INVADING
IMPORTANT! FOLLOW THE INSTRUCTIONS OF THE INSTALLER.

These general instructions are for fabricating, handling, shipping, installation, and handling. Refer to and follow the latest edition of ASCE (American Society of Civil Engineers), by the Institute of Steel Decking (ISD) and the American Institute of Steel Construction (AISC) for the latest specifications and standards. The manufacturer's instructions for the use of the product shall have been installed per ASCE sections 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, or 38, as applicable. Apply patches to each piece of truss and position as shown above and on the next details, unless noted otherwise.



ALPINE
AN IBM COMPANY

514 Earth City Expressway
Suite 242
Earth City, MO 63045

For more information see this job's general notes page and these web sites: www.alpined.com TPI www.tophist.com ECHA www.echa.europa.eu ICD www.icd.com # 278, Yoonhwak Kim, FL PE #86367


MAX. SPACING 24.0'

Professional Engineer Seal for the State of Florida, License No. 86367, for YOUNG KIM.

REF	ASCE7-16-GABI401
DATE	01/26/2018
DRWG	A14015ENC16011

MAX. TOT. L.D. 60 PSI

Gable Detail For Let-in Verticals

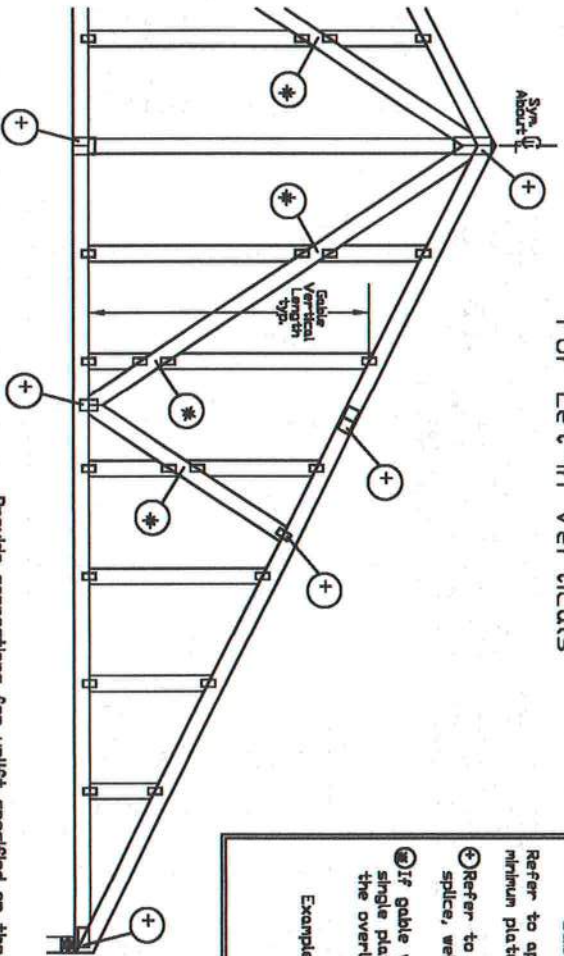

Gable Truss Plate Sizes

Refer to appropriate Alpine gable detail for minimum plate sizes for vertical studs.

⊕ Refer to Engineered truss design for peak, splice, web, and heel plates.

⊗ If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.

Example:



Provide connections for uplift specified on the engineered truss design.

Attach each 1" reinforcing member with
End Driven Nails:
10d Common (0.148"x3", min) Nails at 4" o.c. plus
(4) nails in the top and bottom chords.

Toenailed Nails:
10d Common (0.148"x3", min) Toenails at 4" o.c. plus
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE
wind load.

ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014,
A13030051014, A12030051014, A11030051014, A1030051014, A14030051014

ASCE 7-10 & ASCE 7-15 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A15015ENC100118,
A18015ENC100118, A20015ENC100118, A22015ENC100118, A24015ENC100118,
A1130ENC100118, A12030ENC100118, A14030ENC100118, A16030ENC100118,
A18030ENC100118, A20030ENC100118, A22030ENC100118, A24030ENC100118,
S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118,
S18015ENC100118, S20015ENC100118, S22015ENC100118, S24015ENC100118,
S1130ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118,
S18030ENC100118, S20030ENC100118, S22030ENC100118, S24030ENC100118

See appropriate Alpine gable detail for maximum unreinforced gable vertical length

IMPORTANT NOTES TO BE ADHERED TO BY ALL CONTRACTORS INCLUDING THE INSTALLER.

Thermal break systems shall be installed in accordance with the manufacturer's instructions. Refer to and follow the local building code for details. The installer shall provide temporary bracing per ASCE 7-10 and ASCE 7-15 for safety. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs of truss and position as shown above and on the joint details, unless noted otherwise. Refer to drawings 100-2 for standard plate positions.

Alpine, a division of TV Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in accordance with ASCE 7-10, or for handling, shipping, or installation of the truss.

A seal on this drawing or cover the design page. The sealability and use of this drawing engineering responsibility solely for the design engineer. The sealability and use of this drawing for any structure is the responsibility of the building designer per ASCE 7-10 & 7-15.

514 Earth City Expressway
Suite 242
Earth City, MO 63045



02/24/2018 2:18 PM
Yoonhak Kim, FL PE #86367

To convert from 1" to 1" reinforcing members, multiply 1" increase by length based on appropriate Alpine gable detail.

Maximum allowable 1" reinforced gable vertical length is 14' from top to bottom chord.

1" reinforcing member material must match size, specie, and grade of the 1" reinforcing member.

Web Length Increase w/ 1" Brace

1" Reinf. Mem. Size	1" Increase
2x4	30 %
2x6	20 %

Example:

ASCE 7-10 Wind Speed = 120 mph

Mean Roof Height = 30 ft, Kzt = 1.00


Gable Vertical = 24' o.c. SP #3

1" Reinforcing Member Size = 2x4

1" Brace Increase (from Above) = 30% = 1.30

(1) 2x4 1" Brace Length = 8' 7"

Maximum 1" Reinforced Gable Vertical Length 130 x 8' 7" = 11' 2"

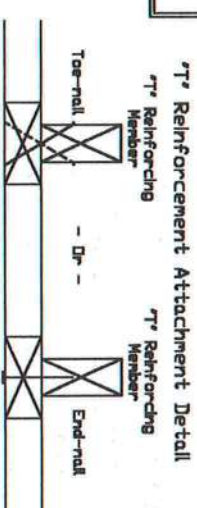

REF	LET-IN VERT
DATE	01/02/2018
DRWG	GBLETTIN0118

MAX. TOT. LD.	60 PSF
DUR. FAC.	ANY
MAX. SPACING	24.0"

Piggyback Detail - ASCE 7-16: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kzt=1.00


160 mph Wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg, located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0, Dr 140 mph wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg, located anywhere in roof, Exp D, Wind DL= 5.0 psf (min), Kzt=1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

See Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

Detail A : Purlin Spacing = 24" o.c. or less

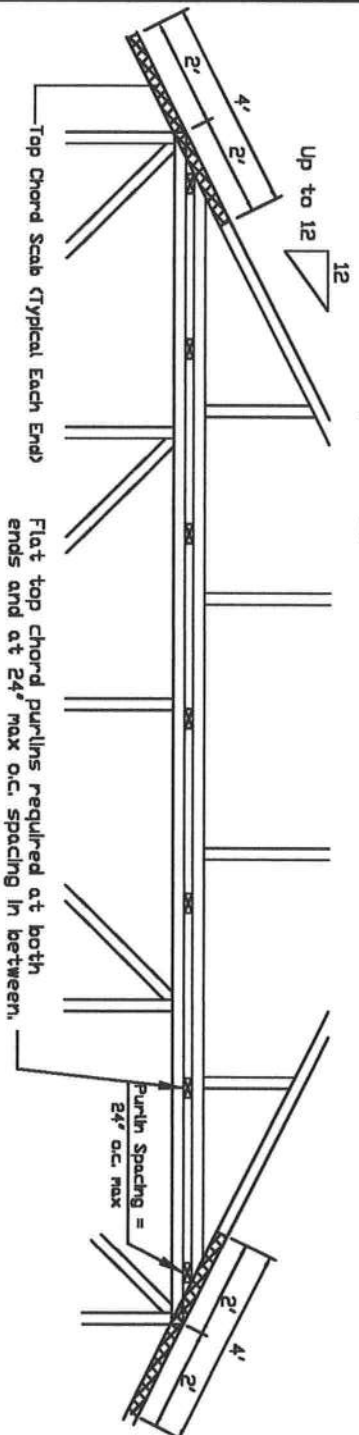


Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0.135"x3.5").

The top chord #3 grade 2x4 scab may be replaced with either of the following (1) 3X8 Trulox plate attached with (8) 0.120"x1.375" nails, (4) into cap TC & (4) into base truss TC or (1) 2BPG wave piggyback plate attached to the piggyback truss TC and attached to the base truss TC with (4) 0.120"x1.375" nails. Note: Nailing thru holes of wave plate is acceptable.

Detail B : Purlin Spacing > 24" o.c.

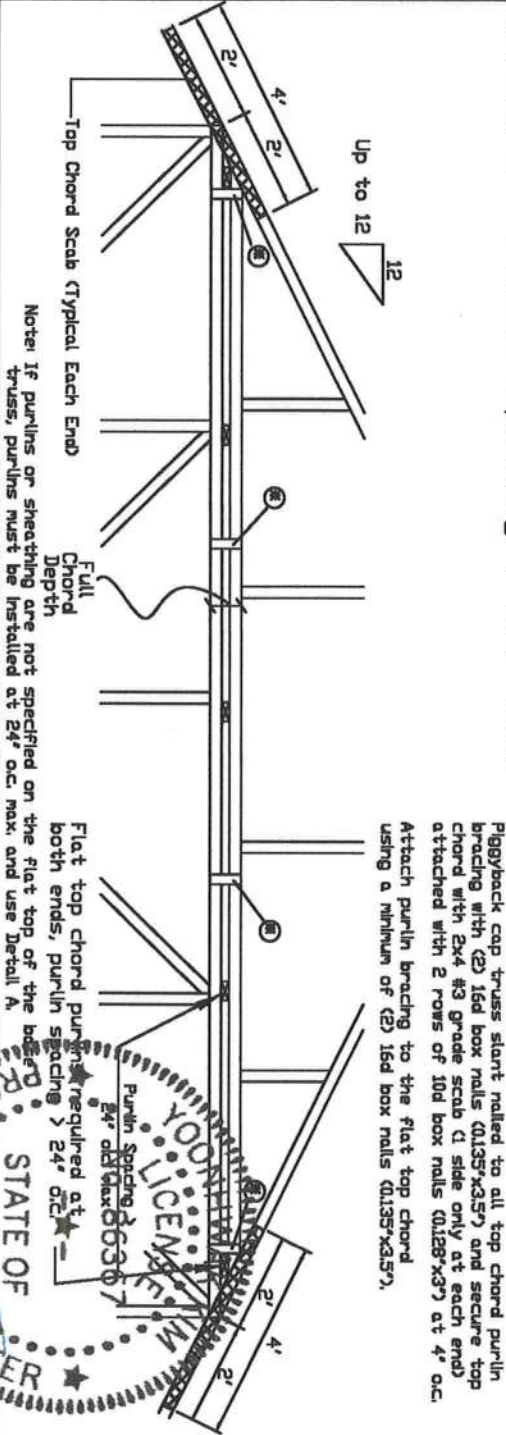

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c. Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0.135"x3.5").

In addition, provide connection with one of the following methods

Trulox: Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face & 8' o.c. with (4) 0.120"x1.375" nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces.

APA Rated Gussert: 8"x8"x7/16" (min) APA rated sheathing gusserts (each face). Attach & 8' o.c. with (8) bd common (0.113"x2") nails per gussert, (4) in cap bottom chord and (4) in base truss top chord. Gusserts may be staggered 4' o.c. front to back faces.

2x4 Vertical Scabs: 2x4 SPF #2, full chord depth scabs (each face), Attach & 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.

2BPG Wave Piggyback Plate: The 2BPG wave piggyback plate to each face & 8' o.c. Attach & 8' o.c. with (8) 0.120"x1.375" nails per gussert, (4) in cap bottom chord and (4) in base truss top chord. Piggyback plates may be staggered 4' o.c. front to back faces.

Note: If purlins or sheathing are not specified on the flat top of the base truss, purlins must be installed at 24' o.c. max. and use Detail A.

Flat top chord purlins required at both ends, purlin spacing > 24' o.c.

INSTALLER READ AND FOLLOW ALL NOTES ON THIS DRAWING

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of ASCE Building Component Safety Information, by TPI and S&P for safety practices prior to performing these functions. Installers shall provide temporary bracing per ASCE. Trusses noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached full depth scab. Locations shown for permanent lateral restraint of webs and top chord as shown above and on the base truss. Trusses shall be installed in accordance with the drawings. Refer to drawings 160H-2 for standard plate positions.

Alpine, a division of TTV Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation, or bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicating acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the building designer per ANSI/TPI 1 back.

For more information see the Job's general notes page and truss web at <http://www.alpineinc.com> or call 800-255-2278. Koonhwa Kim, P.E. #86367



13123 Riverport Drive
Suite 200
Maryland Heights, MO 63043



REF	PIGGYBACK
DATE	01/02/2018
DRWG	PB160160118
SPACING	24.0"

