



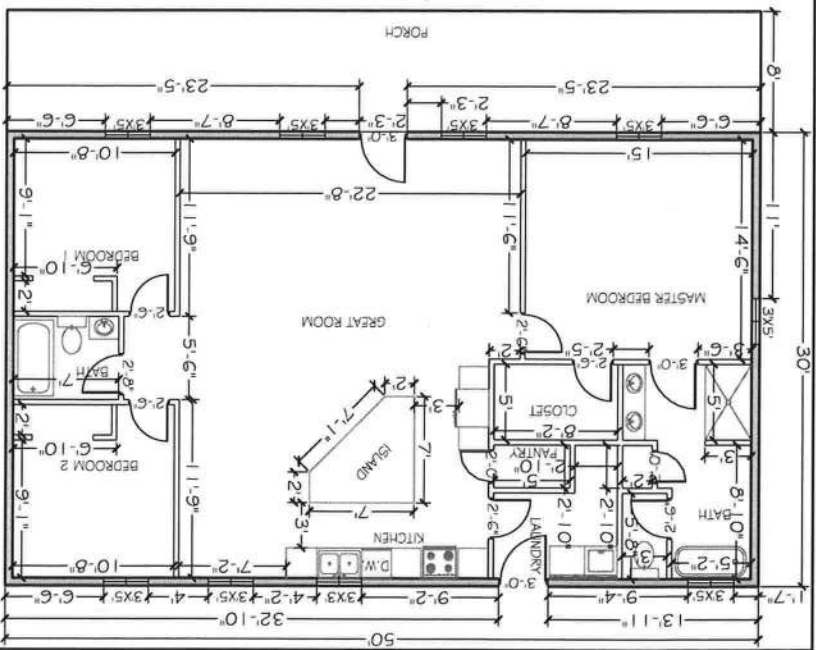

SCALE: 1/8" = 1'

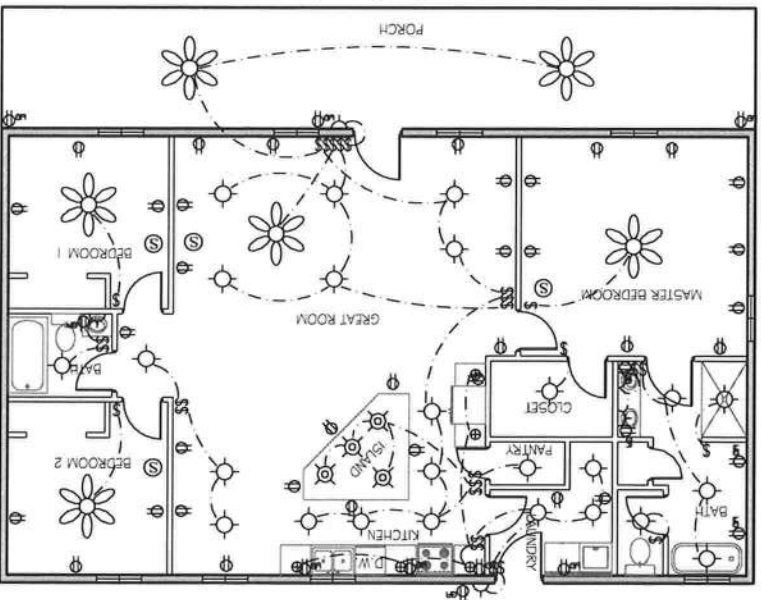

SCALE: 1/8" = 1'

UPLEX WALL RECEPTACLE

- 120V SMOKE DETECTOR
UNDER-CABINET LIGHT
PENDENT LIGHT
LIGHT
SPST WALL SWITCH
GF1 DUPLEX WALL RECEPTACLE



120V SMOKE DETECTOR

- [illegible]

- 2020 FLORIDA BUILDING CODE (FBC) - RESIDENTIAL OCCUPANCY, RESIDENTIAL GROUP R-3 (ONE- AND TWO-FAMILY DWELLINGS)
- NUMBER OF STORIES: 1

Digitally signed by Carol Chadwick
DN: c=US,
o=Unaffiliated,
ou=A01410D0000
01711349D4A700
01621F, cn=Carol
Chadwick
Date: 2021.08.13
16:47:10 -0400



BEDENBAUGH BARNDOMINIUM
FLOOR & ELECTRIC PLAN

PREPARED FOR:
COLBY & LAURA
BEDENBAUGH
bedenbaugh12@hotmail.com
306.292.1929

PROJECT NO.	FL21211
DATE	AUG. 13, 2021
REVISION DATE	
SHEET	5-1

