



END WALL BRACING FOR CEILING DIAPHRAGM

NTS (ALTERNATIVE TO BALLOON FRAMING)

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

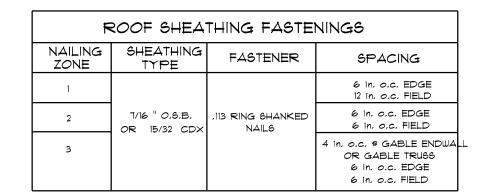

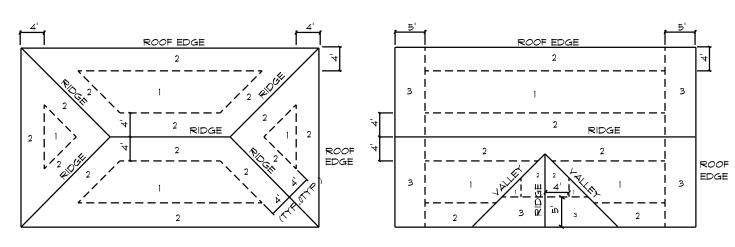

ROOF SHEATHING NAILING ZONES (HIP ROOF) ROOF SHEATHING NAILING ZONES (GABLE ROOF)

B

W/BLOCK'G


NOTE: ALL INTERIOR DOOR

OPENINGS SHOULD BE

FRAMED 2" WIDER THAN


THEIR SPECIFIED SIZE.



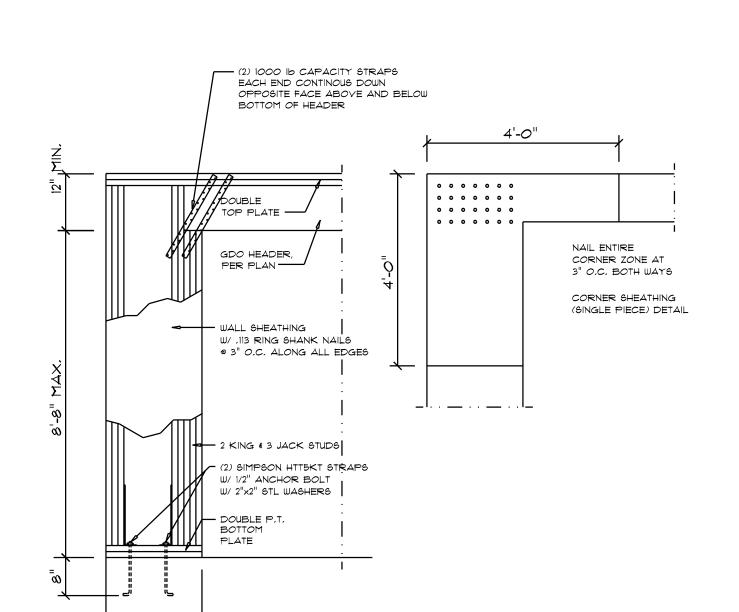




2'-0" MIN.

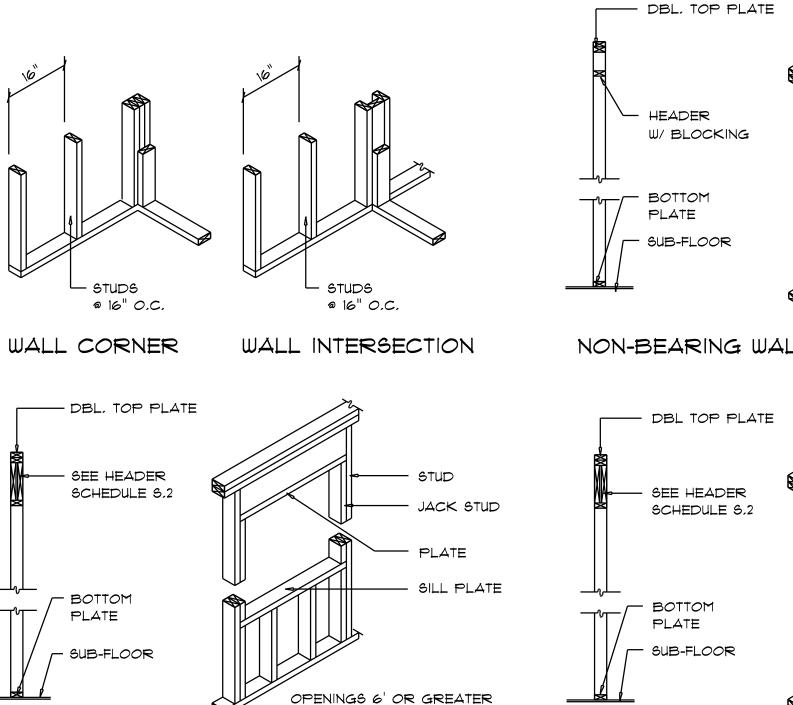


REQUIRE DBL. JACK STUDS

TYPICAL WINDOW HEADER

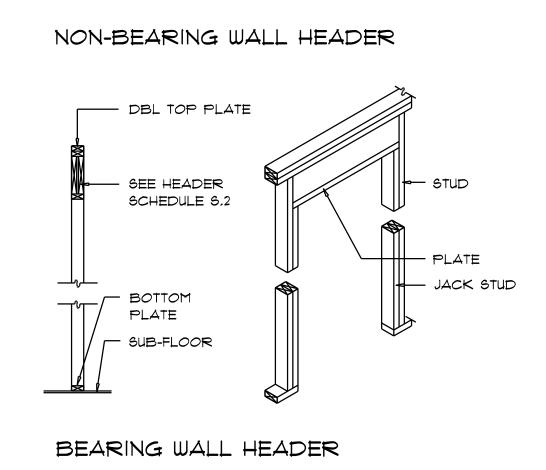




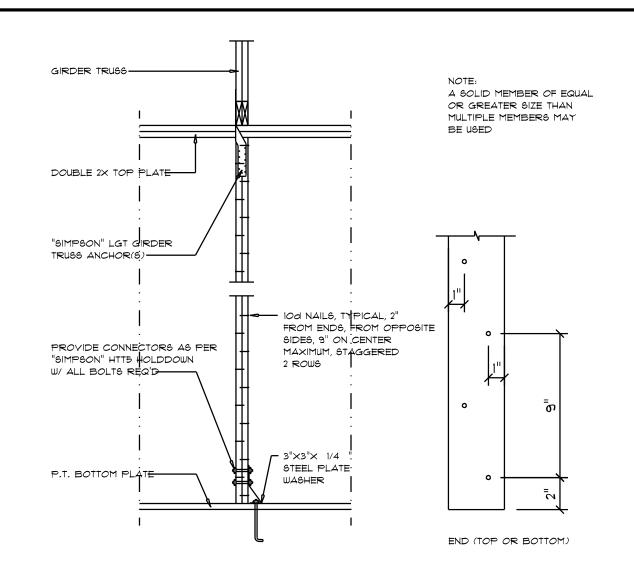

Girder Truss Column DET.

SCALE: 1/2" = 1'-0"

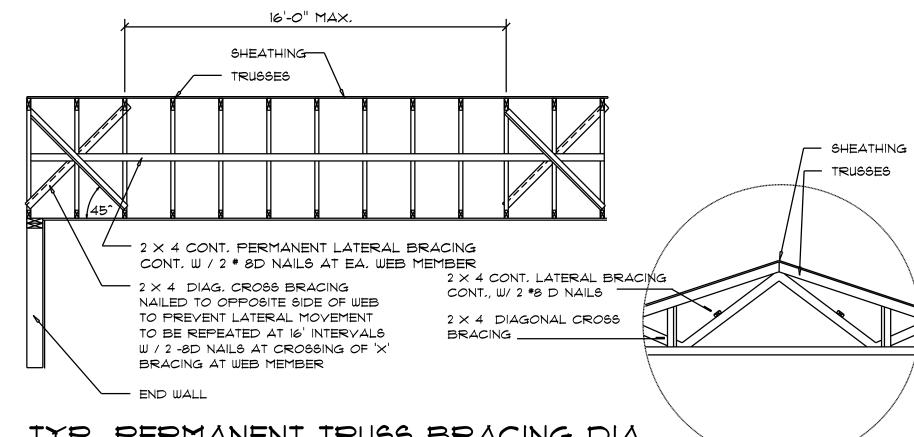


TYP, PERMANENT TRUSS BRACING DIA,

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

Truss Bracing DETAILS

SCALE: AS NOTED

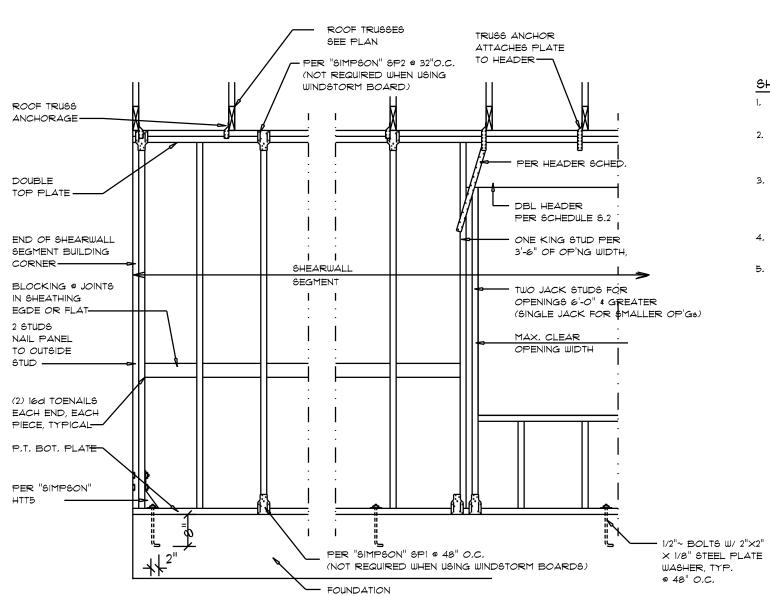

SHEARWALL NOTES:

1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS

2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 1/16" WINDSTORM BD INCLUDING AREAS ABOVE AND BELOW OPENINGS

12" O.C. IN THE FIELD.


D

- ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
 NAIL SPACING SHALL BE 6" O.C. EDGES AND
- 5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS, MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT, THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3").

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

Shear Wall DETAILS

SCALE: NONE

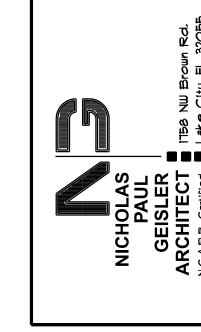

SIDI

 \simeq

KNOLL COLUMBIA COL

