

56

STATE OF FLORIDA
DEPARTMENT OF HEALTH
APPLICATION FOR ONSITE SEWAGE DISPOSAL SYSTEM CONSTRUCTION PERMIT

Permit Application Number 12-165

CLAY KLEC

----- PART II - SITEPLAN -----

Scale: 1 inch = 40 feet.


SEE ATTACHED

Notes: _____

Site Plan submitted by: *Rocky D*
Plan Approved *X* Not Approved _____
By *[Signature]*

MASTER CONTRACTOR
Date 5/31/12
County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

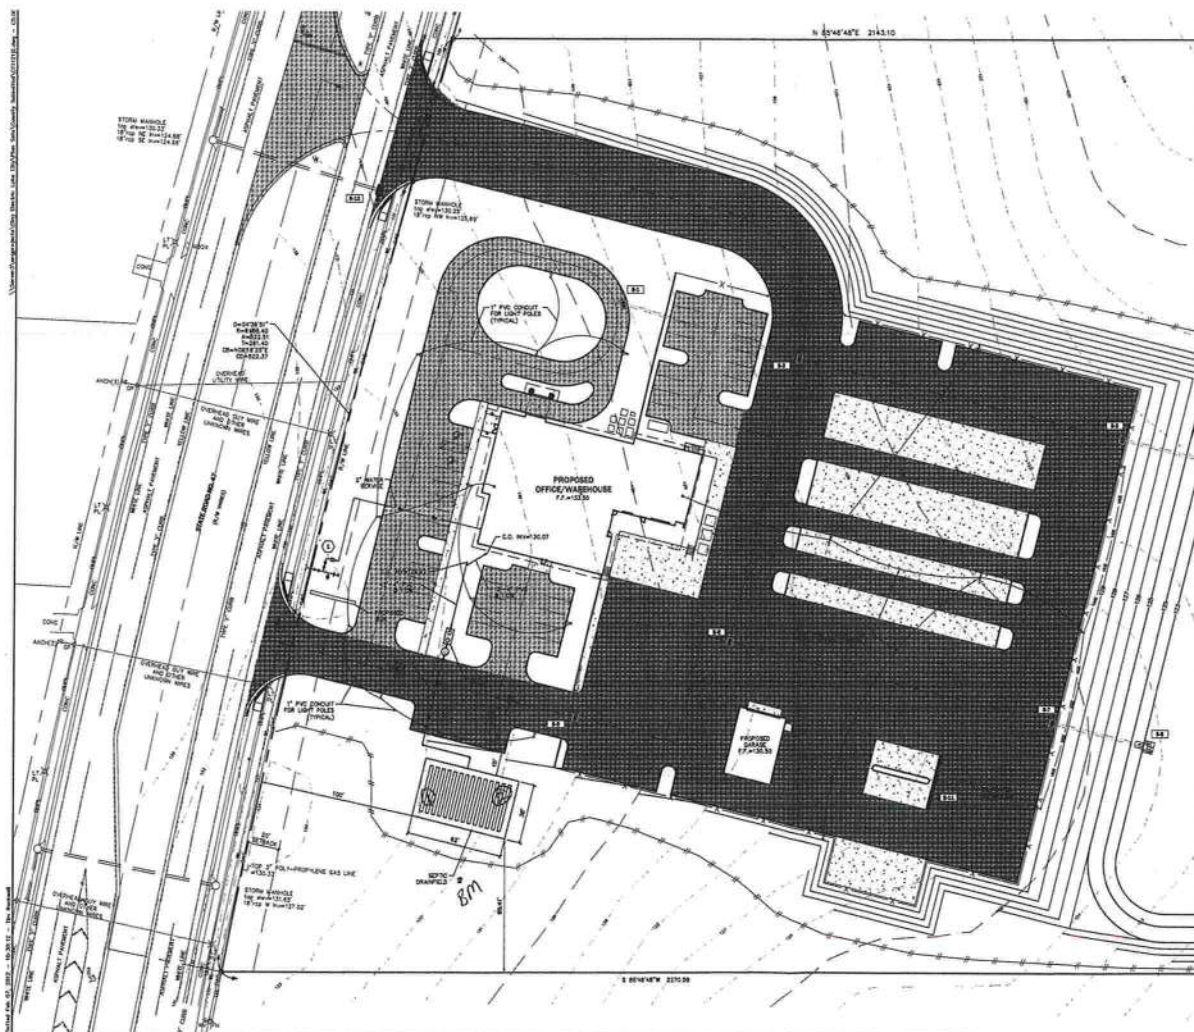

1. CONTRACTOR IS RESPONSIBLE FOR PROTECTION AND VANDALISM OF EXISTING UTILITIES. ANY EXISTING UTILITY TO BE MOVED SHALL BE COORDINATED WITH THE COLUMBIA COUNTY.
2. ALL CONSTRUCTION MATERIALS AND METHODS FOR PORTABLE WATER MAINS AND RESILIENT WATER SERVICES SHALL CONFORM WITH THE CITY OF LAKE CITY. CONTRACTOR SHALL PROVIDE WATER MAINS AND RESILIENT WATER SERVICES IN ACCORDANCE WITH THE CITY OF LAKE CITY. CONTRACTOR SHALL PROVIDE WATER MAINS AND RESILIENT WATER SERVICES IN ACCORDANCE WITH THE CITY OF LAKE CITY.
3. A MINIMUM HORIZONTAL SEPARATION OF 12" FOR PORTABLE WATER MAINS AND RESILIENT WATER SERVICES SHALL BE MAINTAINED. CONTRACTOR SHALL PROVIDE WATER MAINS AND RESILIENT WATER SERVICES IN ACCORDANCE WITH THE CITY OF LAKE CITY. CONTRACTOR SHALL PROVIDE WATER MAINS AND RESILIENT WATER SERVICES IN ACCORDANCE WITH THE CITY OF LAKE CITY.
4. WATER MAINS AND RESILIENT WATER SERVICES SHALL BE INSTALLED BY THE CITY OF LAKE CITY.
5. 12" VALVES LOCATED IN PAVED AREAS INCLUDING DRIVEWAYS SHALL BE CITY APPROVED. CONTRACTOR SHALL PROVIDE WATER MAINS AND RESILIENT WATER SERVICES IN ACCORDANCE WITH THE CITY OF LAKE CITY. CONTRACTOR SHALL PROVIDE WATER MAINS AND RESILIENT WATER SERVICES IN ACCORDANCE WITH THE CITY OF LAKE CITY.
6. WATER MAINS 4" IN DIAMETER AND GREATER, PLACED UNDER DRIVEWAYS, SHALL BE DUCTILE IRON PIPE (DIP) EXTENDING 5' PAST THE BACK OF CURB.
7. 12" WATER SERVICE CONNECTIONS LOCATED UNDER DRIVEWAYS SHALL BE 12" DIP. NO DIP EXTENDING 5' PAST THE BACK OF CURB.
8. ACCORDING TO THE COMPANIES AND BODIES SHALL BE USED ON ALL FIRE HYDRANTS.
9. ALL PRESSURIZED MAIN FITTINGS SHALL BE MECHANICAL JOINT WITH KEY JOINT BLANKS.
10. ALL SANITARY WATERMAIN SERVICE LATERALS SHALL BE MIN. 4" DIAMETER AND 4' LONG WITH SLOPE UNLESS OTHERWISE SPECIFIED.
11. SANITARY WATERMAIN SERVICE LATERALS LOCATED UNDER DRIVEWAYS SHALL BE DUCTILE IRON PIPE (DIP) EXTENDING 5' PAST THE BACK OF CURB.
12. SLOPE INDICATIONS SHALL NOT BE PLACED WITHIN TREE SHADOWS AS SHOWN ON THE PLANS, GRADES AND DRAINAGE PLAN.
13. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF EXISTING UTILITIES. ANY EXISTING UTILITY TO BE MOVED SHALL BE COORDINATED WITH THE COLUMBIA COUNTY.
14. NO PERMANENT STRUCTURES SHALL BE CONSTRUCTED WITHIN 10 FEET OF WATER MAIN OR 15 FEET OF ANY OTHER LINE.
15. CONTRACTOR SHALL PROTECT LANDSCAPE AND ANY DISTURBED AREAS & RESTORE AS EXISTING.

WATER FITTING SCHEDULE	
1	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
2	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
3	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
4	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
5	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
6	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
7	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
8	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
9	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
10	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
11	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
12	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
13	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
14	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
15	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
16	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
17	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
18	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
19	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
20	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
21	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
22	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
23	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
24	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
25	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
26	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
27	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
28	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
29	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
30	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
31	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
32	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
33	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
34	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
35	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
36	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
37	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
38	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
39	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
40	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
41	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
42	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
43	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
44	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
45	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
46	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
47	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
48	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
49	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
50	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
51	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
52	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
53	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
54	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
55	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
56	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
57	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
58	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
59	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
60	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
61	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
62	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
63	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
64	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
65	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
66	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
67	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
68	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
69	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
70	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
71	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
72	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
73	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
74	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
75	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
76	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
77	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
78	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
79	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
80	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
81	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
82	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
83	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
84	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
85	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
86	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
87	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
88	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
89	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
90	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
91	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
92	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
93	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
94	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
95	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
96	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
97	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
98	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
99	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)
100	1/2" 18" TAP & VALVE (BY CITY OF LAKE CITY)

LEGEND	
[Pattern]	LIMITS OF ASPHALT PAVEMENT
[Pattern]	LIMITS OF HEAVY DUTY ASPHALT PAVEMENT
[Pattern]	LIMITS OF CONCRETE PAVEMENT
[Pattern]	EXISTING CONTOUR ELEVATION
[Pattern]	EXISTING CONTOUR ELEVATION
[Pattern]	PROPOSED FIRE HYDRANT