

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and approval numbers on the building components listed below if they will be utilized on the construction project for which you are applying for a building permit. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. Statewide approved products are listed online @ www.floridabuilding.org

Category/Subcategory	Manufacturer	Product Description	Approval Number(s)
1. EXTERIOR DOORS			
A. SWINGING	Jeld Wen	steel wood edge	15474.2
B. SLIDING			
C. SECTIONAL/ROLL UP			
D. OTHER	Silverline	gliding patio door	14998.2
2. WINDOWS			
A. SINGLE/DOUBLE HUNG			
B. HORIZONTAL SLIDER			
C. CASEMENT			
D. FIXED			
E. MULLION			
F. SKYLIGHTS			
G. OTHER			
3. PANEL WALL			
A. SIDING			
B. SOFFITS			
C. STOREFRONTS			
D. GLASS BLOCK			
E. OTHER			
4. ROOFING PRODUCTS			
A. ASPHALT SHINGLES			
B. NON-STRUCTURAL METAL			
C. ROOFING TILES			
D. SINGLE PLY ROOF			
E. OTHER			
5. STRUCTURAL COMPONENTS			
A. WOOD CONNECTORS			
B. WOOD ANCHORS			
C. TRUSS PLATES			
D. INSULATION FORMS			
E. LINTELS			
F. OTHERS			
6. NEW EXTERIOR			
ENVELOPE PRODUCTS			

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufacturers installation requirements.

Further, I understand these products may have to be removed if approval cannot be demonstrated during inspection.


Contractor OR Agent Signature

10/21/2021

Date

NOTES: _____

AMERICAN CRAFTSMAN WINDOWS SILVER LINE WINDOWS AND DOORS

70 SERIES / V3 SERIES/(5800) GLIDING PATIO DOOR (NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE RER OR AHJ.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: PVC
7. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 2.1 FOR GLAZING DETAILS.

DESIGN PRESSURE TABLE			
SIZE	CONFIGURATION	DESIGN PRESSURE	MISSILE IMPACT RATING
96.0" X 82.0"	XO	+50/-50 PSF	NON-IMPACT
96.0" X 96.0"	XO	+30/-30 PSF	NON-IMPACT
96.0" X 82.0"	XO	+15/-15 PSF	NON-IMPACT
96.0" X 80.0"	XO	+20/-20 PSF	NON-IMPACT
72.0" X 80.0"	XO	+35/-35 PSF	NON-IMPACT
76.0" X 82.0"	XO	+25/-25 PSF	NON-IMPACT

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	B	GENERAL NOTES
2	B	ELEVATIONS & ANCHOR LAYOUTS
2.1	B	ELEVATIONS & ANCHOR LAYOUTS & GLAZING DETAILS
3	B	VERTICAL SECTIONS
4	B	HORIZONTAL SECTIONS
5	B	INSTALLATION NOTES & ANCHOR DETAILS & SCHEDULE

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE:
70 SERIES / V3 SERIES / (5800)
GLIDING PATIO DOOR
(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES & GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004

PH: (954) 399-8478
FAX: (954) 744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	LH	10/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.10.22 02:42:16 -02'00'

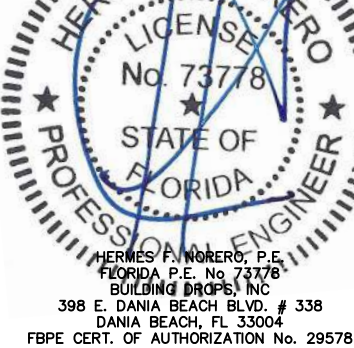

FL #:

FL 14998

DATE: 09.27.17

DWG. BY: CL

CHK. BY: HFN


SCALE: NTS

DWG. #: SWD038


SHEET:

1


OF 5

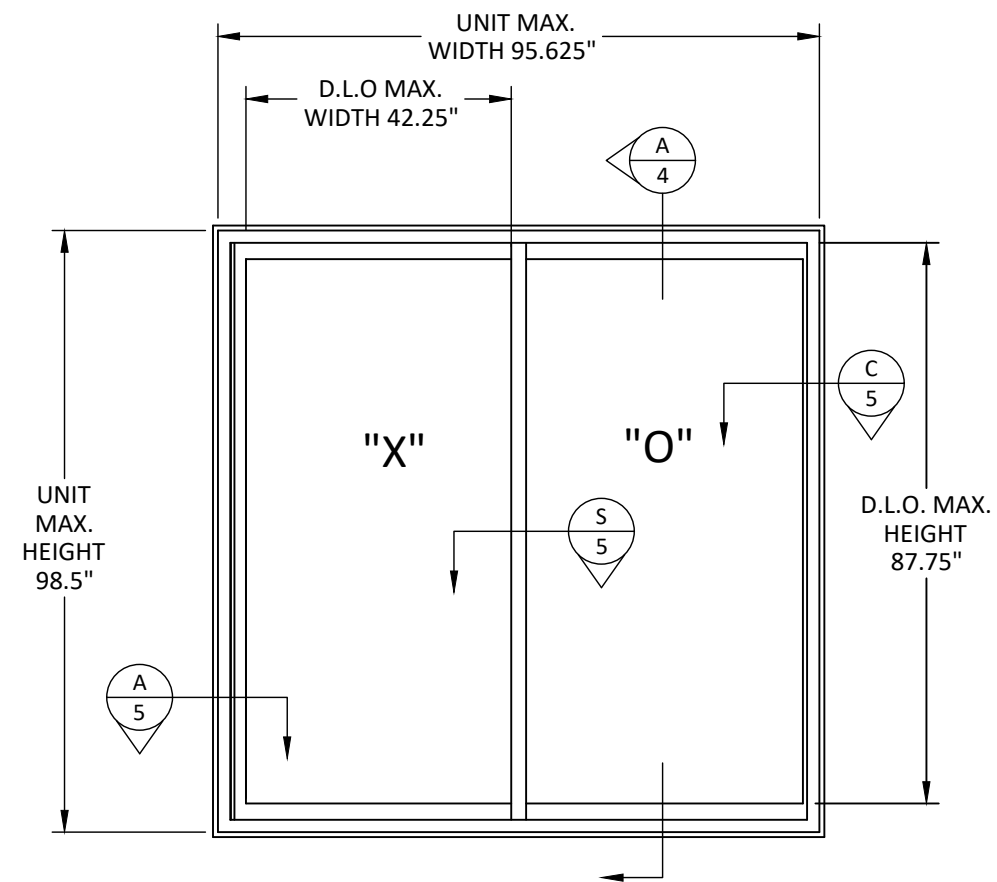

ELEVATION

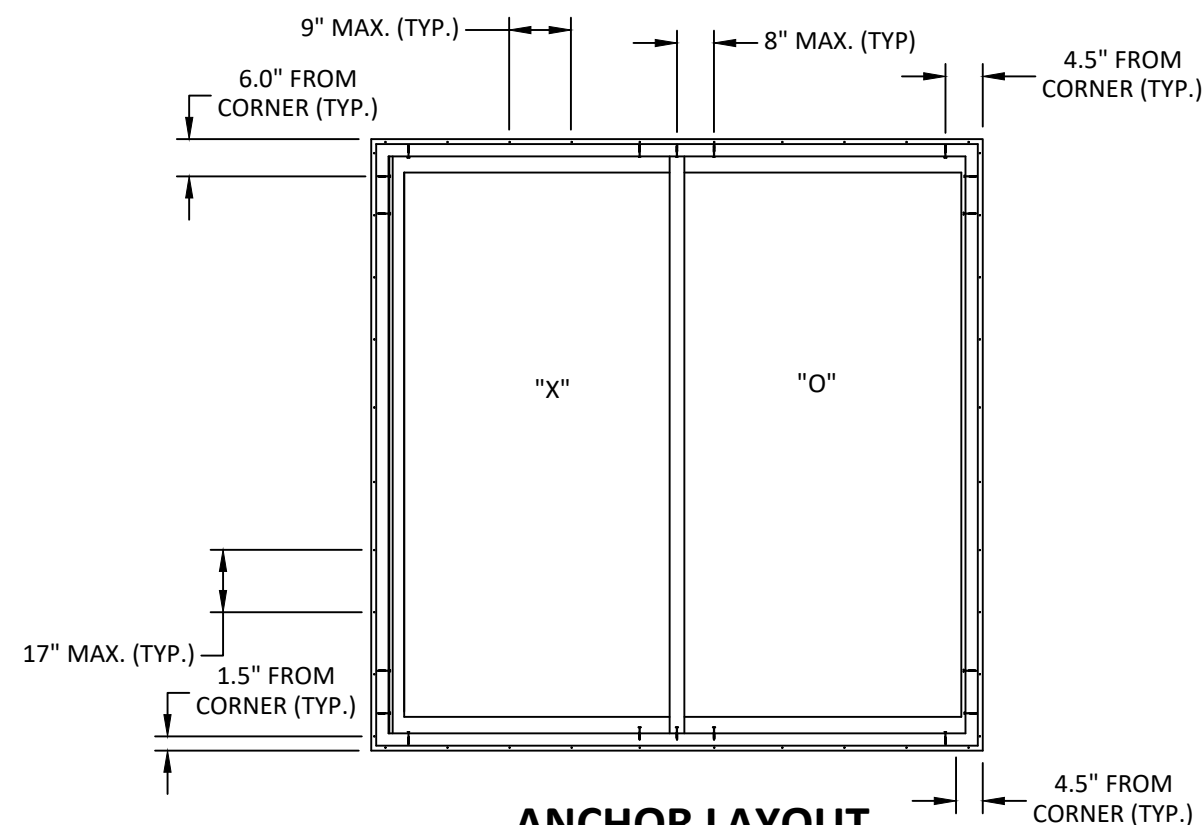

ANCHOR LAYOUT
NAIL FIN

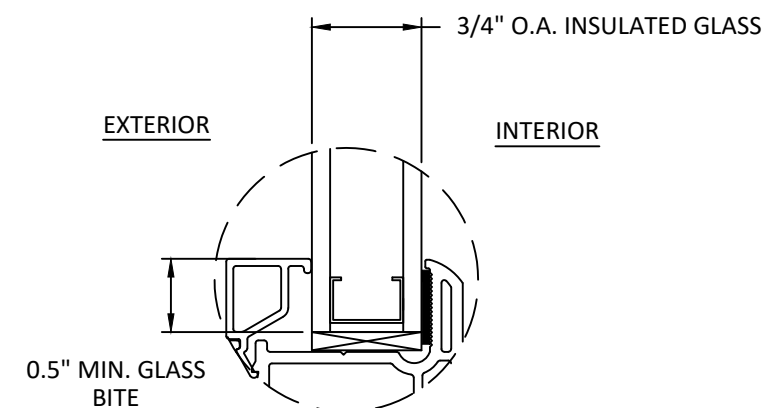

GLAZING DETAIL

GLAZING NOTE:

- GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E-1300 GLASS CHARTS REQUIREMENT

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE:
70 SERIES / V3 SERIES / (5800)
GLIDING PATIO DOOR
(NON-HVHZ)/(NON-IMPACT)
ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	LH	10/20


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

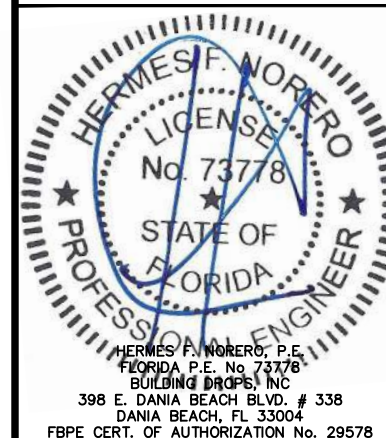

FL #:	FL 14998
DATE:	09.27.17
DWG. BY:	CL
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	SWD038
SHEET:	2.1

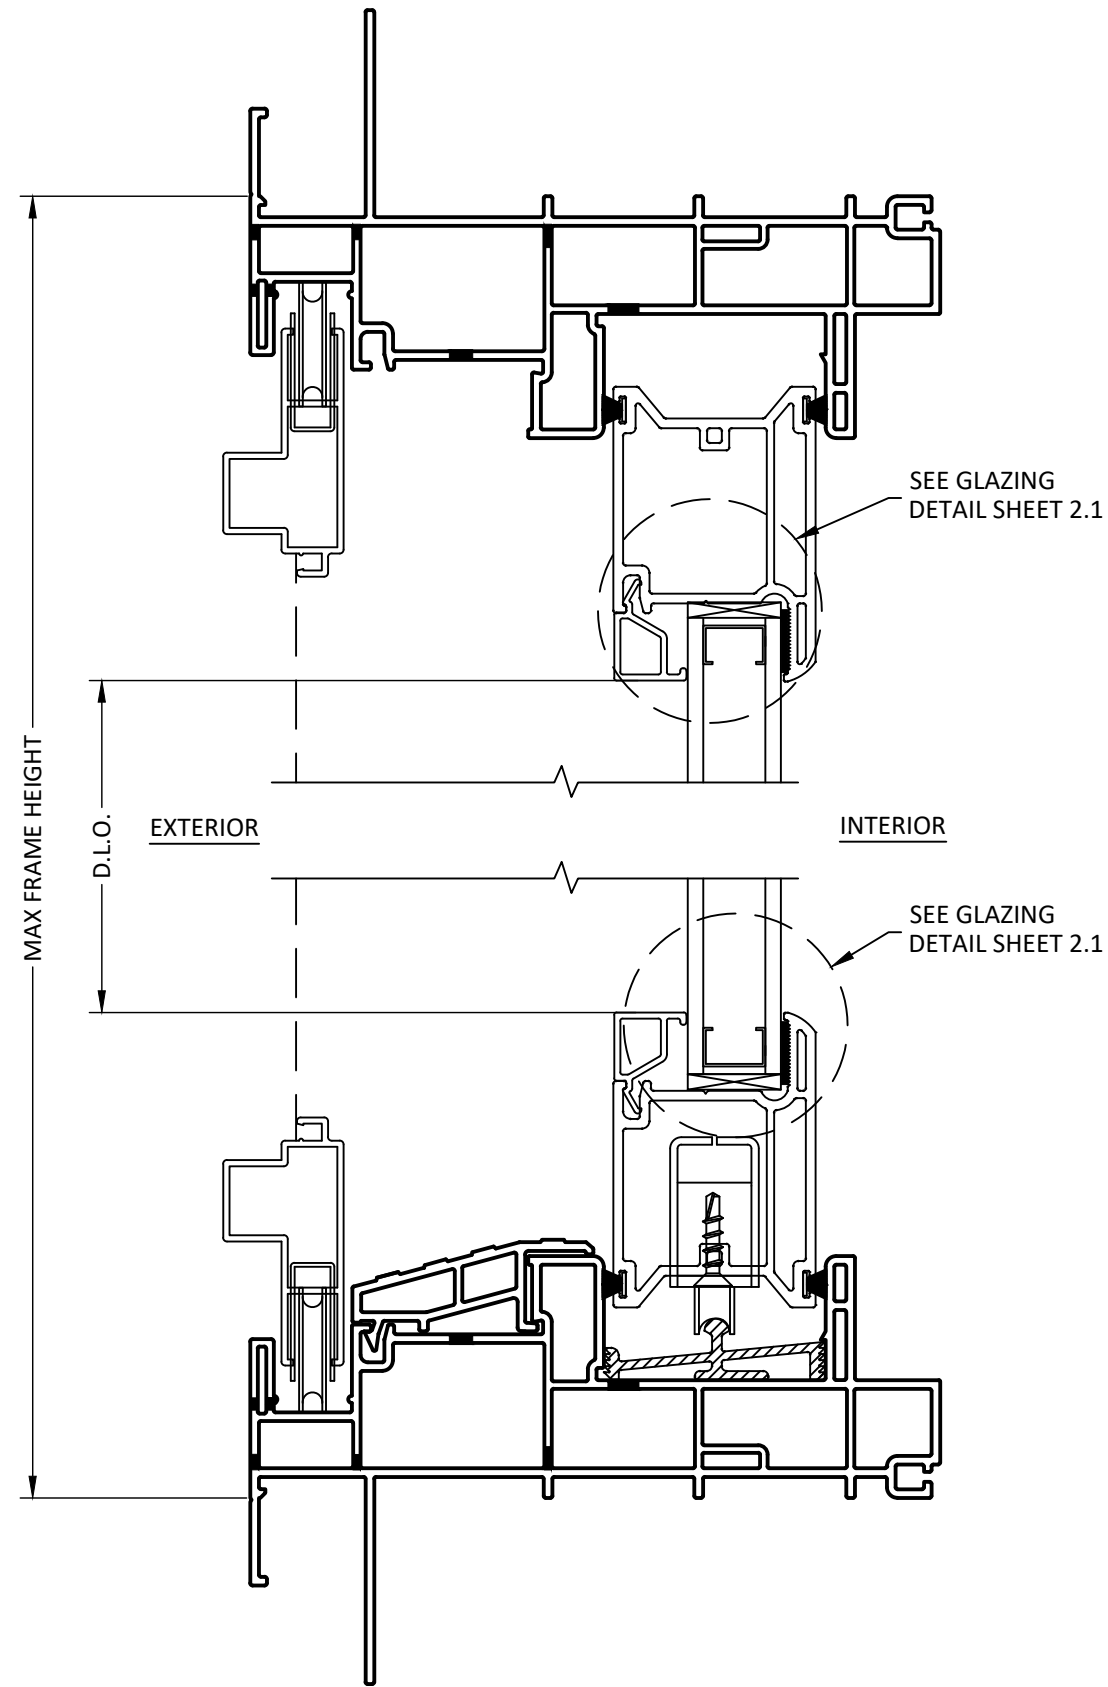

A
3 **VERTICAL SECTION**
NAIL FIN

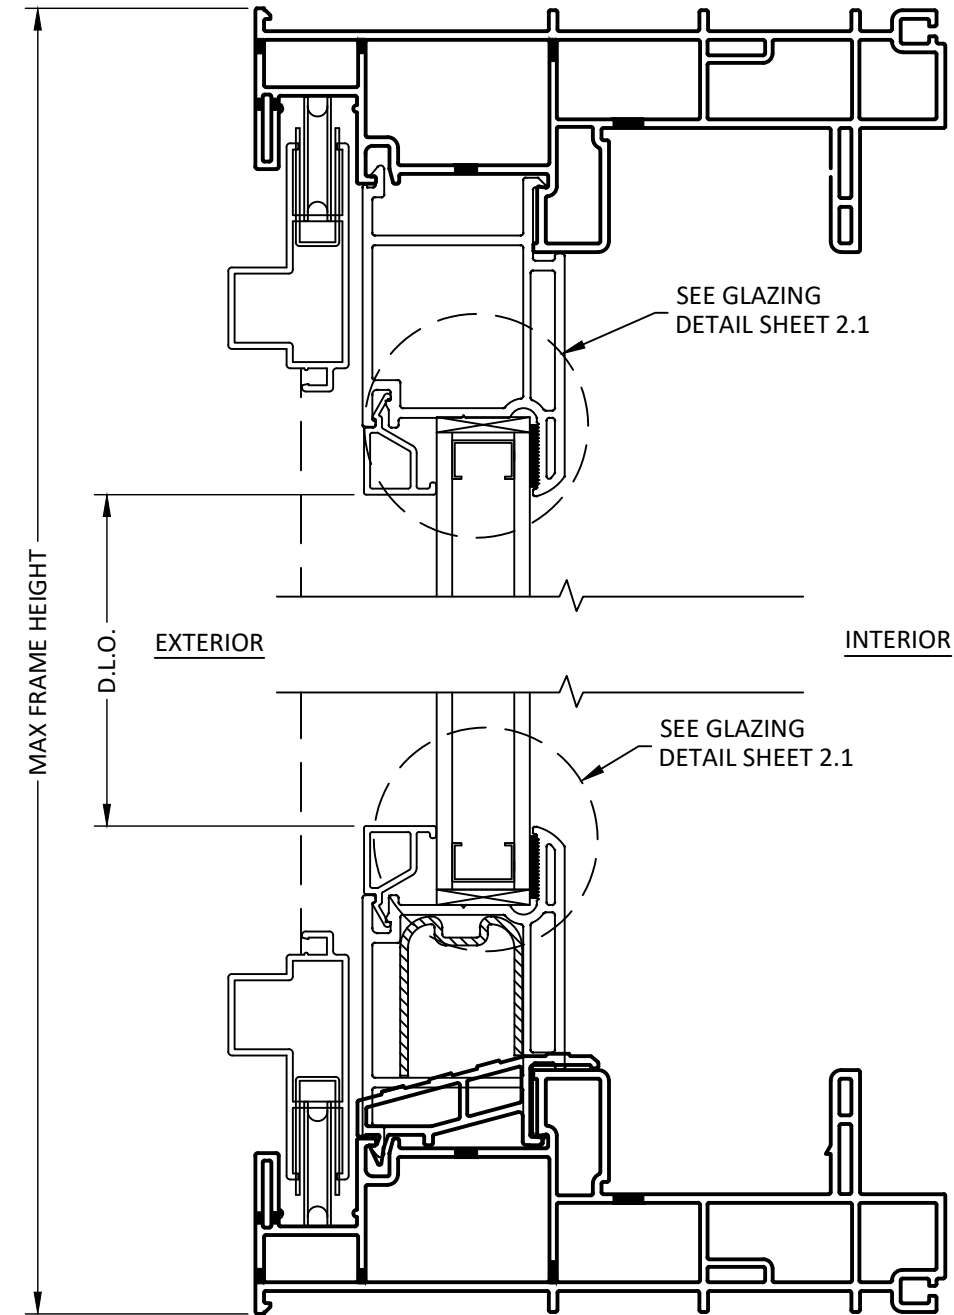

B
3 **VERTICAL SECTION**
THROUGH FRAME

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE:
70 SERIES / V3 SERIES / (5800)
GLIDING PATIO DOOR
(NON-HVHZ)/(NON-IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	LH	10/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

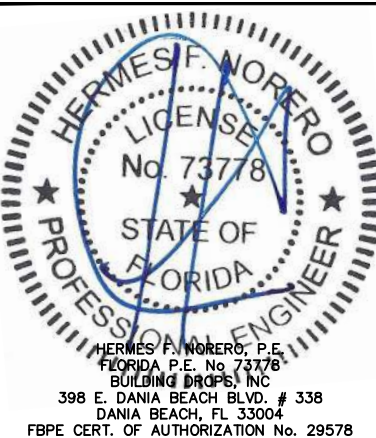

FL #:	FL 14998
DATE:	09.27.17
DWG. BY:	CL
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	SWD038
SHEET:	

3

OF 5

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE:
70 SERIES / V3 SERIES / (5800)
GLIDING PATIO DOOR
(NON-HVHZ)/(NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	LH	10/20

THE INSTALLATION DETAILS DESCRIBED HEREIN
ARE GENERIC AND MAY NOT REFLECT ACTUAL
CONDITIONS FOR A SPECIFIC SITE. IF SITE
CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL
PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

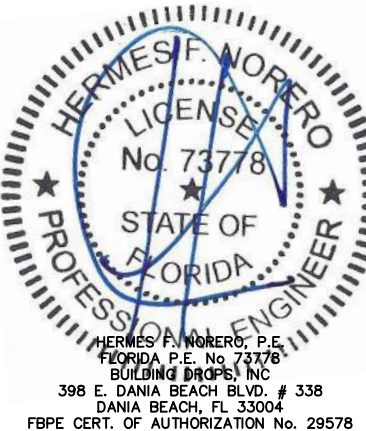

FL #:
FL 14998

DATE: **09.27.17**

DWG. BY: **CL** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **SWD038**

SHEET:

4


OF 5

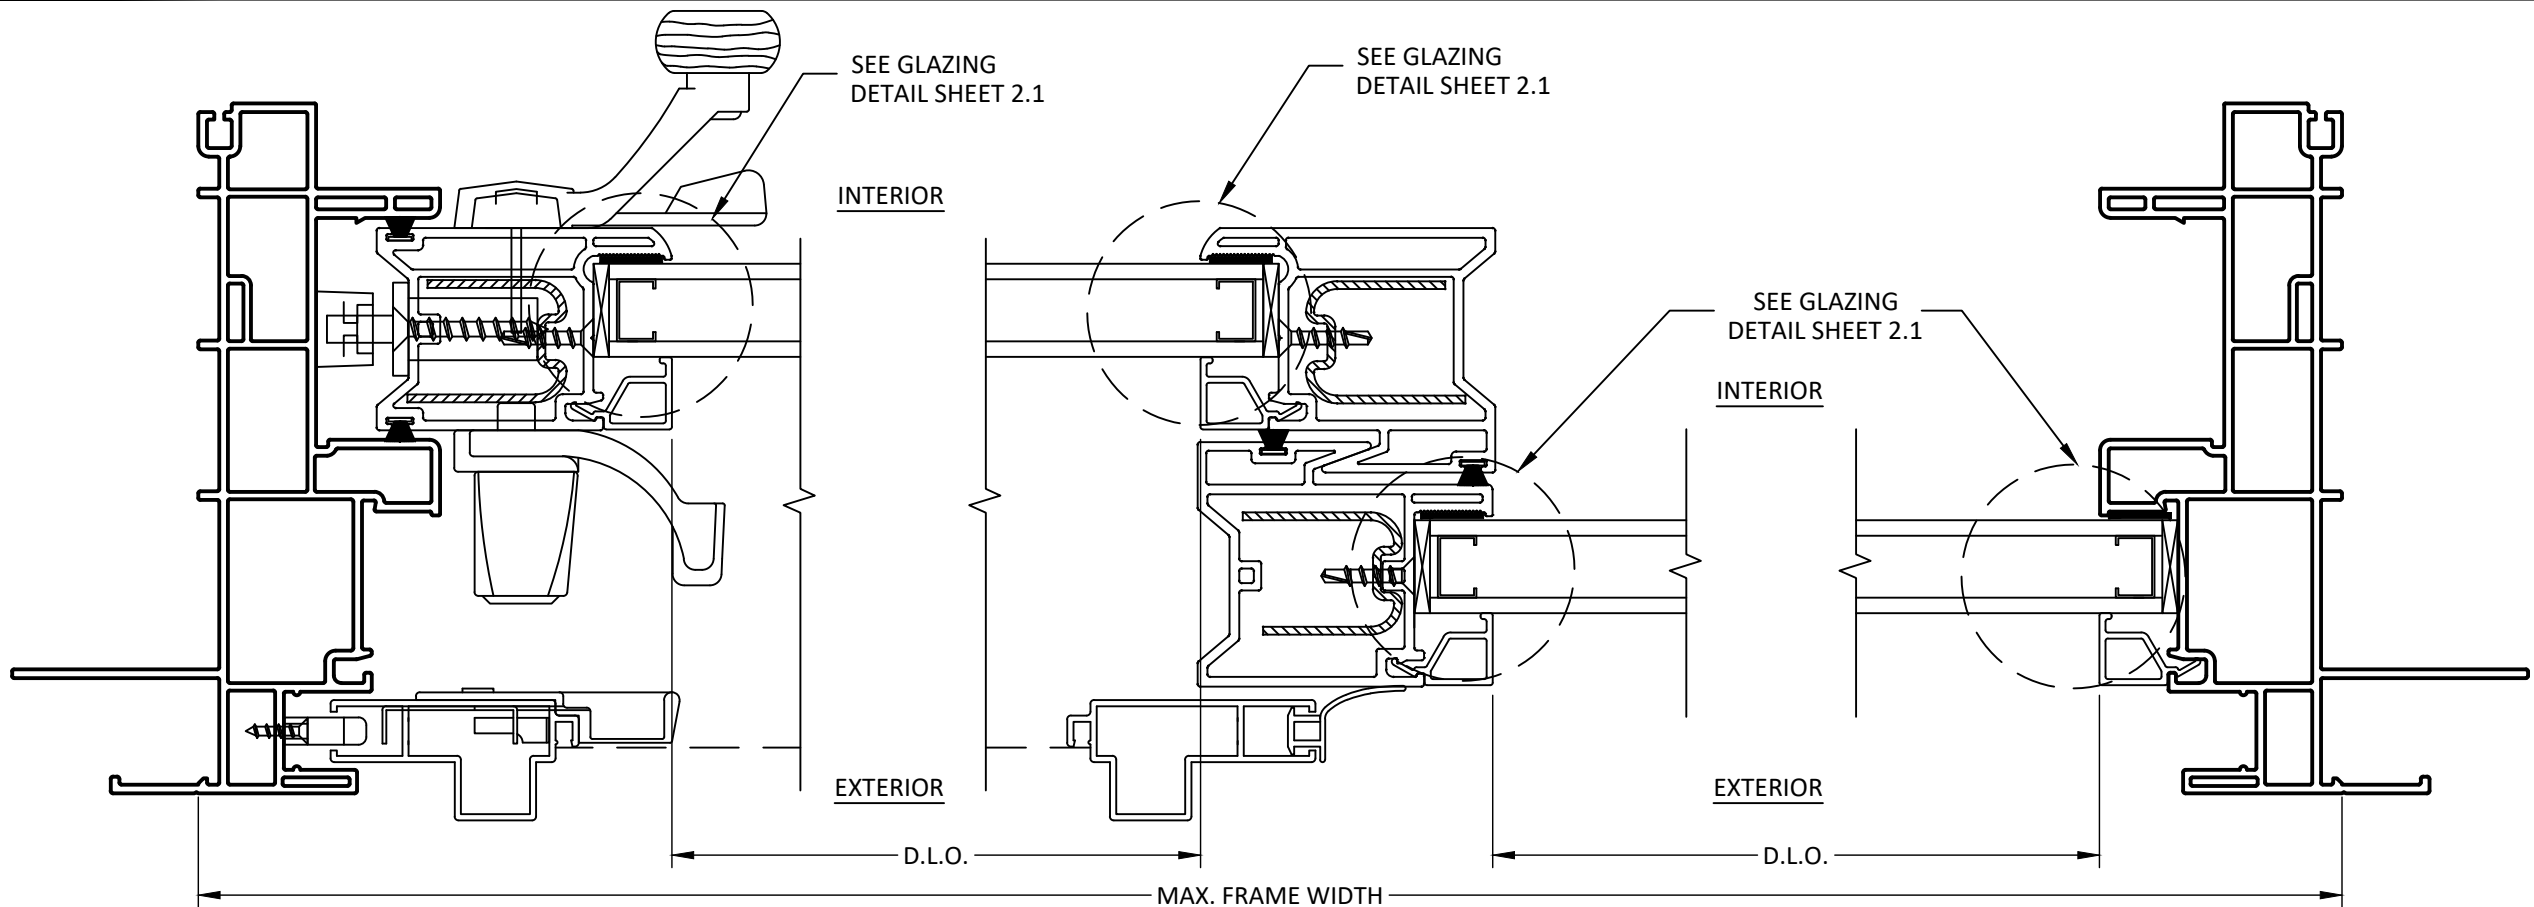

A
4 **HORIZONTAL SECTION**
NAIL FIN

B
4 **HORIZONTAL SECTION**
MEETING RAILS


C
4 **HORIZONTAL SECTION**
NAIL FIN

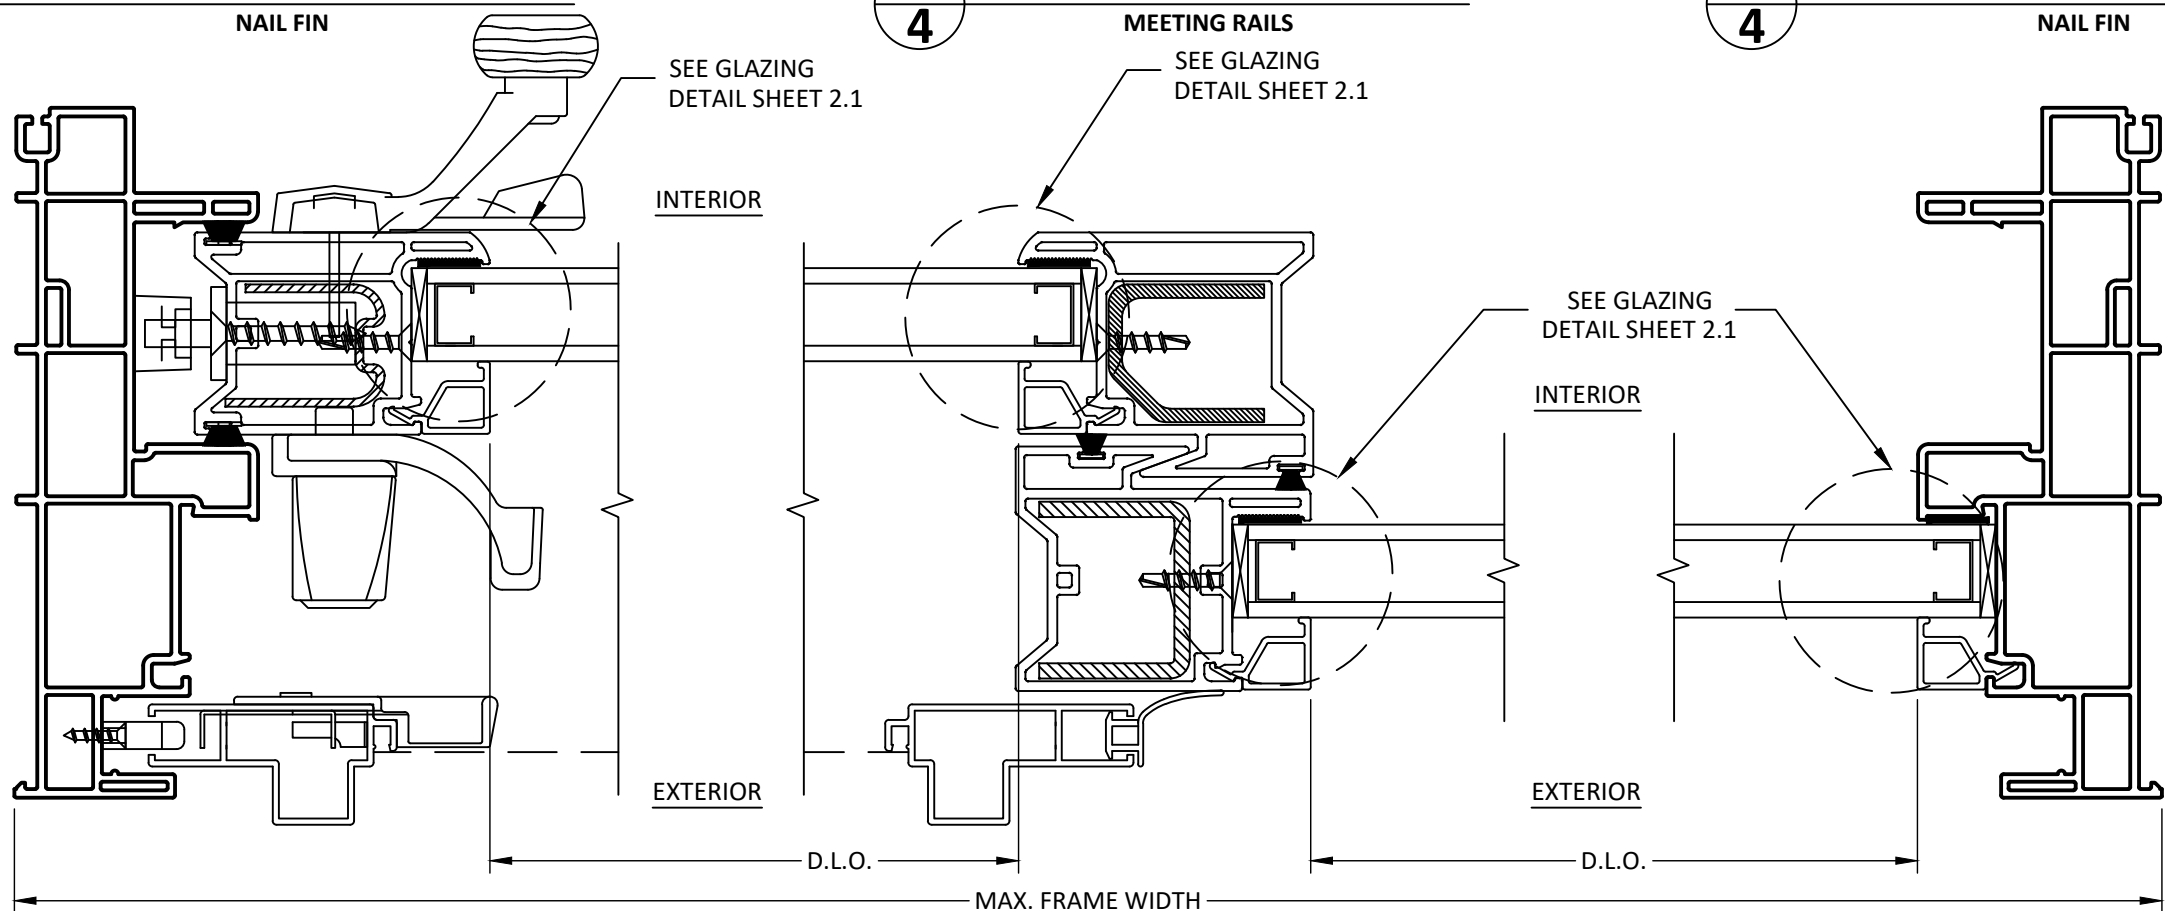

D
4 **HORIZONTAL SECTION**
THROUGH FRAME


E
4 **HORIZONTAL SECTION**
MEETING RAILS

F
4 **HORIZONTAL SECTION**
THROUGH FRAME

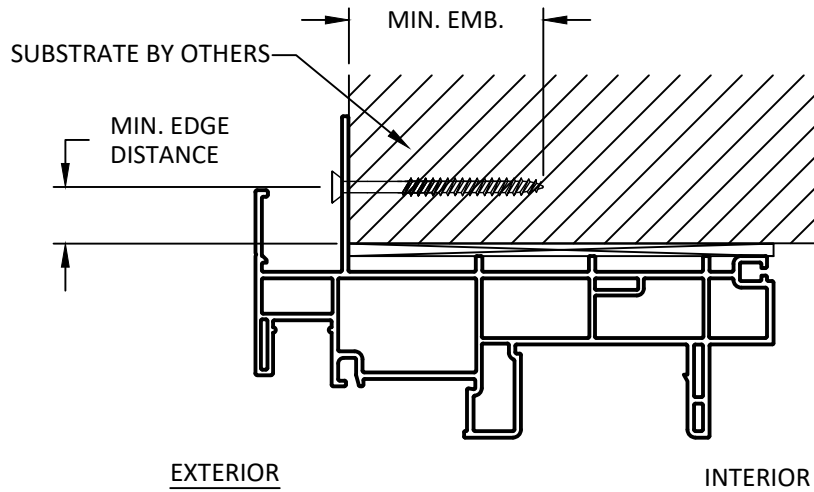

A
5 **ANCHOR DETAIL**
NAIL FIN (HEAD)

NOTE:
SILL AND JAMB HAVE SIMILAR DETAILS

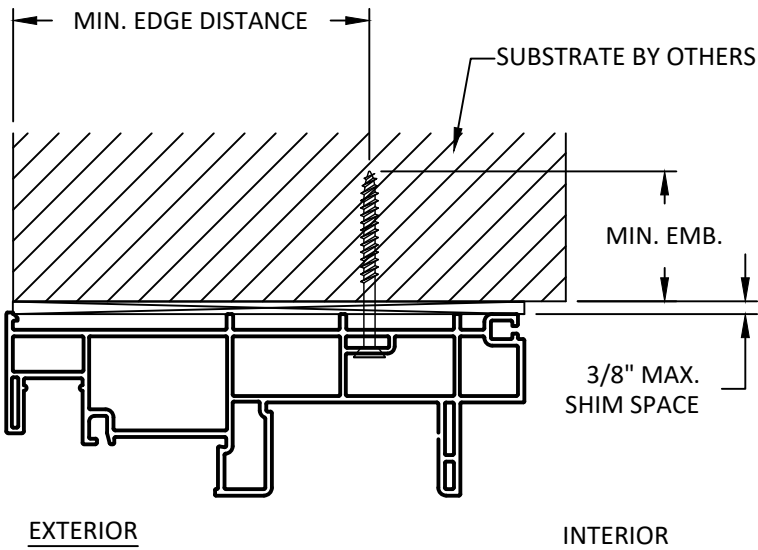

B
5 **ANCHOR DETAIL**
THROUGH FRAME (HEAD)

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.5"	0.75"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#14 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"
	CONCRETE: f'c=2000PSI	1/4" ITW TAPCON	1"	2.5"
	MASONRY: CMU per ASTM C90	1/4" ITW TAPCON	1"	2.5"
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.5"	0.75"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#8 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"

INSTALLATION NOTES

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1.000 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE:
70 SERIES / V3 SERIES / (5800)
GLIDING PATIO DOOR
(NON-HVHZ)(NON-IMPACT)
INSTALLATION NOTES
& ANCHOR DETAILS & SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	LH	10/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

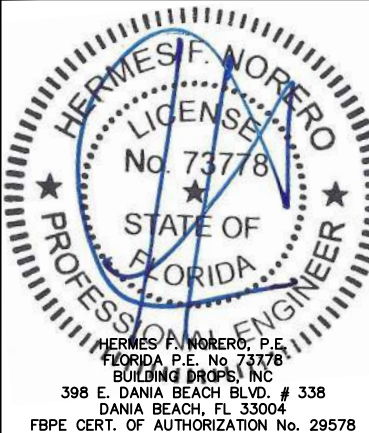

FL #:
FL 14998

DATE: **09.27.17**

DWG. BY: **CL** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **SWD038**

SHEET:

5

OF 5

**JELD-WEN DOOR
INSTALLATION DETAILS
STEEL 24 GA. WOOD EDGE
OPAQUE W/ FULL LITE SIDELITES
UP TO 12'-0" X 8'-0"
OUTSWING/INSWING**

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH CURRENT INTERNATIONAL BUILDING CODE (I.B.C.) & INTERNATIONAL RESIDENTIAL CODE (I.R.C.) AND THE CURRENT FLORIDA BUILDING CODES (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED IN ACCORDANCE TO ASTM E283-04, E330-02, E331-00 AND AAMA 1304-02.

2. 1X AND 2X WOOD BUCKS BY OTHERS AND MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE. BUCK MATERIAL MUST HAVE A SPECIFIC GRAVITY OF 0.55 OR GREATER.

3. PRODUCT ANCHOR TYPES AND SPACING ARE SHOWN ON SHEET 7. DIMENSIONS SHOWN FOR ANCHOR SPACING ARE ALWAYS FROM EDGE OF UNIT FRAME. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.



4. THIS DOCUMENT SUPERCEDES OTHER ANCHOR INSTALLATION INSTRUCTIONS

FOR NON-IMPACT RATED DOORS. FOR OTHER IMPORTANT INSTALLATION INSTRUCTIONS, REFER TO JELD-WEN DOCUMENT #J1106 (INSTALLATION INSTRUCTIONS FOR PRE-HUNG ENTRY DOORS) FOUND ON THE JELD-WEN WEBSITE: [JELD-WEN.COM/LEARN/RESOURCES/INSTALLATION & FINISHING/](http://JELD-WEN.COM/LEARN/RESOURCES/INSTALLATION&FINISHING/).







5. FLORIDA APPROVED SHUTTERS ARE NEEDED WHEN IMPACT PROTECTION IS REQUIRED.

6. FOR DESIGN PRESSURE RATINGS, SEE TABLE 1, SHEET 1.

7. ALL FASTENERS IN WOOD SHALL BE COUNTERSUNK 3/16" DEEP.

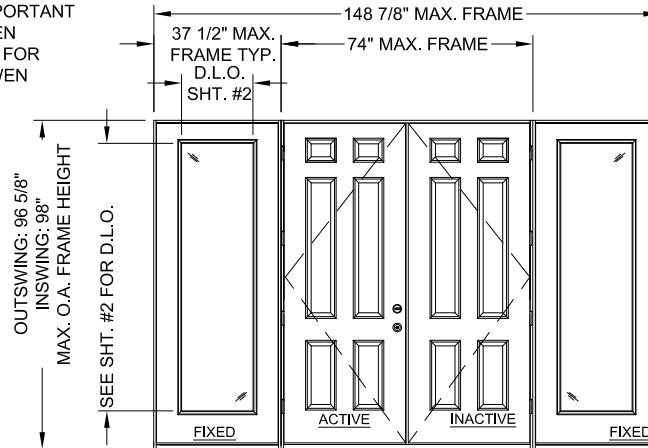

12-0 X 8-0 ELEVATION
DOUBLE DOOR W/ FULL 3-0 SIDELITES (OXXO)

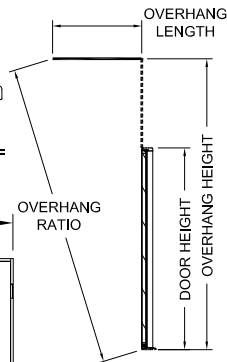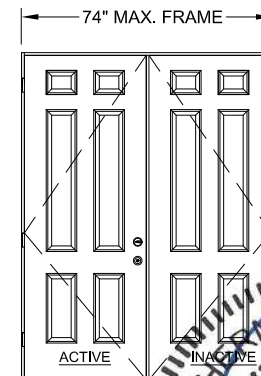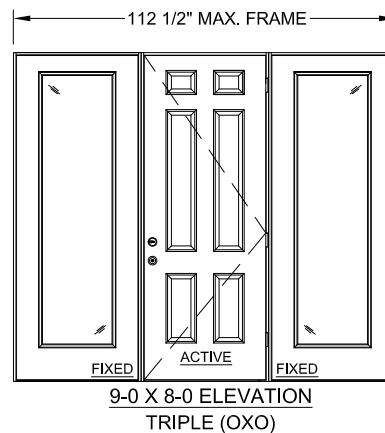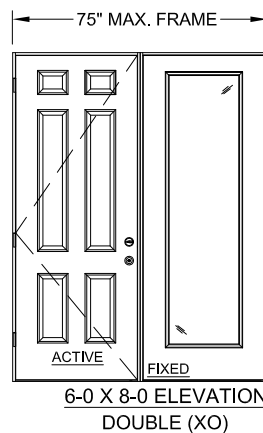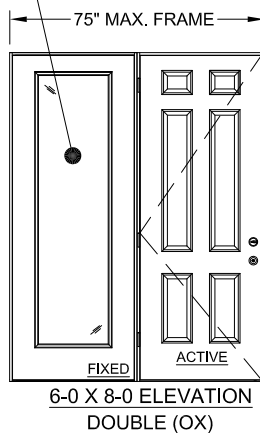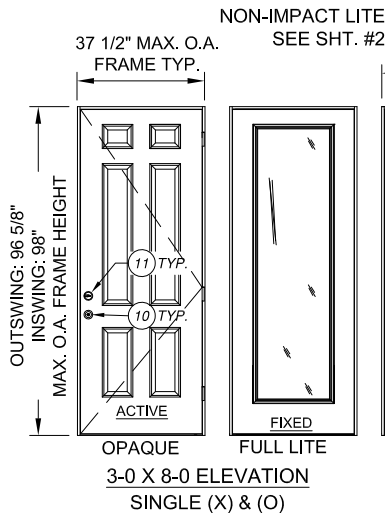

* NOTE: IF PRODUCT IS CONSTRUCTED USING THE OUTSWING ENDURA FOB4566 (SHOWN BELOW), THEN PRODUCT DOES NOT REQUIRE OVERHANG PROTECTION. OTHERWISE, REMAINING SILLS LISTED ON SHEETS 3 THRU. 6 HAVE NOT BEEN RATED FOR WATER INFILTRATION. IF AUTHORITY HAVING JURISDICTION VALIDATES THAT PRODUCT MEETS THIS AND/OR OTHER REQUIREMENTS, LISTED PRODUCT MAY BE USED WHEN INSTALLED AT LOCATION PROTECTED BY OVERHANG SUCH THAT OVERHANG (OH) RATIO = OH LENGTH ÷ OH HEIGHT IS ≥ 1.0




TABLE 1

DESIGN PRESSURE RATING:		
SIZE	QUALIFIES: OPAQUE ACTIVE PANELS WITH NON-IMPACT GLASS SIDELITES	
MAX. PANEL WIDTH = 35 3/4"	8-0 TALL SYSTEMS:	
	(XX) (XOX) (OXXO) (X) (OX) (XO) (OXO)	
OUTSWING	POSITIVE	+ 35*
	NEGATIVE	- 35*
INSWING	POSITIVE	+ 35*
	NEGATIVE	- 35*

COMPONENT LIST

ITEM	DESCRIPTION	MATERIAL	QTY.
1	NON-COMPRESSION SHIM (0.25" MAX. THK.)	WOOD	AS REQ.
2	2x WOOD SUB BUCK (S.G. MUST BE 0.55 OR GREATER)	WOOD	AS REQ.
3	1x WOOD SUB BUCK (S.G. MUST BE 0.55 OR GREATER)	WOOD	AS REQ.
4	#10 WOOD INSTALLATION SCREW W/ 1 1/2" MIN. EMBEDMENT	STEEL	AS REQ.
5	3/16" ITW TAPCON ANCHOR W/ 1 1/4" MIN. EMBEDMENT	STEEL	AS REQ.
6	#9 X 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL	2 OR 4
7	#8 X 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL	AS REQ.
8	#9 X 3/4" PHILLIPS FLATHEAD WOOD SCREW	STEEL	30 OR 60
9	1" O.A. IG NON-IMPACT FRAME GLAZED BY ODL	Polypropylene	1 OR 2
10	LOCK SERIES 400	STEEL	1
11	DEADBOLT SERIES 660	STEEL	1
12	FLAT LITE KIT	ALUMINUM	1
13	ADA THRESHOLD	ALUMINUM	1

JELD-WEN
WINDOWS & DOORS
3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451
Fax: (541) 850-2609

24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
WITH NON-IMPACT FULL SIDELITES
PART OR ASSEMBLY
GENERAL NOTES, ELEVATIONS, DP RATINGS
AND B.O.M.

SHEET INDEX	
SHEET #	DESCRIPTION
1	GENERAL NOTES, B.O.M., & ELEVATIONS
2	OUTSWING/INSWING BOX MULLING DETAILS
3	OUTSWING VERTICAL AND HORIZONTAL SECTIONS IN WOOD
4	OUTSWING VERT. AND HORIZ. SECTIONS IN MASONRY/CONCRETE
5	INSWING VERTICAL AND HORIZONTAL SECTIONS IN WOOD
6	INSWING VERT. AND HORIZ. SECTIONS IN MASONRY/CONCRETE
7	OUTSWING AND INSWING ANCHORING DETAILS

NO.	DATE	REVISIONS	BY
1	01/30/20	DWG NUM. CHANGE FROM JW142012FL TO D015860.	TB
		ADA THRESHOLD ADDED	


Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.09.26 09:04:27 +02'00'

HERMES F. NORERO
FLORIDA P.E. NO. 73778
398 E. DANIA BEACH BLVD. STE. 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTH. NO. 29578


DATE: 2/23/2012
SCALE: NONE
DWG. BY: G.LUBBECKE
CHK. BY: S.SAFFELL
DRAWING No.: D015860
SHEET 1 OF 7

7- #8 X 2"
PFH SCREW AT
EACH MULLION TYP.


APPLY DAP ALEX PLUS SILICONE
OR EQUIV. BETWEEN
JAMBS BEFORE MULLING

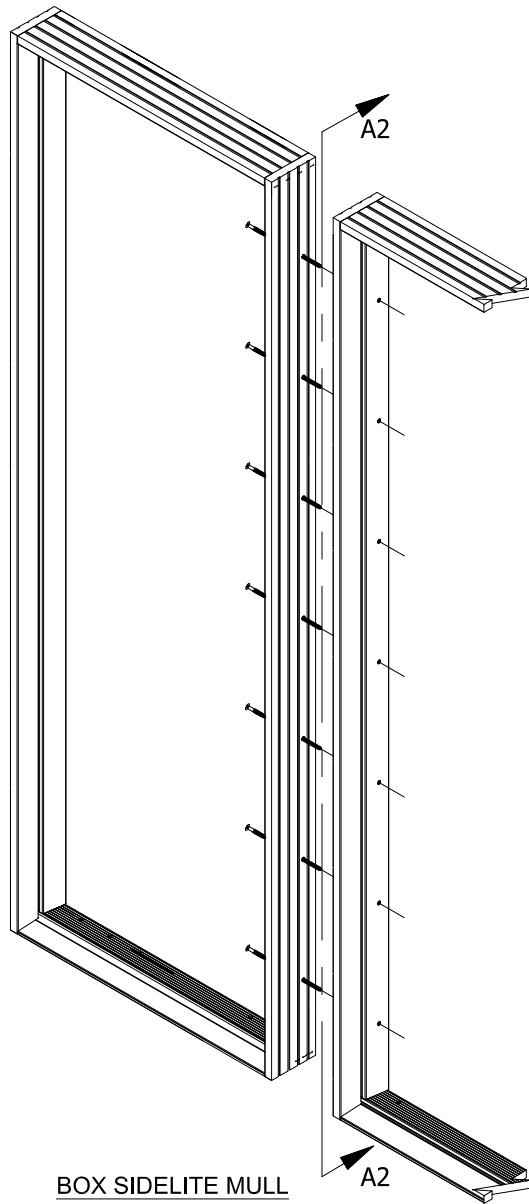


BOX SIDELITE MULL
MAX. 4 UNITS
EXAMPLE: OXXO, OXO, OX

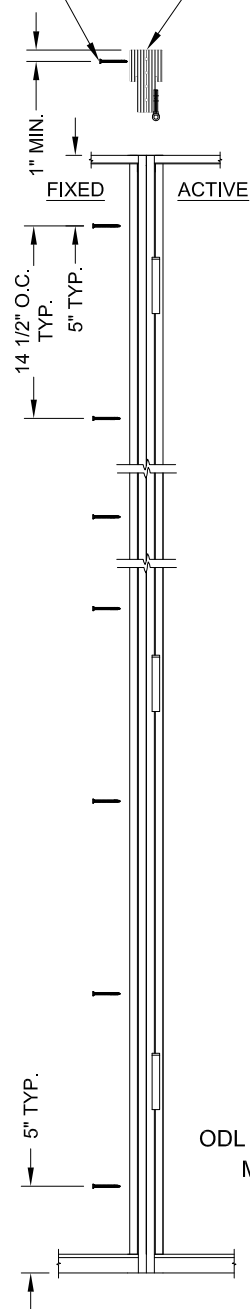


DETAIL A2
(7) FASTENER LOCATIONS AT
DOUBLE-BACK JAMB ATTACHMENT

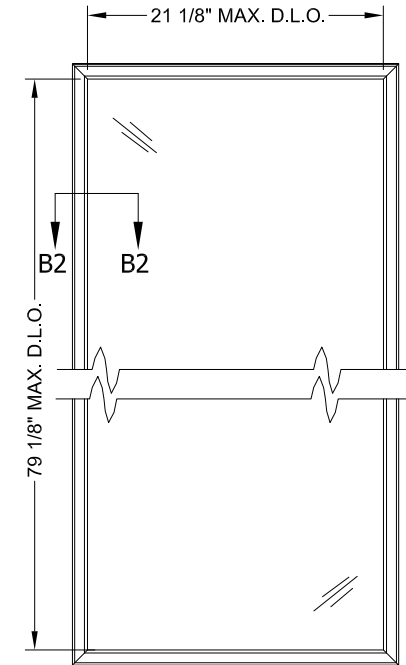

ODL LIP-LITE NON-IMPACT
3-0 X 8-0 SHOWN

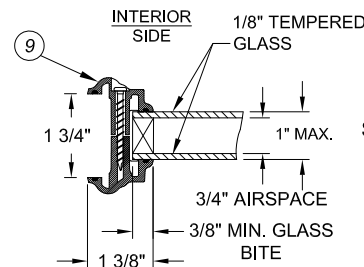

DETAIL B2
ODL NON-IMPACT GLAZING DETAIL
MAX. D.L.O.: 21 1/8" X 79 1/8"

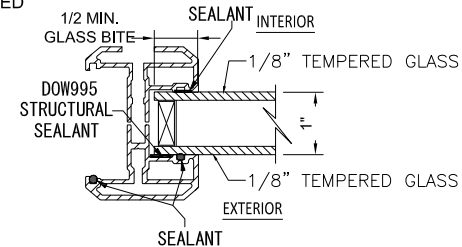

DETAIL
20 1/2" MAX. D.L.O. WIDTH
62 5/8" MAX. D.L.O. HEIGHT

JELD-WEN
WINDOWS & DOORS

3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451
Fax: (541) 850-2609


24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
WITH NON-IMPACT FULL SIDELITES

PART OR ASSEMBLY


MULLING DETAILS AND GLAZING OPTIONS

HERMES F. NORERO
FLORIDA P.E. NO. 73778
398 E. DANIA BEACH BLVD. STE. 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTH. NO. 29578


DATE: 2/23/2012
SCALE: NONE
DWG. BY: G.LUBBECKE
CHK. BY: S.SAFFELL
DRAWING No.: D015860
SHEET 2 OF 7

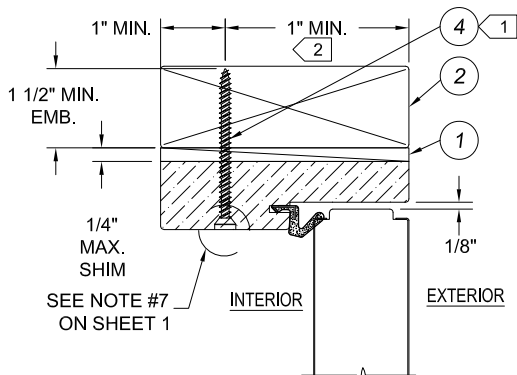

**OUTSWING OPERATING UNIT
VERTICAL CROSS SECTION
HEAD JAMB**


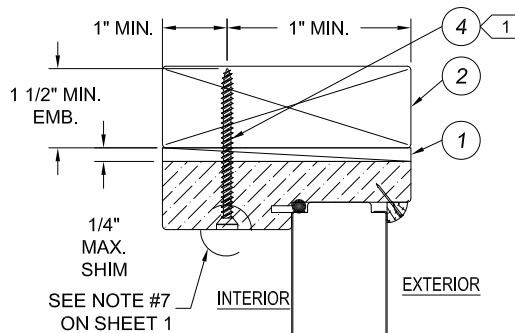


**OUTSWING FIXED UNIT
VERTICAL CROSS SECTION
HEAD JAMB**

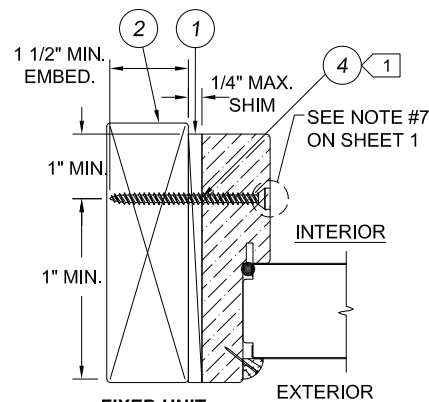


**FIXED UNIT
HORIZONTAL CROSS SECTION
OUTSWING SHOWN**


HINGE DETAIL:
TOP = 6 SCREWS (ITEM #8), 2 SCREWS (ITEM #6)
CENTER TOP = 8 SCREWS (ITEM #8)
CENTER BOTTOM = 8 SCREWS (ITEM #8)
BOTTOM = 8 SCREWS (ITEM #8)

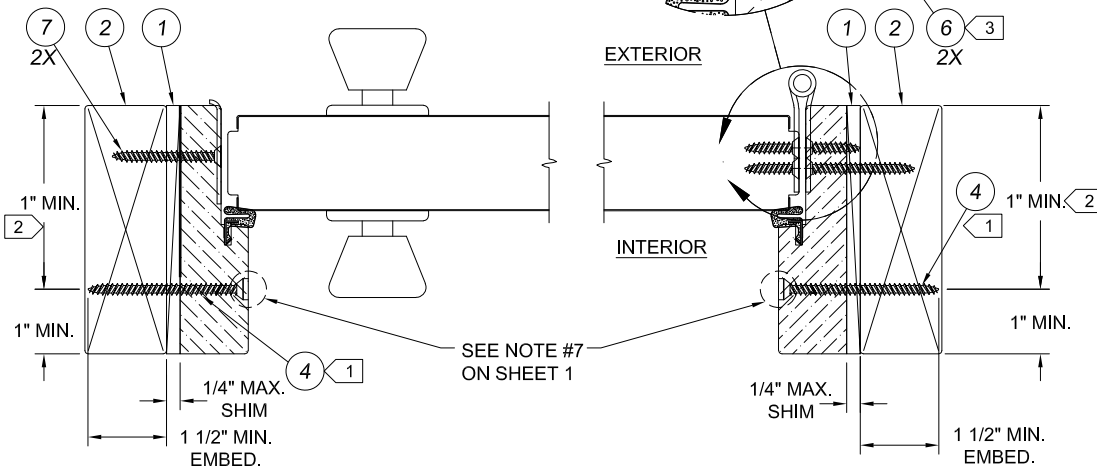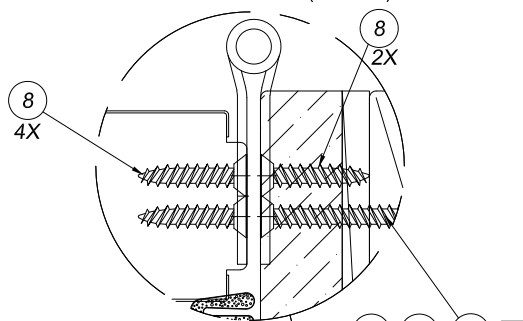


**OUTSWING LATCH JAMB AT FRAME
HORIZONTAL CROSS SECTION**

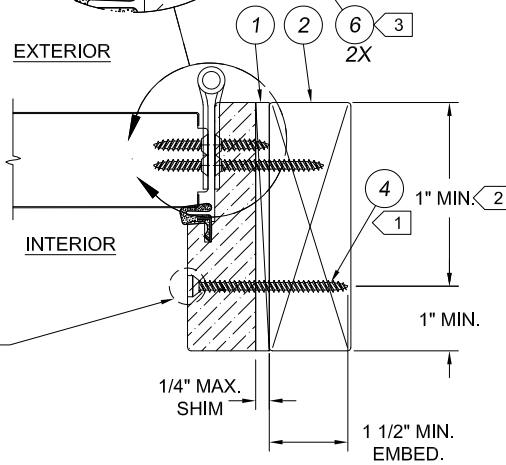


**OUTSWING HINGE JAMB AT FRAME
HORIZONTAL CROSS SECTION**

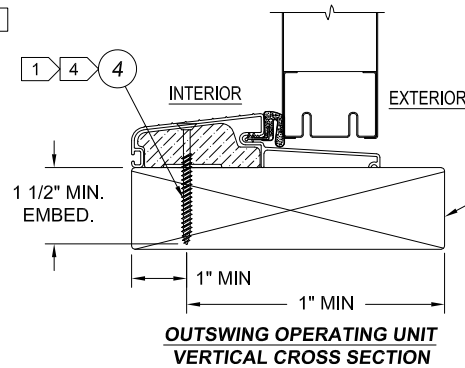


**OUTSWING OPERATING UNIT
VERTICAL CROSS SECTION**

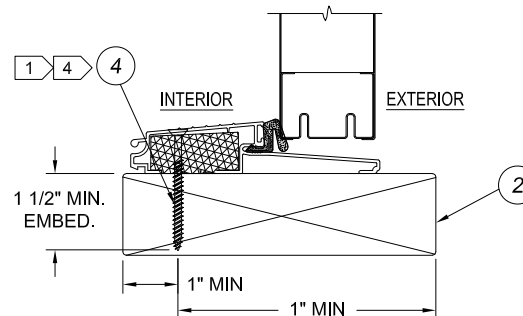

**OUTSWING OPERATING UNIT
VERTICAL CROSS SECTION**

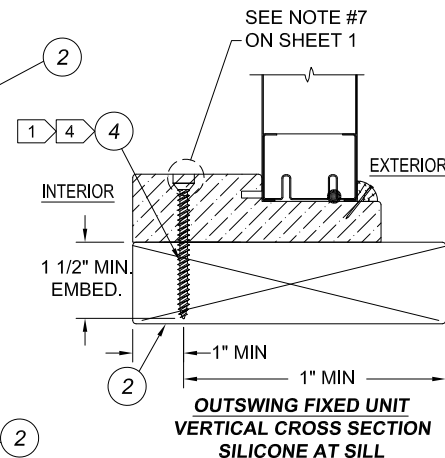


**OUTSWING FIXED UNIT
VERTICAL CROSS SECTION
SILICONE AT SILL**

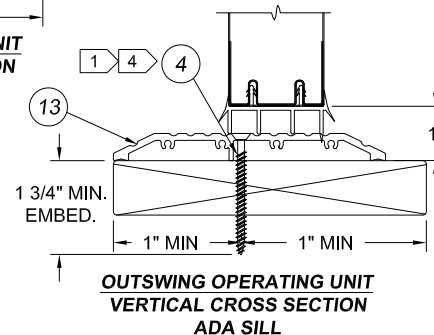

**OUTSWING OPERATING UNIT
VERTICAL CROSS SECTION
ADA SILL**

NOTES:


- 1 FOR PLACEMENT OF ITW TAPCON ANCHORS IN 2X BUCK OR 1X BUCK CONCRETE/MASONRY OPENINGS, SEE SHEET 4
- 2 OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT AND EDGE DISTANCE ARE ACHIEVED.
- 3 ITEM #6, (#9 X 2 1/2") TWO SCREWS TO BE INSTALLED IN TOP HINGE AT JOB SITE, CLOSEST TO WEATHERSTRIP.
- 4 AT SILL, PLACE ANCHOR IN SILL BASE MATERIAL FOR MAXIMUM SUPPORT.

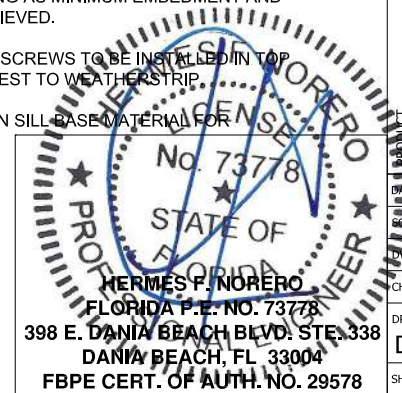

JELD-WEN
WINDOWS & DOORS
3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451
Fax: (541) 850-2609

24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
WITH NON-IMPACT FULL SIDELITES
PART OR ASSEMBLY
OUTSWING VERTICAL AND HORIZONTAL SECTIONS
IN WOOD

DATE: 2/23/2012
SCALE: NONE
DWG. BY: G.LUBBECKE
CHK. BY: S.SAFFELL
DRAWING No.: D015860
SHEET 3 OF 7

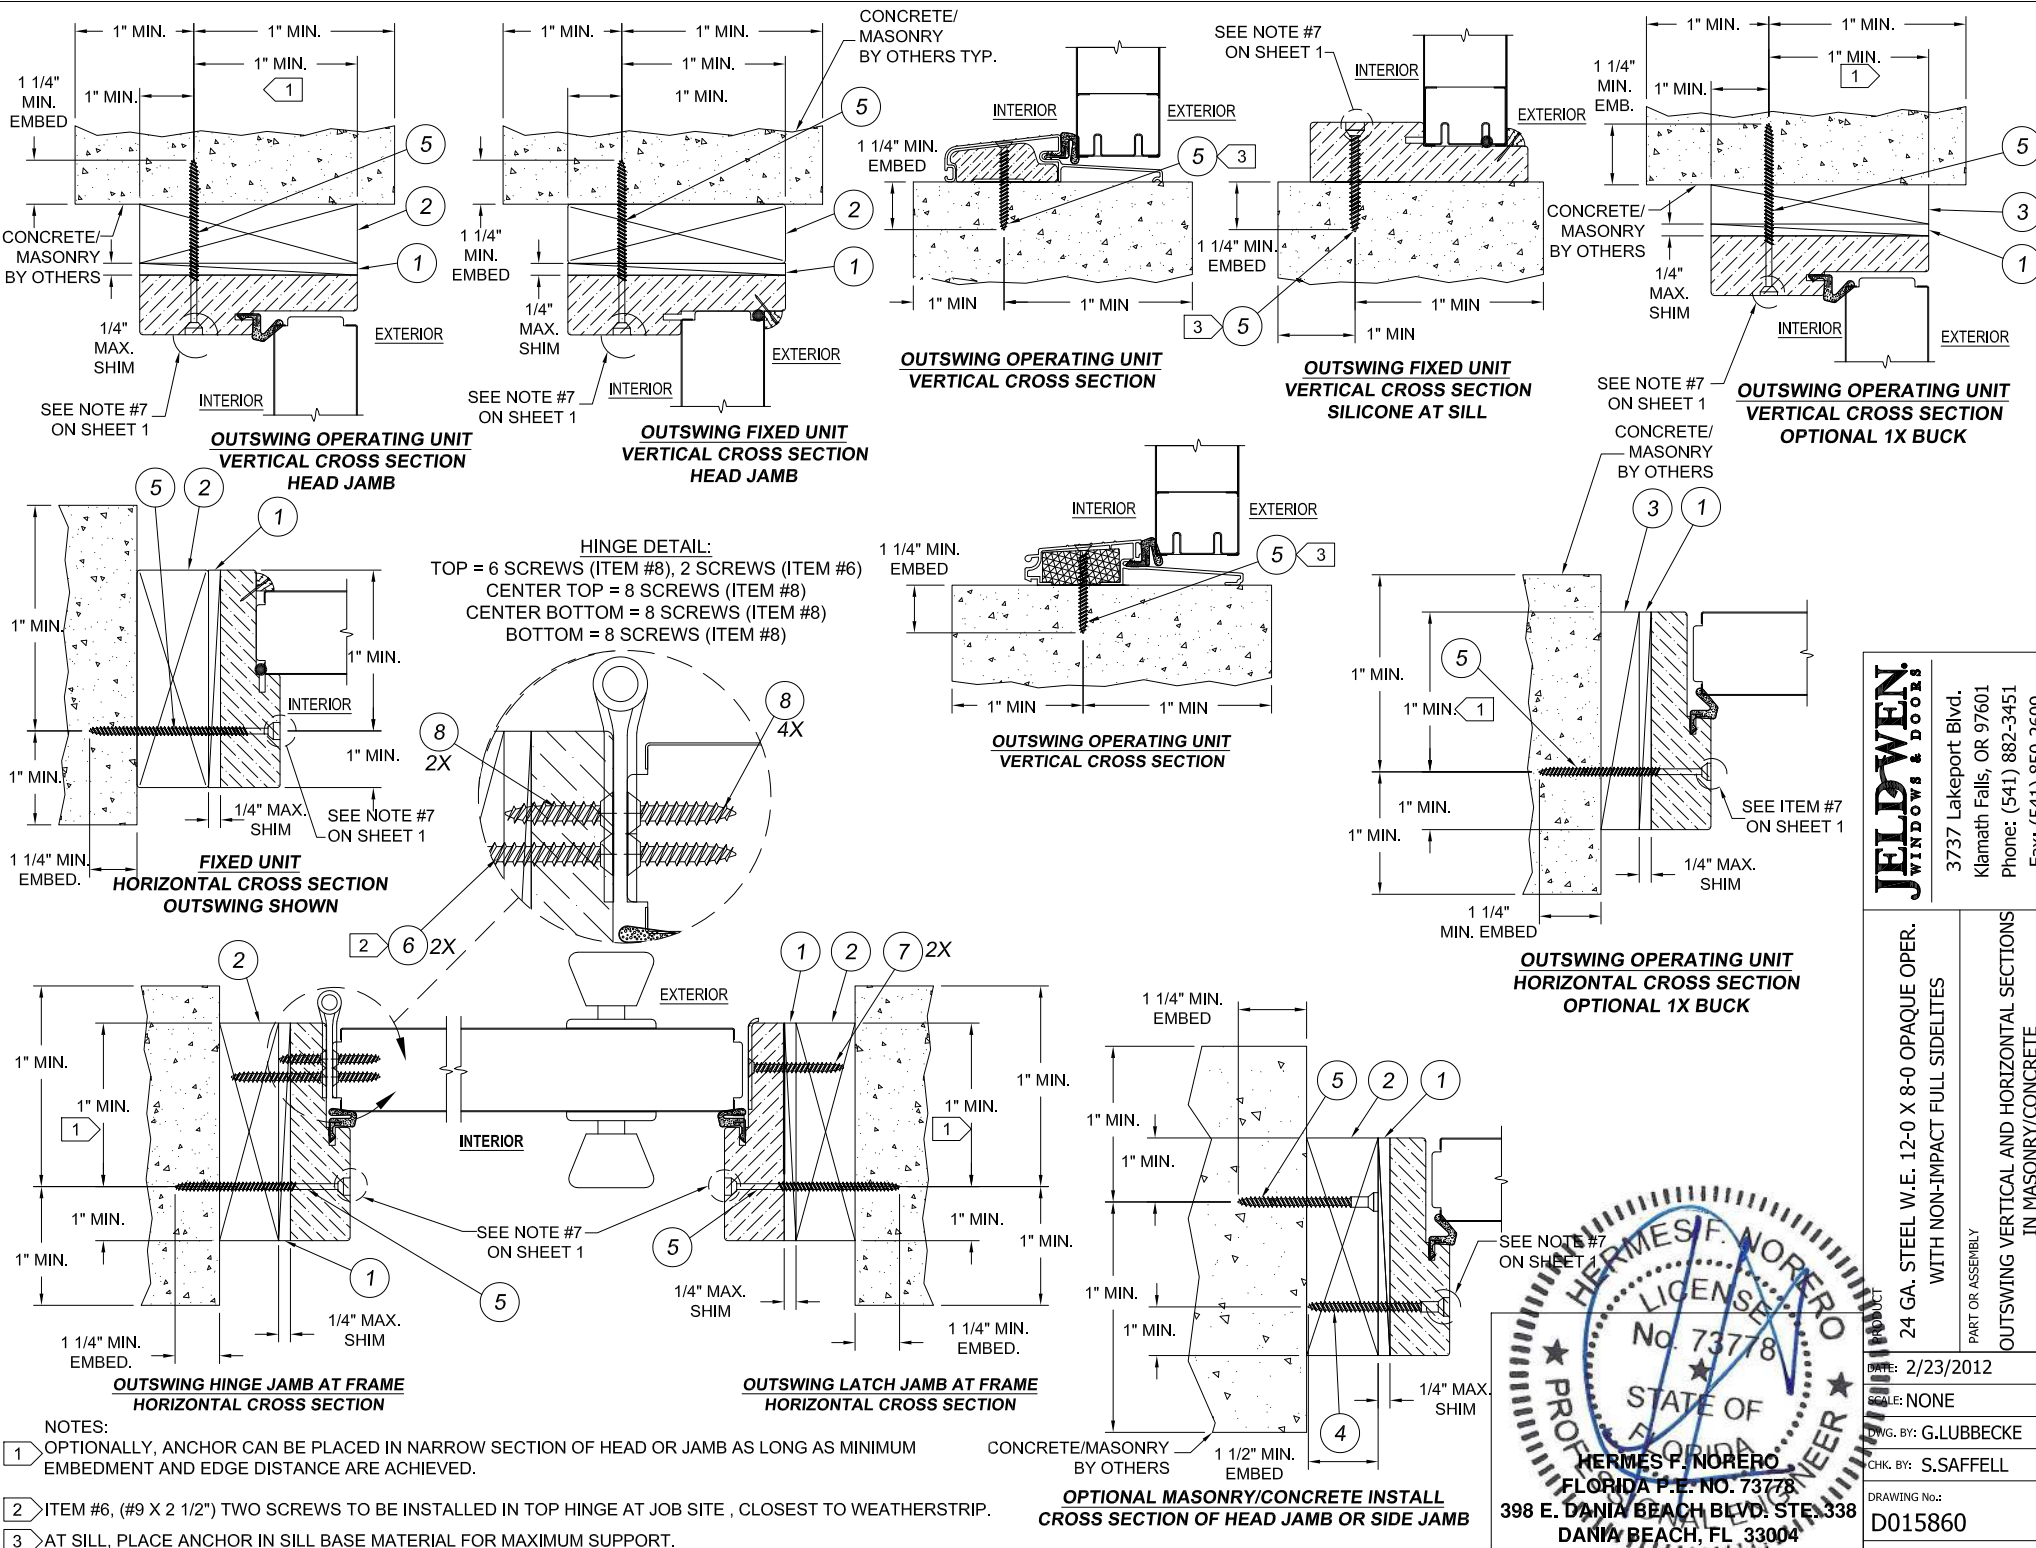


JELD-WEN
WINDOWS & DOORS

3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451
Fax: (541) 850-2609


24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
WITH NON-IMPACT FULL SIDELITES
PART OR ASSEMBLY
OUTSWING VERTICAL AND HORIZONTAL SECTIONS
IN MASONRY/CONCRETE

DATE: 2/23/2012
SCALE: NONE
DWG. BY: G.LUBBECKE
CHK. BY: S.SAFFELL
DRAWING No.: D015860
SHEET 4 OF 7


HERMES F. NORERO
LICENSED PROFESSIONAL ENGINEER
No. 73778
STATE OF FLORIDA
398 E. DANIA BEACH BLVD. STE. 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTH. NO. 29578

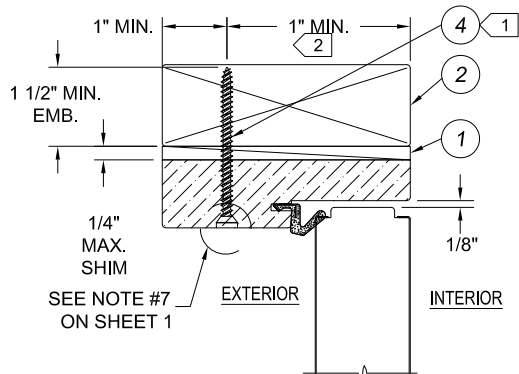


**INSWING OPERATING UNIT
VERTICAL CROSS SECTION
HEAD JAMB**

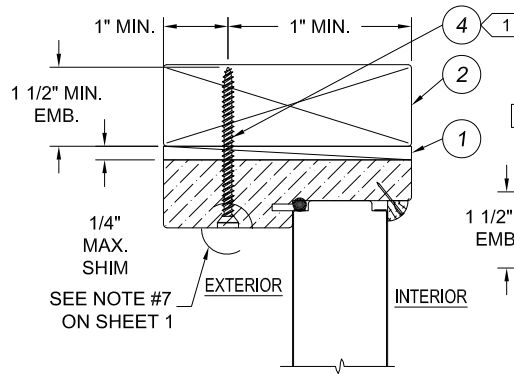


**INSWING FIXED UNIT
VERTICAL CROSS SECTION
HEAD JAMB**

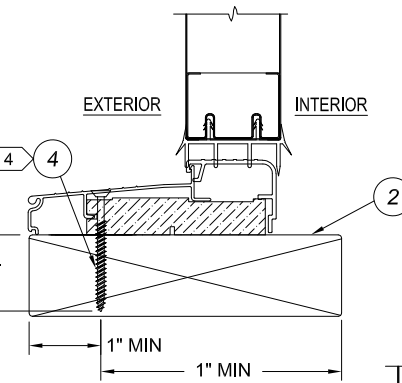

**INSWING OPERATING UNIT
VERTICAL CROSS SECTION**

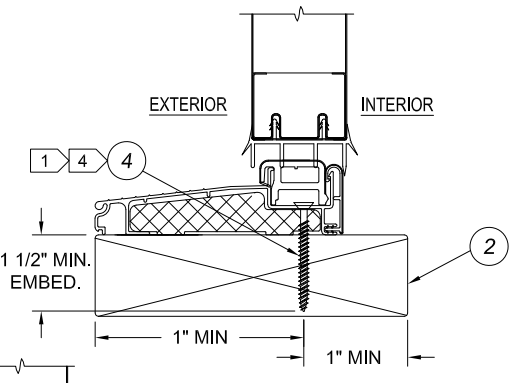


**INSWING OPERATING UNIT
VERTICAL CROSS SECTION**

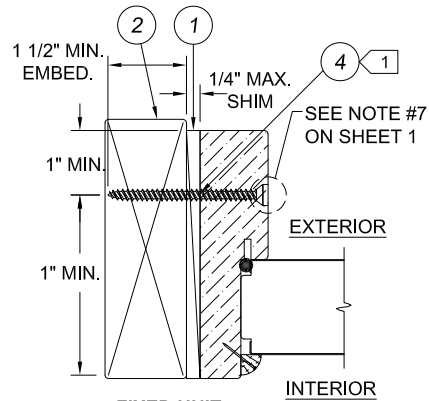


**FIXED UNIT
HORIZONTAL CROSS SECTION
INSWING SHOWN**


HINGE DETAIL:
TOP = 6 SCREWS (ITEM #8), 2 SCREWS (ITEM #6)
CENTER TOP = 8 SCREWS (ITEM #8)
CENTER BOTTOM = 8 SCREWS (ITEM #8)
BOTTOM = 8 SCREWS (ITEM #8)

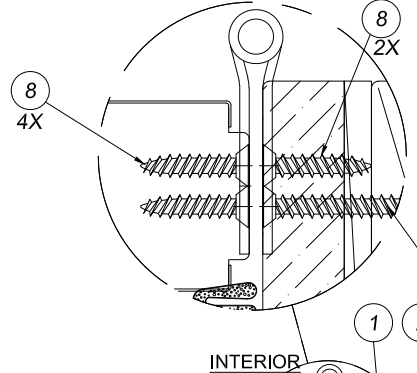


**INSWING OPERATING UNIT
VERTICAL CROSS SECTION
ADA SILL**

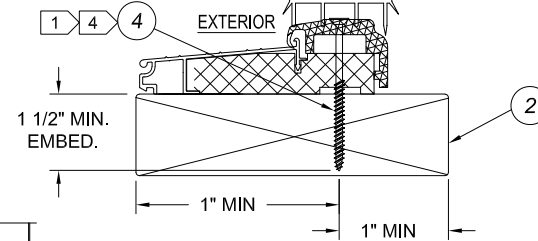

**INSWING OPERATING UNIT
VERTICAL CROSS SECTION**

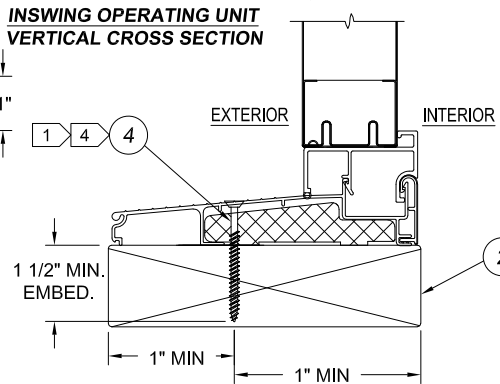


**INSWING FIXED UNIT
VERTICAL CROSS SECTION**

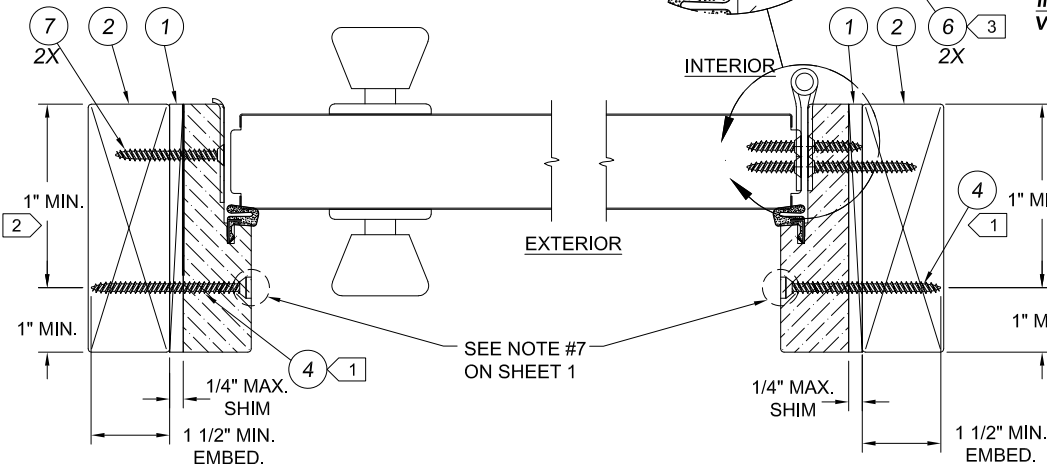

**INSWING LATCH JAMB AT FRAME
HORIZONTAL CROSS SECTION**

SEE NOTE #7
ON SHEET 1

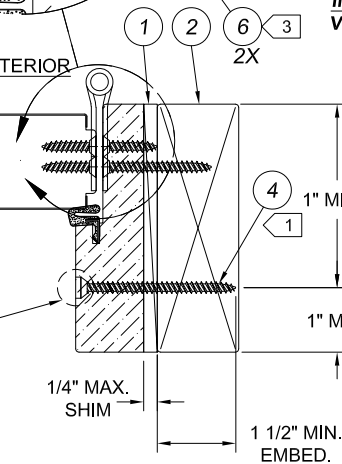

**INSWING HINGE JAMB AT FRAME
HORIZONTAL CROSS SECTION**

NOTES:
FOR PLACEMENT OF ITW TAPCON ANCHORS IN
2X BUCK OR 1X BUCK CONCRETE/MASONRY
OPENINGS, SEE SHEET 6

OPTIONALLY, ANCHOR CAN BE PLACED IN
NARROW SECTION OF HEAD OR JAMB AS
LONG AS MINIMUM EMBEDMENT AND EDGE
DISTANCE ARE ACHIEVED.

ITEM #6, (#9 X 2 1/2") TWO SCREWS TO BE
INSTALLED IN TOP HINGE AT JOB SITE,
CLOSEST TO WEATHERSTRIP.

AT SILL, PLACE ANCHOR IN SILL
BASE MATERIAL FOR MAXIMUM SUPPORT.




JELD-WEN
WINDOWS & DOORS

3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451
Fax: (541) 850-2609

24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
WITH NON-IMPACT FULL SIDELITES

PART OR ASSEMBLY
INSWING VERTICAL AND HORIZONTAL SECTIONS
IN WOOD

DATE: 2/23/2012
SCALE: NONE
DRAWN BY: G.LUBBECKE
CHK. BY: S.SAFFELL
DRAWING No.: D015860
SHEET 5 OF 7

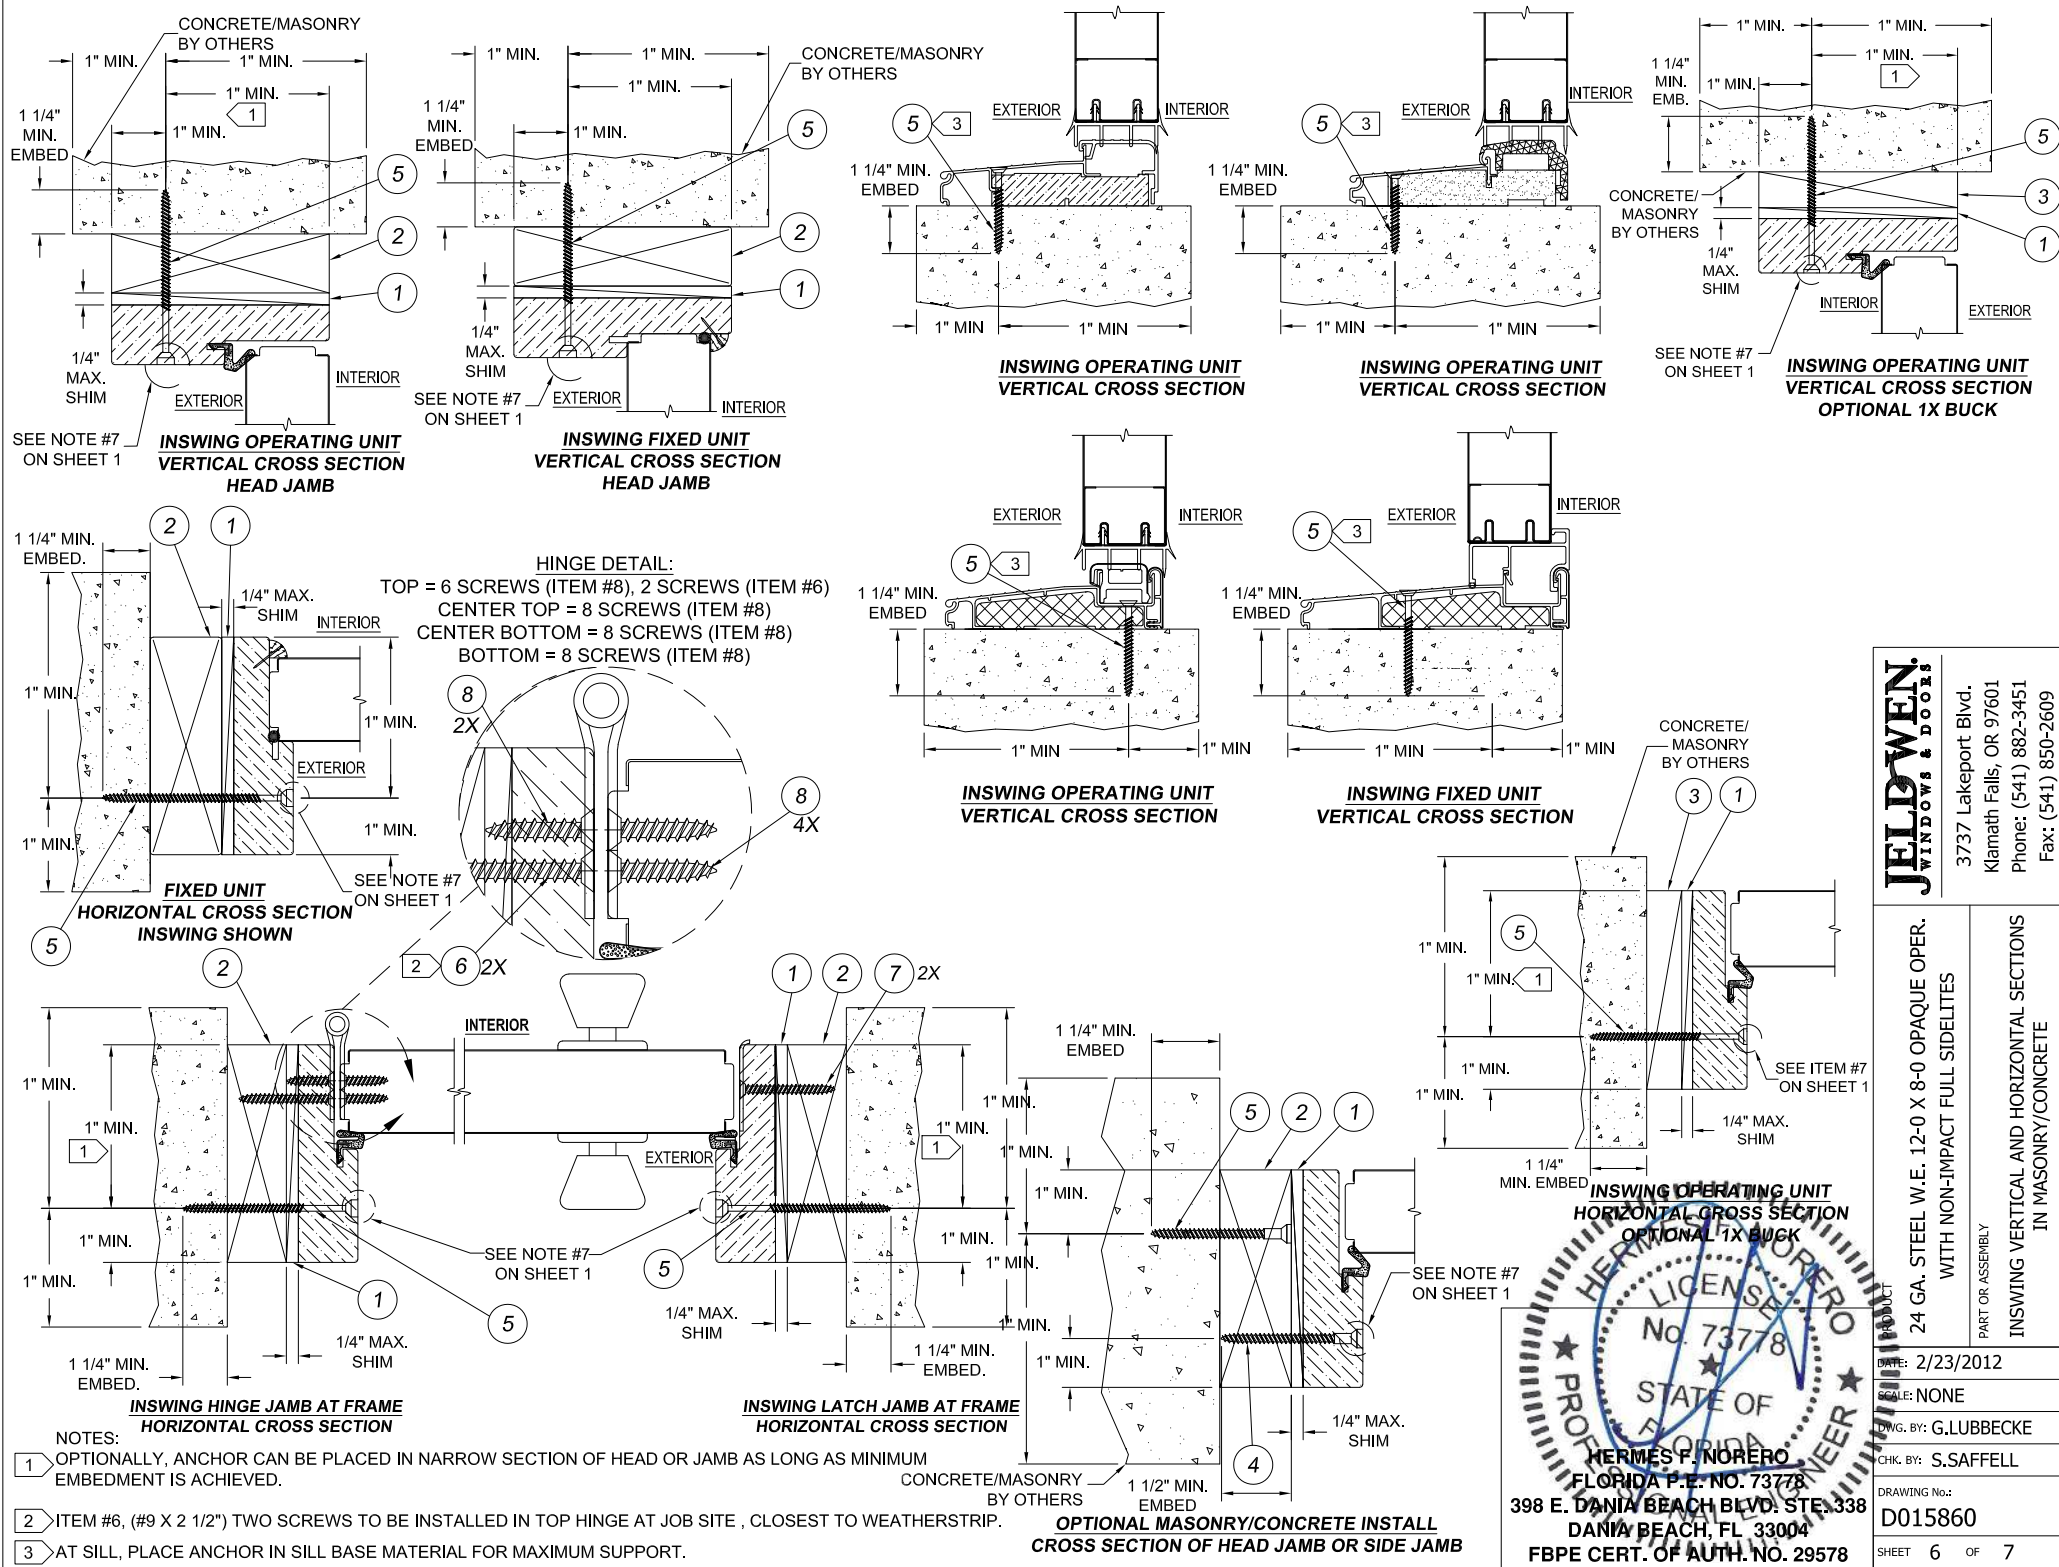


JELD-WEN
 WINDOWS & DOORS
 3737 Lakeport Blvd.
 Klamath Falls, OR 97601
 Phone: (541) 882-3451
 Fax: (541) 850-2609

24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
 WITH NON-IMPACT FULL SIDELITES
 PART OR ASSEMBLY
 INSWING VERTICAL AND HORIZONTAL SECTIONS
 IN MASONRY/CONCRETE

DATE: 2/23/2012
 SCALE: NONE
 DWG. BY: G.LUBBECKE
 CHK. BY: S.SAFFELL
 DRAWING No.: D015860
 SHEET 6 OF 7

HERMES F. NORERO
 FLORIDA P.E. NO. 73778
 398 E. DANIA BEACH BLVD. STE. 338
 DANIA BEACH, FL 33004
 FBPE CERT. OF AUTH. NO. 29578





NOTE:
SHIM FOR SUPPORT AT OR NEAR
EACH ANCHOR IS REQUIRED

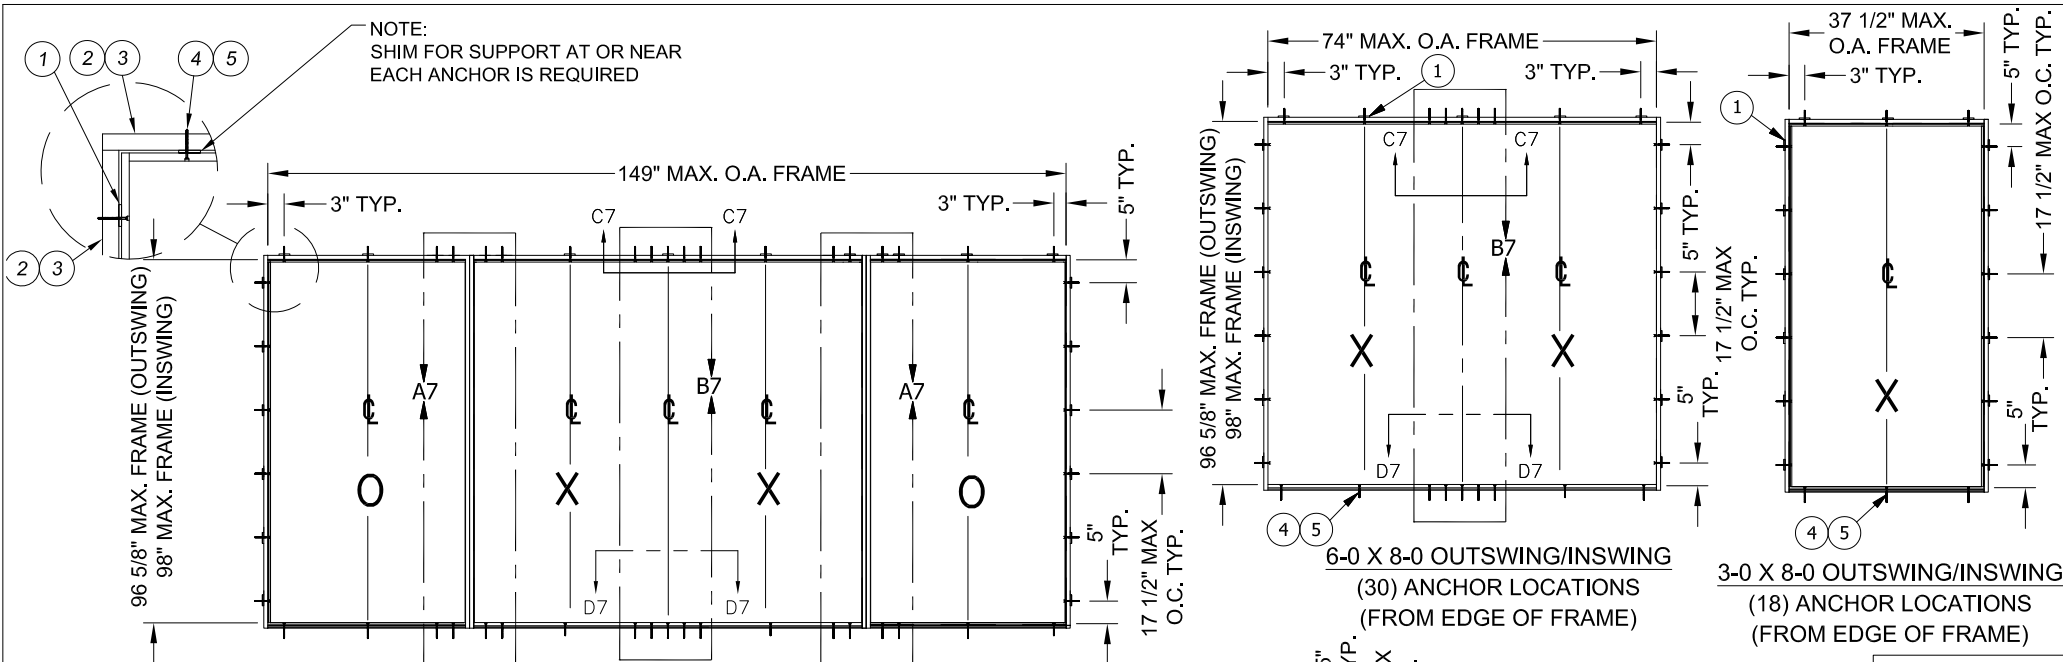


12-0 X 8-0 OUTSWING/INSWING
(50) ANCHOR LOCATIONS
(FROM EDGE OF FRAME)

6-0 X 8-0 OUTSWING/INSWING
(30) ANCHOR LOCATIONS
(FROM EDGE OF FRAME)


3-0 X 8-0 OUTSWING/INSWING
(18) ANCHOR LOCATIONS
(FROM EDGE OF FRAME)

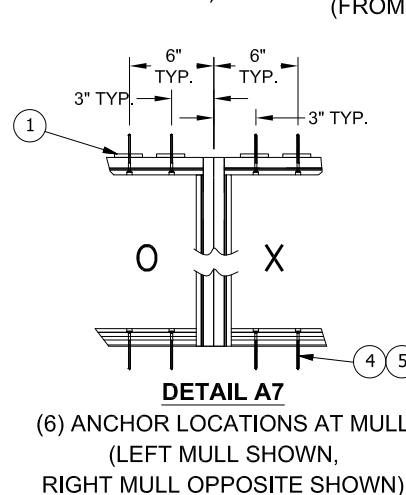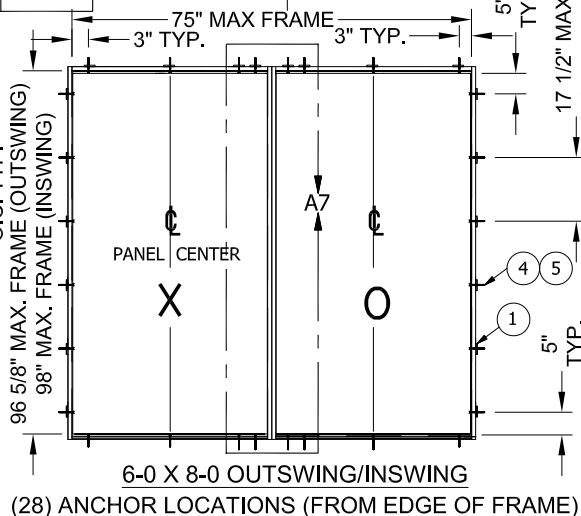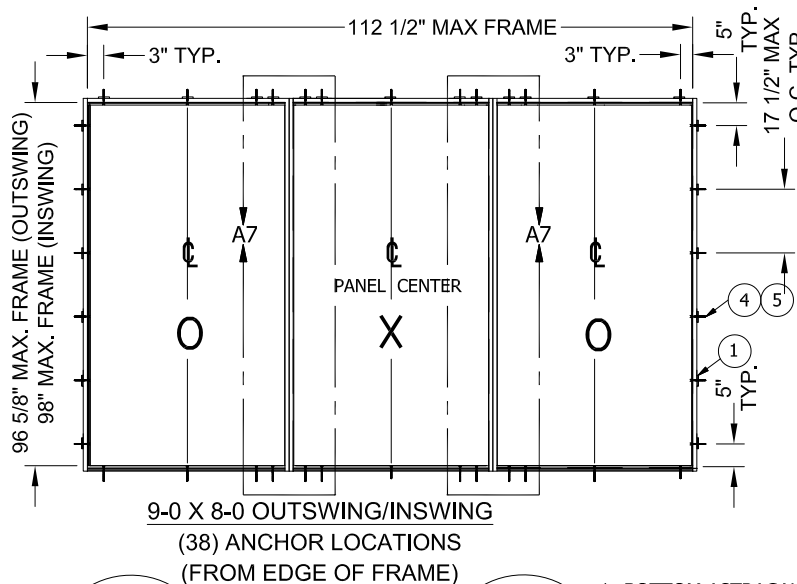


DETAIL C7-C7
OUTSWING OR INSWING



DETAIL D7-D7
OUTSWING ONLY



DETAIL D7-D7
INSWING ONLY

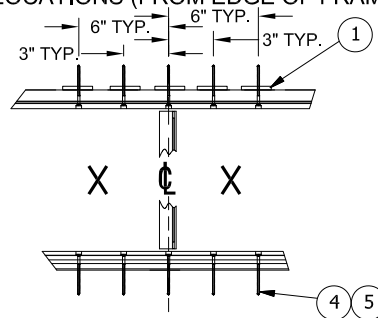

JELD-WEN
WINDOWS & DOORS

3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451
Fax: (541) 850-2609

24 GA. STEEL W.E. 12-0 X 8-0 OPAQUE OPER.
WITH NON-IMPACT FULL SIDELITES
PART OR ASSEMBLY
INSWING AND OUTSWING ANCHORING DETAILS

DATE: 2/23/2012

SCALE: NONE


DWG. BY: G.LUBBECKE

CHK. BY: S.SAFFELL

DRAWING No.:

D015860

SHEET 7 OF 7

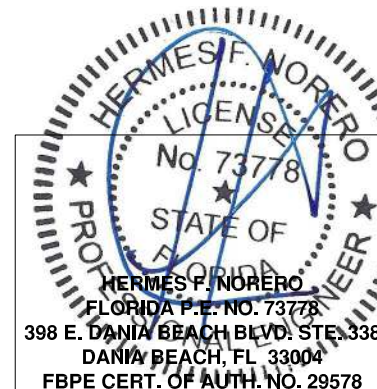



CJ Custom Carpentry, Inc
222 SW Cross Pointe Ct
Lake City, FL 32024
386-754-6924 Office
CGC1513223

Scope of work

Deenitris Weston
159 SE Kiwi Way
Lake City, FL 32056

Replace 2 back doors, size for size.