



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 4053698 - NORRIS CONST. - RUSSWOOD SPEC

MiTek, Inc.

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: JOHN NORRIS CONST. Project Name: Spec House Model: Custom
Lot/Block: TBD Subdivision: Russwood
Address: TBD, TBD
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.7
Wind Code: ASCE 7-22 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 20 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T34003287	CJ01	5/29/24	15	T34003301	T07	5/29/24
2	T34003288	CJ03	5/29/24	16	T34003302	T08	5/29/24
3	T34003289	CJ05	5/29/24	17	T34003303	T09	5/29/24
4	T34003290	EJ01	5/29/24	18	T34003304	T10	5/29/24
5	T34003291	HJ10	5/29/24	19	T34003305	T10G	5/29/24
6	T34003292	T01	5/29/24	20	T34003306	V01	5/29/24
7	T34003293	T01G	5/29/24				
8	T34003294	T02	5/29/24				
9	T34003295	T03	5/29/24				
10	T34003296	T03G	5/29/24				
11	T34003297	T04	5/29/24				
12	T34003298	T05	5/29/24				
13	T34003299	T05G	5/29/24				
14	T34003300	T06	5/29/24				


This item has been digitally signed and sealed by Lee, Julius, PE on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision based on the parameters
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: Lee, Julius
My license renewal date for the state of Florida is February 28, 2025.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

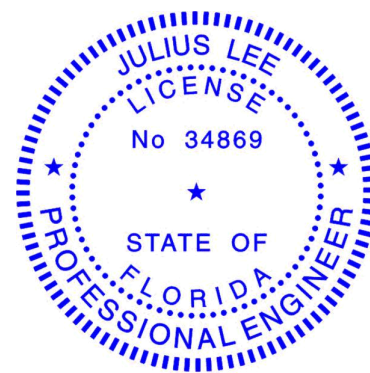


Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29, 2024

Lee, Julius

1 of 1

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:48 2024 Page 1
ID:NfQKPK0vtjt52FdA3Ad5P4zC2NR-Pjr7g_ogBZPQqC2_T1AUuCHKdPWHIFHuludSEzzByjl



LUMBER- TOP CHORD 2x4 SP No.2 BOT CHORD 2x4 SP No.2 WEDGE Left: 2x4 SP No.3	BRACING- TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
--	--

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

May 29, 2024



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-LLS.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003288
4053698	CJ03	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:48 2024 Page 1
ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-Pjr7g_ogBZPQqC2_T1AUuCHKdPVVIFHuludSEzzBylj

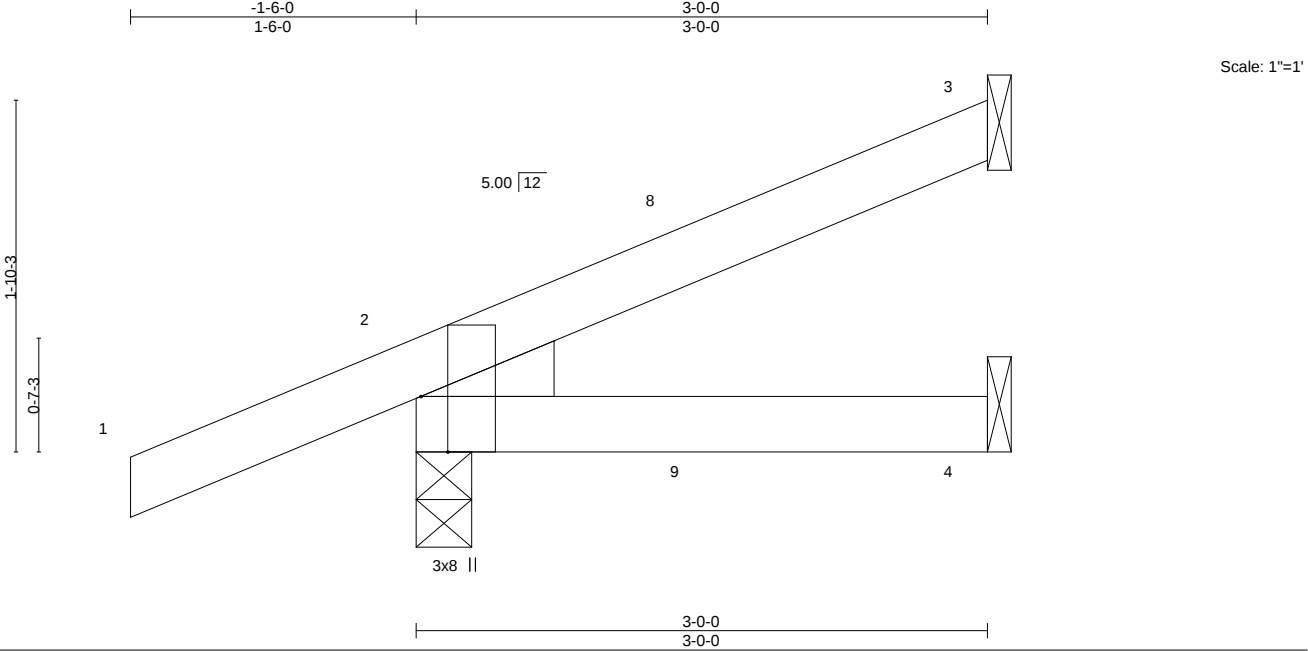


Plate Offsets (X,Y)--		[2:0-3-8,Edge]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15
TCDL 7.0	Lumber DOL	1.25	BC 0.06
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MP
DEFL.	in (loc)	I/defl	L/d
Vert(LL)	0.01	4-7	>999
Vert(CT)	-0.01	4-7	>999
Horz(CT)	-0.00	3	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 13 lb	FT = 20%		

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=68(LC 12)
Max Uplift 3=-38(LC 12), 2=-97(LC 8), 4=-21(LC 9)
Max Grav 3=58(LC 1), 2=210(LC 1), 4=49(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 2-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 3, 97 lb uplift at joint 2 and 21 lb uplift at joint 4.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003289
4053698	CJ05	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:49 2024 Page 1

ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-tvOVuKolxtXHSMdA1IijQPqTYppA1iX2XYN0nQzByli

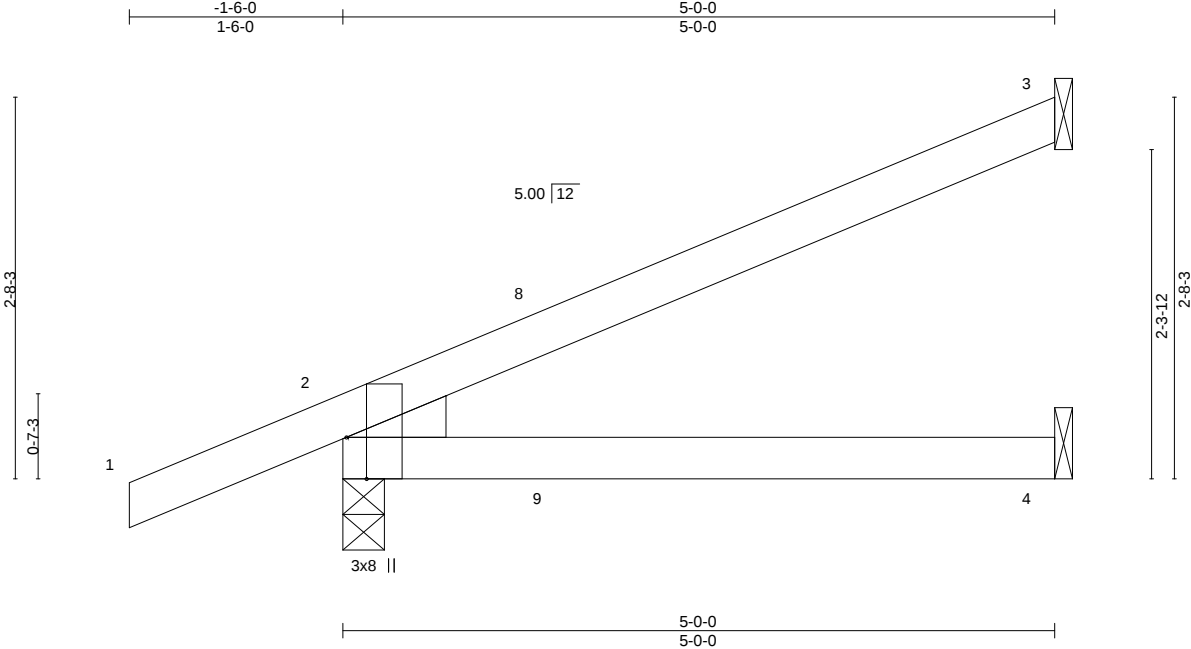


Plate Offsets (X,Y)--		[2:0-3-8,Edge]	
LOADING (psf)		SPACING-	2-0-0
TCLL 20.0		Plate Grip DOL	1.25
TCDL 7.0		Lumber DOL	1.25
BCLL 0.0 *		Rep Stress Incr	YES
BCDL 10.0		Code	FBC2023/TPI2014
		CSI.	
		TC 0.27	
		BC 0.23	
		WB 0.00	
		Matrix-MP	
		DEFL.	
		in (loc)	I/defl L/d
		Vert(LL) 0.05 4-7 >999	240
		Vert(CT) -0.05 4-7 >999	180
		Horz(CT) -0.01 3 n/a	n/a
		PLATES	GRIP
		MT20	244/190
		Weight: 19 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=100(LC 12)
Max Uplift 3=-72(LC 12), 2=-119(LC 8), 4=-35(LC 9)
Max Grav 3=112(LC 1), 2=276(LC 1), 4=87(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 3, 119 lb uplift at joint 2 and 35 lb uplift at joint 4.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003290
4053698	EJ01	Jack-Partial	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:49 2024 Page 1

ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-tvOVuKoltXtHSMdA1lijQPqOBp1x1iX2XYN0nQzByli

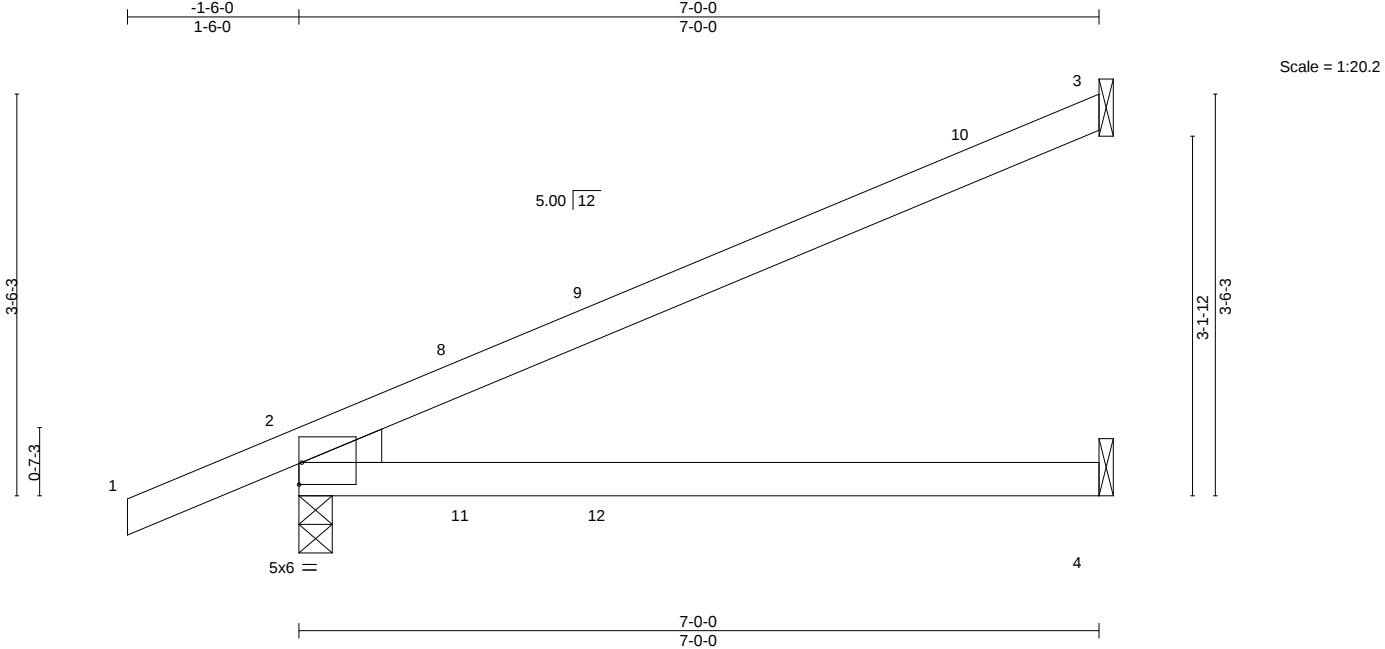


Plate Offsets (X,Y)--		[2:Edge,0-2-5]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.61	Vert(LL)	0.19	4-7	>441	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.50	Vert(CT)	-0.21	4-7	>391	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.03	2	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS						Weight: 25 lb FT = 20%		

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=128(LC 12)
Max Uplift 3=-92(LC 12), 2=-144(LC 8), 4=-49(LC 9)
Max Grav 3=163(LC 1), 2=346(LC 1), 4=124(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 92 lb uplift at joint 3, 144 lb uplift at joint 2 and 49 lb uplift at joint 4.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003291
4053698	HJ10	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:50 2024 Page 1
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-L5yt5gpxiBf83WCNbSDydzdMZwC24m3aBmB6ZJszBylh

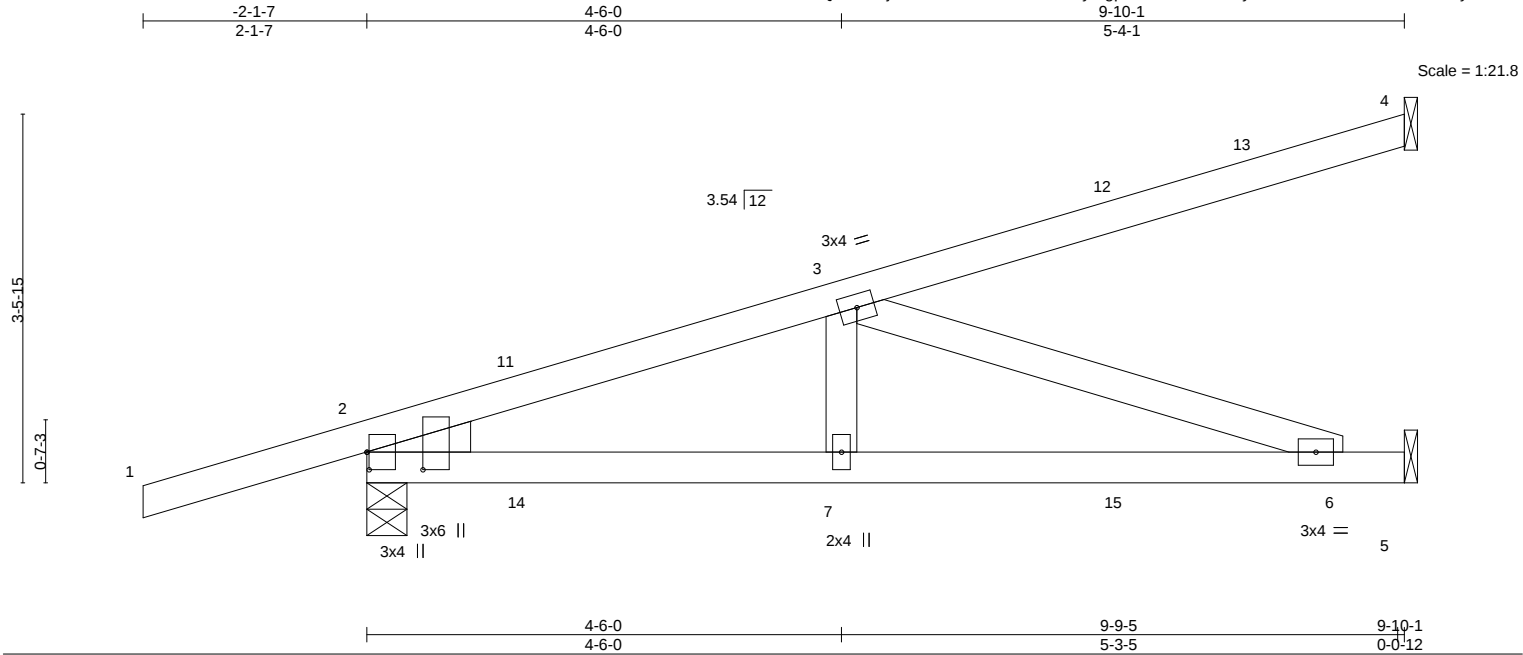


Plate Offsets (X,Y)--		[2:0-2-0,0-0-4], [2:0-2-0,0-6-6]						
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.61	Vert(LL) 0.12	6-7	>951	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.70	Vert(CT) -0.15	6-7	>772	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.40	Horz(CT) 0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS					Weight: 44 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 7-10-7 oc bracing.
WEBS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. (size) 4=Mechanical, 5=Mechanical, 2=0-4-9
Max Horz 2=139(LC 4)
Max Uplift 4=-88(LC 4), 5=-186(LC 4), 2=-315(LC 4)
Max Grav 4=154(LC 1), 5=296(LC 1), 2=529(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-784/425
BOT CHORD 2-7=-483/729, 6-7=-483/729
WEBS 3-7=-102/275, 3-6=-770/510

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 88 lb uplift at joint 4, 186 lb uplift at joint 5 and 315 lb uplift at joint 2.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 66 lb down and 76 lb up at 1-6-1, 66 lb down and 76 lb up at 1-6-1, 23 lb down and 44 lb up at 4-4-0, 23 lb down and 44 lb up at 4-4-0, and 45 lb down and 82 lb up at 7-1-15, and 45 lb down and 82 lb up at 7-1-15 on top chord, and 40 lb down and 40 lb up at 1-6-1, 40 lb down and 40 lb up at 1-6-1, 19 lb down and 29 lb up at 4-4-0, 19 lb down and 29 lb up at 4-4-0, and 41 lb down and 50 lb up at 7-1-15, and 41 lb down and 50 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 5-8=-20

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003291
4053698	HJ10	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:50 2024 Page 2
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-L5yt5gpxiBf83WCNbSDyzdMZwC24m3aBmB6ZJsZBylh

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 7=-9(F=-5, B=-5) 12=-70(F=-35, B=-35) 15=-61(F=-31, B=-31)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003292
4053698	T01	Common	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:50 2024 Page 1

ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-L5yt5gpxiBf83WCNbSDydzdMWQC_gm4cBmB6ZJsZBylh

-1-6-0
1-6-0

6-2-13
6-2-13


12-3-8
6-0-11

18-4-3
6-0-11

24-7-0
6-2-13

26-1-0
1-6-0

Scale = 1:44.2

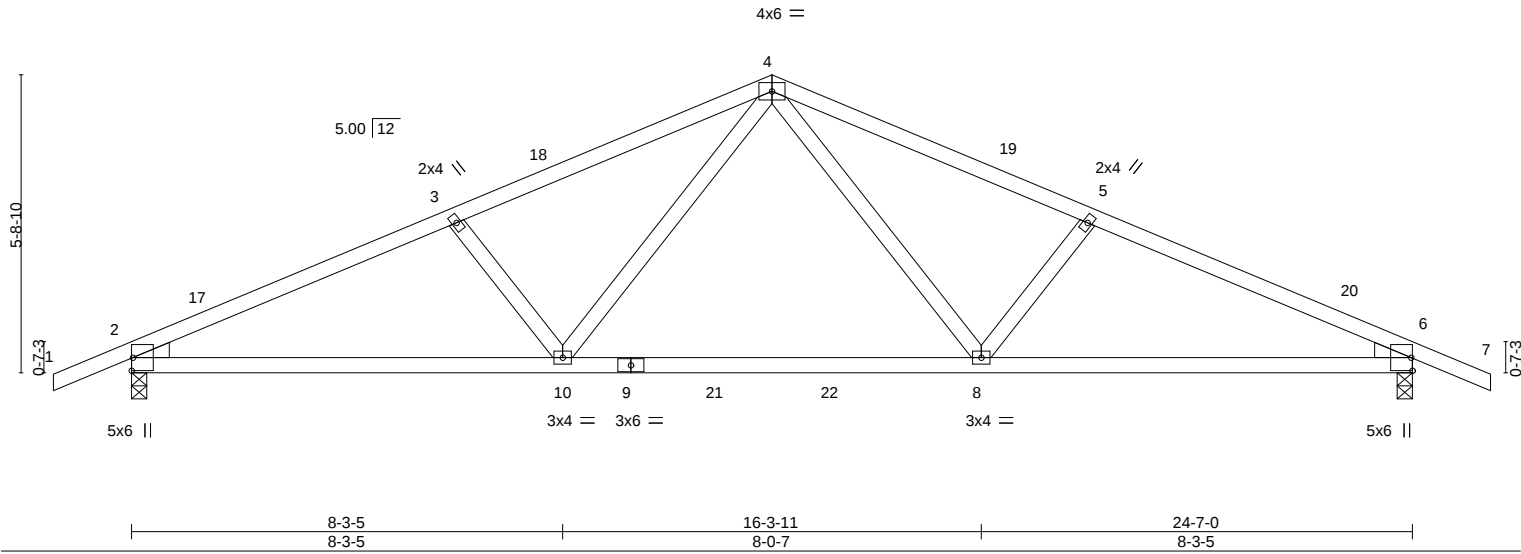

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.77	Vert(LL) -0.33	8-10	>897	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.92	Vert(CT) -0.62	8-10	>479	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.33	Horz(CT) 0.07	6	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS					Weight: 113 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-9 oc purlins.
BOT CHORD 2x4 SP No.1 *Except* 6-9: 2x4 SP 2850F 2.0E or 2x4 SP M 31	BOT CHORD Rigid ceiling directly applied or 8-0-10 oc bracing.
WEBS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3 , Right: 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=96(LC 12)
Max Uplift 2=-353(LC 12), 6=-353(LC 13)
Max Grav 2=1262(LC 2), 6=1262(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2318/630, 3-4=-2177/600, 4-5=-2185/602, 5-6=-2326/632
BOT CHORD 2-10=-592/2085, 8-10=-321/1464, 6-8=-498/2092
WEBS 4-8=-252/870, 5-8=-274/206, 4-10=-249/858, 3-10=-273/205

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 12-3-8, Zone2 12-3-8 to 16-6-7, Zone1 16-6-7 to 26-1-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 353 lb uplift at joint 2 and 353 lb uplift at joint 6.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-7=-54, 10-11=-20, 8-10=-80(F=-60), 8-14=-20

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003293
4053698	T01G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:51 2024 Page 1

ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-qlWGJ0qZTUn?hgnZ9AkBVqvsHcYeVcFL_rs7rizBylg

24-7-0 26-1-0 12-3-8 1-6-0 1-6-0 12-3-8 12-3-8 1-6-0

Scale = 1:45.7

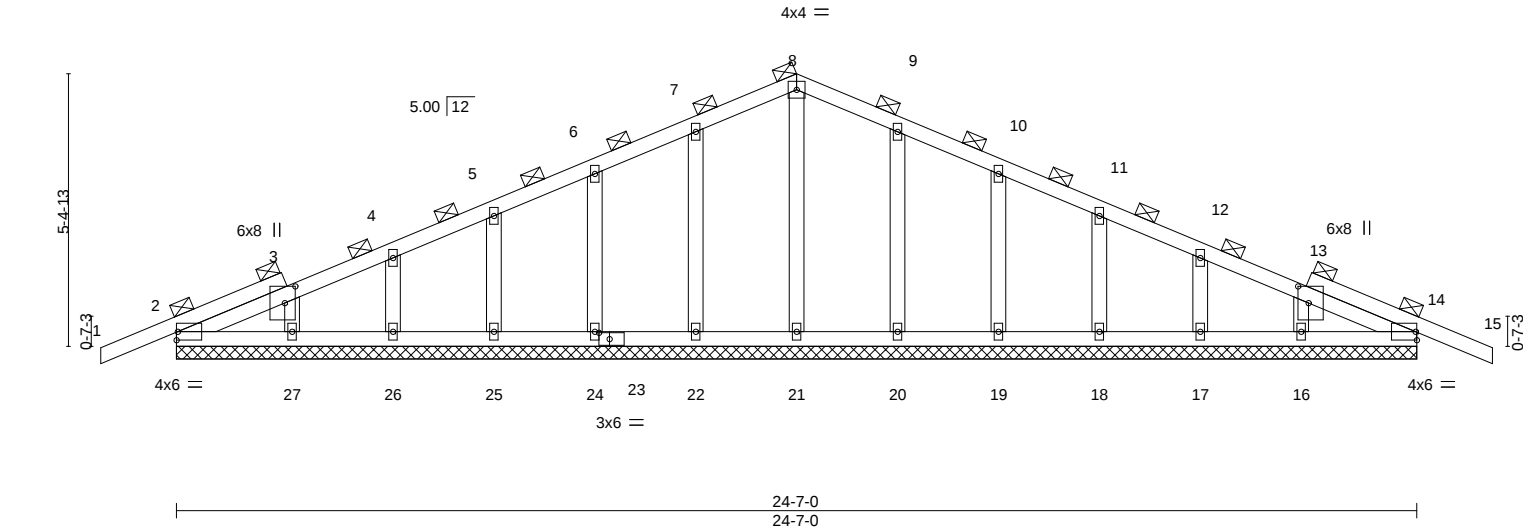


Plate Offsets (X,Y)-- [3:0-4-0,0-2-8], [13:0-4-0,0-2-8], [23:0-2-8,0-1-8]						
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.
TCLL	20.0	Plate Grip DOL	1.25	TC	0.13	in (loc) l/defl L/d
TCDL	7.0	Lumber DOL	1.25	BC	0.04	Vert(LL) -0.01 15 n/r 120
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.05	Vert(CT) -0.01 15 n/r 120
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		Horz(CT) 0.00 14 n/a n/a
				PLATES		GRIP
				MT20		244/190
				Weight: 130 lb		FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	2-0-0 oc purlins (6-0-0 max.).
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3		

REACTIONS. All bearings 24-7-0.
(lb) - Max Horz 2=-91(LC 17)
Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 22, 24, 25, 26, 27, 20, 19, 18, 17, 16
Max Grav All reactions 250 lb or less at joint(s) 2, 14, 21, 22, 24, 25, 26, 27, 20, 19, 18, 17, 16

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 22, 24, 25, 26, 27, 20, 19, 18, 17, 16.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.


This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003294
4053698	T02	Common	7	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:52 2024 Page 1
ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-IU4eWMrBEovsJqLlitFQ22Rsw0gxEx_6UDVbgOkzBylf
-1-6-0 6-2-13 12-3-8 18-4-3 24-7-0
1-6-0 6-2-13 6-0-11 6-0-11 6-2-13

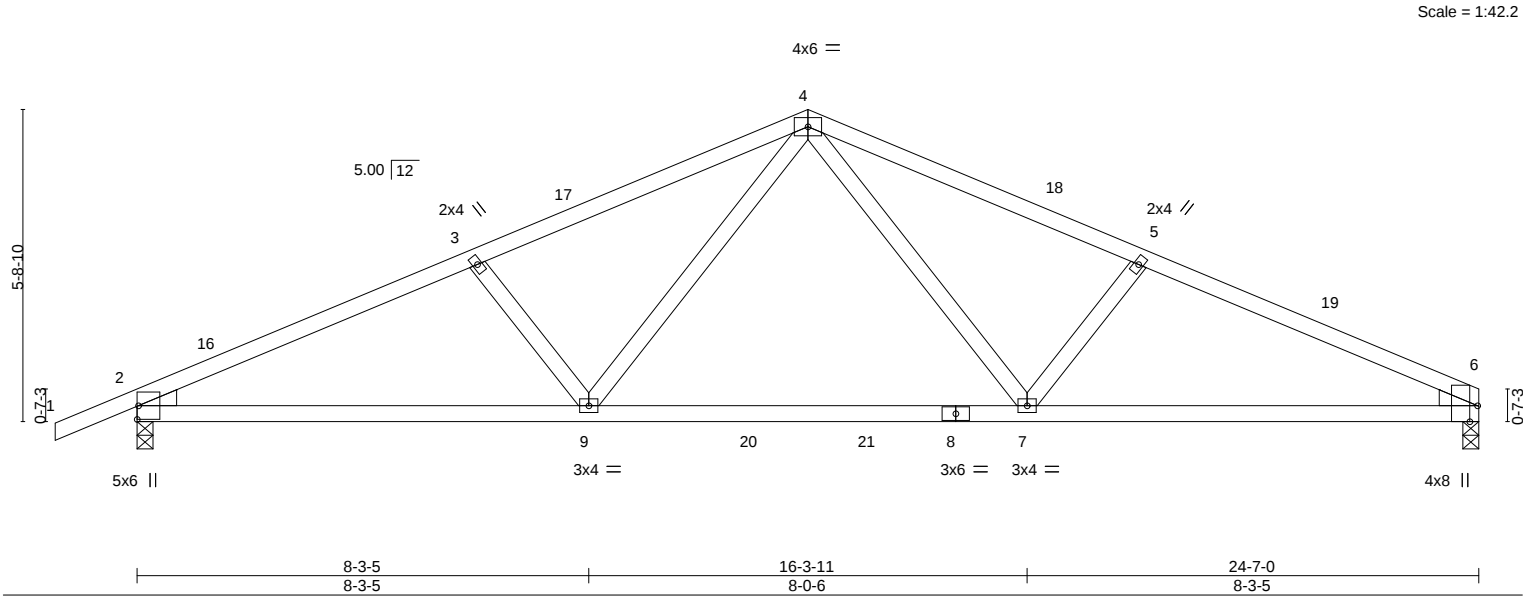

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.77	Vert(LL)	-0.32	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.93	Vert(CT)	-0.61				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.33	Horz(CT)	0.06				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 110 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-0-7 oc purlins.
BOT CHORD	2x4 SP 2850F 2.0E or 2x4 SP M 31 *Except*	BOT CHORD	Rigid ceiling directly applied or 8-6-10 oc bracing.
WEBS	2x4 SP No.3		
WEDGE			
Left: 2x4 SP No.3 , Right: 2x4 SP No.3			

REACTIONS.	
(size)	2=0-3-8, 6=0-3-8
Max Horz	2=106(LC 12)
Max Uplift	2=-353(LC 12), 6=-315(LC 13)
Max Grav	2=1264(LC 2), 6=1194(LC 2)

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2329/633, 3-4=-2188/602, 4-5=-2189/610, 5-6=-2332/639
BOT CHORD	2-9=-605/2095, 7-9=-332/1468, 6-7=-525/2099
WEBS	4-7=-256/868, 5-7=-280/209, 4-9=-252/868, 3-9=-274/206

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 12-3-8, Zone2 12-3-8 to 16-6-7, Zone1 16-6-7 to 24-7-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=353, 6=315.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard	
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25	
Uniform Loads (plf)	
Vert: 1-4=-54, 4-6=-54, 9-10=-20, 7-9=-80(F=-60), 7-13=-20	

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003296
4053698	T03G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:53 2024 Page 1
ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-mge0khrp?61jw_wxGbmfbF_BfQD2zVdeS9LDwBzByLe

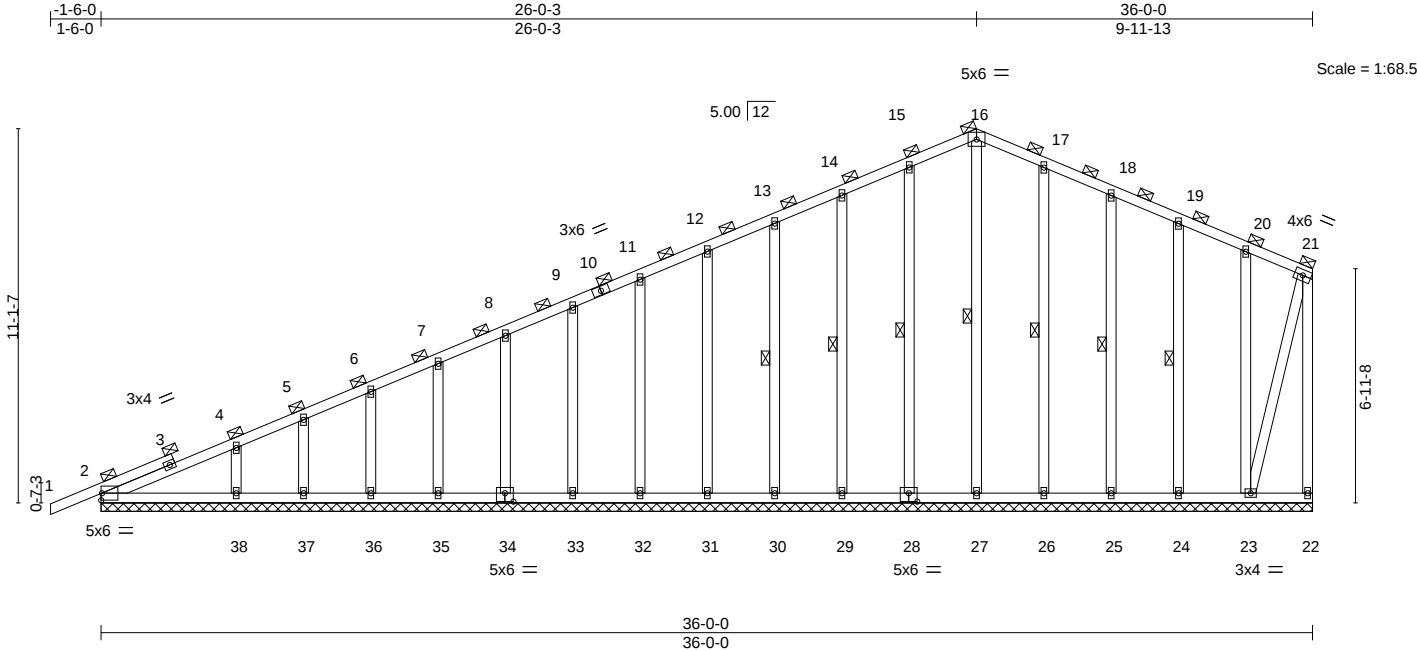


Plate Offsets (X,Y)--		[16:0-0-0,0-0-0], [28:0-3-0,0-3-0], [34:0-3-0,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL 1.25		TC 0.13		Vert(LL)	-0.00 1	n/r	120	MT20	244/190
TCDL 7.0		Lumber DOL 1.25		BC 0.10		Vert(CT)	0.00 1	n/r	120		
BCLL 0.0 *		Rep Stress Incr YES		WB 0.12		Horz(CT)	0.00 23	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-S						Weight: 294 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except:
WEBS 2x4 SP No.3	10-0-0 oc bracing: 22-23.
OTHERS 2x4 SP No.3	WEBS 1 Row at midpt 16-27, 15-28, 14-29, 13-30, 17-26, 18-25, 19-24

REACTIONS. All bearings 36-0-0.
(lb) - Max Horz 2=339(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 22, 2, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 26, 25, 24 except 38=102(LC 12), 23=109(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 22, 2, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 26, 25, 24, 23 except 38=261(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-318/116, 4-5=-259/82

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 22, 2, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 26, 25, 24 except (jt=lb) 38=102, 23=109.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003297
4053698	T04	Roof Special	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:54 2024 Page 1
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-EsCOx1sRmP9aY7V8qIHu7TXG7qQeioQngp4nSdzByld



Scale = 1:71.8

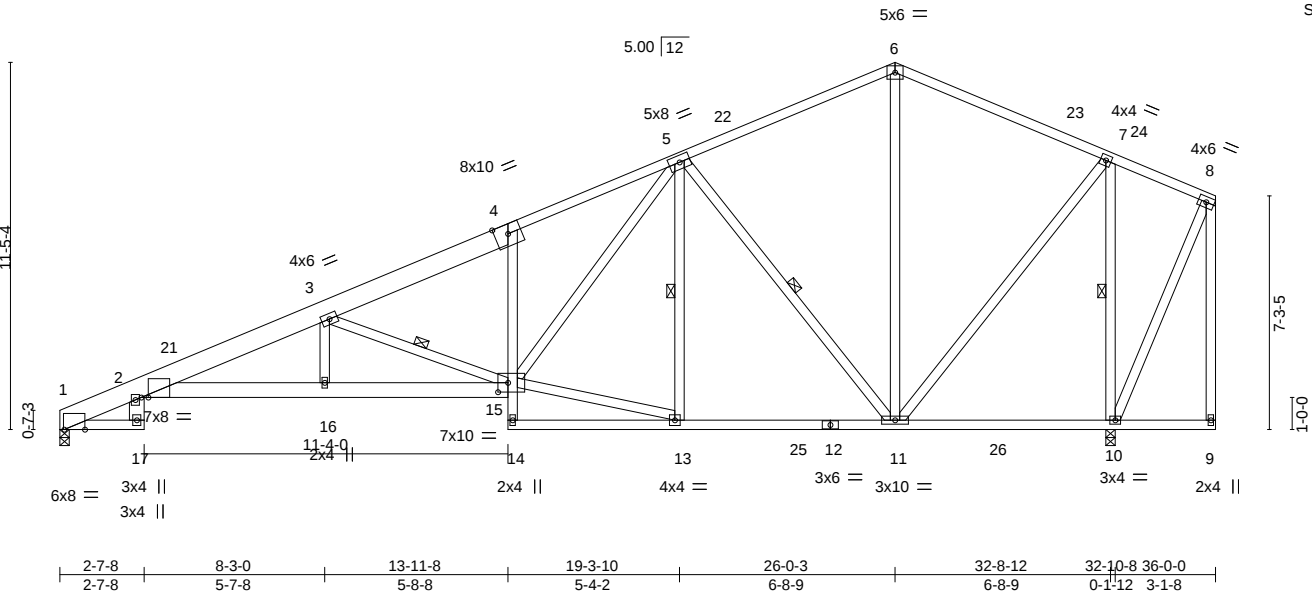


Plate Offsets (X,Y)--		[1:0-7-11,0-0-0], [2:0-2-10,0-0-0], [15:0-3-12,0-3-8]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.54		Vert(LL)	-0.24 2-16	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.59		Vert(CT)	-0.41 2-16	>951	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.73		Horz(CT)	0.21 10	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-MS						Weight: 280 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 *Except* 1-4: 2x8 SP 2400F 2.0E	TOP CHORD	Structural wood sheathing directly applied or 3-7-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2 *Except* 2-17: 2x6 SP No.2, 2-15: 2x6 SP M 26, 4-14: 2x4 SP No.3	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 3-15, 5-13, 5-11, 7-10

REACTIONS. (size) 1=0-3-8, 10=0-3-8
Max Horz 1=333(LC 12)
Max Uplift 1=333(LC 12), 10=367(LC 12)
Max Grav 1=1301(LC 2), 10=1632(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-19=-609/3, 2-3=-3617/1037, 3-4=-2339/651, 4-5=-2292/726, 5-6=-755/244, 6-7=-754/264
BOT CHORD 2-16=-1249/3420, 15-16=-1249/3420, 11-13=-427/1280
WEBS 3-16=-41/428, 3-15=-1449/558, 13-15=-389/1175, 5-15=-515/1355, 5-11=-1027/403, 6-11=-51/318, 7-11=-282/1040, 7-10=-1354/394

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-10 to 3-8-13, Zone1 3-8-13 to 26-0-3, Zone2 26-0-3 to 31-1-5, Zone1 31-1-5 to 35-10-4 zone; cantilever right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=333, 10=367.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003298
4053698	T05	Common	8	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:55 2024 Page 1
ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-i3mm8Nt3XjHRAH4KO0o7gg3N8DgVRH6wvTqK_3zBylc
1-6-0 6-8-0 13-2-0 19-3-10 26-0-3 32-8-12 38-10-6 43-8-0 45-2-0
1-6-0 6-8-0 6-6-0 6-1-10 6-8-9 6-8-9 6-1-10 4-9-10 1-6-0

Scale = 1:81.8

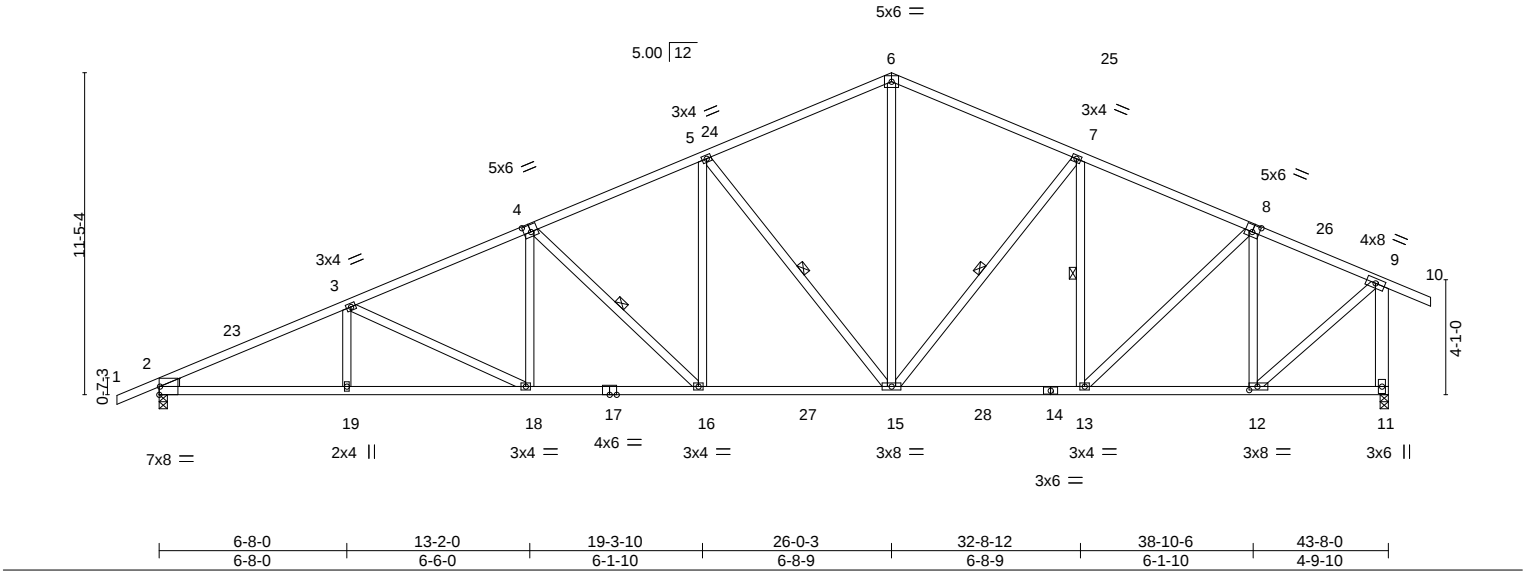


Plate Offsets (X,Y)--		[4:0-3-0,0-3-0], [8:0-3-0,0-3-0], [12:0-3-8,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.78	Vert(LL)	-0.29 18-19	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	1.00	Vert(CT)	-0.50 18-19	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.14 11	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS						Weight: 284 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 2-17: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 1-4-12 oc bracing.
WEBS 2x4 SP No.3 *Except* 9-11: 2x6 SP No.2	WEBS 1 Row at midpt 4-16, 5-15, 7-15, 7-13
WEDGE Left: 2x4 SP No.3	
REACTIONS. (size) 2=0-3-8, 11=0-3-8	
Max Horz 2=198(LC 16)	
Max Uplift 2=-482(LC 12), 11=-422(LC 13)	
Max Grav 2=1825(LC 2), 11=1857(LC 2)	
FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-3577/890, 3-4=-3151/792, 4-5=-2581/670, 5-6=-1907/519, 6-7=-1907/540, 7-8=-1968/468, 8-9=-1430/324, 9-11=-1787/451	
BOT CHORD 2-19=-926/3237, 18-19=-926/3237, 16-18=-737/2866, 15-16=-524/2334, 13-15=-326/1773, 12-13=-274/1282	
WEBS 3-18=-434/209, 4-18=-57/429, 4-16=-730/292, 5-16=-160/755, 5-15=-1014/399, 6-15=-264/1144, 7-13=-274/125, 8-13=-125/673, 8-12=-889/245, 9-12=-324/1667	

- NOTES-
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 2-10-6, Zone1 2-10-6 to 26-0-3, Zone2 26-0-3 to 32-2-5, Zone1 32-2-5 to 45-2-0 zone; end vertical right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=482, 11=422.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003299
4053698	T05G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:56 2024 Page 1
ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-AFJ9Mjuh1PInRfWxjKMCuciGdEIAsS487ZuXWzBylb

1-6-0

1-6-0

26-0-3

26-0-3

43-8-0

17-7-13

45-2-0

1-6-0

Scale = 1:83.3

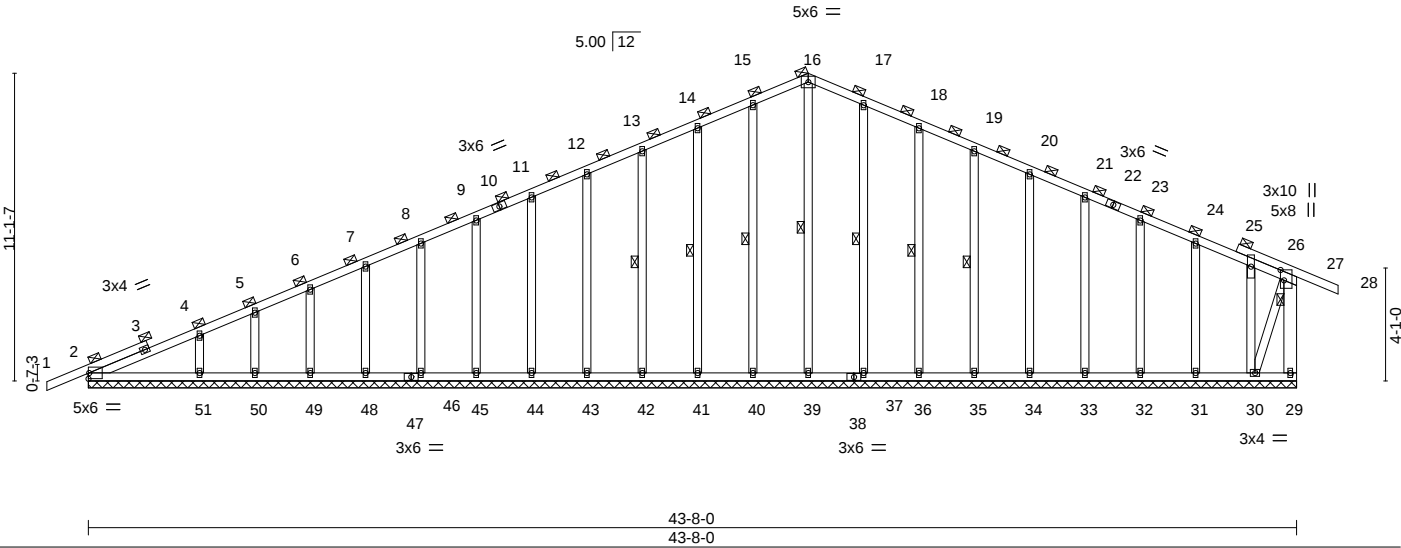


Plate Offsets (X,Y)--		[27-0-4-8,0-1-8]		43-8-0 43-8-0	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc) l/defl L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	-0.01 28 n/r 120
TCDL 7.0	Lumber DOL	1.25	BC 0.10	Vert(CT)	-0.01 28 n/r 120
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.01 29 n/a n/a
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S		
				Weight:	348 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x6 SP No.2 *Except*	WEBS 1 Row at midpt 16-39, 15-40, 14-41, 13-42, 17-37, 18-36, 19-35
27-30: 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 43-8-0.
(lb) - Max Horz 2=194(LC 16)
Max Uplift All uplift 100 lb or less at joint(s) 29, 2, 40, 41, 42, 43, 44, 45, 46, 48, 49, 50, 37, 36, 35, 34, 33, 32, 31 except 51=-102(LC 12), 30=-209(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 29, 2, 39, 40, 41, 42, 43, 44, 45, 46, 48, 49, 50, 37, 36, 35, 34, 33, 32, 31, 30 except 51=261(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 13-14=-114/268, 14-15=-126/309, 15-16=-137/344, 16-17=-137/344, 17-18=-126/309, 18-19=-114/268

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 29, 2, 40, 41, 42, 43, 44, 45, 46, 48, 49, 50, 37, 36, 35, 34, 33, 32, 31 except (it=lb) 51=102, 30=209.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003300
4053698	T06	Roof Special	10	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:57 2024 Page 1
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-eRtXZ3vK3KX9PbEjVQrbl59o91Uyv94DNnJR3yzByla

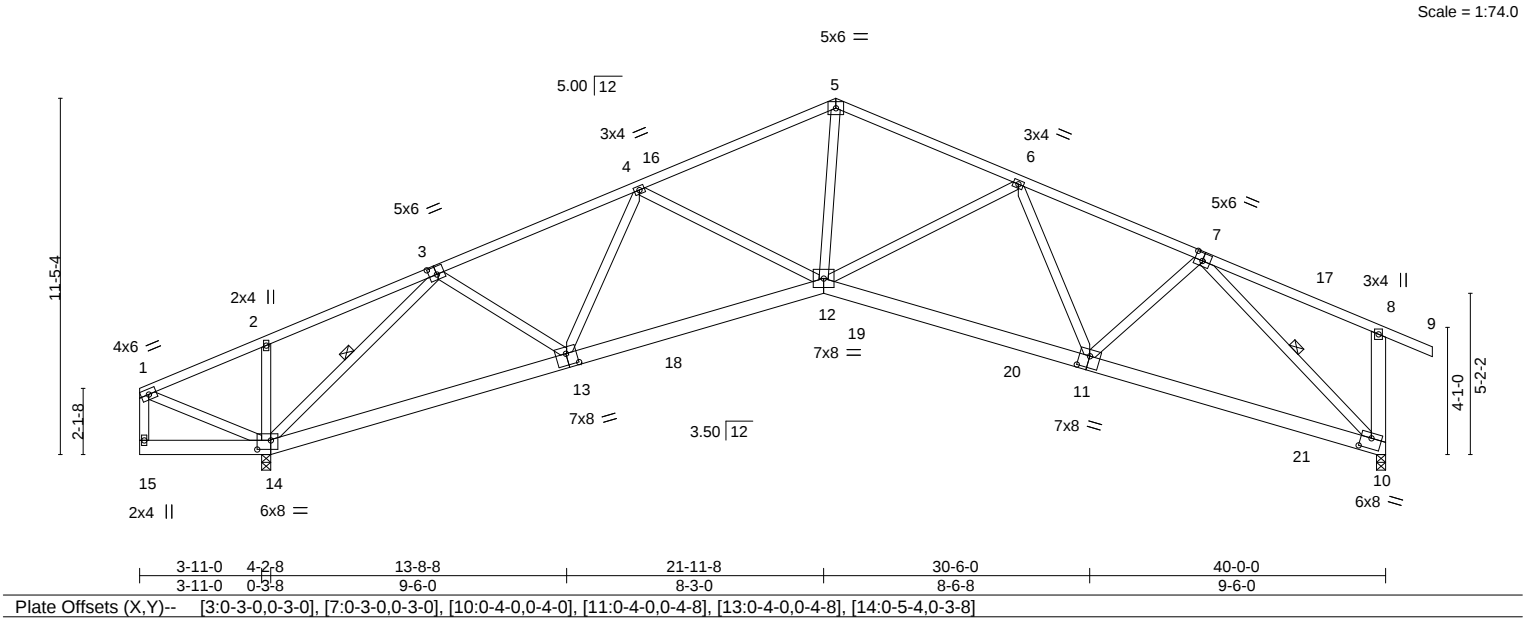

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.49	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.49	Vert(LL) 0.16 11-12 >999 240		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.73	Vert(CT) -0.28 11-12 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.22 10 n/a n/a		
	Code FBC2023/TPI2014			Weight: 268 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-5-3 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 7-7-5 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 3-14, 7-10
8-10: 2x6 SP No.2	

REACTIONS. (size) 14=0-3-8, 10=0-3-8
Max Horz 14=135(LC 16)
Max Uplift 14=-690(LC 8), 10=-551(LC 8)
Max Grav 14=1631(LC 1), 10=1394(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-2095/1046, 4-5=-2244/1081, 5-6=-2140/1047, 6-7=-2000/991, 8-10=-266/197
BOT CHORD 13-14=-679/1388, 12-13=-940/2147, 11-12=-840/2037, 10-11=-651/1434
WEBS 2-14=-272/181, 3-14=-2094/908, 3-13=-310/689, 4-13=-442/130, 5-12=-677/1341, 6-11=-406/129, 7-11=-266/598, 7-10=-1941/864

- NOTES-**
- Unbalanced roof live loads HAVING been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 4-0-12, Zone1 4-0-12 to 22-4-3, Zone2 22-4-3 to 28-2-8, Zone1 28-2-8 to 41-6-0 zone; cantilever left exposed ; end vertical right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=690, 10=551.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003301
4053698	T07	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:57 2024 Page 1
ID:NfQKPk0vtjt52FdA3Ad5P4zC2NR-eRtXZ3vK3KX9PbEjVQrbl59kr1Q3v5_DNnJR3yzByla

Scale = 1:78.1

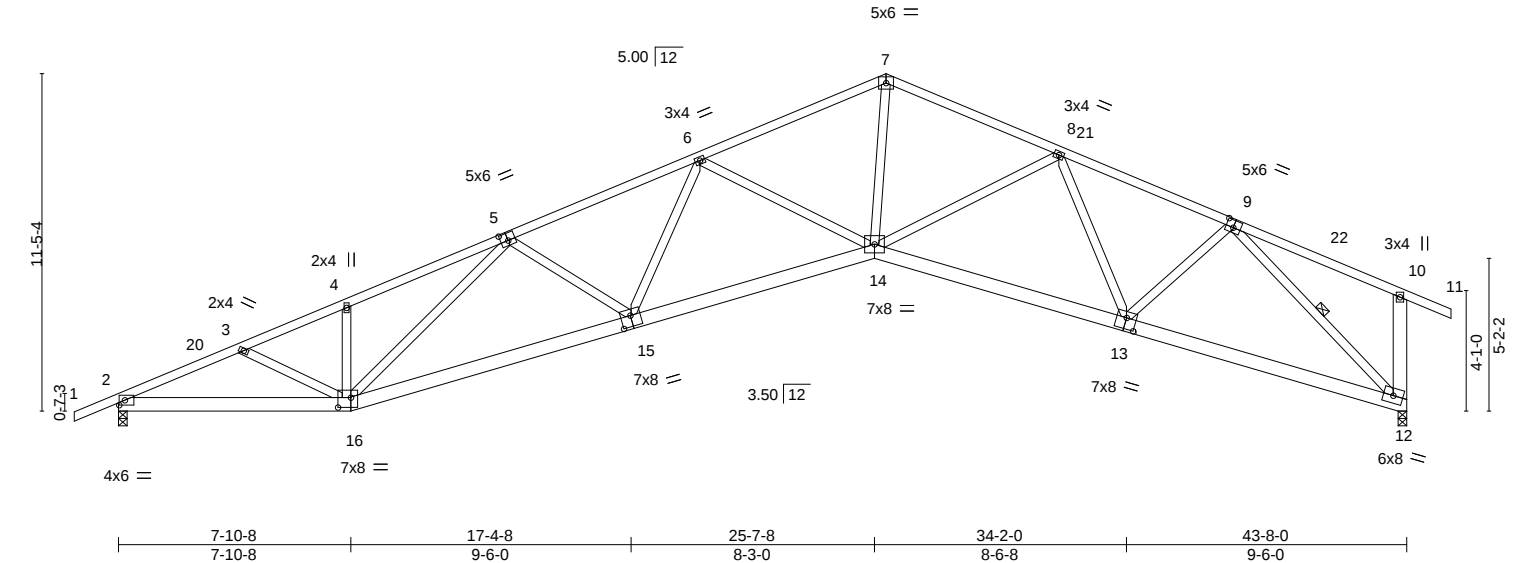


Plate Offsets (X,Y)--	[2:0-2-5,0-2-0], [5:0-3-0,0-3-0], [9:0-3-0,0-3-0], [13:0-4-0,0-4-8], [15:0-4-0,0-4-8], [16:0-5-4,0-4-0]
-----------------------	---

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.76	Vert(LL)	-0.33 14-15	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.74	Vert(CT)	-0.63 14-15	>828	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.99	Horz(CT)	0.36 12	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 283 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 7-1-9 oc bracing.
WEBS 2x4 SP No.3 *Except* 10-12: 2x6 SP No.2	WEBS 1 Row at midpt 9-12

REACTIONS. (size) 2=0-3-8, 12=0-3-8
Max Horz 2=199(LC 16)
Max Uplift 2=-482(LC 12), 12=-422(LC 13)
Max Grav 2=1688(LC 1), 12=1701(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3383/948, 3-4=-3246/893, 4-5=-3273/971, 5-6=-3946/1086, 6-7=-3280/819,
7-8=-3121/802, 8-9=-2621/618, 10-12=-270/192
BOT CHORD 2-16=-999/3058, 15-16=-1081/3716, 14-15=-923/3673, 13-14=-568/2738,
12-13=-438/1829
WEBS 4-16=-276/176, 5-16=-831/204, 6-15=-75/339, 6-14=-713/375, 7-14=-496/2116,
8-14=-69/394, 8-13=-689/207, 9-13=-122/860, 9-12=-2499/565

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 2-10-6, Zone1 2-10-6 to 26-0-3, Zone2 26-0-3 to 32-2-5, Zone1 32-2-5 to 45-2-0 zone; end vertical right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=482, 12=422.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024


Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003302
4053698	T08	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:58 2024 Page 1
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-6eRvnPvyqef?1lpv38MqHJhyoRmLejzNbR2_bOzBylZ



Scale = 1:35.1

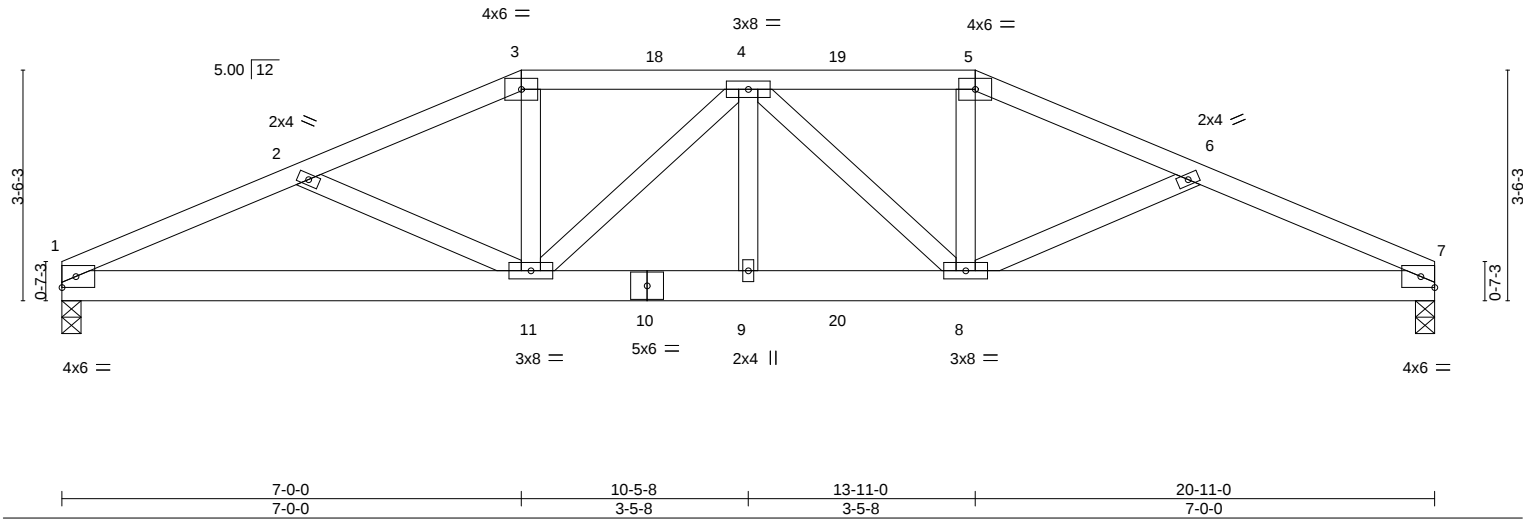

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.56	Vert(LL) 0.16	9	>999	240	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.74	Vert(CT) -0.23	9	>999	180		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.31	Horz(CT) 0.06	7	n/a	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS					Weight: 117 lb	FT = 20%
	Code FBC2023/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-10-12 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 5-7-13 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 1=0-3-8, 7=0-3-8
Max Horz 1=49(LC 8)
Max Uplift 1=-739(LC 8), 7=-745(LC 9)
Max Grav 1=1503(LC 1), 7=1527(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-3140/1624, 2-3=-3000/1586, 3-4=-2787/1509, 4-5=-2838/1521, 5-6=-3058/1600, 6-7=-3197/1639
BOT CHORD 1-11=-1495/2841, 9-11=-1673/3210, 8-9=-1673/3210, 7-8=-1459/2892
WEBS 3-11=-423/804, 4-11=-642/385, 4-9=-212/325, 4-8=-560/329, 5-8=-380/749

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=739, 7=745.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 127 lb down and 95 lb up at 7-0-0, 109 lb down and 95 lb up at 9-0-12, 109 lb down and 87 lb up at 10-5-8, and 109 lb down and 95 lb up at 11-10-4, and 234 lb down and 188 lb up at 13-11-0 on top chord, and 333 lb down and 289 lb up at 7-0-0, 84 lb down and 69 lb up at 9-0-12, 84 lb down and 69 lb up at 10-5-8, and 84 lb down and 69 lb up at 11-10-4, and 333 lb down and 289 lb up at 13-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 5-7=-54, 12-15=-20
Concentrated Loads (lb)
Vert: 3=-109(B) 5=-187(B) 10=-65(B) 11=-333(B) 9=-65(B) 4=-109(B) 8=-333(B) 18=-109(B) 19=-109(B) 20=-65(B)

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003303
4053698	T09	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:16:59 2024 Page 1
ID:NfQKP0vtjt52FdA3Ad5P4zC2NR-bq?H_lwabynsevO5drt3qWECWr7uNCaWq5oY7rzByIY
4-7-8 4-7-8 9-0-0 4-4-8 11-11-0 2-11-0 16-3-8 4-4-8 20-11-0 4-7-8

Scale = 1:35.0

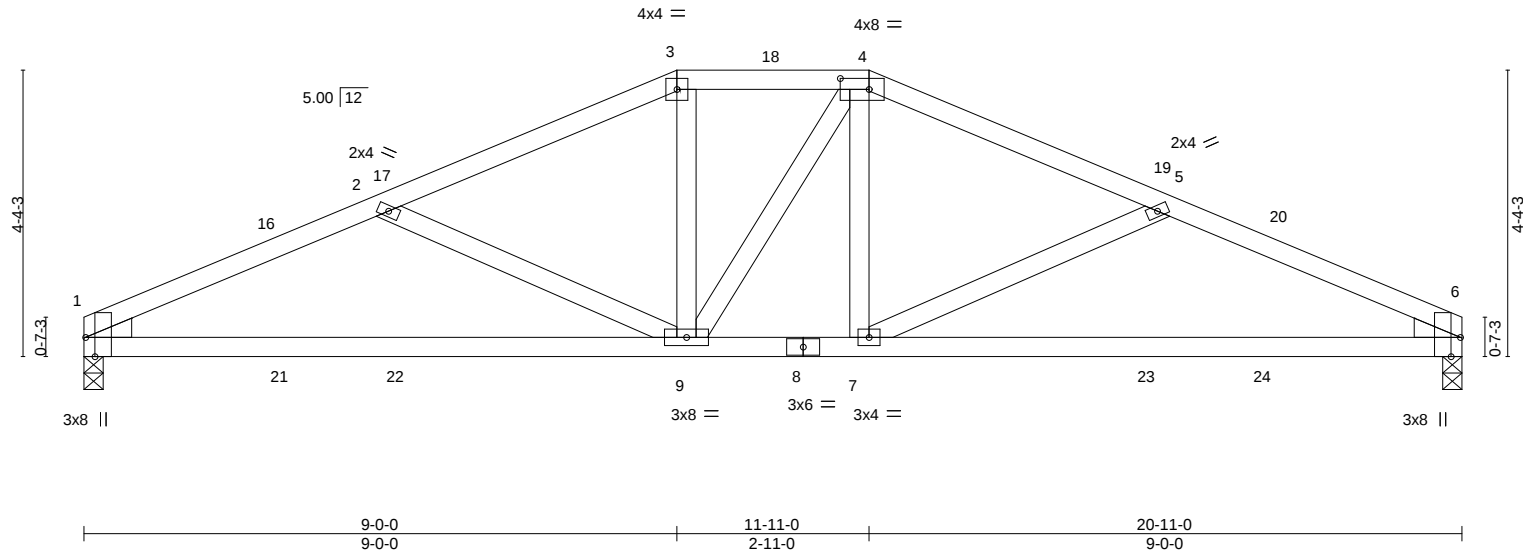

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.24	Vert(LL)	0.13 7-15 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.65	Vert(CT)	-0.25 7-15 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.16	Horz(CT)	0.04 6 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 99 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-10-14 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 7-4-12 oc bracing.
WEBS	2x4 SP No.3		
WEDGE			
Left: 2x4 SP No.3 , Right: 2x4 SP No.3			

REACTIONS. (size) 1=0-3-8, 6=0-3-8
Max Horz 1=63(LC 12)
Max Uplift 1=-343(LC 8), 6=-343(LC 9)
Max Grav 1=774(LC 1), 6=774(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1406/685, 2-3=-1133/592, 3-4=-1007/573, 4-5=-1132/591, 5-6=-1406/685
BOT CHORD 1-9=-605/1262, 7-9=-462/1007, 6-7=-602/1262
WEBS 2-9=-304/190, 3-9=-156/271, 4-7=-148/271, 5-7=-304/190

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 9-0-0, Zone3 9-0-0 to 11-11-0, Zone2 11-11-0 to 16-1-15, Zone1 16-1-15 to 20-11-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=343, 6=343.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003305
4053698	T10G	Monopitch Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:17:00 2024 Page 1
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-30ZfC5xCMFwjG2zIAZOInknLmEaY6fxg3lX5gHzBylX

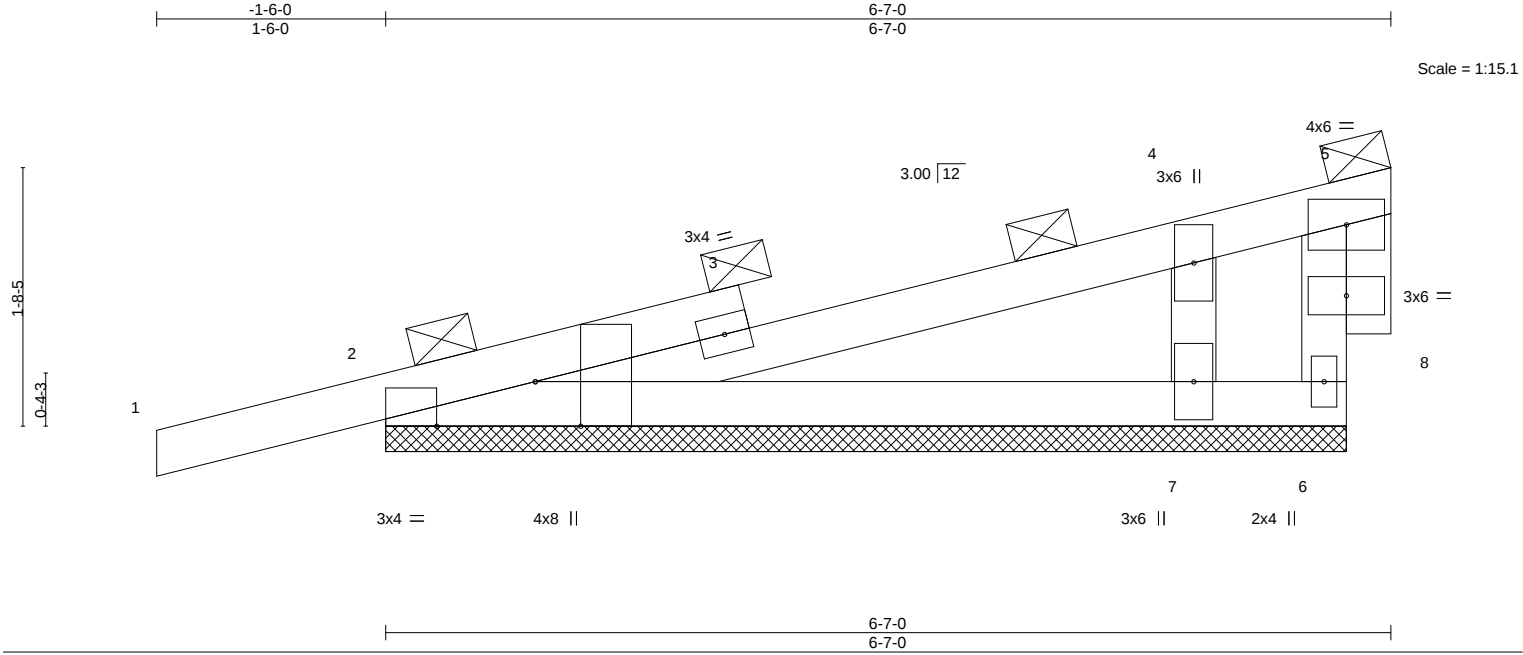


Plate Offsets (X,Y)--		[2:0-3-8,Edge], [2:0-7-12,Edge]										
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.33	Vert(LL)	-0.00	1	n/r	120	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.24	Vert(CT)	0.00	1	n/r	120		
BCLL	0.0 **	Rep Stress Incr	YES	WB	0.15	Horz(CT)	-0.00	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014		Matrix-P						Weight: 28 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	2-0-0 oc purlins (6-0-0 max.), except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS. (size) 2=6-3-8, 6=6-3-8, 7=6-3-8
Max Horz 2=68(LC 8)
Max Uplift 2=-125(LC 8), 6=-155(LC 1), 7=-134(LC 12)
Max Grav 2=257(LC 1), 6=36(LC 12), 7=442(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-7=-298/499

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=125, 6=155, 7=134.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS CONST. - RUSSWOOD SPEC	T34003306
4053698	V01	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 28 13:17:01 2024 Page 1
ID:NfQKPk0vjt52FdA3Ad5P4zC2NR-XD71PRyq7Z2auCXUkGvXvxJb6ey4r8?pHPHeCjzByIW

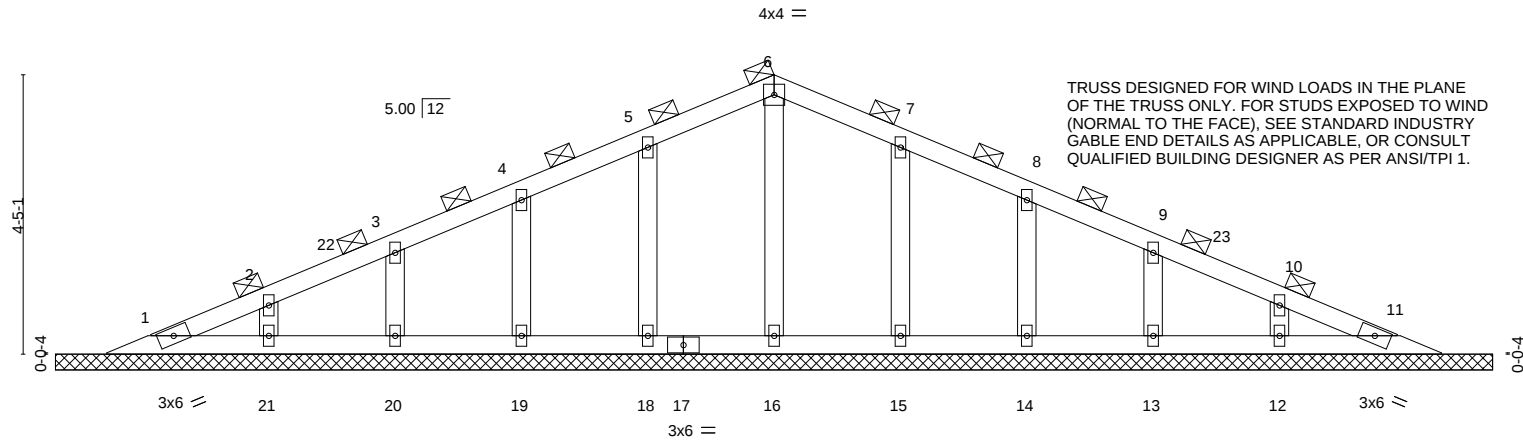

22-9-0 22-9-0									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.04	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	11	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S					Weight: 90 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 22-9-0.
(lb) - Max Horz 1=69(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 18, 19, 20, 21, 15, 14, 13, 12
Max Grav All reactions 250 lb or less at joint(s) 1, 11, 16, 18, 19, 20, 21, 15, 14, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-3 to 4-6-3, Zone1 4-6-3 to 11-4-8, Zone2 11-4-8 to 15-4-8, Zone1 15-4-8 to 21-2-13 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 18, 19, 20, 21, 15, 14, 13, 12.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Lee, Julius, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Julius Lee PE No.34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

May 29,2024




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

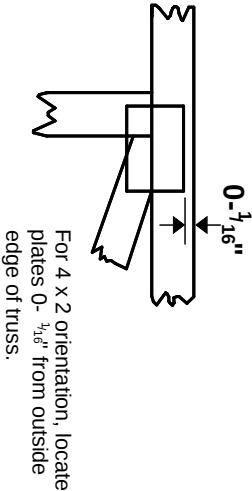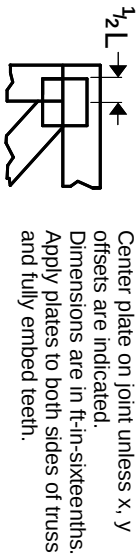

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

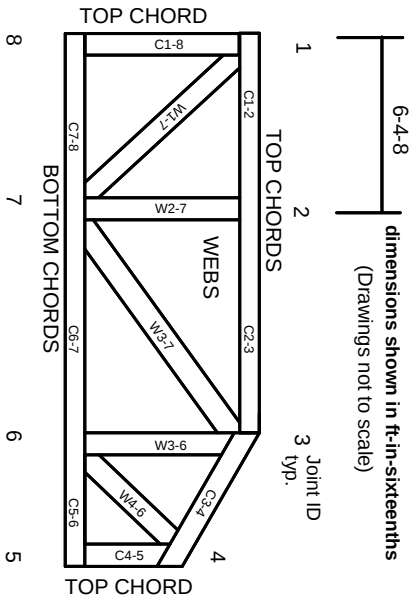

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MIL-7473 rev. 1/12/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.