


















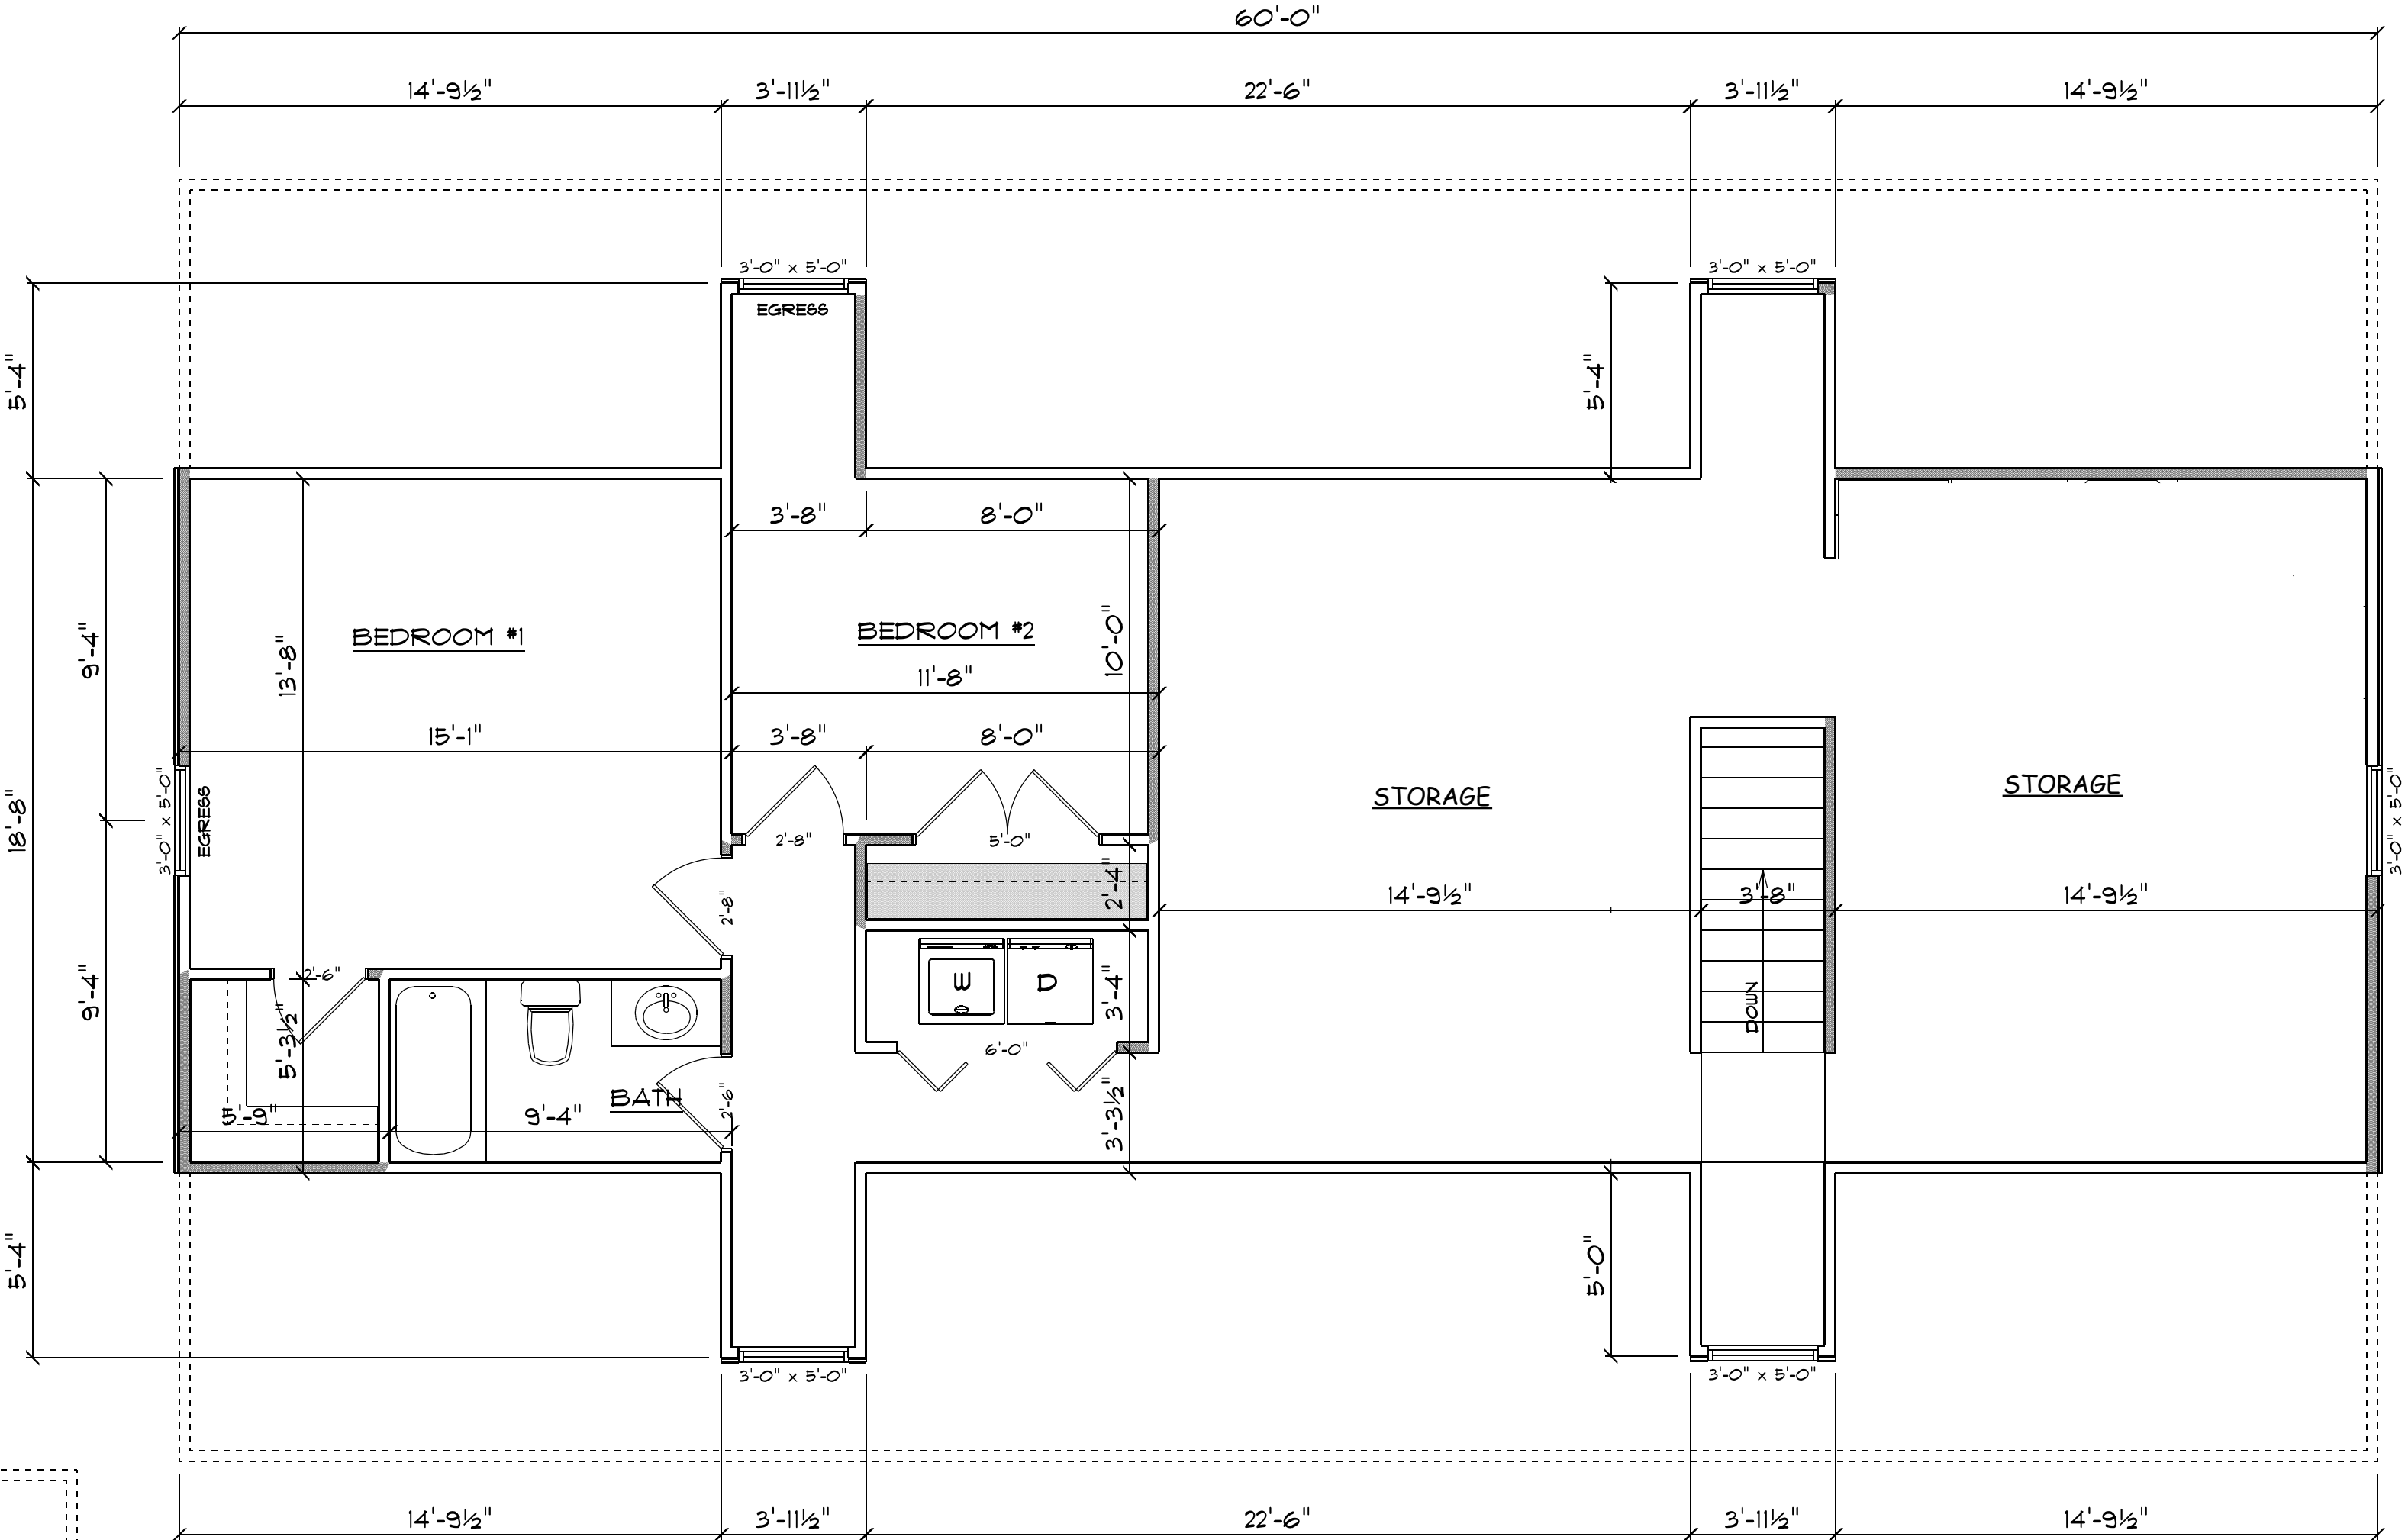


- ELECTRICAL PLAN NOTES:**
- E - 1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
- E - 2 CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.
- E - 3 ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
- E - 4 ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
- E - 5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC LATEST EDITION.
- E - 6 ELECTRICAL CONTR SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- E - 7 ENTRY OF SERVICE ( UNDERGROUND OR OVERHEAD ) TO BE DETERMINED BY POWER COMPANY.
- E - 8 ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUN ROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT.
- E - 9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION.
- E - 10 A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING. SERVICE ENTRANCE CONDUCTORS MAY NOT BE LOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL.
- E - 11 CARBON MONOXIDE ALARMS SHALL BE REQUIRED WITHIN 10' OF ALL ROOMS FOR SLEEPING PURPOSES IN BUILDINGS HAVING A FOSSIL FUEL BURNING HEATER OR APPLIANCE, A FIREPLACE, OR ATTACHED GARAGE.
- E - 12 ALL OUTLETS LOCATED IN RESIDENTIAL TO BE TAMPER-RESISTANT PER NEC.
- E - 13 A MINIMUM OF 75% OF PERMANENTLY INSTALLED LAMPS OR LIGHTING FIXTURES SHALL BE HIGH EFFICACY FBC EC SEC. R404.1

|   | ELECTRICAL LEGEND                       |
|---|---|
|    | CEILING FAN<br>(PRE-WIRE FOR LIGHT KIT) |
|    | DOUBLE SECURITY LIGHT                   |
|    | 2X4 FLUORESCENT LIGHT FIXTURE           |
|    | RECESSED CAN LIGHT                      |
|    | BATH EXAUST FAN WITH LIGHT              |
|    | BATH EXAUST FAN                         |
|    | LIGHT FIXTURE                           |
|    | DUPLEX OUTLET                           |
|    | 220v OUTLET                             |
|    | GFI DUPLEX OUTLET                       |
|    | SMOKE DETECTOR                          |
|    | WALL SWITCH                             |
|    | 3 WAY WALL SWITCH                       |
|    | 4 WAY WALL SWITCH                       |
|    | WATER PROOF GFI OUTLET                  |
|    | PHONE JACK                              |
|    | TELEVISION JACK                         |
|   | GARAGE DOOR OPENER                      |
|  | CARBON MONOXIDE ALARM                   |

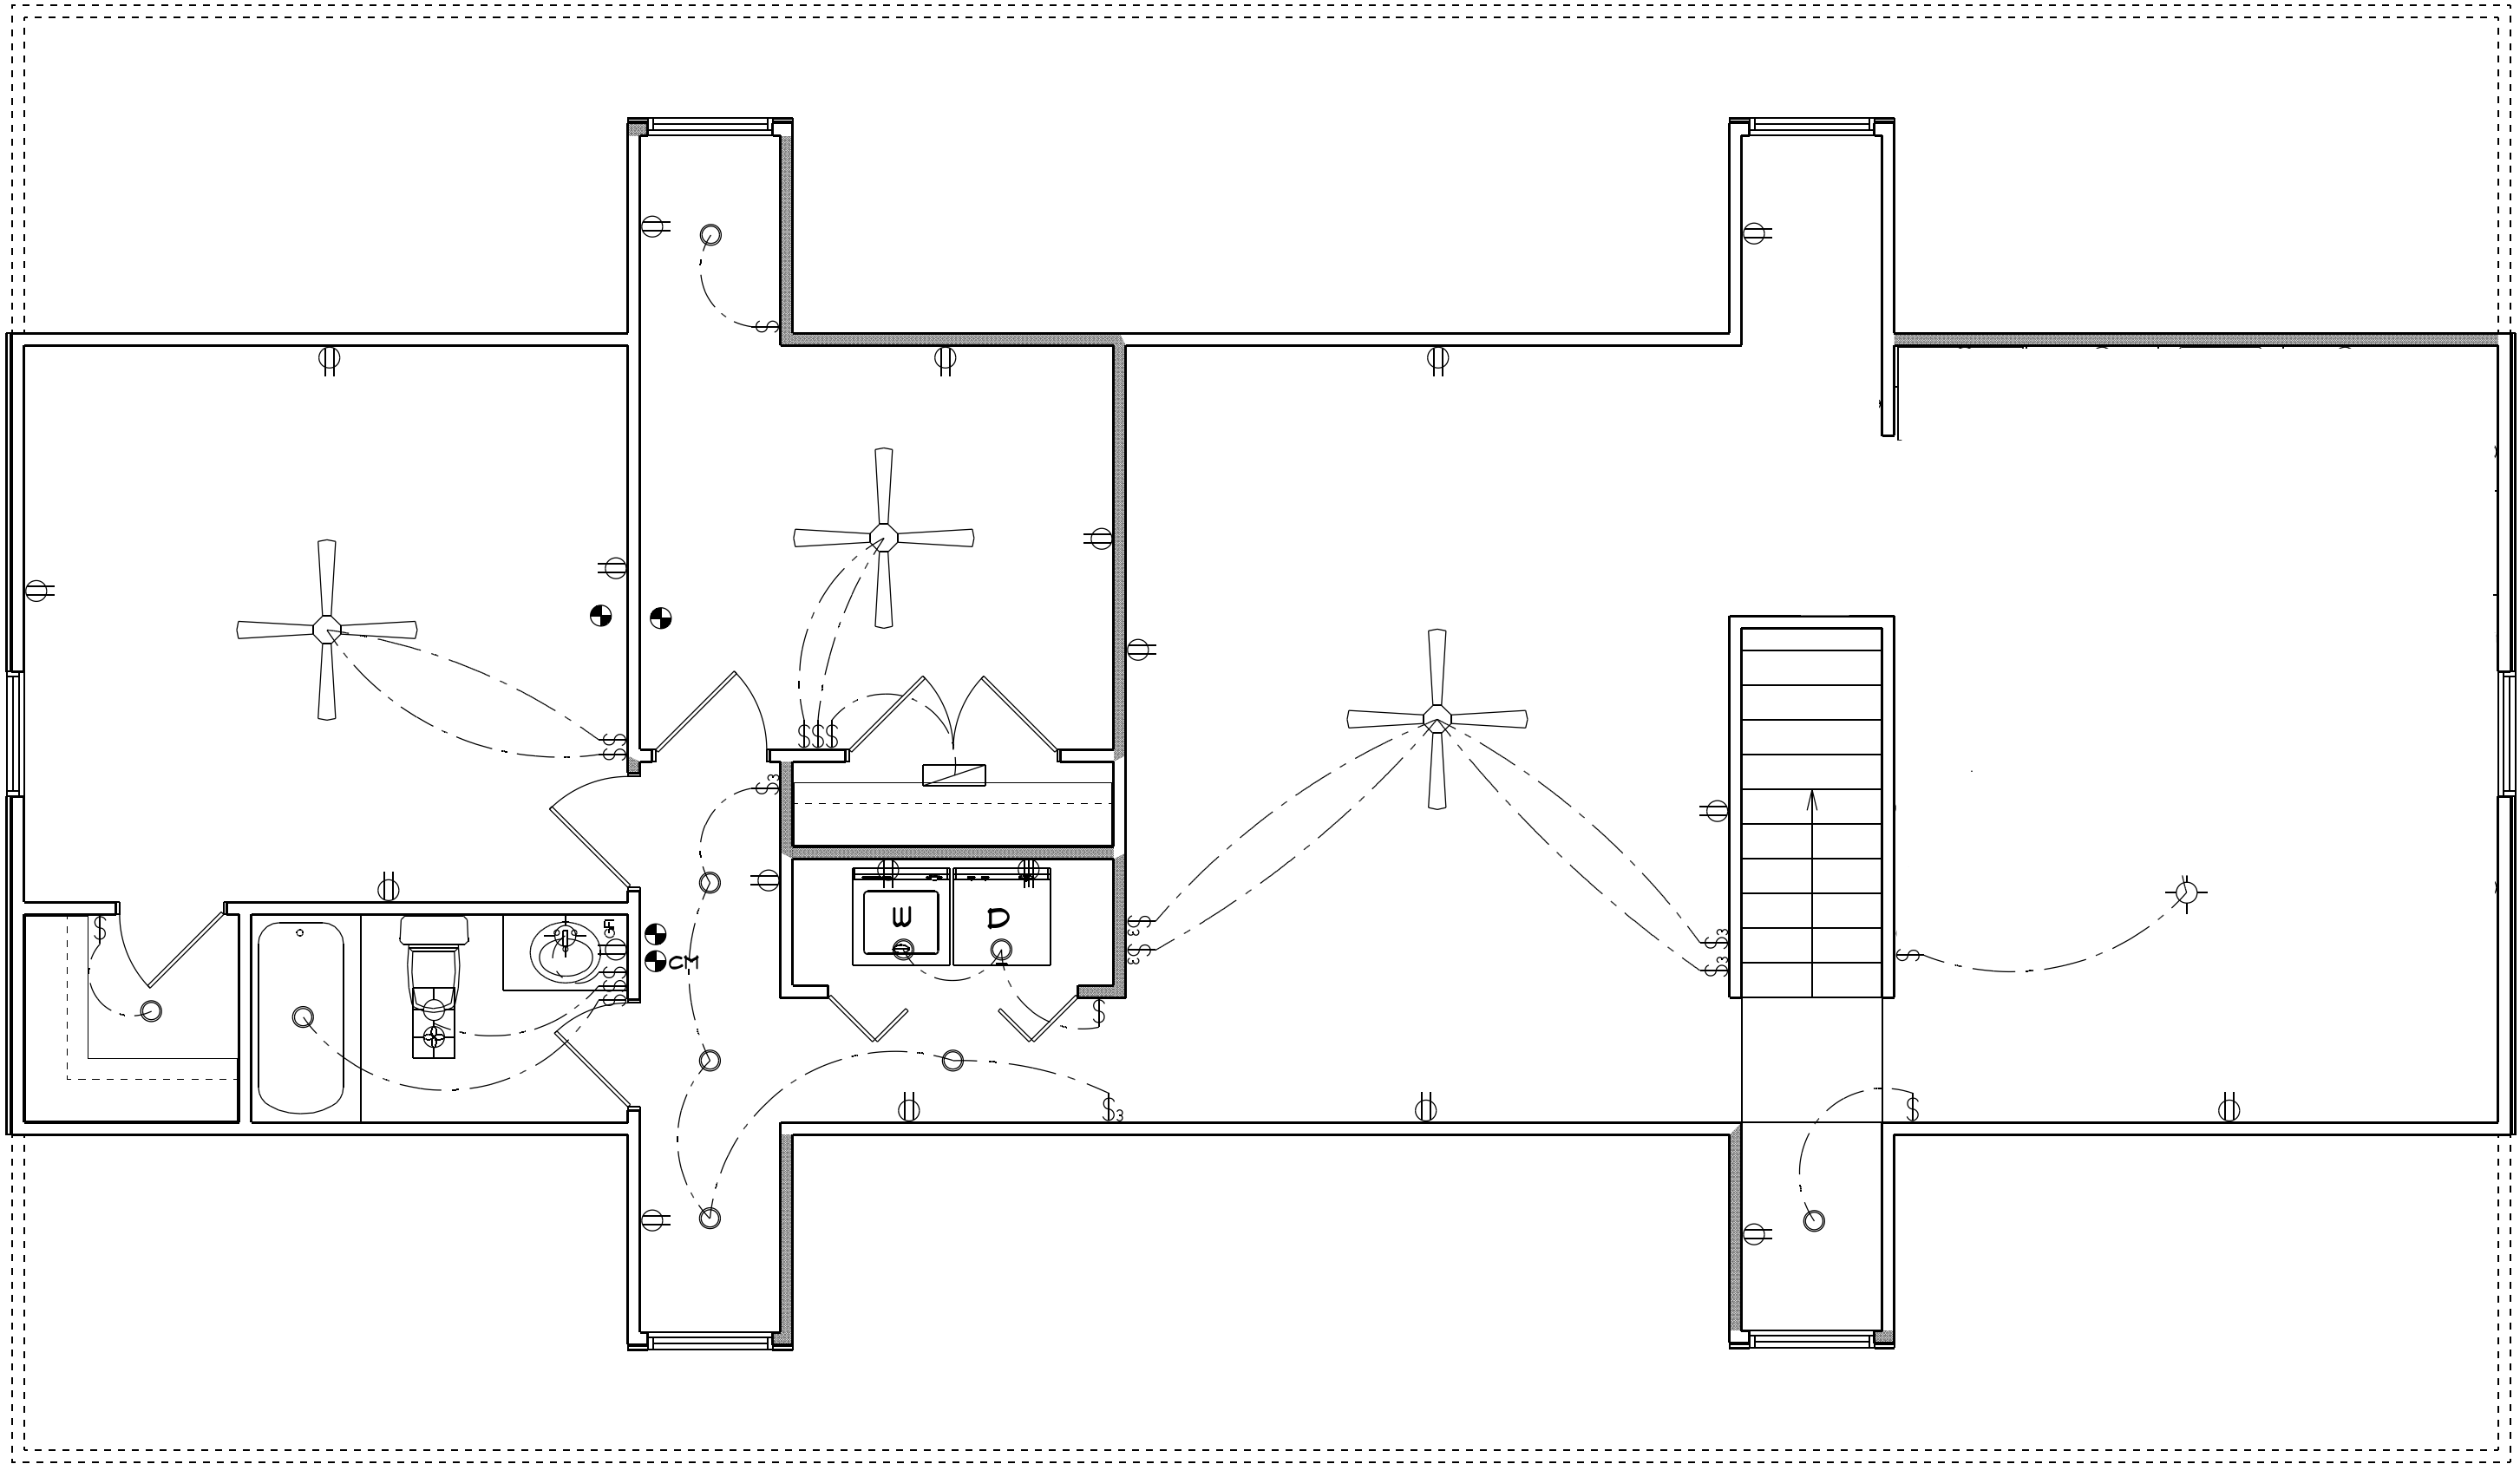


**FLOOR PLAN**

SCALE: 1/4" = 1'-0"

ALL CEILING HEIGHTS TO BE 8'-0" UNLESS NOTED OTHERWISE

| AREA SCHEDULE |             |
|---------------|-------------|
| NAME          | AREA        |
| Living        | 530 sq. ft. |
|               |             |
|               |             |
|               |             |
|               |             |
|               |             |
|               |             |
| Total         | 530 sq. ft. |



**ELECTRICAL PLAN**

SCALE: 1/4" = 1'-0"

Blake Construction

Brad Neal Detached Garage  
Bonus Room

PROJECT ADDRESS:  
Hills of Windsor  
Columbia County, FL

Mark Disosway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.754.5419  
disoswaydesign@gmail.com

JOB NUMBER:  
211710

1  
OF 1 SHEET