
Beverly Toler 415 Sunview St. Fort White, P.C. 32028

FEED ATS OFF LOAD SIDE OF METER/MAIN W/ 2/0 THHN

INTERIOR PANEL WITH 2/0 THHN OFF LOAD INTERCEPT EXISTING 4/0 SER FEEDING SIDE OF ATS WITH INSULATED LUGS





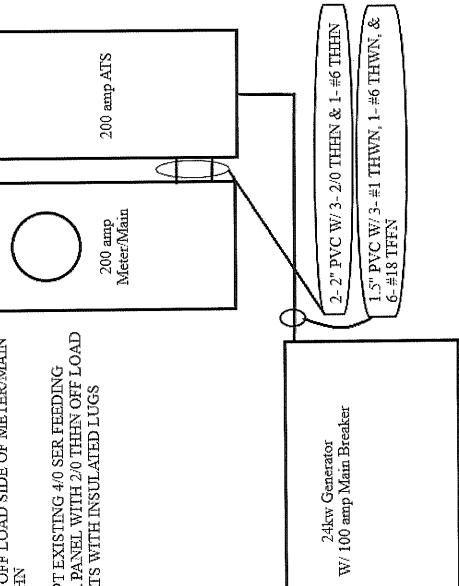


TRADEMARK ELECTRIC INC. 3621 NW 27th Avenue OCALA, FL, 34475 +1 (352) 629-8617

### Sizing Report

Sizzing Information for:						
### A15 sun view et   FCrt white   FL, 32028   Rated Nominal Voltage   120 / 240 Single Phase   Liquid Propane   Part I V    ### Cenerator Fuel Choice   Liquid Propane   Part I V    ### Cenerator Fuel Choice   Choice   Choice   Choice   Part I V    ### Ceneral Lighting & Receptacles   Load (kW)    ### Square Footage Being Covered (ft*2)   2200   3.00    ### Little Circuits   2.00   3.00    ### Little Circuits   1.00   3.00    ### Little Circuits   1.00   1.50    ### Pixed-In-Piace Appliances & Motors   Managed   Loads   (kW)   (kW)    ### Little Circuits   1.00   2.92   X   5.50    ### Extimated   S.50   35.42   X   8.50    ### Refrigerator   0.80   6.67   35.42   X   8.50    ### Refrigerator   0.80   6.67   35.42   X   8.50    ### Water Heater   1.50   12.50   20.83   X   5.00    ### Water Heater   1.50   12.50   20.83   X   5.00    ### Loads   Managed   Estimated   (kW)   (kW)    ### Air Conditioning & Cooling   Estimated   (kW)   (kW)    ### Autor Cooling   Estimated   (kW)   (kPA)   (kPA)    ### Largest Motor's Starting Amps (kPA)   143.8   0.00   143.8    ### Summary NEC Load   Cooling   Estimated   (kW)   (kPA)   (kPA)	Sizing Information for:					
Rated Nominal Voltage   120 / 240 Single Phase	Beverly Toler					
Rated Nominal Voltage   120 / 240 Single Phase   Liquid Propane   Part IV						
Camerator Fuel Choice   Citying Method (NEC 220)   Part IV	Fort white , FL, 32028					
Camerator Fuel Choice   Citying Method (NEC 220)   Part IV		400 40 40 Circula Dia	222			
Sizing Method (NEC 220)   Part IV	<del>-</del>		ase			
Ceneral Lighting & Receptacles   Load (kW)	Generator Fuel Choice					
Square Footage Being Covered (fit*2)         2200         6.60           Small Appliance Circuits (20 amps)         2.00         3.00           Kitchen Circuits         1.00         1.50           Fixed-In-Place Appliances & Motors         Managed Loads         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           Dryer         5.50         22.92         X         5.50         22.92         X         8.50         18.60         35.42         X         8.50         18.60         <	Sizing Method (NEC 220)	Part IV				
Square Footage Being Covered (fit*2)         2200         6.60           Small Appliance Circuits (20 amps)         2.00         3.00           Kitchen Circuits         1.00         1.50           Fixed-In-Place Appliances & Motors         Managed Loads         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           Dryer         5.50         22.92         X         5.50         22.92         X         8.50         18.60         35.42         X         8.50         18.60         <						
Square Footage Being Covered (ff*2)         2200         6.60           Small Appliance Circuits (20 amps)         2.00         3.00           Kichen Circuits         2.00         1.50           Extending Circuits         1.00         1.50           Fixed-In-Place Appliances & Motors         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           Dyer         5.50         22.92         X         5.50           Range - Oven will Top Refrigerator         8.50         35.42         X         8.50           Refrigerator         0.80         6.67         0.80         6.67         0.80           Well Pump         1.50         12.50         12.50         1.50         1.50           Air Conditioning & Cooling         Loads         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           5.0 Ton Unit         5.00         20.83         X         5.00           Heating & Heat Pumps         Managed Loads         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           Transient Requirement         (LRA)         (LRA)         (LRA)         (LRA)           Largest Motor's Starting Amps (LRA)         143.8         11.10         Load (kW)	General Lighting & Receptacles			Load (kW)		
Small Appliance Circuits (20 amps)   Ritchen Circuits   2.00   1.50		2200		6.60		
Kitchen Circuits						
Laundry Circuits		2.00		3.00		
Fixed-In-Place Appliances & Motors						
Fixed-In-Place Appliances & Motors	Laundry Circuits	1,00				
Fixed-In-Place Appliances & Motors		Managed	Estimated	Nameplate		
Dryer   S.5.0   22.92   X   S.50   Range - Oven w/ Top   8.50   35.42   X   5.00   20.83   X   5.00   20.8	Fixed-In-Place Appliances & Motors	Loads			240 V	
Range - Oven w/ Top   8.50   35.42   X   8.50   Name   S.50   S			5.50			
Name	Range - Oven w/ Top				X	
Water Heater Well Pump         Managed Loads         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           5.0 Ton Unit         5.00         20.83         X         5.00           Heating & Heat Pumps         Managed Loads         Estimated (kW)         Nameplate (amps)         240 V         Load (kW)           Transient Requirement         Estimated (LRA)         (LRA)         (LRA)         Utilized (LRA)           Largest Motor's Starting Amps (LRA)         143.8         0.00         143.8           Summary NEC Load         (kW)         Required           General Lighting & Receptacles         11.10         Required           Fixed-in-Place Appliances & Motors         21.30         18.960           Sum of all General Loads         32.40         18.960           Cooling         5.00         5.00           Heating (w/demand factors)         0         0           Larger of Heating & Cooling         5.00         5.00           Sizing based on requirements of NEC Article 220: Part IV         23.960           Elevation         0         18.365000           Minimum size generator for motor starting requirements         18.365000	Refrigerator				V	
Air Conditioning & Cooling  Air Conditioning & Cooling  Managed Loads  Estimated (kW)  5.0 Ton Unit  Managed Loads  Estimated (kW)  Load (kW)  Managed Loads  Estimated (kW)  Managed (kW)  Managed Loads  Estimated (kW)  Managed (kW)  Managed (kW)  Estimated (kW)  Managed (kW)  Managed (kW)  Managed (kW)  Estimated (kW)  Managed (kW)  Man					<b>X</b>	
Air Conditioning & Cooling Loads (kW) (amps) 240 V Load (kW)  5.0 Ton Unit  Estimated (kW) Nameplate (amps) 240 V Load (kW)  Loads (kW) Nameplate (amps) 240 V Load (kW)  Estimated (LRA) (LRA) (LRA)  Largest Motor's Starting Amps (LRA) 143.8  Summary NEC Load (kW) Required  General Lighting & Receptacles   11.10   Required  Fixed-in-Place Appliances & Motors   21.30   Sum of all General Loads   32.40   18.960  Cooling   5.00   5.00   5.00   Larger of Heating (w/demand factors)   Larger of Heating & Cooling   5.00   5.00   5.00    Sizing based on requirements of NEC Article 220: Part IV   23.960   Elevation   Minimum size generator for motor starting requirements	Well Pump		1.50	12.50		1.50
Air Conditioning & Cooling Loads (kW) (amps) 240 V Load (kW)  5.0 Ton Unit  Estimated (kW) Nameplate (amps) 240 V Load (kW)  Loads (kW) Nameplate (amps) 240 V Load (kW)  Estimated (LRA) (LRA) (LRA)  Largest Motor's Starting Amps (LRA) 143.8  Summary NEC Load (kW) Required  General Lighting & Receptacles   11.10   Required  Fixed-in-Place Appliances & Motors   21.30   Sum of all General Loads   32.40   18.960  Cooling   5.00   5.00   5.00   Larger of Heating (w/demand factors)   Larger of Heating & Cooling   5.00   5.00   5.00    Sizing based on requirements of NEC Article 220: Part IV   23.960   Elevation   Minimum size generator for motor starting requirements		Managad	Entimated	Namenlate		
Solution	Air Conditioning & Cooling	Loads			240 V	Load (kW)
Heating & Heat Pumps     Managed Loads     Estimated (kW)     Nameplate (amps)     240 V     Load (kW)       Transient Requirement     Estimated (LRA)     Actual (LRA)     Utilized (LRA)       Largest Motor's Starting Amps (LRA)     143.8     0.00     143.8       Summary NEC Load     Load (kW)     NEC (kW)     Required       General Lighting & Receptacles     11.10     Fixed-in-Place Appliances & Motors     21.30     5.00       Sum of all General Loads     32.40     18.960       Cooling     5.00     5.00     0       Heating (w/demand factors)     0     0     0       Larger of Heating & Cooling     5.00     5.00     5.00       Sizing based on requirements of NEC Article 220: Part IV Elevation     23.960     0       Bilevation     0     0     0       Minimum size generator for motor starting requirements     18     365000			THE RESERVE OF THE PARTY OF THE		Х	5.00
Heating & Heat Pumps  Loads (kW) (amps) 240 V Load (kW)  Estimated (LRA) (LRA) (LRA)  Largest Motor's Starting Amps (LRA) 143.8  Summary NEC Load (kW) Required  General Lighting & Receptacles 11.10  Fixed-in-Place Appliances & Motors Sum of all General Loads 21.30 Sum of all General Loads 32.40 18.960  Cooling Heating (w/demand factors) Larger of Heating & Cooling 5.00 5.00  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements	3.0 TON OTHE					
Heating & Heat Pumps  Loads (kW) (amps) 240 V Load (kW)  Estimated (LRA) (LRA) (LRA)  Largest Motor's Starting Amps (LRA) 143.8 0.00 143.8  Summary NEC Load (KW) Required  General Lighting & Receptacles 11.10  Fixed-in-Place Appliances & Motors Sum of all General Loads 21.30 Sum of all General Loads 32.40 18.960  Cooling Heating (w/demand factors) 0 0 0 Larger of Heating & Cooling 5.00 5.00  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements		Managed	Estimated			
Transient Requirement (LRA) (LRA) (LRA)  Largest Motor's Starting Amps (LRA)  Summary NEC Load (kW) Required  General Lighting & Receptacles 11.10  Fixed-in-Place Appliances & Motors 21.30 Sum of all General Loads 32.40 18.960  Cooling 5.00 5.00  Heating (w/demand factors) 0 0 0  Larger of Heating & Cooling 5.00 5.00  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements	Heating & Heat Pumps	Loads	(kW)	(amps)	240 V	Load (KVV)
Transient Requirement (LRA) (LRA) (LRA)  Largest Motor's Starting Amps (LRA)  Summary NEC Load (kW) Required  General Lighting & Receptacles 11.10  Fixed-in-Place Appliances & Motors 21.30 Sum of all General Loads 32.40 18.960  Cooling 5.00 5.00  Heating (w/demand factors) 0 0 0 Larger of Heating & Cooling 5.00 5.00  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements	GENERAL CONTRACTOR CON			721.0		1 1025
Largest Motor's Starting Amps (LRA)  Summary NEC Load  General Lighting & Receptacles Fixed-in-Place Appliances & Motors Sum of all General Loads  Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements  Load (kW) Required  NEC Required  5.00  5.00  5.00  5.00  5.00  5.00  5.00  5.00  5.00						
Summary NEC Load (kW) Required  General Lighting & Receptacles 11.10  Fixed-in-Place Appliances & Motors 21.30 Sum of all General Loads 32.40 18.960  Cooling 5.00 5.00 Heating (w/demand factors) 0 0 Larger of Heating & Cooling 5.00 5.00  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements						
Summary NEC Load  General Lighting & Receptacles Fixed-in-Place Appliances & Motors Sum of all General Loads  Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements  Required  (kW) Required  (kW) Required  Required  21.30  32.40  18.960  5.00  5.00  5.00  5.00  5.00  6  0  0  18.960  18.960	Largest Motor's Starting Amps (LRA)	143.0	)	0.00		140.0
Summary NEC Load  General Lighting & Receptacles Fixed-in-Place Appliances & Motors Sum of all General Loads  Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements  Required  (kW) Required  (kW) Required  Required  21.30  32.40  18.960  5.00  5.00  5.00  5.00  5.00  6  0  0  18.960  18.960				Lood		NEC
General Lighting & Receptacles Fixed-in-Place Appliances & Motors Sum of all General Loads  Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements	Summary NEC Load				-	
Fixed-in-Place Appliances & Motors  Sum of all General Loads  Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements	700					
Sum of all General Loads  Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements  32.40  18.960  5.00  5.00  5.00  23.960 0 0 18						
Cooling Heating (w/demand factors) Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV Elevation Minimum size generator for motor starting requirements  5.00  5.00  5.00  23.960 0 18	5.5					18 060
Heating (w/demand factors)  Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV  Elevation  Minimum size generator for motor starting requirements  355000	Sum of all General Loads			32.40		10.300
Heating (w/demand factors)  Larger of Heating & Cooling  Sizing based on requirements of NEC Article 220: Part IV  Elevation  Minimum size generator for motor starting requirements  355000				F 00		5.00
Larger of Heating & Cooling 5.00 5.00  Sizing based on requirements of NEC Article 220: Part IV 23.960 Elevation 0 Minimum size generator for motor starting requirements 18	Cooling					
Sizing based on requirements of NEC Article 220: Part IV  Elevation  Minimum size generator for motor starting requirements  355000	Heating (w/demand factors)					
Elevation  Minimum size generator for motor starting requirements  18	Larger of Heating & Cooling			5.00		5.00
Elevation  Minimum size generator for motor starting requirements  18						
Elevation Minimum size generator for motor starting requirements  355000	Sizing based on requirements of NEC Ar	ticle 220: Part IV				
Minimum size generator for motor starting requirements	(T)					
365000		g requirements				
	BTU load required	3				355000

24 kW Generac Model Generator Recommended

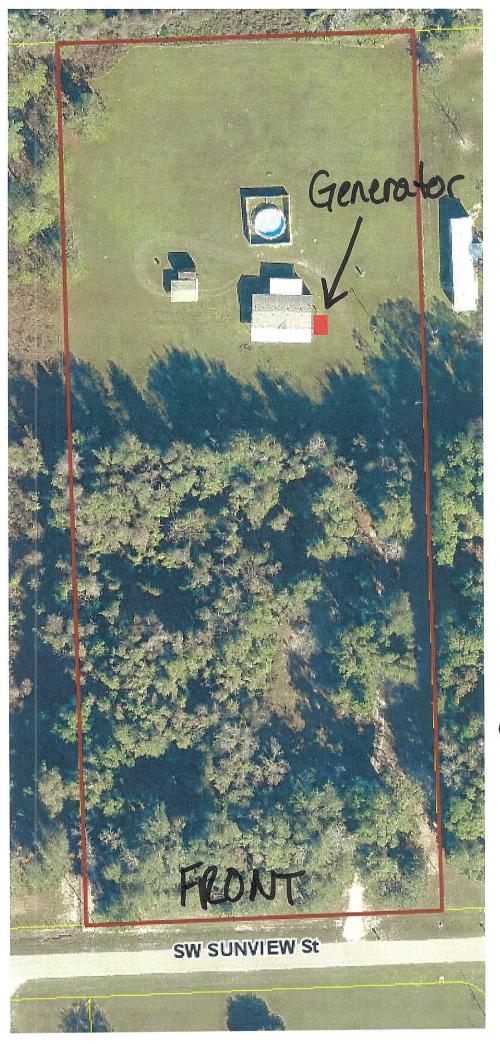

Deverly Toler 415 Sun view St. Fort White, FL. 32028

85 feet generator to Right property line.

495 feet generator to Front property line.

# 1 of 6



## 20/22/24 kW



G007038-1, G007039-1, G007038-3, G007039-3 (Aluminum - Bisque) - 20 kW 60 Hz

**GENERAC®** 

**GUARDIAN® SERIES** 

Air-Cooled Gas Engine

**Residential Standby Generators** 

- Standby Power Rating
- G007042-2, G007043-2, G007042-3, G007043-3 (Alumínum Bisque) 22 kW 60 Hz G007209-0, G007210-0 (Aluminum - Bisque) - 24 kW 60 Hz





Note: CETL or CUL certification only applies to unbundled units and units packaged with limited circuit switches. Units packaged with the Smart Switch are ETL or UL certified in the USA only.

#### **INCLUDES:**

- True Power™ Electrical Technology
- Two-line multilingual digital LCD Evolution ™ controller (English/Spanish/French/Portuguese)
- 200 amp service rated transfer switch available
- Electronic governor
- Standard Wi-Fi® connectivity
- System status & maintenance interval LED indicators
- Sound attenuated enclosure
- Flexible fuel line connector
- Natural gas or LP gas operation
- 5 Year limited warranty
- Listed and labeled by the Southwest Research Institute allowing installation as close as 18 in (457 mm) to a structure.\* \*Must be located away from doors, windows, and fresh air intakes and in accordance with local codes.

https://assets.swri.org/library/DirectoryOfListedProducts/ ConstructionIndustry/973\_DoC\_204\_13204-01-01\_Rev9.pdf

### **FEATURES**

- INNOVATIVE ENGINE DESIGN & RIGOROUS TESTING are at the heart of Generac's success in providing the most reliable generators possible. Generac's G-Force engine lineup offers added peace of mind and reliability for when it's needed the most. The G-Force series engines are purpose built and designed to handle the rigors of extended run times in high temperatures and extreme operating conditions.
- TRUE POWER™ ELECTRICAL TECHNOLOGY: Superior harmonics and sine wave form produce less than 5% Total Harmonic Distortion for utility quality power. This allows confident operation of sensitive electronic equipment and micro-chip based appliances, such as variable speed HVAC systems.
- 0 **TEST CRITERIA:** 
  - PROTOTYPE TESTED SYSTEM TORSIONAL TESTED
- **NEMA MG1-22 EVALUATION** MOTOR STARTING ABILITY
- MOBILE LINK® CONNECTIVITY: FREE with select Guardian Series Home standby generators, Mobile Link Wi-Fi allows users to monitor generator status from anywhere in the world using a smartphone, tablet, or PC. Easily access information such as the current operating status and maintenance alerts. Users can connect an account to an authorized service dealer for fast, friendly, and proactive service. With Mobile Link, users are taken care of before the next power outage

- SOLID-STATE, FREQUENCY COMPENSATED VOLTAGE REGULATION: This state-of-the-art power maximizing regulation system is standard on all Generac models. It provides optimized FAST RESPONSE to changing load conditions and MAXI-MUM MOTOR STARTING CAPABILITY by electronically torque-matching the surge loads to the engine. Digital voltage regulation at  $\pm 1\%$ .
- SINGLE SOURCE SERVICE RESPONSE from Generac's extensive dealer network provides parts and service know-how for the entire unit, from the engine to the smallest electronic component.
- GENERAC TRANSFER SWITCHES: Long life and reliability are synonymous with GENERAC POWER SYSTEMS. One reason for this confidence is that the GENERAC product line is offered with its own transfer systems and controls for total system compatibility.
- PWRVIEW TRANSFER SWITCH: The Generac PWRview Automatic Transfer Switch integrates the PWRview energy monitor to provide real-time energy consumption data that can help lower a home's electricity bill. Using a convenient mobile app, homeowners can access energy usage and alert information while under utility power or generator power. The PWRview energy monitor is a simple to use and low cost tool which helps save money over the life of the generator. Included with model G007210-0.













### **Features and Benefits**

## **Engine**

Generac G-Force design

20/22/24 kW

"Spiny-lok" cast iron cylinder walls

Electronic ignition/spark advance

Full pressure lubrication system

Low oil pressure shutdown system

High temperature shutdown

Maximizes engine "breathing" for increased fuel efficiency. Plateau honed cylinder walls and plasma moly rings help the engine run cooler, reducing oil consumption and resulting in longer engine life.

Rigid construction and added durability provide long engine life.

These features combine to assure smooth, quick starting every time.

Pressurized lubrication to all vital bearings means better performance, less maintenance, and longer engine

life. Now featuring up to a 2 year/200 hour oil change interval.

Shutdown protection prevents catastrophic engine damage due to low oil.

Prevents damage due to overheating.

#### Generator

Revolving field

Skewed stator

Displaced phase excitation

Automatic voltage regulation

UL 2200 listed

Allows for a smaller, light weight unit that operates 25% more efficiently than a revolving armature generator.

Produces a smooth output waveform for compatibility with electronic equipment.

Maximizes motor starting capability.

Regulating output voltage to ±1% prevents damaging voltage spikes.

For your safety.

#### Transfer Switch (if applicable)

Fully automatic

NEMA 3R

Integrated load management technology

Remote mounting

Transfers vital electrical loads to the energized source of power.

Can be installed inside or outside for maximum flexibility.

Capability to manage additional loads for efficient power management.

Mounts near an existing distribution panel for simple, low-cost installation.

#### **PWRview Transfer Switch (if applicable)**

PWRview energy monitor

Ability to view real-time energy consumption data

PWRview mobile app

Energy usage at-a-glance.

Better understand the home's energy profile.

Access daily energy intelligence and insights.

#### **Evolution™ Controls**

AUTO/MANUAL/OFF illuminated buttons

Two-line multilingual LCD

Sealed, raised buttons

Utility voltage sensing

Engine cool-down

Programmable exercise

seconds by a qualified dealer. Verifies engine is ready to assume the load, setpoint approximately 5 seconds.

Selects the operating mode and provides easy, at-a-glance status indication in any condition.

Constantly monitors utility voltage, setpoints 65% dropout, 80% pick-up, of standard voltage.

Constantly monitors generator voltage to verify the cleanest power delivered to the home.

Provides homeowners easily visible logs of history, maintenance, and events up to 50 occurrences.

Allows engine to cool prior to shutdown, setpoint approximately 1 minute.

Smooth, weather-resistant user interface for programming and operations.

Operates engine to prevent oil seal drying and damage between power outages by running the generator for 5 minutes every other week. Also offers a selectable setting for weekly or monthly operation providing

Prevents nuisance start-ups of the engine, adjustable 2-1500 seconds from the factory default setting of 5

flexibility and potentially lower fuel costs to the owner.

Delivers charge to the battery only when needed at varying rates depending on outdoor air temperature.

Compatible with lead acid and AGM-style batteries.

Protects generator from overload.

Maintains constant 60 Hz frequency.

Generator voltage sensing

Utility interrupt delay

Engine warm-up

Smart battery charger

Main line circuit breaker

Electronic governor

## 3 of 6

## 20/22/24 kW

## **Features and Benefits**

GENERAC

l	J	n	iii

SAE weather protective enclosure

Enclosed critical grade muffler

Small, compact, attractive

Sound attenuated enclosures ensure quiet operation and protection against mother nature, withstanding winds up to 150 mph (241 km/h). Hinged key locking roof panel for security. Lift-out front for easy access to all routine maintenance items. Electrostatically applied textured epoxy paint for added durability.

Quiet, critical grade muffler is mounted inside the unit to prevent injuries.

Makes for an easy, eye appealing installation, as close as 18 in (457 mm) away from a structure.

### Installation System

• 14 in (35.6 cm) flexible fuel line connector

Listed ANSI Z21.75/CSA 6.27 outdoor appliance connector for the required connection to the gas supply piping.

Integral sediment trap

Meets IFGC and NFPA 54 installation requirements.

#### Connectivity (Wi-Fi equipped models only)

Ability to view generator status

. -

Ability to view generator Exercise/Run and Total Hours

Ability to view generator maintenance information

Monthly report with previous month's activity

Ability to view generator battery information

Weather information

Monitor generator with a smartphone, tablet, or computer at any time via the Mobile Link application for complete peace of mind.

Review the generator's complete protection profile for exercise hours and total hours.

Provides maintenance information for the specific model generator when scheduled maintenance is due.

Detailed monthly reports provide historical generator information.

Built in battery diagnostics displaying current state of the battery.

Provides detailed local ambient weather conditions for generator location.

## **GENERAC**

## **Specifications**

Generator	G	e	n	e	r	a	t	0	r
-----------	---	---	---	---	---	---	---	---	---

20/22/24 kW

Model	G007038-1 G007039-1 (20 kW)	G007042-2 G007043-2 (22 kW)	G007038-3 G007039-3 (20 kW)	G007042-3 G007043-3 (22 kW)	G007209-0 G007210-0 (24 kW)
Rated maximum continuous power capacity (LP)	20,000 Watts*	22,000 Watts*	20,000 Watts*	22,000 Watts*	24,000 Watts*
Rated maximum continuous power capacity (NG)	18,000 Watts*	19,500 Watts*	18,000 Watts*	19,500 Watts*	21,000 Watts*
Rated voltage			240		
Rated maximum continuous load current – 240 volts (LP/NG)	83.3 / 75.0	91.7 / 81.3	83.3 / 75.0	91.7 / 81.3	100 / 87.5
Total Harmonic Distortion			Less than 5%		
Main line circuit breaker	90 amp	100 amp	90 amp	100 amp	100 amp
Phase			1		
Number of rotor poles			2		
Rated AC frequency			60 Hz		
Power factor			1.0		
Battery requirement (not included)	12 V	olts, Group 26R 540 C	CA minimum or Group	35AGM 650 CCA mir	nimum
Unit weight (lb / kg)	448 / 203	466 / 211	436 / 198	445 / 202	455 / 206
Dimensions (L x W x H) in / cm		48 x 2	25 x 29 / 121.9 x 63.5	x 73.7	
Sound output in dB(A) at 23 ft (7 m) with generator operating at normal load**	67	67	67	67	67
Sound output in dB(A) at 23 ft (7 m) with generator in Quiet-Test ** low-speed exercise mode**	55	57	55	57	57
Exercise duration			5 min		

#### Engine

Eligine					
Engine type		GENERAC G-Force 1000 Series			
Number of cylinders		2			
Displacement				999 cc	
Cylinder block			Alu	minum w/ cast iron sleeve	
Valve arrangement				Overhead valve	
Ignition system				Solid-state w/ magneto	
Governor system				Electronic	
Compression ratio				9.5:1	
Starter			,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	12 VDC	
Oil capacity including filter				Approx. 1.9 qt / 1.8 L	
Operating rpm				3,600	
Fuel consumption					
Natural gas	ft <sup>s</sup> /hr (m³/hr) 1/2 Load Full Load	204 (5.78) 301 (8.52)	228 (6.46) 327 (9.26)	164 (4.64) 287 (8.13)	203 (5.75) 306 (8.66)
Liquid propane	ft <sup>3</sup> /hr (gal/hr) [L/hr] 1/2 Load Full Load	87 (2.37) [8.99] 130 (3.56) [13.48]	92 (2.53) [9.57] 142 (3.90) [14.77]	86 (2.36) [8.95] 136 (3.74) [14.15]	92 (2.53) [9.57] 142 (3.90) [14.77]

Note: Fuel pipe must be sized for full load. Required fuel pressure to generator fuel inlet at all load ranges - 3.5–7 in water column (0.87–1.74 kPa) for NG, 10–12 in water column (2.49–2.99 kPa) for LP gas. For BTU content, multiply ft<sup>3</sup>/hr x 2500 (LP) or ft<sup>3</sup>/hr x 1000 (NG). For Megajoule content, multiply m<sup>3</sup>/hr x 93.15 (LP) or m<sup>3</sup>/hr x 37.26 (NG).

#### Controls

Two-line plain text multilingual LCD	Simple user interface for ease of operation.
Mode buttons: AUTO	Automatic start on utility failure. Weekly, Bi-weekly, or Monthly selectable exerciser.
MANUAL	Start with starter control, unit stays on. If utility fails, transfer to load takes place.
OFF	Stops unit. Power is removed. Control and charger still operate.
Ready to Run/Maintenance messages	Standard
Engine run hours indication	Standard
Programmable start delay between 2–1500 seconds	Standard (programmable by dealer only)
Utility Voltage Loss/Return to Utility adjustable (brownout setting)	From 140-171 V / 190-216 V
Future Set Capable Exerciser/Exercise Set Error warning	Standard
Run/Alarm/Maintenance logs	50 events each
Engine start sequence	Cyclic cranking: 16 sec on, 7 rest (90 sec maximum duration).
Starter lock-out	Starter cannot re-engage until 5 sec after engine has stopped.
Smart Battery Charger	Standard
Charger Fault/Missing AC warning	Standard
Low Battery/Battery Problem Protection and Battery Condition indication	Standard
Automatic Voltage Regulation with Over and Under Voltage Protection	Standard
Under-Frequency/Overload/Stepper Overcurrent Protection	Standard
Safety Fused/Fuse Problem Protection	Standard
Automatic Low Oil Pressure/High Oil Temperature Shutdown	Standard
Overcrank/Overspeed (@ 72 Hz)/rpm Sense Loss Shutdown	Standard
High Engine Temperature Shutdown	Standard
Internal Fault/Incorrect Wiring protection	Standard
Common external fault capability	Standard
Field upgradable firmware	Standard
Field upgradable firmware	Standard  Standard Standard Applicable for SUDD

\*\*Sound levels are taken from the front of the generator. Sound levels taken from other sides of the generator may be higher depending on installation parameters. Rating definitions - Standby: Applicable for supplying emergency power for the duration of the utility power outage. No overload capability is available for this rating. (All ratings in accordance with BS5514, IS03046 and DIN6271). \* Maximum kilovolt amps and current are subject to and limited by such factors as fuel BTU/megajoule content, ambient temperature, altitude, engine power and condition, etc. Maximum power decreases approximately 3.5% for each 1,000 ft (304.8 m) above sea level; and also will decrease approximately 1% for each 10 °F (6 °C) above 60 °F (16 °C).



**Switch Options** 

## 20/22/24 kW

#### **Service Rated Automatic Transfer Switch Features**

- Intelligently manages up to four air conditioner loads with no additional hardware.
- Up to eight additional large (240 VAC) loads can be managed when used in conjunction with Smart Management Modules (SMMs).
- Electrically operated, mechanically-held contacts for fast, clean connections.
- Rated for all classes of load, 100% equipment rated, both inductive and resistive.
- 2-pole, 250 VAC contactors.
- Service equipment rated, dual coil design.
- Rated for both aluminum and copper conductors.
- Main contacts are silver plated or silver alloy to resist welding and sticking.
- NEMA/UL 3R aluminum outdoor enclosure allows for indoor or outdoor mounting flexibility.


#### **Dimensions**

			nps 120/24 sition Servi		
	He	ight	Wi	dth	Donth
	H1	H2	W1	W2	Depth
in	26.8	30.1	10.5	13.5	6.9
cm	67.95	76.43	26.67	34.18	17.5

Wire Ranges		
Conductor Lug	Neutral Lug	Ground Lug
250 MCM - #6	350 MCM - #6	2/0 - #14

#### G007039-1, G007039-3 (20 kW) Model G007043-2, G007043-3 (22 kW) No. of poles 200 Current rating (amps) 120/240, 1Ø Voltage rating (VAC) Utility voltage monitor (fixed)\* 80% -Pick-up 65% -Dropout Approx. 13 sec Return to Utility\* Exercises bi-weekly for 5 minutes\* Standard Standard ETL or UL listed NEMA/UL 3R Enclosure type Circuit breaker protected 22,000 Lug range 250 MCM - #6

<sup>\*</sup>Function of Evolution controller Exercise can be set to weekly, bi-weekly, or monthly



#### **PWRview Automatic Transfer Switch Features**

- Integrated PWRview monitor provides real-time energy usage data through PWRview app.
- Intelligently manages up to four air conditioner loads with no additional hardware.
- Up to eight additional large (240 VAC) loads can be managed when used in conjunction with Smart Management Modules (SMMs).
- Electrically operated, mechanically-held contacts for fast, clean connections.
- Rated for all classes of load, 100% equipment rated, both inductive and resistive.
- 2-pole, 250 VAC contactors.
- Service equipment rated, dual coil design.
- Rated for both aluminum and copper conductors.
- Main contacts are silver plated or silver alloy to resist welding and sticking.
- NEMA 3R aluminum outdoor enclosure allows for indoor or outdoor mounting flexibility.
- Heavy duty Generac Contactor is an ETL recognized device


#### **Dimensions**

			nps 120/24 sition Servi		
İ	He	ight	Wi	dth	Depth
	H1	H2	W1	W2	Depui
in	26.8	30.1	10.5	13.5	6.9
cm	67.95	76.43	26.67	34.18	17.5

Wire Ranges				
Conductor Lug	Neutral Lug	Ground Lug		
250 MCM - #6	350 MCM - #6	2/0 - #14		

Model	G007210-0 (24 kW)
No. of poles	2
Current rating (amps)	200
Voltage rating (VAC)	120/240, 1Ø
Utility voltage monitor (fixed)* -Pick-up -Dropout	80% 65%
Return to Utility*	Approx. 13 sec
Exercises bi-weekly for 5 minutes*	Standard
ETL or UL listed	Standard
Enclosure type	NEMA 3R
Circuit breaker protected	22,000
Lug range	250 MCM - #6

\*Function of Evolution controller
Exercise can be set to weekly, bi-weekly, or monthly



20/22/24 kW





## **Available Accessories**

Model #	Product	Description
G005819-0	26R Wet Cell Battery	Every standby generator requires a battery to start the system. Generac offers the recommended 26R wet cell battery for use with all air-cooled standby product (excluding PowerPact®).
G007101-0	Battery Pad Warmer	Pad warmer rests under the battery. Recommended for use if temperature regularly falls below 0 °F (-18 °C). (Not necessary for use with AGM-style batteries).
G007102-0	Oil Warmer	Oil warmer slips directly over the oil filter. Recommended for use if temperature regularly falls below 0 °F (-18 °C).
G007103-1	Breather Warmer	Breather warmer is for use in extreme cold weather applications. For use with Evolution controllers only in climates where heavy icing occurs.
G005621-0	Auxiliary Transfer Switch Contact Kit	The auxiliary transfer switch contact kit allows the transfer switch to lock out a single large electrical load that may not be needed. Not compatible with 50 amp pre-wired switches.
G007027-0 - Bisque	Fascia Base Wrap Kit (Standard on 22 kW)	The fascia base wrap snaps together around the bottom of the new air-cooled generators. This offers a sleek, contoured appearance as well as offering protection from rodents and insects by covering the lifting holes located in the base.
G005703-0 - Bisque	Touch-Up Paint Kit	If the generator enclosure is scratched or damaged, it is important to touch up the paint to protect from future corrosion. The touch-up paint kit includes the necessary paint to correctly maintain or touch up a generator enclosure.
G006485-0	Scheduled Maintenance Kit	Generac's scheduled maintenance kit provides all the items necessary to perform complete routine maintenance on a Generac automatic standby generator (oil not included).
G007005-0	Wi-Fi LP Tank Fuel Level Monitor	The Wi-Fi enabled LP tank fuel level monitor provides constant monitoring of the connected LP fuel tank. Monitoring the LP tank's fuel level is an important step in verifying the generator is ready to run during an unexpected power failure. Status alerts are available through a free application to notify users when the LP tank is in need of a refill.
G007000-0 (50 amp) G007006-0 (100 amp)	Smart Management Module	Smart Management Modules (SMM) are used to optimize the performance of a standby generator. It manages large electrical loads upon startup and sheds them to aid in recovery when overloaded. In many cases, using SMM's can reduce the overall size and cost of the system.
G007169-0 - 4G LTE G007170-0 - Wi-Fi/ Ethernet	Mobile Link <sup>®</sup> Cellular Accessories	The Mobile Link family of Cellular Accessories allow users to monitor generator status from anywhere in the world, using a smart phone, tablet, or PC. Easily access information such as the current operating status and maintenance alerts. Users can connect an account with an authorized service dealer for fast, friendly, and proactive service. With Mobile Link, users are taken care of before the next power outage.
G007220-0 - Bisque	Base Plug Kit	Base plugs snap into the lifting holes on the base of air-cooled home standby generators. This offers a sleek, contoured appearance, as well as offers protection from rodents and insects by covering the lifting holes located in the base. Kit contains four plugs, sufficient for use on a single air-cooled home standby generator.

## **Dimensions & UPCs**

Model	UPC
G007038-1	696471074185
G007038-3	696471074185
G007039-1	696471074192
G007039-3	696471074192
G007042-2	696471074208
G007042-3	696471074208
G007043-2	696471074215
G007043-3	696471074215
G007209-0	696471071511
G007210-0	696471078220





Dimensions shown are approximate. See installation manual for exact dimensions. DO NOT USE THESE DIMENSIONS FOR INSTALLATION PURPOSES.





**Automatic Transfer Switches** 



GENERA

**Automatic Transfer Switch** with 20-40 Circuit Load Center

200 Amps, Single Phase

Model: RXGW20SHA3







## Description

Generac Transfer Switches are designed for use with single phase generators that utilize an Evolution™ or Nexus™ Controller. The 200 amp open transition switch is a single phase service entrance rated configuration. An integrated load center with pass through lugs allows branch circuit protection for outbuildings, while also feeding a home's main distribution panel.

### **Standard Features**

Service Rated Generac Automatic Transfer Switches are housed in an aluminum Type 3R enclosure, with electrostatically applied and baked powder paint. The Heavy Duty Generac Contactor is an ETL recognized device, designed for years of service. The controller at the generator handles all the timing, sensing, exercising functions, and transfer commands. The integrated 20 space load center accepts 1 in (25.4 mm) standard, GFCI, AFCI, or tandem circuit breakers from Siemens, Murray, Eaton, and Square D for the most flexible and cost effective install. Utilizing tandem breakers, the load center can be equipped to support up to 40 individual circuits. All switches are covered by a 5 year limited warranty.

## **Load Management Technology**

Through the use of the integrated Smart A/C Module (SACM), these switches have the capability to manage up to four individual HVAC (24 VAC controlled) loads with no additional hardware. When used in tandem with external Smart Management Modules (SMM), a total of eight more loads can be managed, providing the most installation efficient power management options available.





## **GENERAC**

## **Automatic Transfer Switches**

## 200 Amps, Single Phase

### **Functions**

All timing and sensing functions originate in the generator controller.

5 Second Factory Set, Adjustable Between 2 - 1,500 Seconds by a Qualified Dealer*
5 Seconds
60% for 5 Seconds
>80%
15 Seconds
60 Seconds
Nexus™: 12 Minutes Weekly Evolution™: 5 to 12 Minutes Adjustable, Weekly/Bi-weekly/Monthly

<sup>\*</sup> When used in conjunction with units utilizing Evolution™ controls

### **Specifications**

Model	RXGW20SHA3
Amps	200
Voltage	120/240, 1ø
Load Transition Type (Automatic)	Open Transition Service Rated
Enclosure Type	NEMA 3R
Compliance	ETL
Withstand Rating (Amps)	10,000 22,000*
Integrated Load Center	20–40

### **Dimensions, Weight, and Wire Ranges**

	RXGW20SHA3
H1	35.0 / 88.9
H2	38.5 / 97.8
W1	14.0 / 35.5
W2	17.6 / 44.7
cm)	8.0 / 20.3
s/kg)	45 / 20.4
ge	#1 - 300 MCM AI/CU 75 °C
	H2 W1 W2 cm)



