
JONES RESIDENCE 29.20kW PV SYSTEM 421 SE ALFRED MARKHAM ST, LAKE CITY, FL 32025

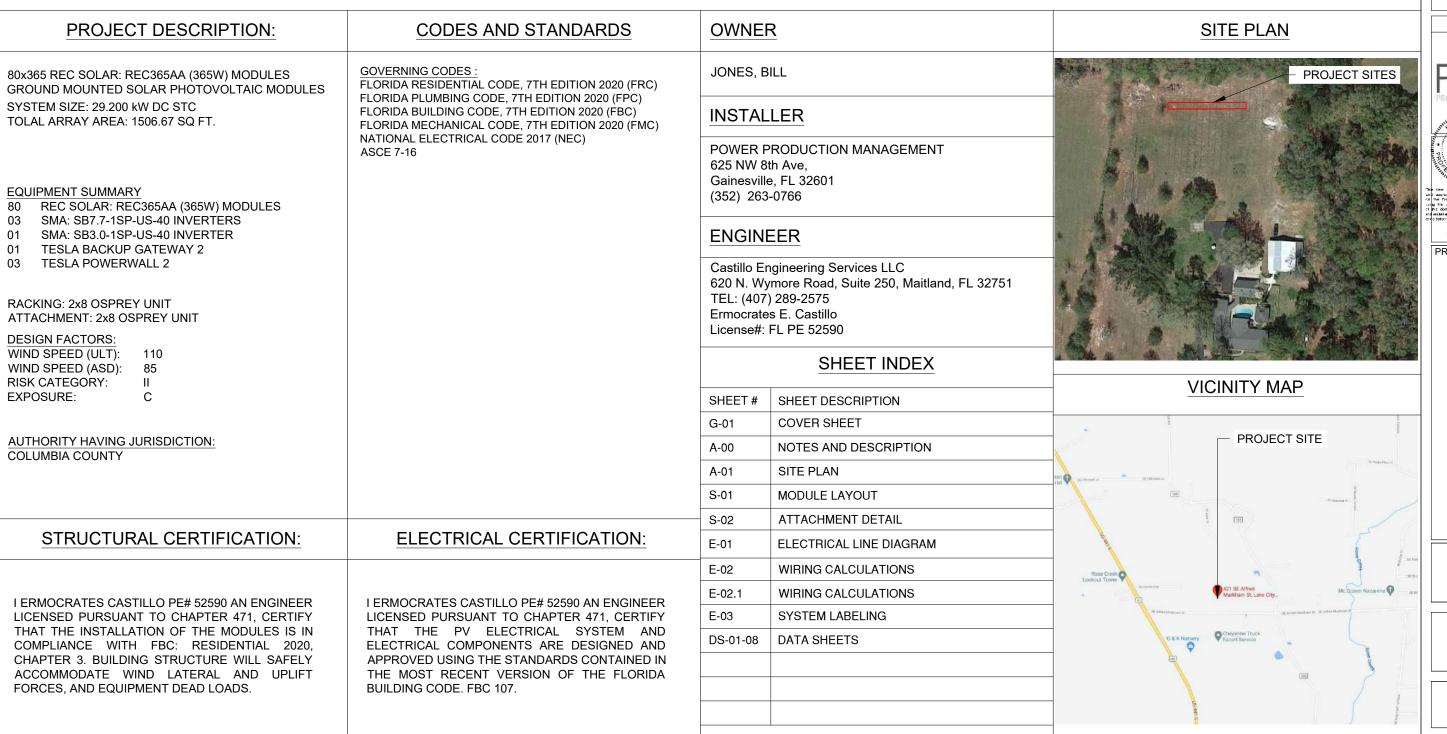

Engineering C

CASTILLO ENGINEERING SERVICES, LLC


COA # 28345 620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590
COPYRIGHTED BY
CASTILLO ENGINEERING

SERVICES, LLC
REVISIONS

DESCRIPTION DATE REV

PROJECT INSTALLER



PROJECT NAME

JONES RESIDENCE
11 SE ALFRED MARKHAM ST,
LAKE CITY, FL 32025

SHEET NAME


COVER SHEET

SHEET SIZE

ANSI B

11" X 17"

G-01

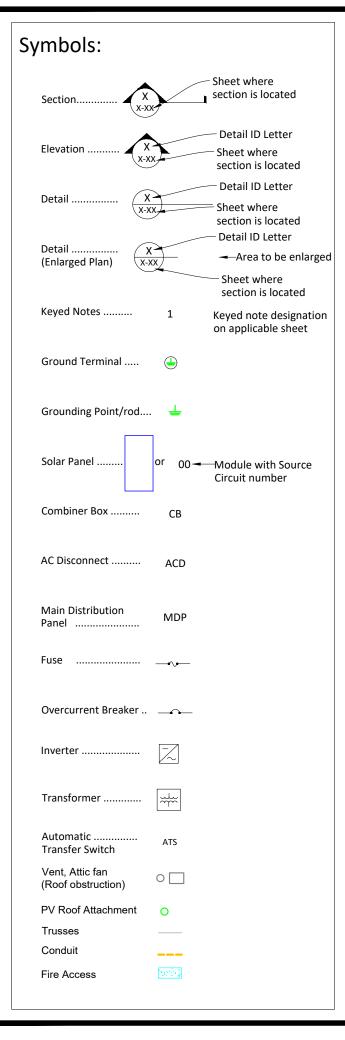

Ahhreviations

Abbreviations:			
AC	Alternating Current		
ACD	Alternating Current Disconnect		
APPROX	Approximate		
AWG	American Wire Gauge		
BAT	Tesla Powerwall		
СВ	Combiner Box		
DC	Direct Current		
DISC	Disconnect		
(E)	Existing		
EL	Elevation		
EQ	Equal		
GP	Generation Panel		
JB	Junction Box		
MCB	Main Combiner Box		
MFR	Manufacturer		
MID	Microgrid Interconnect Device		
MIN	Minimum		
MISC	Miscellaneous		
MDP	Main Distribution Panel		
(N)	New		
NAVD	North American Vertical datum		
OCPD	OverCurrent Protection Device		
POCC	Point Of Common Coupling		
PV	Photovoltaic		
SF	Squarefoot/feet		
STC	Standard Test Conditions		
SD	Soladeck		
TBD	To Be Determined		
TYP	Typical		
UNO	Unless Notified Otherwise		
UM	Utility meter		
VIF	Verify In Field		


Weather Proof

WP

System Description

This system is a grid-tied, PV system, with PV generation consisting of 80x365 REC SOLAR: REC365AA (365W) Modules with a combined STC rated dc output power of 29,200W. The modules are connected into 03 SMA: SB7.7-1SP-US-40 & 01 SMA: SB3.0-1SP-US-40 Inverters. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the National Electrical Code

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

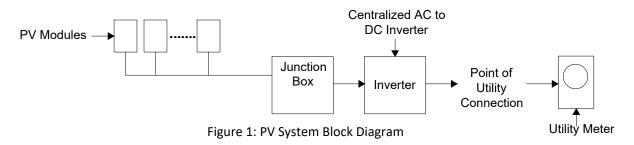

The inverter meets the requirements of IEEE 1547 and UL 1741.

FALL PROTECTION:


ANCHORAGES USED FOR ATTACHMENT OF PERSONAL FALL ARREST EQUIPMENT MUST BE INDEPENDENT OF ANY ANCHORAGE BEING USED TO SUPPORT OR SUSPEND PLATFORMS, AND CAPABLE OF SUPPORTING AT LEAST 5,000 POUNDS PER EMPLOYEE ATTACHED, OR MUST BE DESIGNED AND USED AS FOLLOWS:

- AS PART OF A COMPLETE PERSONAL FALL ARREST SYSTEM WHICH MAINTAINS A SAFETY FACTOR OF AT LEAST TWO.
- UNDER THE SUPERVISION OF A QUALIFIED PERSON

ADDITIONAL INFORMATION

- 29 CFR 1926 SUBPART M, FALL PROTECTION. OSHA STANDARD.
- 1926.502. FALL PROTECTION SYSTEMS CRITERIA AND PRACTICES

1926.502(D)(15)





SUITE 250. MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590 COPYRIGHTED BY

CASTILLO ENGINEERING SERVICES, LLC

REVISIONS DESCRIPTION DATE REV

PROJECT INSTALLER



Ermocrates STATE OF E Castillo Date: 2021.07.09
three course
17:32:26

S

PROJECT NAME


MARKHAM ; FL 32025 RESIDENCE FRED I JONES

SHEET NAME NOTES AND DESCRIPTION

421

SHEET SIZE ANSI B 11" X 17"

SHEET NUMBER A-00

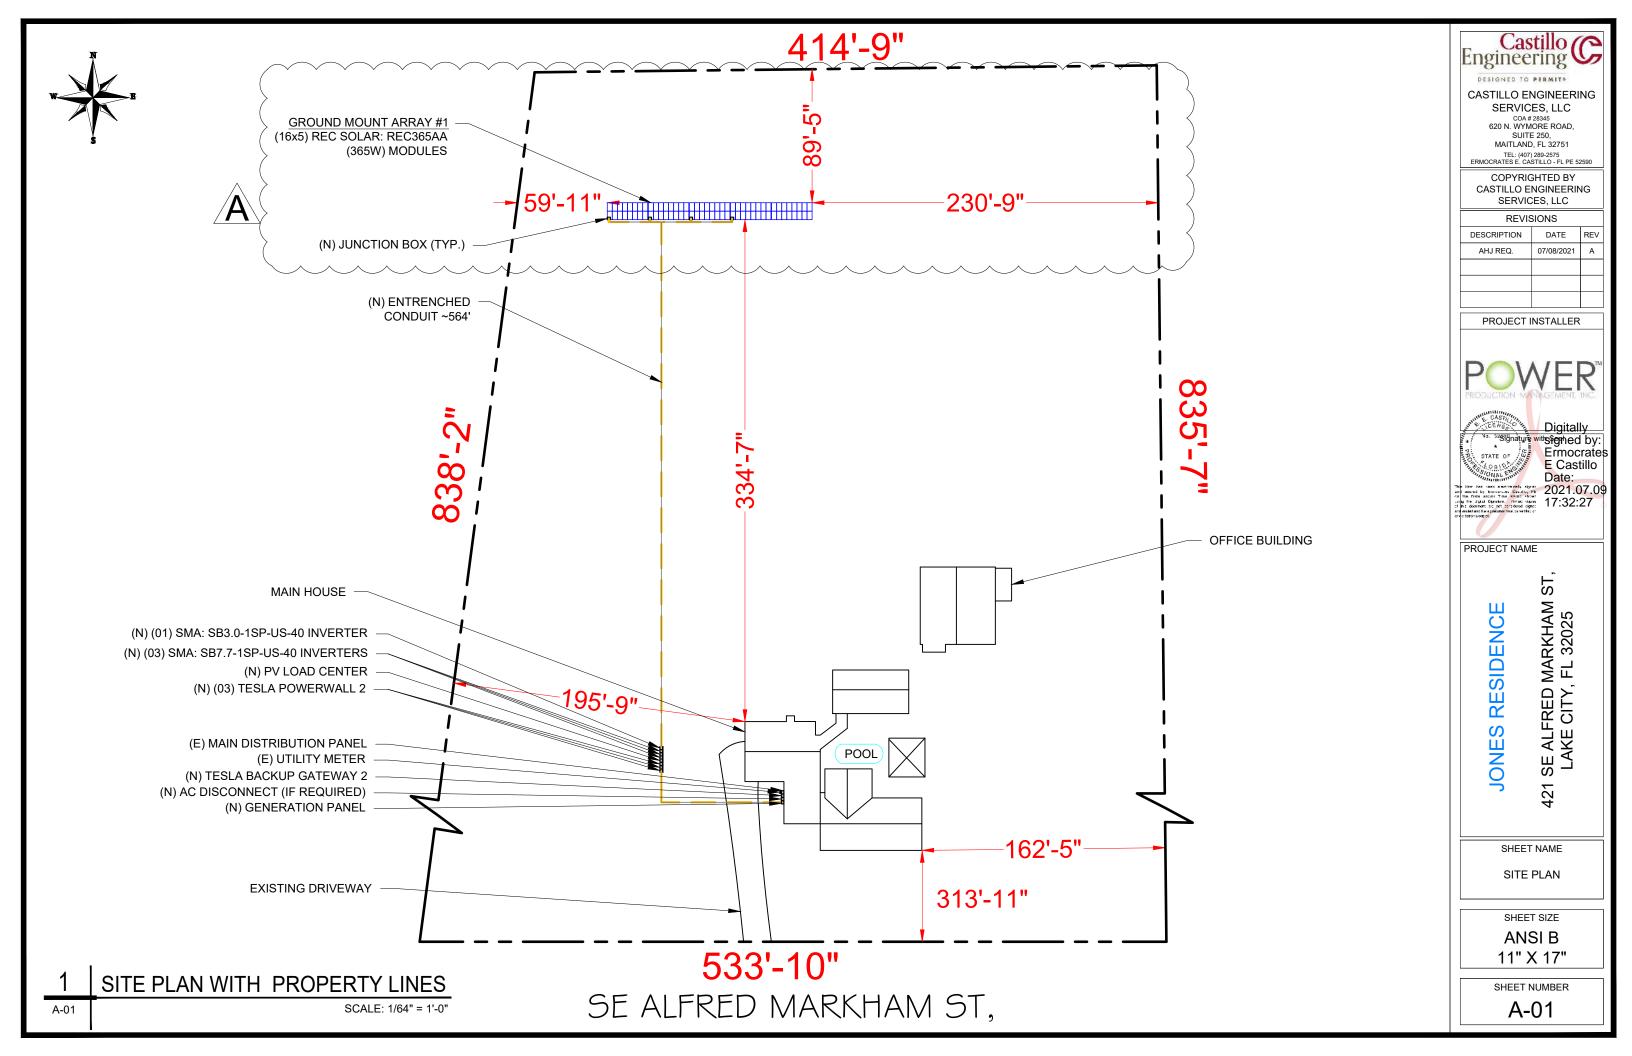

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 80 MODULES
MODULE TYPE = REC SOLAR: REC365AA (365W) MODULES
MODULE WEIGHT = 42.99 LBS / 19.5 KG.
MODULE DIMENSIONS = 67.8"x 40.0" = 18.83 SF
UNIT WEIGHT OF ARRAY = 2.28 PSF




GROUND MOUNT FOR PV PANEL GENERAL NOTES:

- 1. APPLICABLE CODE: ASCE 7-16 MINIMUM DESIGN LOADS FOR BUILDING AND OTHER STRUCTURES COMPATIBLE WITH 2020 FLORIDA BUILDING CODE (7th EDITION).
- 2. GROUND RACK SHOWN MAY BE SLOPED UP TO A MAXIMUM 18°.
- 3. SOIL BEARING CAPACITY ASSUMED TO BE THE FOLLOWING: UNDISTURBED COMPACTED SAND, SILTY SAND, CLAYEY SAND, SILTY GRAVEL AND CLAYEY GRAVEL

WITH VERTICAL FOUNDATION PRESSURE OF 2,000 PSF AND LATERAL BEARING PRESSURE OF 150 PSF / FT BELOW NATURAL GRADE THAT CONTINUES TO HOLD IT SHAPE BEFORE AND AFTER INSTALLATION. IN THE CASE OF LOOSE SANDS, MUD, SILTS, OR ORGANIC TYPE SOILS, LARGER FOOTER SIZE WILL BE REQUIRED. CONTRACTOR SHALL NOTIFY ENGINEER TO RE-SIZE FOOTERS. SEE FBC CHAPTER 18 SECTION 1806.2 FOR ADDITIONAL DETAILS AND EXCEPTIONS.

- 4. REFER TO UNIRAC FOR ALL COMPONENT SPECIFICATION AND INSTALLATION INSTRUCTIONS.
- 5. CONTRACTOR/INSTALLER SHALL INSTALL GROUND RACK SYSTEM WITHIN NEW OR EXISTING PROPERTY SETBACKS PER GOVERNING BUILDING DEPARTMENT.
- 6. THIS SHEET REFLECTS STRUCTURAL CONNECTIONS AND STRUCTURAL DETAILS OF GROUND RACK ONLY. INSTALL SOLAR PV MODULES PER MANUFACTURER RECOMMENDATIONS.
- 7. CONCRETE SHALL BE NORMAL WEIGHT 3000 PSI MINIMUM.
- 8. ALL DISSIMILAR METALS & MATERIALS SHALL BE SEPARATED WITH NEOPRENE OR EQUAL
- 9. CONTRACTOR CAN MAKE FINAL ADJUSTMENTS ON SITE TO ACCOMODATE ACTUAL FIELD CONDITIONS
- -- DESIGN CRITERIA FOR GROUND RACK AND ALL CONNECTIONS THIS SHEET IS BASED ON MAIN WIND FORCE RESISTING SYSTEM (MWFRS) VULT = 110 MPH WITH EXPOSURE "C", RISK CATEGORY I, MONOSLOPE FREE ROOF AND H < 15'-0" PER ASCE 7-16 "MINIMUM DESIGN LOADS FOR BUILDING AND OTHER STRUCTURES" AND 2017 F.B.C. (7th EDITION). SITE SPECIFIC ENGINEERS APPROVAL IS REQUIRED IF SITE REQUIREMENTS EXCEEDS DESIGN CRITERIA.

(E) BACK YARD

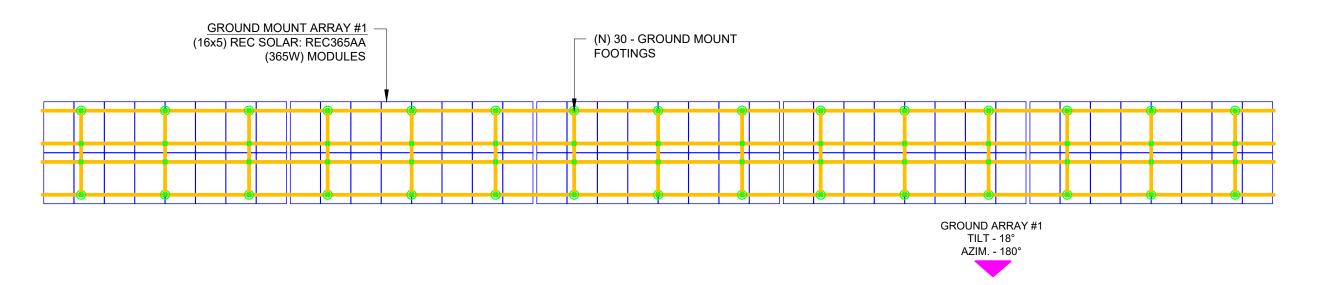

(E) FRONT YARD

Castillo C Engineering

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345 620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

T C VIC	310110	
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally

Vo. 53 Signatur with Signhed by:
Ermocrates
E Castillo
Date:
2021.07.09
117:32:27

PROJECT NAME

JONES RESIDENCE
421 SE ALFRED MARKHAM ST
LAKE CITY, FL 32025

SHEET NAM

MODULE LAYOUT

SHEET SIZE

ANSI B

SHEET NUMBER


11" X 17"

S-01

1 MODULE LAYOUT

S-01

SCALE: 3/32" = 1'-0"

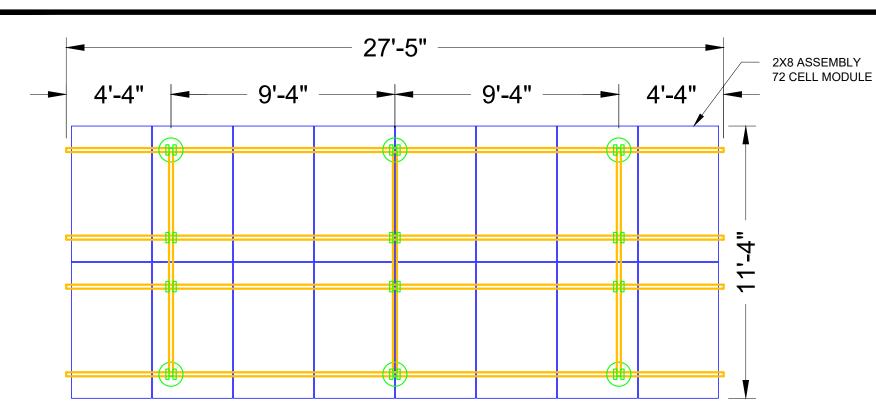

REQUIRED EARTH ANCHOR TEST LOADS

	Design Wind Speed (V)	72 Cell	Modules	60 Cell I	Modules
	ASCE 7-16 (or 7-10)	Back Legs	Front Legs	Back Legs	Front Legs
<u>a</u>	ASCE 7-16 (01 7-10)	Load (lbs.)	Load (lbs.)	Load (lbs.)	Load (lbs.)
3	100 MPH	1700	800	1400	700
	110 MPH	2000	900	1700	800
	115 MPH	2200	1000	1900	900
Ø	120 MPH	2400	1100	2000	900
saeri.	130 MPH	2800	1300	2400	1100
	140 MPH	3200	1500	2700	1300
	150 MPH	3700	1700	3100	1400

UPWARD DEFLECTION LIMIT AFTER ANCHOR SET = 1/2"

LATERAL DEFLECTION LIMIT AFTER ANCHOR SET = 1"

THE LOAD TEST MUST BE PERFORMED BY AN

APPROVED CONTRACTOR.


ARRAY#1, #2 #3, #4 & #5 STRUCTURE DETAIL 2X8 RACKS

S-02 SCALE: 1/4" = 1'-0"

SIDE VIEW DETAIL

SCALE: 1/2" = 1'-0"

S-02

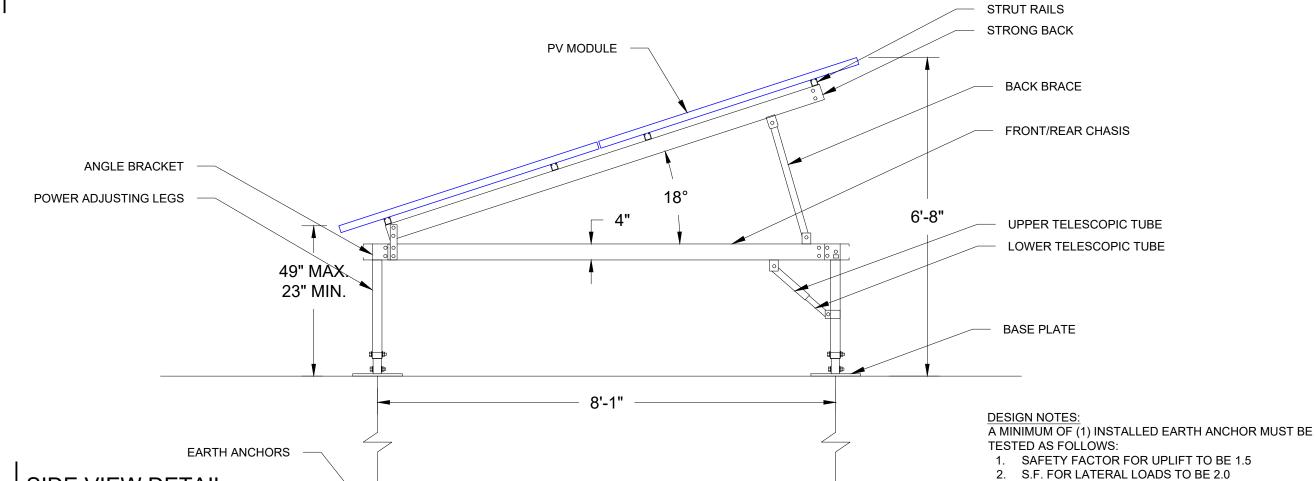

Castillo C Engineering

CASTILLO ENGINEERING

SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

TEL: (407) 289-2575 MOCRATES E. CASTILLO - FL PE 52

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES LLC

SERVICES, LLC

REVISIONS			
ESCRIPTION	DATE	REV	

PROJECT INSTALLER



PROJECT NAME

JONES RESIDENCE

421 SE ALFRED MARKHAM ST LAKE CITY, FL 32025

SHEET NAME


ATTACHMENT DETAIL

SHEET SIZE ANSI B

11" X 17"

SHEET NUMBER

S-02

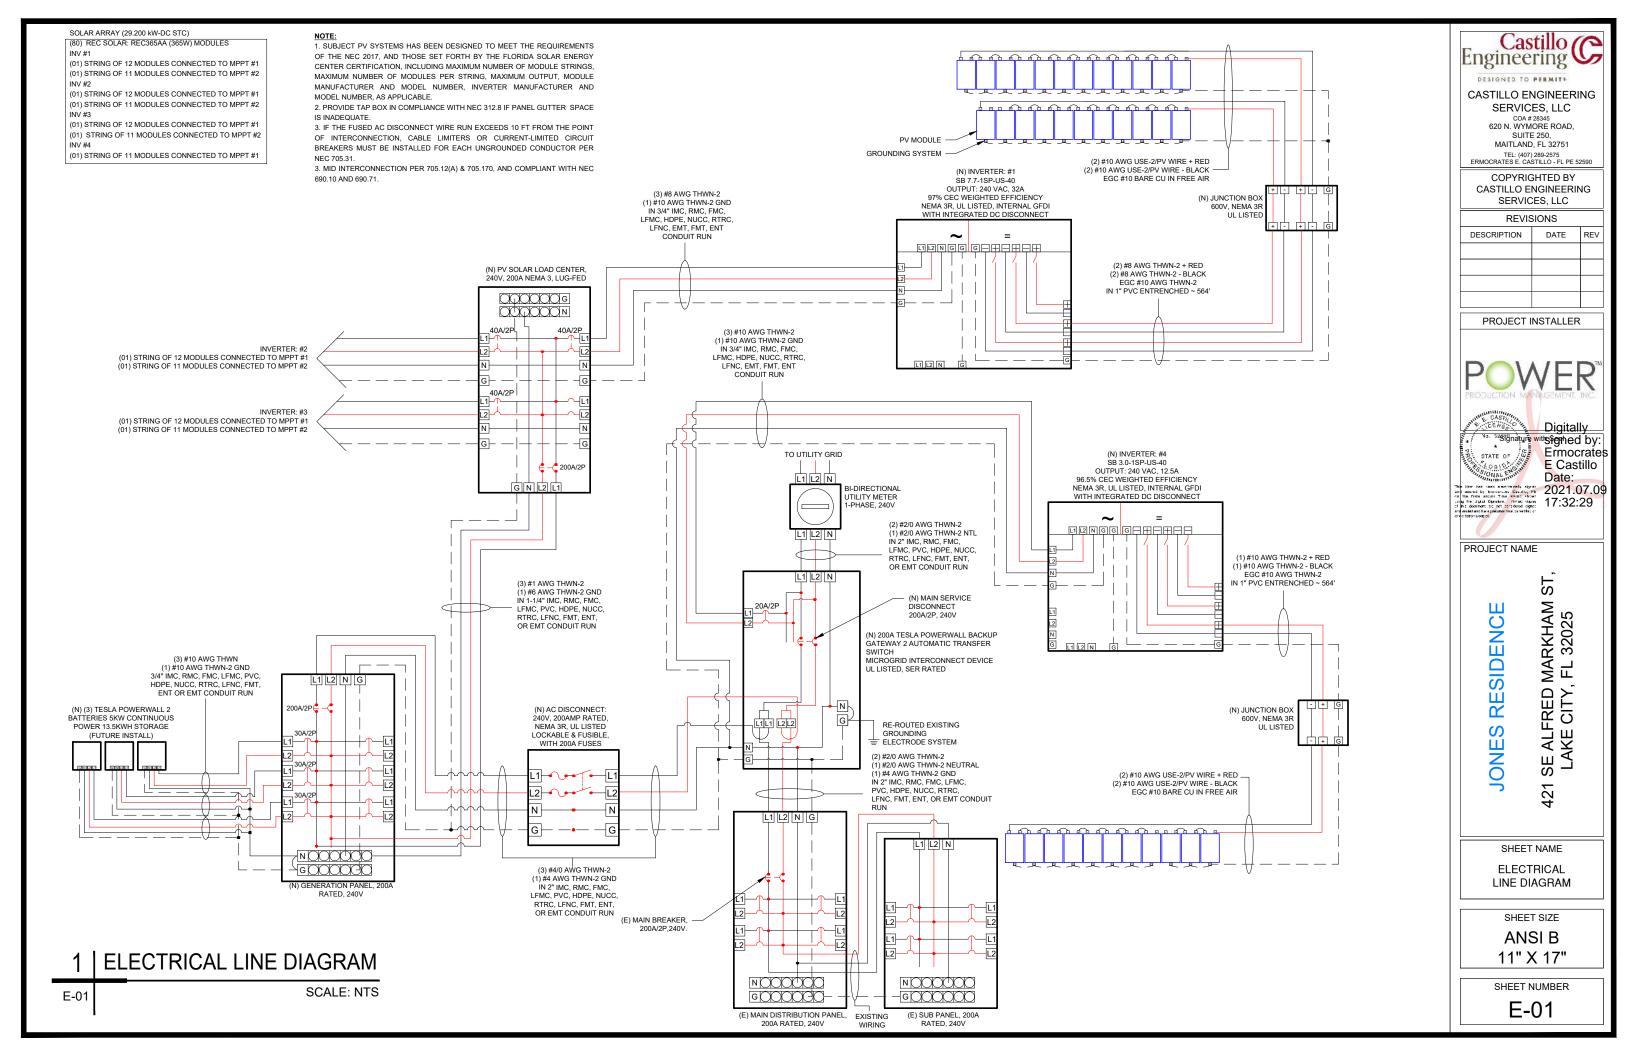

DC CONDUCTOR AMPACITY CALCULATIONS: ARRAY TO JUNCTION BOX (INV#1, INV#2 & INV#3):

EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORRECTION PER 310.15(B)(2)(a)	0.96
NO. OF CURRENT CARRYING CONDUCTORS	4
CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a)	0.80
CIRCUIT CONDUCTOR SIZE	10 AWG
CIRCUIT CONDUCTOR AMPACITY	40A

TEMP. CORRECTION PER 310.15(B)(2)(a) X CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	30.72A
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)	
1.25 X 1.25 X lsc	10.03A
REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(A&B)	16.03A

RESULT SHOULD BE GREATER THAN (16.03A) OTHERWISE INCREASE THE SIZE OF THE CONDUCTOR AND ITS AMPACITY

FROM JUNCTION BOX TO INVERTER (INV#1, INV#2 & INV#3):

EXPECTED WIRE TEMP (In Celsius)	25°
TEMP. CORRECTION PER 310.15(B)(2)(a)	1.0
NO. OF CURRENT CARRYING CONDUCTORS	8
CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a)	0.70
CIRCUIT CONDUCTOR SIZE	8 AWG
CIRCUIT CONDUCTOR AMPACITY	55A

REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(A&B)	16.03A	
1.25 X1.25 X lsc	16.03A	
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)		
TEMP. CORRECTION PER 310.15(B)(2)(a) X CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	38.5A	

RESULT SHOULD BE GREATER THAN (16.03A) OTHERWISE INCREASE THE SIZE OF THE CONDUCTOR AND ITS AMPACITY

AC CONDUCTOR AMPACITY CALCULATIONS: INVERTER TO LOAD CENTER (INV#1, INV#2 & INV#3):

No. OF INVERTER	1
EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORRECTION PER 310.15(B)(3)(a)	0.96
NO. OF CURRENT CARRYING CONDUCTORS	3
CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a)	1
CIRCUIT CONDUCTOR SIZE	8AWG
CIRCUIT CONDUCTOR AMPACITY	55A

REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(B) & 705.12.D.2	40A
1.25 X MAX INVERTER OUTPUT CURRENT	10/1
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)	
TEMP. CORRECTION PER 310.15(B)(3)(a)X CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a) X CIRCUIT CONDUCTOR AMPACITY	52.8A

Result should be greater than (40A) otherwise increase the size of the conductor and its ampacity

AC CONDUCTOR AMPACITY CALCULATIONS:

No. OF INVERTER	4
EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORRECTION PER 310.15(B)(3)(a)	0.96
NO. OF CURRENT CARRYING CONDUCTORS	3
CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a)	1
CIRCUIT CONDUCTOR SIZE	1 AWG
CIRCUIT CONDUCTOR AMPACITY	130A

LOAD CENTER TO GENERATION PANEL

20/15 0211121110 02112101110111711122	
REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(B) & 705.12.D.2	120.0A
1.25 X MAX INVERTER OUTPUT CURRENT(32A + 32A + 32A)	120.07
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)	
TEMP. CORRECTION PER 310.15(B)(3)(a)X CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a) X CIRCUIT CONDUCTOR AMPACITY	139.2A

Result should be greater than (120.0A) otherwise increase the size of the conductor and its ampacity

ELECTRICAL NOTES

- 1.) ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- 2.) ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREES C.
- 3.) THE WIRES ARE SIZED ACCORDING TO NEC 110.14
- 4.) WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- 5.) WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- 6.) DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
- 7.) WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- 8.) ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- 9.) MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
- 10.) MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
- 11.) UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
- 12.) MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
- 13.) RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
- 14.) CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
- 15.) CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).

GENERATION PANEL AMPACITY CALCULATIONS:

No. OF INVERTER	4
EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORRECTION PER 310.15(B)(3)(a)	0.96
NO. OF CURRENT CARRYING CONDUCTORS	3
CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a)	1
CIRCUIT CONDUCTOR SIZE	4/0AWG
CIRCUIT CONDUCTOR AMPACITY	260A
	EXPECTED WIRE TEMP (In Celsius) TEMP. CORRECTION PER 310.15(B)(3)(a) NO. OF CURRENT CARRYING CONDUCTORS CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a) CIRCUIT CONDUCTOR SIZE

REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(B) & 705.12.D.2	210A
CURRENT FROM SLC + BATTERIES (120A + 90A)	210A
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)	
TEMP. CORRECTION PER 310.15(B)(3)(a)X CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a) X CIRCUIT CONDUCTOR AMPACITY	249.6A
Double bould be supplied by (240A) about it is supplied by the size of the supplied by	1.74

Result should be greater than (210A) otherwise increase the size of the conductor and its ampacity

DC PHOTOVOLTAIC POWER SOURCE TO BE INSTALLED AT INVERTER #1, #2 & #3 PER NEC 690.53 & 690.54 OPERATING CURRENT 12.0A OPERATING VOLTAGE 456.0V MAXIMUM SYSTEM VOLTAGE 531.60V

SHORT CIRCUIT CURRENT

INVERTER #1, #2	& #3 SPECIFICATIONS
MANUFACTURER	SMA
MODEL#	SB7.7-1SP-US-40
NOMINAL AC POWER	7.7 KW
NOMINAL OUTPUT VOLTAGE	240V
NOMINAL OUTPUT CURRENT	32 A

SOLAR MOD	DULE SPECIFICATIONS
MANUFACTURER	REC SOLAR
MODEL#	REC365AA
PMAX	365W
VMP	38.0V
IMP	9.60A
VOC	44.3V
ISC	10.26A
MODULE DIMENSION	67.8"L x 40.0"W x 1.2"D (In Inch)

	NUMBER OF CURRENT
PERCENT OF	CARRYING CONDUCTORS IN
VALUES	EMT
0.80	4-6
0.70	7-9
0.50	10-20

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107.

Castillo C Engineering

CASTILLO ENGINEERING SERVICES, LLC COA # 28345

COA # 28345 620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES LLC

OLITAIOLO, LLO		
REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



PROJECT NAME

RESIDENCE

JONES

12.83A

421 SE ALFRED MARKHAM ST

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE ANSI B

SHEET NUMBER

11" X 17"

E-02

DC CONDUCTOR AMPACITY CALCULATIONS: ARRAY TO JUNCTION BOX (INV#4):

EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORRECTION PER 310.15(B)(2)(a)	0.96
NO. OF CURRENT CARRYING CONDUCTORS	2
CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a)	1
CIRCUIT CONDUCTOR SIZE	10 AWG
CIRCUIT CONDUCTOR AMPACITY	40A

DECLUTE OLICIUS DE ODEATES TUANI (10.00A) OTUESIMOS INODEACE T	017E 0E
TEMP. CORRECTION PER 310.15(B)(2)(a) X CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	38.4A
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)	
1.25 X 1.25 X Isc	10.03A
REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(A&B)	16.03A

RESULT SHOULD BE GREATER THAN (16.03A) OTHERWISE INCREASE THE SIZE OF THE CONDUCTOR AND ITS AMPACITY

FROM JUNCTION BOX TO INVERTER (INV#4):

25°
1.0
2
1.0
10 AWG
40A

REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(A&B)	16.03A
1.25 X1.25 X lsc	10.03A
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)	
TEMP. CORRECTION PER 310.15(B)(2)(a) X CONDUIT FILL CORRECTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	40.0A
RESULT SHOULD BE GREATER THAN (16.03A) OTHERWISE INCREASE THE	

AC CONDUCTOR AMPACITY CALCULATIONS: INVERTER TO LOAD CENTER (INV#4):

No. OF INVERTER	1
	0.40
EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORRECTION PER 310.15(B)(3)(a)	0.96
NO. OF CURRENT CARRYING CONDUCTORS	3
CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a)	1
CIRCUIT CONDUCTOR SIZE	10AWG
CIRCUIT CONDUCTOR AMPACITY	40A

REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(B) & 705.12.D.2	15 624	
1.25 X MAX INVERTER OUTPUT CURRENT	- 15.63A	
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC 310.15(B)(2)(a)		
TEMP. CORRECTION PER 310.15(B)(3)(a)X CONDUIT FILL CORRECTION PER NEC 310.15(B)(2)(a) X CIRCUIT CONDUCTOR AMPACITY	38.4A	
Result should be greater than (15.63A) otherwise increase the size of the conductor and		

DC PHOTOVOLTAIC POWER SOURCE TO BE INSTALLED AT INVERTER #4 PER NEC 690.53 & 690.54

INVERTER #4 SPECIFICATIONS					
MANUFACTURER	SMA				
MODEL#	SB3.0-1SP-US-40				
NOMINAL AC POWER	3.0 KW				
NOMINAL OUTPUT VOLTAGE	240V				
NOMINAL OUTPUT CURRENT	12.8 A				

SOLAR MODULE SPECIFICATIONS			
MANUFACTURER	REC SOLAR		
MODEL#	REC365AA		
PMAX	365W		
VMP	38.0V		
IMP	9.60A		
VOC	44.3V		
ISC	10.26A		
MODULE DIMENSION	67.8"L x 40.0"W x 1.2"D (In Inch)		

	NUMBER OF CURRENT
PERCENT OF	CARRYING CONDUCTORS IN
VALUES	EMT
0.80	4-6
0.70	7-9
0.50	10-20

ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107.

OPERATING CURRENT 12.0A OPERATING VOLTAGE 418.0V 487.30V MAXIMUM SYSTEM VOLTAGE SHORT CIRCUIT CURRENT 12.83A

INVERTER #4 SPECIFICATIONS		
MANUFACTURER	SMA	
MODEL#	SB3.0-1SP-US-40	
NOMINAL AC POWER	3.0 KW	
NOMINAL OUTPUT VOLTAGE	240V	
NOMINAL OUTPUT CURRENT	12.8 A	

	NUMBER OF CURRENT
PERCENT OF	CARRYING CONDUCTORS IN
VALUES	EMT
0.80	4-6
0.70	7-9
0.50	10-20

Castillo Engineering DESIGNED TO PERMITS

CASTILLO ENGINEERING SERVICES, LLC COA # 28345 620 N. WYMORE ROAD,

SUITE 250. MAITLAND, FL 32751

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

DESCRIPTION DATE REV

PROJECT INSTALLER



Date: The liter has been entired by styres and sound by the transfer that would be the transfer to t

PROJECT NAME

RESIDENCE

JONES

ST 421

WIRING CALCULATIONS

SHEET SIZE ANSI B

11" X 17"

SHEET NUMBER E-02.1

ELECTRICAL NOTES

THE CONDUCTOR AND ITS AMPACITY

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREES C.
- THE WIRES ARE SIZED ACCORDING TO NEC 110.14. 3.)
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.

its ampacity

- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
- MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
- UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
- MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
- RACKING CONFORMS TO AND IS LISTED UNDER UL 2703. 13.)
- CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D). 14.)
- CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLÉ 310.10 (C).



ELECTRIC SHOCK HAZARD TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

AC DISCONNECT, POINT OF INTERCONNECTION (PER CODE: NEC 690.13(B))

WARNING DUAL POWER SOURCE SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION: POINT OF INTERCONNECTION (PER CODE: NEC 705.12(B)(2)(3)(b))

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

LABEL LOCATION: (PER CODE: NEC690.56(C)(3))

ADHESIVE FASTENED SIGNS:

- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
- WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD. APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING]. • ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]

PHOTOVOLTAIC SYSTEM AC DISCONNECT RATED AC OPERATING CURRENT 108.5 AMPS AC NOMINAL OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION: AC DISCONNECT, POINT OF INTERCONNECTION (PER CODE: NEC690.54)

WARNING

INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION: POINT OF INTERCONNECTION (PER CODE: NEC 705.12(B)(2)(3)(b))

INVERTER #1, #2 & #3

MAXIMUM SYSTEM VOLTAGE (VOC)	531.60	٧
MAXIMUM CIRCUIT CURRENT (Isc)	12.83	Α
MAXIMUM RATED OUTPUT OF DC TO DC CONVERTER (Idc)	15	Α

LABEL LOCATION: DC DISCONNECT, INVERTER (PER CODE: NEC690.53)

INVERTER #4

MAXIMUM SYSTEM VOLTAGE (VOC)	487.30	V
MAXIMUM CIRCUIT CURRENT (Isc)	12.83	A
MAXIMUM RATED OUTPUT OF DC TO DC CONVERTER (Idc)	15	A

LABEL LOCATION: DC DISCONNECT, INVERTER (PER CODE: NEC690.53)

WARNING:

THIS EQUIPMENT FED BY MULTIPLE **SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING** MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR

LABEL LOCATION: POINT OF INTERCONNECTION (PER CODE: NEC 705.12(D)(2)(3)(c))



CASTILLO ENGINEERING

SERVICES, LLC COA # 28345 620 N. WYMORE ROAD, SUITE 250. MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS DESCRIPTION DATE REV

PROJECT INSTALLER



Date: The liter has been and referred to digitate and award by binner was boundary. Per collins from a many from a street product of the product of

ST

FRED I

SE ALFF LAKE O

SE

421

E Castillo

PROJECT NAME

RESIDENCE JONES


SYSTEM LABELING

SHEET SIZE ANSI B


11" X 17"

SHEET NUMBER

E-03

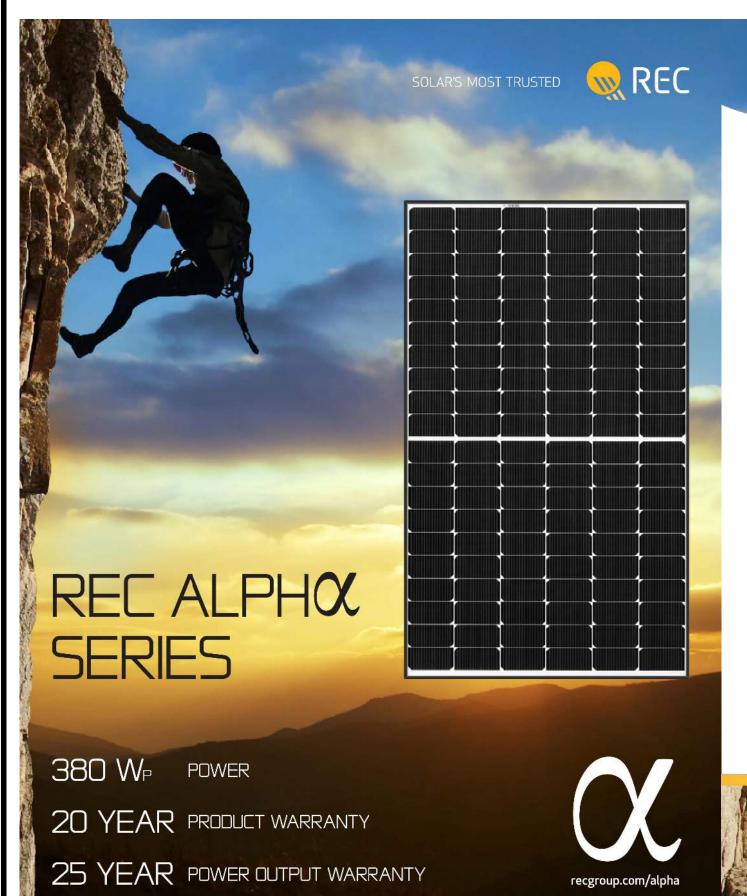

REC ALPHOX SERIES PRODUCT DATASHEET

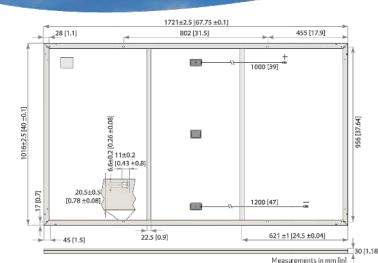

🬳 GENERAL DATA

Cell type:	120 half-cut cells with REC heterojunction cell technology 6 strings of 20 cells in series
Glass:	0.13 in (3.2 mm) solar glass with anti-reflection surface treatment
Backsheet:	Highly resistant polymeric construction
Eramo	Anadizad aluminum (black)

Stäubli MC4PV-KBT4/KST4,12AWG(4 mm²) Connectors in accordance with IEC 62852 IP68 only when connected Made in Singapore

Cable:

Junction box:

7	EL	EC.	TRICAL	DAT	Ά(<u>@</u>	ST
-				_			

Product Code*: RECxxxAA				
360	365	370	375	380
-0/+5	-0/+5	-0/+5	-0/+5	-0/+5
37.7	38.0	38.3	38.7	39.0
9.55	9.60	9.66	9.72	9.76
44.1	44.3	44.5	44.6	44.7
10.23	10.26	10.30	10.40	10.46
20.6	20.9	21.2	21,4	21.7
	360 -0/+5 37.7 9.55 44.1 10.23	360 365 -0/+5 -0/+5 37.7 38.0 9.55 9.60 44.1 44.3 10.23 10.26	360 365 370 -0/+5 -0/+5 -0/+5 37.7 38.0 38.3 9.55 9.60 9.66 44.1 44.3 44.5 10.23 10.26 10.30	360 365 370 375 -0/+5 -0/+5 -0/+5 -0/+5 37.7 38.0 38.3 38.7 9.55 9.60 9.66 9.72 44.1 44.3 44.5 44.6 10.23 10.26 10.30 10.40


P ELECTRICAL DATA @ NMOT	Product Code*: RECxxxAA				
Nominal Power - P _{MPP} (Wp)	274	278	282	286	290
Nominal Power Voltage - V _{MPP} (V)	35.5	35.8	36.1	36.4	36.7
Nominal Power Current-I _{MPP} (A)	7.71	7.76	7.80	7.85	7.88
Open Circuit Voltage - V _{oc} (V)	41.6	41.7	41.9	42.0	42.1
Short Circuit Current-I _{SC} (A)	8.26	8.29	8.32	8.40	8.45

Nominal module operating temperature (NMDT.air mass AM1.5, irracliance 800 W/m², temperature 68°F (20°C), windspeed 3.3 ft/s (1 m/s). $^{\circ}$ Where xxxx indicates the nominal power class ($F_{\rm vps}$) at STC above.

CERTIFICATIONS

IEC 61215:2016, IEC 617:	30:2016, UL 1703, UL 61730
IEC 62804	PID
IEC 61701	Salt Mist
IEC 62716	Ammonia Resistance
UL 1703	Fire Type Class 2
IEC 62782	Dynamic Mechanical Load
IEC 61215-2:2016	Hailstone (35mm)
AS4040.2 NCC 2016	Cyclic Wind Load
ISO 14001:2004, ISO 9001	:2015, OHSAS 18001:2007

WARRANTY



MECHANICALDATA

Dimensions:	67.8 x 40 x 1.2 in {1721 x 1016 x 30 mr		
Area:	18.8 sq ft (1.75 m²)		
Weight:	43 lbs (19.5 kg)		

MAXIMIIM RATINGS

3-part, 3 bypass diodes, IP67 rated

12 AWG (4 mm²) PV wire, 39 + 47 in (1+1,2 m)

1-0 Otto-Tot-Triating	
Operational temperature:	-40+85°C
Maximum system voltage:	1000 V
Design load (+): srow Maximum test load (+):	4666 Pa (97.5 lbs/sq ft) 7000 Pa (146 lbs/sq ft)
Design load (-): wind Maximum test load (-):	2666 Pa (55.6 lbs/sq ft) 4000 Pa (83.5 lbs/sq ft)
Max series fuse rating:	25 A
Max reverse current:	25 A


*Calculated using a safety factor of 1.5 *See installation manual for mounting instructions

TEMPERATURE RATINGS*

TEI-W ENVIOUE TOTAL	
Nominal Module Operating Temperature:	44°C (±2°C)
Temperature coefficient of P _{MPP} :	-0.26 %/°C
Temperature coefficient of V _{oc} :	-0.24 %/°C
Temperature coefficient of I _{sc} :	0.04 %/°C

*The temperature coefficients stated are linear values

LOW LIGHT BEHAVIOUR



Founded in Norway in 1996, REC is a leading vertically integrated solar energy company. Through integrated manufacturing from silicon to wafers, cells, high-quality panels and extending to solar solutions, REC provides the world with a reliable source of clean energy. REC's renowned product quality is supported by the lowest warranty claims rate in the industry. REC is a Bluestar Elkem company with headquarters in Norway and operational headquarters in Singapore. REC employs around 2,000 people worldwide, producing 1.5 GW of solar panels annually.





DESIGNED TO PERMITS

CASTILLO ENGINEERING SERVICES, LLC COA # 28345

620 N. WYMORE ROAD, SUITE 250. MAITLAND, FL 32751

COPYRIGHTED BY

CASTILLO ENGINEERING SERVICES, LLC

REVISIONS				
DESCRIPTION DATE REV				

PROJECT INSTALLER





PROJECT NAME

ST RESIDENCE JONES

DATA SHEET

421

SHEET SIZE **ANSI B**

11" X 17"

SHEET NUMBER

DS-01

REC Americas LLC 1420 Gateway Dr, Suite 170 San Mateo, CA 94404 Dir 805 704 3226 Fax 805 457 6104 www.recgroup.com



Castillo Engineering Services, LLC 2925 W. State Road 434, Suite 111, Longwood, FI 32779

RE: REC Modules Max Wind Load

San Luis Obispo, 18 February 2021

To Whom it May Concern;

REC Americas LLC confirms that the REC Twin Peak 3M series (RECXXXTP3M) and REC Alpha Series (RECXXXAA) modules have passed UL2703 Mechanical Load testing at a test load of +/-113 PSF utilizing four-point attachments on the long side of the module.

Please be in touch with the REC Technical Department if you have any questions.

Sincerely,

George McClellan **REC Americas LLC**

Senior Technical Sales Manager



CASTILLO ENGINEERING

SERVICES, LLC COA # 28345 620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

,					
REVISIONS					
DESCRIPTION DATE REV					

PROJECT INSTALLER





PROJECT NAME

ST, SE ALFRED MARKHAM LAKE CITY, FL 32025 JONES RESIDENCE 421

SHEET NAME

DATA SHEET

SHEET SIZE ANSI B 11" X 17"

SHEET NUMBER

DS-02

SUNNY BOY 3.0-US / 3.8-US / 5.0-US / 6.0-US / 7.0-US / 7.7-US





Value-Added Improvements

- Superior integration with SMA's MLPE Power+ Solution
- World's first Secure Power Supply* now offers up to 2,000 W
- Full grid management capabilities ensure a utility-compliant solution for any market

Reduced Labor

- New Installation Assistant with direct access via smartphone minimizes time in the field
- Advanced communication interface with fewer components creates 50% faster setup and commissioning

Unmatched Flexibility

- SMA's proprietary OptiTrac™
 Global Peak technology mitigates
 shade with ease
- Multiple independent MPPTs accommodate hundreds of stringing possibilities

Trouble-Free Servicing

- Two-part enclosure concept allows for simple, expedited servicing
- Equipped with SMA Smart Connected, a proactive service solution that is integrated into Sunny Portal

SUNNY BOY 3.0-US / 3.8-US / 5.0-US / 6.0-US / 7.0-US / 7.7-US

Reduce costs across your entire residential business model

The residential PV market is changing rapidly. Your bottom line matters more than ever—so we've designed a superior residential solution to help you decrease costs at every stage of your business operations. The Sunny Boy 3.0-US/3.8-US/5.0-US/6.0-US/7.0-US/7.7-US join the SMA lineup of field-proven solar technology backed by the world's #1 service team, along with a wealth of improvements. Simple design, improved stocking and ordering, value-driven sales support and streamlined installation are just some of the ways that SMA helps your business operate more efficiently. And, Sunny Boy's superior integration with the innovative Power+ Solution means installers have even more flexibility in addressing their toughest challenges. Finally, SMA Smart Connected will automatically detect errors and initiate the repair and replacement process so that installers can reduce service calls and save time and money.

www.SMA-America.com

Technical data			nny Boy 3.0-US Sunny Boy 3.8-US			oy 5.0-US
1 2 3	208 V	240 V	208 V	240 V	208 V	240 V
Input (DC)						A. V. V. V.
Max. PV power	4260) Wp		6 Wp	710	0 Wp
Max. DC voltage		600 V			10000000	
Rated MPP voltage range	155 -	480 V	(4.5)	480 V	220 -	480 V
MPPT operating voltage range		100 - 550 V				
Min. DC voltage / start voltage			THE STATE OF STREET	/ 125 V		
Max. operating input current per MPPT				λA		
Max. short circuit current per MPPT				3 A		
Number of MPPT tracker / string per MPPT tracker		2,	/1		3,	/ 1
Output (AC)						
AC nominal power	3000 W	3000 W	3330 W	3800 W	5000 W	5000 W
Max. AC apparent power	3000 VA	3000 VA	3330 VA	3800 VA	5000 VA	5000 VA
Nominal voltage / adjustable	208 V / •	240 V / •	208 V / •	240 V / •	208 V / •	240 V / •
AC voltage range	183 - 229 V	211 - 264 V	183 - 229 V	211 - 264 V	183 - 229 V	211 - 264
AC grid frequency			60 Hz	/ 50 Hz		
Max. output current	14.5 A	12.5 A	16.0 A	16.0 A	24.0 A	24.0 A
Power factor (cos φ)				1		
Output phases / line connections			1	/2		
Harmonics			7.0	4 %		
Efficiency				ava.		
Max. efficiency	97.2 %	97.6 %	97.2 %	97.5 %	97.2 %	97.5 %
CEC efficiency	96 %	96.5 %	96.5 %	96.5 %	96.5 %	97 %
Protection devices	70 70	70.0 %	70.070	70.0 70	70.0 70	., .,
DC disconnect device / DC reverse polarity protection				/ •		
Ground fault monitoring / Grid monitoring						
AC short circuit protection						
All-pole sensitive residual current monitoring unit (RCMU)						
Arc fault circuit interrupter (AFCI)						
				/IV		
Protection class / overvoltage category General data			17	IA		
			505 700 100	(011 005 70)		
Dimensions (W / H / D) in mm (in)				$(21.1 \times 28.5 \times 7.8)$		
Packaging dimensions (W / H / D) in mm (in)				23.6 × 31.5 × 11.8)		
Weight / packaging weight				/ 30 kg (66 lb)		
Temperature range: operating / non-operating				/ -40°C+60°C		
Environmental protection rating				1A 3R		
Noise emission (typical)				B(A)		
Internal power consumption at night				5 W		
Topology / Cooling concept			Transformerles	ss / Convection		
Features						
Ethernet ports				2		
Secure Power Supply			9	•*		
Display (2 x 16 characters)				•		
WLAN / Sensor module / External WLAN antenna	•/0/0					
Cellular (4G / 3G) / Revenue Grade Meter	0/0**					
Warranty: 10 / 15 / 20 years				0/0		
Certificates and approvals	UL 1741, UL 1741	SA incl. Rule 21 RS		9B, IEEE1547, FCC F RD-UL-1741-SA-V1.1	Part 15 (Class A & B)	, CAN/CSA V2
Standard features O Optional features - Not available	Data at nominal cond	itions	107.1-1, HECO SK	D-QE1741-3A-V1.1		
NOTE: US inverters ship with gray lids. * Not compatible wi	h the Power+ Solution	Shutdown functionality	**Standard in SBX.X-	TTP-US-40		
Type designation					SB5.0-1SP-US-40	/ SRS A ITPLIS



Sensor module MD.SEN-US-40



onno Z





((0



Cellular Modem Kit CELLMODKIT-US-10

98
96
96
97
98
88
88
60
00
02
04
0.6
0.8
1.0
Output power / Rotad power

Castillo C Engineering C

CASTILLO ENGINEERING

SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS
DESCRIPTION DATE REV

PROJECT INSTALLER



The liter has been enditioned, styres and sound by being control of the control o

Date:

PROJECT NAME

JONES RESIDENCE

421 SE ALFRED MARKHAM ST, LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B

11" X 17"

SUNNY BOY 3.0-US / 3.8-US / 5.0-US / 6.0-US / 7.0-US / 7.7-US





Value-Added Improvements

- Superior integration with SMA's MLPE Power+ Solution
- World's first Secure Power Supply* now offers up to 2,000 W
- Full grid management capabilities ensure a utility-compliant solution for any market

Reduced Labor

- New Installation Assistant with direct access via smartphone minimizes time in the field
- Advanced communication interface with fewer components creates 50% faster setup and commissioning

Unmatched Flexibility

- SMA's proprietary OptiTrac™
 Global Peak technology mitigates
 shade with ease
- Multiple independent MPPTs accommodate hundreds of stringing possibilities

Trouble-Free Servicing

- Two-part enclosure concept allows for simple, expedited servicing.
- Equipped with SMA Smart Connected, a proactive service solution that is integrated into Sunny Portal

SUNNY BOY 3.0-US / 3.8-US / 5.0-US / 6.0-US / 7.0-US / 7.7-US

Reduce costs across your entire residential business model

The residential PV market is changing rapidly. Your bottom line matters more than ever—so we've designed a superior residential solution to help you decrease costs at every stage of your business operations. The Sunny Boy 3.0-US/3.8-US/5.0-US/6.0-US/7.0-US/7.7-US join the SMA lineup of field-proven solar technology backed by the world's #1 service team, along with a wealth of improvements. Simple design, improved stocking and ordering, value-driven sales support and streamlined installation are just some of the ways that SMA helps your business operate more efficiently. And, Sunny Boy's superior integration with the innovative Power+ Solution means installers have even more flexibility in addressing their toughest challenges. Finally, SMA Smart Connected will automatically detect errors and initiate the repair and replacement process so that installers can reduce service calls and save time and money.

www.SMA-America.com

Technical data	Sunny Boy 6.0-US		Sunny Boy 7.0-US		Sunny Boy 7.7-US		
	208 V	240 V	208 V	240 V	208 V	240 V	
Input (DC)							
Max. PV power	852	0 Wp		0 Wp	1090	5 Wp	
Max. DC Voltage				0 V			
Rated MPP Voltage range	220 -	480 V		480 V	270 -	270 - 480 V	
MPPT operating voltage range			100 -	550 V			
Min. DC voltage / start voltage			100 V ,	/ 125 V			
Max. operating input current per MPPT				λ			
Max. short circuit current per MPPT			18	3 A			
Number of MPPT tracker / string per MPPT tracker			3,	/1			
Output (AC)							
AC nominal power	5200 W	6000 W	6660 W	7000 W	6660 W	7680 W	
Max. AC apparent power	5200 VA	6000 VA	6660 VA	7000 VA	6660 VA	7680 VA	
Nominal voltage / adjustable	208 V / ●	240 V / •	208 V / •	240 V / •	208 V / •	240 V / •	
AC voltage range	183 - 229 V	211 - 264 V	183 - 229 V	211 - 264 V	183 - 229 V	211 - 264	
AC grid frequency			60 Hz ,	/ 50 Hz			
Max. output current	25.0 A	25.0 A	32.0 A	29.2 A	32.0 A	32.0 A	
Power factor (cos φ)				1			
Output phases / line connections			1.	/2			
Harmonics				4 %			
Efficiency							
Max. efficiency	97.2 %	97.6 %	97.1 %	97.5 %	97.1 %	97.5 %	
CEC efficiency	96.5 %	97%	96.5 %	97 %	96.5 %	97 %	
Protection devices	3/75/3/07		VAC-17-130	20000000	A PROPERTY OF		
DC disconnect device / DC reverse polarity protection			• .	/ •			
Ground fault monitoring / Grid monitoring				•			
AC short circuit protection							
All-pole sensitive residual current monitoring unit (RCMU)							
Arc fault circuit interrupter (AFCI)							
Protection class / overvoltage category			17	'IV			
General data			.,,				
Dimensions (W / H / D) in mm (in)			535 x 730 x 198	(21.1 × 28.5 × 7.8)			
Packaging Dimensions (W / H / D) in mm (in)				$23.6 \times 31.5 \times 11.8$			
Weight / packaging weight				/ 30 kg (66 lb)			
Temperature range: operating / non-operating				/ -40°C+60°C			
Environmental protection rating				1A 3R			
Noise emission (typical)	30.	JB(A)	IALIV		HB(A)		
Internal power consumption at night	371	201.71	25	5 W	ant A		
Topology / Cooling concept	Transformedor	ss / Convection	~3		erless / Fan		
Features	riginalorinelles	a / Convection		Hunstoffit	enessy ruit		
Ethernet ports			-	2			
Secure Power Supply				*			
Display (2 x 16 characters)				×			
WLAN / Sensor module / External WLAN antenna			_ '	• o/o			
Cellular (4G / 3G) / Revenue Grade Meter			1 manual 1 mg	0**			
Warranty: 10 / 15 / 20 years	HI 1731 HI 174	1 SA incl Pule 21 PS		0/0 OR IEFE1547 FCC I	Part 1.5 (Class A & B)	CAN/CSA VO	
Certificates and approvals	011/41,011/4	i w inci. Ruic 21 Ru		D-UL-1741-SA-V1.1	air 13 (Cidss A & b)	, Gray Con VZ	
ullet Standard features O Optional features — Not available					the Power+ Solution Sh	nutdown functional	
NOTE: US inverters ship with gray lids. * Not compatible wi		and the second s					
Type designation	SB6.0-1SP-US-40	/ SB6.0-1TP-US-40	SB7.0-1SP-US-40	/ SB7.0-1TP-US-40	SB7.7-1 SP-US-40	/ SB7.7-1TP-US-4	

POWER+ SOLUTION

The SMA Power+ Solution combines legendary SMA inverter performance and intelligent DC module-level electronics in one cost-effective, comprehensive package. This means that you can achieve maximum solar power production for your customers while also

NEW! Advanced communication interface allows for 50% faster setup and commissioning thanks to reduced components and a simplified process.

realizing significant installation savings.

Visit www.SMA-America.com for more information.

SUPERIOR INTEGRATION WITH THE POWER+ SOLUTION



Engineering C

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345 620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS
DESCRIPTION DATE REV

PROJECT INSTALLER



The litter has been endingly, styres and sty

PROJECT NAME

RESIDENCE

JONES F

421 SE ALFRED MARKHAM ST, LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B

11" X 17"

SHEET NUMBER

DS-04

POWERWALL

Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, time-based control, and backup.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240 V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Total Energy ¹	14 kWh
Usable Energy ¹	13.5 kWh
Real Power, max continuous ²	5 kW (charge and discharge)
Real Power, peak (10s, off-grid/backup)2	7 kW (charge and discharge)
Apparent Power, max continuous	5.8 kVA (charge and discharge)
Apparent Power, peak (10s, off-grid/backup)	7.2 kVA (charge and discharge)
Maximum Supply Fault Current	10 kA
Maximum Output Fault Current	32 A
Overcurrent Protection Device	30 A
Imbalance for Split-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor Range (full-rated power)	÷/= 0.85
Internal Battery DC Voltage	50 V
Round Trip Efficiency ^{1,8}	90%
Warranty	10 years


¹Values provided for 25°C (77°F), 3.3 kW charge/discharge power.

COMPLIANCE INFORMATION

Certifications	UL 1642, UL 1741, UL 1973,
	UL 9540, IEEE 1547, UN 38.3
Grid Connection	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)

MECHANICAL SPECIFICATIONS

Dimensions	1150 mm x 755 mm x 155 mm
	(45.3 in x 29.7 in x 6.1 in)
Weight	125 kg (276 lbs)
Mounting options	Floor or wall mount




ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Optimum Temperature	0°C to 30°C (32°F to 86°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Conditions	-20°C to 30°C (-4°F to 86°F)
	Up to 95% RH, non-condensing
	State of Energy (SoE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
ngress Rating	IP67 (Battery & Power Electronics)
	IP56 (Wiring Compartment)
Wet Location Rating	Yes
Noise Level @ 1m	< 40 dBA at 30°C (86°F)


TESLA.COM/ENERGY

TYPICAL SYSTEM LAYOUTS

WHOLE HOME BACKUP

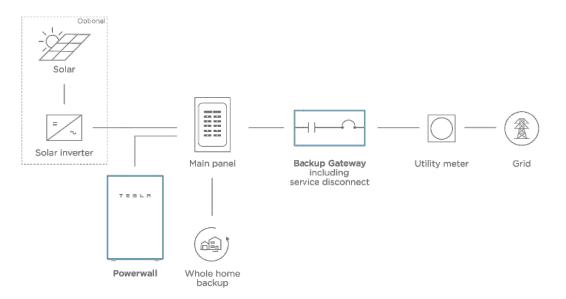

PARTIAL HOME BACKUP

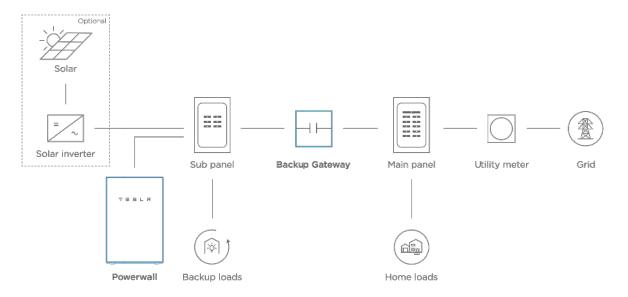

NA - BACKUP - 2018-11-01 TESLA TESLA.COM/ENERGY

Castillo C ineering **Engineering** DESIGNED TO PERMITA

CASTILLO ENGINEERING

SERVICES, LLC COA # 28345 620 N. WYMORE ROAD, SUITE 250. MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS				
DESCRIPTION	DATE	REV		

PROJECT INSTALLER



PROJECT NAME

RESIDENCE

JONES F

ST MARKHAM ; FL 32025 SE ALFRED N LAKE CITY, I 421

SHEET NAME DATA SHEET

SHEET SIZE ANSI B 11" X 17"

²In Backup mode, grid charge power is limited to 3.3 kW.
³AC to battery to AC, at beginning of life.

POWERWALL

Backup Gateway 2

The Backup Gateway 2 for Tesla Powerwall provides energy management and monitoring for solar self-consumption, time-based control, and backup.

The Backup Gateway 2 controls connection to the grid, automatically detecting outages and providing a seamless transition to backup power. When equipped with a main circuit breaker, the Backup Gateway 2 can be installed at the service entrance. When the optional internal panelboard is installed, the Backup Gateway 2 can also function as a load center.

The Backup Gateway 2 communicates directly with Powerwall, allowing you to monitor energy use and manage backup energy reserves from any mobile device with the Tesla app.




PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Input Short Circuit Current	10 kA1
Overcurrent Protection Device	100-200A; Service Entrance Rated
Overvoltage Category	Category IV
AC Meter	Revenue accurate (+/- 0.2 %)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) ²
User Interface	Tesla App
Operating Modes	Support for solar self-consumption time-based control, and backup
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200A 6-space / 12 circuit Eaton BR Circuit Breakers
Warranty	10 years

MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 149 mm (26 in x 16 in x 6 in)		
Weight	20.4 kg (45 lb)		
Mounting options	Wall mount, Semi-flush mount		

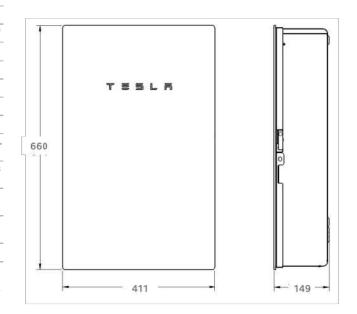

COMPLIANCE INFORMATION

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

ENVIRONMENTAL SPECIFICATIONS

-20°C to 50°C (-4°F to 122°F)		
Up to 100%, condensing		
3000 m (9843 ft)		
Indoor and outdoor rated		
NEMA 3R		

TSSLA NA 2020-05-23 TESLA.COM/ENERGY



CASTILLO ENGINEERING SERVICES, LLC

COA # 28345 620 N. WYMORE ROAD, SUITE 250. MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS			
DESCRIPTION DATE REV			

PROJECT INSTALLER



The time has a section of super-ord award by these was Bordon, the only find and The steet them of a by the data Barrious. The steet them a by the data Barrious award of the decrease of the data of the data of the data of the advantable of the data of the data of the data of the data of the advantable of the data of the data of the data of the data of the advantable of the data of the data of the data of the data of the advantable of the data of the data of the data of the data of the advantable of the data of the data of the data of the data of the advantable of the data of

PROJECT NAME

RESIDENCE

JONES F


ST SE ALFRED N LAKE CITY, I SE 421

SHEET NAME

DATA SHEET

SHEET SIZE ANSI B 11" X 17"


When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.
 The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.



ENGINEERED POWER SOLUTIONS

1405 SPRING STREET, SUITE 204 PASO ROBLES, CA 93446 (805) 423-1326

2x8 Osprey Unit

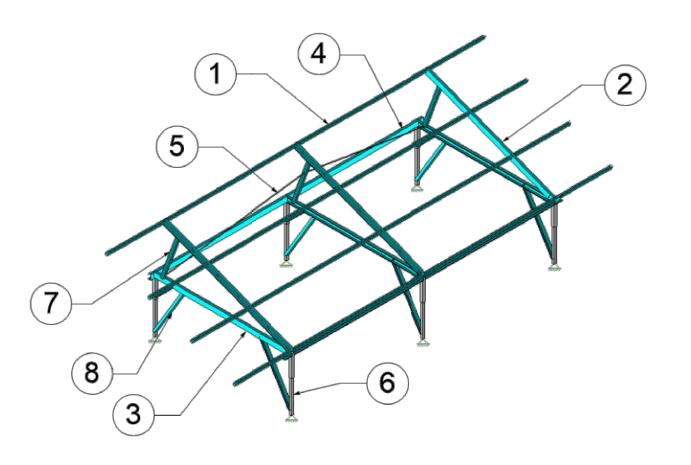

		Su-		0	
#	Component	Standard (STD)	Heavy Duty (HD)	Extra Heavy Duty (XHD)	High Snow Load (HSL)
1	Rails	1-5/8"x1-5/8"x14 ga. Strut (80 ksi)	1-5/8"x2-7/16"x14 ga. Strut (80 ksi)	1-5/8"x2-7/16"x14 ga. Strut (80 ksi)	1-3/4"x2-7/16"x12 ga. Strut (80 ksi)
2	Strongback	2"x4"x16 ga. Channel (50 ksi)	2"x4"x14 ga. Channel (50 ksi)	2"x4"x12 ga. Channel (50 ksi)	2"x4"x12 ga. Channel (50 ksi)
3	Chassis Stud	2"x4"x16 ga. Channel (50 ksi)	2"x4"x14 ga. Channel (50 ksi)	2"x4"x12 ga. Channel (50 ksi)	2"x4"x12 ga. Channel (50 ksi)
4	Chassis Rail	2"x4"x16 ga. Channel (50 ksi)	2"x4"x14 ga. Channel (50 ksi)	2"x4"x12 ga. Channel (50 ksi)	2"x4"x12 ga. Channel (50 ksi)
5	Cable Brace	3/16" Cable (36 ksi)	3/16" Cable (36 ksi)	3/16" Cable (36 ksi)	3/16" Cable (36 ksi)
6	Post	Telescoping Tube Assembly	Telescoping Tube Assembly	Telescoping Tube Assembly	Telescoping Tube Assembly
7	Backstay	Jackstay 1-5/8"x1-5/8"x14 ga. Strut (80 ksi)	0-30°: 1-5/8"x1-5/8"x14 ga. Strut (80 ksi)	0-30°: 1-5/8"x1-5/8"x14 ga. Strut (80 ksi)	0-30": 1-5/8"×1-5/8"×14 ga. Strut (80 ksi)
1 "	Dackstay	1-3/6 k1-3/6 k14 gd. 3trut (60 k3t)	35-45": 1-5/8"x1-5/8"x12 ga. Strut (50 ksi)	35-45": 1-5/8"x1-5/8"x12 ga. Strut (50 ksi)	35-45°: 1-5/8"x1-5/8"x12 ga. Strut (50 ksi)
8	Chassis Brace	Telescoping Tube Assembly	Telescoping Tube Assembly	Telescoping Tube Assembly	Telescoping Tube Assembly

*Standard Units use the Chassis Brace on the back legs only.



CASTILLO ENGINEERING

SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

,			
REVISIONS			
DESCRIPTION DATE R			

PROJECT INSTALLER



PROJECT NAME

JONES RESIDENCE

SE ALFRED MARKHAM ST, LAKE CITY, FL 32025

421

SHEET NAM

DATA SHEET

SHEET SIZE
ANSI B
11" X 17"

^{**}Standard Units use 12"x12"x1/4" baseplates. All other units use 18"x18"x1/4" baseplates

TLA4 Anchor



Product Data Sheet

Terra-Lock™ Earth Percussion Anchors are designed to provide drive efficiency and maximize load capacity across a wide range of applications. The Terra-Lock™ A4 Anchor is Gripple's largest anchor. It is made of corrosion resistant Zinc Aluminum and will provide the holding capacity your project needs for many years.


Component	Туре	Material	Test Method	Physical Properties
Anchor Head	TLA4	Zinc-Aluminum Alloy - ZA 2 (1)	ASTM B-240-10	6.50" x 2.36" x 1.40" (L x W x H) Bearing Area: 12 in ²

⁽¹⁾ Corrosion resistant pressure die cast zinc alloy

Performance Properties	Value	Data
Typical Anchor Load Range(2)	lbs	500 - 2,300
Maximum Working Load(2)	lbs	2,520
Ultimate Anchor Pull Out(3)	lbs	8,300

⁽²⁾ Values are soil dependent; See graph on the following page.



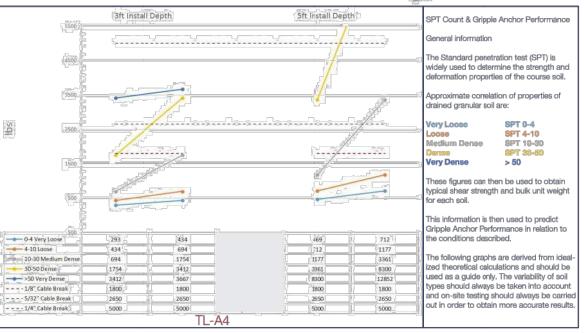

Gripple Inc | 1611 Emily Lane | Aurora | IL 60502 USA
Tel +1 866 474 7753 Fax +1 800 654 0689 email grippleinc@gripple.com
Gripple's policy is one of continuous development and innovation. We therefore reserve the right to alter specifications, etc. without notice.

Castillo C Engineering

CASTILLO ENGINEERING

SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

TEL: (407) 289-2575 ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS			
DESCRIPTION	DATE	REV	

PROJECT INSTALLER



PROJECT NAME

JONES RESIDENCE

421 SE ALFRED MARKHAM ST, LAKE CITY, FL 32025

DATA SHEET

ANSI B 11" X 17"

SHEET SIZE

DS-08

TL-A4

www.gripple.com

⁽³⁾ Value based on an install depth of 5ft in very dense soil.