

2/3/25



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: 12-SC-3060422
APPLICATION #: AP2185838
DATE PAID: 1/14/25
FEE PAID: 310.00
RECEIPT #:
DOCUMENT #: PR2203874

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: DOUGLAS**25-0014 JACKSON

PROPERTY ADDRESS: 206 SW COLONY, Lake City, FL 32025

LOT: 35 BLOCK: Glen SUBDIVISION: MEADOWLANDS PH-3

PROPERTY ID #: 03761-135

[SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GPD New Multi-Chambered Septic CAPACITY
A [] GALLONS / GPD N/A CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK: 1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS @ [] DOSES PER 24 HRS #Pumps []

D [375] SQUARE FEET Drainfield SYSTEM
R [] SQUARE FEET N/A SYSTEM
A TYPE SYSTEM: [x] STANDARD [] FILLED [] MOUND []
I CONFIGURATION: [x] TRENCH [] BED []

N
F LOCATION OF BENCHMARK: Nail in forked oak tree north of system site

I ELEVATION OF PROPOSED SYSTEM SITE [24.00] [INCHES] FT [] ABOVE / BELOW BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE [36.00] [INCHES] FT [] ABOVE / BELOW BENCHMARK/REFERENCE POINT

L
D FILL REQUIRED: [6.00] INCHES EXCAVATION REQUIRED: [] INCHES

O The system is sized for 3 bedrooms with a maximum occupancy of 6 persons (2 per bedroom), for a total estimated flow of 300 gpd.

T \$4200 make sure to flag off
H + maybe tank and df.
E 1 load fill
R

SPECIFICATIONS BY: PAUL LLOYD

TITLE: PSE

APPROVED BY: [Signature]

Sean P Havens

TITLE: Environmental Specialist I

Columbia

CHD

DATE ISSUED: 01/14/2025

EXPIRATION DATE: 07/14/2026

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)

Incorporated 62-6.004, FAC

v 1.1.4

AP2185838

SE2104515

Page 1 of 3

KN



STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM (OSTDS)

CR # 24-00401
PERMIT NO. 25-0014
DATE PAID: 1-10-25
FEE PAID: 310.00
RECEIPT #: 2194638

APPLICATION FOR CONSTRUCTION PERMIT

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: DOUGLAS JACKSON

EMAIL: paullloyd@callmeonthephone.com

AGENT: PAUL LLOYD

TELEPHONE: (603) 848-8160

MAILING ADDRESS: 318 CENTER RD.

BRADFORD NH 03221

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

OSTDS REMEDIATION PLAN? ☐ Y ☒ N

LOT: 35 BLOCK: N/A SUBDIVISION: MEADOWLAND S/D

PLATTED: _____

PROPERTY ID #: 01-6S-16-03761-135

ZONING: AG I/M OR EQUIVALENT: ☐ NO ☒

PROPERTY SIZE: 5.010 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ ☐ ≤2000GPD ☐ >2000GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☐ NO ☒

DISTANCE TO SEWER: N/A FT

PROPERTY ADDRESS: 206 SW COLONY GLN LAKE CITY

DIRECTIONS TO PROPERTY:

441 SOUTH TURN RIGHT ON TUSTENUGGEE AVE. TURN RIGHT ON SW MEADOWLAND DR. TURN RIGHT ON SW HIGHLANDS TER. TURN RIGHT ON SW COLONY GLN. 1ST ON RIGHT.

BUILDING INFORMATION ☒ RESIDENTIAL ☐ COMMERCIAL

Unit No.	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 62-6, FAC
----------	-----------------------	-----------------	--------------------	---

1	MOBILE HOME	3	1,344	
2				
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify) _____


SIGNATURE: Paul Lloyd

DATE: 12/26/24

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)
Incorporated 62-6.004, FAC

Application for Onsite Sewage Disposal System
 Construction Permit. Part II Site Plan
 Permit Application Number: 25-2014

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

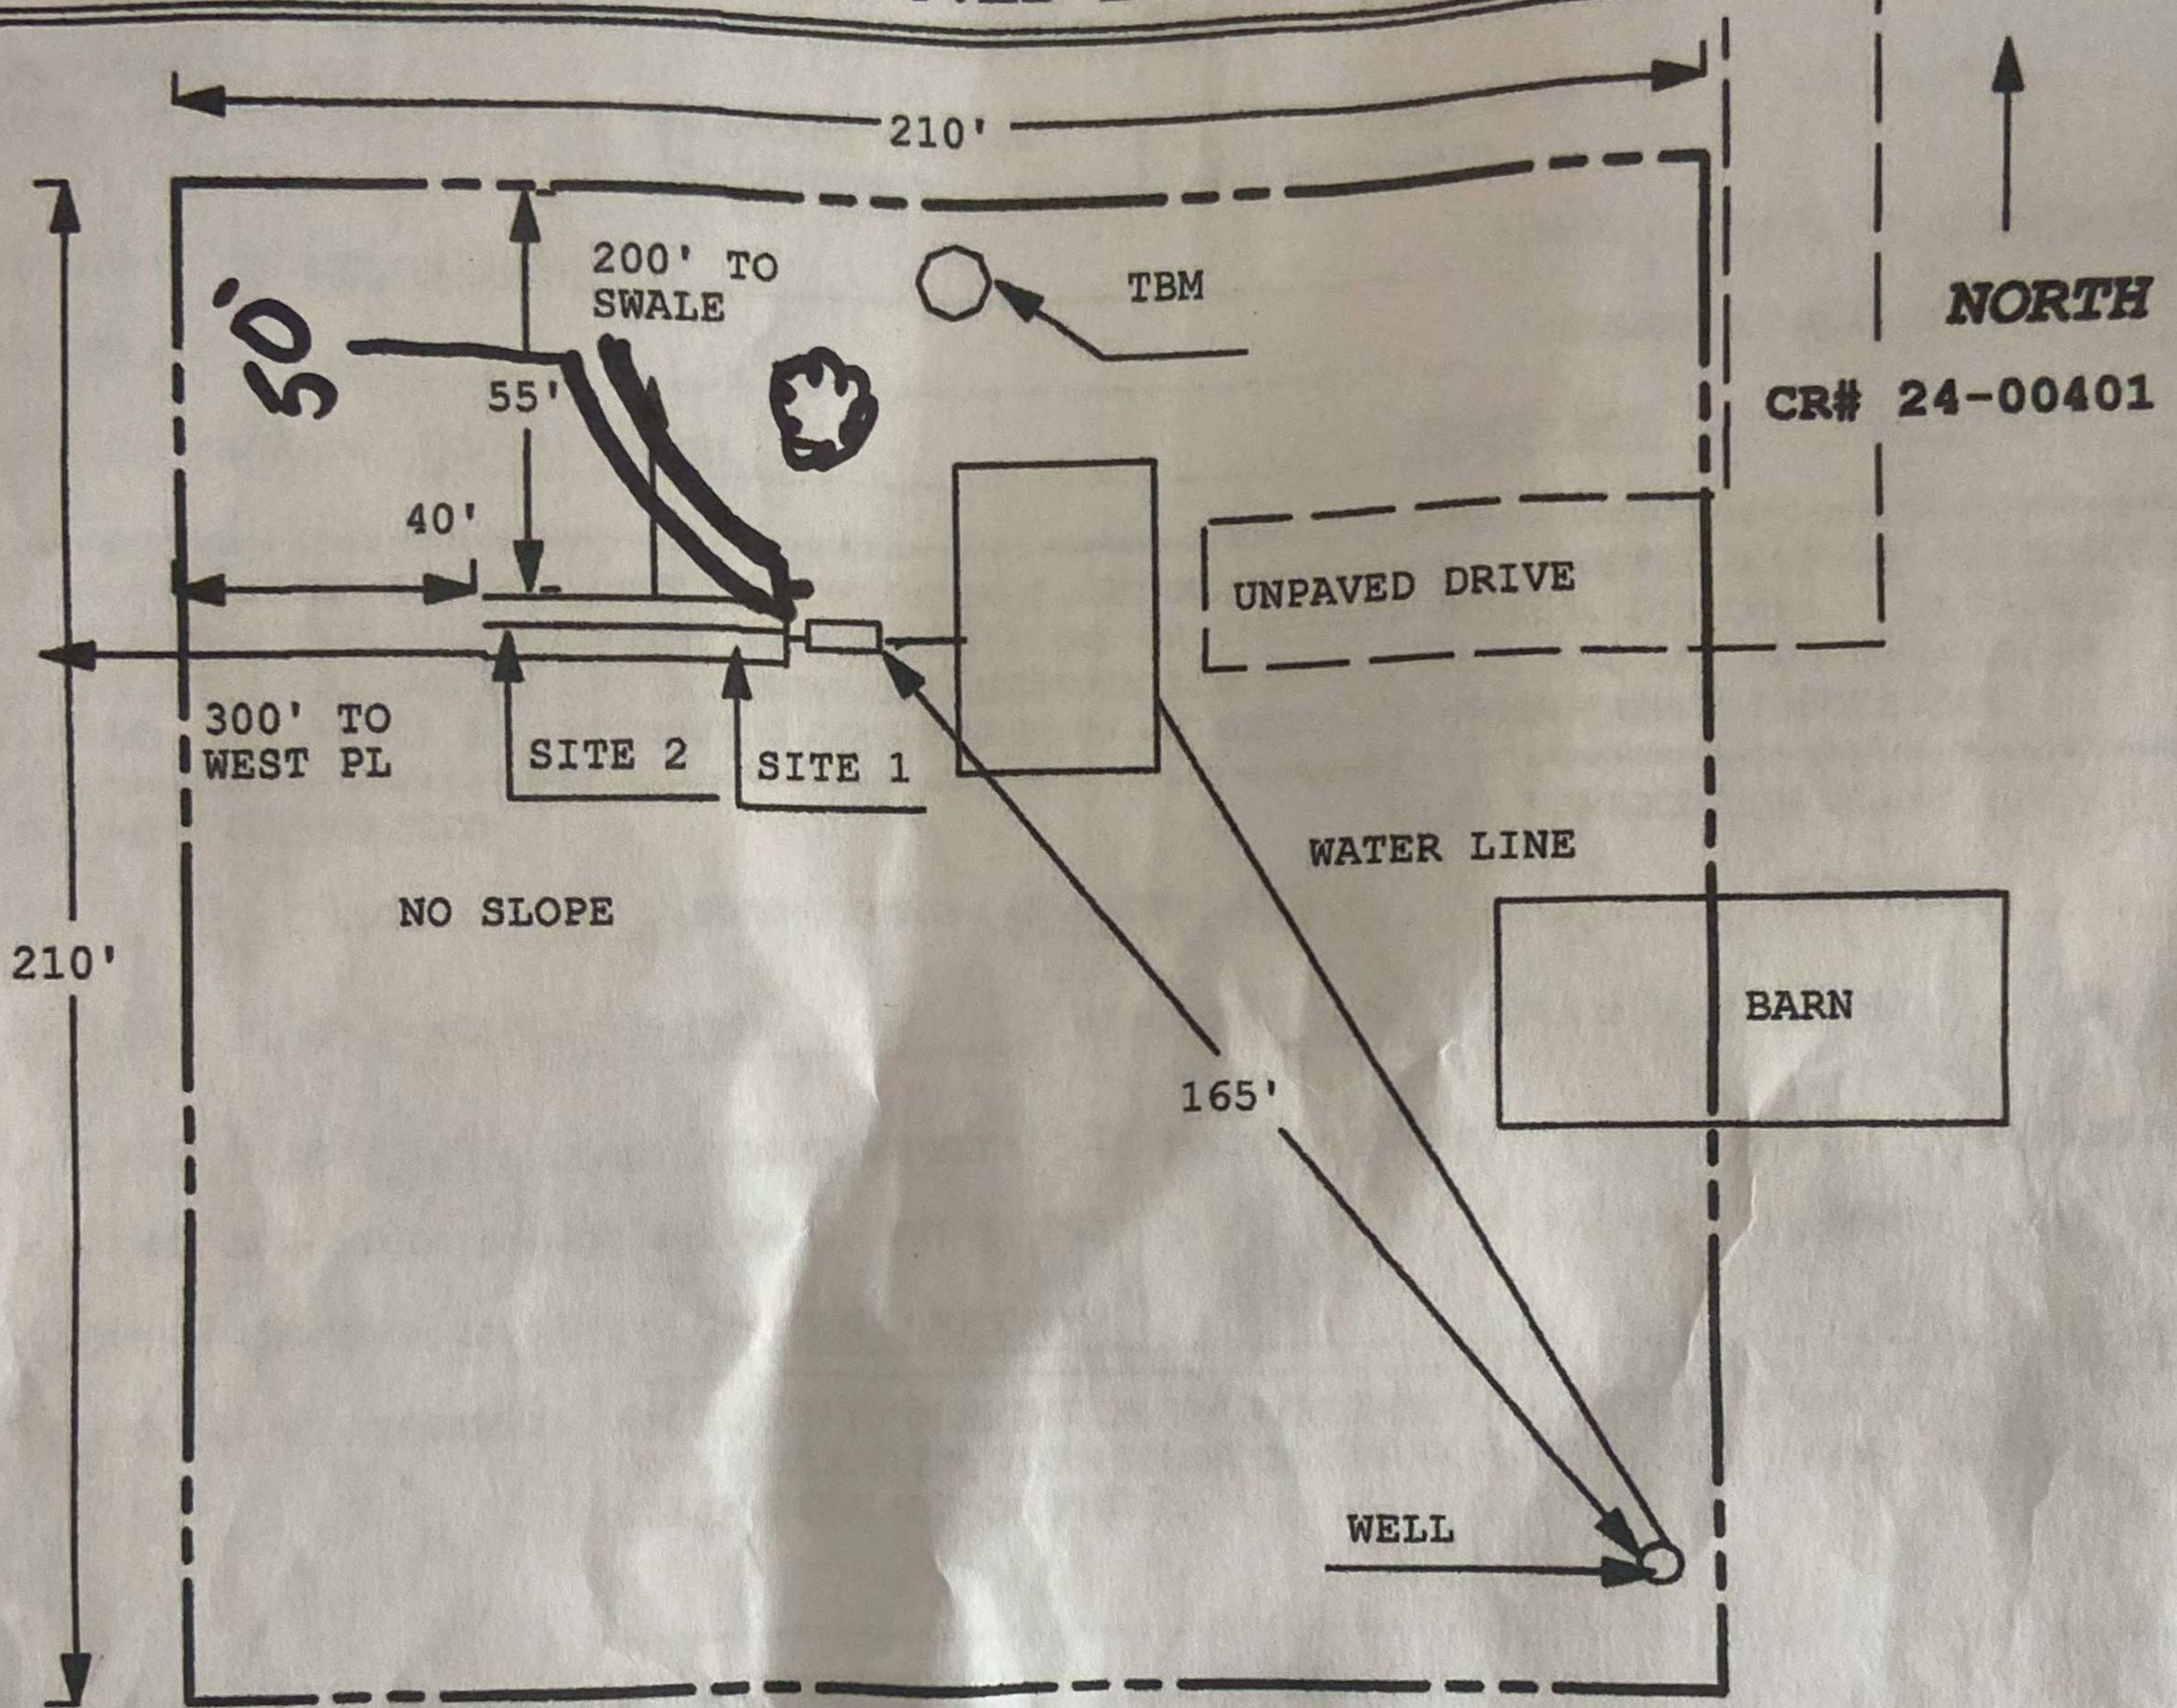

1 INCH = 40 FEET

NO WELLS WITHIN 100'

Site Plan Submitted By Paul Lloyd Date 12/26/24
 Plan Approved ✓ Not Approved _____ Date 11/14/25
 By [Signature] Columbia CPHU
 Notes: _____

