


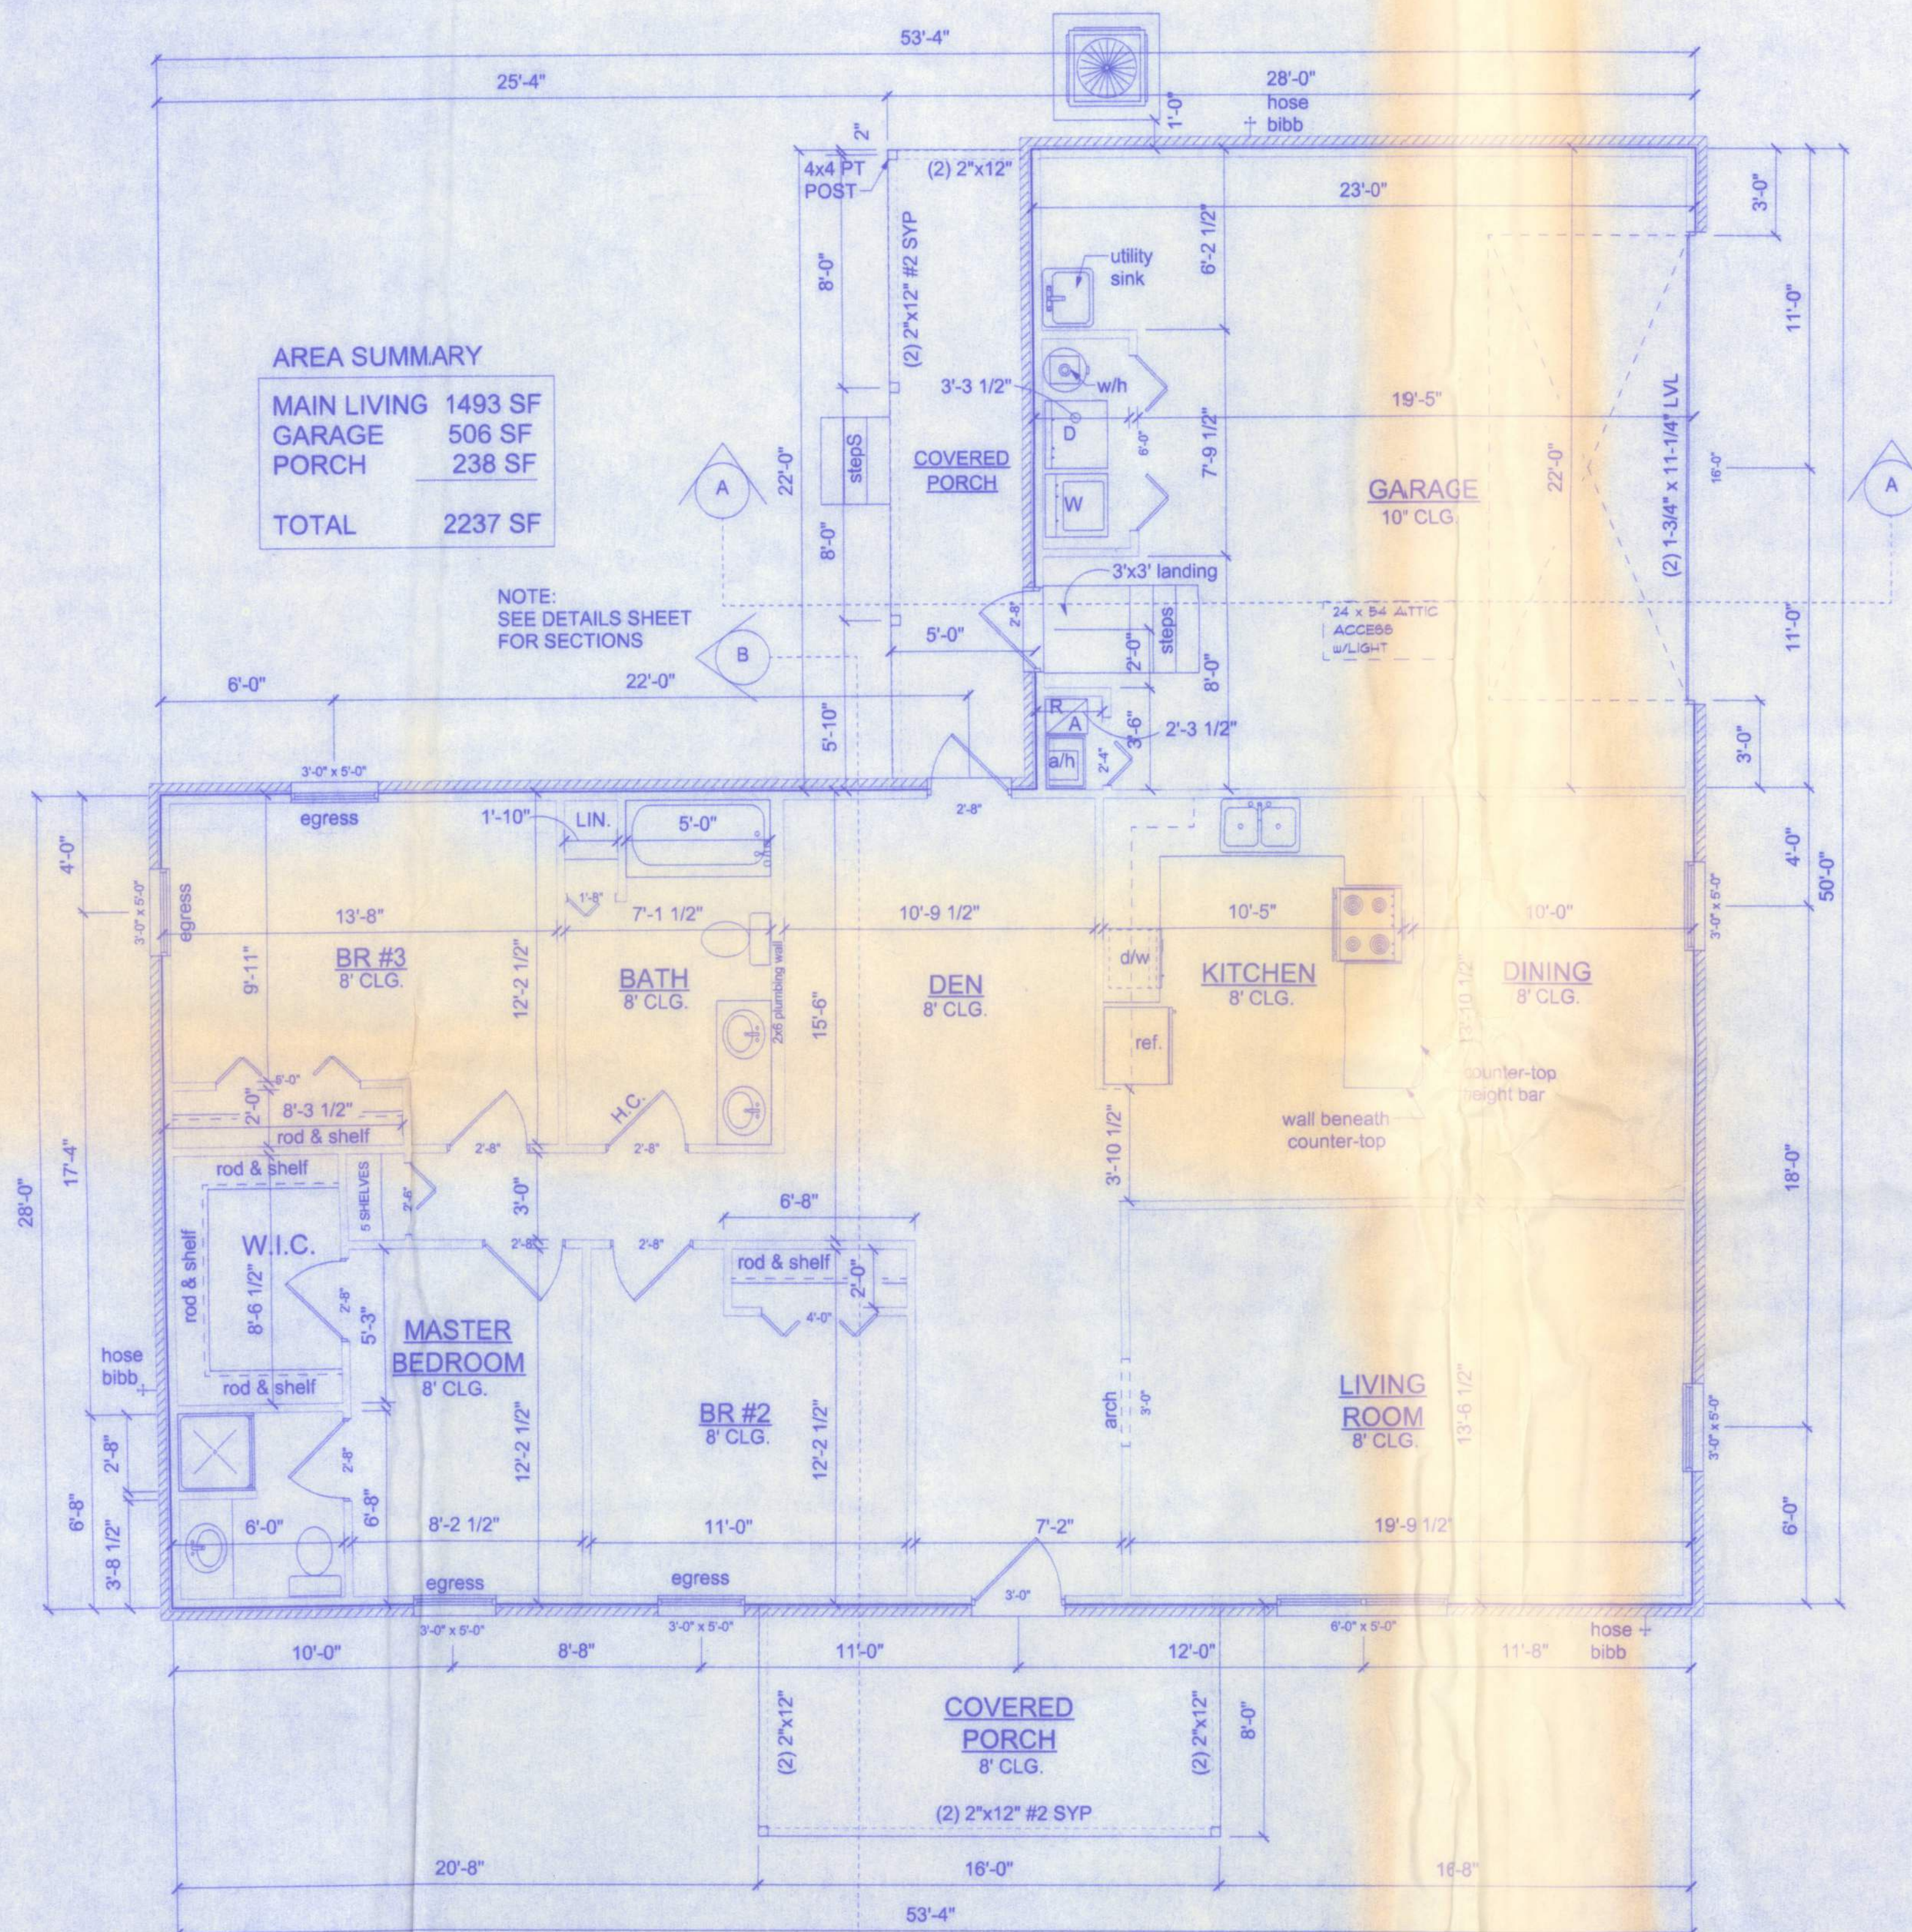

PRODUCT CODE	SIZE	HINGE DIRECTION	COUNT
32x80 therma-tru steel	2'-8"	R	1
36x80 therma-tru steel	3'-0"	L	1
32x80 therma-tru french	2'-8"	L	1
192x84 amaar garage door	16'-0"	N	1
1868 BF	1'-8"	L	1
2668 BF	2'-6"	L	1
2868 colonial masonite	2'-8"	L	4
2868 colonial masonite	2'-8"	R	2
SH 3050	3'-0" x 5'-0"	N	8

NOTE:
ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION 1609, FLORIDA BUILDING CODE, 2004 EDITION.

BASIC WIND SPEED	110 MPH
IMPORTANCE FACTOR	1.0
BUILDING CATEGORY	2
EXPOSURE	B
INTERNAL PRESSURE COEFFICIENT	+/- 0.18
COMPONENT AND CLADDING PRESSURE	WALLS +21.8/-29.1 PSF ROOF +12.5/-29.1 PSF OVERHANGS -71.6 PSF
TYPE OF STRUCTURE	ENCLOSED

NOTE:
EXTERIOR WINDOWS AND GLASS DOORS SHALL BE TESTED BY AN APPROVED INDEPENDENT TESTING LABORATORY, AND BEAR AN AAMA OR WDMA OR OTHER APPROVED LABEL IDENTIFYING THE MANUFACTURER, PERFORMANCE CHARACTERISTICS AND APPROVED PRODUCT EVALUATION ENTITY TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF THE FOLLOWING SPECIFICATION:

ANSI/AAMA/NWDA 101/IS2 2/97


THE CONSTRUCTION SHALL BE TESTED IN ACCORDANCE WITH ASTM E 330, STANDARD TEST METHODS FOR STRUCTURAL PERFORMANCE OF EXTERIOR WINDOWS, CURTAIN WALLS, AND DOORS BY UNIFORM STATIC AIR PRESSURE.

NOTE:
THE MINIMUM NATURAL VENTILATION AREA REQUIRED FOR GARAGES SHALL BE 4 PERCENT OF THE FLOOR AREA BEING VENTILATED. THE MINIMUM MECHANICAL VENTILATION FOR GARAGES SHALL BE 100 CFM PER CAR.

NOTE:
BATHROOM EXHAUST SHALL BE DIRECTED TO OUTSIDE OF BUILDING. EXHAUST AIR SHALL NOT BE DIRECTED ONTO WALKWAYS. AIR EXHAUST OPENINGS SHALL BE PROTECTED WITH CORROSION-RESISTANT SCREENS, LOUVERS OR GRILLS IF TERMINATING OUT DOORS.

CLARENCE ROSSIN RESIDENCE

161 N.W. MADISON STREET
SUITE #102
LAKE CITY, FL 32055
(386)758-4209



Freeman
Design Group

DATE 11/09/04 DRAWN BY J.T.D.

REVISIONS
11/01/05

SHEET A-2

OF 8

PROJECT NO.

CERTIFICATE OF AUTHORIZATION # 00000701

23830