


ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS



FRONT ELEVATION
SCALE: 1/4" = 1'

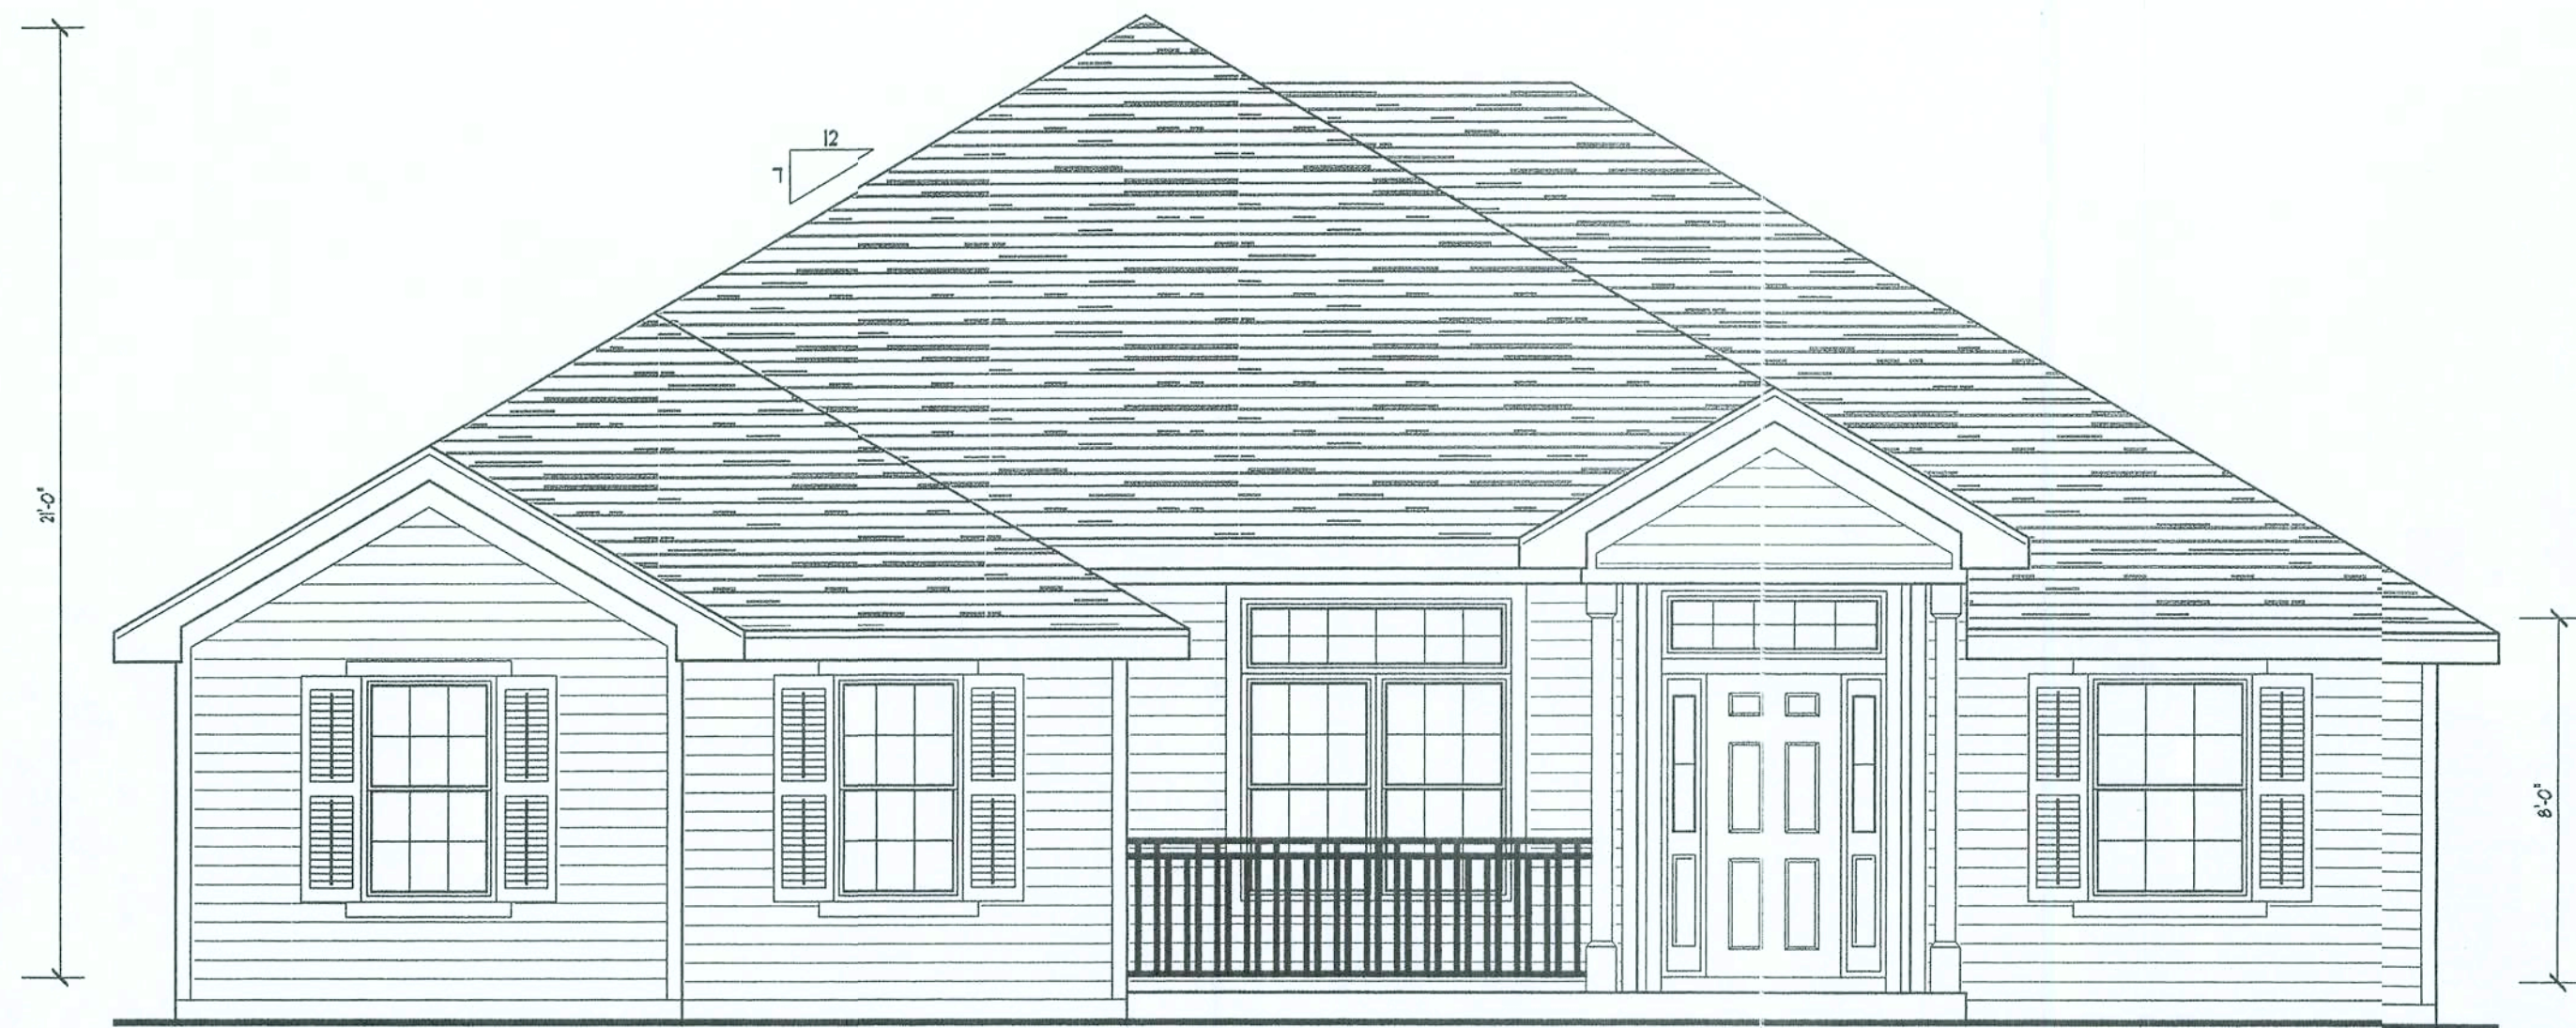

LEFT ELEVATION
SCALE: 1/4" = 1'




REAR ELEVATION
SCALE: 1/4" = 1'



FLOOR PLAN
SCALE: 1/4" = 1'

December 14, 2005

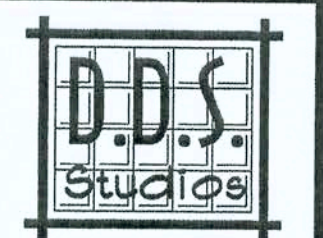

D.D.S. STUDIOS
P.O. Box 275
Lake City, FL 32056
(386) 754-0181

A SPECULATIVE HOME BY EWPL INC.

THE MORICE

THREE RIVERS ESTATES, LOT 39
COPYRIGHT: 2004 DDS STUDIOS

OUR PLANS ARE DRAFTED FOR AVERAGE SITE CONDITIONS AND COMPLIANCE WITH APPLICABLE CODES IN LAKE CITY, FL. AT THE TIME THEY ARE DRAFTED. DUE TO VARYING STATE, LOCAL, AND NATIONAL CODES, RULES AND REGULATIONS, DDS STUDIOS CANNOT WARRANT COMPLIANCE WITH ALL APPLICABLE STATE, LOCAL, AND NATIONAL CODES IN YOUR AREA OR WITH YOUR PARTICULAR SITE CONDITIONS. IT IS THE RESPONSIBILITY OF THE PURCHASER AND/OR BUILDER TO SEE THAT THE STRUCTURE IS BUILT IN STRICT COMPLIANCE WITH ALL GOVERNING MUNICIPAL CODES (CITY, COUNTY, STATE, AND FEDERAL). IF YOUR CITY OR STATE REQUIRES AN ENGINEER'S STAMP, YOU WILL NEED TO HAVE THIS DONE LOCALLY BY A QUALIFIED ARCHITECT OR ENGINEER.

EXTERIOR ELEVATIONS


SHEET NUMBER
1 of 3

All work shall comply with the standard building code, and all applicable local codes and ordinances.
Contractor shall verify all dimensions prior to commencing construction.

ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS


- SEE PLANS FOR WALL HEIGHTS
- 12" OVERHANG (TYPICAL)
- GAF-TIMBERLINE SHINGLES W/ 4-NAILS IN EACH SHINGLE STRIP ON 30-LB FELT PAPER OVER 1/16" ORIENTED STRAND BOARD ROOF SHEATHING W/ 131 8d COMMON @ 4" 8" O.C.
- FLASHING: 26 ga. GALVANIZED STEEL
- PRE-ENGINEERED WOOD ROOF TRUSSES AT 24" O.C. (SELECT TRUSS CONNECTORS PER WINDLOAD ANALYSIS)
- BLOW-IN INSULATION EQUAL TO R-30
- (2) 2X4 SYP DOUBLE TOP PLATE
NOTE: SEAL ALL PENETRATIONS IN TOP PLATE AND FIRE STOP BLOCKING WITH CODE APPROVED SEALANT
- 2X6 SYP #2 FASCIA
- ALUMINUM DRIP EDGE MOLDING, AND VENTED SOFFIT
- INTERIOR FINISH - 1/2" GYPSUM WALLBOARD
- 2X4 #2 SPF PRECUT STUDS AT 16" O.C. WITH FULL-THICK FIBERGLASS INSULATION EQUAL TO R-11
- EXTERIOR FINISH TO BE HARDI-PLANK LAP SIDING
- 1/16" O.S.B. WALL SHEATHING (BLOCK ALL EDGES) W/ 131 8d COMMON @ 3" 8" O.C.
- FLOORING AND INTERIOR TRIM PER SPECIFICATIONS
- 4" CONCRETE FLOOR SLAB REINFORCED WITH 6X6-14/14 WELDED WIRE MESH EMBEDDED 2" IN SLAB OR FIBER MESH ON 6 MIL POLY VAPOR BARRIER (6' LAPS SEALED WITH POLY TAPE) OVER COMPACTED FILL TREATED WITH TERMITICIDE
- 2 x 4 P.T. PINE SOLE PLATE ANCHORED WITH WITH ANCHOR BOLTS AS PER WINDLOAD ANALYSIS
- 1-5, CONTINUOUS, IN CONCRETE BOND BEAM AT SLAB EDGE INTERSECTION WITH STEMWALL
- APPROXIMATE FINISH GRADE

TYPICAL WALL SECTION
SCALE: 1" = 1'0"

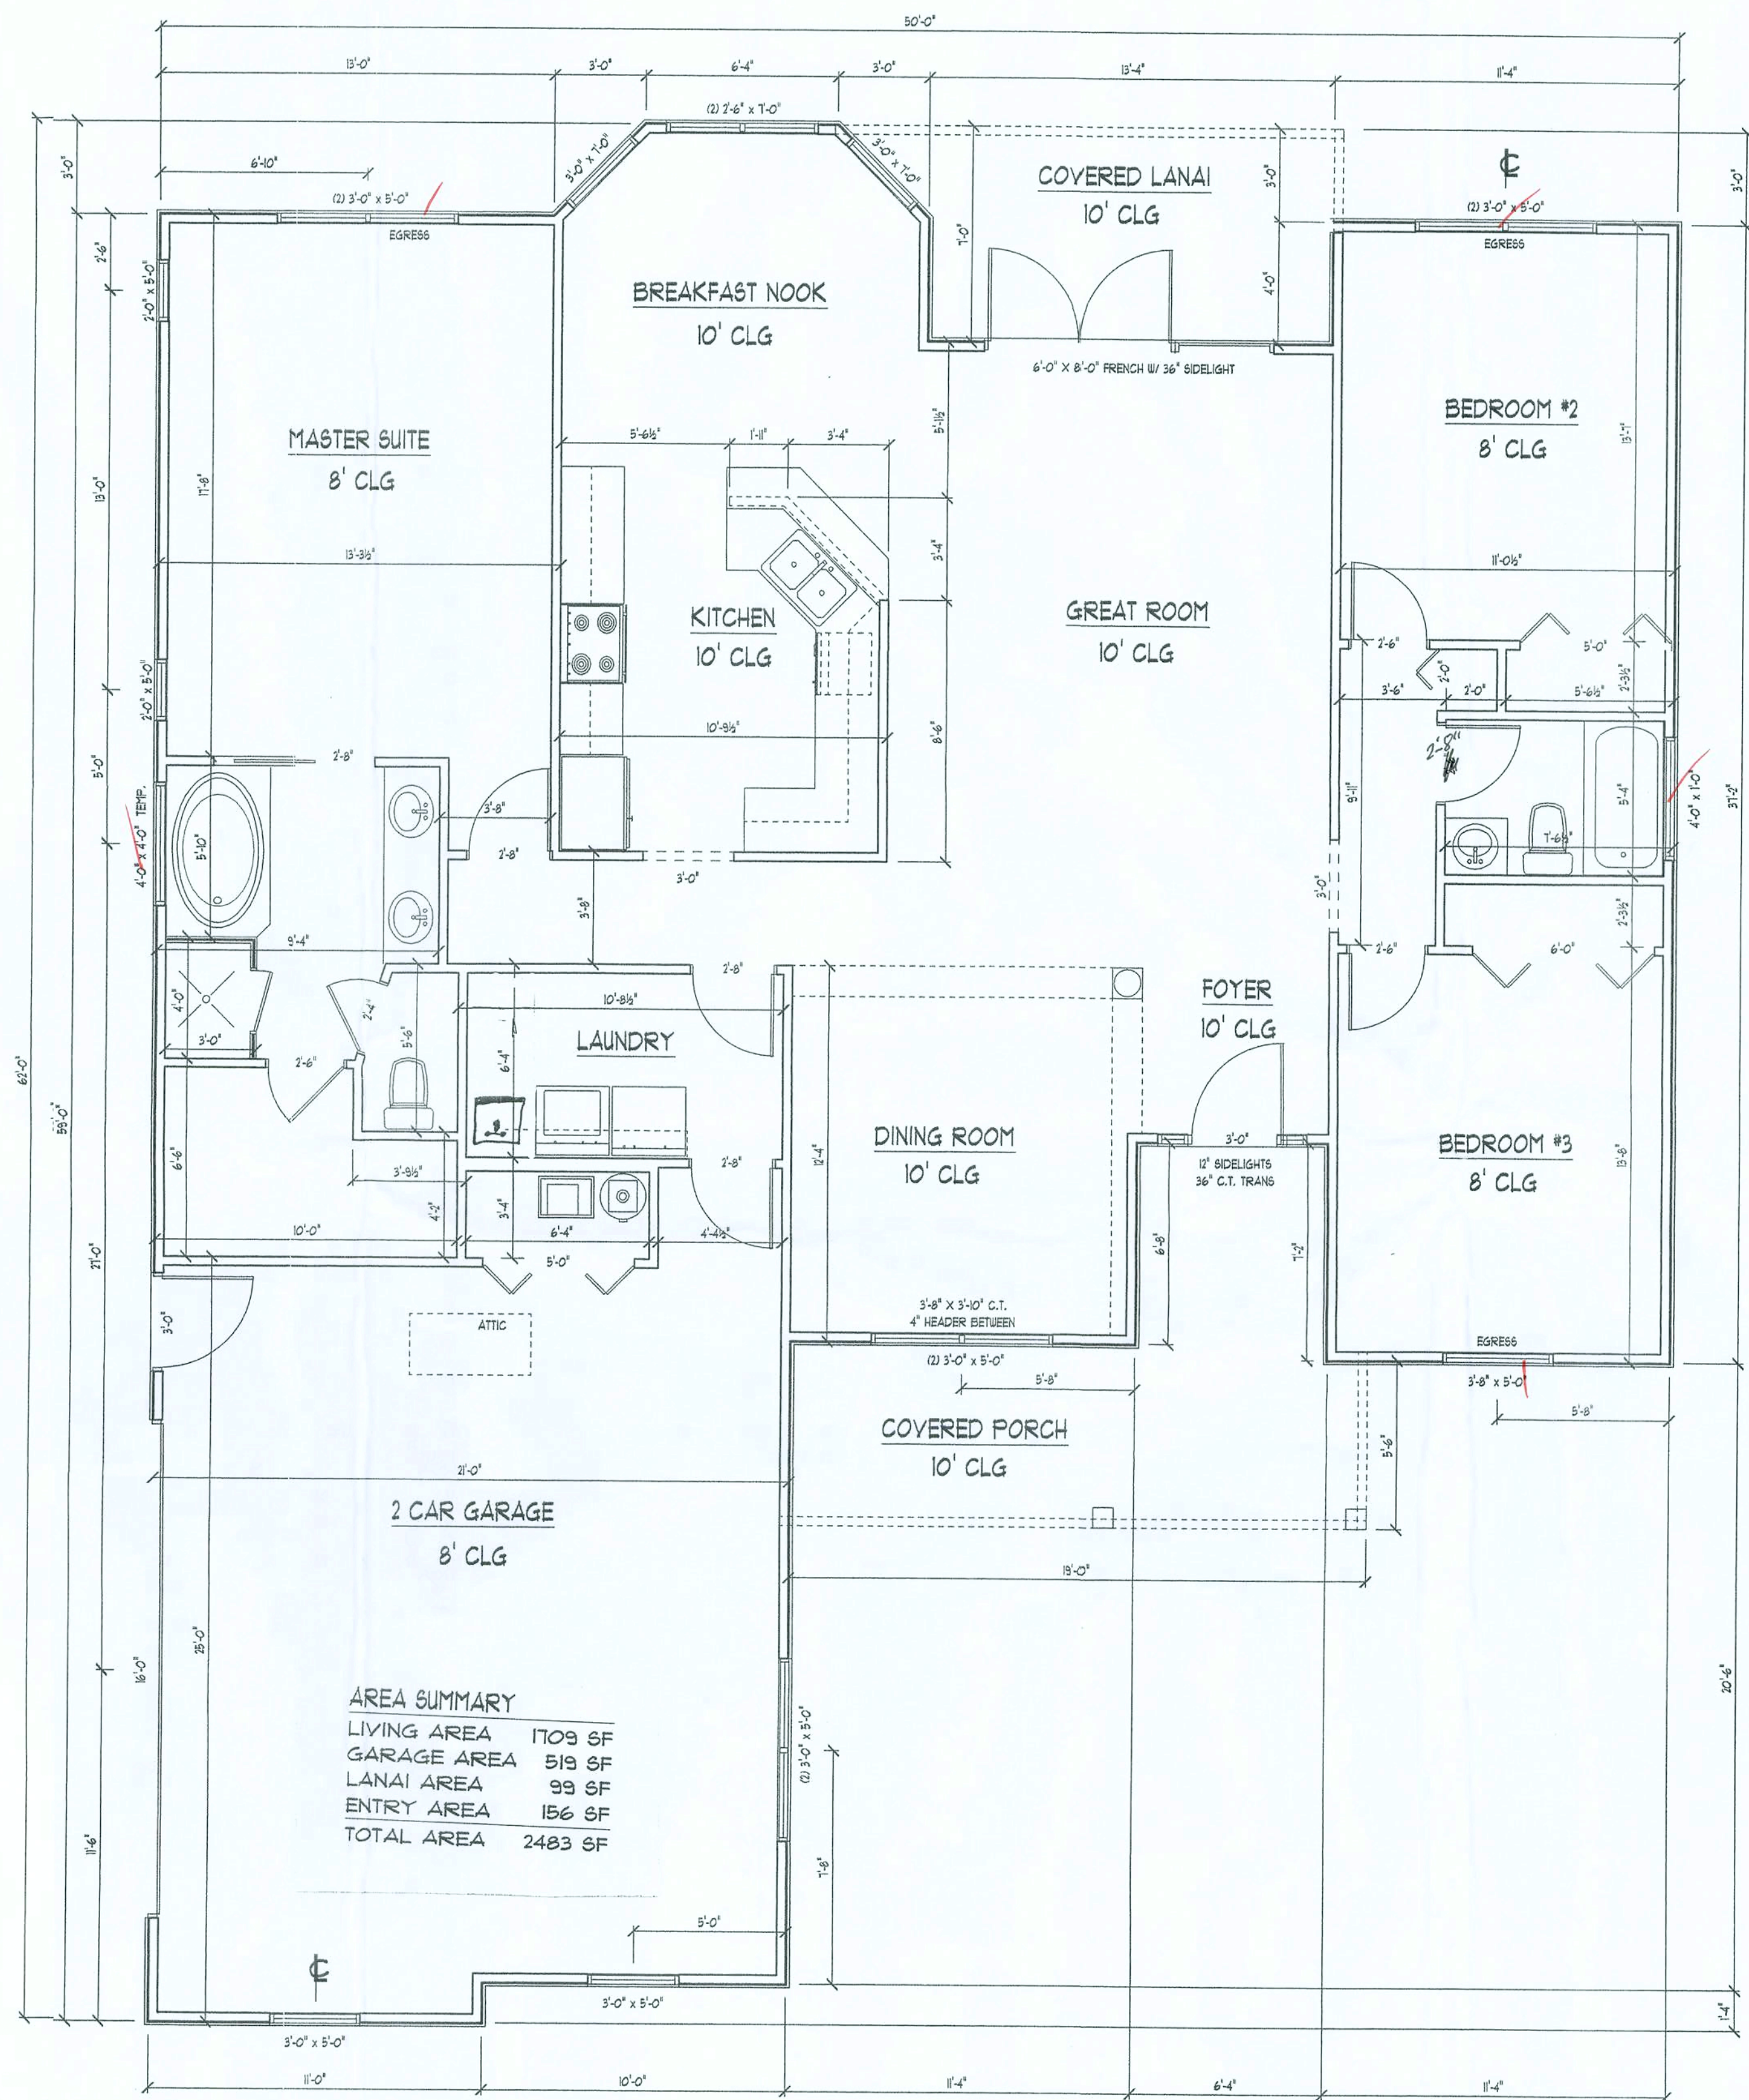

FLOOR PLAN
SCALE: 1/4" = 1'

December 14, 2005

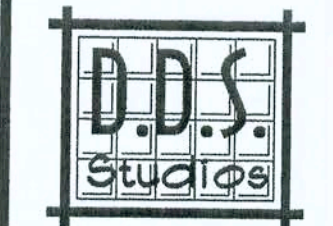

D.D.S. STUDIOS
P.O. Box 273
Lake City FL 32056
(386) 784-0181

A SPECULATIVE HOME BY EWPL INC.
THE MORICE
THREE RIVERS ESTATES, LOT 39
COPYRIGHT: 2004 DDS STUDIOS

OUR PLANS ARE DRAFTED FOR AVERAGE SITE CONDITIONS AND COMPLIANCE WITH APPLICABLE CODES IN LAKE CITY, FL. AT THE TIME THEY ARE DRAFTED. DUE TO VARYING STATE, LOCAL, AND NATIONAL CODES, RULES, AND REGULATIONS, DDS STUDIOS CANNOT WARRANT COMPLIANCE WITH ALL APPLICABLE STATE, LOCAL, AND NATIONAL CODES IN YOUR AREA OR WITH YOUR PARTICULAR SITE CONDITIONS. IT IS THE RESPONSIBILITY OF THE PURCHASER AND/OR BUILDER TO SEE THAT THE STRUCTURE IS BUILT IN STRICT COMPLIANCE WITH ALL GOVERNING MUNICIPAL CODES, CITY, COUNTY, STATE, AND FEDERAL. IF YOUR CITY OR STATE REQUIRES AN ENGINEER'S STAMP, YOU WILL NEED TO HAVE THIS DONE LOCALLY BY A QUALIFIED ARCHITECT OR ENGINEER.

FLOOR PLAN
TYPICAL WALL SECTION

SHEET NUMBER
2 of 3


All work shall comply with the standard building code, and all applicable local codes and ordinances.

Contractor shall verify all dimensions prior to commencing construction.


ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

ROOF PLAN NOTES

- R-1 ALL ROOF PITCH 1/2
- R-2 ALL OVERHANGS 8" AND 12" AT GABLES UNLESS OTHERWISE NOTED
- R-3 PROVIDE ATTIC VENTILATION IN ACCORDANCE WITH CODE REQUIREMENTS
- R-4 SEE EXTERIOR ELEVATIONS AND FLOOR PLANS TO VERIFY PLATE AND HELL HEIGHTS
- R-5 MOVE ALL VENTS AND OTHER ROOF PENETRATIONS TO REAR

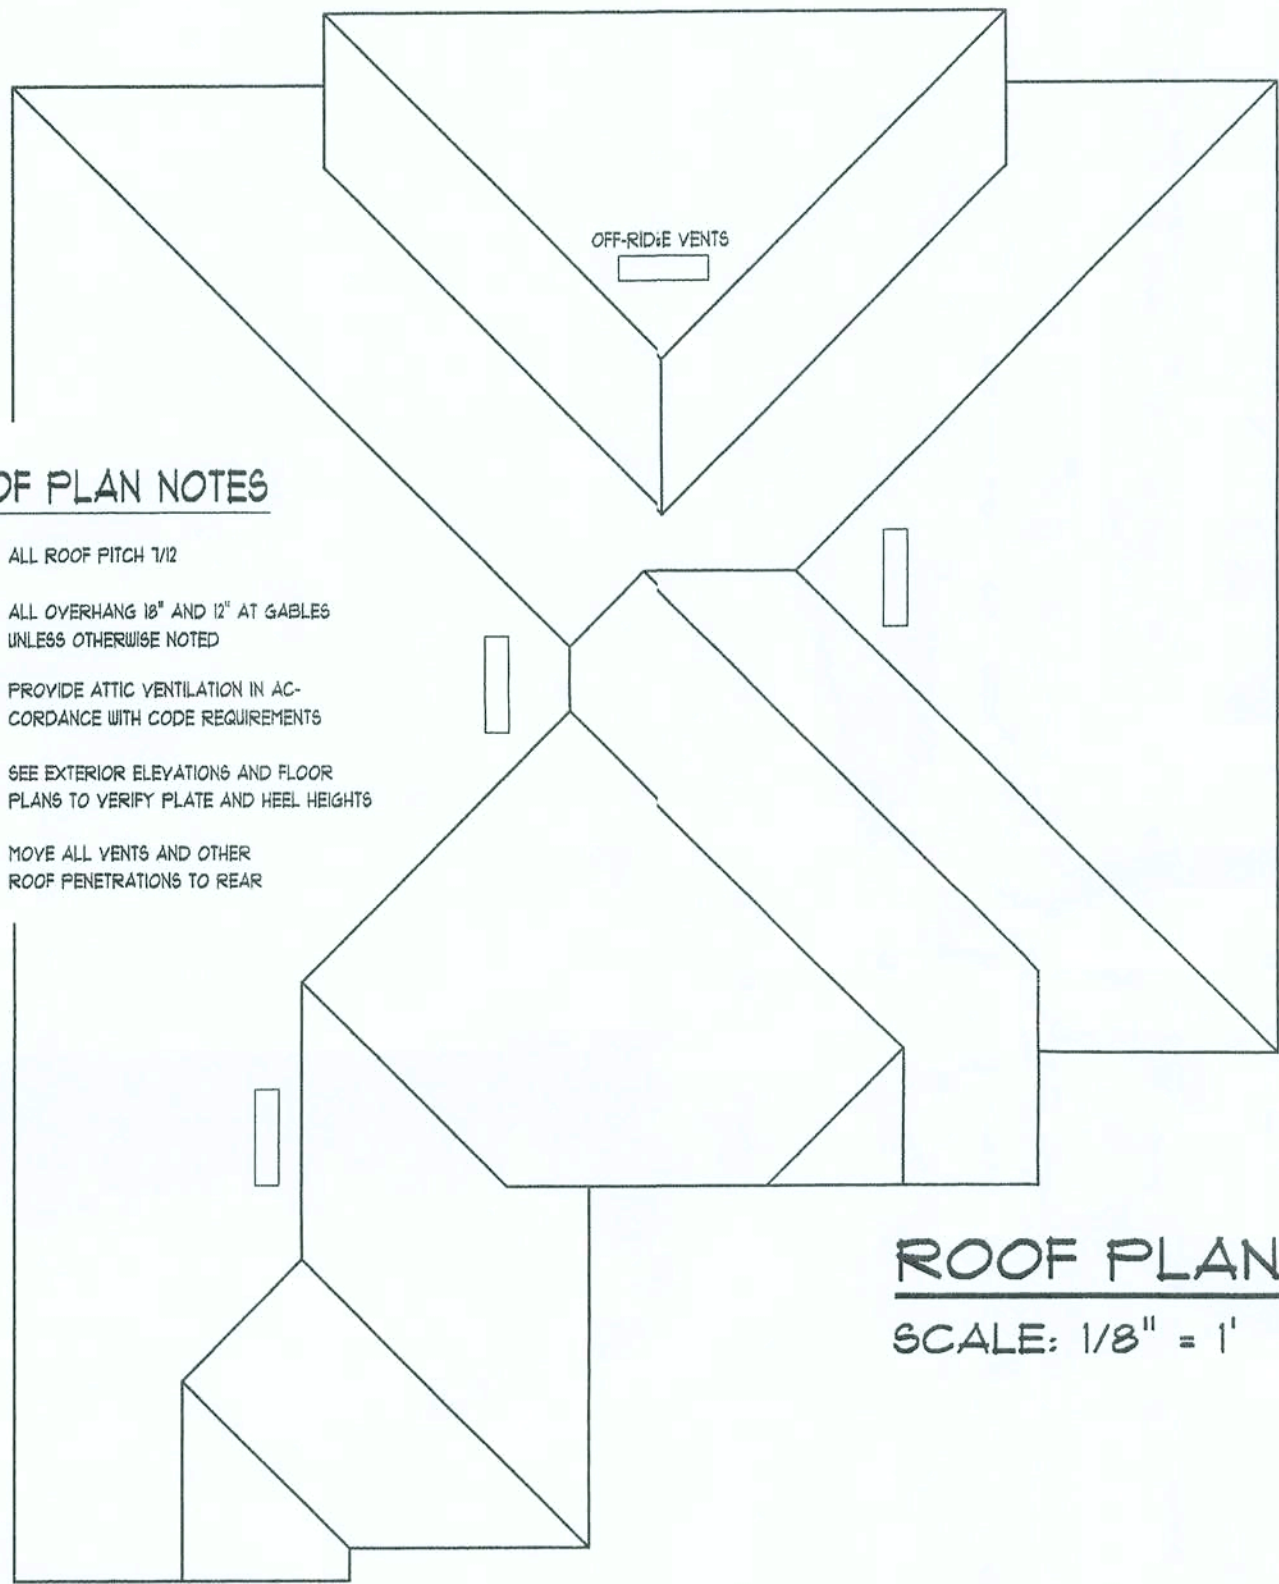

ROOF PLAN
SCALE: 1/8" = 1'

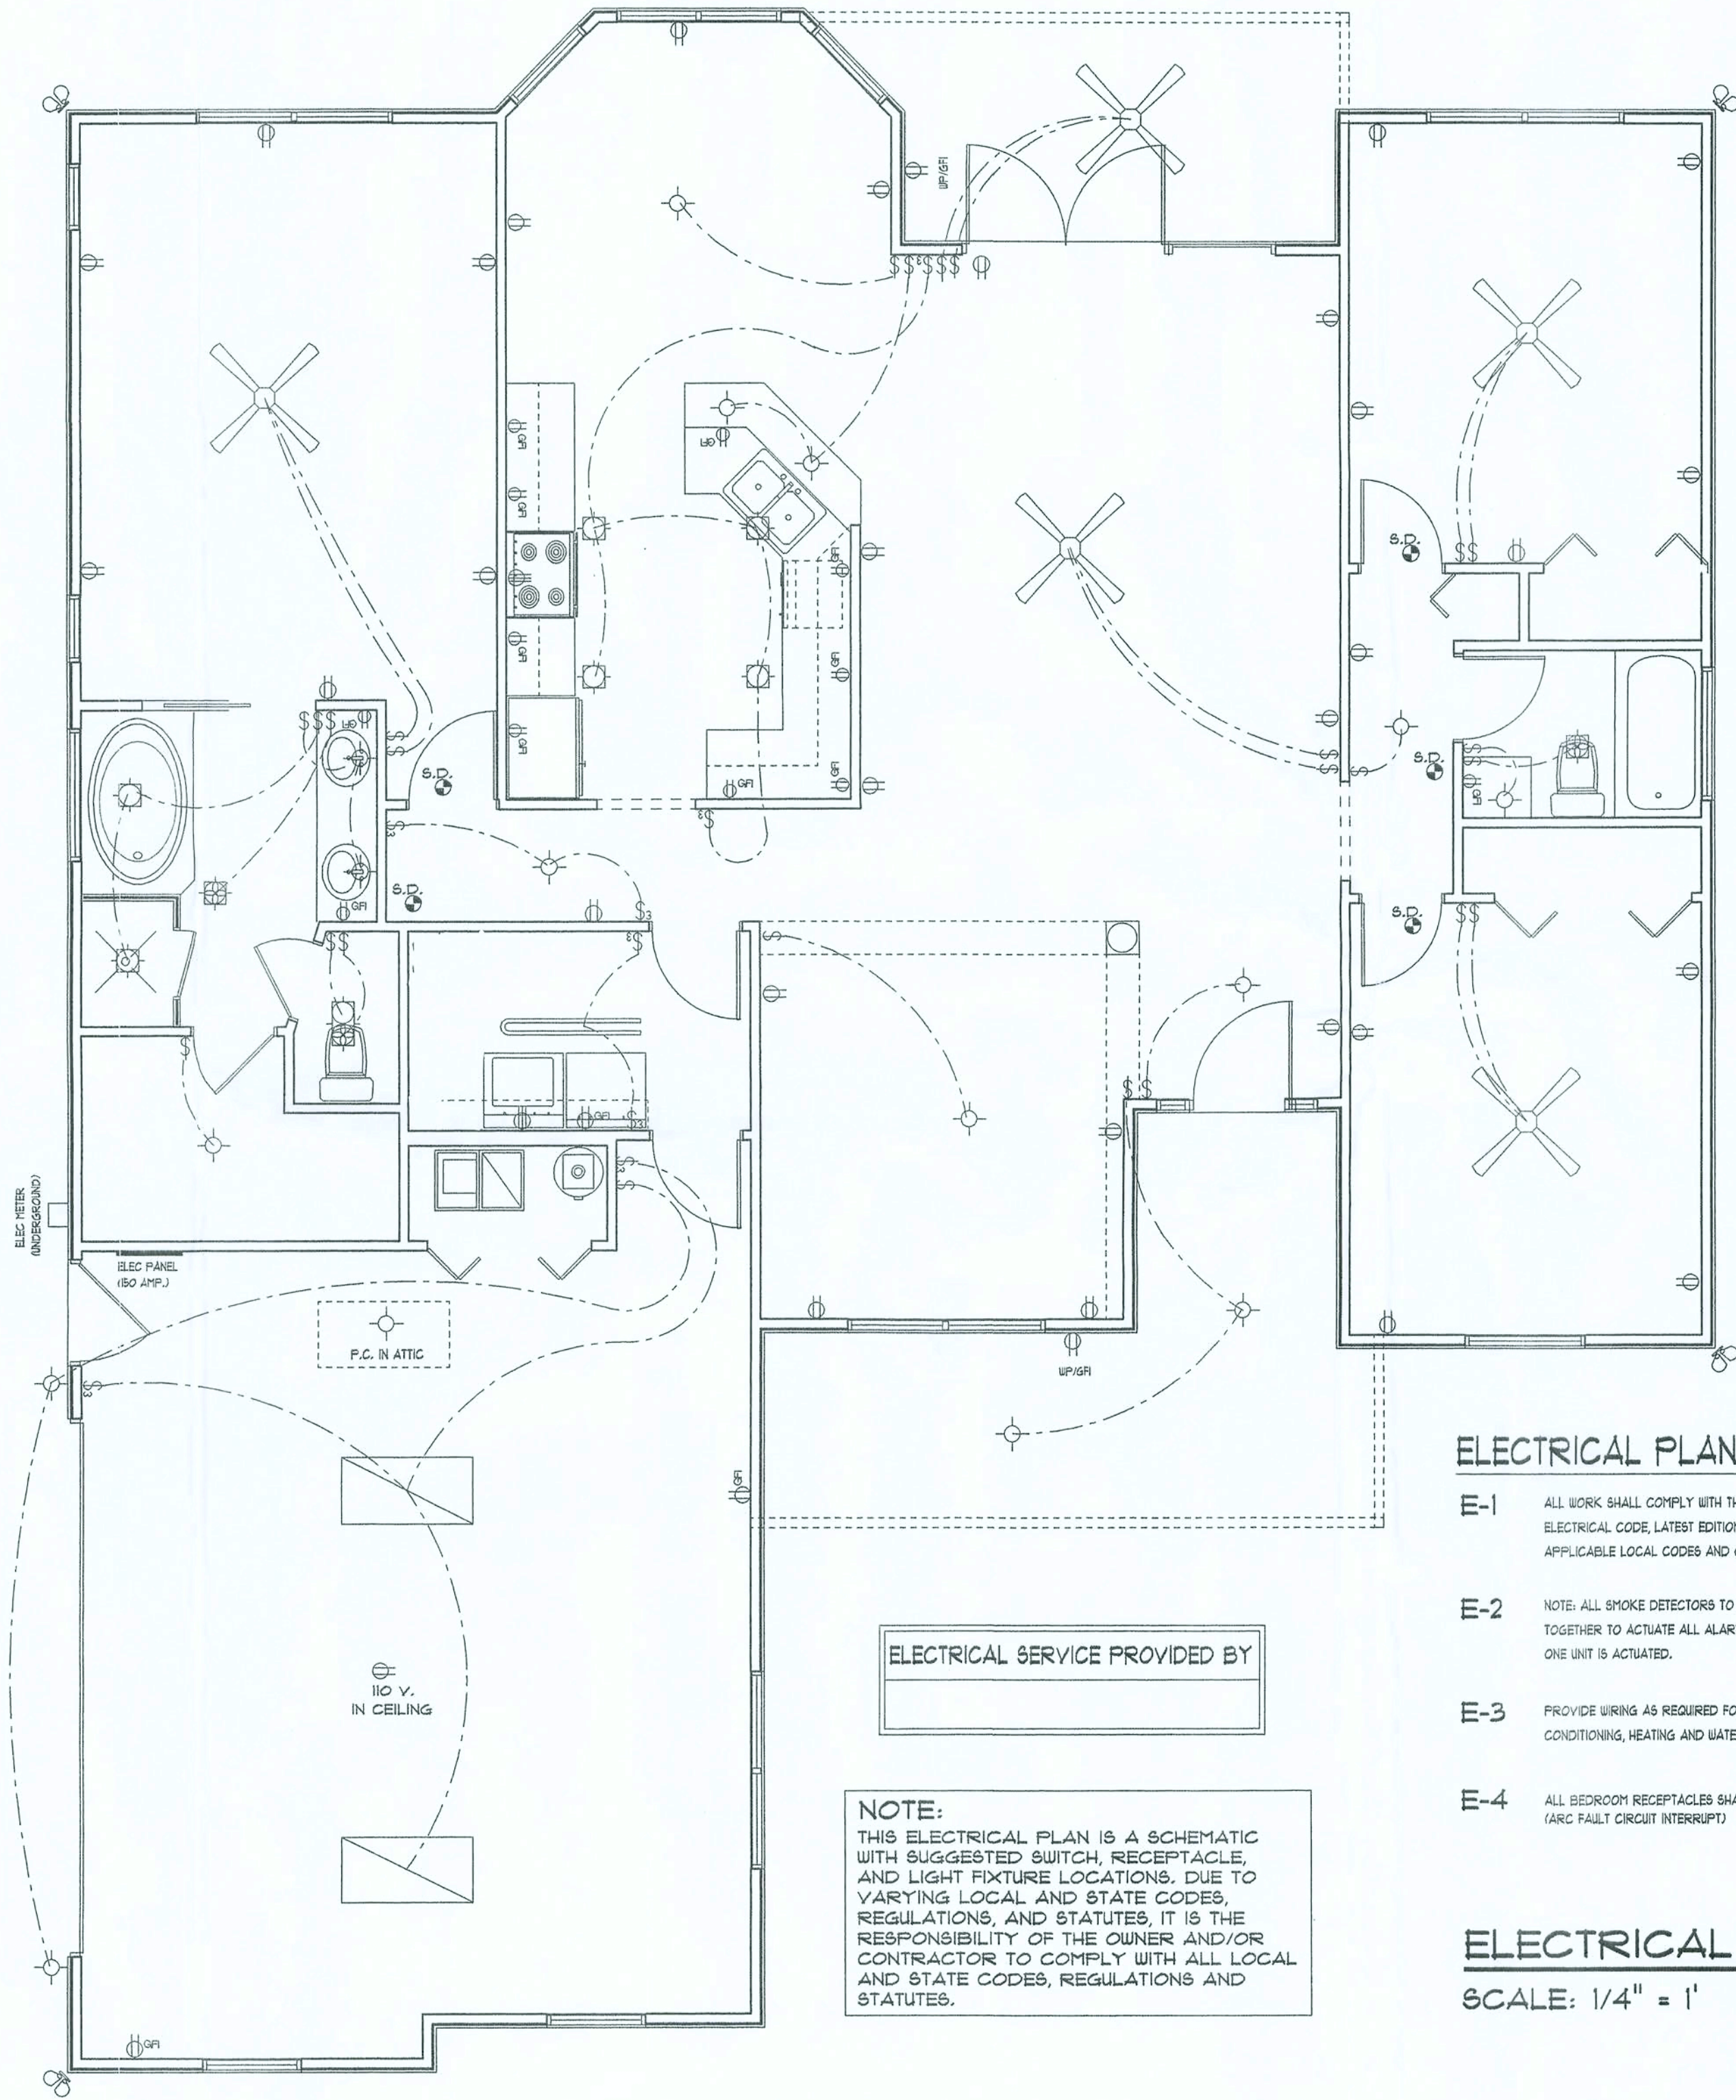

ELECTRICAL PLAN NOTES

- E-1 ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE, LATEST EDITION, AND ALL OTHER APPLICABLE LOCAL CODES AND ORDINANCES.
- E-2 NOTE: ALL SMOKE DETECTORS TO BE WIRED TOGETHER TO ACTIVATE ALL ALARMS IF ANY ONE UNIT IS ACTIVATED.
- E-3 PROVIDE WIRING AS REQUIRED FOR APPLIANCES, AIR CONDITIONING, HEATING AND WATER HEATING EQUIPMENT.
- E-4 ALL BEDROOM RECEPTACLES SHALL BE AFCI (ARC FAULT CIRCUIT INTERRUPT).

ELECTRICAL PLAN
SCALE: 1/4" = 1'

OUR PLANS ARE DRAFTED FOR AVERAGE SITE CONDITIONS AND COMPLIANCE WITH APPLICABLE CODES IN LAKE CITY, FL. AT THE TIME THEY ARE DRAFTED. DUE TO VARYING STATE, LOCAL, AND NATIONAL CODES, RULES AND REGULATIONS, DDS STUDIOS CANNOT WARRANT COMPLIANCE WITH ALL APPLICABLE STATE, LOCAL, AND NATIONAL CODES IN YOUR AREA OR WITH YOUR PARTICULAR SITE CONDITIONS. IT IS THE RESPONSIBILITY OF THE PURCHASER AND/OR BUILDER TO SEE THAT THE STRUCTURE IS BUILT IN STRICT COMPLIANCE WITH ALL GOVERNING MUNICIPAL CODES (CITY, COUNTY, STATE, AND FEDERAL). IF YOUR CITY OR STATE REQUIRES AN ENGINEER'S STAMP, YOU WILL NEED TO HAVE THIS DONE LOCALLY BY A QUALIFIED ARCHITECT OR ENGINEER.


ELECTRICAL PLAN

ROOF PLAN

SHEET NUMBER
3 of 3

All work shall comply with the standard building codes, and all applicable local codes and ordinances.
Contractor shall verify all dimensions prior to commencing construction.

December 14, 2005



D.D.S. STUDIOS
P.O. Box 213
Lake City FL 32056
(386) 784-0161

A SPECULATIVE HOME BY EWPL INC.
THE MORICE
THREE RIVERS ESTATES, LOT 39
COPYRIGHT: 2004 DDS STUDIOS

REVISIONS

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

ANCHOR TABLE

OBTAIN UPLIFT REQUIREMENTS FROM TRUSS MANUFACTURER'S ENGINEERING

| UPLIFT LBS. SYP | UPLIFT LBS. SPF | TRUSS CONNECTOR* | TO PLATES | TO RAFTER/TRUSS | TO STUDS |
|------------------------|-----------------|-----------------------|-----------------|-----------------|-----------------------------------|
| < 420 | < 245 | H5A | 3-8d | 3-8d | |
| < 455 | < 265 | H5 | 4-8d | 4-8d | |
| < 360 | < 235 | H4 | 4-8d | 4-8d | |
| < 455 | < 320 | H3 | 4-8d | 4-8d | |
| < 415 | < 365 | H2.5 | 5-8d | 5-8d | |
| < 600 | < 535 | H2.5A | 5-8d | 5-8d | |
| < 990 | < 820 | H6 | 8-8d | 8-8d | |
| < 745 | < 665 | H8 | 5-10d, 1 1/2" | 5-10d, 1 1/2" | |
| < 1465 | < 1050 | H14-1 | 13-8d, 1 1/2" | 12-8d, 1 1/2" | |
| < 1465 | < 1050 | H14-2 | 15-8d | 12-8d, 1 1/2" | |
| < 990 | < 800 | H10-1 | 8-8d, 1 1/2" | 8-8d, 1 1/2" | |
| < 760 | < 655 | H10-2 | 6-10d | 6-10d | |
| < 1470 | < 1265 | H16-1 | 10-10d, 1 1/2" | 2-10d, 1 1/2" | |
| < 1470 | < 1265 | H16-2 | 10-10d, 1 1/2" | 2-10d, 1 1/2" | |
| < 1000 | < 860 | MTS24C | 7-10d 1 1/2" | 7-10d 1 1/2" | |
| < 1450 | < 1245 | HTS24 | 12-10d 1 1/2" | 12-10d 1 1/2" | |
| < 2900 | < 2490 | 2 - HTS24 | | | |
| < 2050 | < 1785 | LG2 | 14 -16d | 14 -16d | |
| HEAVY GIRDER TIEDOWNS* | | | | | TO FOUNDATION |
| < 3965 | < 3330 | MG1 | | 22 -10d | 1-5/8" THREADED ROD 12" EMBEDMENT |
| < 10980 | < 6485 | HGT-2 | | 16 -10d | 2-5/8" THREADED ROD 12" EMBEDMENT |
| < 10530 | < 9035 | HGT-3 | | 16 -10d | 2-5/8" THREADED ROD 12" EMBEDMENT |
| < 9250 | < 9250 | HGT-4 | | 16 -10d | 2-5/8" THREADED ROD 12" EMBEDMENT |
| STUD STRAP CONNECTOR* | | | | | TO STUDS |
| < 435 | < 435 | SSP DOUBLE TOP PLATE | 3 -10d | | 4 -10d |
| < 455 | < 420 | SSP SINGLE SILL PLATE | 1 -10d | | 4 -10d |
| < 825 | < 825 | DSP DOUBLE TOP PLATE | 6 -10d | | 8 -10d |
| < 825 | < 600 | DSP SINGLE SILL PLATE | 2 -10d | | 8 -10d |
| < 885 | < 760 | SP4 | | | 6 -10d, 1 1/2" |
| < 1240 | < 1065 | SPH4 | | | 10 -10d, 1 1/2" |
| < 885 | < 760 | SP6 | | | 6 -10d, 1 1/2" |
| < 1240 | < 1065 | SPH6 | | | 10 -10d, 1 1/2" |
| < 1235 | < 1165 | LSTA18 | 14 -10d | | |
| < 1235 | < 1235 | LSTA21 | 16 -10d | | |
| < 1030 | < 1030 | CS20 | 18 -8d | | |
| < 1705 | < 1705 | CS16 | 28 -8d | | |
| STUD ANCHORS* | | | | | TO FOUNDATION |
| < 1350 | < 1305 | LT119 | 8 -16d | | 1/2" AB |
| < 2310 | < 2310 | LT131 | 18 -10d, 1 1/2" | | 1/2" AB |
| < 2775 | < 2570 | HD2A | 2-5/8" BOLTS | | 5/8" AB |
| < 4175 | < 3695 | HTT16 | 18 -16d | | 5/8" AB |
| < 1400 | < 1400 | PAHD42 | 16 -16d | | |
| < 3335 | < 3335 | HPAHD22 | 16 -16d | | |
| < 2200 | < 2200 | ABU44 | 12 -16d | | 1/2" AB |
| < 2300 | < 2300 | ABU68 | 12 -16d | | 1/2" AB |
| < 2320 | < 2320 | ABU88 | 18 -16d | | 2-5/8" AB |

GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR 2004. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN UPLIFT CONNECTION 415LB EACH END; 2X6 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN

FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1000 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOIL TEST PROVES OTHERWISE)

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F_c = 3000 PSI

WELDED WIRE REINFORCED SLAB: 8" x 6" W1.4 x W1.4, F_y = 80KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.R.) CONFORMING TO ASTM A185, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH 12 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT WWM OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTORS APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A 615, GRADE 60, DEFORMED BARS, F_y = 60 KSI, ALL LAP SPLICES 4" DB (25" FOR #5 BARS); UNO, ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 315-86, U.N.O.

GLULAM BEAMS: GLULAM BEAM, GLB, 24F-V3SP, F_b = 2,400 E = 1,800,000, UNO. SUPPLIER MAY SUPPLY AN ALTERNATE BEAM WITH EQUAL PROPERTIES OR MAY SUBMIT THEIR OWN SIZING CALC.

ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS, 7/16" OSB SHEATHING, UNLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED, FASTENED WITH 8d COMMON NAILS (131), 6" OC PANEL EDGES, 12" OC INTERMEDIATE MEMBERS, GABLE ENDS AND DIAPHRAGM BOUNDARY, 4" OC, UNO.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES, MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: 3/30" ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED CONCRETE OR 10" IN GROUTED CMU.

WASHERS: WASHERS USED WITH 1/2" BOLTS TO BE 2" x 2" x 9/64", WITH 5/8" BOLTS TO BE 3" x 3" x 9/64", WITH 3/4" BOLTS TO BE 3" x 3" x 9/64", WITH 7/8" BOLTS TO BE 3" x 3" x 5/16", UNO.

NAILS: ALL NAILS ARE COMMON NAILS UNLESS OTHERWISE SPECIFIED OR ACCEPTED BY FBC TEST REPORTS AS HAVING EQUAL STRUCTURAL VALUES.

BUILDER'S RESPONSIBILITY

THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.

CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.

PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR 2004 REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.

PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.


VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

ROOF SYSTEM DESIGN

THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR 2004, SECTION R301.2.1 IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBC 2001 REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.


GRADE & SPECIES TABLE

| | | Fb (psi) | E (10 ⁶ psi) |
|------|--------------|----------|-------------------------|
| 2x8 | SYP #2 | 1200 | 1.6 |
| 2x10 | SYP #2 | 1050 | 1.6 |
| 2x12 | SYP #2 | 975 | 1.6 |
| GLB | 24F-V3 SP | 2400 | 1.8 |
| LSL | TIMBERSTRAND | 1700 | 1.7 |
| LVL | MICROLAM | 1600 | 1.9 |
| PSL | PARALAM | 2900 | 2.0 |

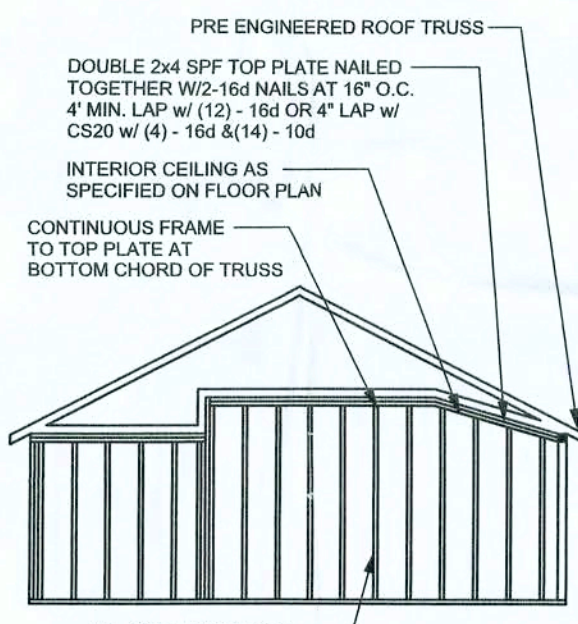


CONTINUOUS FRAME TO CEILING DIAPHRAGM DETAIL

SCALE: N.T.S.

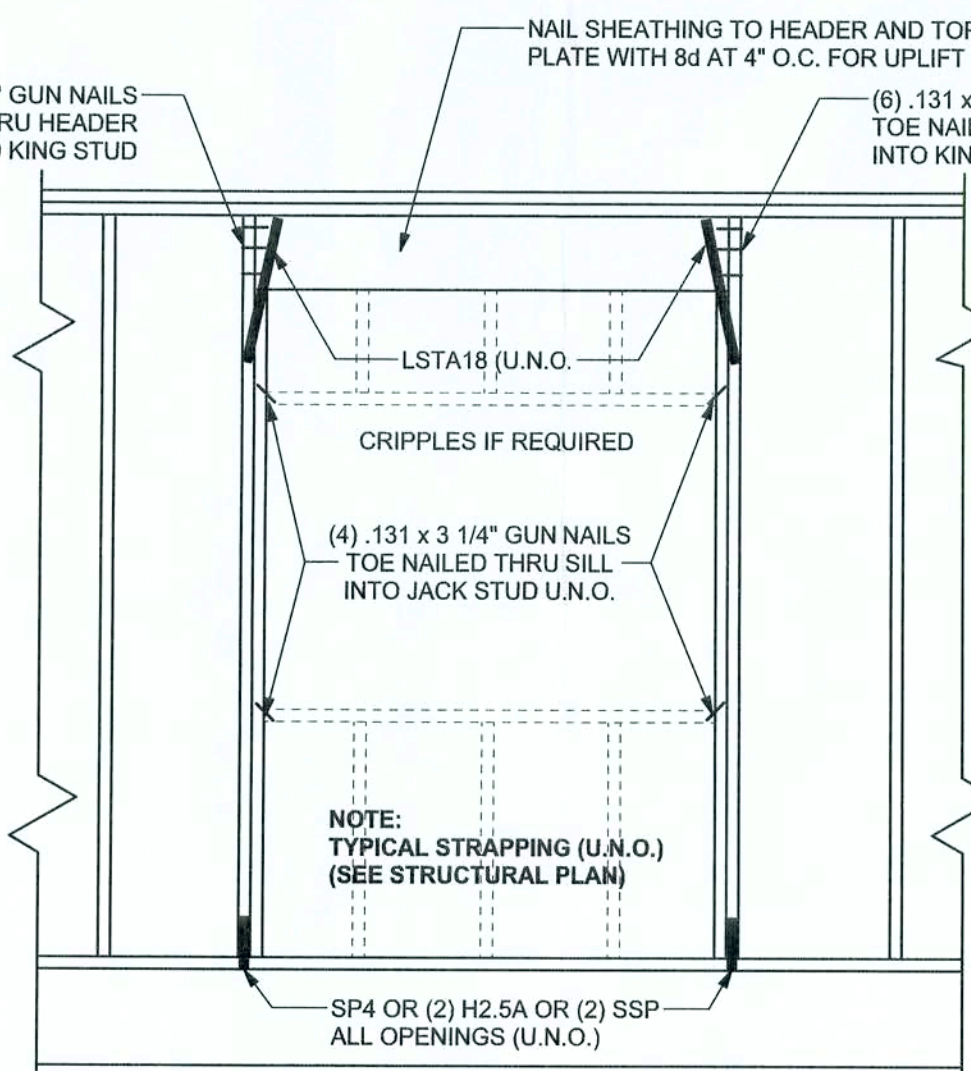


TYPICAL HEADER STRAPPING DETAIL

SCALE: 1/2" = 1'-0"

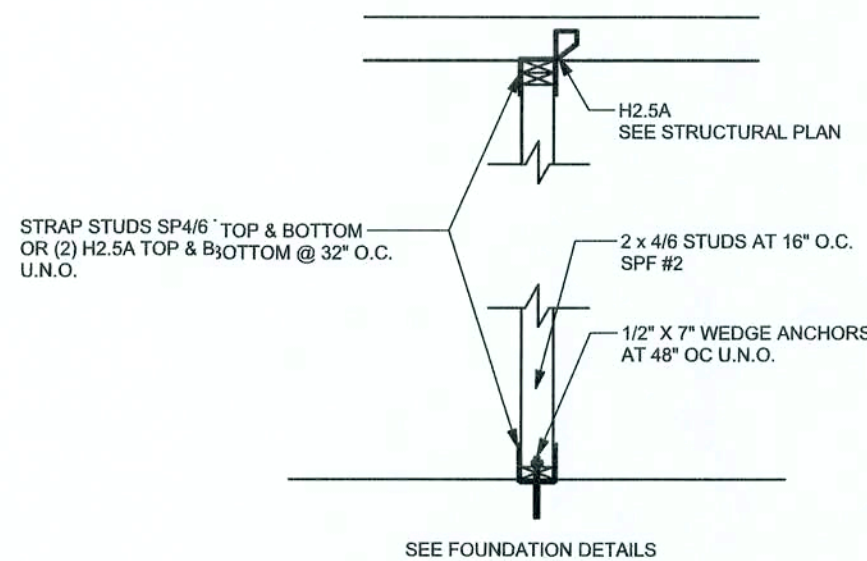


INTERIOR BEARING WALL

SCALE: 1/2" = 1'-0"

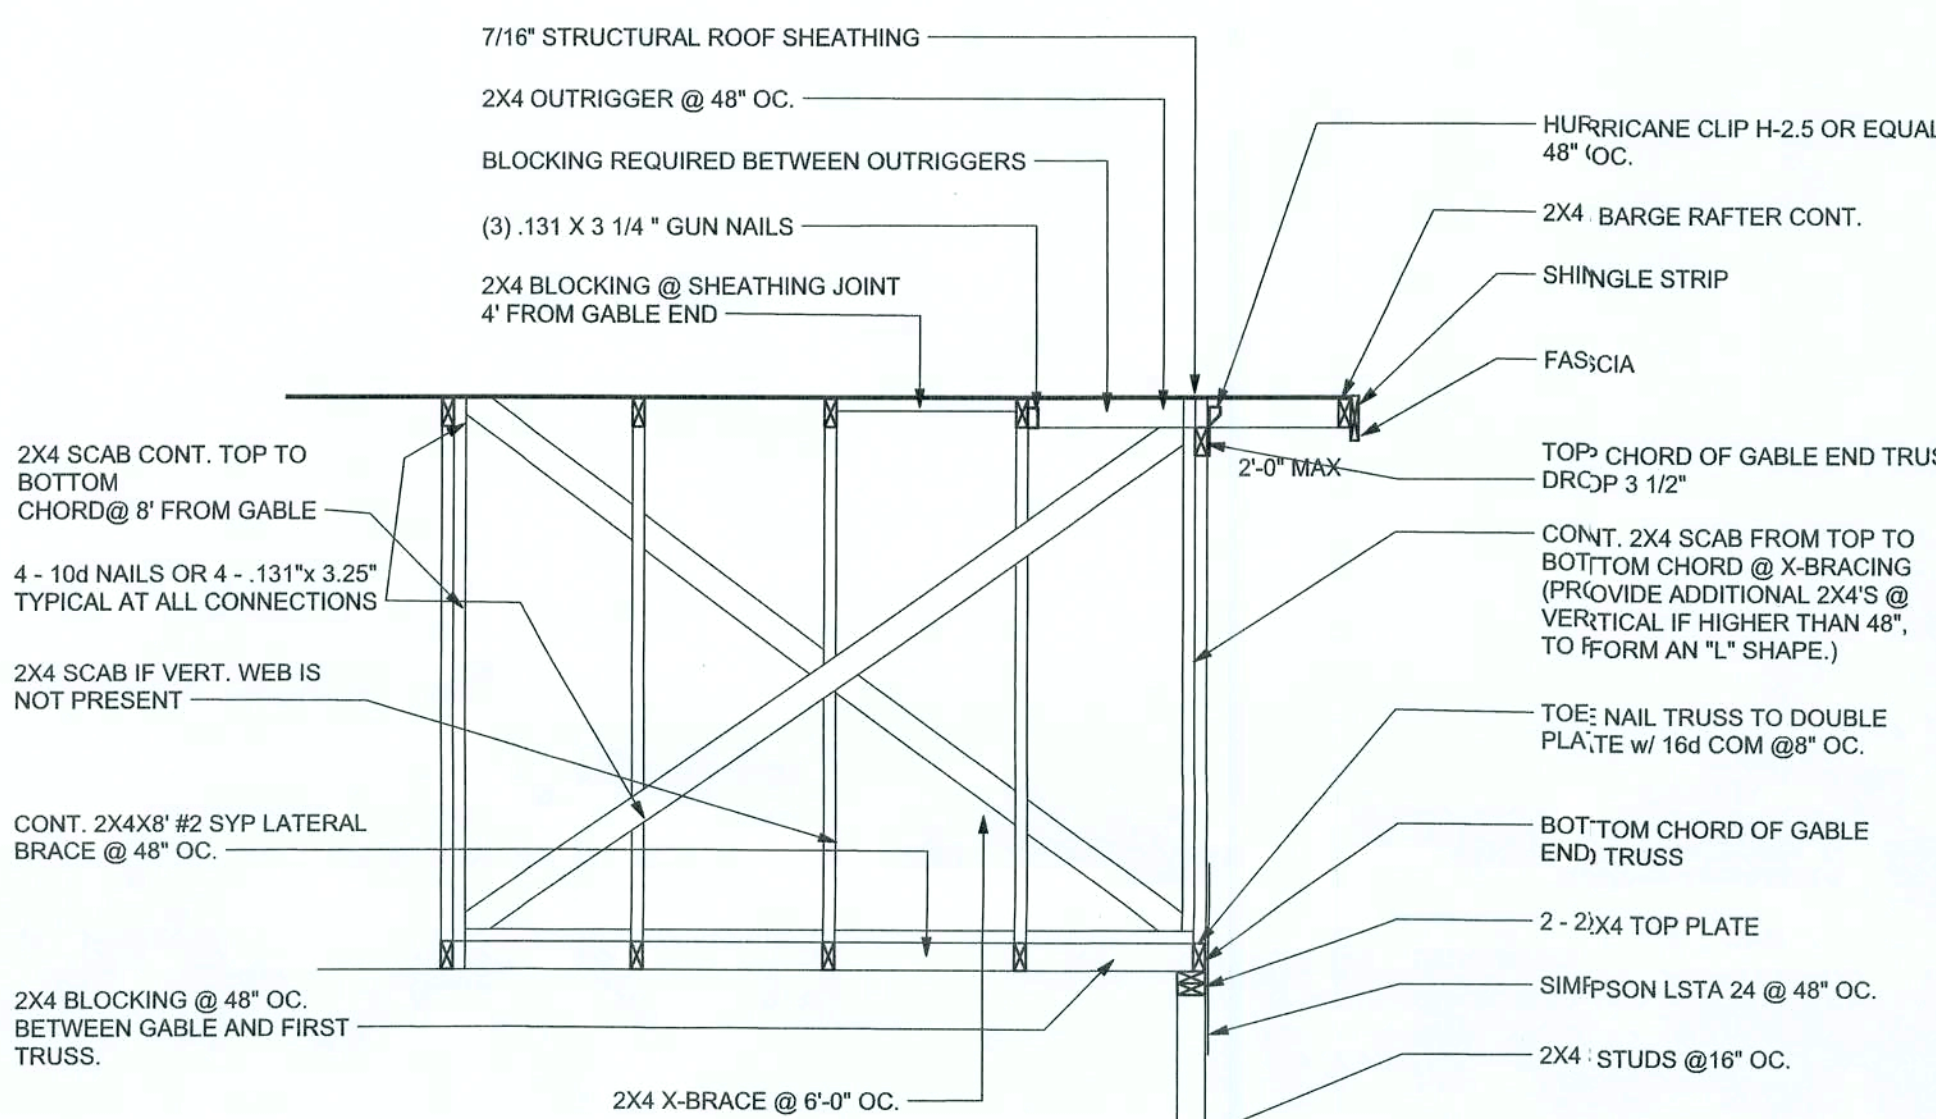

TYPICAL GABLE END (X-BRACING)

ALL MEMBERS SHALL BE SYP

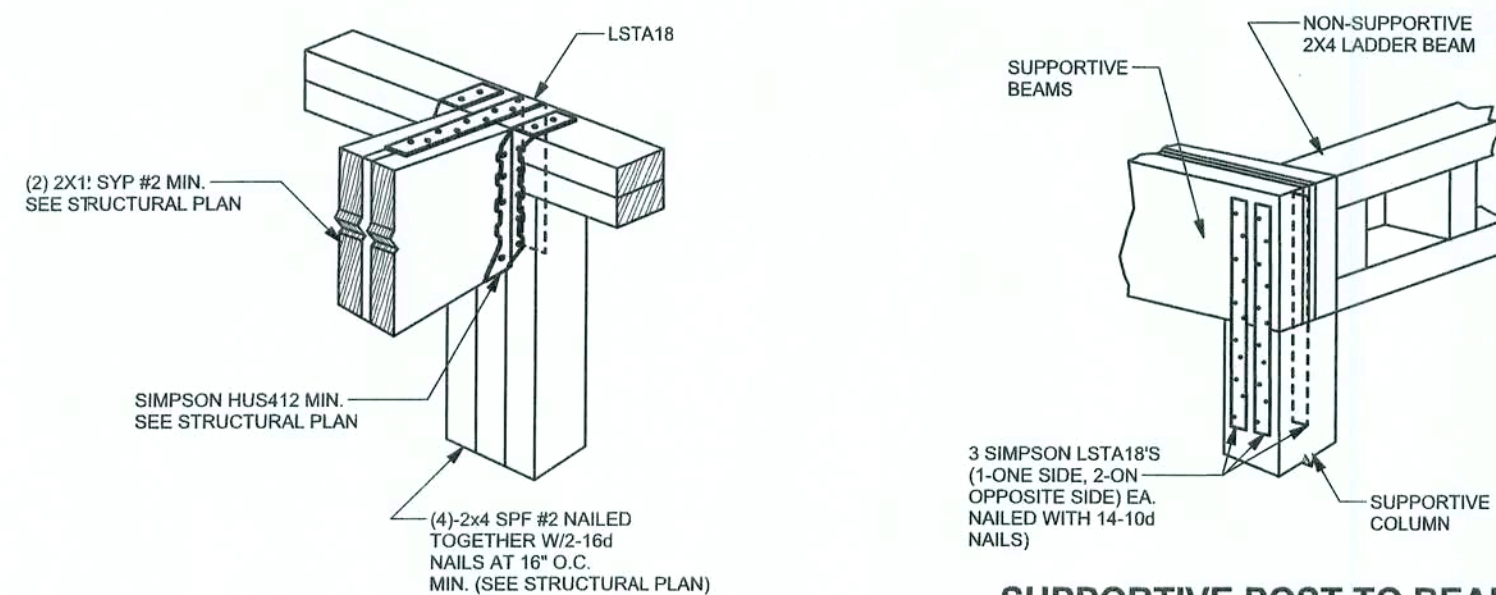


BEAM MID-WALL CONNECTION DETAIL

SCALE: N.T.S.

SUPPORTIVE POST TO BEAM DETAIL FOR SINGLE BEAM

SCALE: N.T.S.

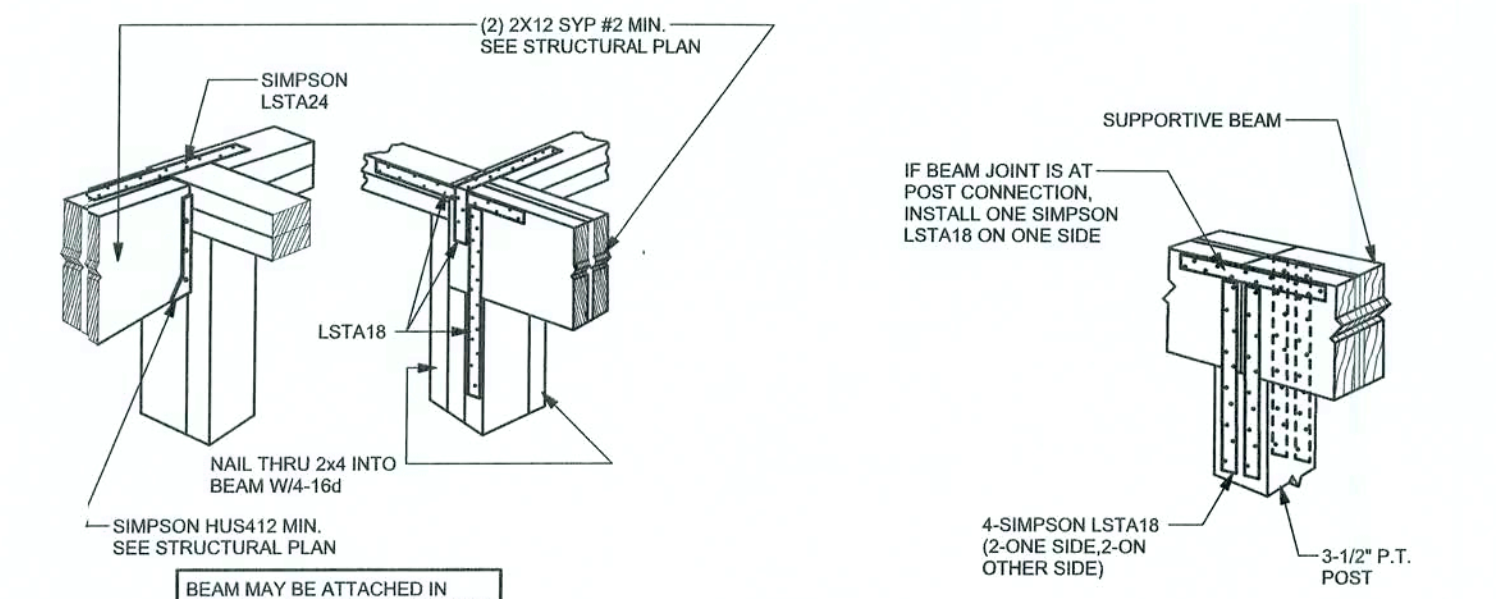


BEAM CORNER CONNECTION DETAIL

SCALE: N.T.S.

SUPPORTIVE CENTER POST TO BEAM DETAIL

SCALE: N.T.S.

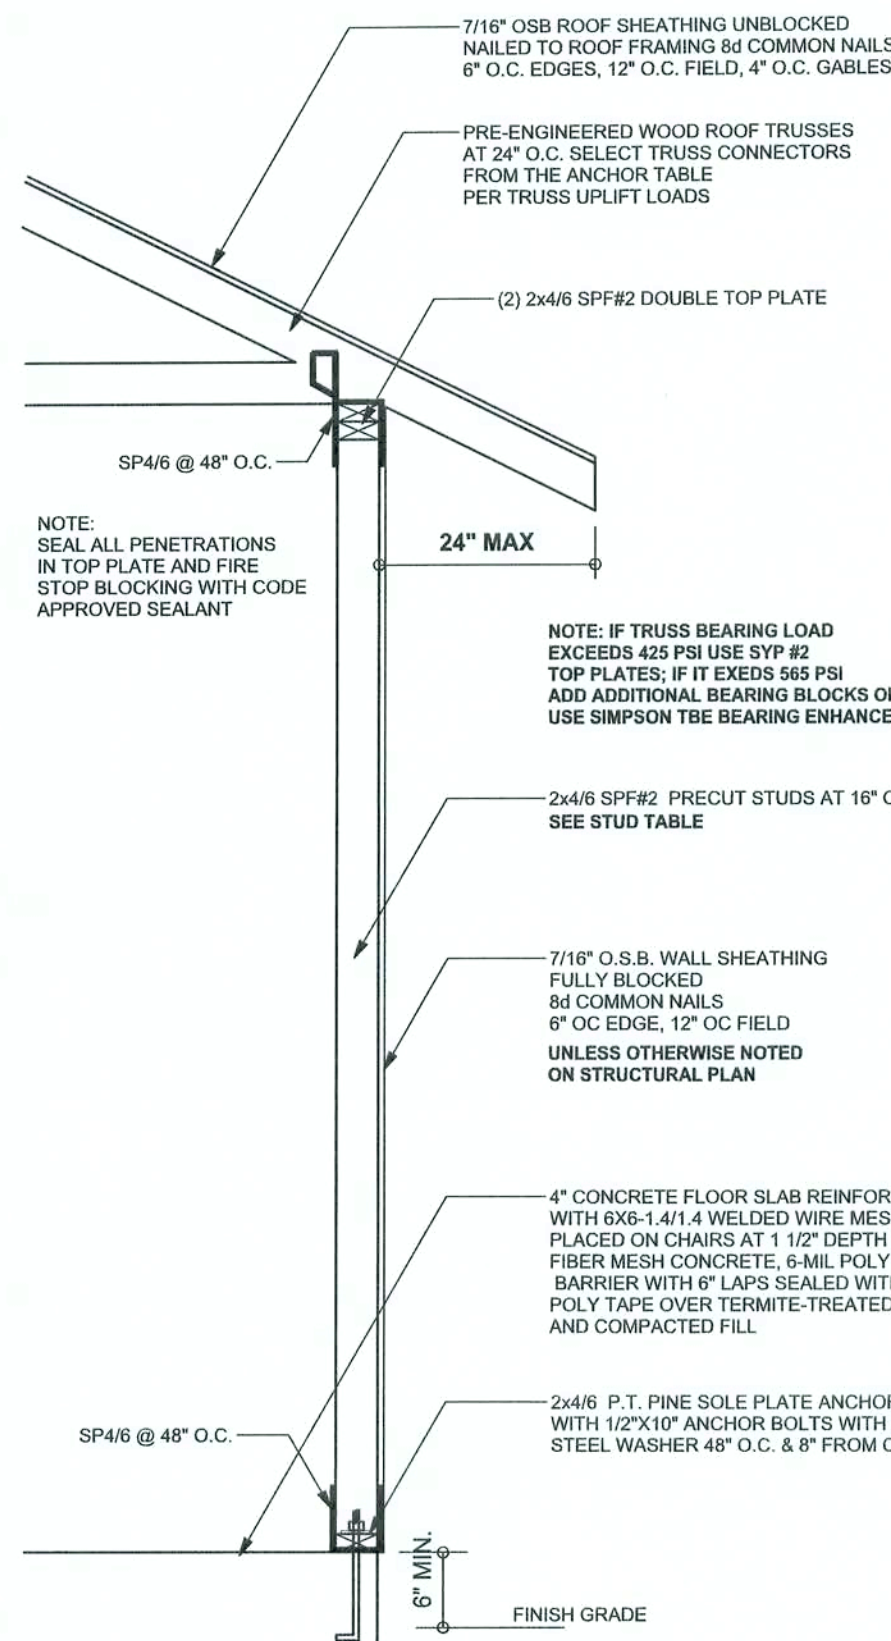


ONE STORY WALL SECTION

SCALE: 3/4" = 1'-0"

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS

| | |
|------------------|------------------------|
| (1) 2x4 @ 16" OC | TO 11'-9" STUD HEIGHT |
| (1) 2x4 @ 12" OC | TO 13'-0" STUD HEIGHT |
| (1) 2x6 @ 16" OC | TO 18'-10" STUD HEIGHT |
| (1) 2x6 @ 12" OC | TO 20'-0" STUD HEIGHT |

THIS STUD HEIGHT TABLE IS PER WFCM 2001, TABLE 3.20B. EXTERIOR LOAD BEARING & NON-LOAD BEARING STUD LENGTHS RESISTING INTERIOR ZONE WINDLOADS 110 MPH EXPOSURE B. STUD SPACINGS SHALL BE MULTIPLIED BY 0.85 FOR FRAMING LOCATED WITHIN 4 FEET OF CORNERS FOR END ZONE LOADING. EXAMPLE 16" O.C. x 0.85 = 13'-6" O.C.

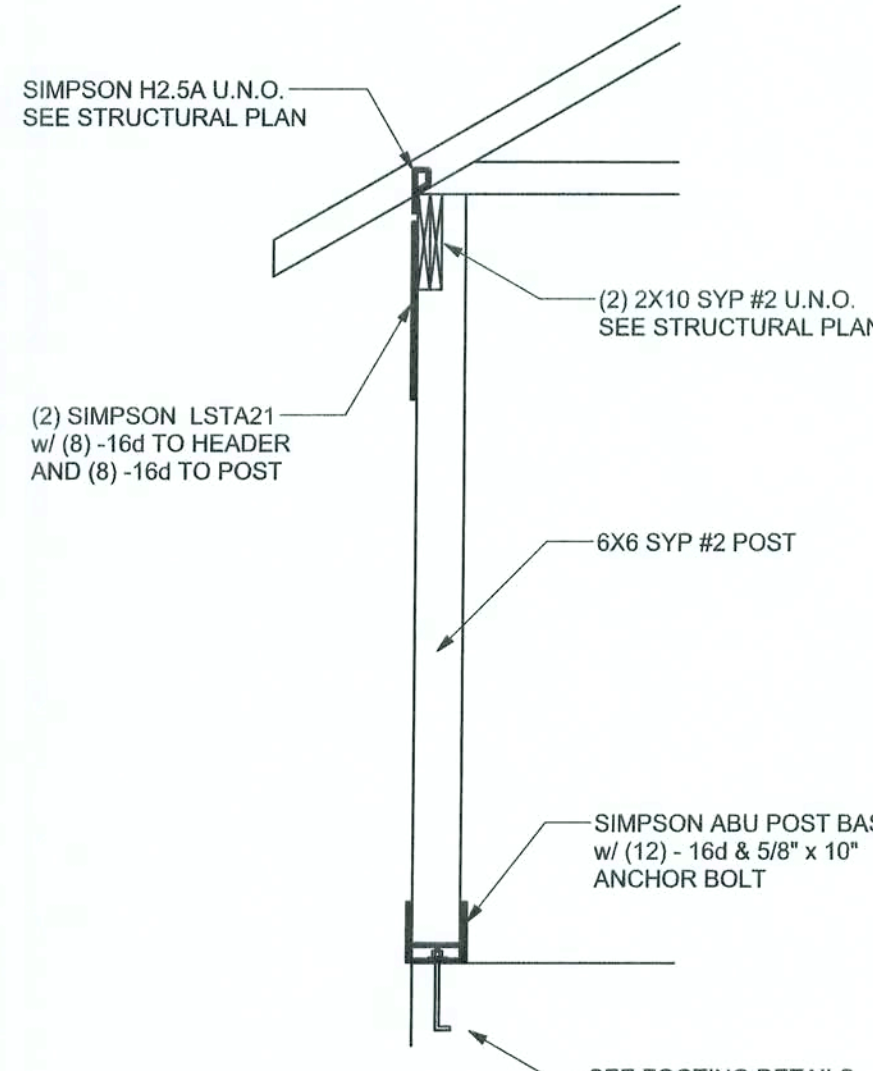

TYPICAL PORCH POST DETAIL

SCALE: 1/2" = 1'-0"

WINDLOAD ENGINEER: Mark Disoway, P.E. No. 53915, POB 868, Lake City, FL 32066, 386-754-5419

DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with section R301.2.1, Florida building code residential 2004, to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY
P.E. 53915

SEAL

EWPL, INC.

The Morice Model
Lot 39
Three Rivers Estates S/D

ADDRESS:
Lot 39 Three Rivers Estates S/D
Columbia County, Florida
Mark Disoway P.E.
P.O. Box 868
Lake City, Florida 32066
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
January 07, 2006

DRAWN BY: David Disoway

CHECKED BY:

FINALS DATE:
07 / Jan / 06

JOB NUMBER:
512142

DRAWING NUMBER


S-1

OF 3 SHEETS

OFFICE COPY


| REVISIONS |
|-----------|
| |
| |
| |

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE



The table assumes 60 ksi reinforcing bars with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16"OC vertically or a horizontal bond beam with 1#5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.

| STEMWALL HEIGHT (FEET) | UNBALANCED BACKFILL HEIGHT | VERTICAL REINFORCEMENT FOR 8" CMU STEMWALL (INCHES O.C.) | | | VERTICAL REINFORCEMENT FOR 12" CMU STEMWALL (INCHES O.C.) | | |
|------------------------------|----------------------------------|--|----|----|---|----|----|
| | | #5 | #7 | #8 | #5 | #7 | #8 |
| 3.3 | 3.0 | 96 | 96 | 96 | 96 | 96 | 96 |
| 4.0 | 3.7 | 96 | 96 | 96 | 96 | 96 | 96 |
| 4.7 | 4.3 | 88 | 96 | 96 | 96 | 96 | 96 |
| 5.3 | 5.0 | 56 | 96 | 96 | 96 | 96 | 96 |
| 6.0 | 5.7 | 40 | 80 | 96 | 80 | 96 | 96 |
| 6.7 | 6.3 | 32 | 56 | 80 | 56 | 96 | 96 |
| 7.3 | 7.0 | 24 | 40 | 56 | 40 | 80 | 96 |
| 8.0 | 7.7 | 16 | 32 | 48 | 32 | 64 | 80 |
| 8.7 | 8.3 | 8 | 24 | 32 | 24 | 48 | 64 |
| 9.3 | 9.0 | 8 | 16 | 24 | 16 | 40 | 48 |

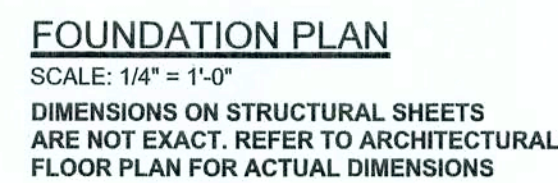

MEASUREMENTS:
 Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPIES AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable provisions of the plan, relating to wind engineering comply with section R301.2.1, Florida building code residential 2004, to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY
P.E. 53915

MARK DISOSWAY
P.E. 53915

Mark Disosway
09 JAN 86
SEAL

Ewpl, Inc.

The Morice Model
Lot 39
Three Rivers Estates S/D

ADDRESS:
Lot 39 Three Rivers Estates S/D
Columbia County, Florida

Mark Disosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
January 07, 2006


| | |
|-----------------------------|-------------|
| DRAWN BY: David Disosway | CHECKED BY: |
|-----------------------------|-------------|

| | |
|-------------------------------|--|
| FINALS DATE: 07 / Jan / 06 | |
|-------------------------------|--|

JOB NUMBER:
542142

| |
|----------------|
| 512142 |
| DRAWING NUMBER |

S-2
OF 3 SHEETS

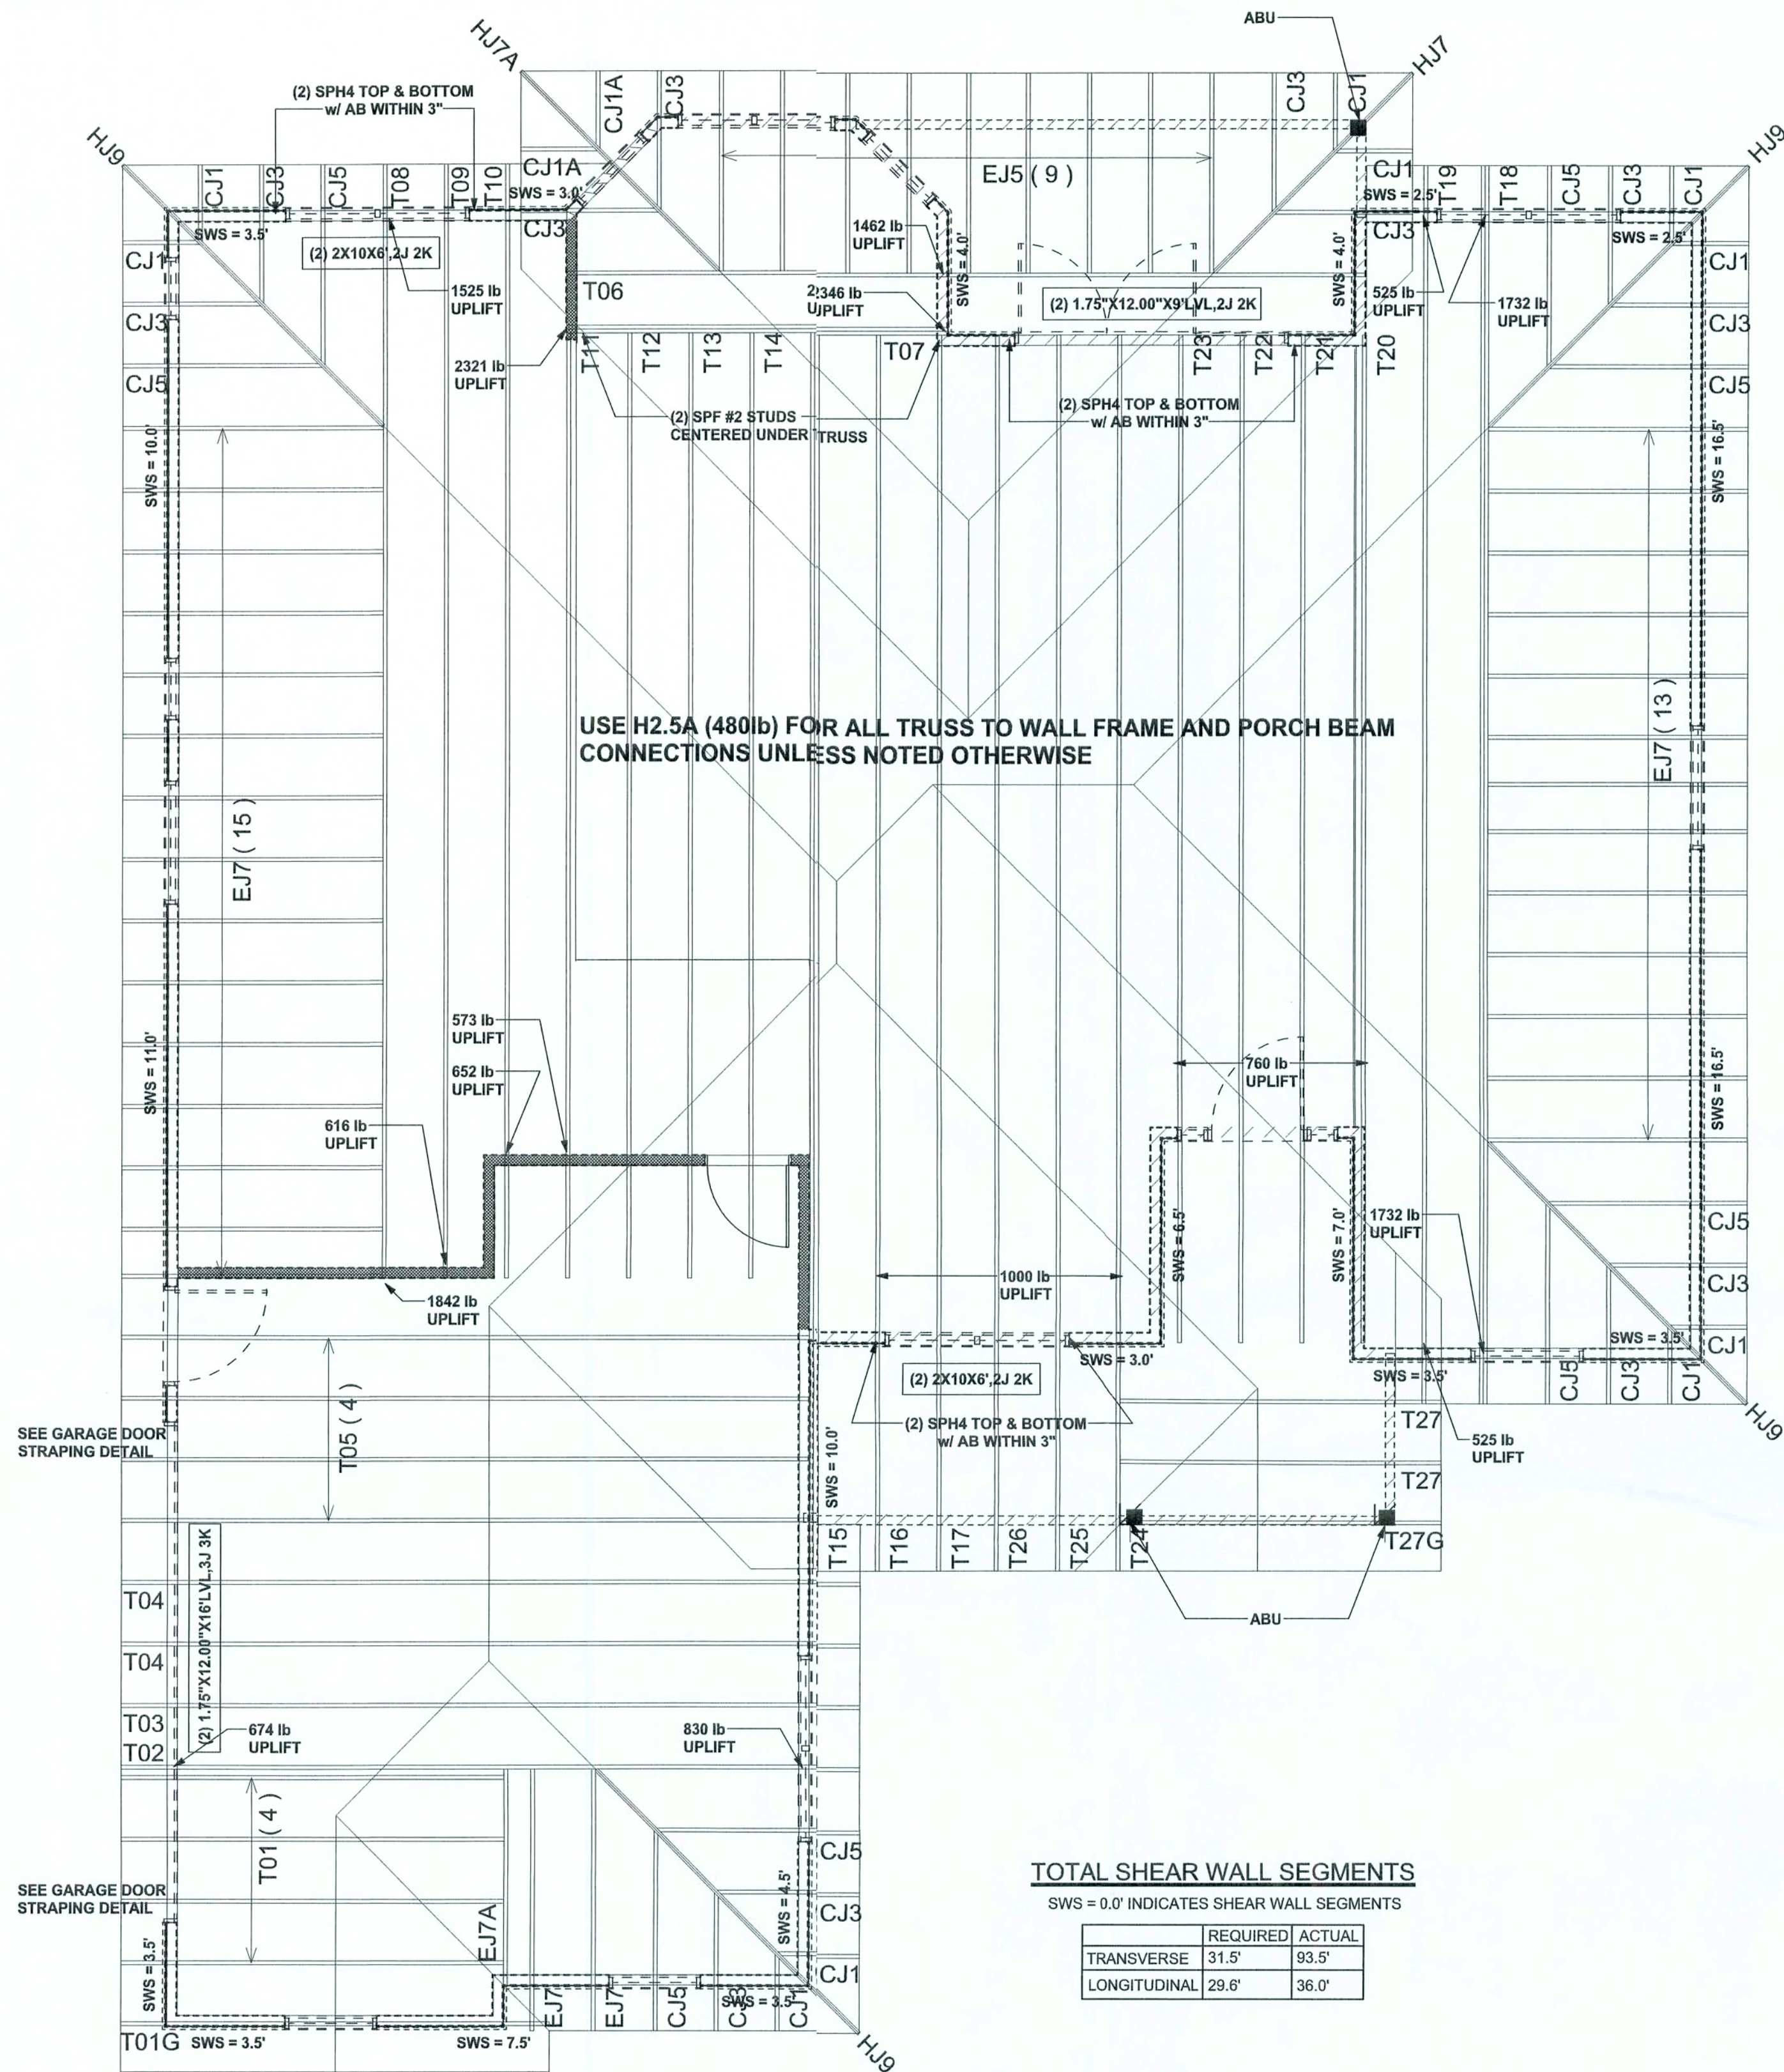

STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"


STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X10 SYP #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-4 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCS1-43, BCS1-B1, BCS1-B2, & BCS1-B3. BCS1-B1, BCS1-B2, & BCS1-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

WALL LEGEND

| | |
|------------|--|
| SWS = 0.0' | 1ST FLOOR EXTERIOR WALL WITH 7/16" O.S.B. WALL SHEATHING FULLY BLOCKED 8d COMMON NAILS 6" O.C. EDGE, 12" O.C. FIELD (U.N.O.) |
| SWS = 0.0' | 2ND FLOOR EXTERIOR WALL WITH 7/16" O.S.B. WALL SHEATHING FULLY BLOCKED 8d COMMON NAILS 6" O.C. EDGE, 12" O.C. FIELD (U.N.O.) |
| IBW | 1ST FLOOR INTERIOR BEARING WALLS SEE DETAILS ON SHEET S-1 |
| IBW | 2ND FLOOR INTERIOR BEARING WALLS SEE DETAILS ON SHEET S-1 |

HEADER LEGEND

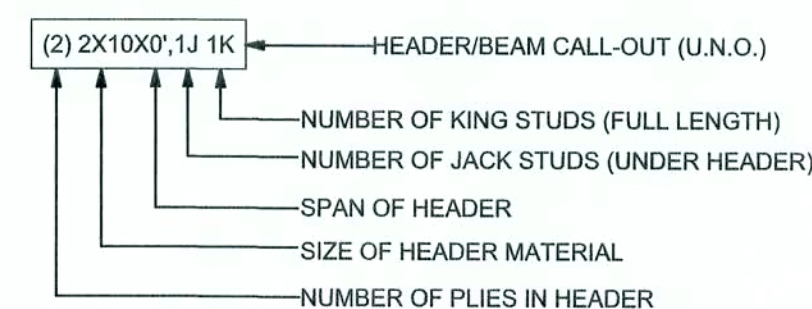

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. BUILDERS FIRST SOURCE JOB #144266

| REVISIONS | |
|-----------|--|
| | |
| | |
| | |

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

WINDLOAD ENGINEER: Mark Disoway,
P.E. No. 53915, P.O. Box 868, Lake City, FL
32066, 386-754-5419

DIMENSIONS:
Stated dimensions supersede scaled
dimensions. Refer all questions to
Mark Disoway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable
portions of the plan, relating to valid engineering
comply with section R301.2.1, Florida building
code residential 2004, to the best of my
knowledge.

LIMITATION: This design is valid for one
building, at specified location.

MARK DISOWAY
P.E. 53915

Mark Disoway
09 JAN 06
SEAL

Ewpl, Inc.

The Morice Model
Lot 39
Three Rivers Estates S/D

ADDRESS:
Lot 39 Three Rivers Estates S/D
Columbia County, Florida

Mark Disoway P.E.
P.O. Box 868
Lake City, Florida 32066
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
January 07, 2006

DRAWN BY: David Disoway

CHECKED BY:

FINALS DATE:
07 / Jan / 06

JOB NUMBER:
512142

DRAWING NUMBER

S-3

OF 3 SHEETS