


DESCRIPTION

CEDAR SPRING SHORES UNIT NO. 5 LOT 32 (1.40 A) COLUMBIA COUNTY, FLORIDA

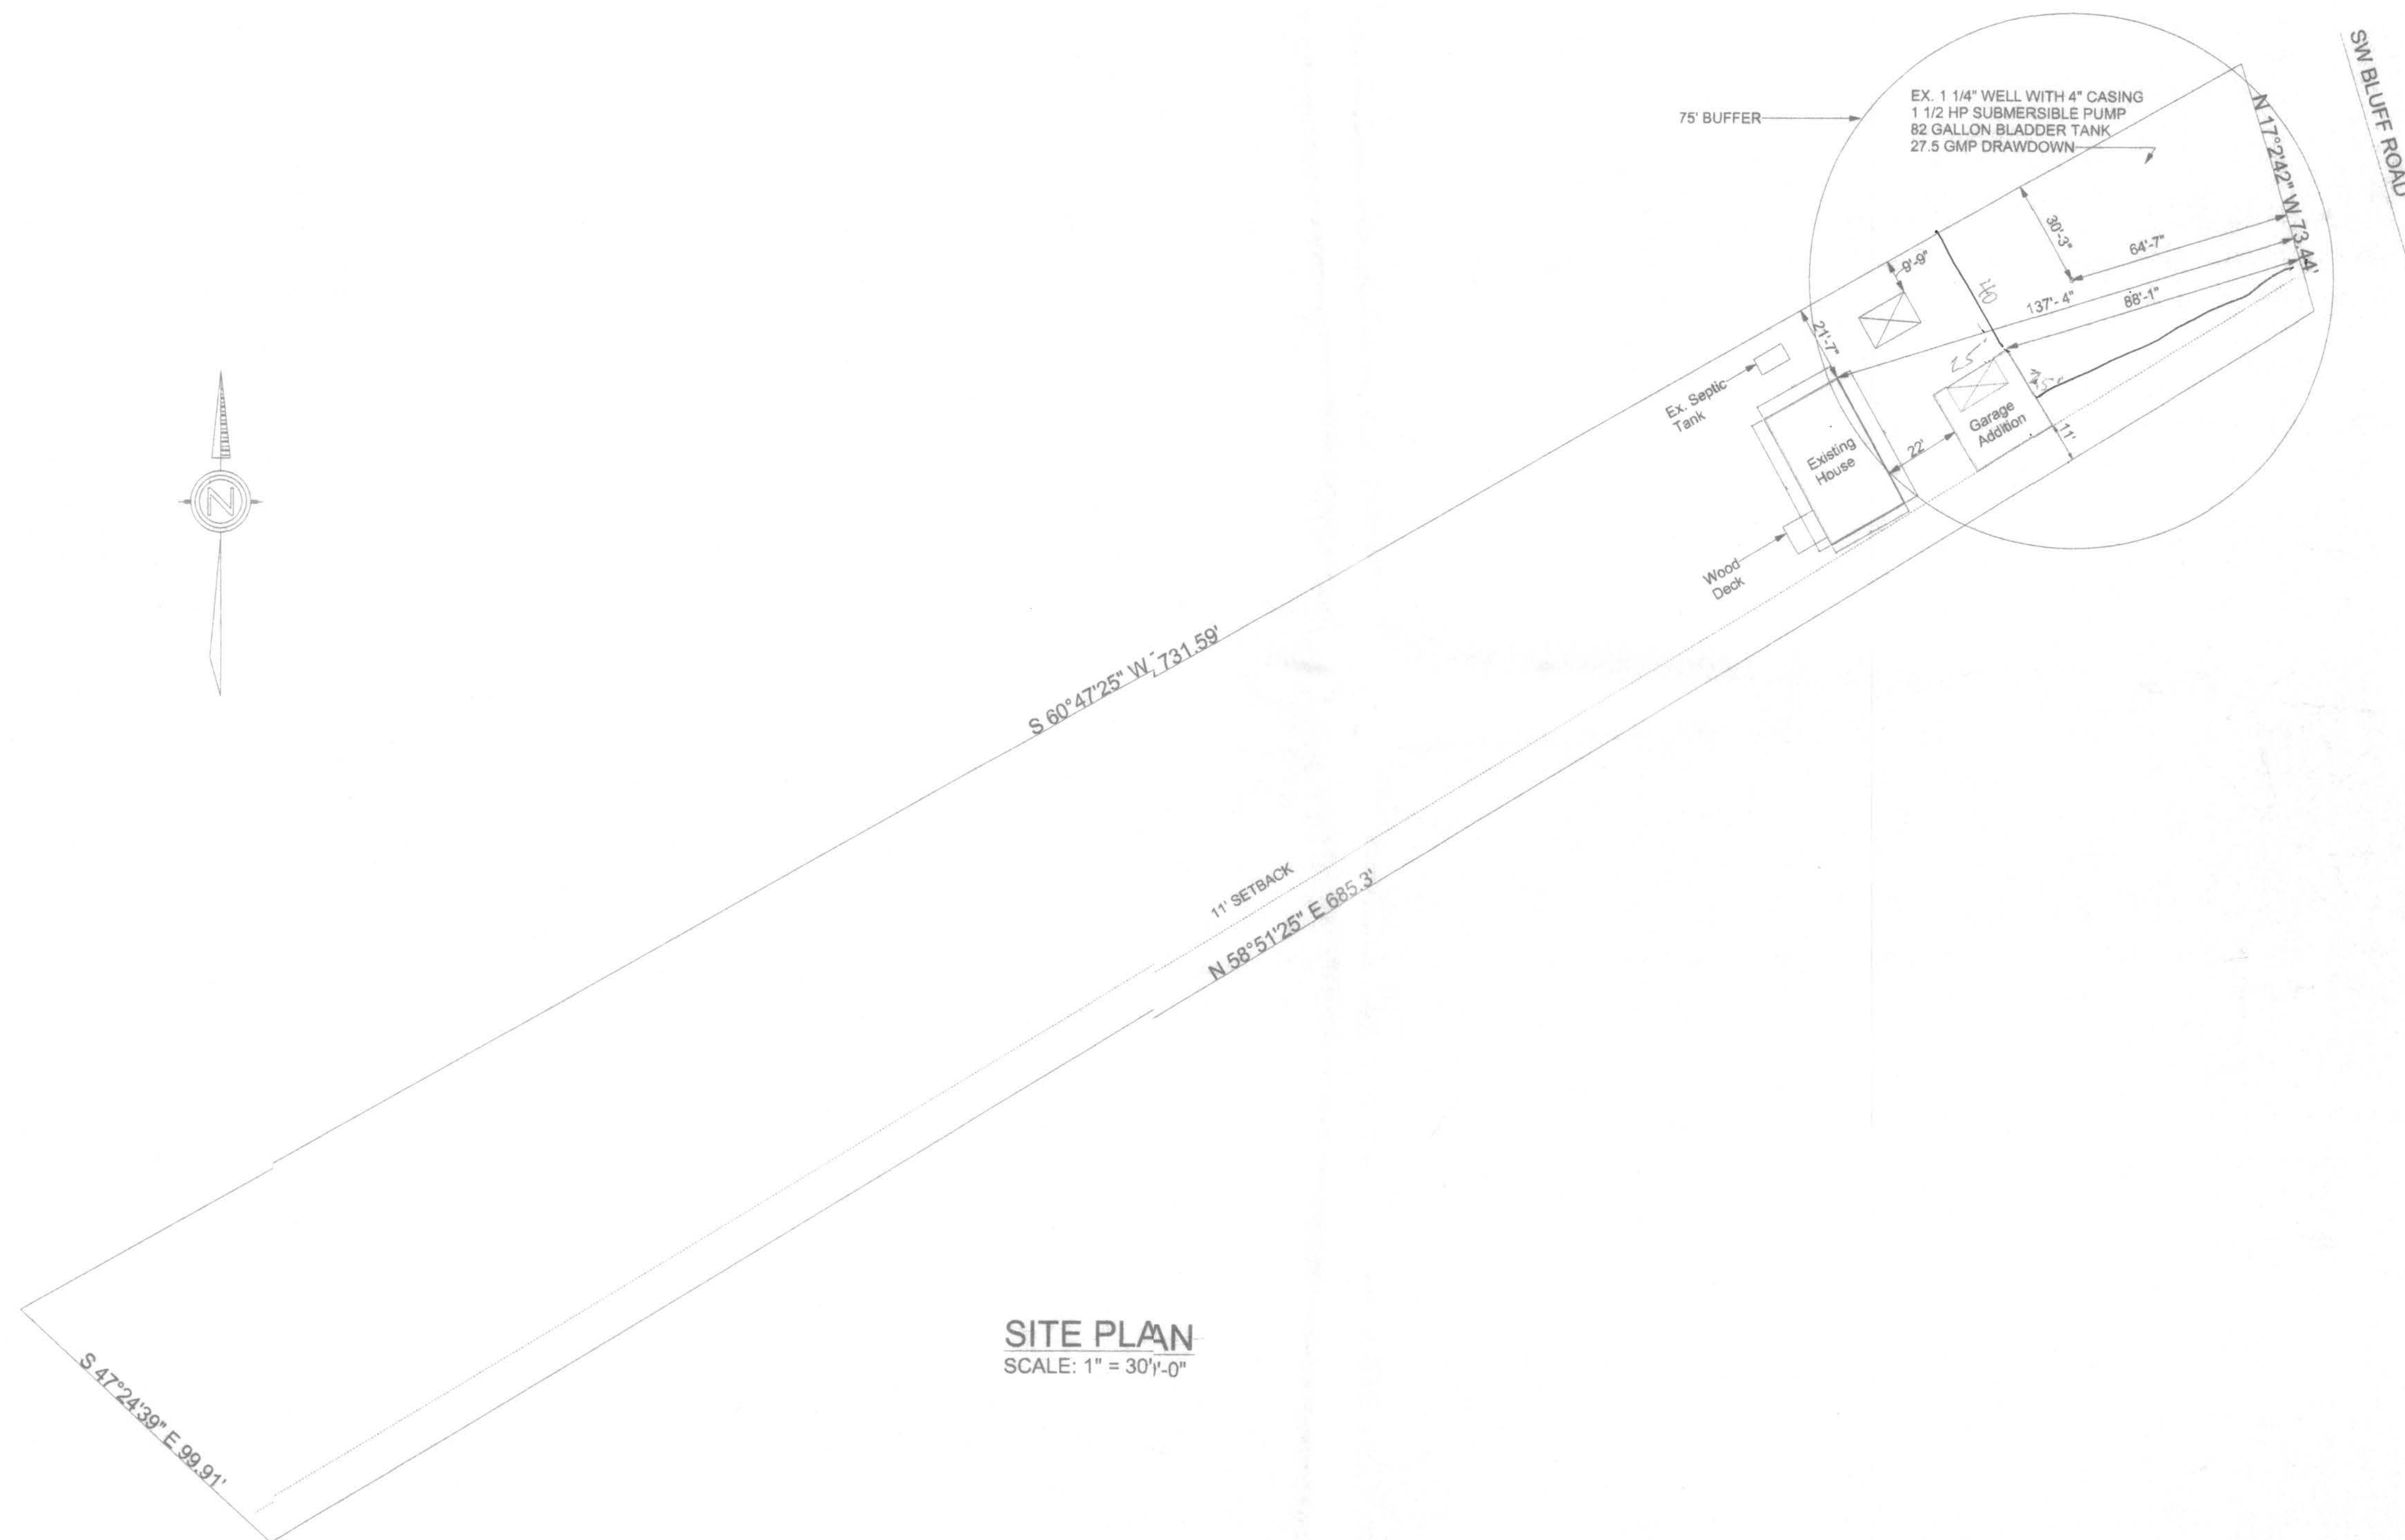

SITE PLAN
SCALE: 1" = 30'-0"

HEIMSATH RESIDENCE

161 NW MADISON STREET
SUITE #102
LAKE CITY, FL. 32055
(386) 758-4209

CERTIFICATE OF AUTHORIZATION # 00008701



DATE
4/27/06

DRAWN BY
W.H.F.


REVISIONS

SHEET SP-1

OF 1

PROJECT NO.
05.R018

Office Copy

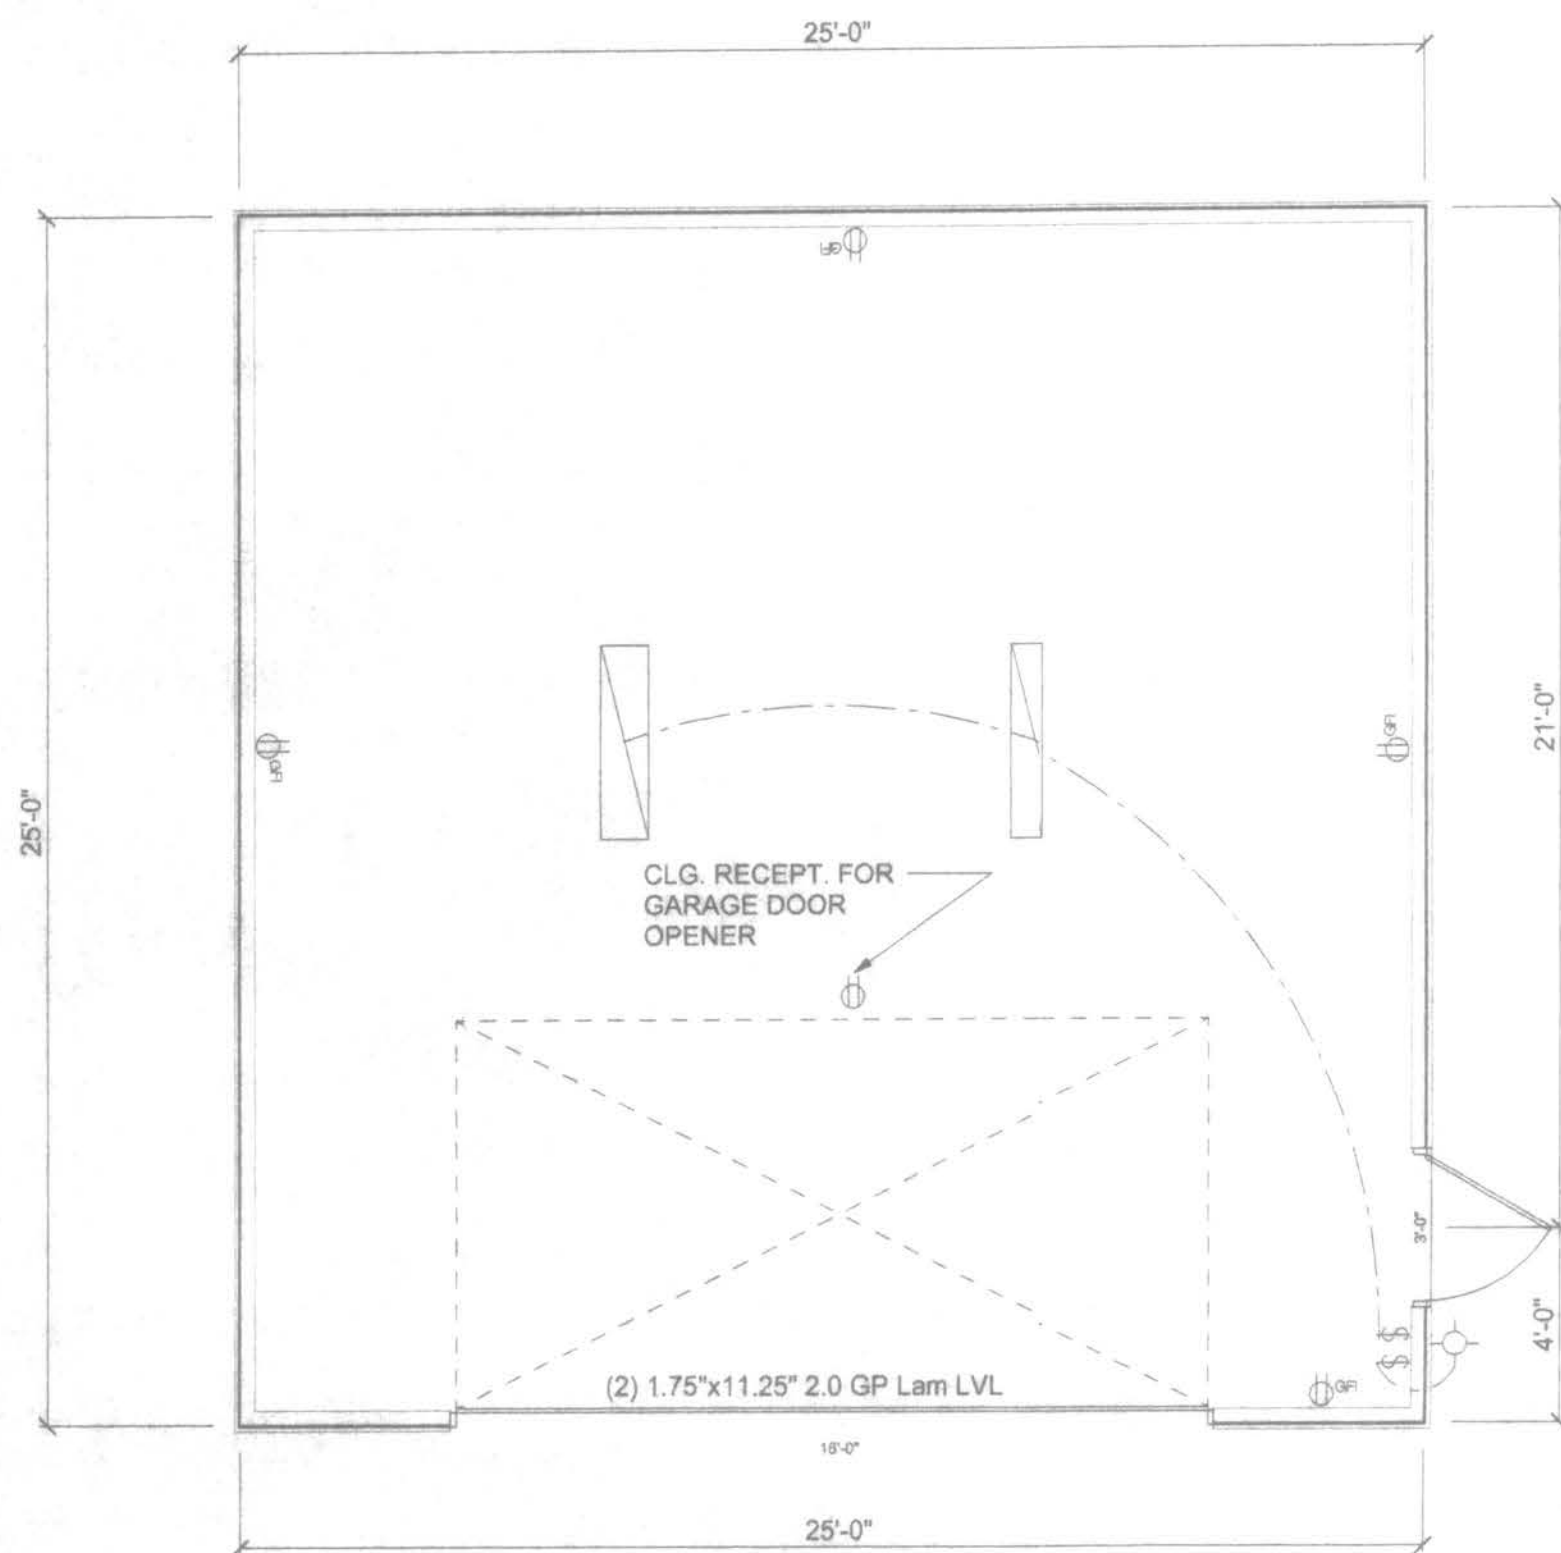

GARAGE FLOOR PLAN

SCALE: 1/4" = 1'-0"

AREA SUMMARY

GARAGE: 625 S.F.

| PRODUCT CODE | SIZE | COUNT |
|-------------------------------|--------|-------|
| 36x80 colonial | 3'-1" | 1 |
| 192x84 wide panel garage door | 16'-0" | 1 |

| ELECTRICAL | SYMBOL |
|---------------------|--------|
| fluorescent fixture | |
| outlet | |
| outlet gfi | |
| switch | |

NOTE:
ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION 1609, FLORIDA BUILDING CODE, 2004 EDITION.


| | | |
|---------------------------------|-----------|-----------------|
| BASIC WIND SPEED | | 110 MPH |
| IMPORTANCE FACTOR | | 1.0 |
| BUILDING CATEGORY | | 2 |
| EXPOSURE | | B |
| INTERNAL PRESSURE COEFFICIENT | | +/- 0.18 |
| COMPONENT AND CLADDING PRESSURE | WALLS | +21.8/-29.1 PSF |
| | ROOF | +12.5/-29.1 PSF |
| | OVERHANGS | -71.6 PSF |
| TYPE OF STRUCTURE | | ENCLOSED |
| ROOF DEAD LOAD | | 10 psf |
| ROOF LIVE LOAD | | 20 psf |
| FLOOR DEAD LOAD | | 20 psf |
| FLOOR LIVE LOAD | | 40 psf |

ALLOWABLE DEFLECTION OF STRUCTURAL MEMBERS

| STRUCTURAL MEMBER | ALLOWABLE DEFLECTION |
|--|----------------------|
| rafters having slopes greater than 2/12 with no finished ceiling attached to rafters | L/180 |
| interior walls and partitions | H/180 |
| floors and plastered ceilings | L/360 |
| all other structural members | L/240 |
| exterior walls with plaster or stucco finish | H/360 |
| exterior walls - wind loads with brittle finishes | L/240 |
| exterior walls - wind loads with flexible finishes | L/120 |


GENERAL NOTES:

1. THE CONTRACTOR SHALL INDEMNIFY THE OWNER AGAINST ALL CLAIMS, WHETHER FROM PERSONAL INJURY OR PROPERTY DAMAGE, ARISING FROM EVENTS ASSOCIATED WITH THE WORK PERFORMED UNDER THE CONTRACT FOR THIS PROJECT.
2. THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL WARRANT ALL WORK FOR A PERIOD OF ONE YEAR FOLLOWING THE WORK DATE OF FINAL COMPLETION AND ACCEPTANCE BY THE OWNER. DEFECTS IN MATERIALS, EQUIPMENT, COMPONENTS AND WORKMANSHIP SHALL BE CORRECTED AT NO FURTHER COST TO THE OWNER DURING THE ONE YEAR WARRANTY PERIOD.
3. AT THE OWNER'S OPTION, A WARRANTY INSPECTION SHALL BE PERFORMED DURING THE ELEVENTH MONTH FOLLOWING THE COMMENCEMENT OF THE WARRANTY PERIOD, FOR THE PURPOSE OF DETERMINING ANY WARRANTY WORK THAT MAY BE REQUIRED. THE CONTRACTOR SHALL BE PRESENT DURING THIS INSPECTION IF REQUESTED BY THE OWNER.
4. THE CONTRACTOR SHALL PAY FOR ALL PERMITS, LICENSES, TESTS AND THE LIKE THAT MAY BE REQUIRED BY THE VARIOUS AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT BE THEY CITY, COUNTY, STATE OR FEDERAL.
5. THE OWNER SHALL FILE A "NOTICE OF COMMENCEMENT" PRIOR TO THE BEGINNING OF THE PROJECT AND THE CONTRACTOR(S) SHALL FILE "NOTICE TO OWNER" AND PROVIDE "RELEASE OF LIEN" FOR ALL PAYMENT REQUESTS PRIOR TO DISBURSEMENT OF ANY FUNDS.
6. ANY AND ALL DISPUTES ARISING FROM EVENTS ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT BETWEEN THE OWNER, CONTRACTOR(S) AND SUPPLIERS SHALL BE RESOLVED THROUGH BINDING ARBITRATION.
7. ALL WORK SHALL BE IN ACCORDANCE WITH APPLICABLE CODES AND LOCAL REGULATIONS, INCLUDING APPLICABLE ENERGY CODES. ALL COMPONENTS OF THE BUILDING SHALL MEET WITH THE MINIMUM ENERGY REQUIREMENTS OF THE BUILDING CODE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IN WRITING PRIOR TO THE COMMENCEMENT OF THE WORK.
8. ALL INSULATION SHALL BE LEFT EXPOSED AND ALL LABELS LEFT INTACT ON THE WINDOWS AND DOORS UNTIL INSPECTED BY THE BUILDING OFFICIAL.
9. ALL WOOD IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED.

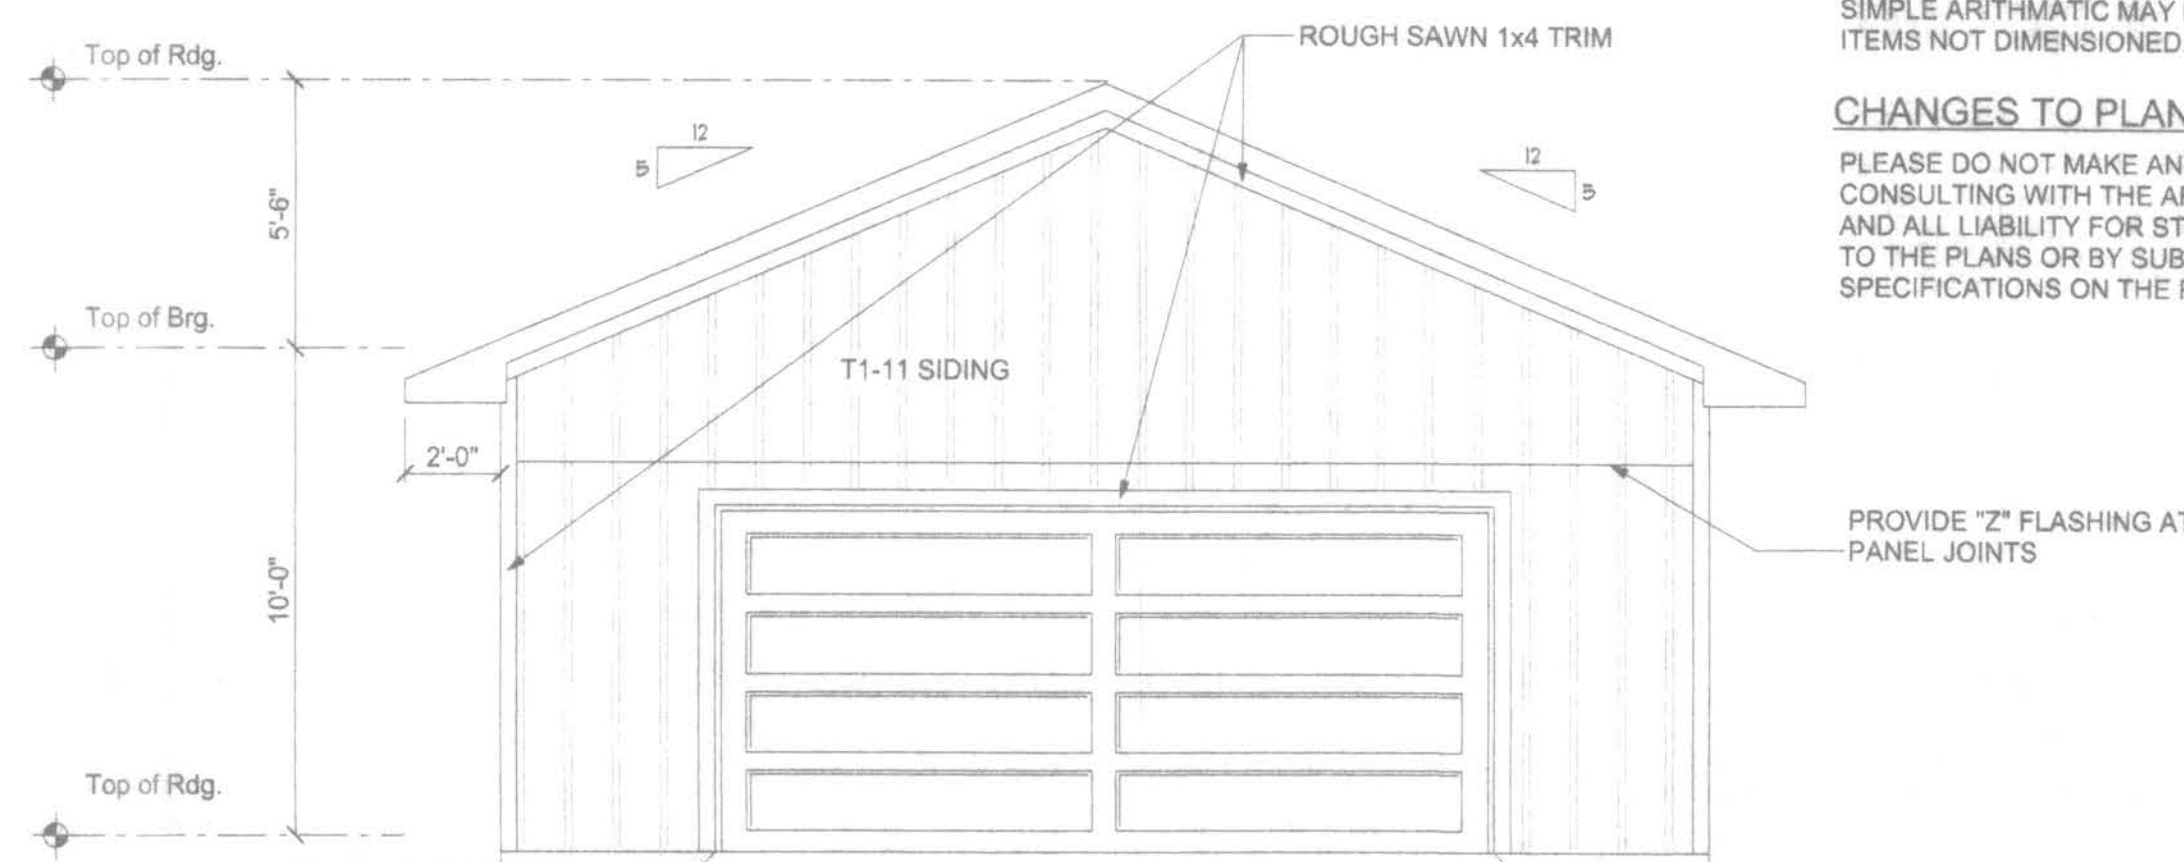


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

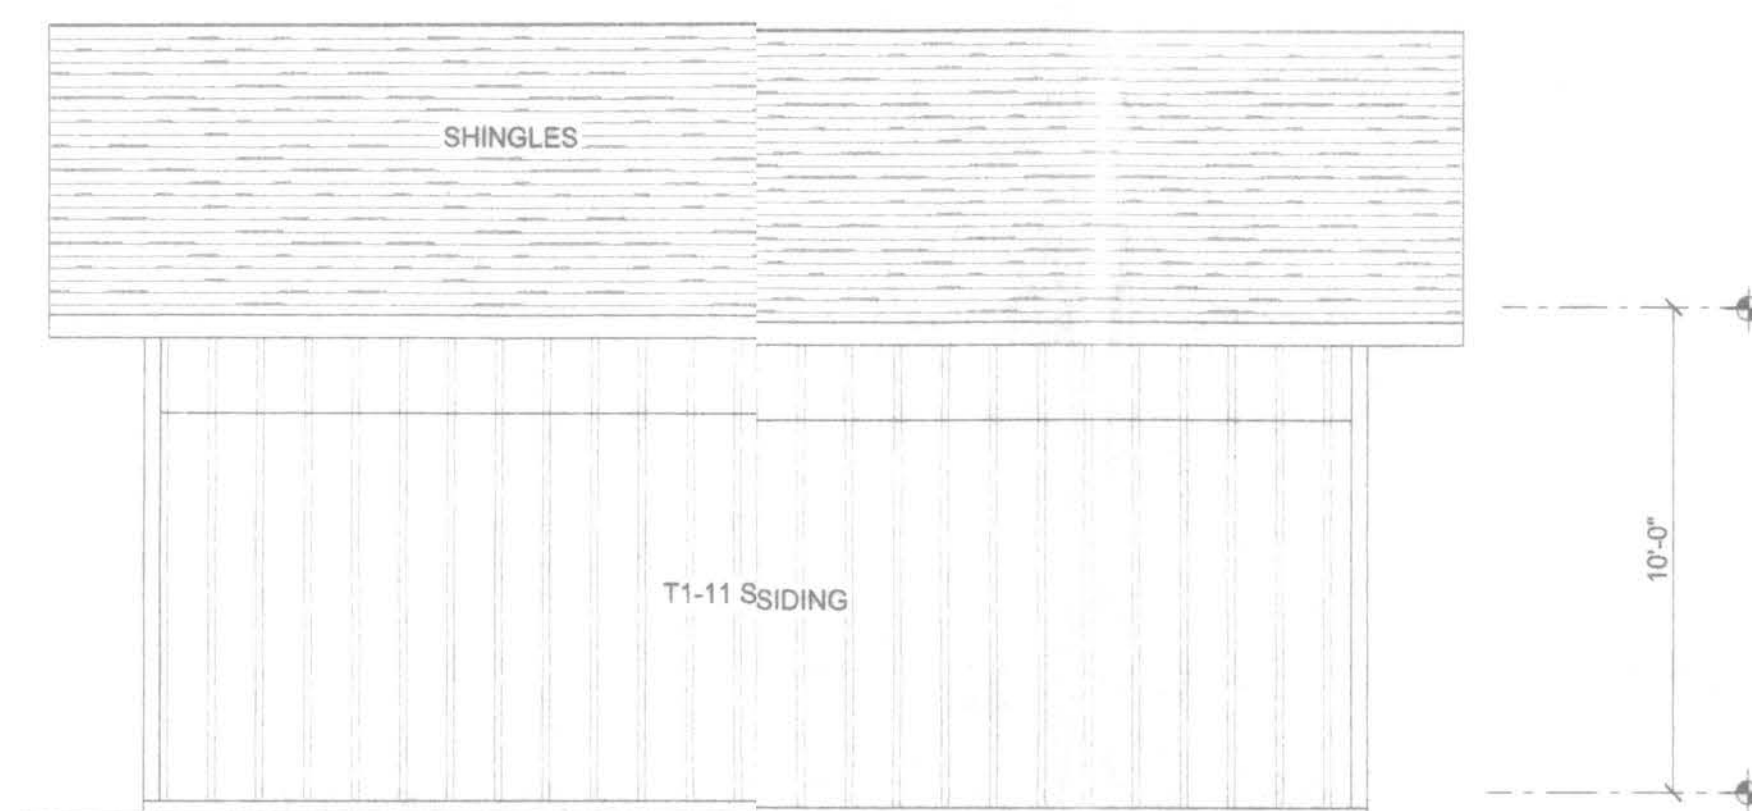

LEFT ELEVATION

SCALE: 1/4" = 1'-0"

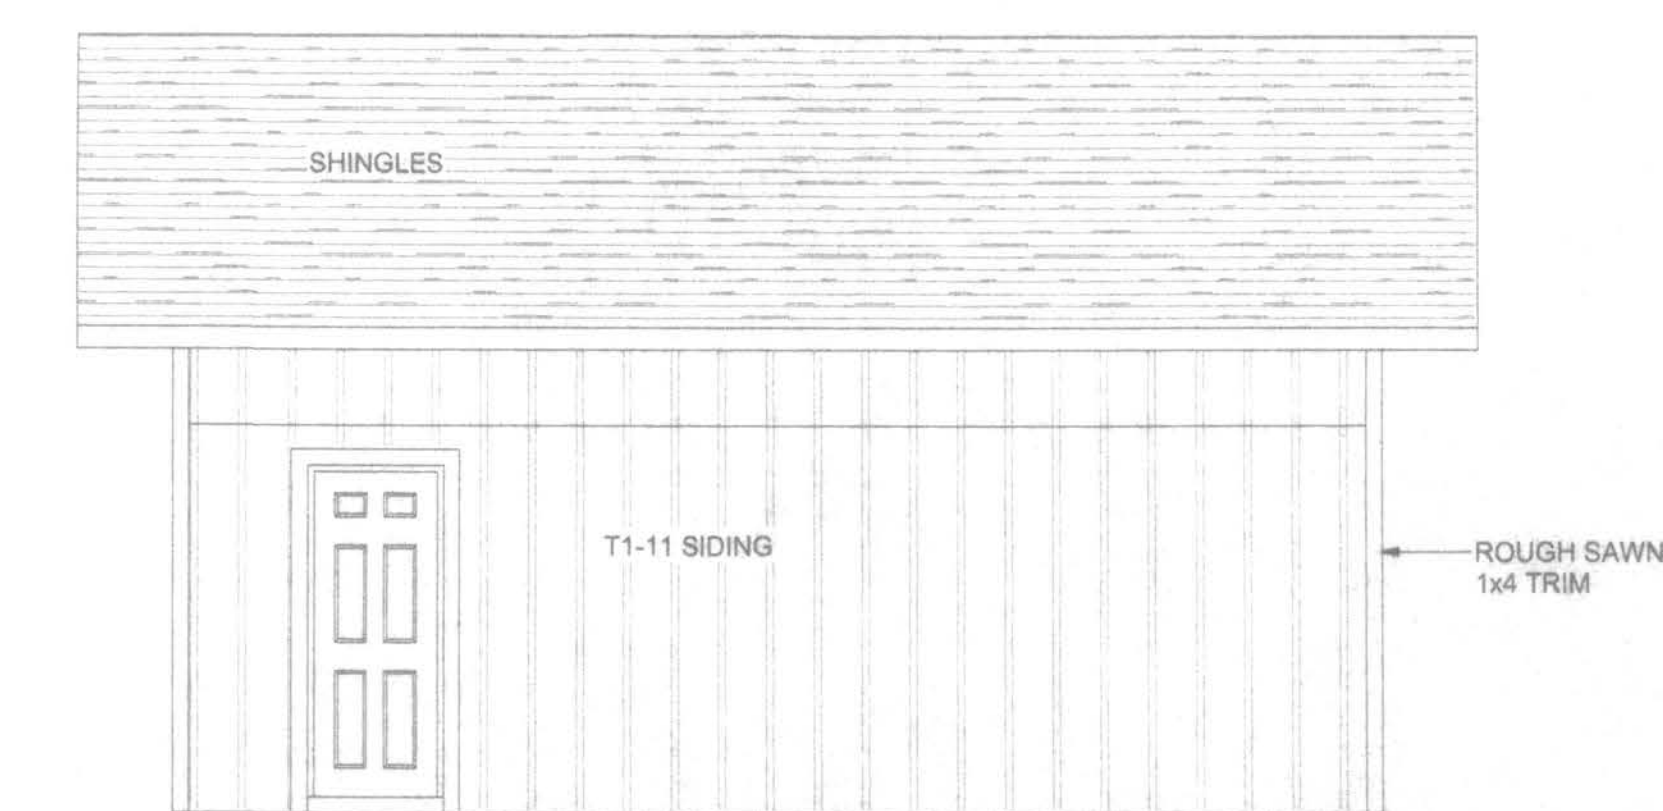

RIGHT ELEVATION

SCALE: 1/4" = 1'-0"



REAR ELEVATION

SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN NOTES

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

CONSULT THE OWNER FOR THE NUMBER OF SEPARATE TELEPHONE LINES TO BE INSTALLED.

INSTALLATION SHALL BE PER NAT'L. ELEC. CODE.

ELECTRICAL CONTR. SHALL PREPARE "AS-BUILT" SHOP DWGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADDNS TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT Nr., DESCRIPTION & BREAKER SERVICE ENT. & ALL UNDERGROUND WIRE LOCATIONS/ROUTING/DEPTH, RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT TYPE W/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OFF AS-BUILT DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

CONSTRUCTION DOCUMENTS:

THE CUSTOMER IS RESPONSIBLE FOR DELIVERING THE REQUIRED SETS OF CONSTRUCTION DOCUMENTS TO THE PERMIT ISSUING AUTHORITY FOR THE ISSUANCE OF CONSTRUCTION PERMITS. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR REVIEWING THE PLANS AND VERIFYING ALL EXISTING CONDITIONS, ELEVATIONS, AND DIMENSIONS PRIOR TO COMMENCING CONSTRUCTION INCLUDING FABRICATION. ALL DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT/ENGINEER FOR RESOLUTION.

DO NOT SCALE THESE PLANS:


AMPLE DIMENSIONS ARE SHOWN ON THE PLANS TO LOCATE ALL ITEMS. SIMPLE ARITHMETIC MAY BE USED TO DETERMINE THE LOCATION OF THOSE ITEMS NOT DIMENSIONED.

CHANGES TO PLAN SETS:

PLEASE DO NOT MAKE ANY STRUCTURAL CHANGES TO THESE PLANS WITHOUT CONSULTING WITH THE ARCHITECT/ENGINEER. THE OWNER SHALL ASSUME ANY AND ALL LIABILITY FOR STRUCTURAL DAMAGE RESULTING FROM CHANGES MADE TO THE PLANS OR BY SUBSTITUTION OF MATERIALS DIFFERENT FROM SPECIFICATIONS ON THE PLANS.

HEIMSATH RESIDENCE

161 N.W. MADISON STREET
SUITE #102
LAKE CITY, FL 32055
(386)758-4209



Freeman
Design Group inc

DATE: 5/2/06
DRAWN BY: W.H.F.

REVISIONS

SHEET: A-1

OF: 4


PROJECT NO.: 06.R018

CERTIFICATE OF AUTHORIZATION # 0008701

W.H. Lee
4/20/06

HEIMSATH RESIDENCE

161 N.W. MADISON STREET
SUITE #102
LAKE CITY, FL 32055
(386) 758-4209



Freeman
Design Group

DATE
5/2/06

DRAWN BY
W.H.F.


REVISIONS

SHEET
A-2

OF
4

PROJECT NO.
06.R016

CERTIFICATE OF AUTHORIZATION # 00005701

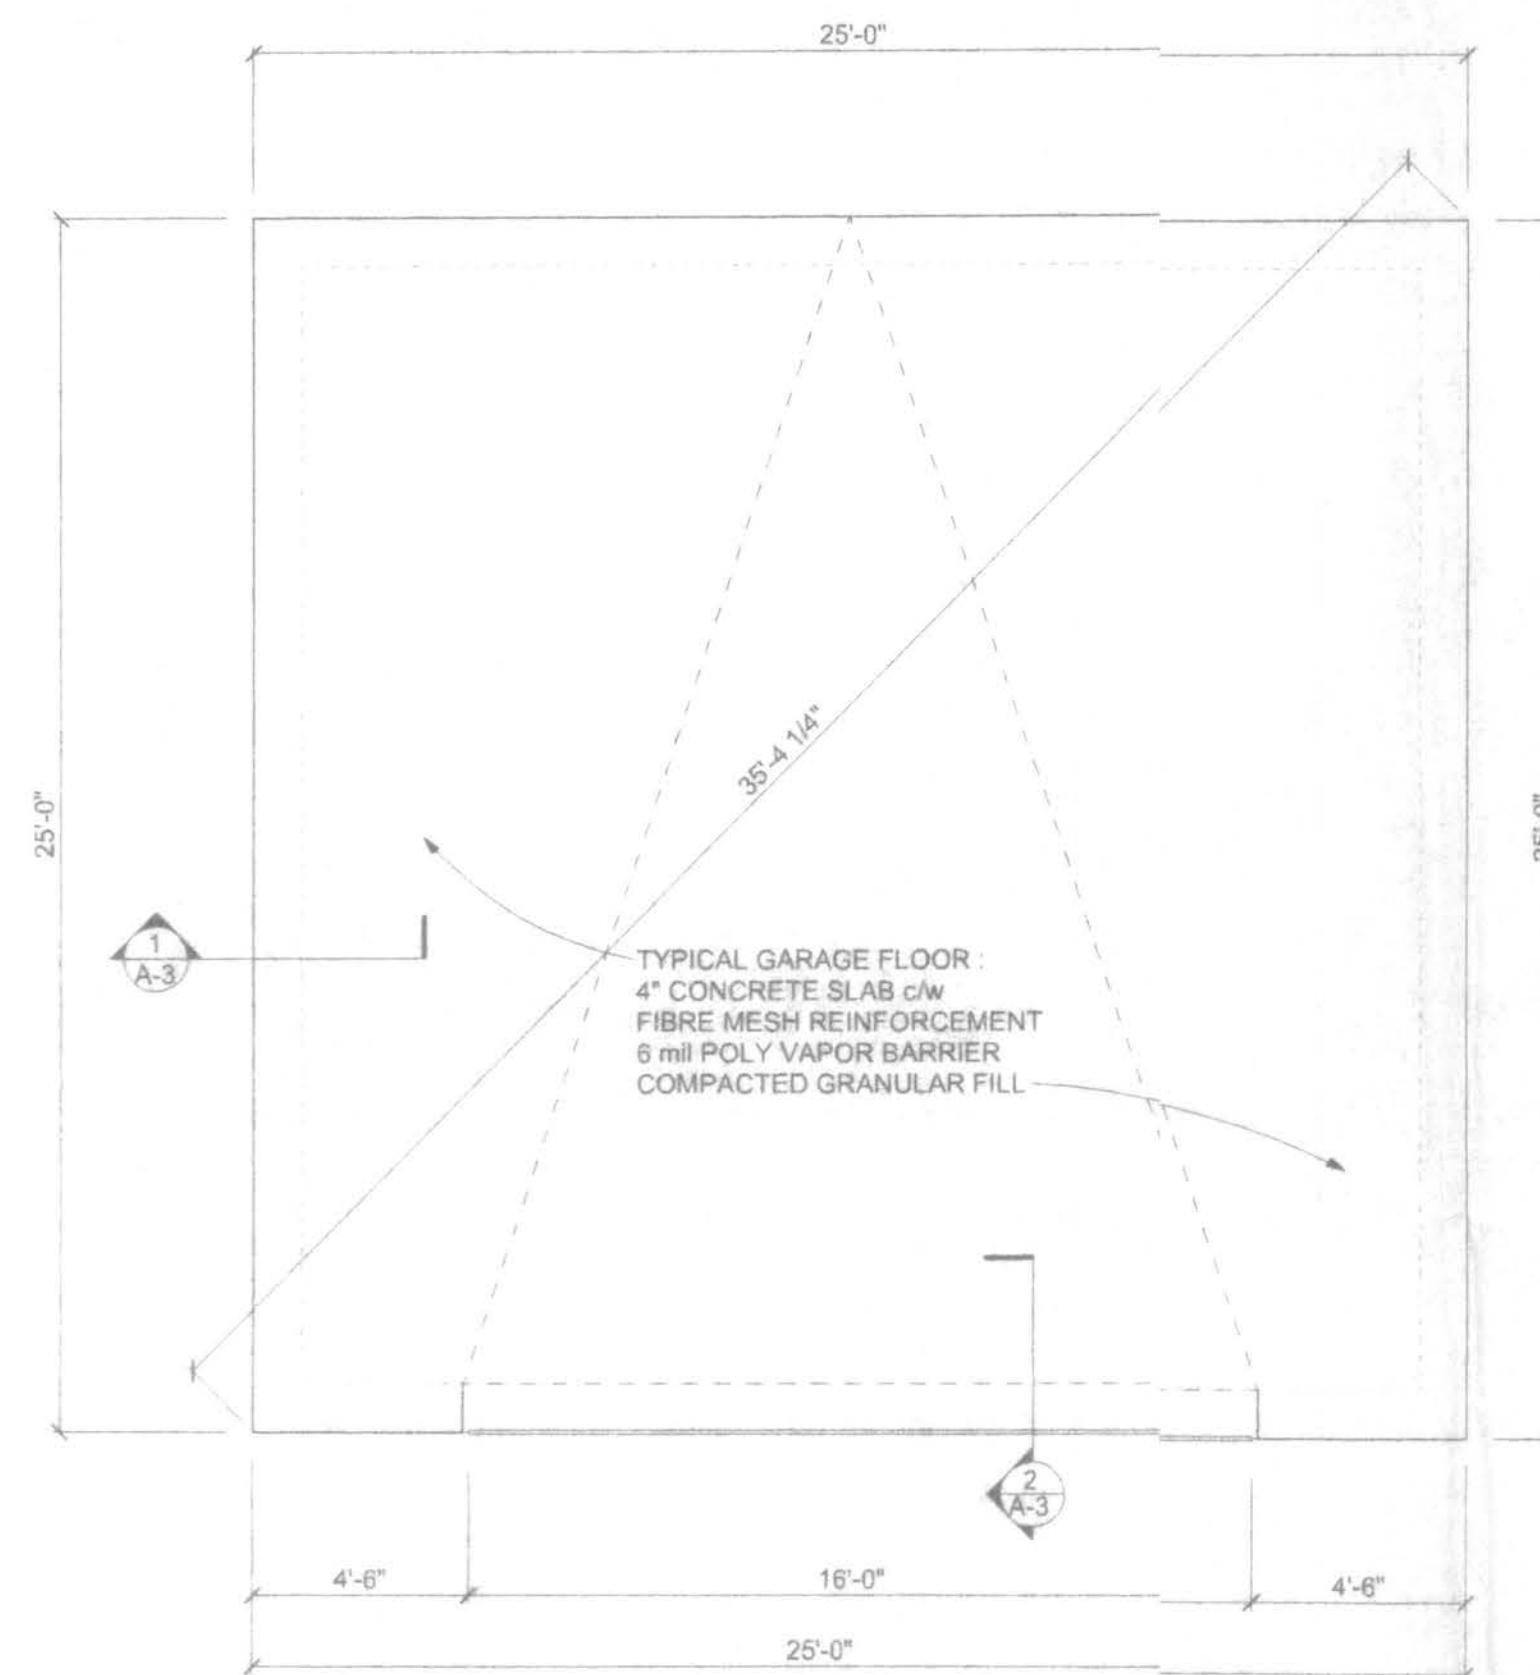

GARAGE FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES

COVER OVER REINFORCING STEEL
FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE:
3 INCHES IN FOUNDATIONS WHERE THE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH THE EARTH OR EXPOSED TO THE EARTH OR WEATHER AND 1 1/2 INCHES ELSEWHERE. REINFORCING BARS EMBEDDED IN GROUTED CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1 1/4 INCH FOR FINE GROUT OR 1/2 INCH FOR COARSE GROUT BETWEEN REINFORCING BARS AND ANY FACE OF A CELL. REINFORCING BARS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN 2 INCHES FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER 1 1/2 INCHES FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER.

CONCRETE
CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS.

GALVANIZATION
METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION AND NOT DIRECTLY EXPOSED TO THE WEATHER SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153, CLASS B-2. METAL PLATE CONNECTORS, SCREWS, BOLTS AND NAILS EXPOSED DIRECTLY TO THE WEATHER SHALL BE STAINLESS STEEL OR HOT DIPPED GALVANIZED.


REINFORCING STEEL
THE REINFORCING STEEL SHALL BE MINIMUM GRADE 40.

BEARING CAPACITY
THE FOOTING IS DESIGNED FOR SOIL WITH AN ALLOWABLE BEARING CAPACITY OF 1,000 PSF. THE FOOTINGS SHALL REST ON UNDISTURBED OR COMPACTED SOIL OF UNIFORM DENSITY AND THICKNESS. AT THE OWNER'S REQUEST, COMPACTED SOILS SHALL BE TESTED TO A MINIMUM OF 95% OF MODIFIED PROCTOR AND COMPACTED IN LIFTS NOT TO EXCEED 12 INCHES.

SLAB REQUIREMENTS

JOINTS ARE NOT REQUIRED IN UNREINFORCED PLAIN CONCRETE SLABS ON GROUND OR IN SLABS FOR ONE AND TWO FAMILY DWELLINGS COMPLYING WITH ONE OF THE FOLLOWING:

- CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTHS SHALL BE 1/2 INCH TO 12 INCHES IN LENGTH. DOSAGE AMOUNTS SHALL BE FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. SYNTHETIC FIBERS SHALL COMPLY WITH ASTM C 1116. THE MANUFACTURER OR SUPPLIER SHALL PROVIDE CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY THE BUILDING OFFICIAL, OR CONCRETE SLABS ON GROUND CONTAINING 6x6 W14 x W14 WELDED WIRE REINFORCEMENT FABRIC LOCATED IN THE MIDDLE TO THE UPPER 1/2 OF THE SLAB. WELDED WIRE REINFORCEMENT FABRIC SHALL BE SUPPORTED WITH APPROVED MATERIAL OR SUPPORTS AT SPACING NOT TO EXCEED 3 FT OR IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATION. WELDED PLAIN WIRE REINFORCEMENT FABRIC FOR CONCRETE SHALL CONFORM TO ASTM A 185, STANDARD SPECIFICATION FOR STEEL WELDED WIRE REINFORCEMENT FABRIC, PLAIN, FOR CONCRETE REINFORCEMENT.
-

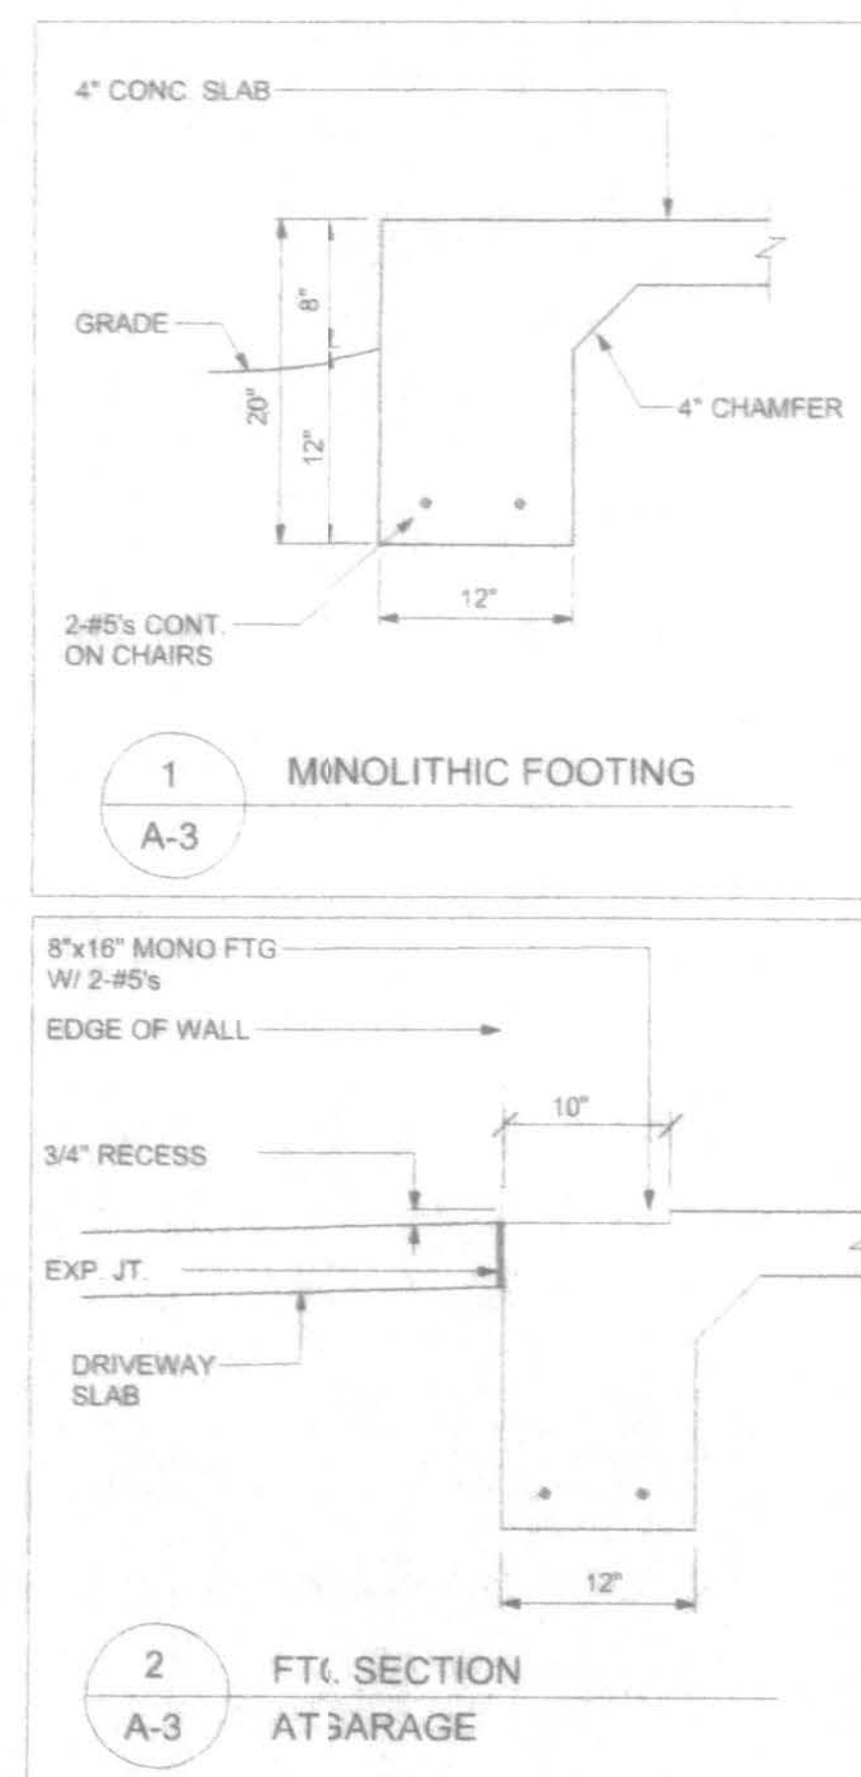


STEEL COATING RECOMMENDATIONS IN PRESSURE TREATED WOOD:


- Thicker galvanizing generally extends service life of a product. The treated wood industry recommends use of Stainless Steel and hot-dip galvanized connectors and fasteners with treated wood.
- Due to the uncertainties, which are out of the specifier's control, in regard to the chemicals used in pressure treated wood, Simpson recommends the use of stainless steel fasteners, anchors and connectors with treated wood when possible. At a minimum, customers should use ZMAX (G185 HDG per ASTM A663), Batch/Post Hot-Dip Galvanized (per ASTM A123 for connectors and ASTM A153 for fasteners), or mechanically galvanized fasteners (per ASTM B695, Class 55 or greater), product with the newer alternative treated woods.
- G60 galvanized products should not be used with treated woods.
- G90 galvanized connectors can be used with Sodium Borate (DOT - Disodium Octaborate Tetrahydrate) treated woods. Sodium Borate Treated woods are not suitable for applications where moisture exposure is likely. They are suitable for mudfill applications when transported, stored, and installed appropriately.
- When using stainless steel or hot-dip galvanized connectors, the connectors and fasteners should be made of the same material.

| Simpson Strong-Tie Product Finishes | Untreated Wood | Chromated Copper Arsenate (CCA-C) | DOT Sodium Borate (SBX) | Alkaline Copper Quat ACO-C and ACO-D (Carbonate) | Copper Azole (CBA-A and CA-B) | SBX (DOT) with NAS/O | Ammoniacal Copper Zinc Arsenate (ACZA) | Other Pressure Treated Woods |
|-------------------------------------|----------------|-----------------------------------|-------------------------|--|-------------------------------|----------------------|--|------------------------------|
| Standard (G90) | X | X | X | | | | | |
| ZMAX (G185) | X | X | X | X | X | X | | |
| Post Hot-Dip Galvanized (HDG) | X | X | X | X | X | X | X | X |
| 304/316 (Stainless Steel) | X | X | X | X | X | X | X | X |

| ROOF SHEATHING FASTENINGS | | | |
|---------------------------|-----------------------------|--|---|
| NAILING ZONE | SHEATHING TYPE | FASTENER | SPACING |
| 1 | 1/2" O.S.B. OR 15/32 CDX | 8d COMMON OR 8d HOT DIPPED GALVANIZED BOX NAILS | 6 in. o.c. EDGE 12 in. o.c. FIELD |
| 2 | | | 6 in. o.c. EDGE 6 in. o.c. FIELD |
| 3 | | | 4 in. o.c. @ GABLE ENDWALL OR GABLE TRUSS 6 in. o.c. EDGE 6 in. o.c. FIELD |

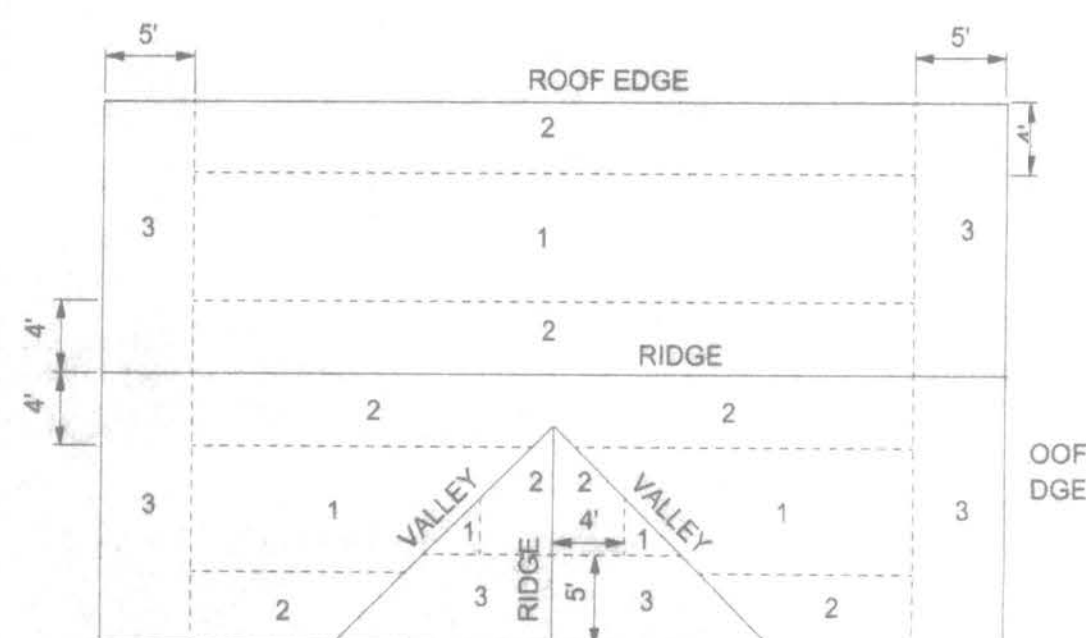

ROOF SHEATHING NAILING ZONES
(GABLE ROOF)

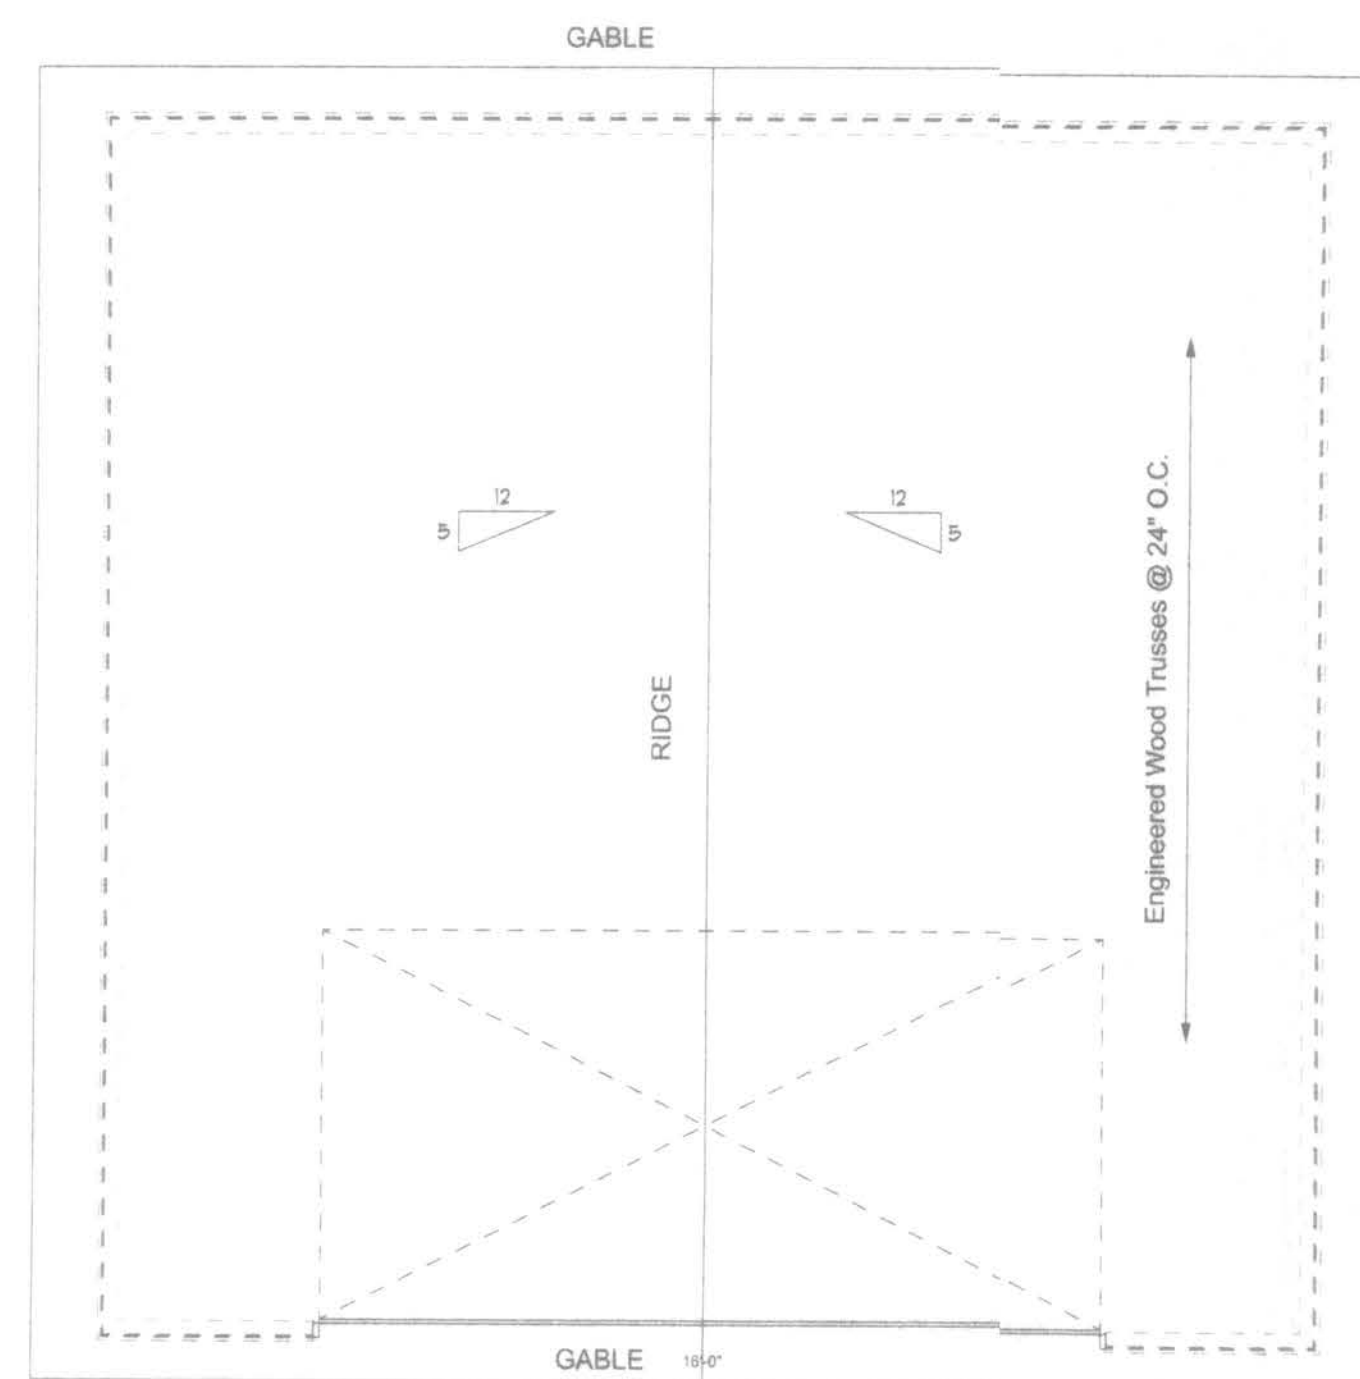

ROOF PLAN
SCALE: 1/4" = 1'-0"

NOTE: VENTILATE ROOF TO 1/300TH THE INSULATED ATTIC.
(625 SF / 300 = 2.08 SF * 144 SQ. IN./SF = 300 SQ. IN.)


SHEARWALL NOTES:

- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-89 305.4.3
- THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS
- ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING
- NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD
- TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/8 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 ie. FOR 8'-0" WALLS - (2'-3").


| OPENING WIDTH | SILL PLATES | 16d TOE NAILS EACH END |
|----------------|--------------------|------------------------|
| UP TO 6'-0" | (1) 2x4 OR (1) 2x6 | 1 |
| > 6' TO 9'-0" | (3) 2x4 OR (1) 2x6 | 2 |
| > 9' TO 12'-0" | (5) 2x4 OR (2) 2x6 | 3 |

OPENING CONNECTION REQUIREMENTS

| CLEAR OPENING WIDTH | HEADER SIZE #2 GRADE OR BETTER | END BEARING | CONNECTOR AT EACH END OF OPENING | ANCHORAGE TO FOUNDATION @ EACH END OF OPENING |
|---------------------|---------------------------------|-------------|----------------------------------|---|
| 0' - 3' | (2) 2x8 | 1.5" | N/A | N/A |
| >3' - 6' | (2) 2x10 | 3" | N/A | N/A |
| >6' - 9' | (2) 2x12 | 3" | 1/2" ALL THREAD ROD | 1/2" ALL THREAD ROD |
| >9' - 12' | (2) 1 3/4" x 11 1/4" LVL - 2.0E | 3" | 1/2" ALL THREAD ROD | 1/2" ALL THREAD ROD |
| >12' - 15' | (2) 1 3/4" x 11 1/4" LVL - 2.0E | 3" | 1/2" ALL THREAD ROD | 1/2" ALL THREAD ROD |
| >15' - 18' | (2) 1 3/4" x 11 1/4" LVL - 2.0E | 4.5" | 1/2" ALL THREAD ROD | 1/2" ALL THREAD ROD |

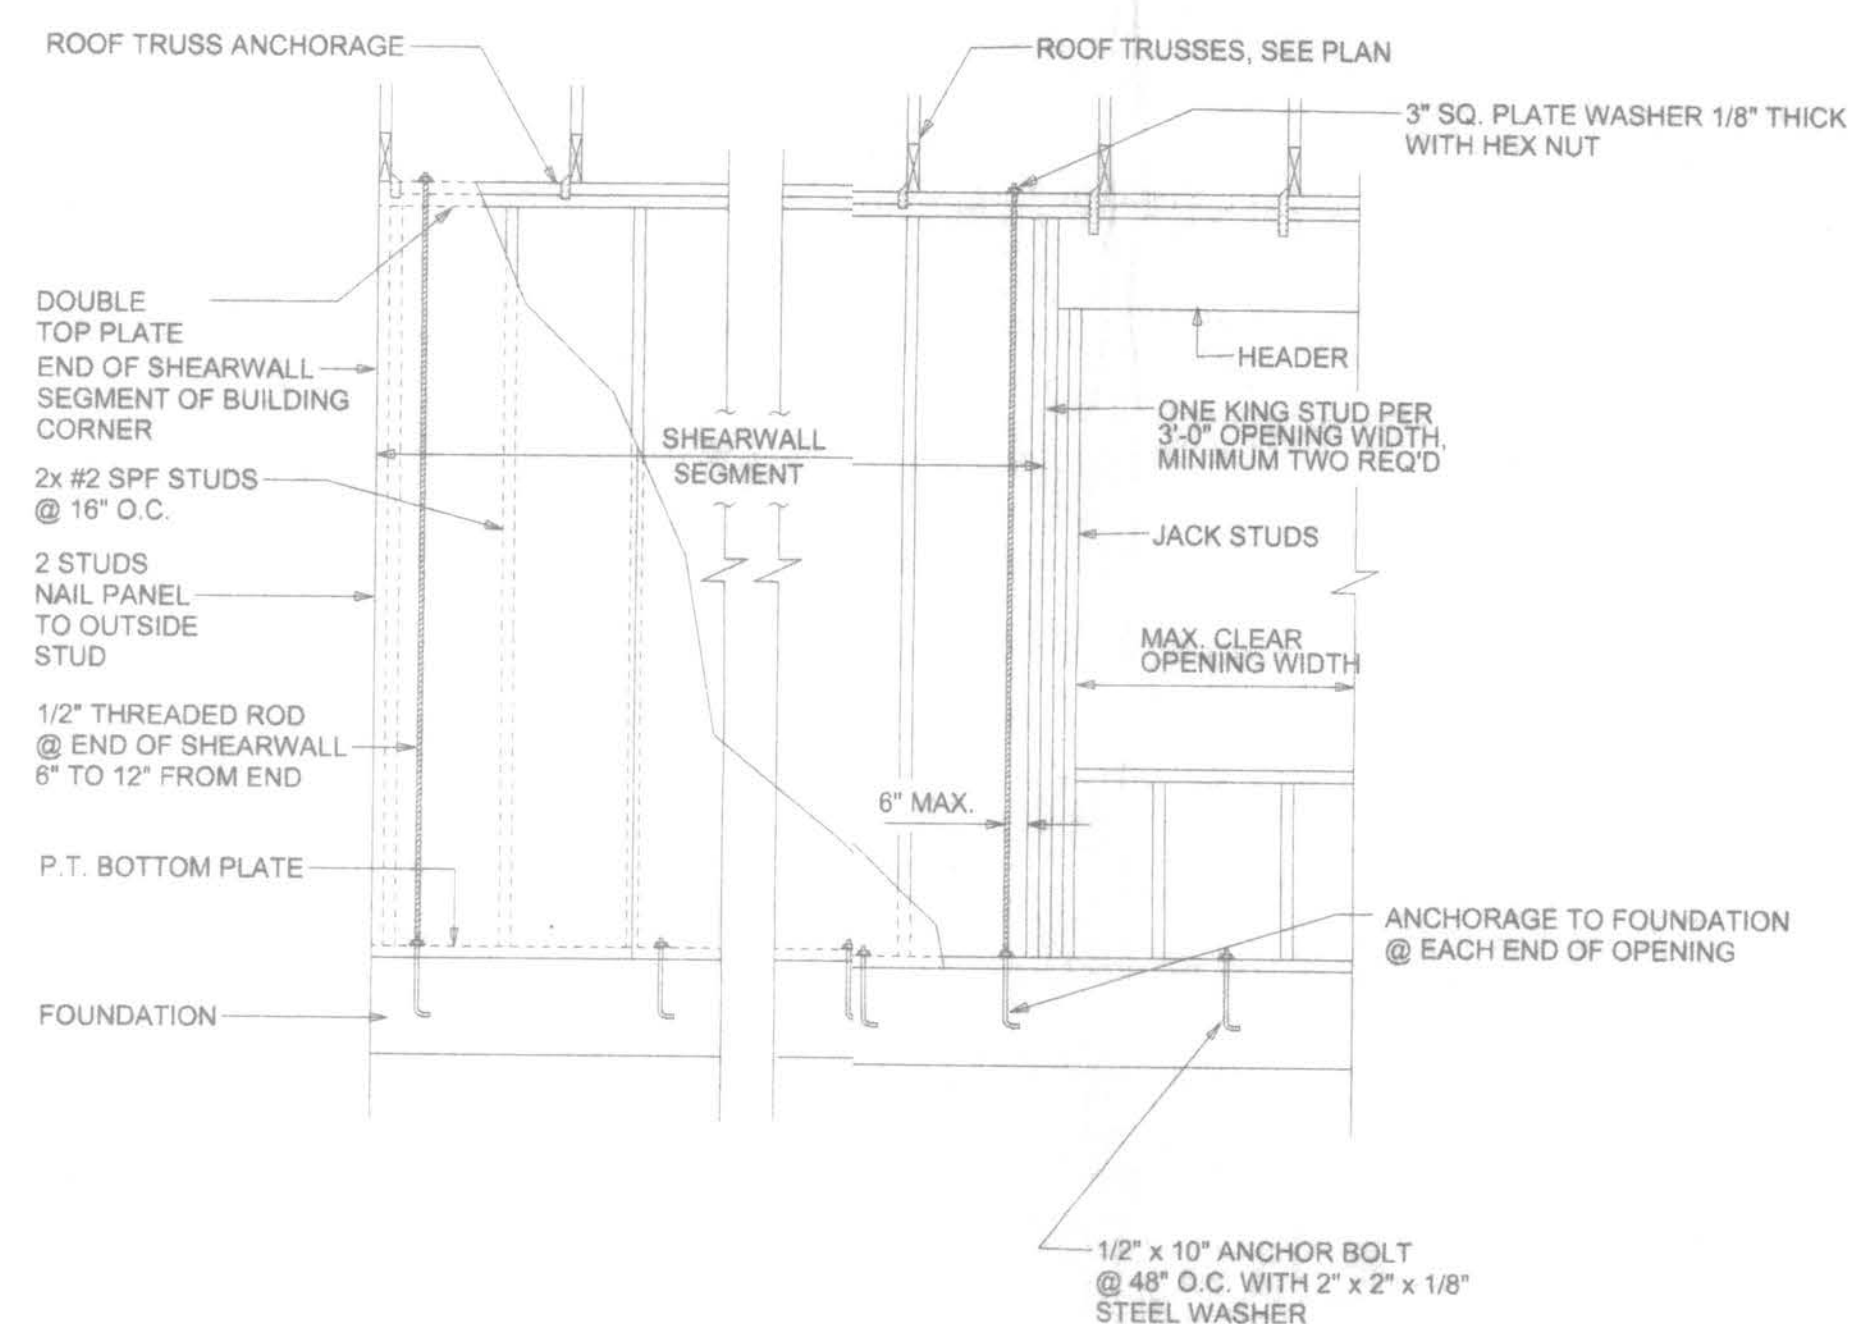

SHEARWALL DETAILS
SCALE: 1/2" = 1'-0"

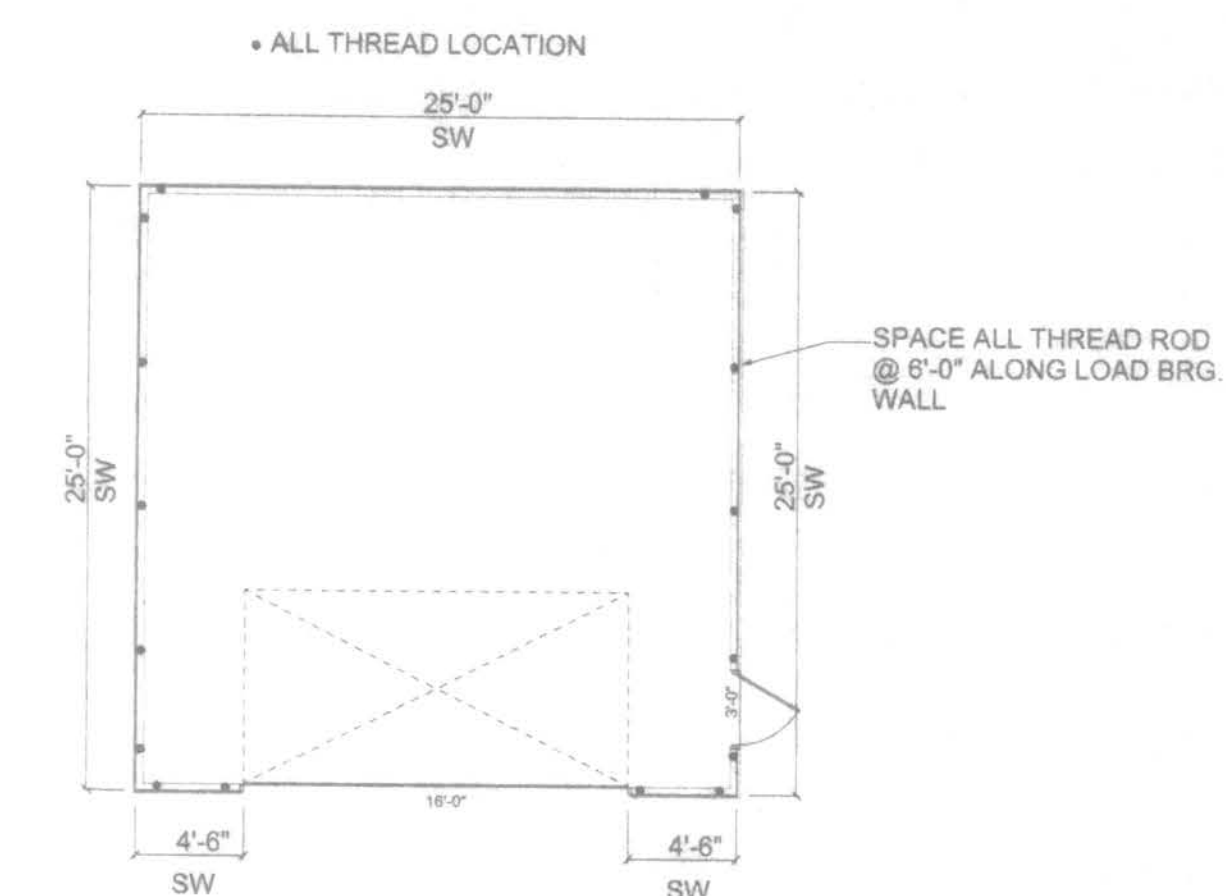


SHEARWALL DETAIL
SCALE: 1/2" = 1'-0"

HEIMSATH RESIDENCE

161 N.W. MADISON STREET
SUITE #102
LAKE CITY, FL. 32055
(386) 758-4209

CERTIFICATE OF AUTHORIZATION # 0008701



Freeman
Design Group Inc

DATE
5/206


DRAWN BY
W.H.F.

REVISIONS

SHEET A-3


OF 4

PROJECT NO.
06.R018

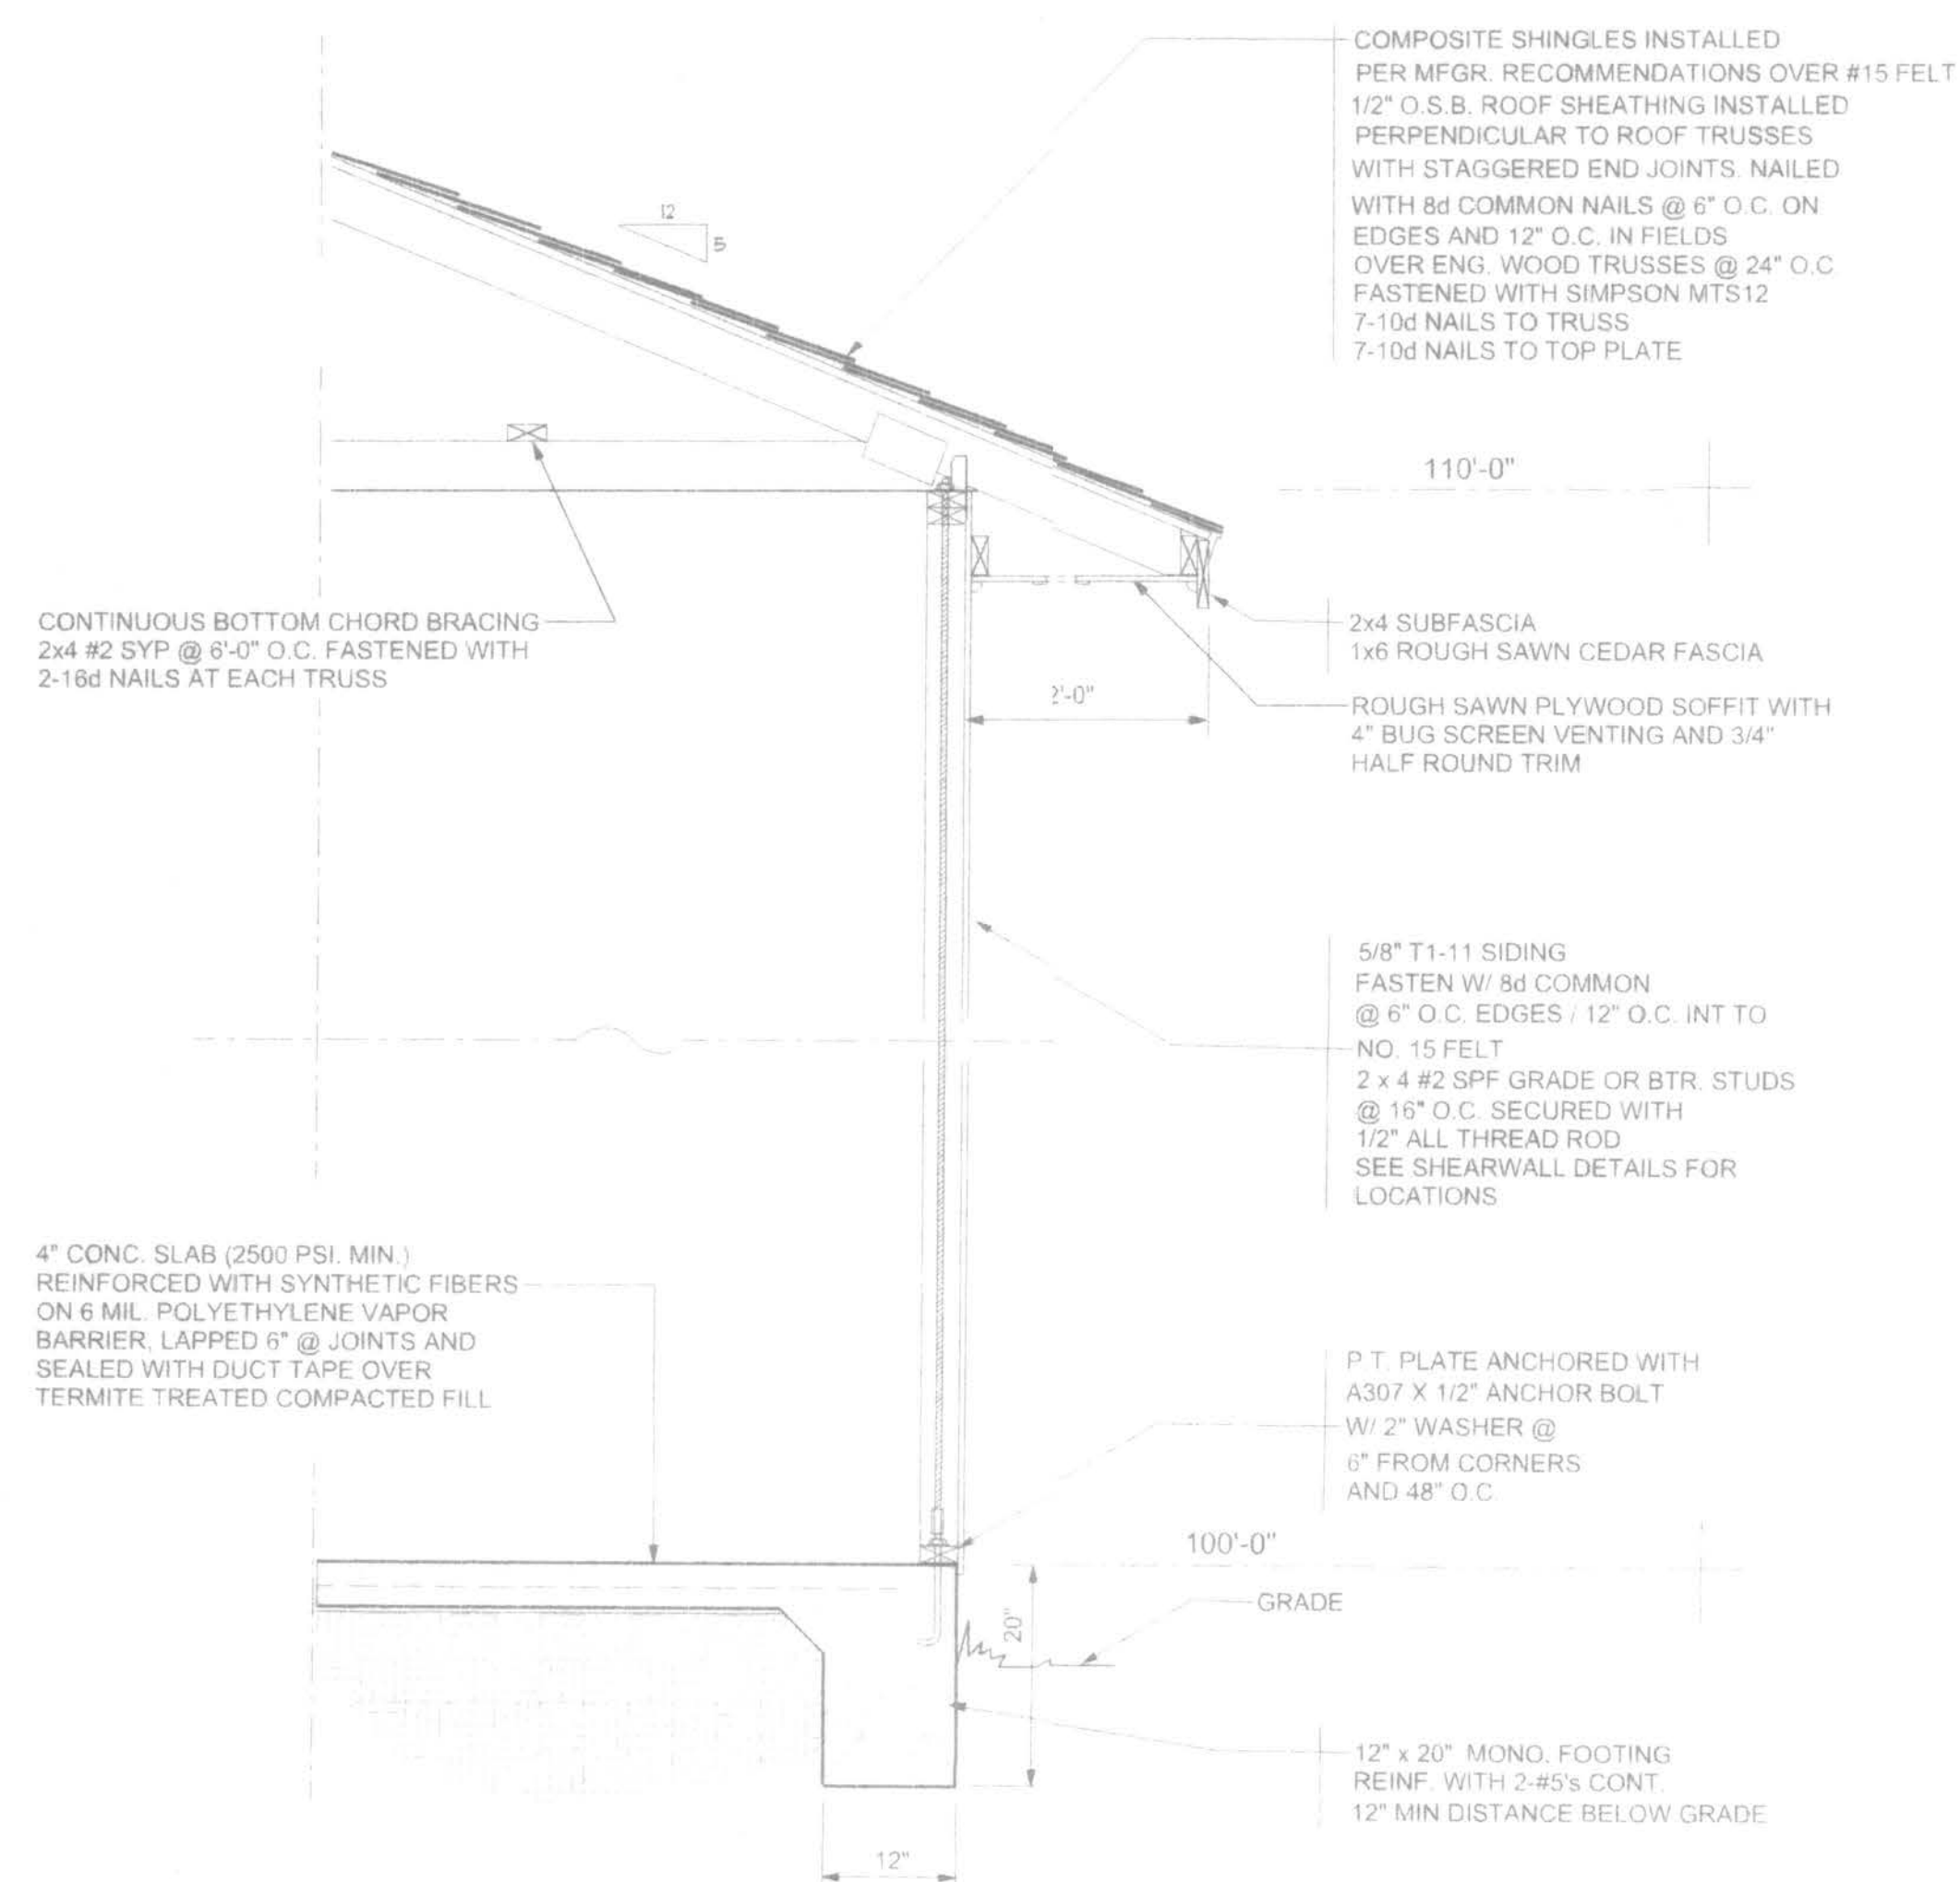


TYPICAL WALL SECTION


3/4" = 1'-0"

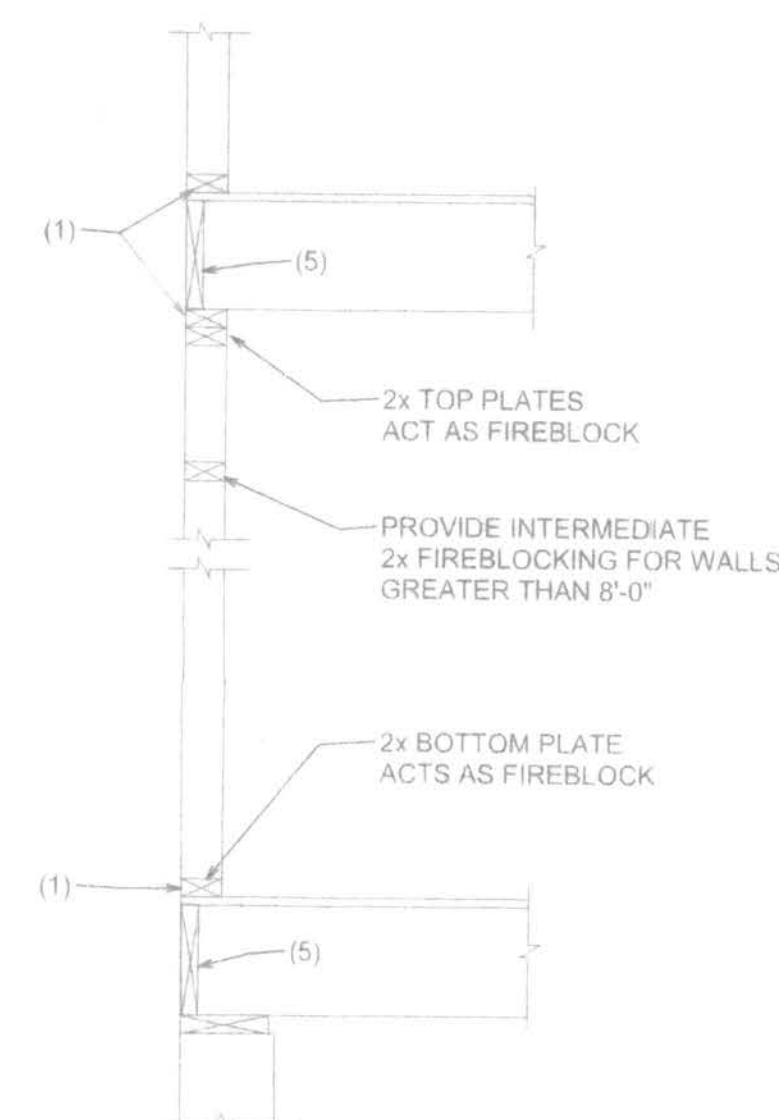

PLATFORM FRAMING

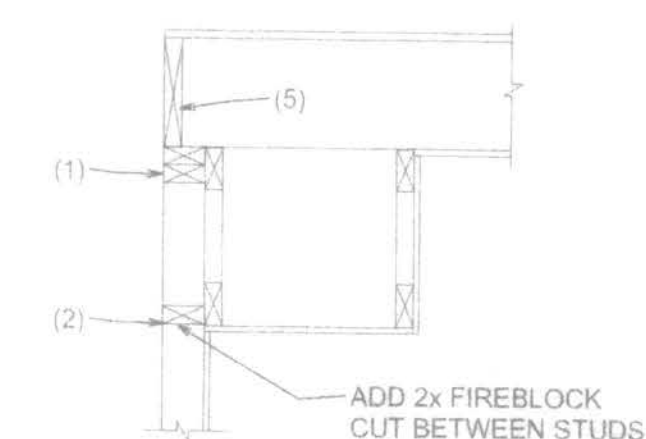


SOFFIT/DROPPED CLG.

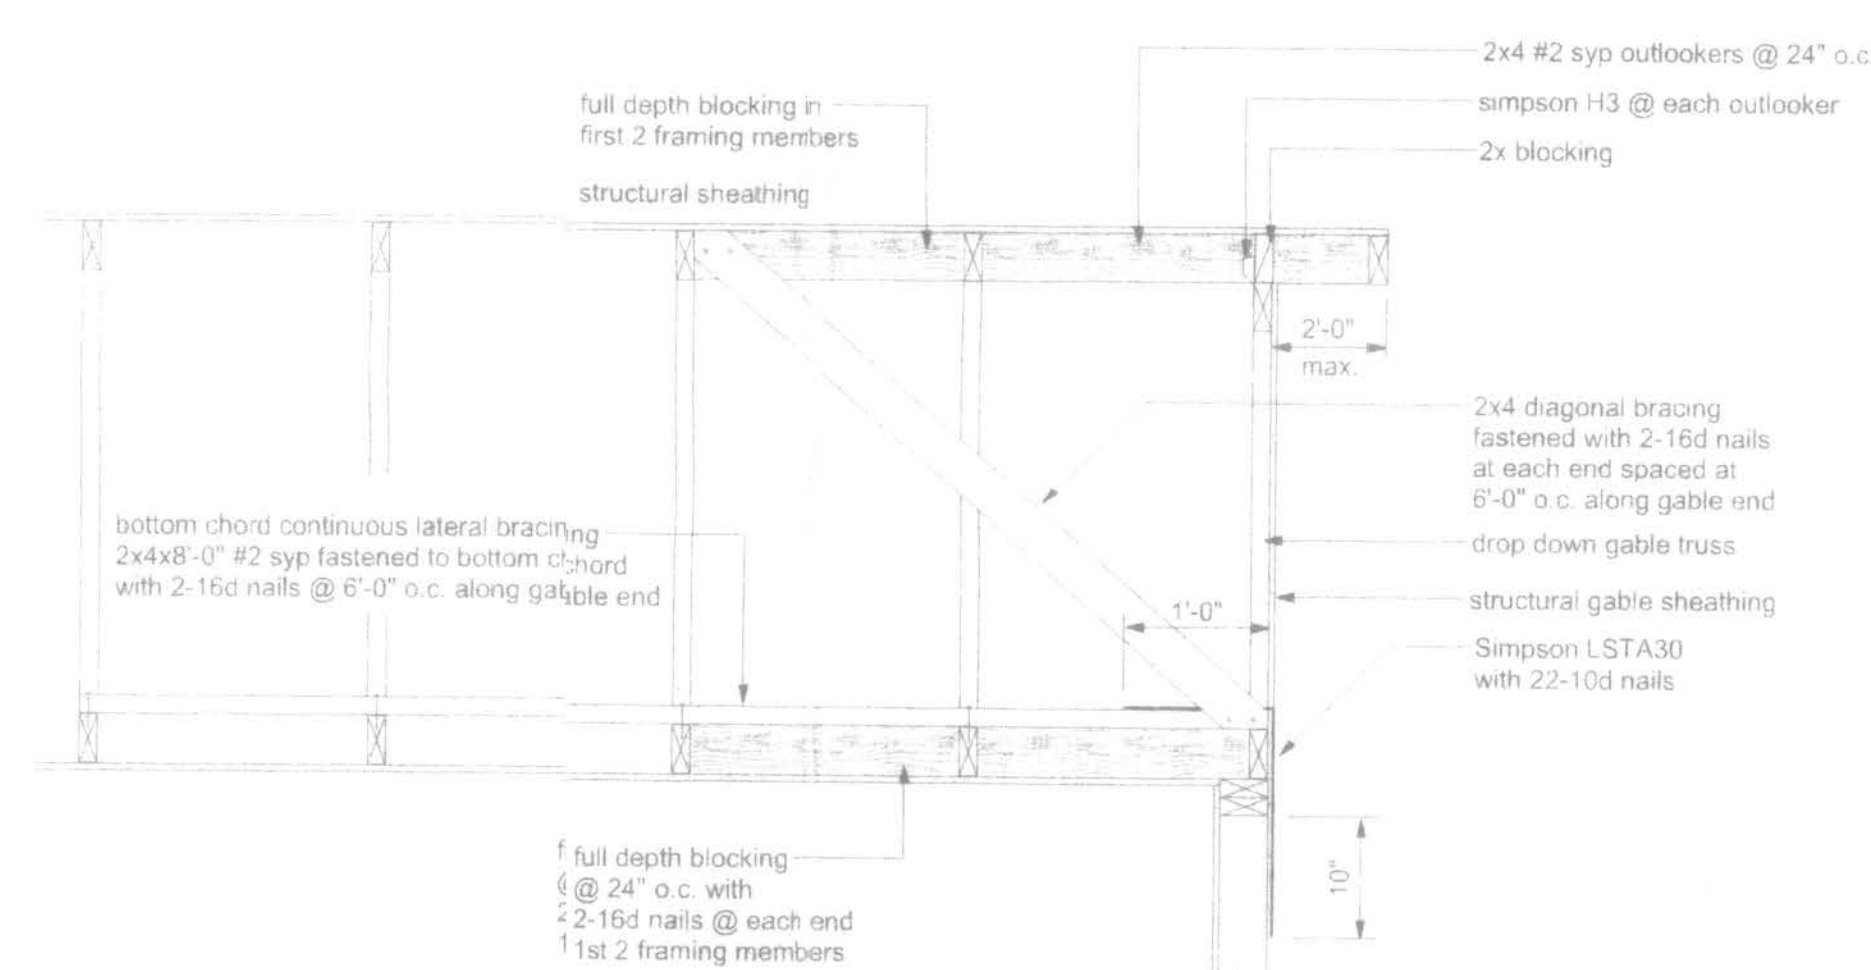

END WALL BRACING FOR CEILING DIAPHRAGM

NTS


NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

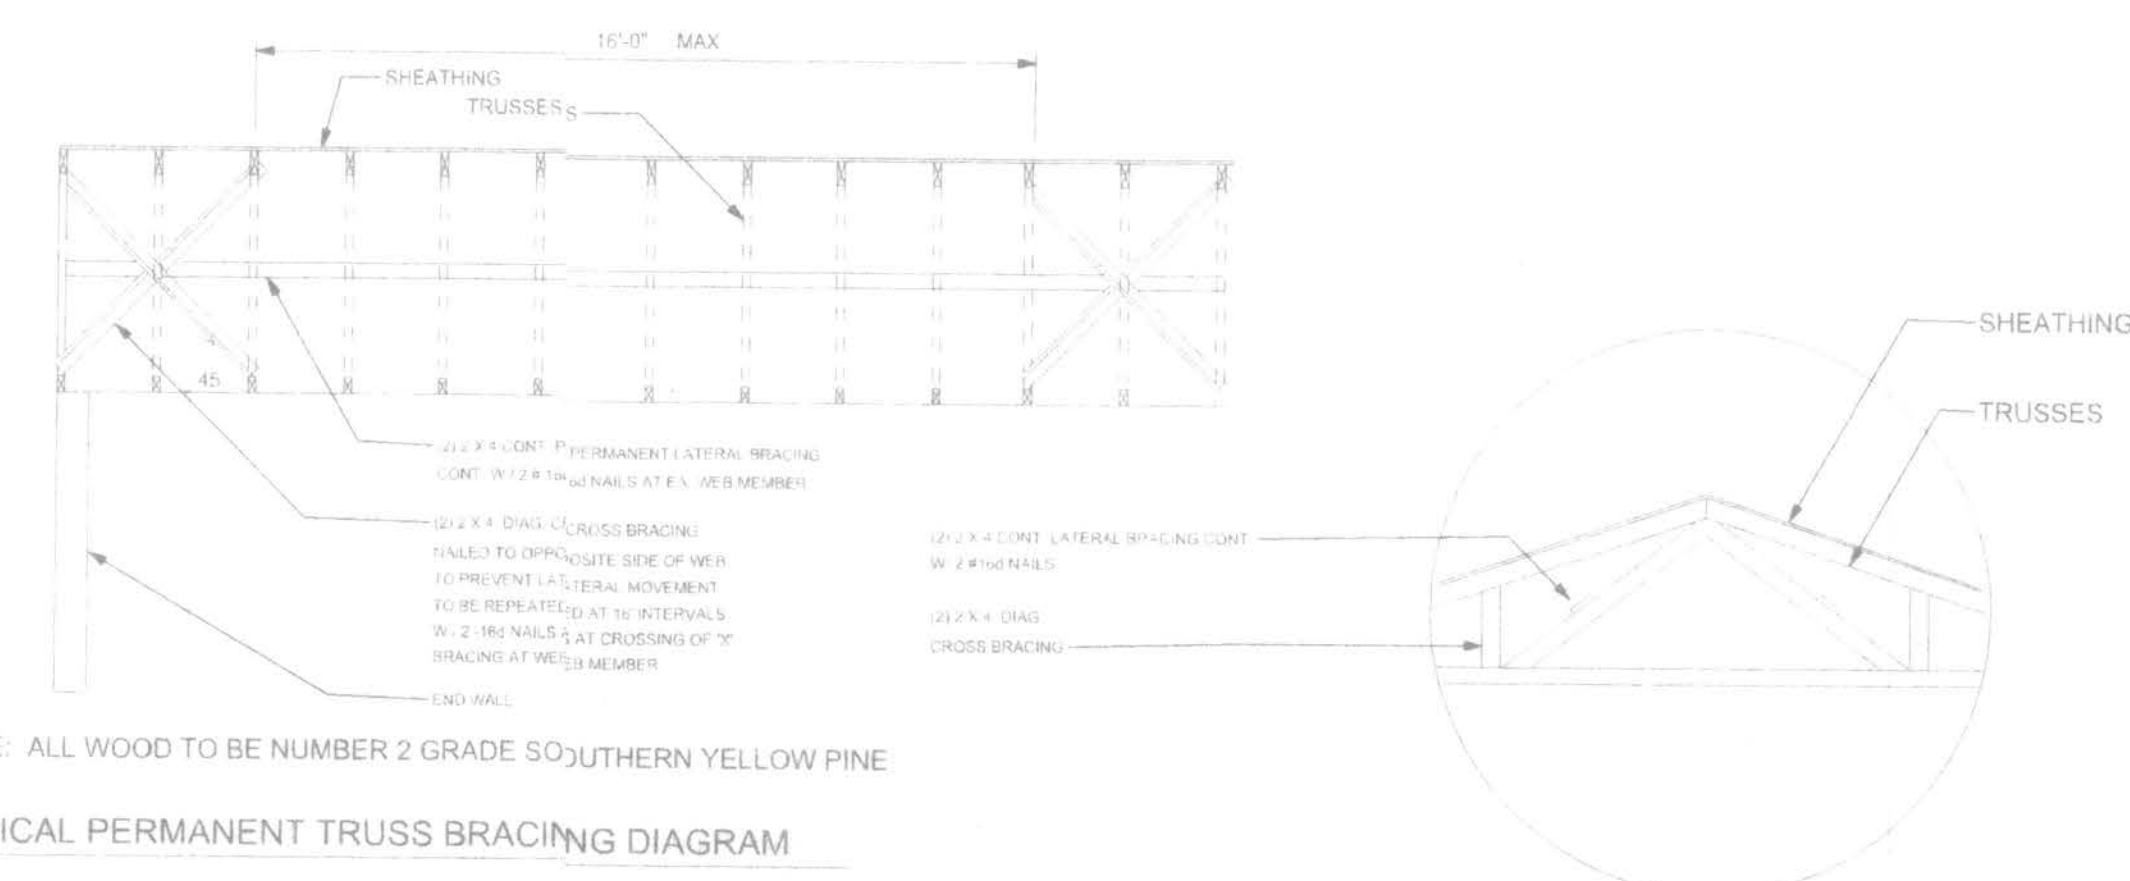

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

TYPICAL PERMANENT TRUSS BRACING DIAGRAM

NTS

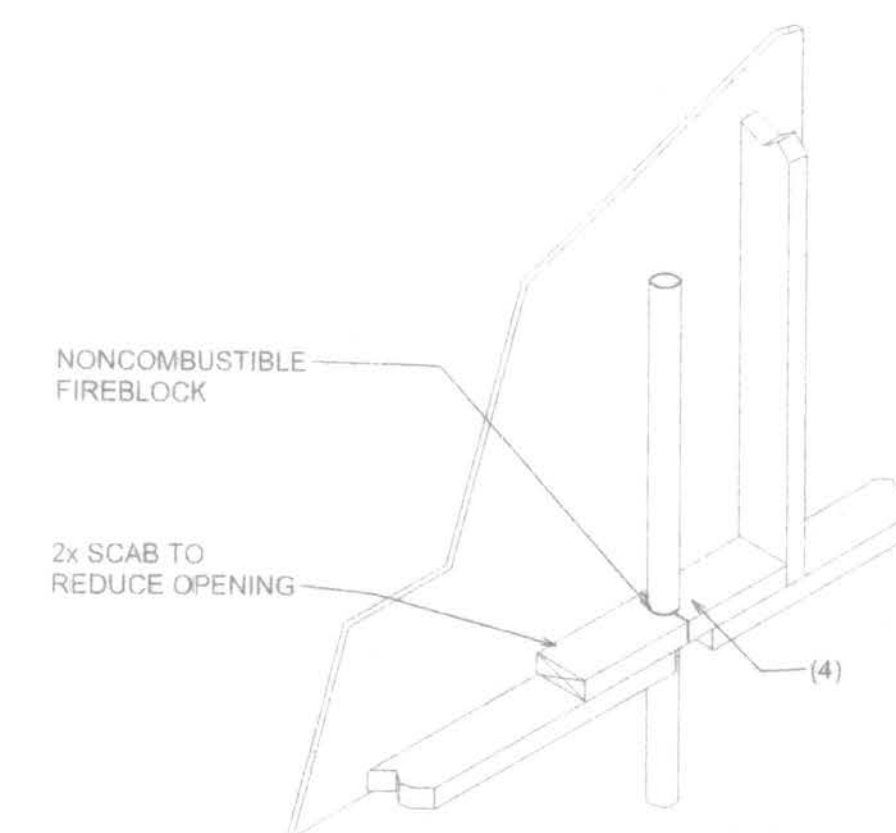

PENETRATIONS

FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:


1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
2. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
3. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN.
4. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH PYROPANEL MULTIFLEX SEALANT
5. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

W.H.F.
6/20/06

HEIMSATH RESIDENCE

161 N.W. MADISON STREET
SUITE #102
LAKE CITY, FL 32055
(386) 588-4208

CERTIFICATE OF AUTHORIZATION # 00080701



Freeman
Design Group
inc

DATE
5/2/06

DRAWN BY
W.H.F.

REVISIONS

SHEET
A-4

OF
4

PROJECT NO.
6.R018