



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
 These truss designs rely on lumber values established by others.

RE: 0126-022 - Spates

MiTek, Inc.
 16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200

Site Information:

Customer Info: SCCI Project Name: . Model: .
 Lot/Block: . Subdivision: .
 Address: ., .
 City: Lake City State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
 Address:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.8
 Wind Code: ASCE 7-22 Wind Speed: 130 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 46 individual, Truss Design Drawings and 0 Additional Drawings.
 With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T39798751	A01	1/14/26	23	T39798773	C04	1/14/26
2	T39798752	A02	1/14/26	24	T39798774	C05	1/14/26
3	T39798753	A03	1/14/26	25	T39798775	C06	1/14/26
4	T39798754	A04	1/14/26	26	T39798776	CJ01	1/14/26
5	T39798755	A05	1/14/26	27	T39798777	CJ02	1/14/26
6	T39798756	A06	1/14/26	28	T39798778	D01	1/14/26
7	T39798757	A07	1/14/26	29	T39798779	E01	1/14/26
8	T39798758	A08	1/14/26	30	T39798780	E02	1/14/26
9	T39798759	A09	1/14/26	31	T39798781	E03	1/14/26
10	T39798760	A10	1/14/26	32	T39798782	F01	1/14/26
11	T39798761	A11	1/14/26	33	T39798783	F02	1/14/26
12	T39798762	A12	1/14/26	34	T39798784	F03	1/14/26
13	T39798763	B01	1/14/26	35	T39798785	F04	1/14/26
14	T39798764	B02	1/14/26	36	T39798786	F05	1/14/26
15	T39798765	B03	1/14/26	37	T39798787	H01	1/14/26
16	T39798766	B04	1/14/26	38	T39798788	H02	1/14/26
17	T39798767	B05	1/14/26	39	T39798789	J01	1/14/26
18	T39798768	B06	1/14/26	40	T39798790	J01A	1/14/26
19	T39798769	B07	1/14/26	41	T39798791	J01B	1/14/26
20	T39798770	C01	1/14/26	42	T39798792	J02	1/14/26
21	T39798771	C02	1/14/26	43	T39798793	J03	1/14/26
22	T39798772	C03	1/14/26	44	T39798794	J03A	1/14/26

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Mayo Truss Company, Inc..

Truss Design Engineer's Name: Lee, Julius
 My license renewal date for the state of Florida is February 28, 2027.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026



RE: 0126-022 - Spates

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: SCCI Project Name: . Model: .
Lot/Block: . Subdivision: .
Address: ., .
City: Lake City State: FL


No.	Seal#	Truss Name	Date
45	T39798795	J04	1/14/26
46	T39798796	J06	1/14/26

Job 0126-022	Truss A01	Truss Type Half Hip Girder	Qty 1	Ply 2	Spates Job Reference (optional)	T39798751
-----------------	--------------	-------------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:46:56
 ID:dYVoVe7rFaHYN7jpqJhivlvzk6E-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?z

Page: 1

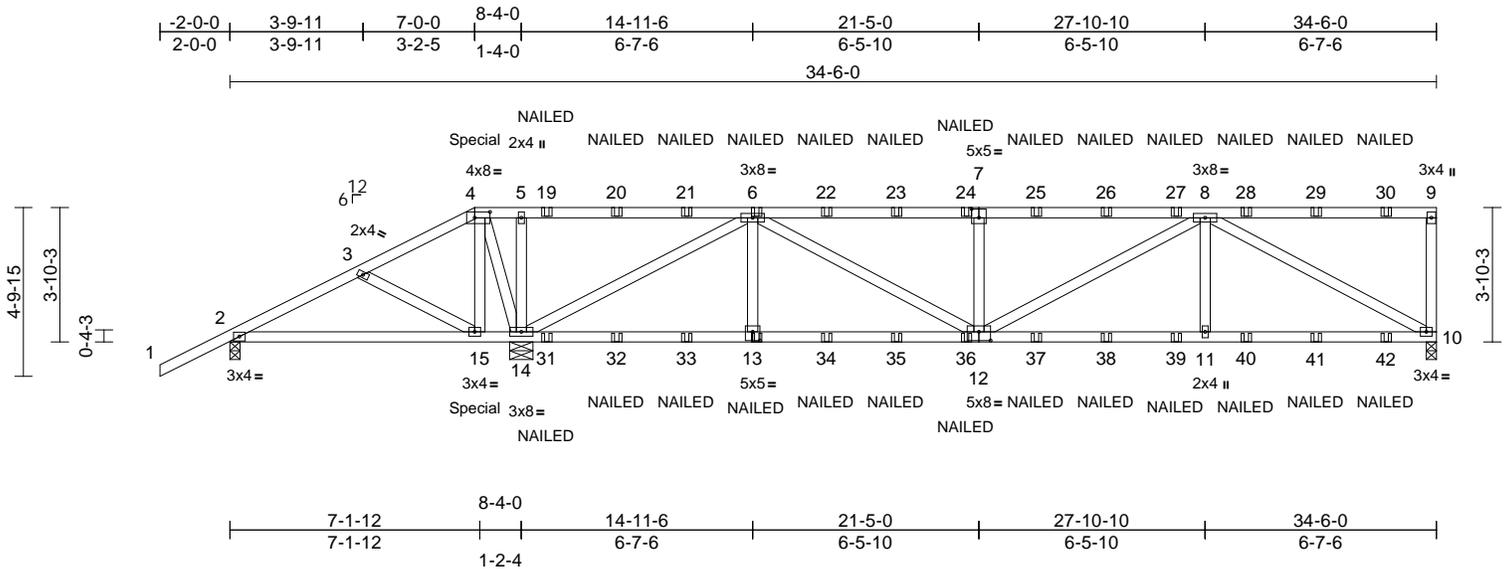

Scale = 1:65.6

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [7:0-2-8,0-3-0], [12:0-4-0,0-3-0], [13:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.69	Vert(LL)	-0.08	11-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	-0.18	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.04	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS								
											Weight: 377 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 10=0-3-8, 14=0-8-0
 Max Horiz 2=120 (LC 7)
 Max Uplift 2=621 (LC 20), 10=205 (LC 8), 14=530 (LC 8)
 Max Grav 2=55 (LC 5), 10=1968 (LC 14), 14=4401 (LC 13)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-3=-175/1672, 3-4=-193/1890, 4-5=-231/2094, 5-6=-231/2094, 6-8=-3283/373, 8-9=-104/43, 9-10=-335/114
 BOT CHORD 2-15=-1497/140, 14-15=-1683/191, 11-14=-306/2799, 10-11=-306/2799
 WEBS 4-15=-120/411, 4-14=-1253/236, 5-14=-823/276, 6-14=-4275/458, 6-13=0/536, 6-12=-197/1789, 7-12=-789/276, 8-12=-52/533, 8-11=0/568, 8-10=-3094/326, 3-15=-312/74

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 205 lb uplift at joint 10, 621 lb uplift at joint 2 and 530 lb uplift at joint 14.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 245 lb down and 130 lb up at 7-0-0 on top chord, and 404 lb down at 7-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

Concentrated Loads (lb)
 Vert: 4=-169 (B), 15=-306 (B), 6=-121 (B), 13=-59 (B), 19=-121 (B), 20=-121 (B), 21=-121 (B), 22=-121 (B), 23=-121 (B), 24=-121 (B), 25=-121 (B), 26=-121 (B), 27=-121 (B), 28=-121 (B), 29=-121 (B), 30=-121 (B), 31=-59 (B), 32=-59 (B), 33=-59 (B), 34=-59 (B), 35=-59 (B), 36=-59 (B), 37=-59 (B), 38=-59 (B), 39=-59 (B), 40=-59 (B), 41=-59 (B), 42=-59 (B)

- NOTES**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (lb/ft)
 Vert: 1-4=-60, 4-9=-60, 10-16=-20



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss A02	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798752
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:46:58
ID:q9dzcdQ1t32hRnhjuhzI0DzvkVh-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRCDoi7J4zJC?f

Page: 1

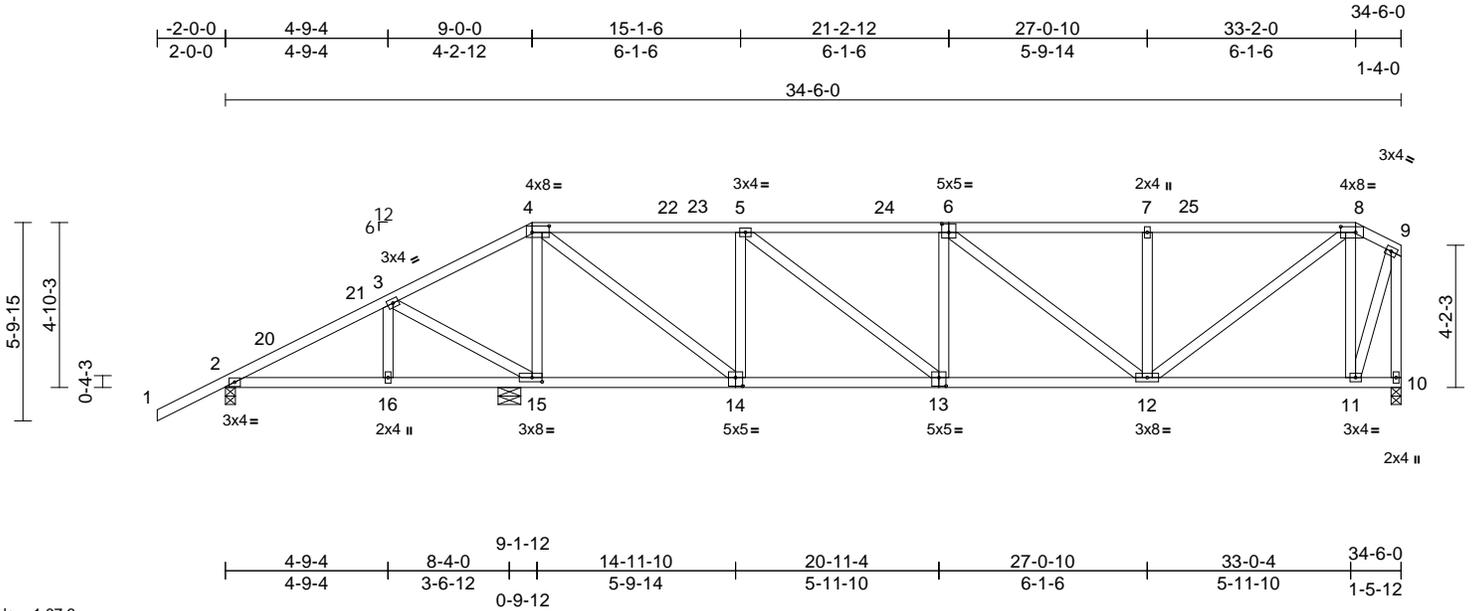

Scale = 1:67.3

Plate Offsets (X, Y): [4:0-6-0,0-2-4], [6:0-2-8,0-3-0], [8:0-5-4,0-2-0], [13:0-2-8,0-3-0], [14:0-2-8,0-3-0], [15:0-3-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.35	Vert(LL)	-0.05	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.40	Vert(CT)	-0.12	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.01	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 204 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 10=0-3-8, 15=0-8-0
Max Horiz 2=142 (LC 11)
Max Uplift 2=-123 (LC 12), 15=-84 (LC 12)
Max Grav 2=198 (LC 23), 10=909 (LC 24), 15=1773 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-51/407, 3-4=-120/681, 4-5=-620/67, 5-7=-1133/78, 7-8=-1044/78, 8-9=-300/77, 9-10=-913/21
BOT CHORD 2-16=-343/74, 15-16=-343/0, 12-15=-605/1150, 11-12=-51/258, 10-11=-54/64
WEBS 3-15=-392/191, 4-15=-1474/139, 8-11=-719/119, 9-11=-41/851, 3-16=-66/180, 5-14=-785/97, 4-14=-32/1484, 5-13=-21/638, 6-13=-272/84, 6-12=-134/0, 7-12=-380/92, 8-12=-8/980

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-5-6, Zone1 1-5-6 to 9-0-0, Zone2 9-0-0 to 13-10-9, Zone1 13-10-9 to 33-2-0, Zone3 33-2-0 to 34-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 2 and 84 lb uplift at joint 15.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES
1) Unbalanced roof live loads have been considered for this design.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss A04	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798754
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:46:58
 ID:PIJgGog0vWwmDZb4G15P?8zvkc_-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

Page: 1

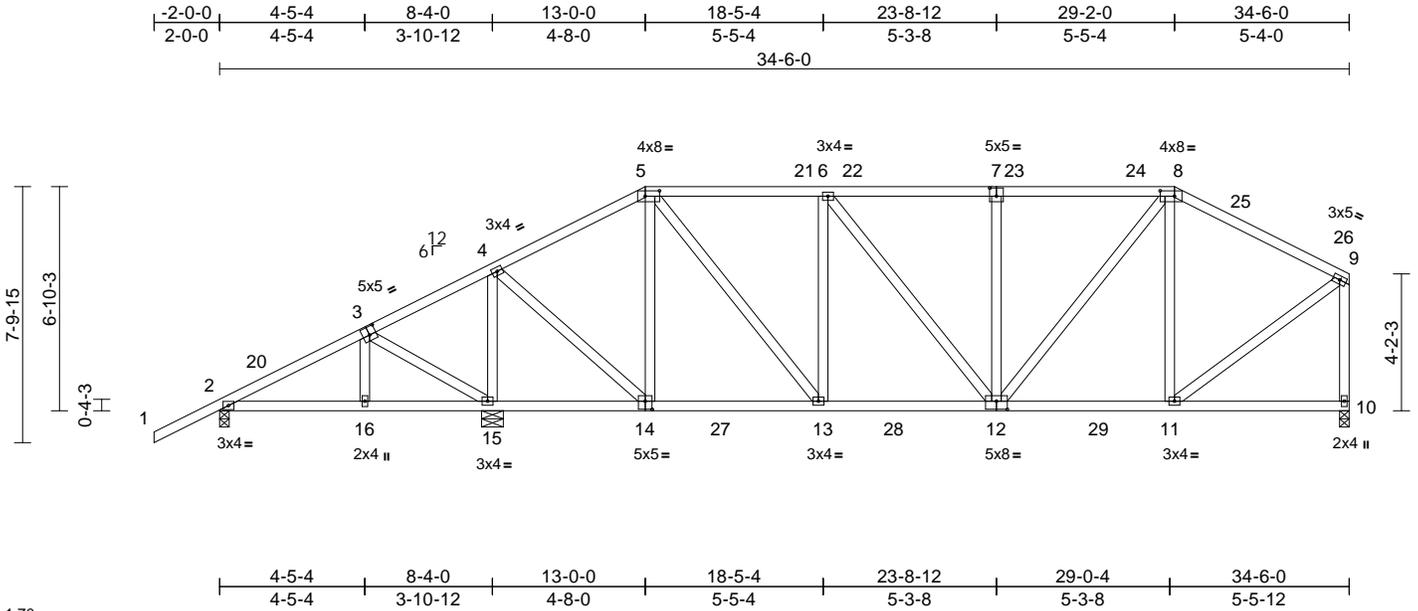

Scale = 1:70
 Plate Offsets (X, Y): [3:0-2-8,0-3-0], [5:0-5-4,0-2-0], [7:0-2-8,0-3-0], [8:0-5-4,0-2-0], [12:0-4-0,0-3-0], [14:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.27	Vert(LL)	-0.05	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.38	Vert(CT)	-0.09	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.43	Horz(CT)	0.02	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 221 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 10=0-3-8, 15=0-8-0
 Max Horiz 2=178 (LC 11)
 Max Uplift 2=-115 (LC 12), 15=-78 (LC 12)
 Max Grav 2=329 (LC 23), 10=1134 (LC 18), 15=1734 (LC 17)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-4=-117/393, 4-5=-698/90, 5-6=-1048/115, 6-8=-1104/115, 8-9=-923/101, 9-10=-1052/64
 BOT CHORD 2-16=-134/81, 15-16=-131/53, 13-15=-320/583, 11-13=-62/1045, 10-11=-45/64
 WEBS 3-15=-373/144, 4-15=-1432/144, 4-14=-41/1127, 5-14=-558/94, 8-11=-356/88, 9-11=-24/895, 3-16=-62/169, 6-13=-412/85, 5-13=-27/751, 6-12=-19/90, 7-12=-338/80, 8-12=-5/550

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-5-6, Zone1 1-5-6 to 13-0-0, Zone2 13-0-0 to 17-10-9, Zone1 17-10-9 to 29-2-0, Zone2 29-2-0 to 34-0-9, Zone1 34-0-9 to 34-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 115 lb uplift at joint 2 and 78 lb uplift at joint 15.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES
 1) Unbalanced roof live loads have been considered for this design.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss A05	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798755
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:46:59
 ID:PINXOR5LvyCxloBcFAiONJzvKBS-RfC?PsB70Hq3NSgPqnl8w3uITxBGKWrCDoi7J4zJC7f

Page: 1

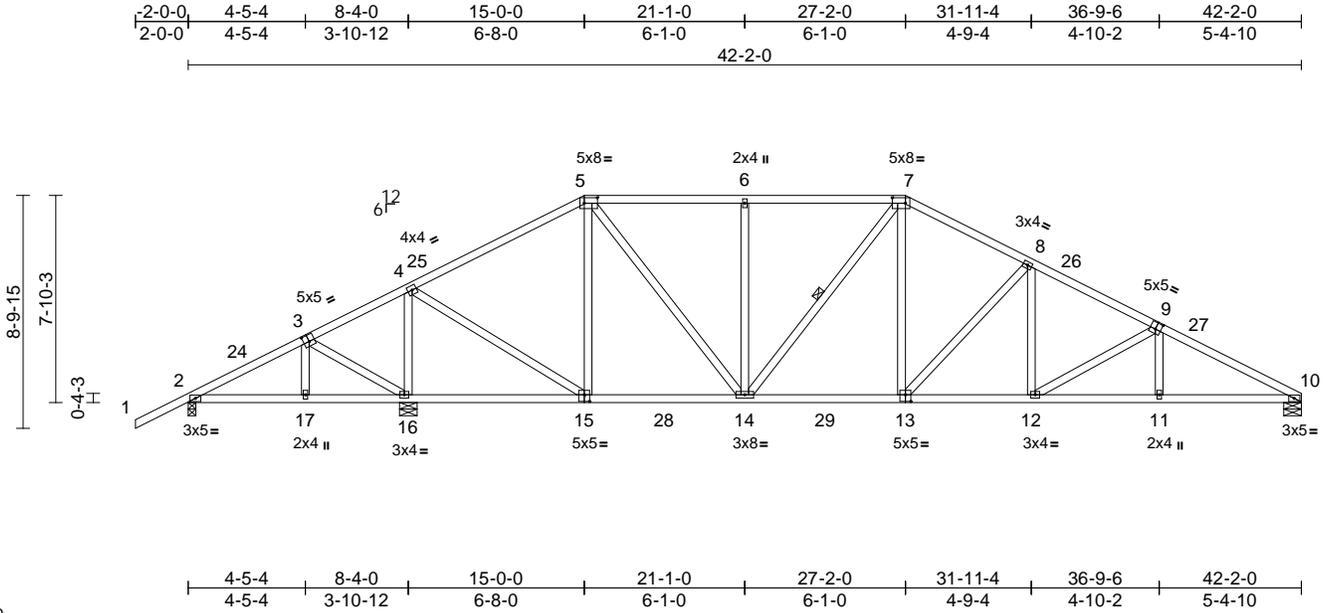

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.47	Vert(LL)	-0.13	13-14	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.64	Vert(CT)	-0.24	13-14	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.06	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 249 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.
 WEBS 1 Row at midpt 7-14

REACTIONS (size) 2=0-3-8, 10=0-8-0, 16=0-8-0
 Max Horiz 2=151 (LC 11)
 Max Uplift 2=119 (LC 12), 16=73 (LC 12)
 Max Grav 2=211 (LC 23), 10=1464 (LC 18), 16=2305 (LC 17)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-4=-58/811, 4-5=-984/101, 5-6=-1419/141, 6-7=-1419/141, 7-8=-1817/141, 8-10=-2784/120
 BOT CHORD 2-17=-490/74, 16-17=-493/0, 14-16=-704/837, 12-14=0/1975, 11-12=-35/2442, 10-11=-33/2448
 WEBS 3-16=-336/135, 4-16=-1972/147, 4-15=-17/1711, 5-15=-682/91, 5-14=-41/987, 6-14=-404/96, 7-14=-263/11, 7-13=0/718, 3-17=-71/151, 8-13=-660/77, 8-12=0/422, 9-12=-540/60, 9-11=0/211

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=42ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 2-2-10, Zone1 2-2-10 to 15-0-0, Zone2 15-0-0 to 21-1-0, Zone1 21-1-0 to 27-2-0, Zone2 27-2-0 to 33-1-9, Zone1 33-1-9 to 42-2-0 zone; cantilever left and right exposed ; end vertical left and right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 119 lb uplift at joint 2 and 73 lb uplift at joint 16.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES
 1) Unbalanced roof live loads have been considered for this design.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss A09	Truss Type Common	Qty 4	Ply 1	Spates Job Reference (optional)	T39798759
-----------------	--------------	----------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:00
ID:VQ6JMJkIKFos4SQibf7kIVzvK81-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

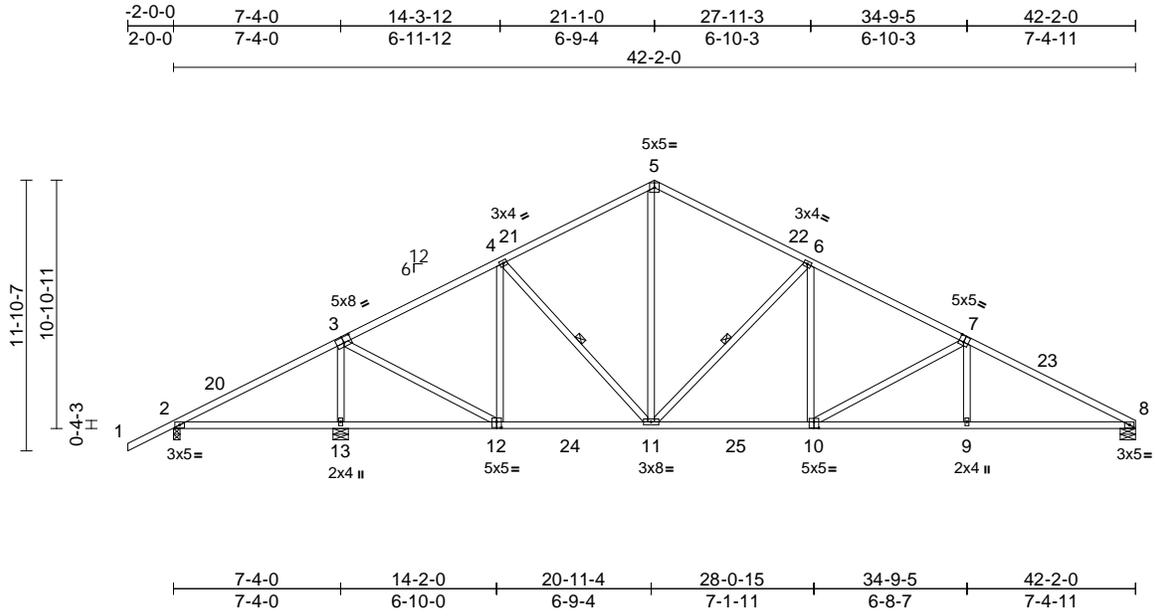

Scale = 1:100.5

Plate Offsets (X, Y): [3:0-4-0,0-3-0], [7:0-2-8,0-3-4], [10:0-2-8,0-3-4], [12:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.60	Vert(LL)	0.09	13-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.84	Vert(CT)	-0.30	10-11	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.81	Horz(CT)	0.07	8	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 233 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-11, 6-11

REACTIONS

(size) 2=0-3-8, 8=0-8-0, 13=0-8-0
Max Horiz 2=207 (LC 11)
Max Uplift 2=-122 (LC 12), 13=-50 (LC 12)
Max Grav 2=224 (LC 23), 8=-1523 (LC 18),
13=2308 (LC 17)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-4=-1173/810, 4-5=-1357/189,
5-6=-1325/193, 6-8=-2784/163
BOT CHORD 2-13=-678/103, 11-13=-636/1051,
9-11=-49/2429, 8-9=-50/2435
WEBS 3-13=-2069/134, 5-11=-30/794, 4-11=-11/298,
4-12=-611/90, 3-12=0/1721, 6-11=-996/108,
6-10=0/658, 7-10=-776/102, 7-9=0/294

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft;
B=45ft; L=42ft; eave=5ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -2-0-0 to 2-2-10,
Zone1 2-2-10 to 21-1-0, Zone2 21-1-0 to 27-0-9, Zone1
27-0-9 to 42-2-0 zone; cantilever left and right exposed ;
end vertical left and right exposed; porch left exposed;C-
C for members and forces & MWFRS for reactions
shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 122 lb uplift at joint 2 and 50 lb uplift at joint 13.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss A10	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798760
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:01
 ID:vYr1zBwccSc08lpFxlQllzvK7S-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?F

Page: 1

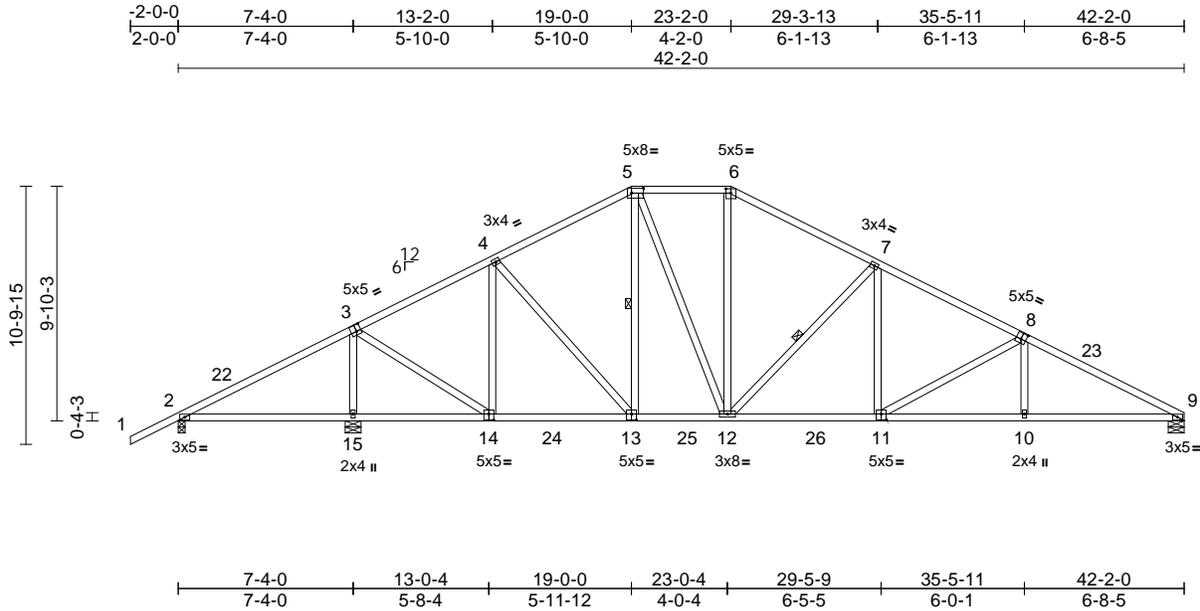

Scale = 1:96.1

Plate Offsets (X, Y): [3:0-2-4,0-3-4], [5:0-6-0,0-2-8], [6:0-2-8,0-2-4], [8:0-2-8,0-3-0], [11:0-2-8,0-3-0], [13:0-2-8,0-3-0], [14:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.57	Vert(LL)	0.09	15-18	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.78	Vert(CT)	-0.28	11-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.58	Horz(CT)	0.07	9	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 252 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.
 WEBS 1 Row at midpt 5-13, 7-12

REACTIONS (size) 2=0-3-8, 9=0-8-0, 15=0-8-0
 Max Horiz 2=188 (LC 11)
 Max Uplift 2=-124 (LC 12), 15=-48 (LC 12)
 Max Grav 2=217 (LC 23), 9=1533 (LC 18), 15=2308 (LC 17)


FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-4=-1041/797, 4-5=-1347/163, 5-6=-1331/176, 6-7=-1545/165, 7-9=-2850/134
 BOT CHORD 2-15=-666/76, 12-15=-623/1169, 10-12=-31/2493, 9-10=-29/2498
 WEBS 3-15=-2086/113, 3-14=0/1682, 4-14=-712/76, 4-13=0/436, 5-13=-206/25, 5-12=-25/508, 6-12=0/403, 7-12=-907/87, 7-11=0/596, 8-11=-684/70, 8-10=0/260

- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 124 lb uplift at joint 2 and 48 lb uplift at joint 15.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=42ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 2-2-10, Zone1 2-2-10 to 19-0-0, Zone3 19-0-0 to 23-2-0, Zone2 23-2-0 to 29-3-13, Zone1 29-3-13 to 42-2-0 zone; cantilever left and right exposed ; end vertical left and right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

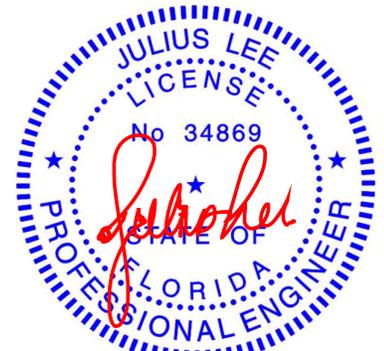

Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss A11	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798761
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:01
ID:5wXu?YXU0D_eNRuCuPo_uCzvK70-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

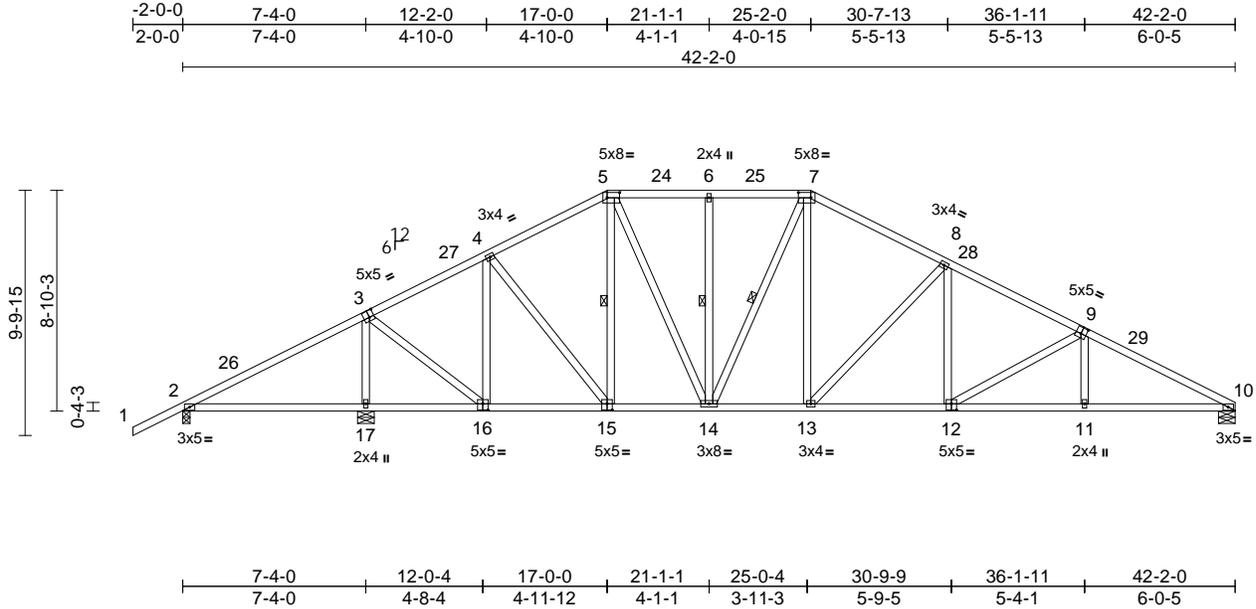

Scale = 1:91.9

Plate Offsets (X, Y): [3:0-2-4,0-3-4], [5:0-6-0,0-2-8], [7:0-6-0,0-2-8], [9:0-2-8,0-3-0], [12:0-2-8,0-3-0], [15:0-2-8,0-3-0], [16:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.56	Vert(LL)	0.08	17-20	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.63	Vert(CT)	-0.22	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.75	Horz(CT)	0.06	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 265 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-15, 7-14, 6-14


REACTIONS
(size) 2=0-3-8, 10=0-8-0, 17=0-8-0
Max Horiz 2=170 (LC 11)
Max Uplift 2=123 (LC 12), 17=49 (LC 12)
Max Grav 2=203 (LC 23), 10=1328 (LC 1), 17=2047 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 5-6=-1204/167, 6-7=-1204/167, 1-2=0/54, 2-4=-774/680, 4-5=-1140/152, 7-8=-1527/163, 8-10=-2520/136
BOT CHORD 2-17=-541/77, 14-17=-507/960, 13-14=0/1304, 11-13=-42/2206, 10-11=-40/2210
WEBS 3-17=-1872/113, 4-15=0/554, 5-15=-332/35, 7-14=-283/10, 7-13=0/579, 8-13=-661/81, 6-14=-253/64, 5-14=-31/633, 8-12=0/418, 9-12=-514/65, 9-11=0/230, 4-16=-828/67, 3-16=0/1411

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=42ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 2-2-10, Zone1 2-2-10 to 17-0-0, Zone2 17-0-0 to 22-11-9, Zone1 22-11-9 to 25-2-0, Zone2 25-2-0 to 31-1-9, Zone1 31-1-9 to 42-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 2 and 49 lb uplift at joint 17.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES
1) Unbalanced roof live loads have been considered for this design.

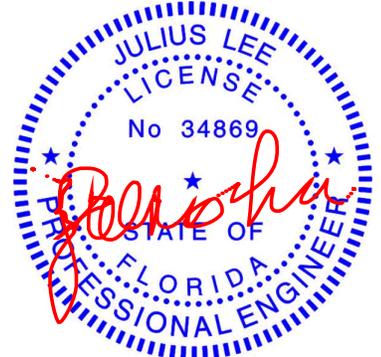

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss A12	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798762
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:01
ID:kEFQWeg?BvUxpHpVbK0oNkzv6q-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCD0i7J4zJC?f

Page: 1

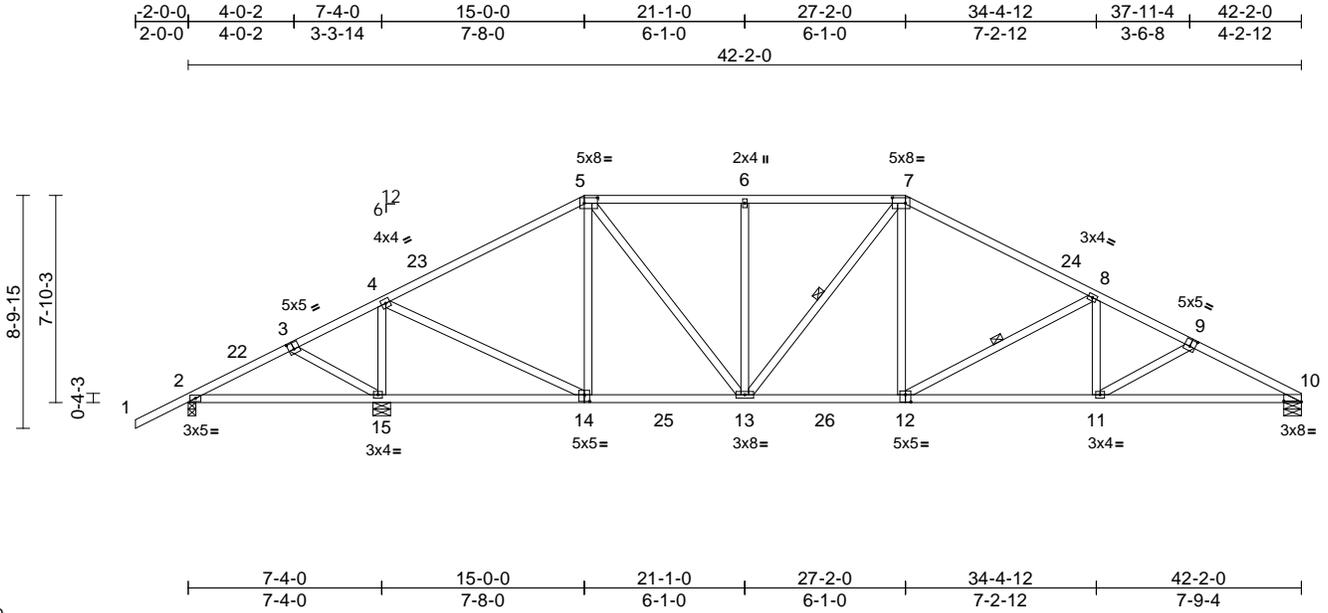

Scale = 1:86.9

Plate Offsets (X, Y): [3:0-2-8,0-3-0], [5:0-6-0,0-2-8], [7:0-6-0,0-2-8], [9:0-2-8,0-3-0], [10:0-8-0,0-0-6], [12:0-2-8,0-3-4], [14:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.59	Vert(LL)	-0.15	11-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.79	Vert(CT)	-0.29	11-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.55	Horz(CT)	0.07	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 240 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 7-13, 8-12

REACTIONS

(size) 2=0-3-8, 10=0-8-0, 15=0-8-0
Max Horiz 2=151 (LC 11)
Max Uplift 2=-116 (LC 12), 15=-58 (LC 12)
Max Grav 2=186 (LC 23), 10=1524 (LC 18),
15=2281 (LC 17)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-4=-47/742, 4-5=-1245/112,
5-6=-1581/152, 6-7=-1581/152,
7-8=-1988/138, 8-10=-2895/120
BOT CHORD 2-15=-523/81, 13-15=-634/1064,
11-13=-29/2382, 10-11=-60/2563
WEBS 4-15=-1964/137, 4-14=0/1776, 5-14=-549/94,
5-13=-38/893, 6-13=-385/86, 7-13=-215/51,
7-12=0/662, 8-12=-822/83, 8-11=0/376,
3-15=-169/65, 9-11=-211/57

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft;
B=45ft; L=42ft; eave=5ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -2-0-0 to 2-2-10,
Zone1 2-2-10 to 15-0-0, Zone2 15-0-0 to 21-1-0, Zone1
21-1-0 to 27-2-0, Zone2 27-2-0 to 33-1-9, Zone1 33-1-9
to 42-2-0 zone; cantilever left and right exposed ; end
vertical left and right exposed; porch left exposed;C-C
for members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60

- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 116 lb uplift at joint 2 and 58 lb uplift at joint 15.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss B01	Truss Type Hip Girder	Qty 1	Ply 2	Spates Job Reference (optional)	T39798763
-----------------	--------------	--------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:02
 ID:hDbCmsPvz37EXG?QAq_nfDzvKYH-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

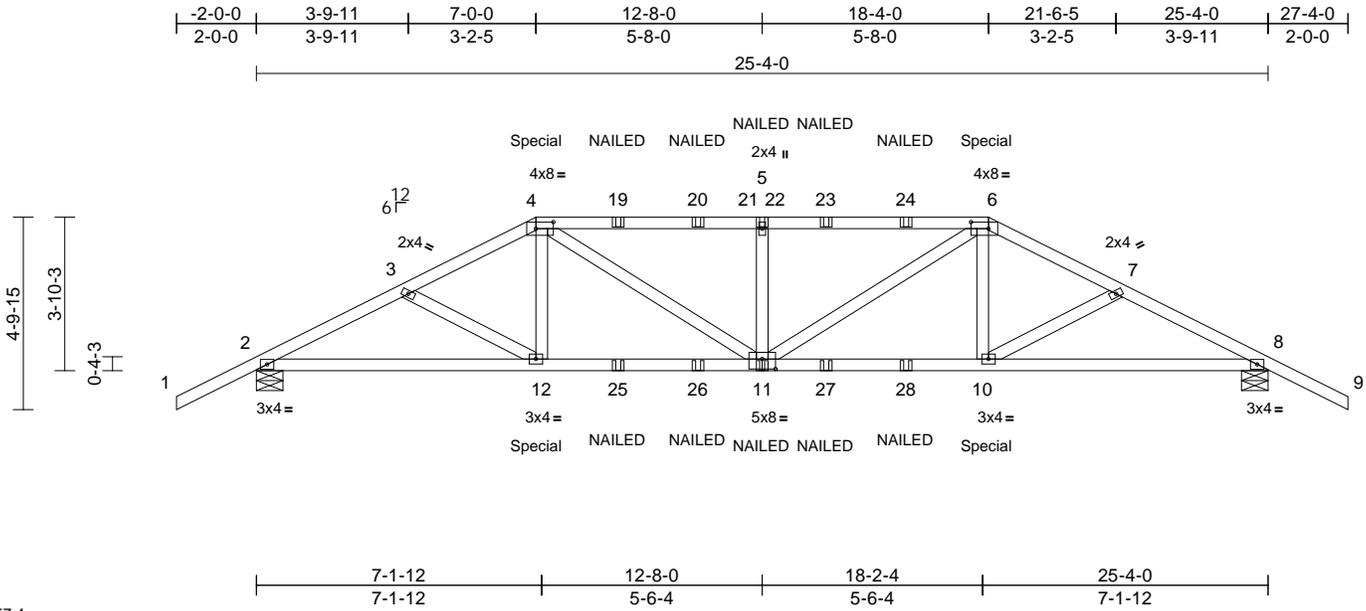

Scale = 1:57.4

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [6:0-5-4,0-2-0], [11:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.46	Vert(LL)	-0.10	10-11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.21	11-12	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.12	Horz(CT)	0.07	8	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 257 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 5-6-9 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-8-0, 8=0-8-0
 Max Horiz 2=75 (LC 7)
 Max Uplift 2=-251 (LC 8), 8=-251 (LC 8)
 Max Grav 2=2148 (LC 13), 8=2148 (LC 14)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-3=-4101/438, 3-4=-3951/447, 4-5=-4480/540, 5-6=-4480/540, 6-7=-3951/447, 7-8=-4102/438, 8-9=0/54
 BOT CHORD 2-12=-311/3667, 10-12=-296/3580, 8-10=-311/3611
 WEBS 4-12=0/667, 4-11=-149/1134, 5-11=-863/310, 6-11=-149/1134, 6-10=0/667, 3-12=-141/111, 7-10=-141/111

- 4) Wind: ASCE 7-22; Vult=130mph (3-second gust)
 Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
 B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed;
 MWFRS (directional); cantilever left and right exposed ;
 end vertical left and right exposed; Lumber DOL=1.60
 plate grip DOL=1.60
- 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 251 lb uplift at joint 2 and 251 lb uplift at joint 8.
- 10) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 245 lb down and 130 lb up at 7-0-0, and 245 lb down and 130 lb up at 18-4-0 on top chord, and 373 lb down and 10 lb up at 7-0-0, and 373 lb down and 10 lb up at 18-3-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (lb/ft)
 Vert: 1-4=-60, 4-6=-60, 6-9=-60, 13-16=-20
 Concentrated Loads (lb)
 Vert: 4=-169 (B), 6=-169 (B), 12=-306 (B), 11=-59 (B), 5=-121 (B), 10=-306 (B), 19=-121 (B), 20=-121 (B), 23=-121 (B), 24=-121 (B), 25=-59 (B), 26=-59 (B), 27=-59 (B), 28=-59 (B)

- NOTES**
- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - 3) Unbalanced roof live loads have been considered for this design.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss B02	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798764
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:02
ID: _ZWseFVIJD0EsL1A4ocQRhvkYA-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

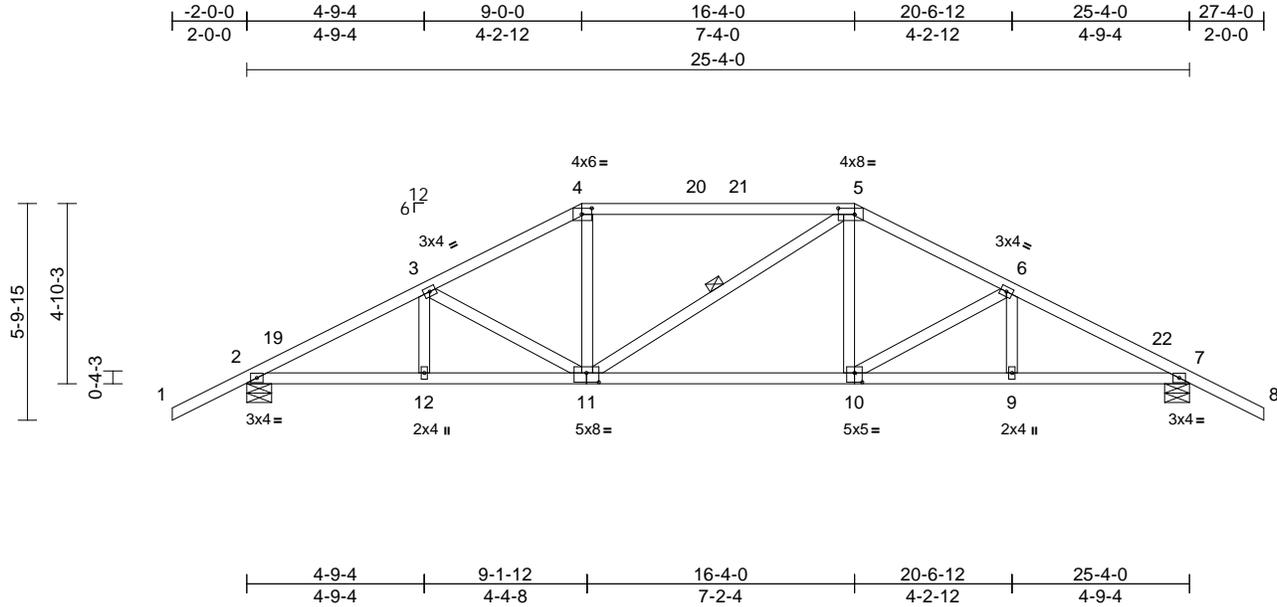

Scale = 1:61.6

Plate Offsets (X, Y): [4:0-3-4,0-2-0], [5:0-5-4,0-2-0], [10:0-2-8,0-3-0], [11:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.63	Vert(LL)	-0.09	10-11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.21	10-11	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 130 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-11

REACTIONS

(size) 2=0-8-0, 7=0-8-0
Max Horiz 2=-92 (LC 10)
Max Uplift 2=-48 (LC 12), 7=-48 (LC 12)
Max Grav 2=1133 (LC 1), 7=1133 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-1838/76, 3-4=-1512/91, 4-5=-1318/103, 5-6=-1518/91, 6-7=-1838/76, 7-8=0/54
BOT CHORD 2-12=0/1592, 9-12=-4/1592, 7-9=-4/1592
WEBS 3-11=-326/49, 4-11=0/378, 5-11=-116/122, 5-10=0/378, 6-10=-322/49, 3-12=0/147, 6-9=0/144

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 16-4-0, Zone2 16-4-0 to 20-6-12, Zone1 20-6-12 to 27-4-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 2 and 48 lb uplift at joint 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss B03	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798765
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:02
ID:sKIM4dYoNRWgZLxJehMcXzvKY6-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

Page: 1

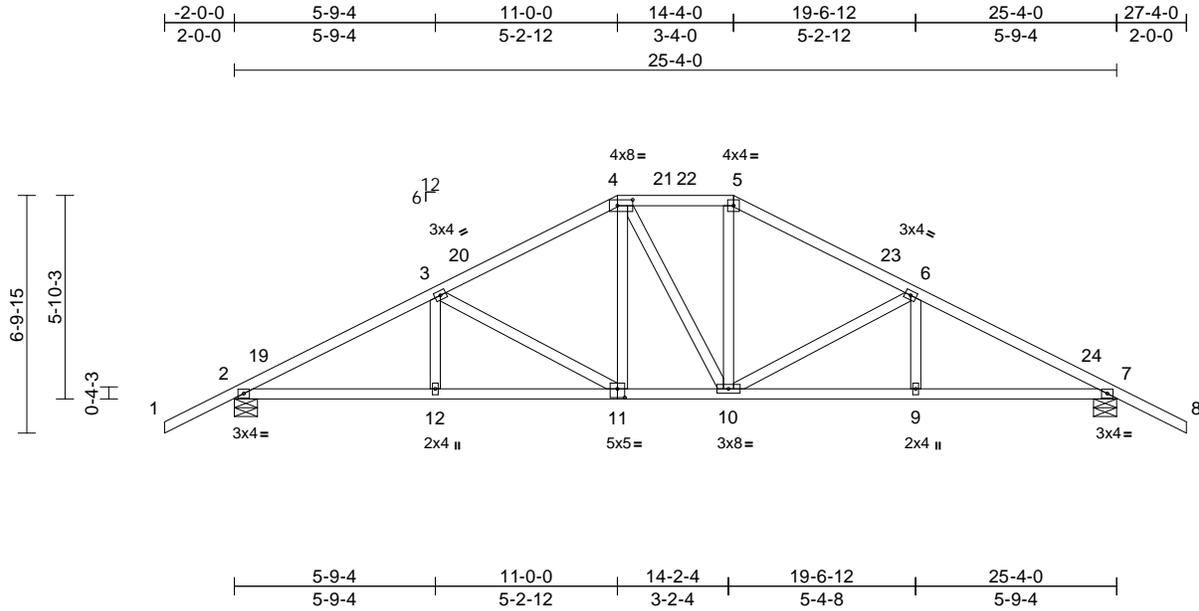

Scale = 1:65.8

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [11:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.27	Vert(LL)	-0.07	11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.43	Vert(CT)	-0.14	11-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.32	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 136 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 7=0-8-0
Max Horiz 2=-108 (LC 10)
Max Uplift 2=-48 (LC 12), 7=-48 (LC 12)
Max Grav 2=1133 (LC 1), 7=1133 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-1818/74, 3-4=-1343/100,
4-5=-1133/113, 5-6=-1336/100, 6-7=-1818/73,
7-8=0/54
BOT CHORD 2-12=0/1569, 10-12=0/1569, 9-10=0/1569,
7-9=0/1569
WEBS 3-12=0/232, 3-11=-503/56, 4-11=0/346,
4-10=-116/125, 5-10=0/348, 6-10=-507/56,
6-9=0/233

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 2 and 48 lb uplift at joint 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0,
Zone1 1-0-0 to 11-0-0, Zone3 11-0-0 to 14-4-0, Zone2
14-4-0 to 18-6-15, Zone1 18-6-15 to 27-4-0 zone;
cantilever left and right exposed ; end vertical left and
right exposed;C-C for members and forces & MWFRS
for reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss B04	Truss Type Common	Qty 6	Ply 1	Spates Job Reference (optional)	T39798766
-----------------	--------------	----------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:03
ID:I6?tv?bJRg06qaeiYUlmNzvkY2-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

Page: 1

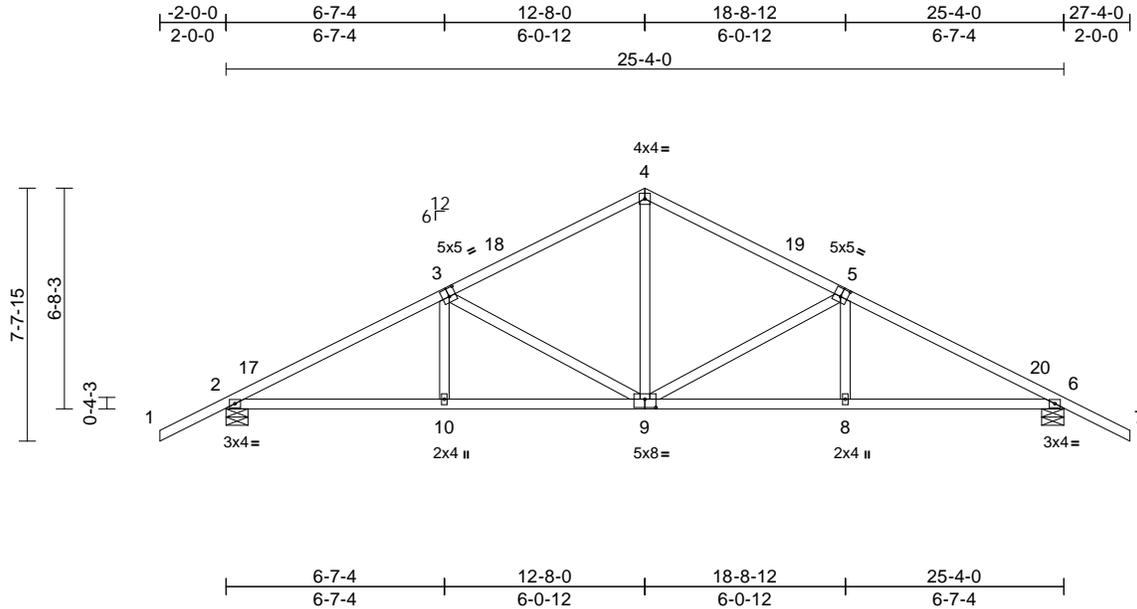

Scale = 1:69.3

Plate Offsets (X, Y): [3:0-2-8,0-3-0], [5:0-2-8,0-3-0], [9:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.37	Vert(LL)	-0.07	9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.50	Vert(CT)	-0.15	9-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.49	Horz(CT)	0.06	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 125 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 6=0-8-0
Max Horiz 2=122 (LC 11)
Max Uplift 2=-48 (LC 12), 6=-48 (LC 12)
Max Grav 2=1133 (LC 1), 6=1133 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-4=-1776/116, 4-6=-1776/116, 6-7=0/54

BOT CHORD 2-10=0/1524, 8-10=0/1520, 6-8=0/1524


WEBS 3-10=0/263, 3-9=-594/76, 4-9=0/687, 5-9=-594/76, 5-8=0/263

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 12-8-0, Zone2 12-8-0 to 16-10-15, Zone1 16-10-15 to 27-4-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 2 and 48 lb uplift at joint 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

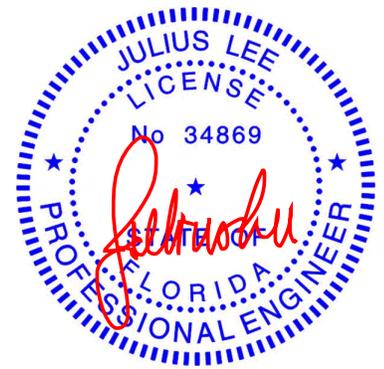

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss B05	Truss Type Common	Qty 1	Ply 1	Spates Job Reference (optional)	T39798767
-----------------	--------------	----------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:03
ID:dtEOImepVvWXIByTnJqEwDzvK_Y_-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwrcDoi7J4zJC?l

Page: 1

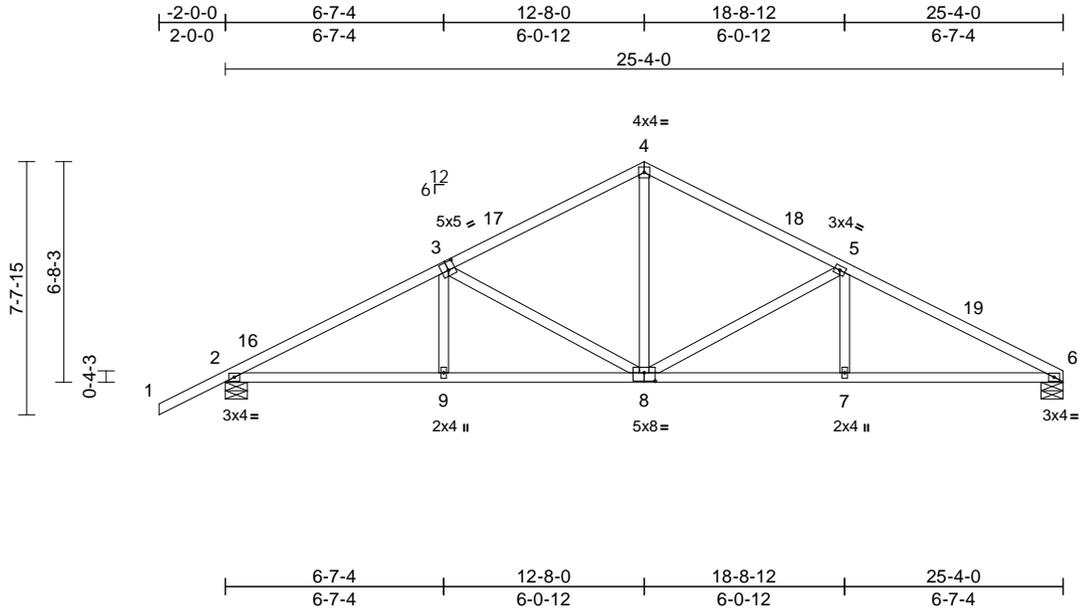

Scale = 1:69.3

Plate Offsets (X, Y): [3:0-2-8,0-3-0], [8:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.40	Vert(LL)	-0.07	7-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.55	Vert(CT)	-0.16	7-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.52	Horz(CT)	0.06	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 121 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 6=0-8-0
Max Horiz 2=118 (LC 11)
Max Uplift 2=-50 (LC 12)
Max Grav 2=1138 (LC 1), 6=1009 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-4=-1787/118, 4-5=-1234/132, 5-6=-1798/115
BOT CHORD 2-9=-26/1533, 7-9=-28/1564, 6-7=-36/1564
WEBS 3-9=0/263, 3-8=-594/78, 4-8=0/696, 5-8=-630/81, 5-7=0/267

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 12-8-0, Zone2 12-8-0 to 16-10-15, Zone1 16-10-15 to 25-4-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss B06	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798768
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:03
ID:2SwXN0ginqv69fg2SSOxYszvkXx-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCDoi7J4zJC?f

Page: 1

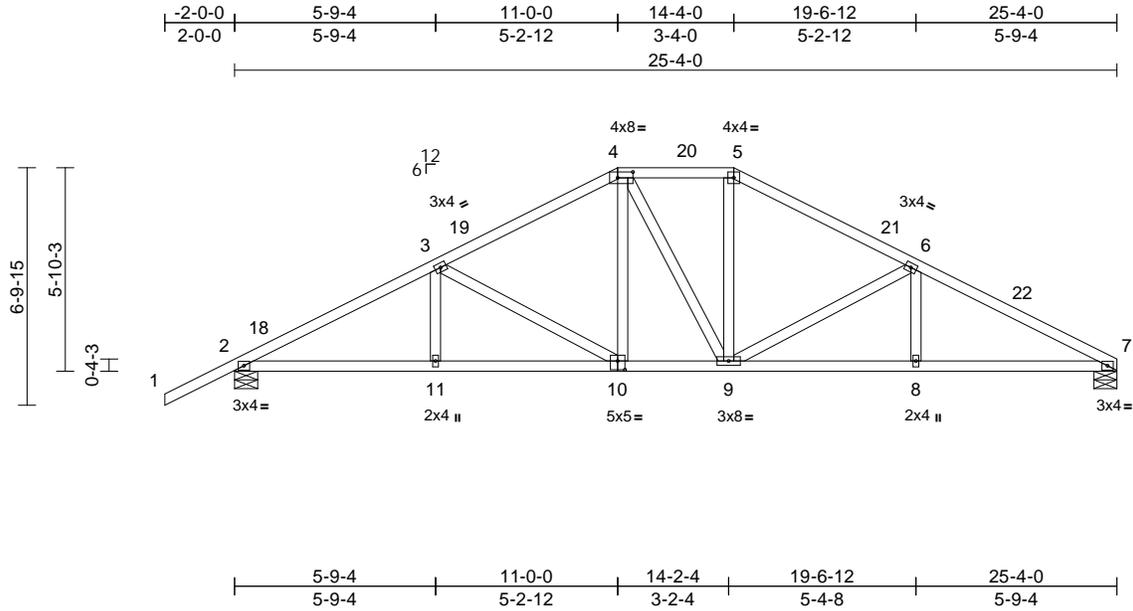

Scale = 1:65.8

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [10:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.30	Vert(LL)	-0.07	10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.15	10-11	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 133 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 7=0-8-0
Max Horiz 2=105 (LC 11)
Max Uplift 2=-50 (LC 12)
Max Grav 2=1138 (LC 1), 7=1009 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-1828/83, 3-4=-1354/110, 4-5=-1144/115, 5-6=-1350/110, 6-7=-1845/89
BOT CHORD 2-11=-27/1578, 9-11=-27/1578, 8-9=-24/1611, 7-8=-24/1611
WEBS 3-11=0/232, 3-10=-503/56, 4-10=0/347, 4-9=-115/127, 5-9=0/352, 6-9=-544/64, 6-8=0/239

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 11-0-0, Zone3 11-0-0 to 14-4-0, Zone2 14-4-0 to 18-6-15, Zone1 18-6-15 to 25-4-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.

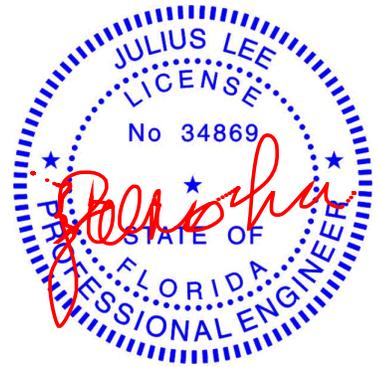

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss B07	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798769
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:03
ID:scHoeRTngfGua8CpiULo7zvKXr-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRcDoi7J4zJC?f

Page: 1

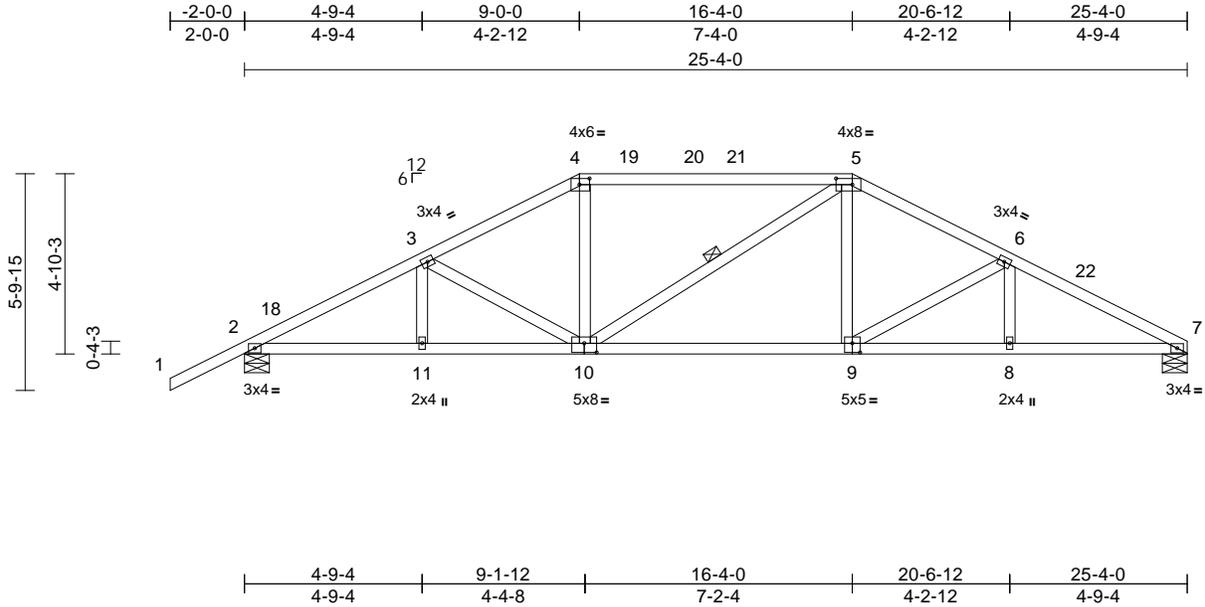

Scale = 1:61.6

Plate Offsets (X, Y): [4:0-3-4,0-2-0], [5:0-5-4,0-2-0], [9:0-2-8,0-3-0], [10:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.63	Vert(LL)	-0.09	9-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.21	9-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 127 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-10

REACTIONS

(size) 2=0-8-0, 7=0-8-0
Max Horiz 2=88 (LC 11)
Max Uplift 2=50 (LC 12)
Max Grav 2=1138 (LC 1), 7=1009 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-1848/85, 3-4=-1523/101,
4-5=-1327/112, 5-6=-1538/103, 6-7=-1878/92
BOT CHORD 2-11=-36/1601, 8-11=-36/1644, 7-8=-35/1644
WEBS 3-10=-325/48, 4-10=0/379, 5-10=-123/119,
5-9=0/383, 6-9=-363/58, 3-11=0/147,
6-8=0/150

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0,
Zone1 1-0-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1
13-2-15 to 16-4-0, Zone2 16-4-0 to 20-6-12, Zone1
20-6-12 to 25-4-0 zone; cantilever left and right
exposed; end vertical left and right exposed; C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 50 lb uplift at joint
2.
- This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®



16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss C01	Truss Type Half Hip Girder	Qty 1	Ply 2	Spates Job Reference (optional)	T39798770
-----------------	--------------	-------------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:04
ID:e1SolsH7HfEd5LcItG7RvzvVs-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwCRDoi7J4zJC?f

Page: 1

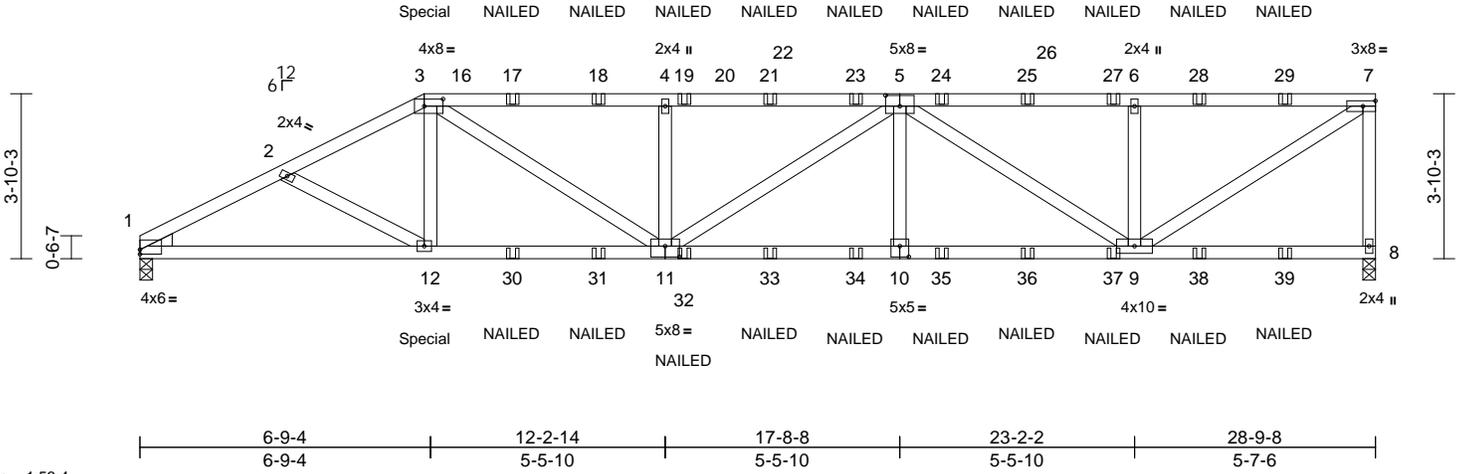

Scale = 1:53.4

Plate Offsets (X, Y): [1:Edge,0-1-4], [3:0-5-4,0-2-0], [5:0-4-0,0-3-0], [10:0-2-8,0-3-0], [11:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.68	Vert(LL)	-0.14	10-11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.69	Vert(CT)	-0.29	10-11	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.43	Horz(CT)	0.08	8	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 308 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE Left: 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-3-8, 8=0-3-8
Max Horiz 1=105 (LC 7)
Max Uplift 1=-204 (LC 8), 8=-154 (LC 8)
Max Grav 1=2297 (LC 13), 8=2427 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-4313/436, 2-3=-4313/448,
3-4=-5252/539, 4-6=-5252/539,
6-7=-3285/265, 7-8=-2321/203
BOT CHORD 1-12=-380/3770, 9-12=-434/4991, 8-9=-24/64
WEBS 3-12=0/525, 3-11=-147/1664, 4-11=-743/266,
5-11=-93/332, 5-10=0/432, 5-9=-2034/241,
6-9=-736/177, 7-9=-272/3849, 2-12=-51/277

NOTES
1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
3) Unbalanced roof live loads have been considered for this design.

- 4) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=29ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 204 lb uplift at joint 1 and 154 lb uplift at joint 8.
- 10) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 245 lb down and 130 lb up at 6-7-8 on top chord, and 373 lb down and 10 lb up at 6-7-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-60, 3-7=-60, 8-13=-20
Concentrated Loads (lb)
Vert: 3=-169 (B), 12=-306 (B), 17=-121 (B), 18=-121 (B), 19=-121 (B), 21=-121 (B), 23=-121 (B), 24=-121 (B), 25=-131 (B), 27=-131 (B), 28=-131 (B), 29=-131 (B), 30=-59 (B), 31=-59 (B), 32=-59 (B), 33=-59 (B), 34=-59 (B), 35=-59 (B), 36=-67 (B), 37=-67 (B), 38=-67 (B), 39=-67 (B)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss C02	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798771
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:04
 ID:OhFr?vxVcag_o1MHl4n5RVzvKXb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?fi

Page: 1

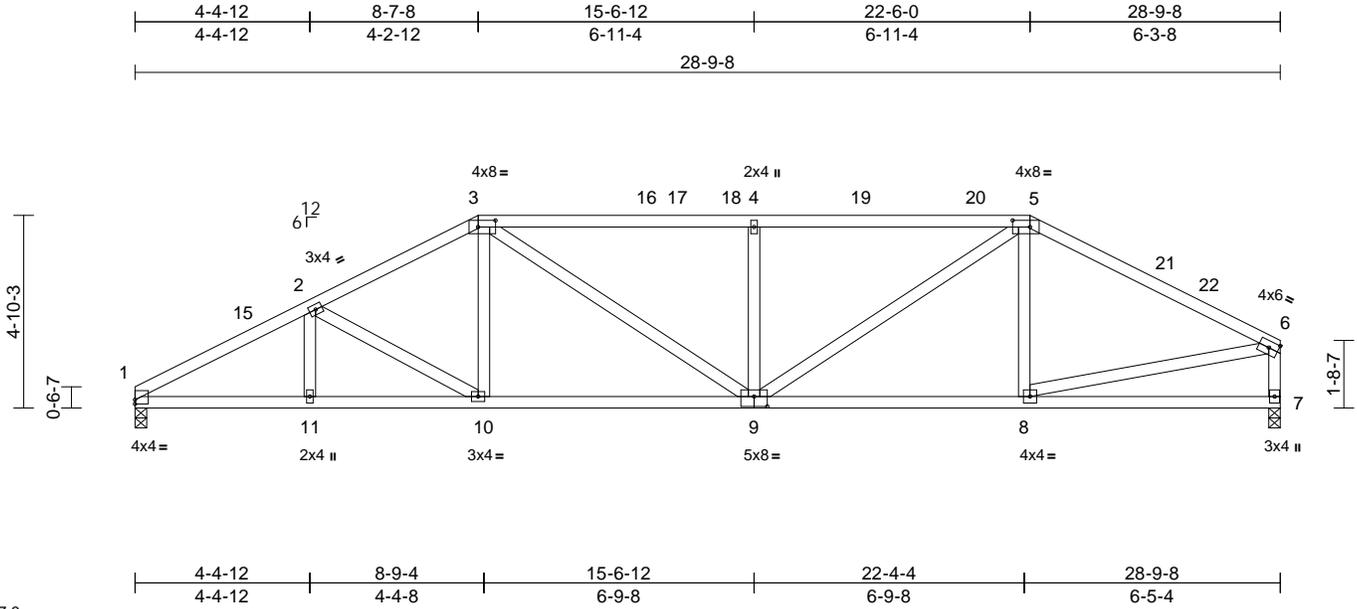

Scale = 1:57.6

Plate Offsets (X, Y): [1:Edge,0-1-4], [3:0-5-4,0-2-0], [5:0-5-4,0-2-0], [9:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.48	Vert(LL)	-0.09	9-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.68	Vert(CT)	-0.21	9-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.26	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 152 lb	FT = 20%

- LUMBER**
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2
- BRACING**
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.
- REACTIONS** (size) 1=0-3-8, 7=0-3-8
 Max Horiz 1=95 (LC 11)
 Max Grav 1=1146 (LC 1), 7=1146 (LC 1)
- FORCES** (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-2033/88, 2-3=-1774/105,
 3-4=-1863/119, 4-5=-1863/119, 5-6=-1501/83,
 6-7=-1084/81
 BOT CHORD 1-11=-102/1750, 10-11=-102/1750,
 8-10=-53/1561, 7-8=-32/130
 WEBS 2-10=-236/55, 3-10=0/327, 3-9=-12/462,
 4-9=-467/102, 5-9=-23/780, 5-8=-133/86,
 6-8=-13/1169, 2-11=0/108

- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust)
 Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=29ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 8-7-8, Zone2 8-7-8 to 12-10-7, Zone1 12-10-7 to 22-6-0, Zone2 22-6-0 to 26-8-15, Zone1 26-8-15 to 28-7-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®



16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss C03	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798772
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:05
ID:9DKsge1Wj2gsmGzpDlwzmBzvkXT-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

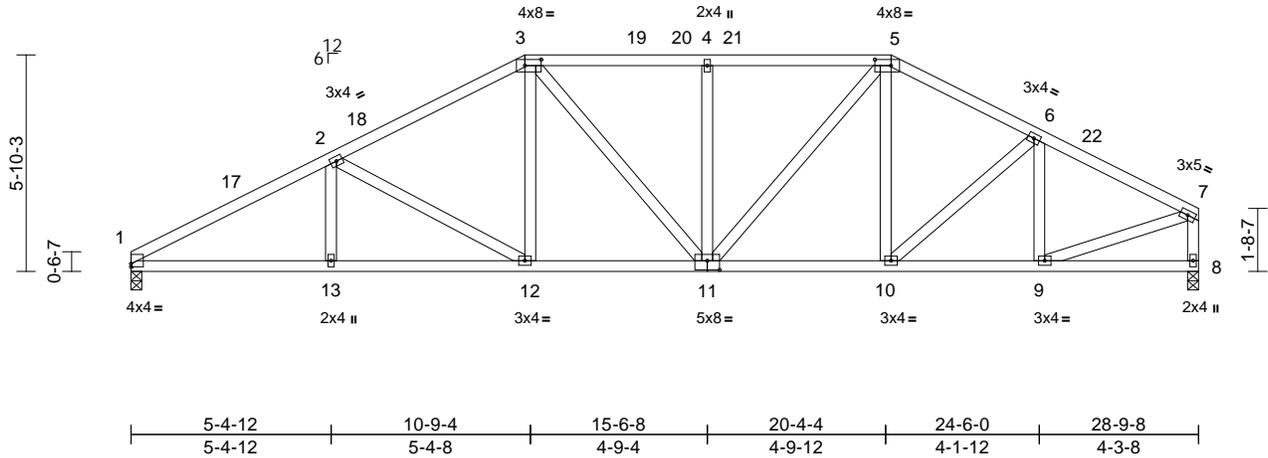

Scale = 1:61.8

Plate Offsets (X, Y): [1:Edge,0-1-0], [3:0-5-4,0-2-0], [5:0-5-4,0-2-0], [11:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.39	Vert(LL)	-0.08	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	-0.17	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.26	Horz(CT)	0.06	8	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 166 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 1=0-3-8, 8=0-3-8
Max Horiz 1=112 (LC 11)
Max Grav 1=1146 (LC 1), 8=1146 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-2035/90, 2-3=-1637/115, 3-4=-1495/127, 4-5=-1495/127, 5-6=-1423/112, 6-7=-1366/82, 7-8=-1098/70
BOT CHORD 1-13=-100/1748, 12-13=-98/1748, 10-12=-44/1407, 9-10=-54/1174, 8-9=-23/68
WEBS 2-13=0/188, 2-12=-404/61, 3-12=0/356, 5-11=-20/475, 5-10=-10/152, 6-10=-13/164, 7-9=-32/1173, 4-11=-324/76, 3-11=-11/249, 6-9=-320/64

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=29ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 10-7-8, Zone2 10-7-8 to 14-10-7, Zone1 14-10-7 to 20-6-0, Zone2 20-6-0 to 24-6-0, Zone1 24-6-0 to 28-7-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.

- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss C05	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798774
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:05
ID:PynGZj8AcopaLe9YF8a4d4zvKXK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

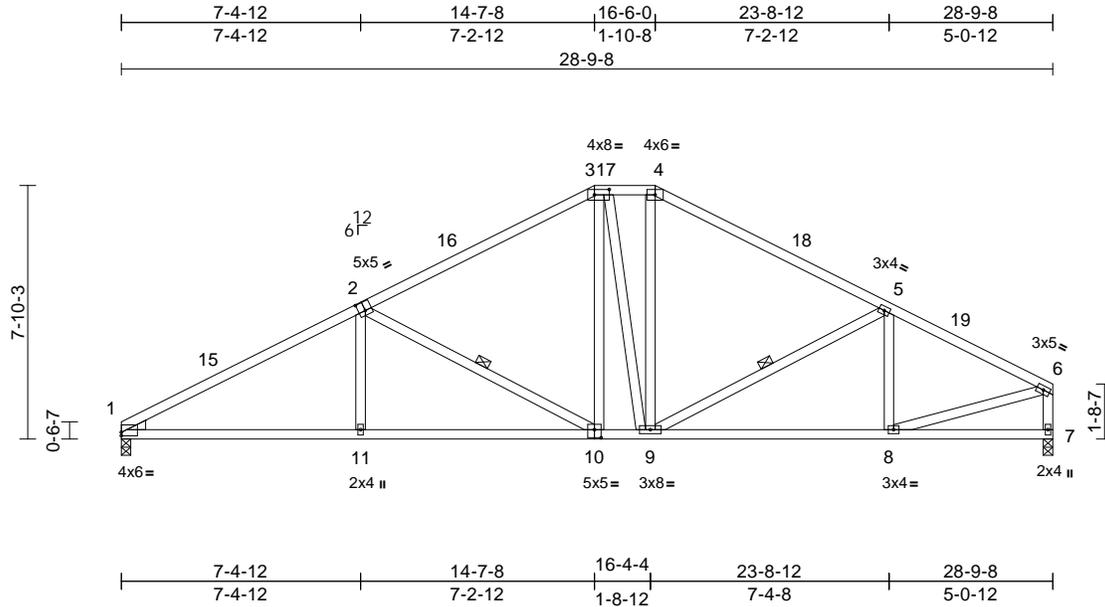

Scale = 1:70.9

Plate Offsets (X, Y): [1:Edge,0-1-4], [2:0-2-8,0-3-4], [3:0-5-8,0-2-0], [10:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.46	Vert(LL)	-0.09	10-11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	-0.21	10-11	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.28	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 168 lb	FT = 20%

LUMBER

- TOP CHORD 2x4 SP No.2
- BOT CHORD 2x4 SP No.2
- WEBS 2x4 SP No.2
- WEDGE Left: 2x4 SP No.3

BRACING

- TOP CHORD Structural wood sheathing directly applied, except end verticals.
- BOT CHORD Rigid ceiling directly applied.
- WEBS 1 Row at midpt 2-10, 5-9

REACTIONS

- (size) 1=0-3-8, 7=0-3-8
- Max Horiz 1=146 (LC 11)
- Max Grav 1=1146 (LC 1), 7=1146 (LC 1)

FORCES

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-3=-1983/123, 3-4=-1093/137, 4-5=-1320/118, 5-6=-1463/77, 6-7=-1103/64
- BOT CHORD 1-11=-134/1688, 9-11=-76/1685, 8-9=-50/1265, 7-8=-23/57
- WEBS 2-11=0/298, 2-10=-668/79, 3-10=0/395, 3-9=-235/120, 4-9=0/345, 5-9=-262/65, 5-8=-234/92, 6-8=-28/1261

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=29ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 14-7-8, Zone3 14-7-8 to 16-6-0, Zone2 16-6-0 to 20-8-15, Zone1 20-8-15 to 28-7-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.

- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss C06	Truss Type Roof Special	Qty 1	Ply 1	Spates Job Reference (optional)	T39798775
-----------------	--------------	----------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:05
 ID:m?hshu1yPE0DbsEa0zOC5TzvKWB-RfC?PsB70Hq3NSgPqnL8u3uITXbGKWrCDoi7J4zJC7f

Page: 1

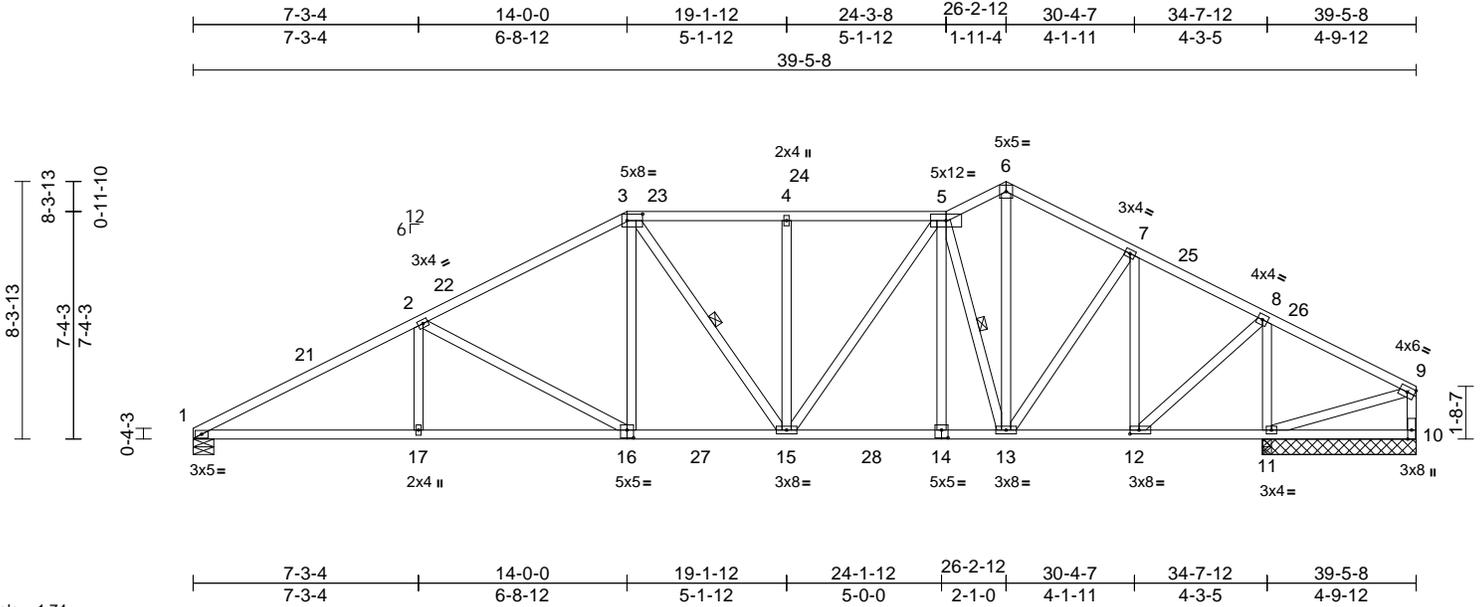

Scale = 1:74
 Plate Offsets (X, Y): [3:0-6-0,0-2-8], [12:0-3-8,0-1-8], [14:0-2-8,0-3-0], [16:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.49	Vert(LL)	-0.14	17-20	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.79	Vert(CT)	-0.26	17-20	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.85	Horz(CT)	0.07	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 256 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.
 WEBS 1 Row at midpt 3-15, 5-13

REACTIONS (size) 1=0-8-0, 10=4-11-8, 11=4-11-8
 Max Horiz 1=163 (LC 11)
 Max Uplift 10=636 (LC 17), 11=4 (LC 12)
 Max Grav 1=1463 (LC 17), 10=6 (LC 12), 11=2627 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-2673/177, 2-3=-1950/189,
 3-4=-1619/199, 4-5=-1619/199,
 5-6=-1021/181, 6-7=-1046/166,
 7-8=-571/101, 8-9=-671/130, 9-10=-18/701
 BOT CHORD 1-17=-127/2447, 15-17=-127/2447,
 13-15=0/1268, 12-13=0/436, 11-12=-943/109,
 10-11=-35/49
 WEBS 2-17=0/300, 2-16=-815/102, 3-16=0/619,
 3-15=-98/44, 4-15=-333/105, 5-15=-41/688,
 5-14=0/179, 8-11=-2138/169,
 9-11=-1029/102, 5-13=-1333/100,
 6-13=-82/714, 7-13=-4/839, 7-12=-1088/103,
 8-12=-76/1840

- Wind: ASCE 7-22; Vult=130mph (3-second gust)
 Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
 B=45ft; L=39ft; eave=5ft; Cat. II; Exp B; Enclosed;
 MWFRS (directional) and C-C Zone3 0-0-0 to 3-11-6,
 Zone1 3-11-6 to 14-0-0, Zone2 14-0-0 to 19-6-15, Zone1
 19-6-15 to 26-2-12, Zone2 26-2-12 to 31-9-11, Zone1
 31-9-11 to 39-3-12 zone; cantilever left and right
 exposed ; end vertical left and right exposed;C-C for
 members and forces & MWFRS for reactions shown;
 Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for
 verifying applied roof live load shown covers rain loading
 requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom
 chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf
 on the bottom chord in all areas where a rectangle
 3-06-00 tall by 2-00-00 wide will fit between the bottom
 chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to
 bearing plate capable of withstanding 636 lb uplift at joint
 10 and 4 lb uplift at joint 11.
- This truss design requires that a minimum of 7/16"
 structural wood sheathing be applied directly to the top
 chord and 1/2" gypsum sheetrock be applied directly to
 the bottom chord.

LOAD CASE(S) Standard

NOTES
 1) Unbalanced roof live loads have been considered for
 this design.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss CJ01	Truss Type Diagonal Hip Girder	Qty 7	Ply 1	Spates Job Reference (optional)	T39798776
-----------------	---------------	-----------------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:06
ID: xuRuJBAMOX1uXUEYgKiiTPzvkdl-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?F

Page: 1

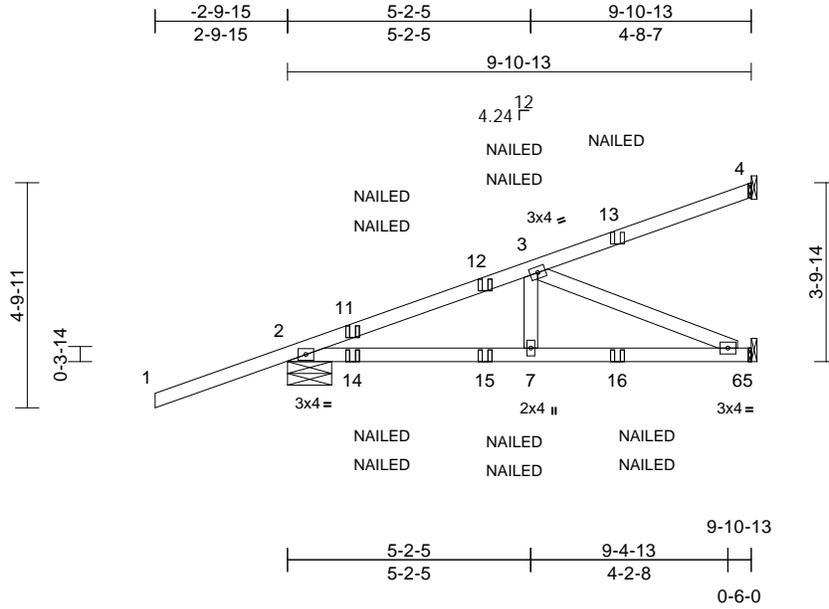

Scale = 1:49

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.62	Vert(LL)	-0.07	7-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	-0.08	6-7	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.31	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 44 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-11-5, 4= Mechanical, 5= Mechanical
Max Horiz 2=152 (LC 25)
Max Uplift 2=-203 (LC 8), 4=-51 (LC 8), 5=-20 (LC 8)
Max Grav 2=566 (LC 13), 4=132 (LC 19), 5=333 (LC 13)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/57, 2-3=-762/226, 3-4=-67/36
BOT CHORD 2-7=-235/697, 6-7=-126/697, 5-6=0/0
WEBS 3-7=0/249, 3-6=-756/137

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 51 lb uplift at joint 4, 203 lb uplift at joint 2 and 20 lb uplift at joint 5.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-60, 5-8=-20
Concentrated Loads (lb)
Vert: 11=72 (F=36, B=36), 13=-36 (B), 14=82 (F=41, B=41), 15=6 (F=3, B=3), 16=-49 (F=-24, B=-24)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job 0126-022	Truss CJ02	Truss Type Diagonal Hip Girder	Qty 4	Ply 1	Spates Job Reference (optional)	T39798777
-----------------	---------------	-----------------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:06

Page: 1

ID:EEM7naGIlgvviZHvalKLFuzvkte-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRCDoi7J4zJC?I

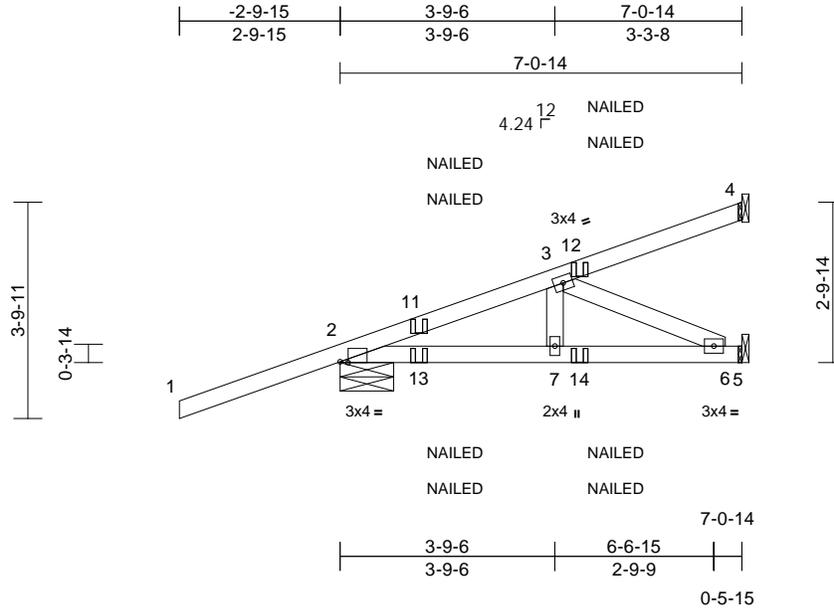

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.62	Vert(LL)	-0.03	7-10	>999	240
TCDL	10.0	Lumber DOL	1.25	BC	0.44	Vert(CT)	0.04	7-10	>999	180
BCLL	0.0*	Rep Stress Incr	NO	WB	0.08	Horz(CT)	0.00	5	n/a	n/a
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP						
									Weight: 32 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2


BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-11-5, 4= Mechanical, 5= Mechanical
Max Horiz 2=96 (LC 25)
Max Uplift 2=-176 (LC 8), 4=-21 (LC 8), 5=-14 (LC 5)
Max Grav 2=415 (LC 13), 4=100 (LC 19), 5=175 (LC 14)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/57, 2-3=-425/315, 3-4=-61/27
BOT CHORD 2-7=-318/344, 6-7=-82/344, 5-6=0/0
WEBS 3-7=-53/150, 3-6=-377/90

- NOTES**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 4, 176 lb uplift at joint 2 and 14 lb uplift at joint 5.
 - 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-60, 5-8=-20
Concentrated Loads (lb)
Vert: 11=72 (F=36, B=36), 13=82 (F=41, B=41), 14=6 (F=3, B=3)

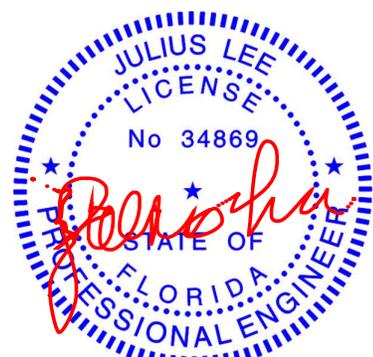

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)</p>	 <p>16023 Swingley Ridge Rd. Chesterfield, MO 63017 314.434.1200 / MiTek-US.com</p>
--	--

Job 0126-022	Truss D01	Truss Type Hip Girder	Qty 1	Ply 2	Spates Job Reference (optional)	T39798778
-----------------	--------------	--------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:06
 ID:G5sD?DzhhtUaagiVzq5fQzvKys-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRcDoi7J4zJC7f

Page: 1

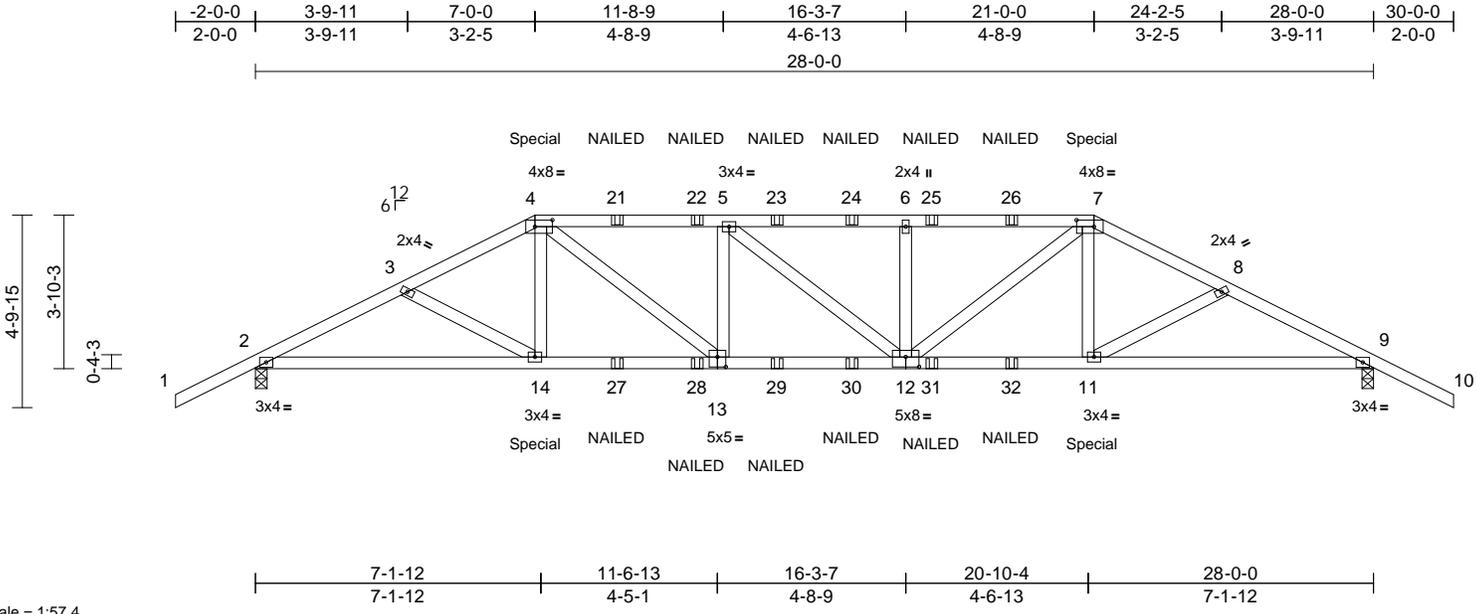

Scale = 1:57.4

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [7:0-5-4,0-2-0], [12:0-4-0,0-3-0], [13:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.40	Vert(LL)	-0.13	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.63	Vert(CT)	-0.27	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.16	Horz(CT)	0.09	9	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS								

Weight: 294 lb FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 5-2-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 9=0-3-8
 Max Horiz 2=77 (LC 7)
 Max Uplift 2=350 (LC 8), 9=350 (LC 8)
 Max Grav 2=2412 (LC 13), 9=2412 (LC 14)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-3=-4649/624, 3-4=-4471/606, 4-5=-5126/721, 5-6=-5155/727, 6-7=-5155/727, 7-8=-4472/606, 8-9=-4650/624, 9-10=0/54
 BOT CHORD 2-14=-470/4151, 11-14=-577/5158, 9-11=-470/4094
 WEBS 4-14=0/624, 7-11=0/630, 3-14=-175/152, 8-11=-174/152, 7-12=-205/1458, 5-13=-644/237, 4-13=-200/1439, 5-12=-27/37, 6-12=-629/238

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=28ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 350 lb uplift at joint 2 and 350 lb uplift at joint 9.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 267 lb down and 107 lb up at 7-0-0, and 267 lb down and 107 lb up at 21-0-0 on top chord, and 373 lb down and 10 lb up at 7-0-0, and 373 lb down and 10 lb up at 20-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (lb/ft)
 Vert: 1-4=-60, 4-7=-60, 7-10=-60, 15-18=-20
 Concentrated Loads (lb)

Vert: 4=-169 (F), 7=-169 (F), 14=-306 (F), 11=-306 (F), 21=-121 (F), 22=-121 (F), 23=-121 (F), 24=-121 (F), 25=-121 (F), 26=-121 (F), 27=-59 (F), 28=-59 (F), 29=-59 (F), 30=-59 (F), 31=-59 (F), 32=-59 (F)



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss E01	Truss Type Hip Girder	Qty 1	Ply 2	Spates Job Reference (optional)	T39798779
-----------------	--------------	--------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:07
ID:Oc88kf7rdh6eea9CmoZ8h9zvKfYf-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRcDoi7J4zJC?f

Page: 1

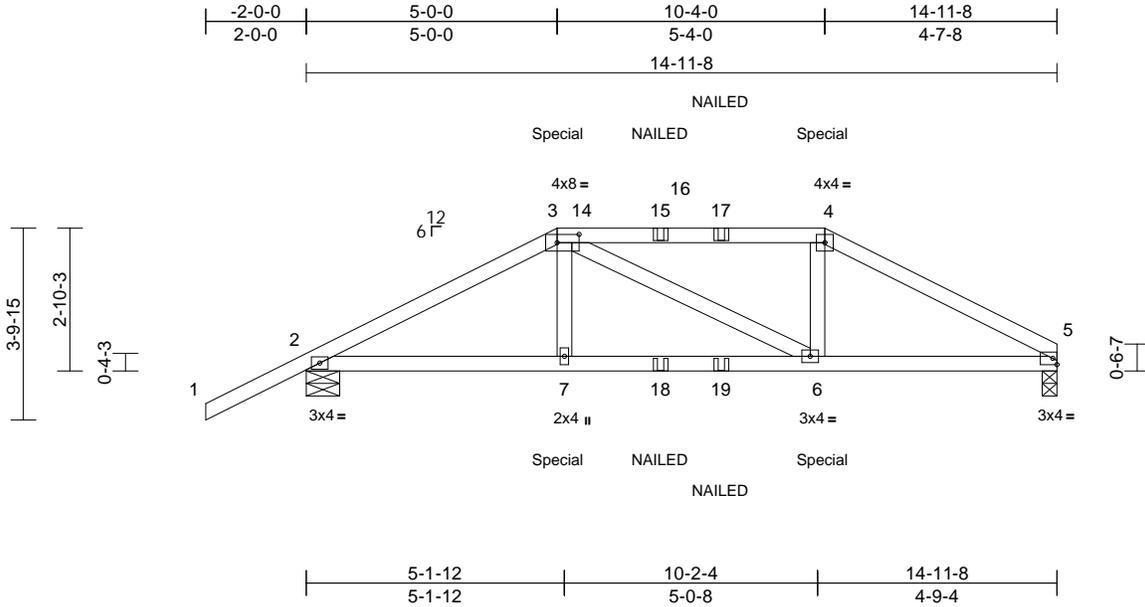

Scale = 1:45.7

Plate Offsets (X, Y): [3:0-5-4,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	-0.03	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.31	Vert(CT)	-0.06	6-7	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.05	Horz(CT)	0.02	5	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 129 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-8-0, 5=0-3-8
Max Horiz 2=53 (LC 7)
Max Uplift 2=-135 (LC 8), 5=-81 (LC 8)
Max Grav 2=1068 (LC 13), 5=969 (LC 14)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-1766/175, 3-4=-1505/175, 4-5=-1715/182
BOT CHORD 2-7=-132/1557, 6-7=-128/1578, 5-6=-123/1477
WEBS 3-7=0/399, 3-6=-106/16, 4-6=0/378


NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 5 and 135 lb uplift at joint 2.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 164 lb down and 76 lb up at 5-0-0, and 164 lb down and 76 lb up at 10-4-0 on top chord, and 197 lb down and 16 lb up at 5-0-0, and 197 lb down and 16 lb up at 10-3-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-60, 3-4=-60, 4-5=-60, 8-11=-20
Concentrated Loads (lb)
Vert: 3=-76 (B), 4=-76 (B), 7=-127 (B), 6=-127 (B), 15=-61 (B), 17=-61 (B), 18=-33 (B), 19=-33 (B)

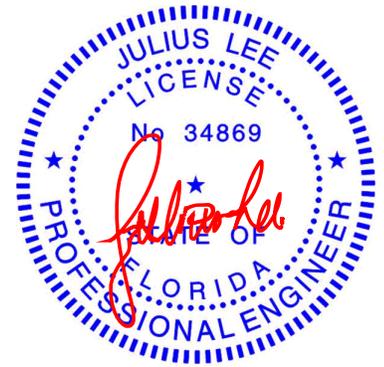

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss E02	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798780
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:07
ID:DIVP_iBcCXsnMvDm62gYxQzvKYZ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

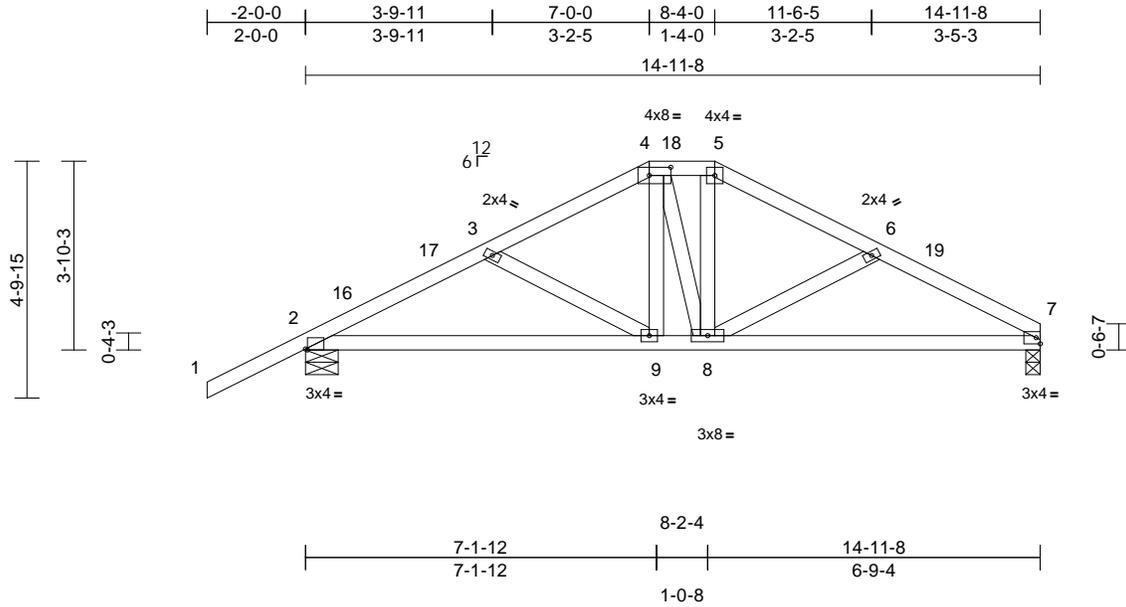

Scale = 1:46.7

Plate Offsets (X, Y): [2:0-0-8, Edge], [4:0-5-4, 0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	-0.05	9-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.40	Vert(CT)	-0.11	9-15	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.02	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 76 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 7=0-3-8
Max Horiz 2=69 (LC 11)
Max Uplift 2=-53 (LC 12)
Max Grav 2=726 (LC 1), 7=590 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-964/113, 3-4=-749/84,
4-5=-630/93, 5-6=-743/88, 6-7=-944/115
BOT CHORD 2-9=-68/839, 8-9=0/633, 7-8=-70/803
WEBS 4-9=0/237, 4-8=-85/65, 5-8=-3/196,
3-9=-243/81, 6-8=-213/87

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0,
Zone1 1-0-0 to 7-0-0, Zone3 7-0-0 to 8-4-0, Zone2 8-4-0
to 12-6-15, Zone1 12-6-15 to 14-11-8 zone; cantilever
left and right exposed; end vertical left and right
exposed; C-C for members and forces & MWFRS for
reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- 3) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.

- 6) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 7) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 53 lb uplift at joint
2.
- 8) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss E03	Truss Type Common	Qty 2	Ply 1	Spates Job Reference (optional)	T39798781
-----------------	--------------	----------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:07
ID: V6Q2S6H?Zhkoiafi10lCjuzvkYS-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

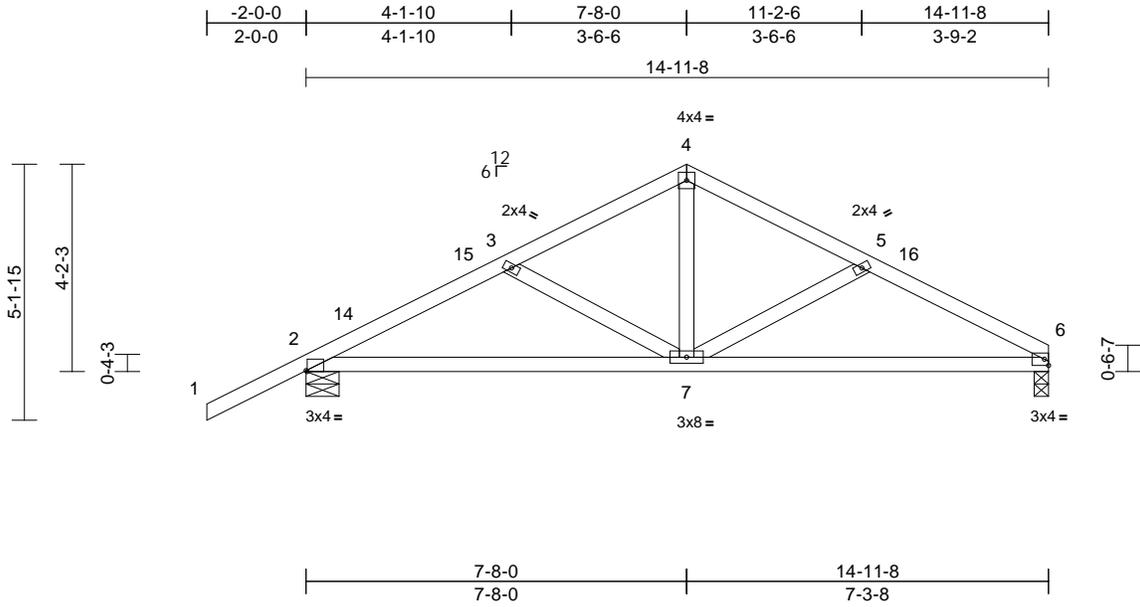

Scale = 1:46.2

Plate Offsets (X, Y): [2:0-0-4,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	-0.06	7-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.12	7-13	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horz(CT)	0.02	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 68 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 6=0-3-8
Max Horiz 2=74 (LC 11)
Max Uplift 2=-53 (LC 12)
Max Grav 2=726 (LC 1), 6=590 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-949/167, 3-4=-720/122,
4-5=-718/132, 5-6=-937/177
BOT CHORD 2-7=-104/823, 6-7=-105/794
WEBS 4-7=-18/422, 3-7=-267/114, 5-7=-243/119

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 7-8-0, Zone2 7-8-0 to 11-10-15, Zone1 11-10-15 to 14-11-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss F01	Truss Type Hip Girder	Qty 1	Ply 2	Spates Job Reference (optional)	T39798782
-----------------	--------------	--------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:07
ID:PLXi4LOf93LhF0j61wCCzvkdT-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

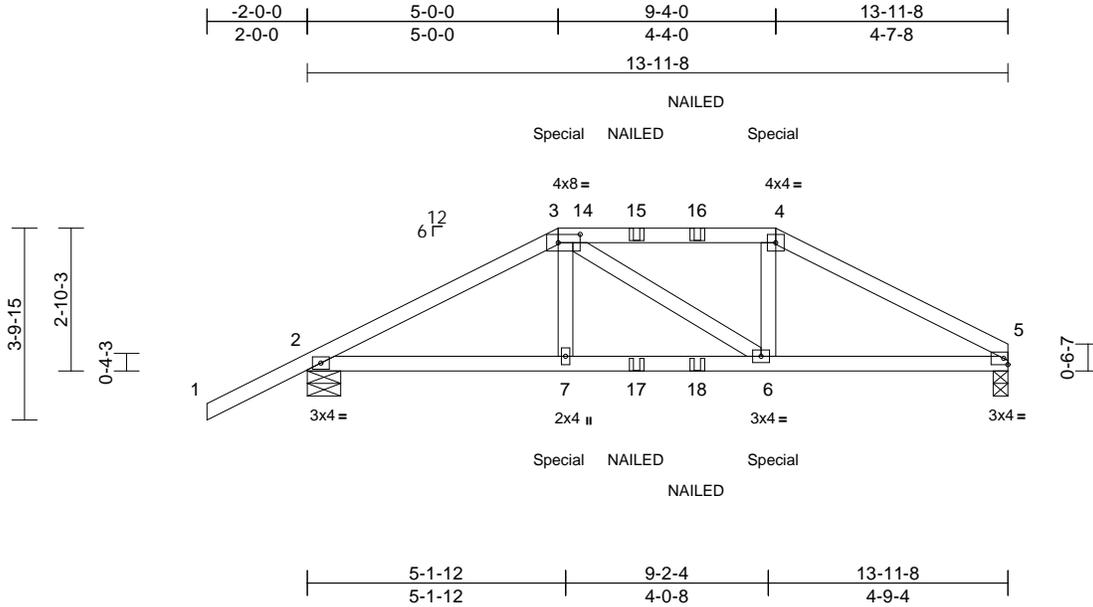

Scale = 1:45.7

Plate Offsets (X, Y): [3:0-5-4,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	-0.02	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.28	Vert(CT)	-0.04	6-7	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.04	Horz(CT)	0.02	5	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 120 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-8-0, 5=0-3-8
Max Horiz 2=53 (LC 7)
Max Uplift 2=-135 (LC 8), 5=-81 (LC 8)
Max Grav 2=1032 (LC 13), 5=934 (LC 14)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-1672/176, 3-4=-1423/175, 4-5=-1627/183
BOT CHORD 2-7=-131/1471, 6-7=-128/1490, 5-6=-123/1398
WEBS 3-7=0/375, 3-6=-102/17, 4-6=0/354

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCdL=6.0psf; BCdL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional); cantilever left and right exposed ;
end vertical left and right exposed; Lumber DOL=1.60
plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 5 and 135 lb uplift at joint 2.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 164 lb down and 76 lb up at 5-0-0, and 164 lb down and 76 lb up at 9-4-0 on top chord, and 197 lb down and 16 lb up at 5-0-0, and 197 lb down and 16 lb up at 9-3-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-60, 3-4=-60, 4-5=-60, 8-11=-20
Concentrated Loads (lb)
Vert: 3=-76 (F), 4=-76 (F), 7=-127 (F), 6=-127 (F), 15=-61 (F), 16=-61 (F), 17=-33 (F), 18=-33 (F)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss F02	Truss Type Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798783
-----------------	--------------	-------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:08
ID:E2ypU0tkLLgVOgi3Vllqezvkcr-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

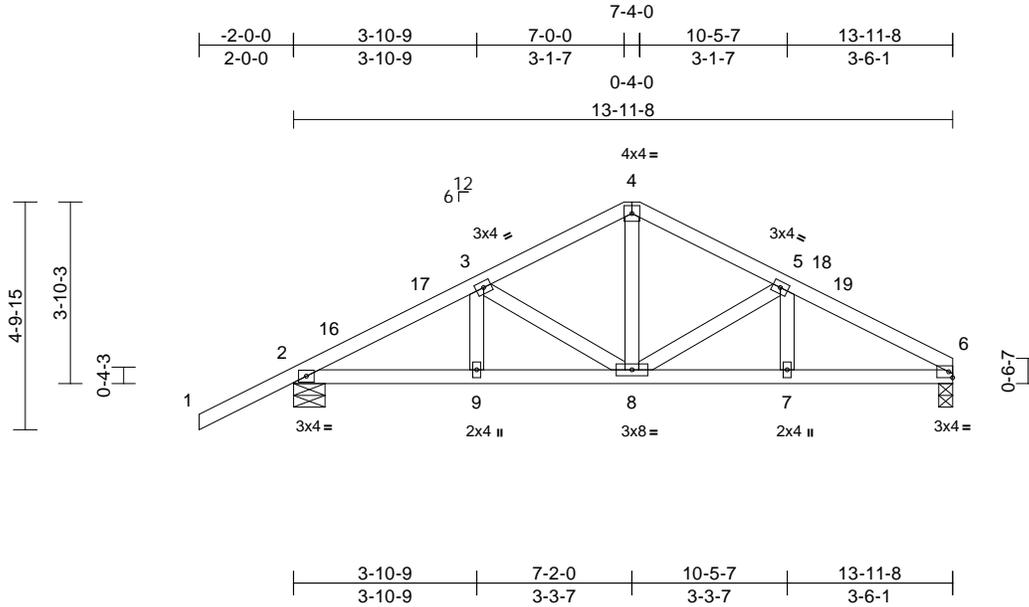

Scale = 1:48.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	-0.02	7-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.24	Vert(CT)	-0.04	7-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.02	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 68 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 6=0-3-8
Max Horiz 2=70 (LC 11)
Max Uplift 2=-53 (LC 12)
Max Grav 2=687 (LC 1), 6=550 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-3=-906/86, 3-4=-652/93,
4-5=-651/99, 5-6=-876/94
BOT CHORD 2-9=-48/770, 8-9=-48/770, 7-8=-44/737,
6-7=-44/737
WEBS 4-8=-18/335, 3-8=-273/56, 3-9=0/135,
5-8=-246/63, 5-7=0/111

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 7-2-0, Zone2 7-2-0 to 11-4-15, Zone1 11-4-15 to 13-11-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 2.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss F04	Truss Type Half Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798785
-----------------	--------------	------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:08
ID:YqcJ3kp62VVzh_vSR6dqJNzvkAL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC7f

Page: 1

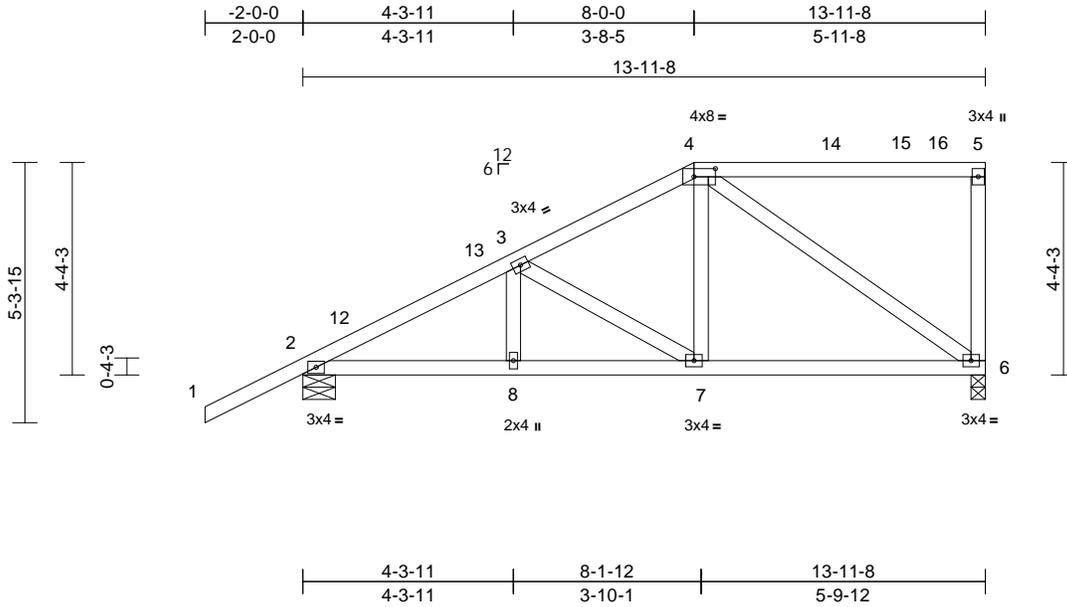

Scale = 1:46.9

Plate Offsets (X, Y): [4:0-5-4,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.34	Vert(LL)	-0.03	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.06	6-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.46	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 76 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-8-0, 6=0-3-8
Max Horiz 2=135 (LC 11)
Max Uplift 2=-51 (LC 12), 6=-12 (LC 9)
Max Grav 2=681 (LC 1), 6=544 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/54, 2-3=-876/43, 3-4=-577/81, 4-5=-82/69, 5-6=-174/57
BOT CHORD 2-8=-185/738, 7-8=-185/738, 6-7=-128/485
WEBS 4-7=0/333, 4-6=-553/101, 3-7=-302/64, 3-8=0/142

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 8-0-0, Zone2 8-0-0 to 12-2-15, Zone1 12-2-15 to 13-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 51 lb uplift at joint 2 and 12 lb uplift at joint 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss F05	Truss Type Half Hip	Qty 1	Ply 1	Spates Job Reference (optional)	T39798786
-----------------	--------------	------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:08
ID:Rbspv5sc6k?OAbCDgyhmTDzvkaH-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

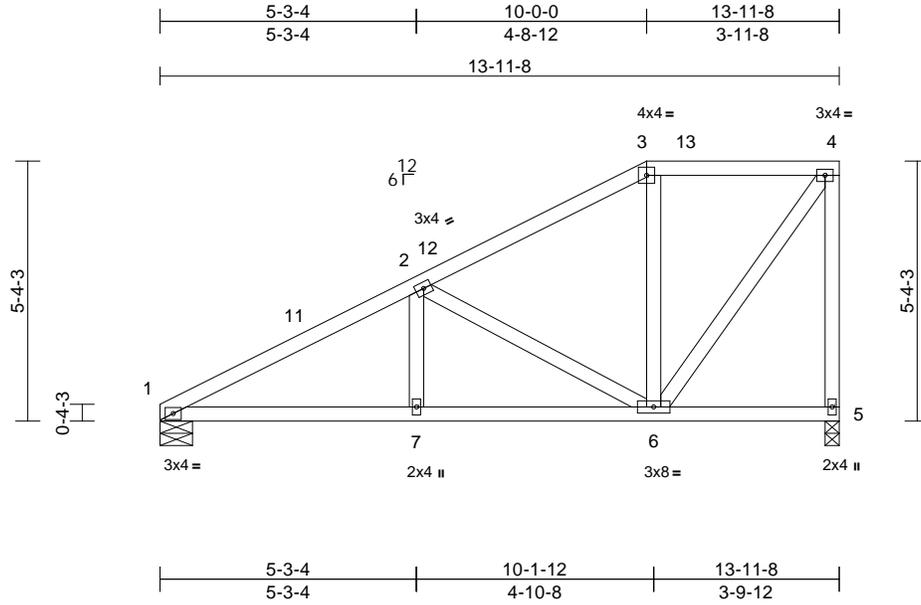

Scale = 1:47.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.24	Vert(LL)	-0.03	7-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.31	Vert(CT)	-0.06	7-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.26	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 78 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 1=0-8-0, 5=0-3-8
Max Horiz 1=152 (LC 11)
Max Uplift 5=-11 (LC 9)
Max Grav 1=553 (LC 1), 5=553 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-874/90, 2-3=-420/94, 3-4=-309/101, 4-5=-518/117
BOT CHORD 1-7=-200/749, 6-7=-200/749, 5-6=-70/80
WEBS 2-6=-498/89, 3-6=-94/114, 4-6=-110/512, 2-7=0/218

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 10-0-0, Zone3 10-0-0 to 13-9-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 5.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job 0126-022	Truss H01	Truss Type Half Hip Girder	Qty 1	Ply 1	Spates Job Reference (optional)	T39798787
-----------------	--------------	-------------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:09

Page: 1

ID:zqgsFZZfl0753Rlcl_W7bzvka1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

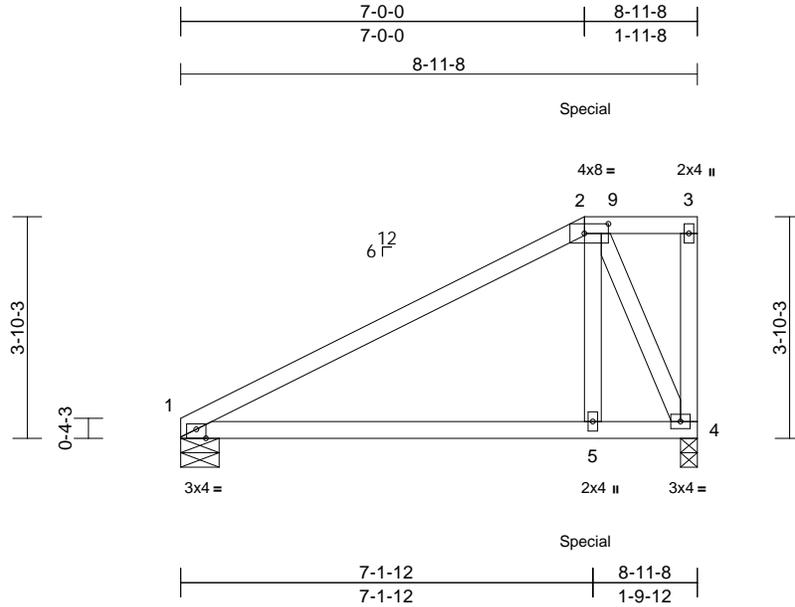

Scale = 1:39.8

Plate Offsets (X, Y): [1:0-2-0,Edge], [2:0-5-0,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.83	Vert(LL)	-0.09	5-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.69	Vert(CT)	-0.19	5-8	>564	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.24	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 43 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-1-5 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=0-8-0, 4=0-3-8
 Max Horiz 1=107 (LC 7)
 Max Uplift 1=-19 (LC 8), 4=-97 (LC 5)
 Max Grav 1=445 (LC 1), 4=804 (LC 13)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-538/60, 2-3=-39/35, 3-4=-54/13
 BOT CHORD 1-5=-63/412, 4-5=-60/437
 WEBS 2-5=0/621, 2-4=-945/86

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 1 and 97 lb uplift at joint 4.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 245 lb down and 130 lb up at 7-0-0 on top chord, and 373 lb down and 10 lb up at 7-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (lb/ft)
 Vert: 1-2=-60, 2-3=-60, 4-6=-20
 Concentrated Loads (lb)
 Vert: 2=-169 (B), 5=-306 (B)



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss H02	Truss Type Half Hip Girder	Qty 1	Ply 1	Spates Job Reference (optional)	T39798788
-----------------	--------------	-------------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:09
ID:4A6n_0DoHefH83wotXjZ8LzvKzq-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

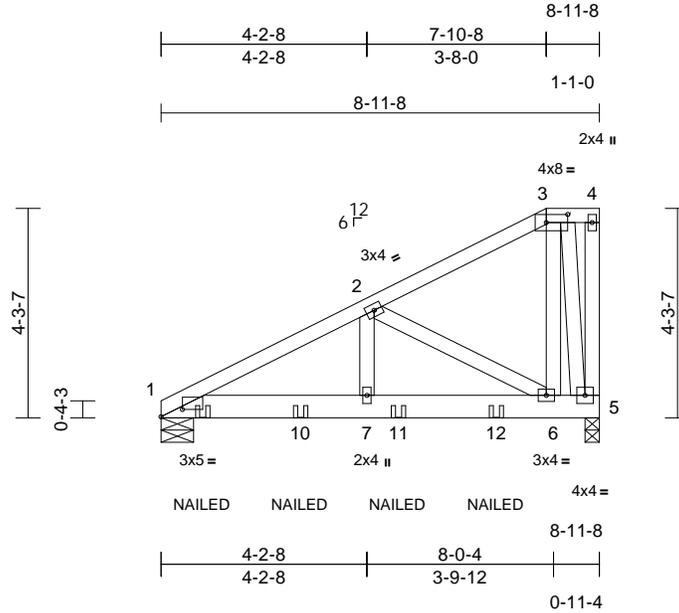

Scale = 1:46.9

Plate Offsets (X, Y): [1:0-5-4,0-1-13], [3:0-5-4,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.22	Vert(LL)	-0.03	7-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.05	7-9	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.35	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 60 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-8-0, 5=0-3-8

Max Horiz 1=118 (LC 24)
Max Grav 1=933 (LC 1), 5=804 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-1301/0, 2-3=-247/0, 3-4=-42/38, 4-5=-28/7
BOT CHORD 1-7=0/1134, 6-7=0/1134, 5-6=0/191
WEBS 2-7=0/735, 2-6=-1105/0, 3-6=0/761, 3-5=-816/0

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 7) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-60, 3-4=-60, 1-5=-20
Concentrated Loads (lb)
Vert: 9=-259 (F), 10=-258 (F), 11=-258 (F), 12=-258 (F)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss J01	Truss Type Jack-Open	Qty 37	Ply 1	Spates Job Reference (optional)	T39798789
-----------------	--------------	-------------------------	-----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:09
ID:p2Zj11419N?NWkj_O3sLiRzvkzq-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

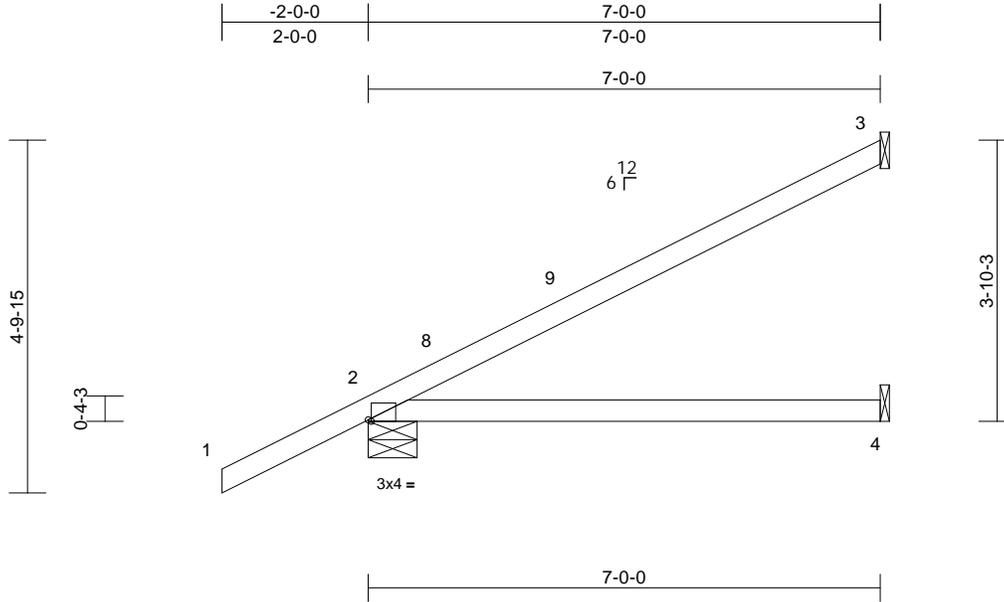

Scale = 1:31.4

Plate Offsets (X, Y): [2:0-0-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.57	Vert(LL)	0.09	4-7	>890	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.20	4-7	>408	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 26 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-8-0, 3= Mechanical, 4= Mechanical

Max Horiz 2=152 (LC 12)
Max Uplift 2=-61 (LC 12), 3=-77 (LC 12)
Max Grav 2=415 (LC 1), 3=202 (LC 17),
4=123 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-3=-231/76
BOT CHORD 2-4=-44/103

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 77 lb uplift at joint 3 and 61 lb uplift at joint 2.

7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 0126-022	Truss J01A	Truss Type Jack-Open	Qty 4	Ply 1	Spates Job Reference (optional)	T39798790
-----------------	---------------	-------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:09
ID:p2Zjj1419N?NWKj_O3sLiRzvkzq-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?#

Page: 1

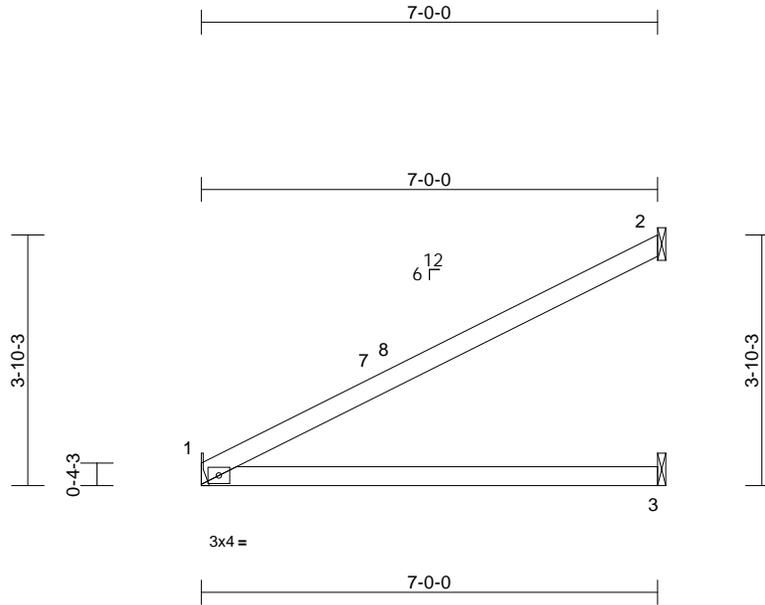

Scale = 1:35.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.63	Vert(LL)	-0.09	3-6	>896	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.22	3-6	>375	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	1	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 22 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 1= Mechanical, 2= Mechanical, 3= Mechanical
Max Horiz 1=83 (LC 12)
Max Uplift 2=-47 (LC 12)
Max Grav 1=278 (LC 1), 2=191 (LC 1), 3=126 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-115/68
BOT CHORD 1-3=-75/108

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 6-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 47 lb uplift at joint 2.

8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

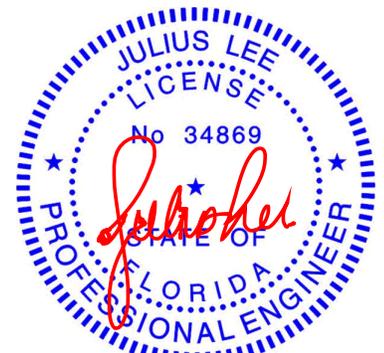

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Spates	T39798791
0126-022	J01B	Jack-Open	8	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:09
 ID:HE75yN4fwh8E8UIAynNaFezvzpz-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

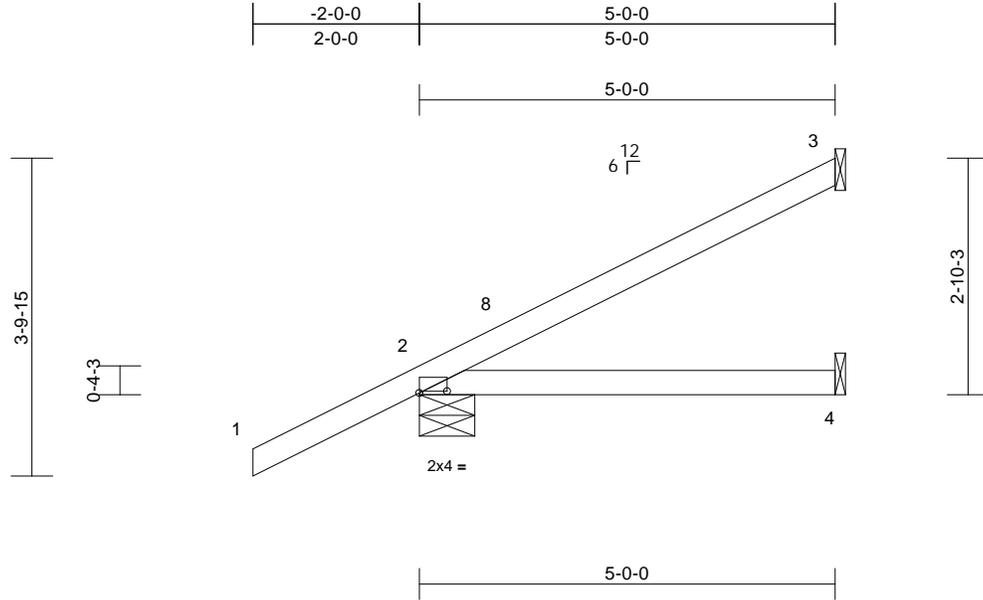

Scale = 1:27.6

Plate Offsets (X, Y): [2:0-4-0,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.26	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.23	Vert(CT)	-0.05	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 19 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 3= Mechanical, 4= Mechanical
 Max Horiz 2=119 (LC 12)
 Max Uplift 2=-64 (LC 12), 3=-50 (LC 12)
 Max Grav 2=342 (LC 1), 3=135 (LC 17), 4=86 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-3=-216/72
 BOT CHORD 2-4=-75/138

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
 Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
 B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 3 and 64 lb uplift at joint 2.

7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss J02	Truss Type Jack-Open	Qty 13	Ply 1	Spates Job Reference (optional)	T39798792
-----------------	--------------	-------------------------	-----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:10
ID:HE75yN4fwh8E8UIAynNaFezvzpz-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?fi

Page: 1

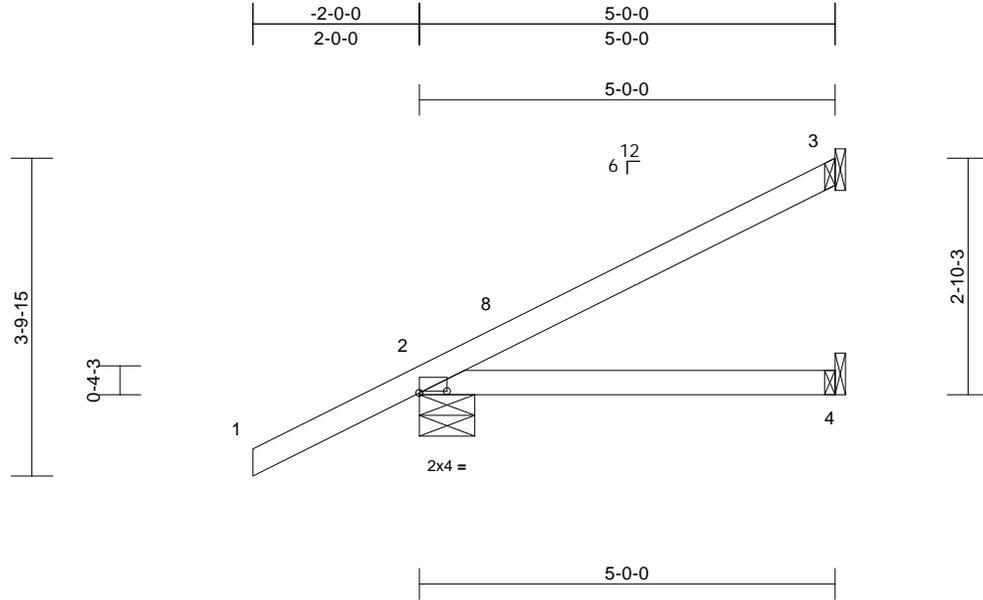

Scale = 1:27.6

Plate Offsets (X, Y): [2:0-4-0,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.26	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.23	Vert(CT)	-0.05	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 19 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-8-0, 3= Mechanical, 4= Mechanical
Max Horiz 2=119 (LC 12)
Max Uplift 2=-64 (LC 12), 3=-50 (LC 12)
Max Grav 2=342 (LC 1), 3=135 (LC 17), 4=86 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-3=-216/72
BOT CHORD 2-4=-75/138

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 3 and 64 lb uplift at joint 2.

7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Spates	T39798793
0126-022	J03	Jack-Open	19	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:10
 ID:HE75yN4fwh8E8UIAynNaFezvzpz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

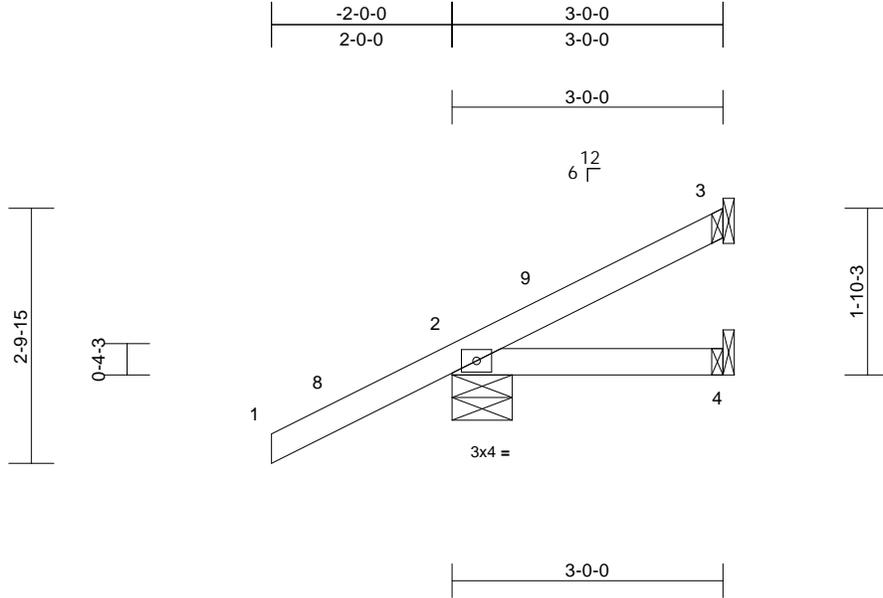

Scale = 1:25.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.27	Vert(LL)	0.00	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	-0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 13 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-8-0, 3= Mechanical, 4= Mechanical
 Max Horiz 2=85 (LC 12)
 Max Uplift 2=-72 (LC 12), 3=-22 (LC 12)
 Max Grav 2=278 (LC 1), 3=67 (LC 17), 4=47 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/54, 2-3=-185/92
 BOT CHORD 2-4=-102/157

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
 Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
 B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 2-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 3 and 72 lb uplift at joint 2.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Spates	T39798794
0126-022	J03A	Jack-Open	3	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:10
 ID:HE75yN4fwh8E8UIAynNaFezvzp-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

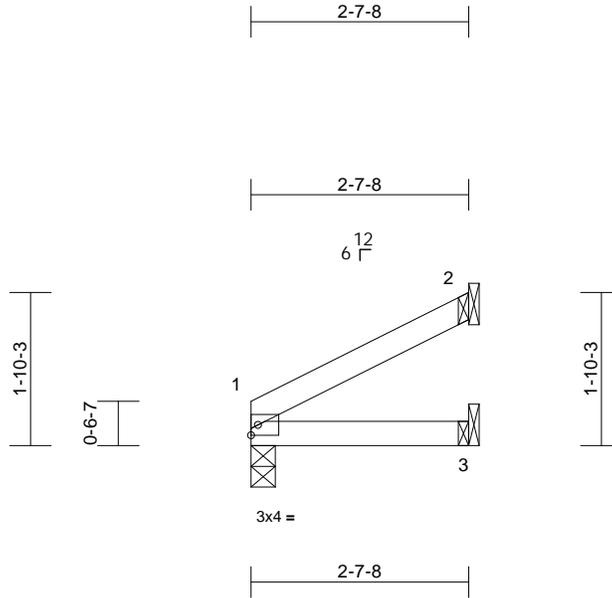

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.08	Vert(LL)	0.00	3-6	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	0.00	3-6	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	1	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 8 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-7-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-3-8, 2= Mechanical, 3= Mechanical
 Max Horiz 1=31 (LC 12)
 Max Uplift 2=-19 (LC 12)
 Max Grav 1=103 (LC 1), 2=69 (LC 1), 3=48 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-55/24
 BOT CHORD 1-3=-84/40

6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 2.
LOAD CASE(S) Standard

- NOTES**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Spates	T39798795
0126-022	J04	Jack-Open	22	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:10
 ID:HE75yN4fwh8E8UIAynNaFezvzpz-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

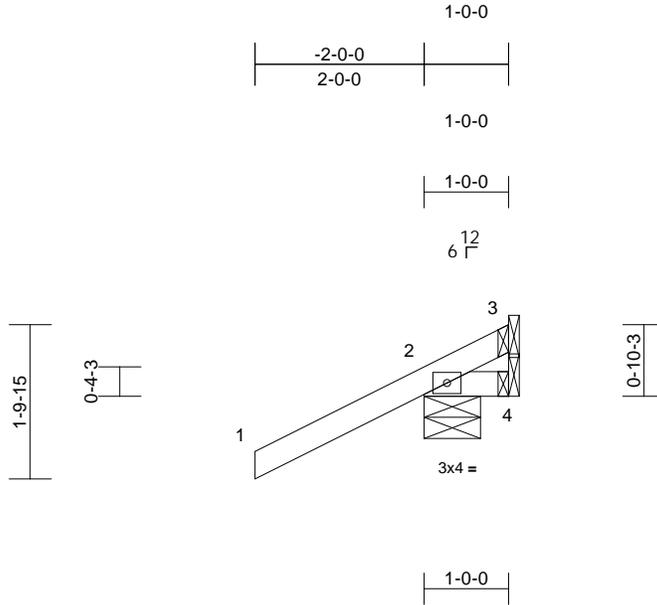

Scale = 1:27.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.27	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	0.00	7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 7 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-8-0, 3= Mechanical, 4= Mechanical
 Max Horiz 2=53 (LC 12)
 Max Uplift 2=-116 (LC 12), 3=-29 (LC 1), 4=-53 (LC 1)
 Max Grav 2=281 (LC 1), 3=20 (LC 12), 4=37 (LC 12)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-3=-126/87
 BOT CHORD 2-4=-103/142

6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 116 lb uplift at joint 2, 53 lb uplift at joint 4 and 29 lb uplift at joint 3.

LOAD CASE(S) Standard

- NOTES**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

January 14,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job 0126-022	Truss J06	Truss Type Jack-Open	Qty 1	Ply 1	Spates Job Reference (optional)	T39798796
-----------------	--------------	-------------------------	----------	----------	------------------------------------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Tue Jan 13 15:47:10
ID:HE75yN4fwh8E8UIAynNaFezvzp-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

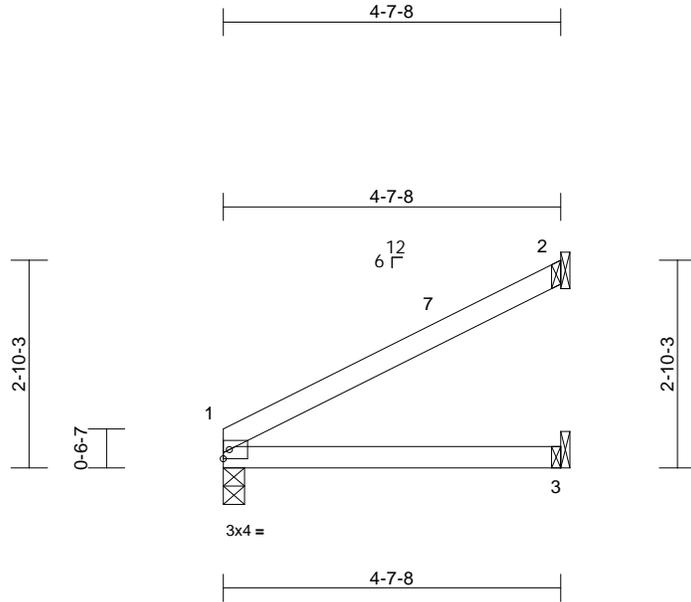

Scale = 1:31.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.28	Vert(LL)	0.02	3-6	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.22	Vert(CT)	-0.04	3-6	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	1	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 15 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 1=0-3-8, 2= Mechanical, 3= Mechanical

Max Horiz 1=55 (LC 12)

Max Uplift 2=-33 (LC 12)

Max Grav 1=183 (LC 1), 2=125 (LC 1), 3=85 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-162/57

BOT CHORD 1-3=-193/84

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 0-0-0 to 3-0-0,
Zone1 3-0-0 to 4-6-12 zone; cantilever left and right
exposed ; end vertical left and right exposed;C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 33 lb uplift at joint
2.

7) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 14, 2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

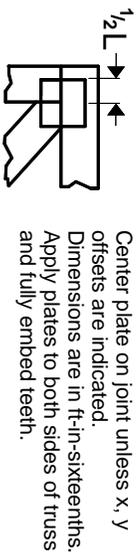

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

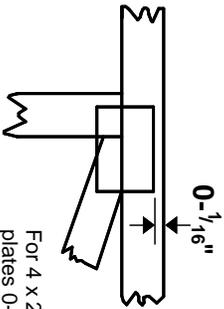

For 4 x 2 orientation, locate plates 0- 1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITtek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

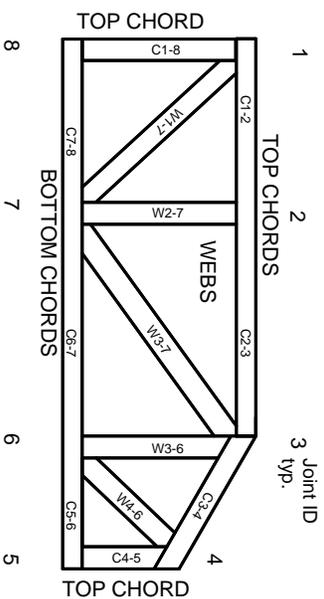

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1-1988, ESR-2-362, ESR-2-685, ESR-3-282
ESR-4-722, ESL-1-388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITtek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek®

MITtek Engineering Reference Sheet: Mill-7473 rev. 1/2/2023