




**LEFT**  
SCALE: 1/4" = 1'-0"

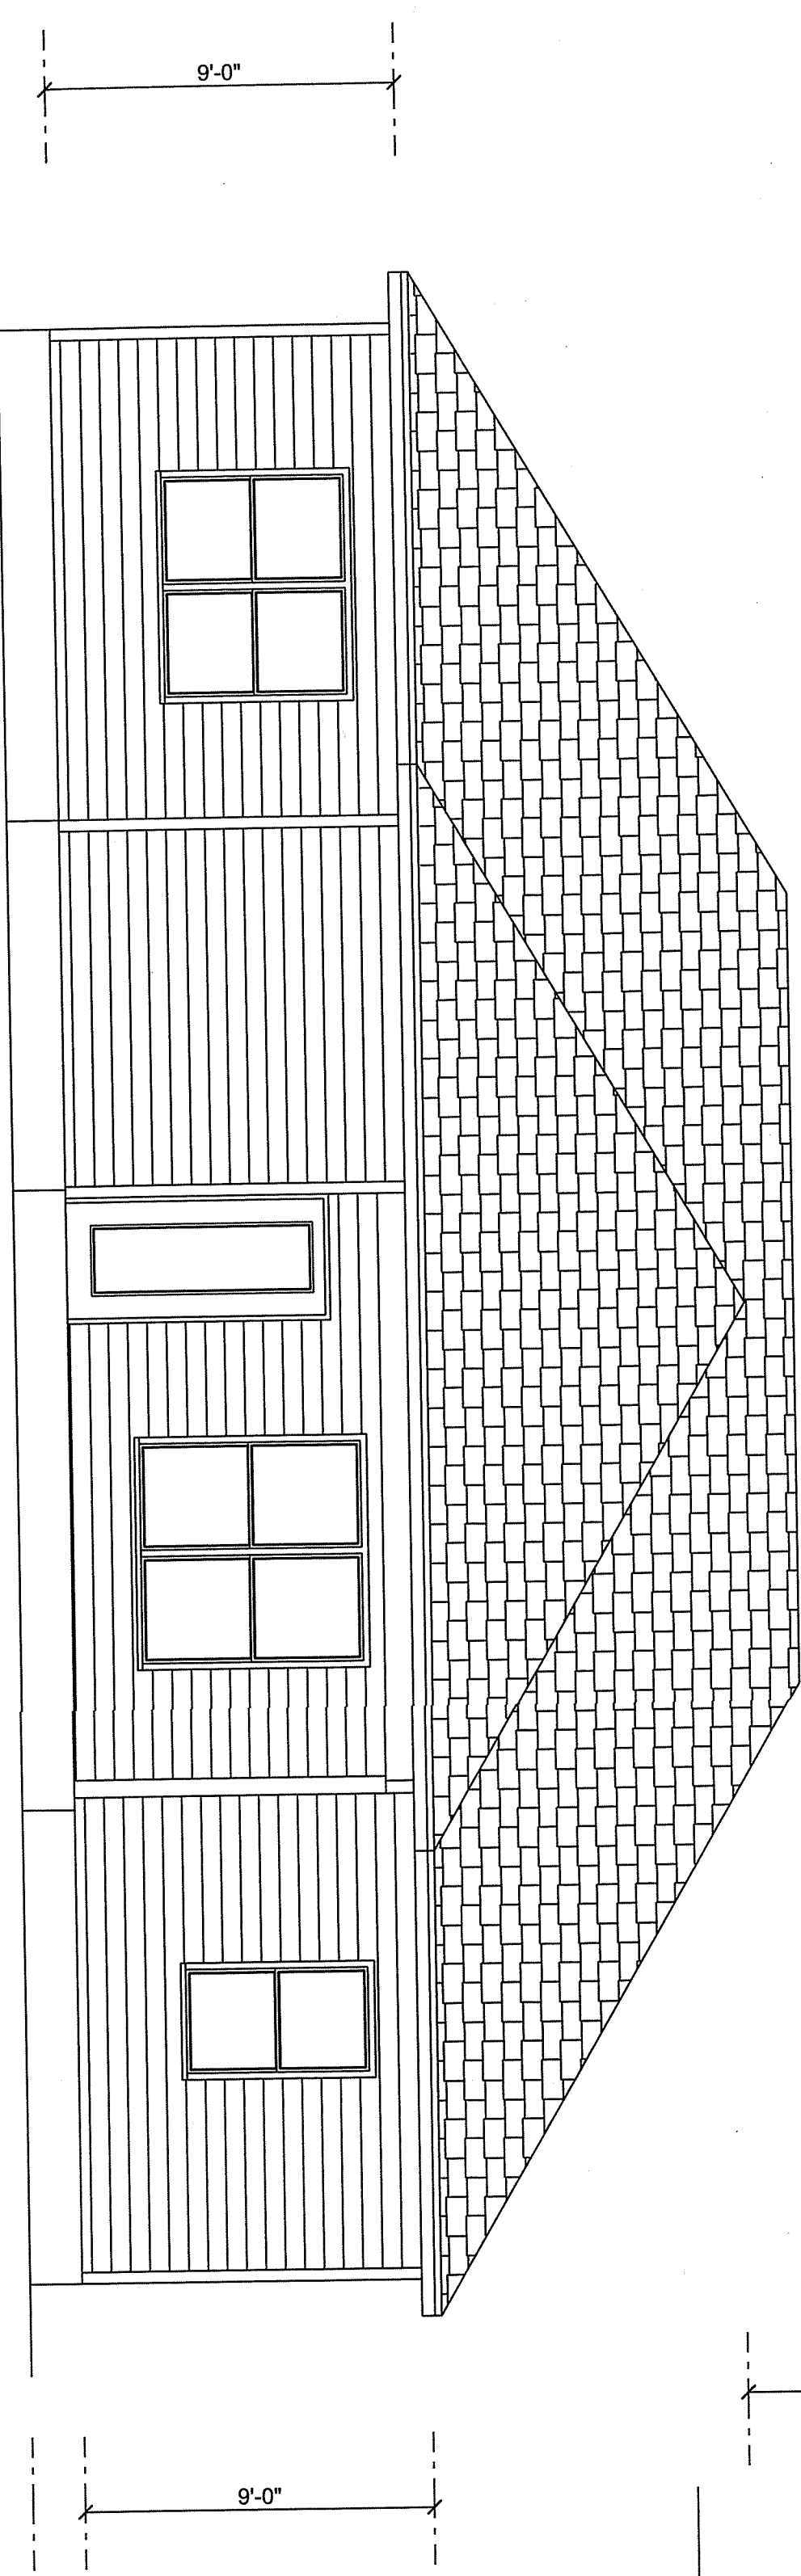

**REAR**  
SCALE: 1/4" = 1'-0"

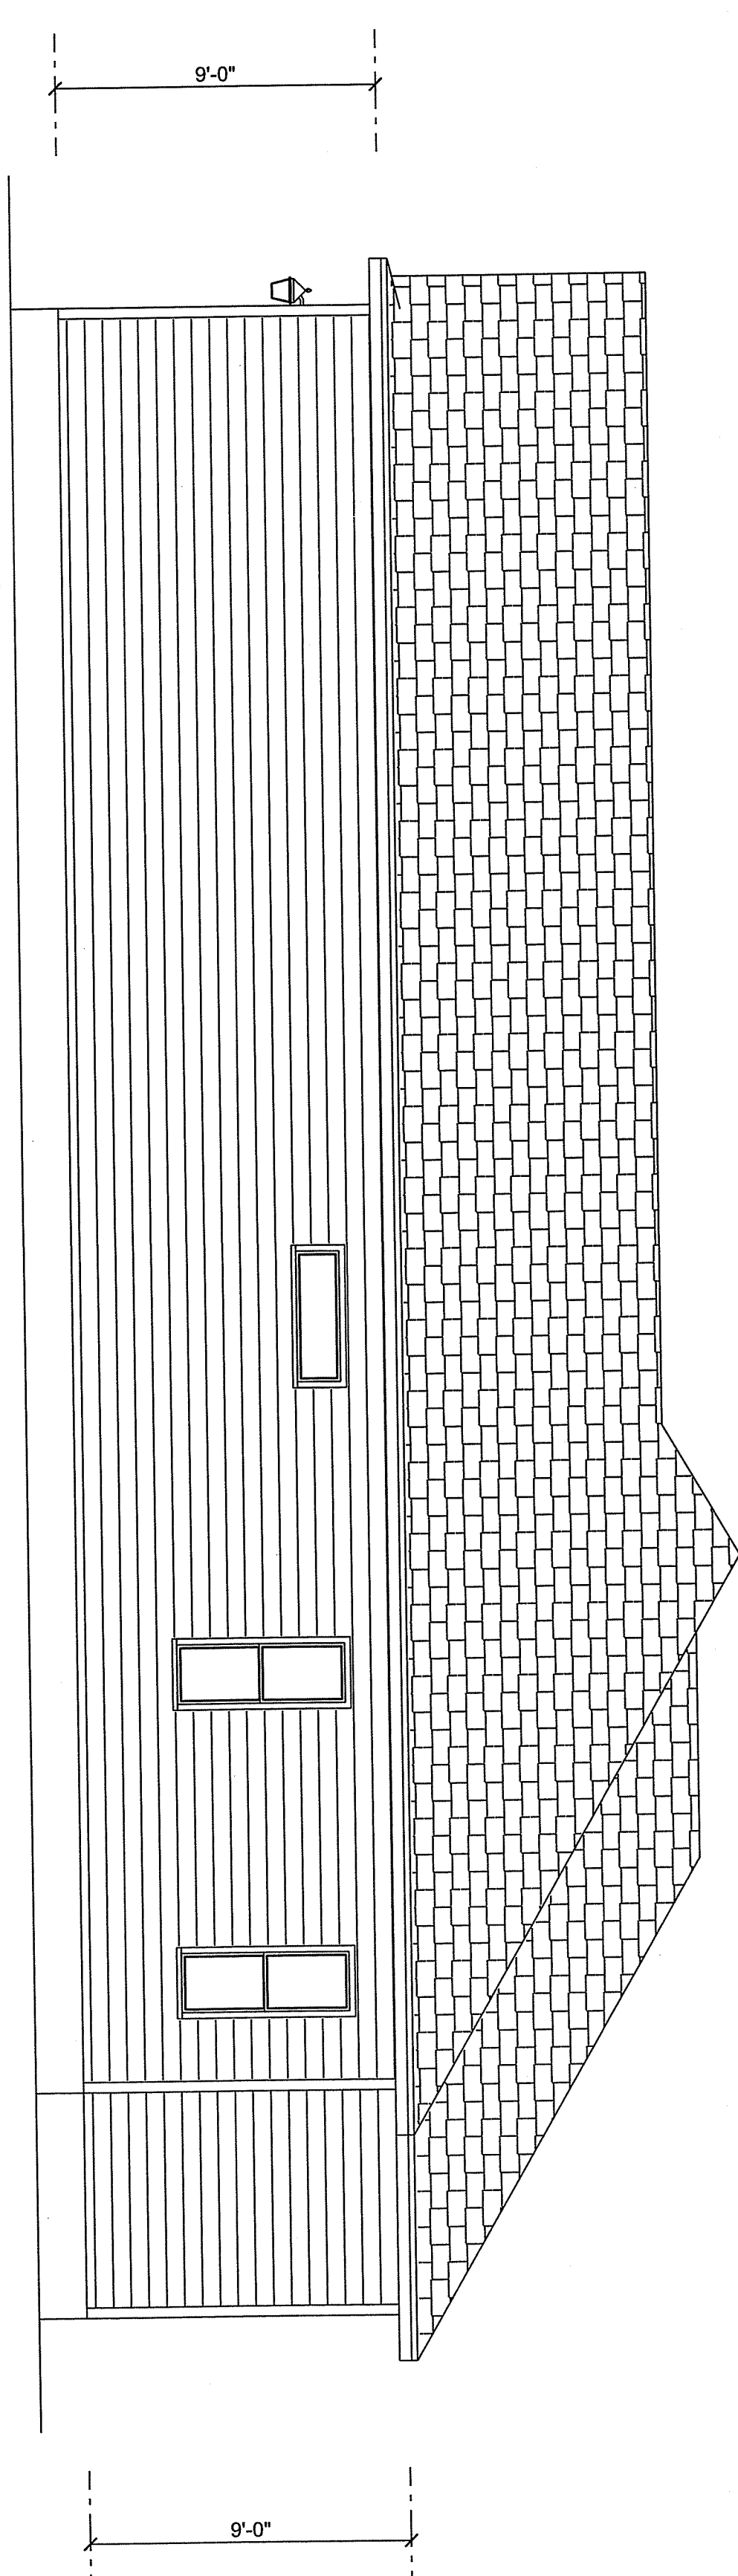


**RIGHT**  
SCALE: 1/4" = 1'-0"

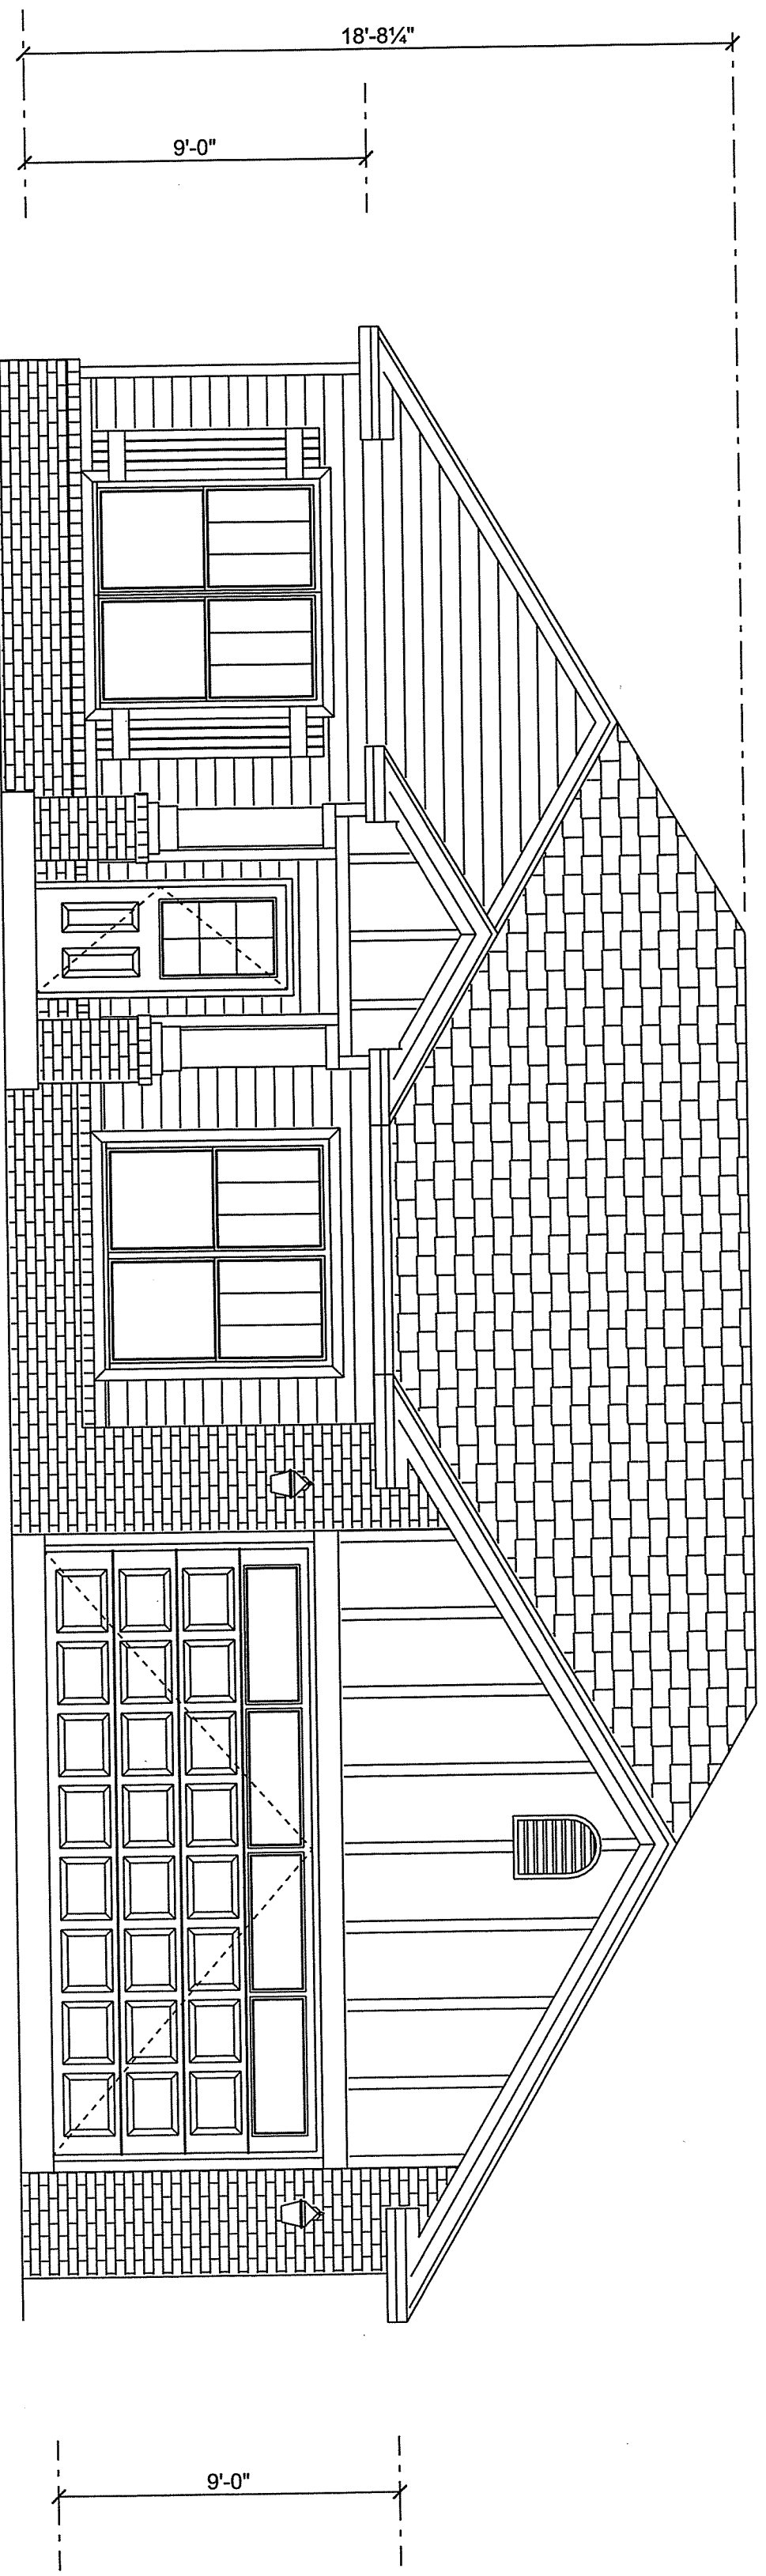

**Front**  
SCALE: 1/4" = 1'-0"


CONCRETE / MASONRY /  
METALS GENERAL NOTES:

- DESIGN SOIL BEARING PRESSURE: 1000 PSF.
- EXPANSIVE SOILS, WHERE DIRECTED BY THE SOILS ENGINEER, SOIL ADAPTATION PER THE SOILS ENGINEER'S SPECIFICATIONS SHALL BE IMPLEMENTED PRIOR TO BEGIN ANY FOUNDATIONS. TESTS AS SPECIFIED SHALL BE PERFORMED TO DETERMINE THE STABILITY OF THE SUB-GRADE TO SUPPORT THE DESIGN LOADS.
- CLEAN SAND FILL OVER STRIPPED AND COMPACTED EXISTING GD, SHALL BE PLACED IN 12" LIFTS. BOTH SUB-SOIL AND FILL COMPACT-  
TION SHALL BE NOT LESS THAN 98% AS MEASURED BY A MODIFIED PROCTOR TEST AT THE RATE OF ONE TEST FOR EACH 1000 SF OF BUILDING PAD AREA, OR FRACTION THEREOF, FOR EACH 12" LIFT.
- REINFORCING STEEL SHALL BE GRADE 60 AND MEET THE REQUIRE-  
MENTS OF ASTM A63. ALL BENDS SHALL BE MADE COLD.
- WELDED WIRE MESH SLAB REINFORCING SHALL MEET THE REQUIRE-  
MENTS OF ASTM A185 - MIN. YIELD STRESS = 65 KSI.
- CONCRETE SHALL BE STANDARD MIX F.C. = 3000 PSI FOR ALL FTGS.  
SLABS, COLUMNS AND BEAMS OR SHALL BE STANDARD PIPE MIX F.C. =  
3000 PSI. STRENGTH SHALL BE ATTAINED WITHIN 28 DAYS OF PLACE-  
MENT. MIXING, PLACING AND FINISHING SHALL BE AS PER ACI  
STANDARDS.
- CONCRETE BLOCK SHALL BE AS PER MANUFACTURER'S PRODUCT  
GUIDE FOR ASTM C-90 REQUIREMENTS WITH MEDIUM SURFACE FINISH -  
Fm = 1800 PSI.
- MORTAR SHALL BE TYPE "M" OR "N" FOR ALL MASONRY UNITS.
- STRUCTURAL STEEL SHALL CONFORM TO ASTM A36 STANDARDS FOR  
STRENGTH. BOLTS SHALL BE ASTM A307 / GRADE I OR A325, AS PER  
PLAN REQUIREMENTS.
- WELDS SHALL BE AS PER "AMERICAN WELDING SOCIETY" STANDARDS  
FOR STRUCTURAL STEEL APPLICATIONS.

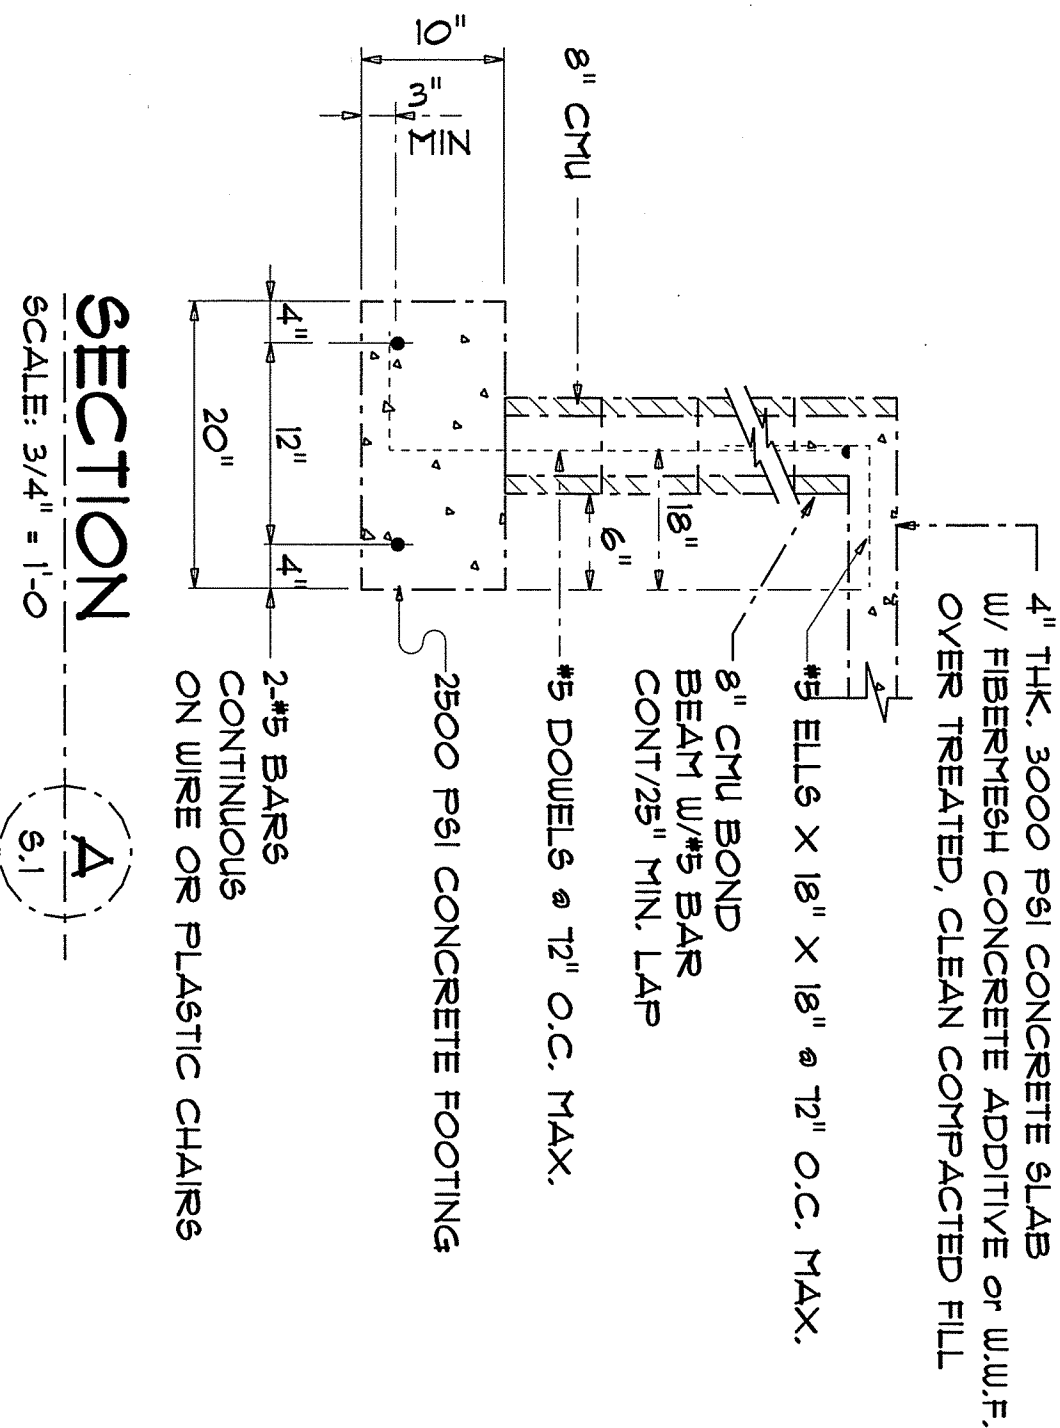


NOTE:  
THE DESIGN WIND SPEED FOR THIS  
PROJECT IS 120 MPH PER 2020 FBC 1603  
AND LOCAL JURISDICTION REQUIREMENTS


NOTE:  
ADDED FILL SHALL BE APPLIED IN 8" LIFTS -  
EACH LIFT SHALL BE COMPACTED TO 98% DRY  
COMPACTION PER THE "MODIFIED PROCTOR"  
METHOD.

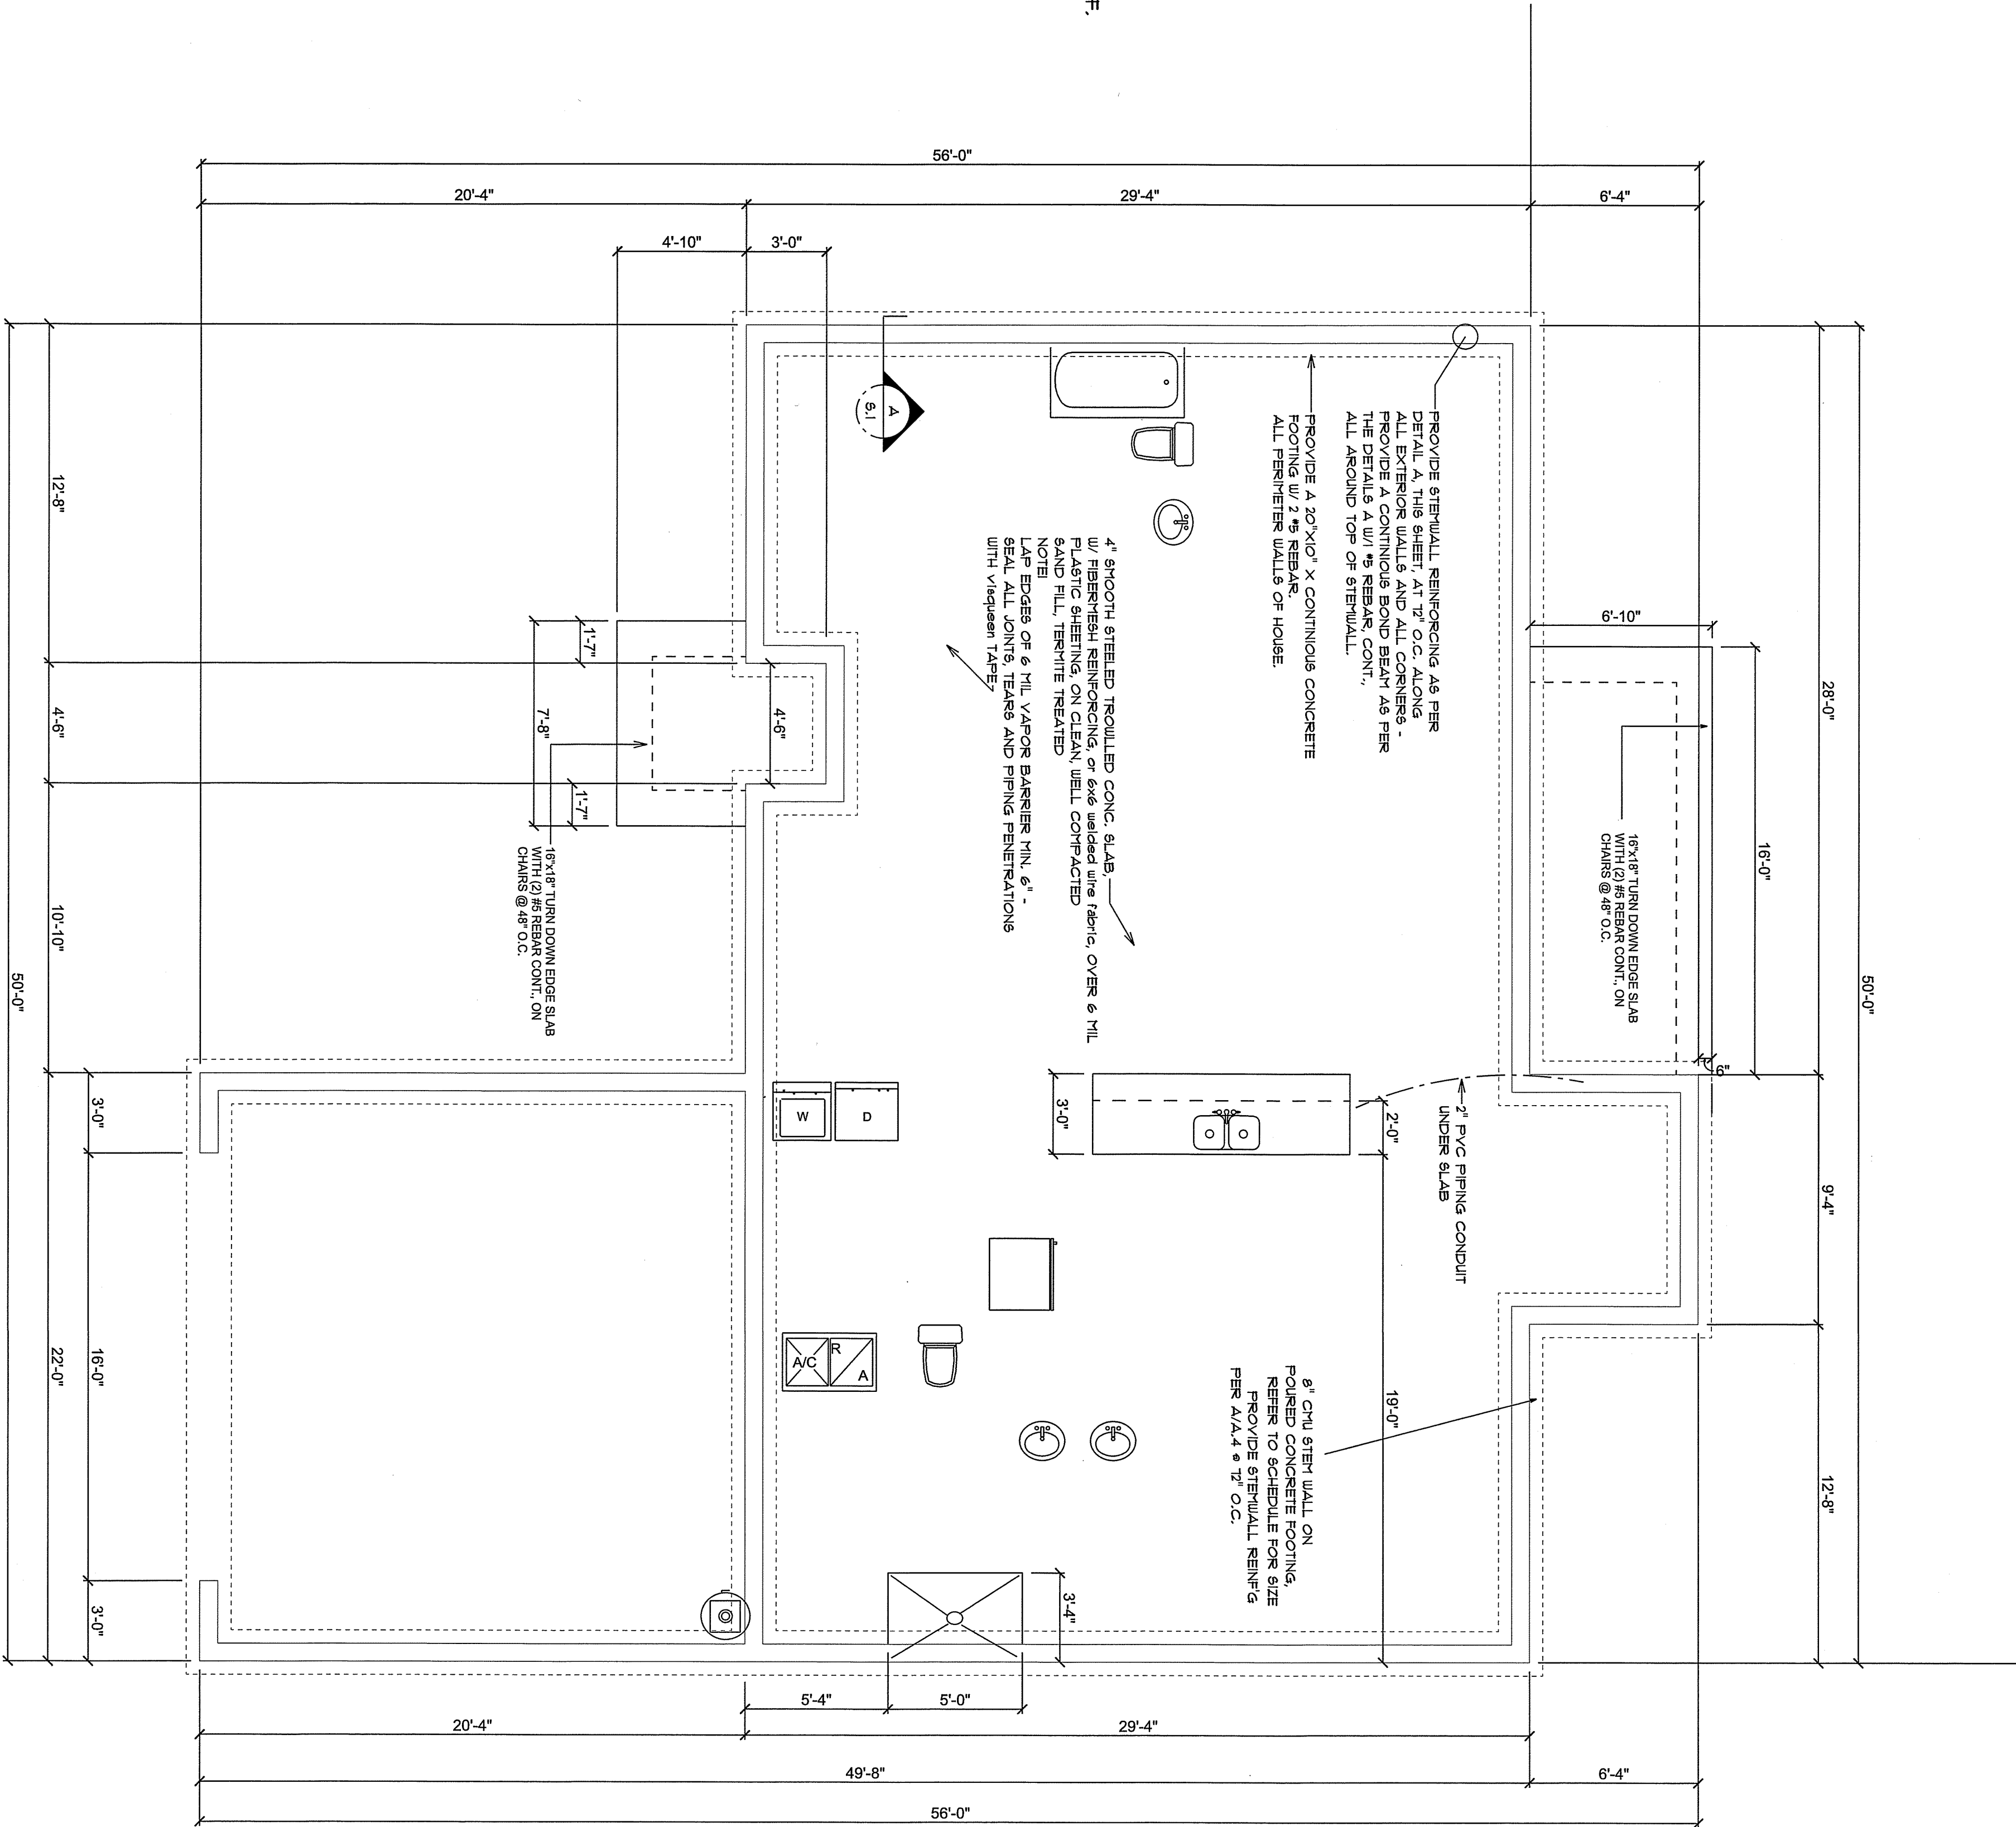

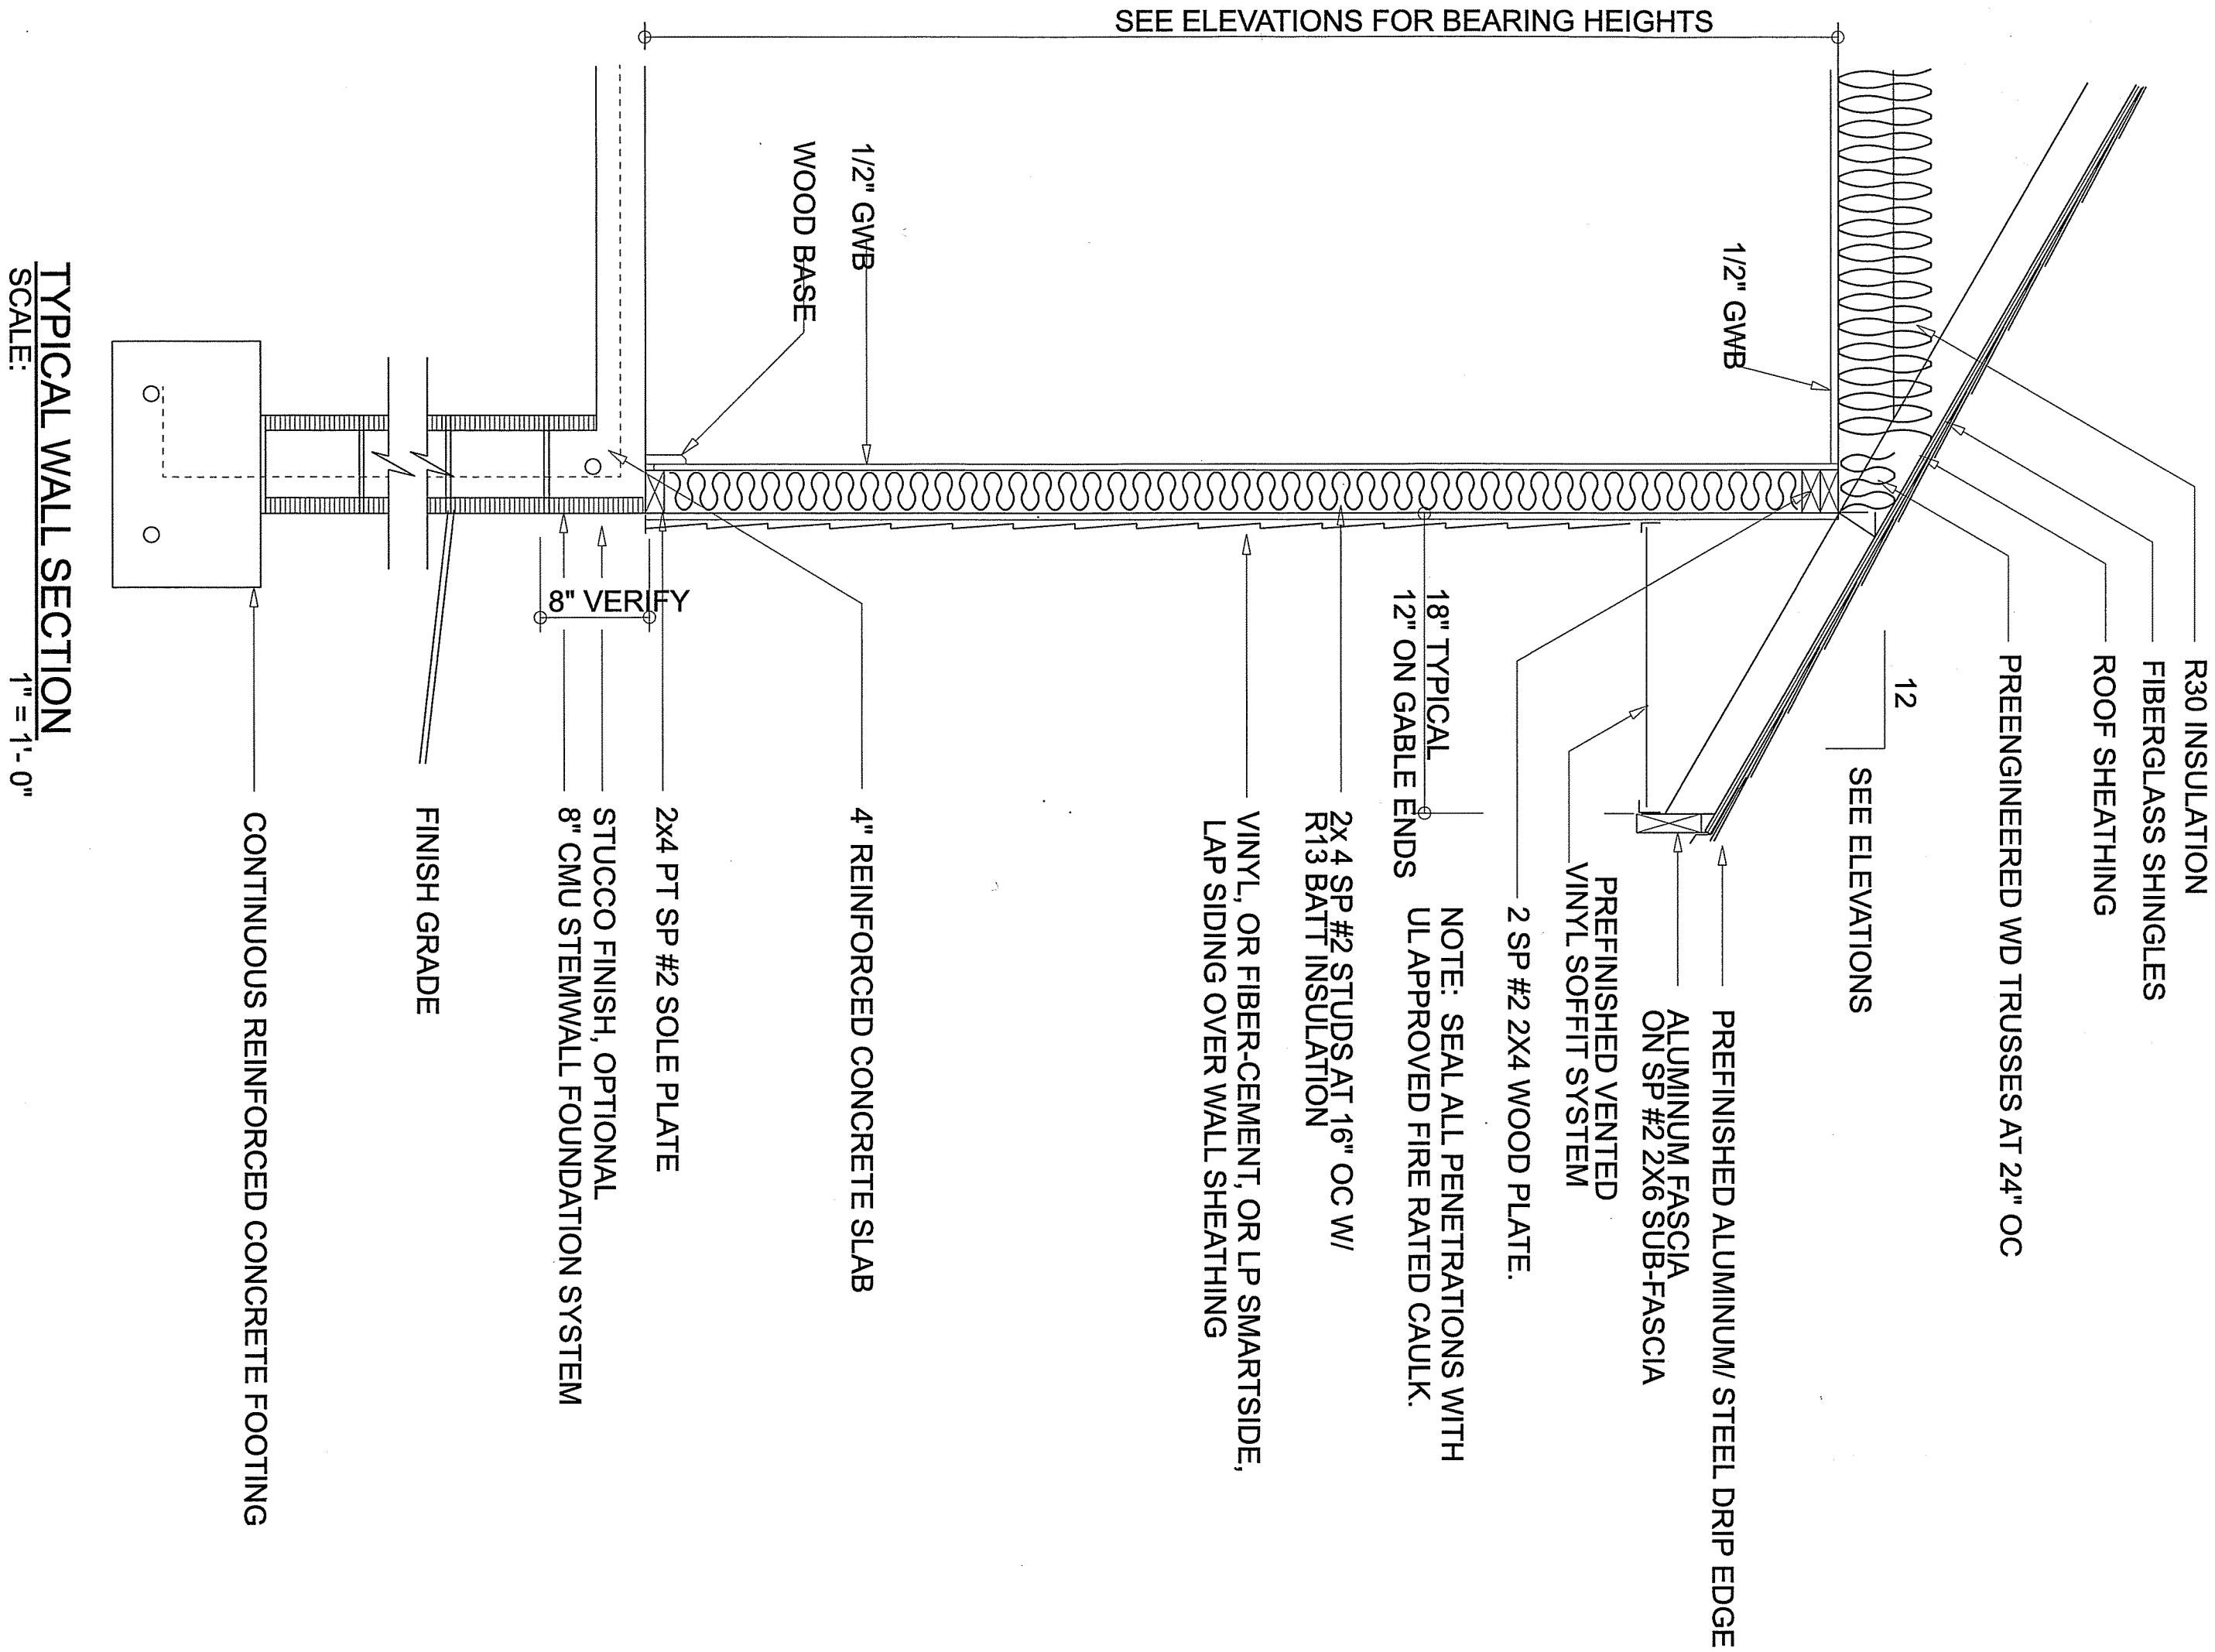





















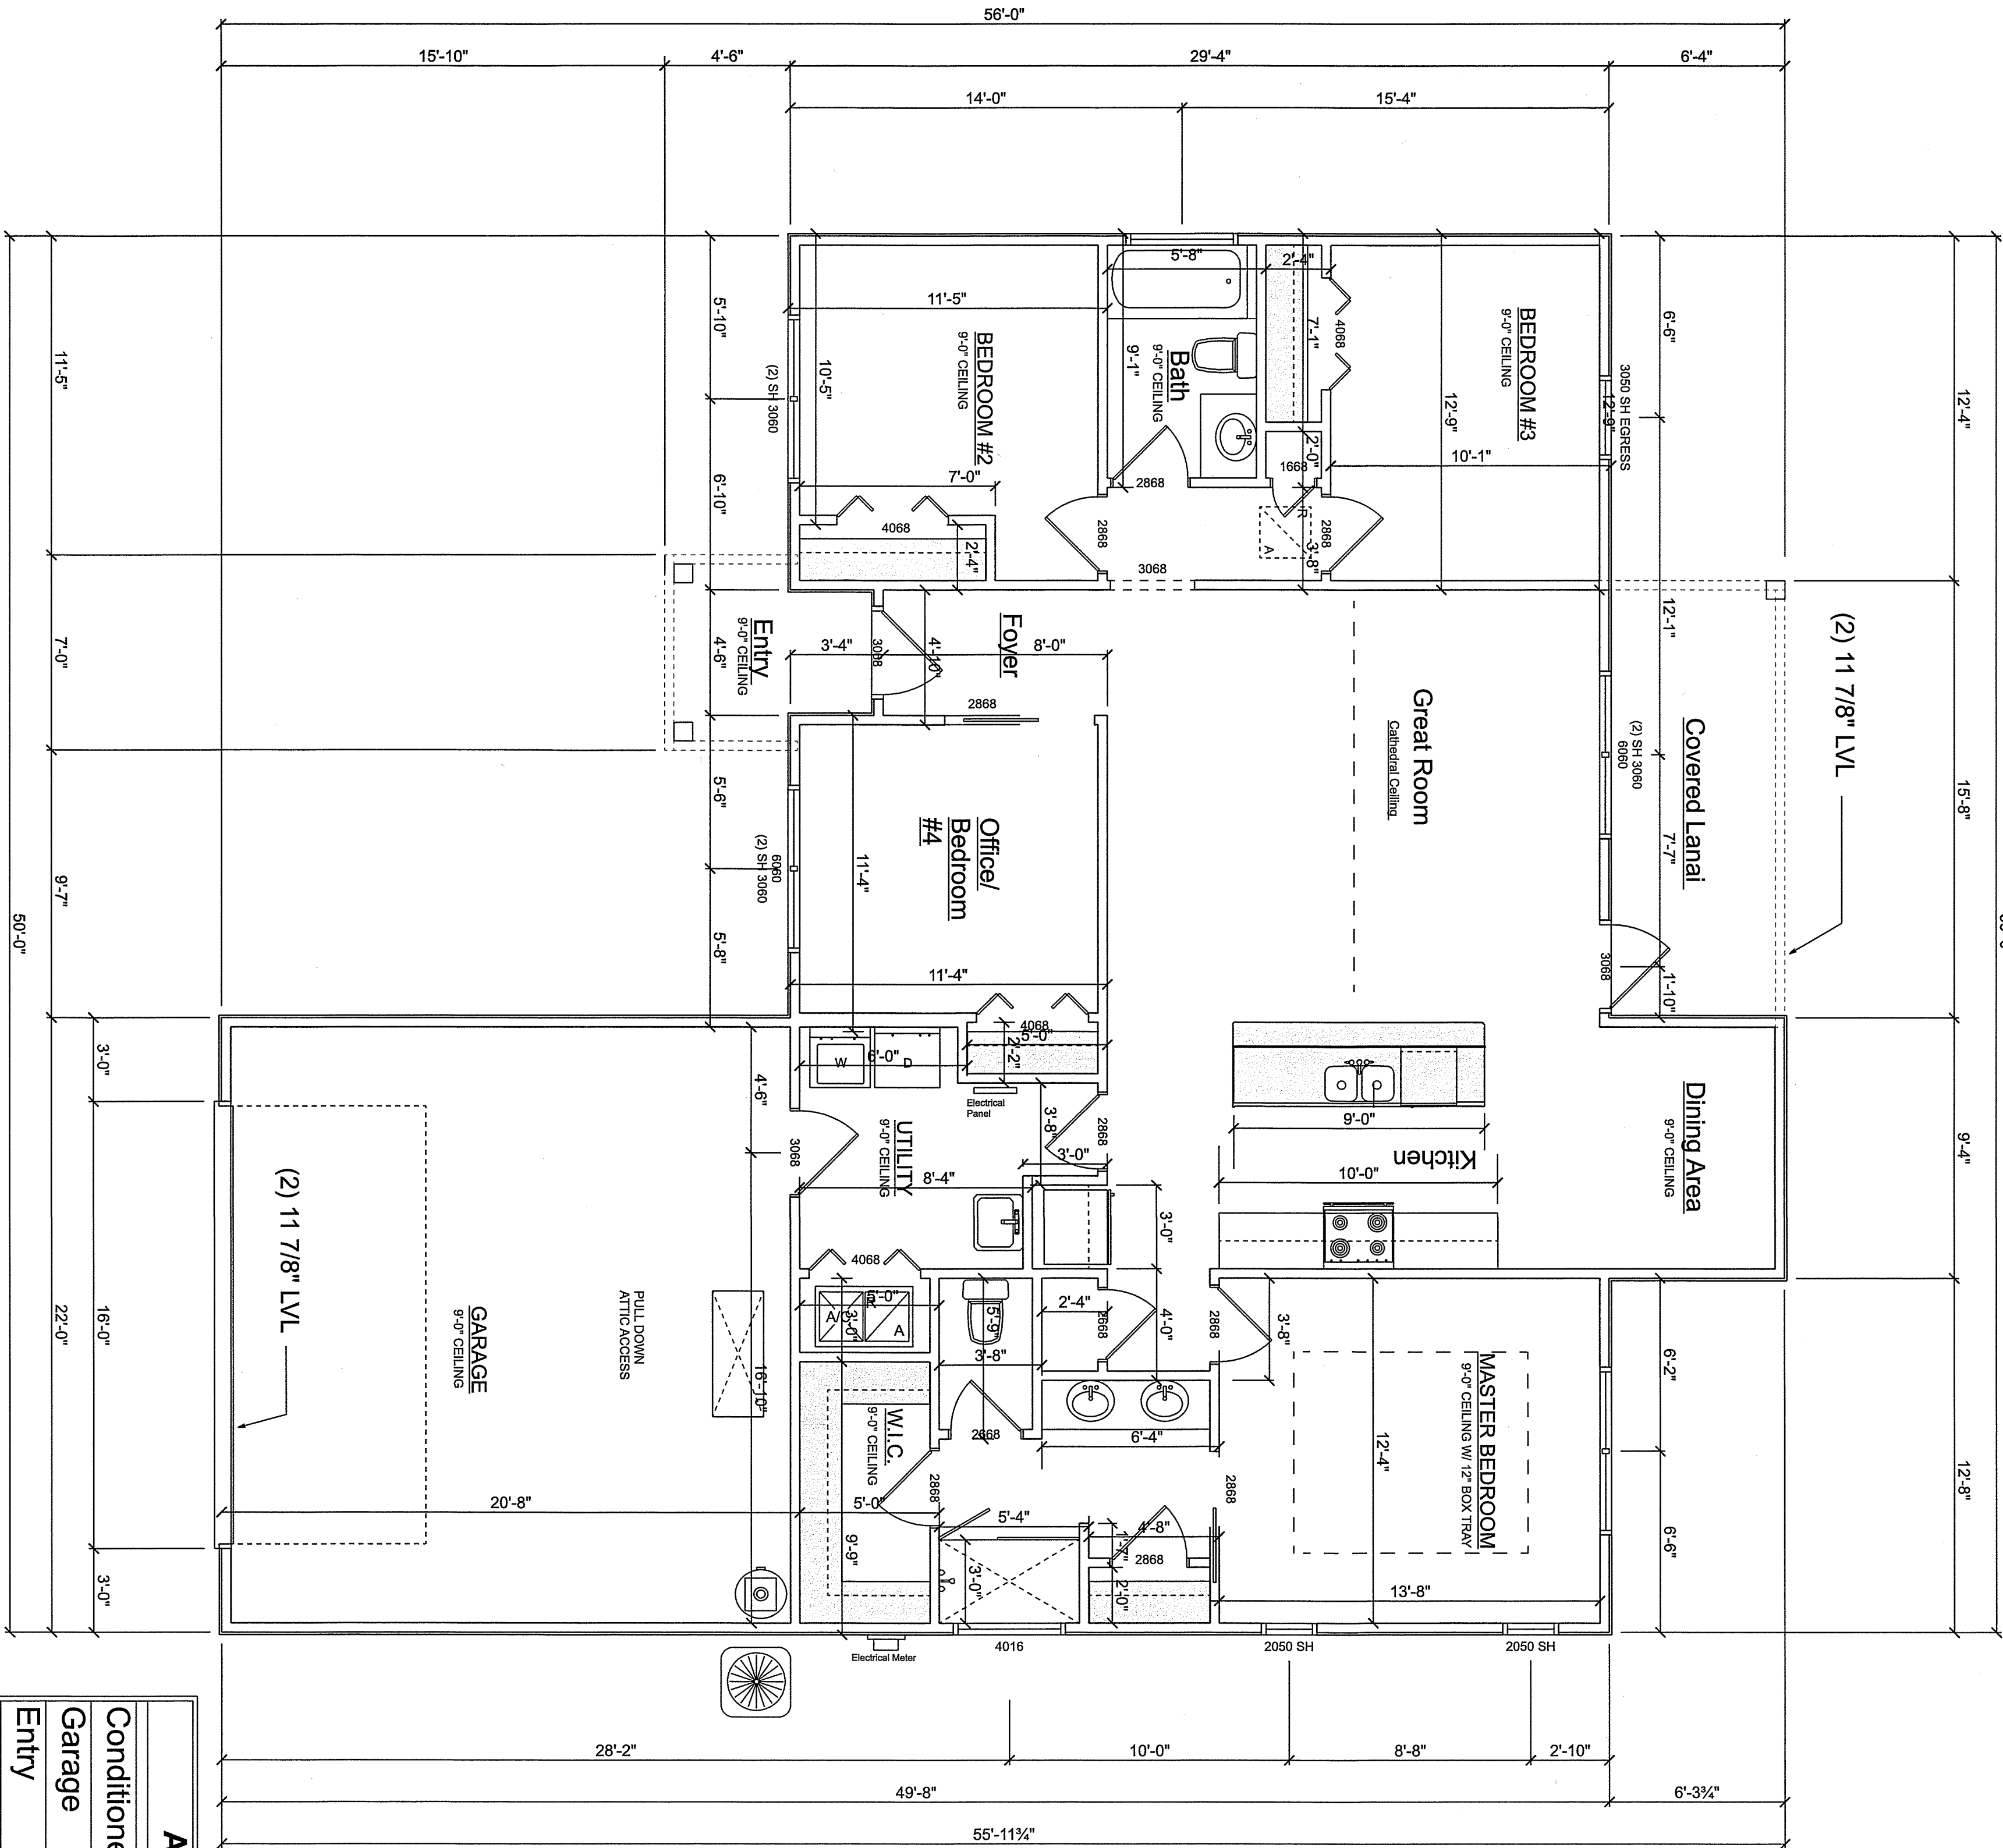






TYPICAL WALL SECTION  
SCALE: 1/4" = 1'-0"




Dimensioned Floor Plan  
SCALE: 1/4" = 1'-0"

AREA SCHEDULE	
Conditioned Space	1525 sq ft.
Garage	453 sq ft.
Entry	44 sq ft.
Lanai	97 sq ft.
Total	2119 sq ft.

ELECTRICAL LEGEND		
ELECTRICAL	COUNT	SYMBOL
ceiling fan 4 bladed 01	5	
can light 6inch	7	
ceiling light 38	3	
chandelier 03	1	
fluorescent light 1 x 4	2	
fluorescent light 2 x 4	1	
exterior light 03	1	
spotlight double	3	
LAN connection	6	
cable tv outlet	6	
fan	3	
light	9	
outlet	29	
outlet 220v	3	
outlet gfi	13	
outlet wp	5	
outlet-contemporary	1	
smoke detector	6	
switch	5	
switch double	9	
switch double - rocker style	1	
switch quad	1	
switch triple	3	
vanity bar light 02	1	
wall mounted 01 2 lights	2	

Electrical Plan - ELECTRICAL


SCALE: 1/4" = 1'-0"

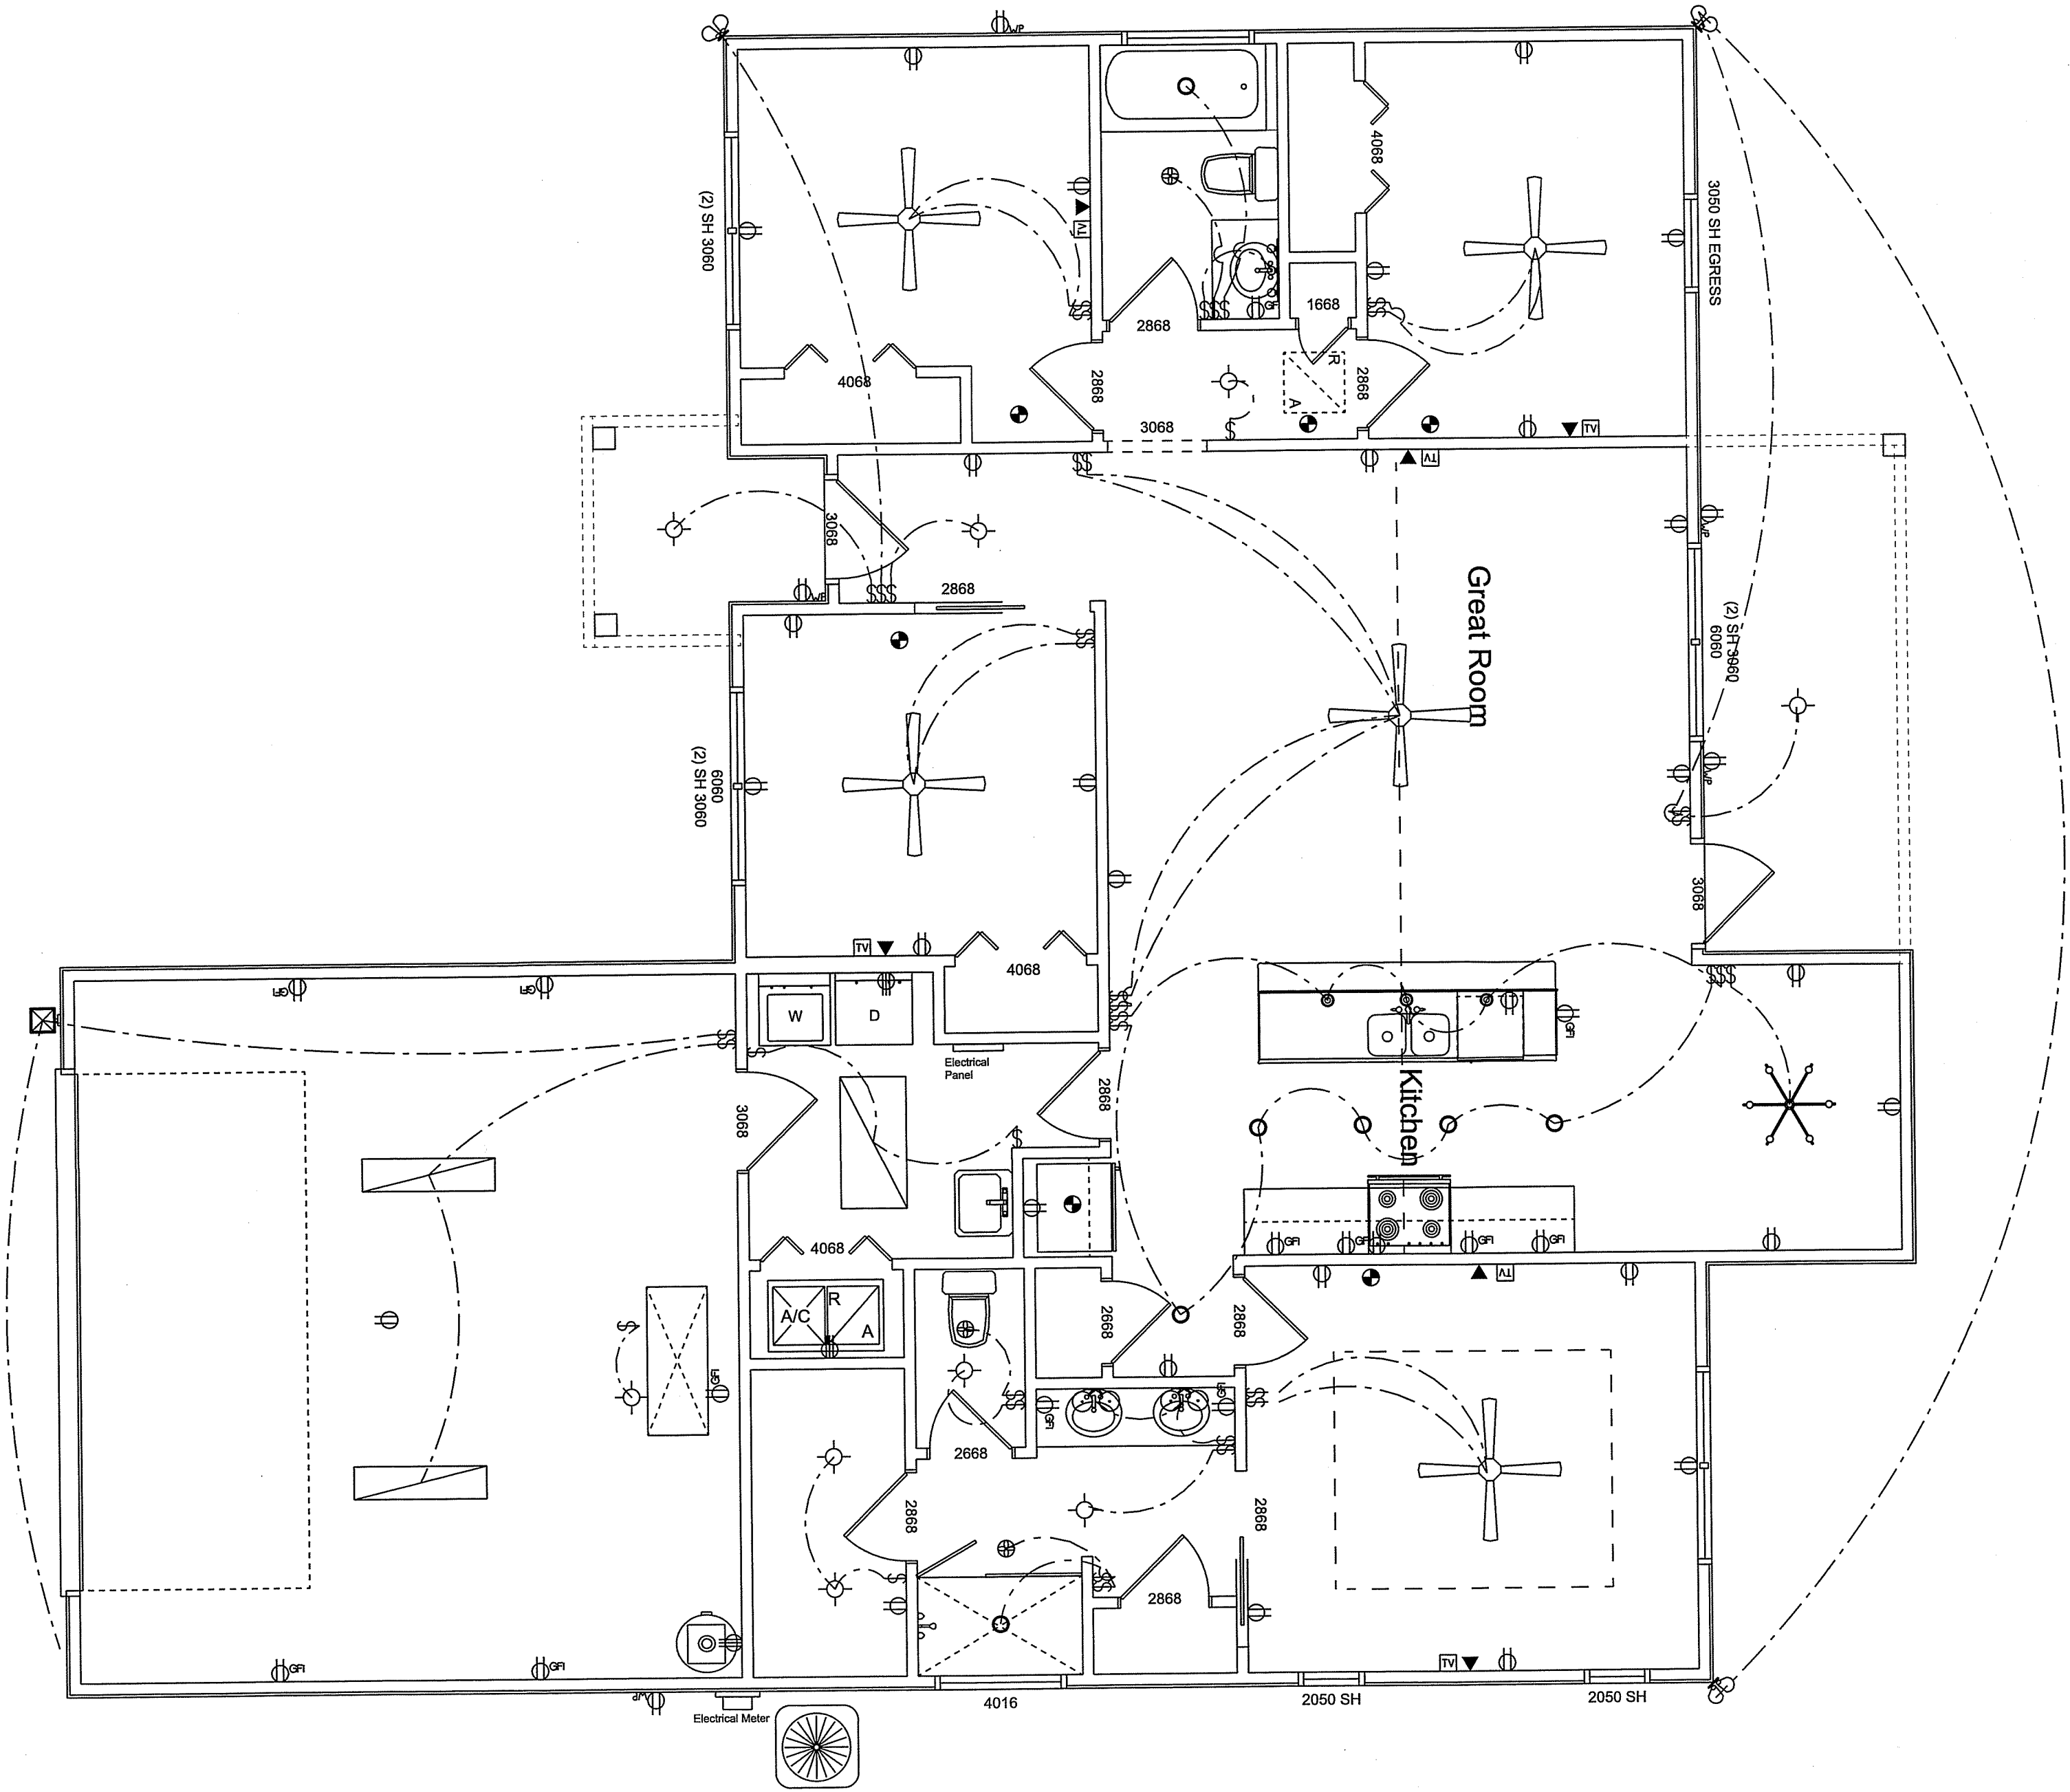

WOOD STRUCTURAL NOTES


1. TEMPORARY BRACING OF THE STRUCTURE DURING ERECTION, REQUIRED FOR SAFE AND STABLE CONSTRUCTION, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR SO ENGAGED. TEMPORARY & PERMANENT BRACING OF ROOF TRUSSES SHALL BE AS PER THE STANDARD GUIDELINES OF THE TRUSS PLATE INSTITUTE.
2. ALL TRUSSES SHALL BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER & SHALL BE SIGNED AND SEALED BY SAID ENGINEER. TRUSS DESIGN SHALL INCLUDE PLACEMENT PLANS, TRUSS DETAILS, TRUSSES TO TRUSS CONNECTIONS & THE STANDARD SPECIFICATIONS & RECOMMENDATIONS OF INSTALLATION OF THE TRUSS PLATE INSTITUTE.
3. WOOD STUDS IN EXTERIOR WALLS & INTERIOR BEARING WALLS SHALL BE NOT LESS THAN N.2 HEM-FIR OR BETTER.
4. CONNECTORS FOR WOOD FRAMING SHALL BE GALVANIZED METAL OR BLACK METAL AS MANUFACTURED AND SHALL BE OF A DESIGN SUITABLE FOR THE LOADS AND USES INTENDED. REFER TO THE JOINT REINFORCEMENT SCHEDULE FOR PRINCIPLE CONNECTIONS.

AREA OF ATTIC	REQ'D L.F. OF VENT	NET FREE AREA OF VENT
1600 SF	20 LF	480 SQ.IN.
1800 SF	24 LF	576 SQ.IN.
2000 SF	28 LF	672 SQ.IN.
2200 SF	32 LF	768 SQ.IN.
2400 SF	36 LF	864 SQ.IN.
2600 SF	40 LF	960 SQ.IN.
2800 SF	44 LF	1056 SQ.IN.
3000 SF	48 LF	1152 SQ.IN.

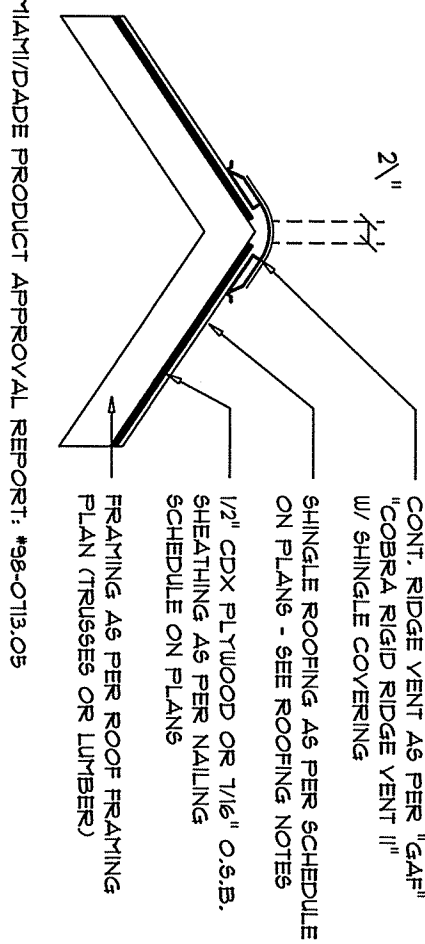

Ridge Vent Detail  
SCALE: 3/4" = 1'-0"

B

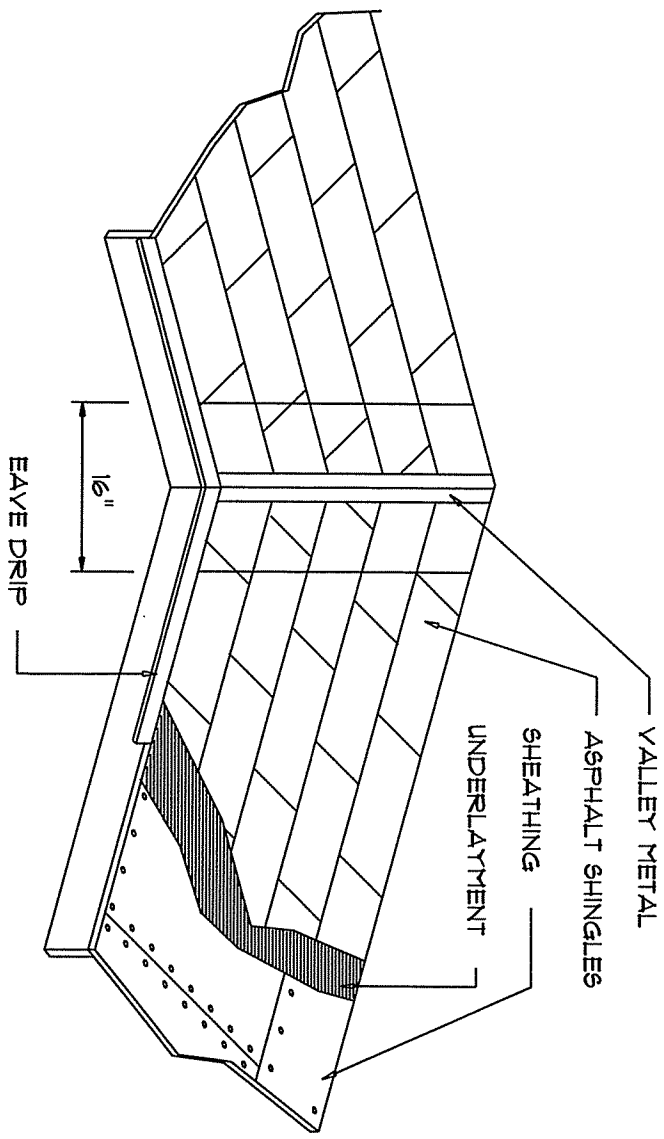

Valley Flashing

Roofing Metals for Flashing/Roofing			
Minimum Thickness Requirements			
MATERIAL	MINIMUM THICKNESS (in)	GAGE	WEIGHT (OZ.)
COPPER			16
ALUMINUM	0.024		
STAINLESS STEEL		28	
GALVANIZED STEEL	0.0175	34 ZINC COATED G90	
ZINC ALLOY LEAD	0.027		
PAINTED TERNE			40

Roofing/Flashing Dets.  
SCALE: NONE

A

12/13/2022  
PK-0022

ANCHOR BEAM TO ENDLINE POSTS  
W/ "SIMPSON" HST24 OR THRU  
BOLTED W/ (2) 5/8" BOLTS

9'-0" TOP OF BEAM

9'-0" TOP OF PLATE

FASTEN TOP PLATE WITH 1/4" NAILS AT  
12" O.C. TYPICAL TO

2X6 SUB-FASCIA TYPICAL & ALL  
TRUSS EAVES & GABLE ENDS

CONSTRUCT EXTERIOR WALLS W/ 2 TOP PLATES & 1 SILL  
PLATE, 2X4 STUDS @ 16" O.C.  
W/ 1/2" WOODS CRE. APPLIED W/ 8d COMMON NAILS @ 4" O.C.  
ALONG EDGES & 8" O.C. ALONG INTERMEDIATE SUPPORTS

9'-0" TOP OF PLATE

9'-0" TOP OF PLATE

Continuous Ridge Vent, GAF CORREA Ridge Vent

9'-0" TOP OF BEAM

9'-0" TOP OF PLATE

ANCHOR BEAM TO ENDLINE POSTS  
W/ "SIMPSON" HST24 OR THRU  
BOLTED W/ (2) 5/8" BOLTS

Roof Framing Plan  
SCALE: 1/4" = 1'-0"

NOTE: REFERENCE TRUSS ENGINEERING II

NOTE:  
ANCHOR GIRDERS TRUSSED TO HEADER  
W/ "SIMPSON" HST24 OR THRU  
ANCHOR BEAM TO KING STUDS W/  
2 "SIMPSON" 572 EA. END - TYP. TO.

NOTE:  
RESISTANCE TO THE WIND-UPDRAUGHT  
W/ "SIMPSON" HST24 OR THRU  
MINIMUM 6X6 HEADERS AND ALTERNATES  
MINIMUM 6X6 ALLOWABLE IS 25K10.

ROOF PLAN NOTES




- R-1 SEE ELEVATIONS FOR ROOF PITCH
- R-2 ALL OVERHANG 8" (2" on gables)  
UNLESS OTHERWISE NOTED
- R-3 PROVIDE ATTIC VENTILATION IN 4:6  
CORONA WITH SCHEDULE ON 8D3
- R-4 SEE EXTERIOR ELEVATIONS AND FLOOR  
PLANS TO VERIFY PLATE AND HILL HEIGHTS
- R-5 MOVE ALL VENTS AND OTHER  
ROOF PENETRATIONS TO REAR

NOTE:  
ROOF W/ 1/2" CDX PLYWOOD PLACED  
W/ LONG DIMENSION PERPENDICULAR TO THE  
ROOF TRUSSES, SECURE TO FRAMING W/ 8d  
NAILS - AS PER DETAIL ON SHEET 8D.4


NOTE:  
THE DESIGN WIND SPEED FOR THIS  
PROJECT IS 115 MPH PER FBC 1609  
AND LOCAL JURISDICTION REQUIREMENTS

Roof plan  
SCALE: 1/4" = 1'-0"






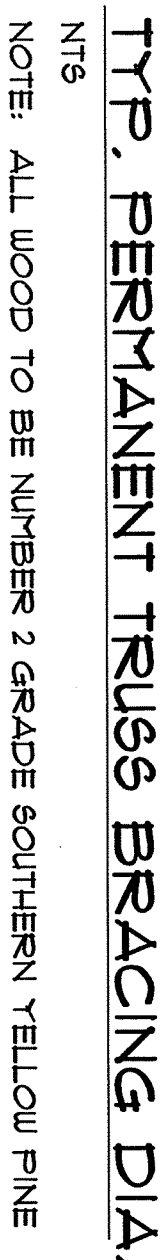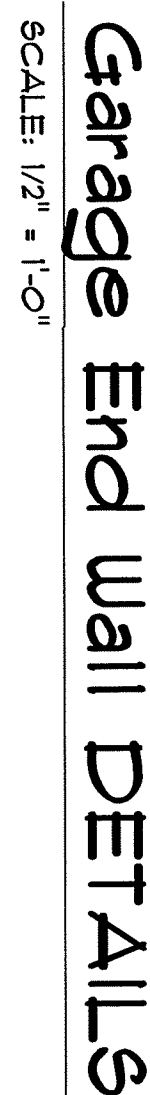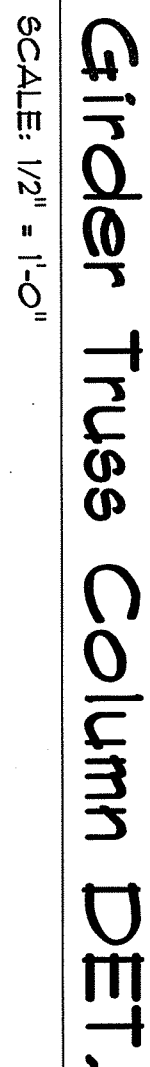

## SCALE: AS NOTED



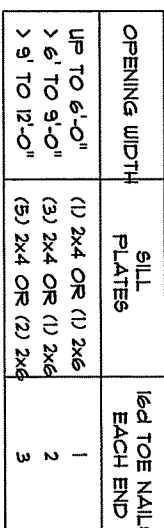


1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD O.C. DETAIL 105.4A.
2. THE WALL SHALL BE FINISHED WITH INTERIOR AND EXTERIOR OPENINGS.
3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH NAILS FOR JOINTS AND SCREWS FOR EDGES. PROVIDE CORNER REINFORCING MEMBERS OR LONG BUCKING.
4. NAIL SPACING SHALL BE 4" O.C. EDGES AND 6" O.C. IN THE FIELD.
5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE BETWEEN OPENINGS SHALL BE THE WALL HEIGHTS FOR 6" O.C. WALLS IS 9'3".
6. ALL HEADS USED SHALL BE DETLETED WHEN HEADS LATER BEING USED - 1974/4.

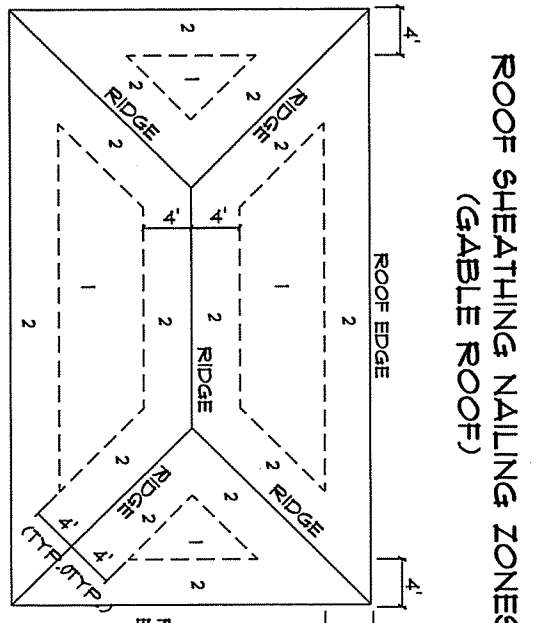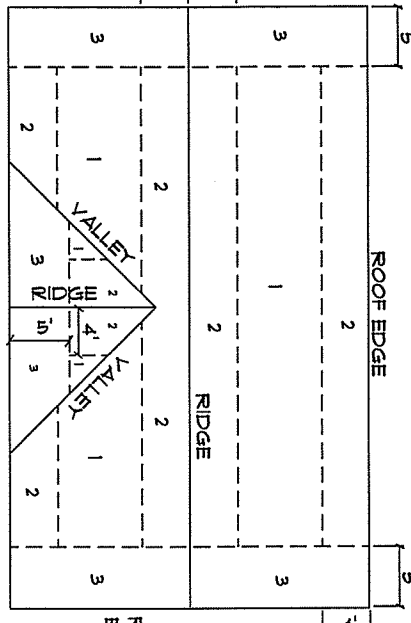
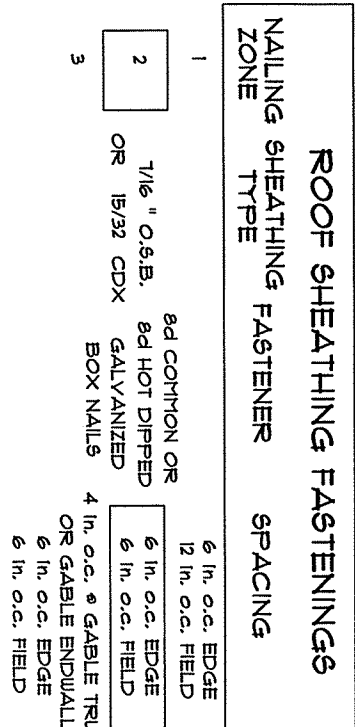


## SCALE: NONE


		BUILDING WIDTH (FT)					
		20'		26'		36'	
HEADERS, SUPPORTING,	HEADER 6/12E	SPAN 3'-6"	JACKS 1	SPAN 3'-2"	JACKS 1	SPAN 2'-0"	JACKS 1
	2'-2x4	3'-6"	1	4'-8"	1	4'-2"	1
	2'-2x6	5'-5"	1	5'-11"	1	5'-4"	1
	2'-2x8	6'-10"	2	7'-3"	2	6'-6"	2
	2'-2x10	8'-5"	2	1'-3"	2	1'-6"	2
	2'-2x12	9'-9"	2	8'-5"	2	8'-2"	2
	3'-2x8	8'-4"	1	1'-5"	1	6'-8"	1
	3'-2x10	10'-6"	1	9'-1"	2	8'-2"	1
	3'-2x12	12'-2"	2	10'-1"	2	9'-5"	2
	4'-2x8	9'-2"	1	8'-4"	1	9'-2"	1
ROOF, CEILING	4'-2x10	11'-8"	1	10'-6"	1	9'-5"	1
	4'-2x12	14'-1"	1	12'-2"	2	10'-11"	1

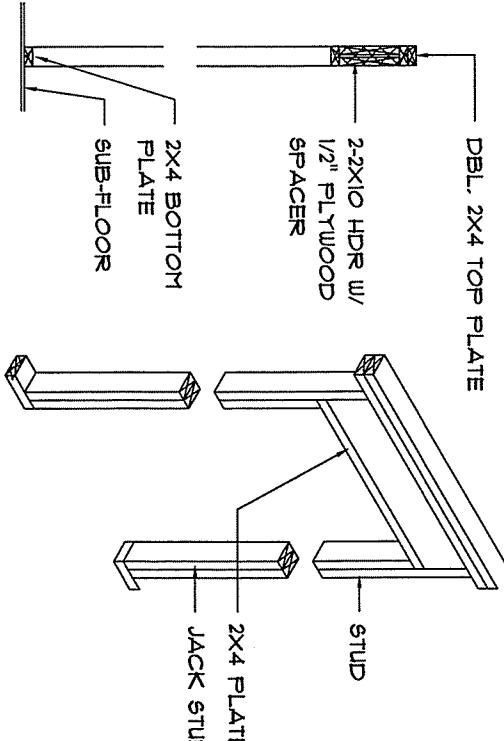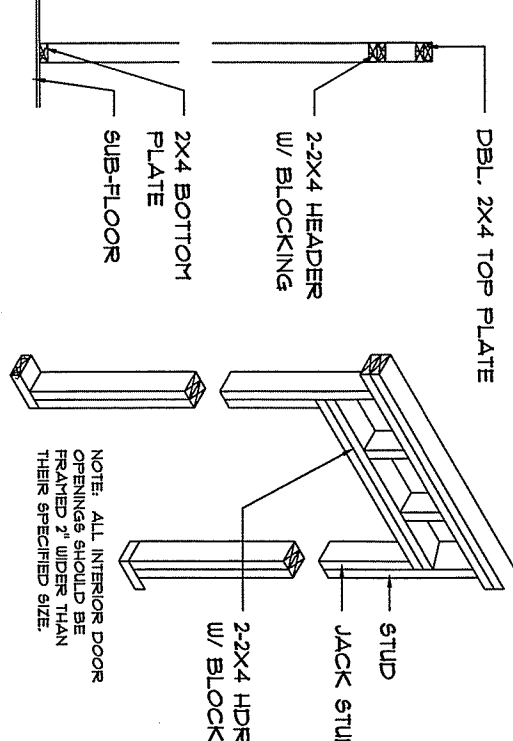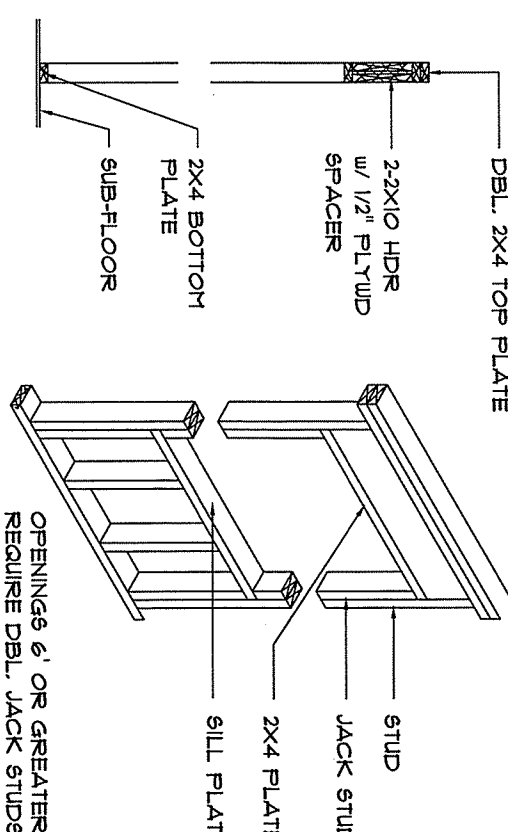

SCALE: NONE

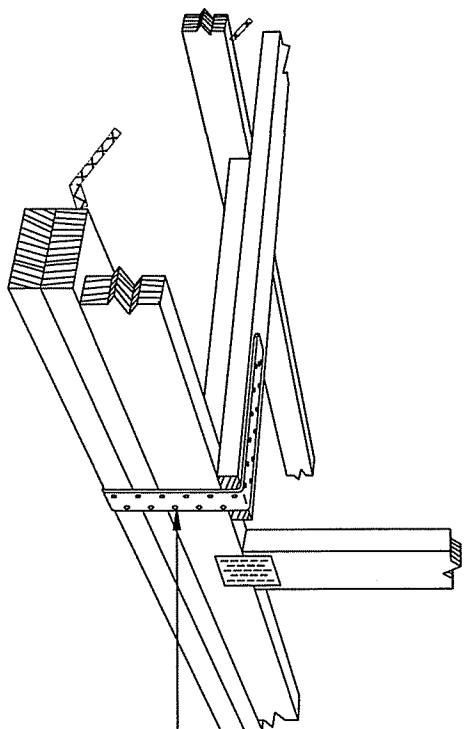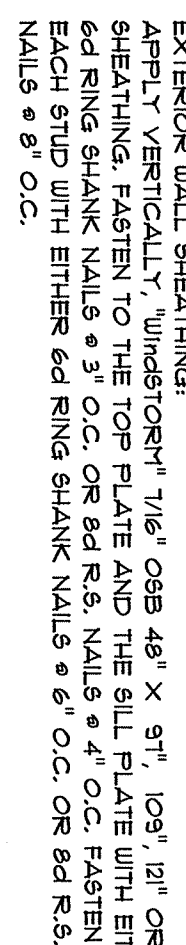EXTENDING WALL SHEET

SCALE: NONE

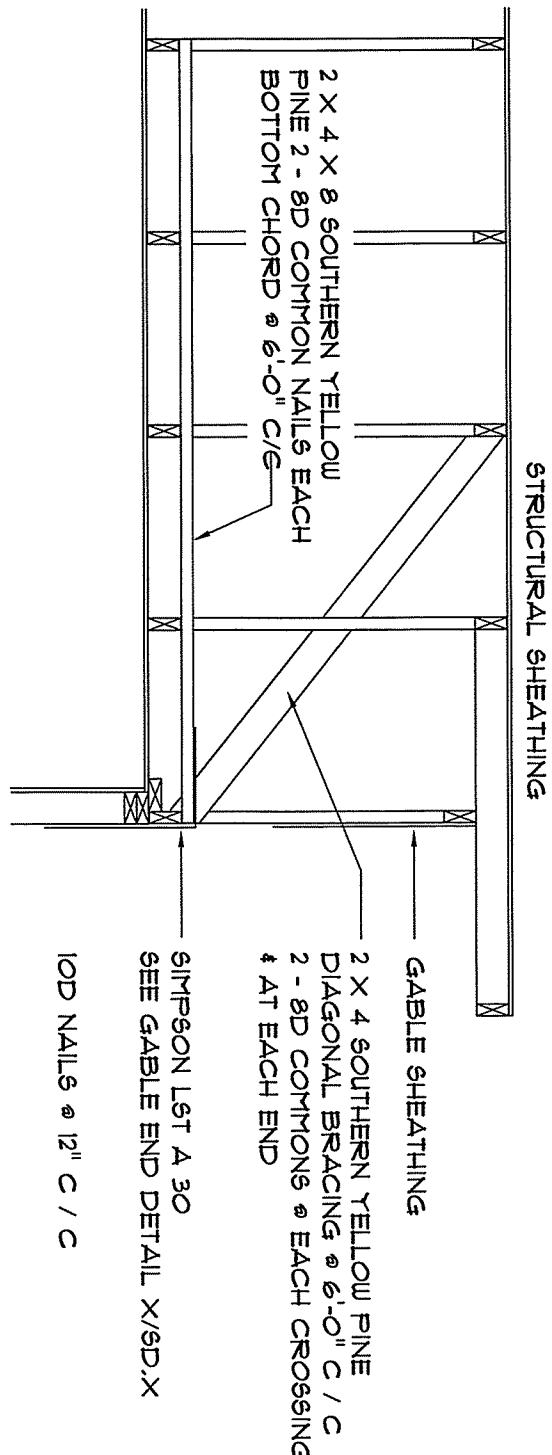

## Nts

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE



