



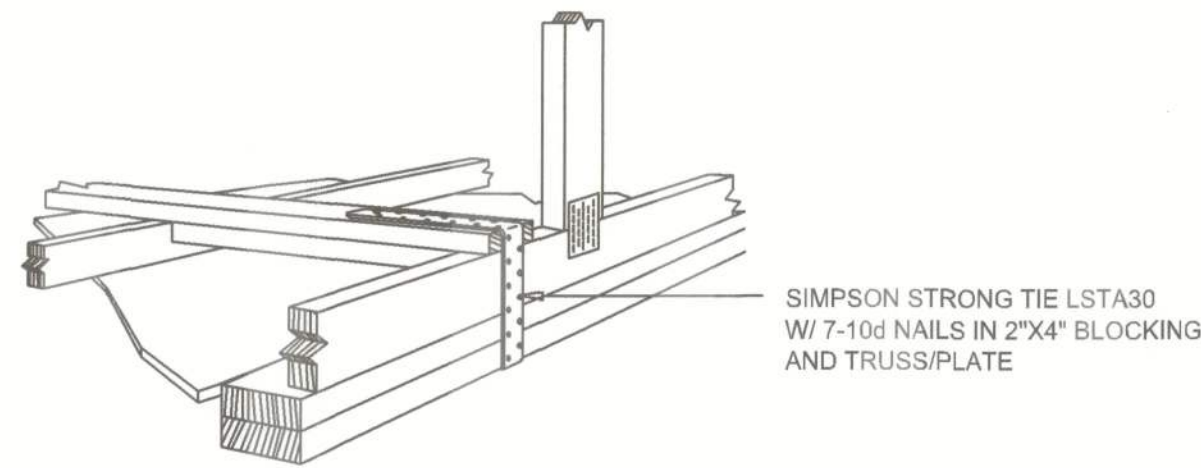

GABLE END GYPSUM DIAPHRAGM HOLDOWN CONNECTOR

SCALE: NONE

A.1

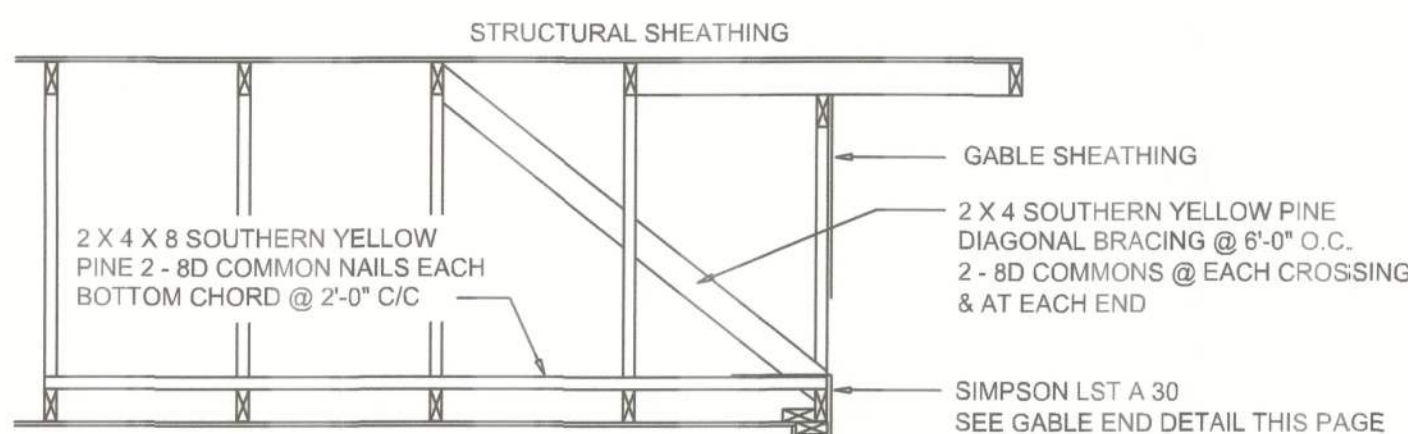


END WALL BRACING FOR CEILING DIAPHRAGM

NTS


(ALTERNATIVE TO BALLOON FRAMING)

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

A

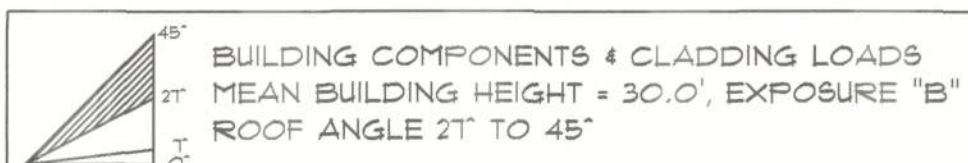

ZONE	AREA (ft ²)	Vult 115 MPH		Vult 120 MPH		Vult 130 MPH		Vult 140 MPH	
		Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
1	10	15.2	-26.1	11.1	-20.1	10	-20	10.1	-20.1
1	20	10	-18	10	-19.9	11.3	-21	13.1	-20.7
1	30	10	-12	10	-16.3	10	-19.2	10.5	-22.2
1	100	10	-12.7	10	-13.8	10	-19.2	10	-19.8
2	10	15.2	-26.1	11.1	-20.1	13	-20.9	15.1	-20.9
2	20	10	-18.1	10	-20.6	11.3	-20.4	13.1	-20.5
2	30	10	-11.9	10	-12.9	10	-20.1	10.5	-21.6
2	100	10	-11.9	10	-12.9	10	-15.1	10	-17.6
3	10	15.2	-26.1	11.1	-20.1	13	-20.1	15.1	-20.4
3	20	10	-25.7	10	-20.9	11.3	-20.8	13.1	-20.1
3	30	10	-19.2	10	-20.9	10	-20.5	10.5	-20.4
3	100	10	-14.2	10	-18.5	10	-18.2	10	-21.2
4	10	15.2	-26.7	11.1	-20.5	13	-20.7	15.1	-20.4
4	20	10	-24.6	10	-20.7	11.3	-21.4	13.1	-20.4
4	30	10	-14.3	10	-15.5	10	-18.2	10.5	-21.2
5	100	10	-14.3	10	-15.5	10	-18.2	10	-21.2
6	10	14.3	-20.5	10.5	-18.9	10.7	-19.8	12.1	-20.6
6	20	10.5	-14.5	10.5	-16.1	11.4	-19	12.2	-22
6	30	12.8	-14	10.9	-15.2	10.3	-17.9	10	-20.7
7	100	12.1	-15.3	10.2	-14.5	10.5	-17.1	10	-19.6
8	100	10.6	-11.9	11.6	-12.9	10.6	-15.1	10.5	-17.6
9	10	14.3	-19.1	10.5	-20.6	10.2	-24.4	12.1	-20.5
9	20	10.6	-17.6	10.9	-19.4	11.4	-20.8	12.2	-24.4
9	30	12.8	-16.1	10.9	-17.6	10.3	-20.6	10	-20.6
10	100	12.1	-14.8	10.2	-16.1	10.5	-19	10	-22
11	100	10.6	-11.9	11.6	-12.9	10.6	-15.1	10.5	-17.6

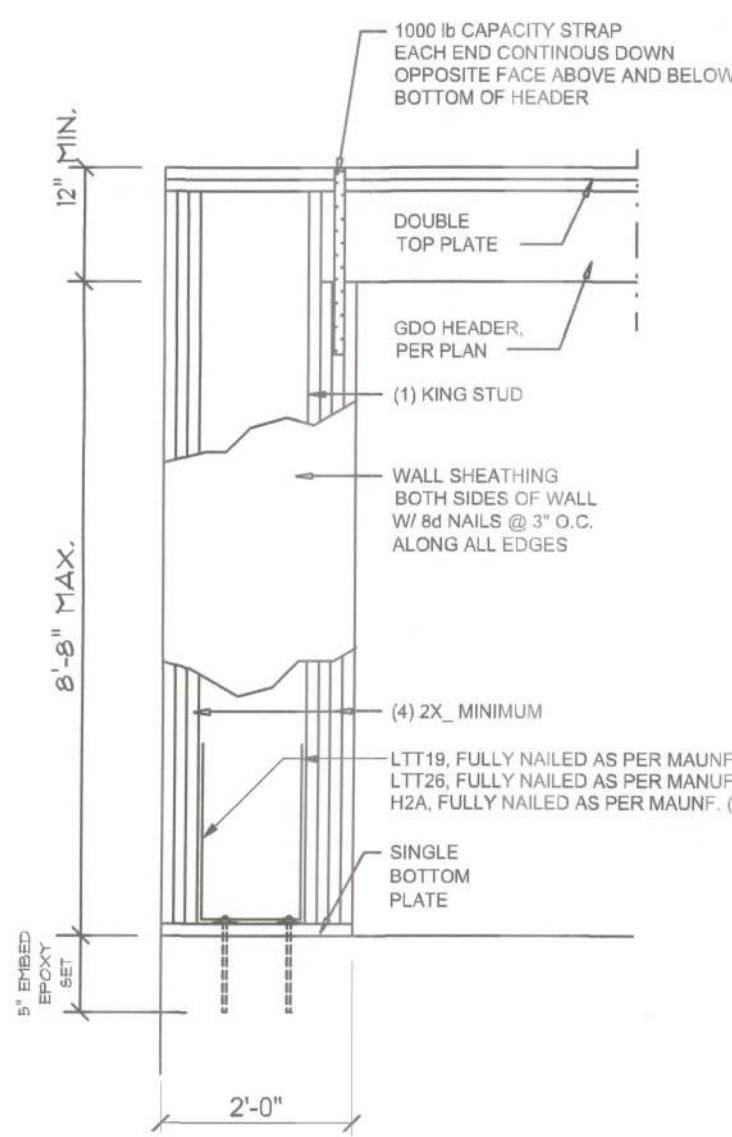


Garage End Wall DETAIL

SCALE: NTS

G

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1	7/16" O.S.B. OR 1992 CDX PLYWOOD	10d RING SHANK NAILS	6 in. o.c. EDGE 8 in. o.c. FIELD
2			4 in. o.c. EDGE 6 in. o.c. FIELD
3			4 in. o.c. @ GABLE ENDWALL OR GABLE TRUSS 6 in. o.c. EDGE 8 in. o.c. FIELD

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS FOR BUILDING COMPONENTS & CLADDING			
BLDG HEIGHT (ft)	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"
15	.82	1.21	1.41
20	.89	1.29	1.55
25	.94	1.35	1.61
30	1.00	1.40	1.66

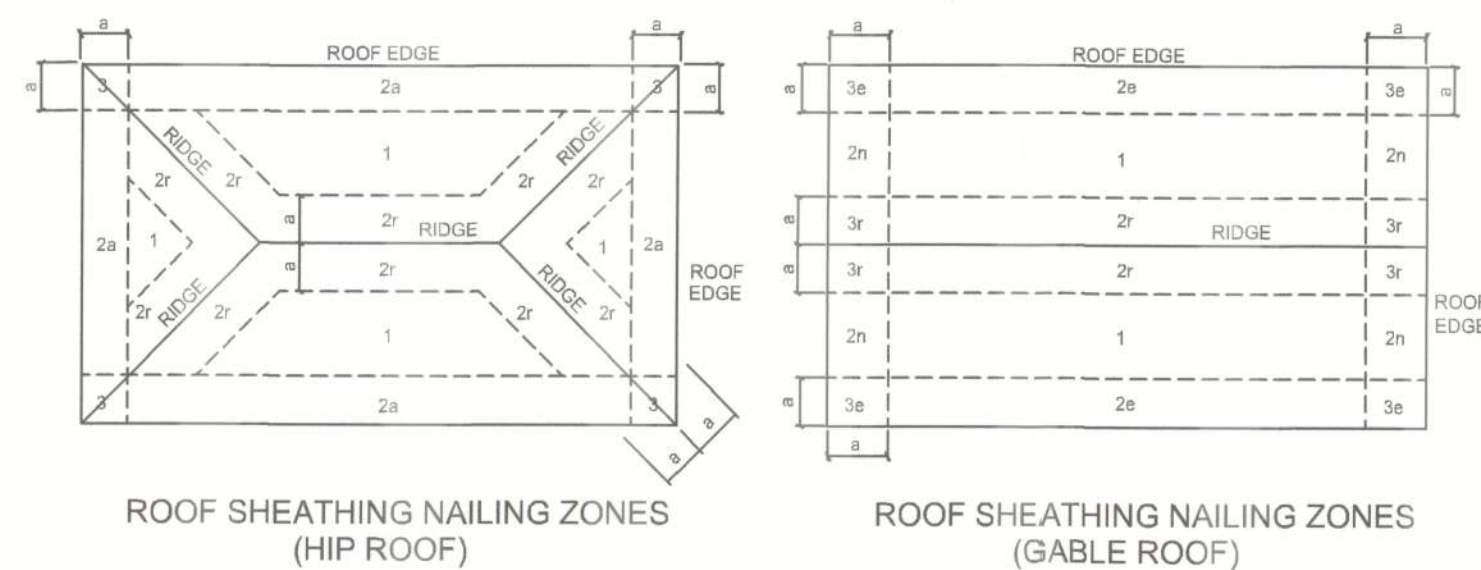


Roof Nail Pattern DET.

SCALE: NONE

B


HEADER SPANS FOR EXTERIOR BEARING WALLS							
HEADERS SUPPORTING:	HEADER SIZE	BUILDING WIDTH (FT)					
		20'		28'		36'	
		SPAN	# JACKS	SPAN	# JACKS	SPAN	# JACKS
ROOF, CEILING	2-2x4	3'-6"	1	3'-2"	1	2'-10"	1
	2-2x6	5'-5"	1	4'-8"	1	4'-2"	1
	2-2x8	6'-10"	1	5'-11"	2	5'-4"	1
	2-2x10	8'-5"	2	7'-3"	2	6'-6"	2
	2-2x12	9'-9"	2	8'-5"	2	7'-6"	2
	3-2x8	8'-4"	1	7'-5"	1	6'-8"	1
	3-2x10	10'-6"	1	9'-1"	2	8'-2"	1
	3-2x12	12'-2"	2	10'-7"	2	9'-5"	2
	4-2x8	9'-2"	1	8'-4"	1	9'-2"	1
	4-2x10	11'-8"	1	10'-6"	1	9'-5"	1
	4-2x12	14'-1"	1	12'-2"	2	10'-11"	1

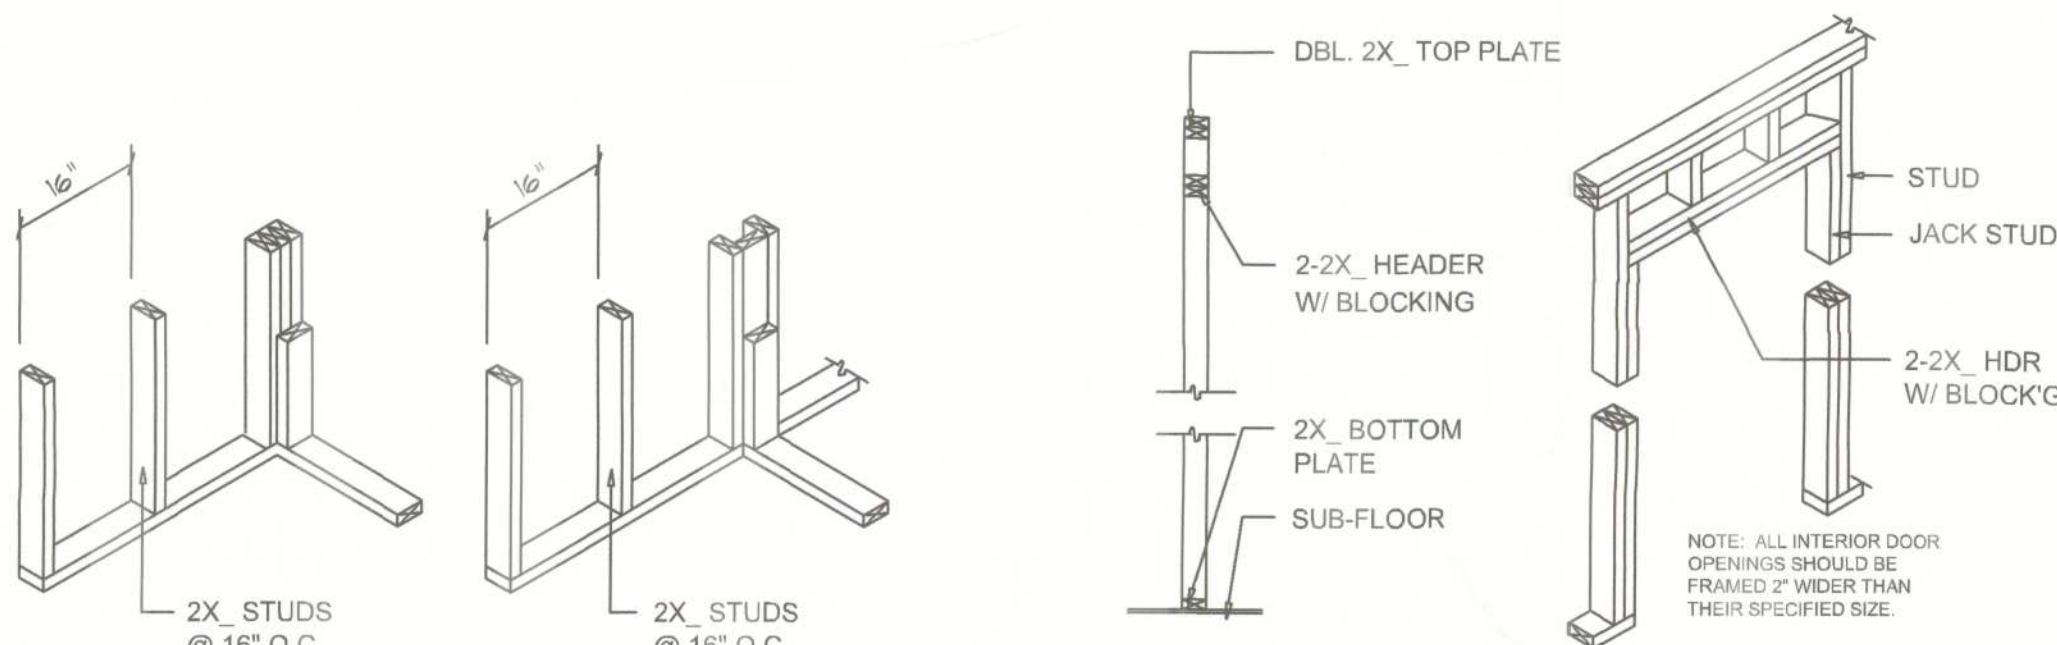



WALL CORNER

WALL INTERSECTION

NON-BEARING WALL HEADER

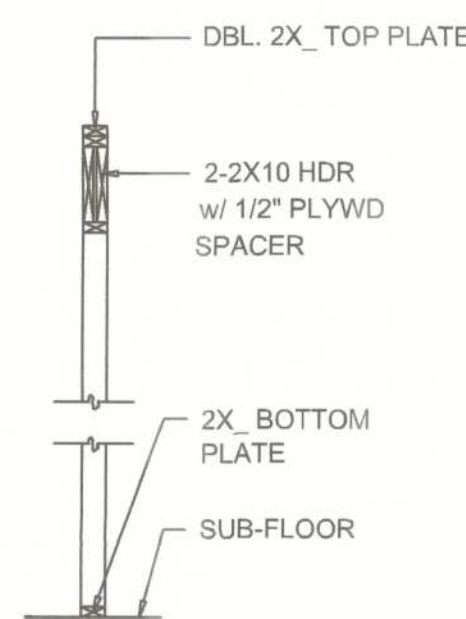

TYPICAL WINDOW HEADER

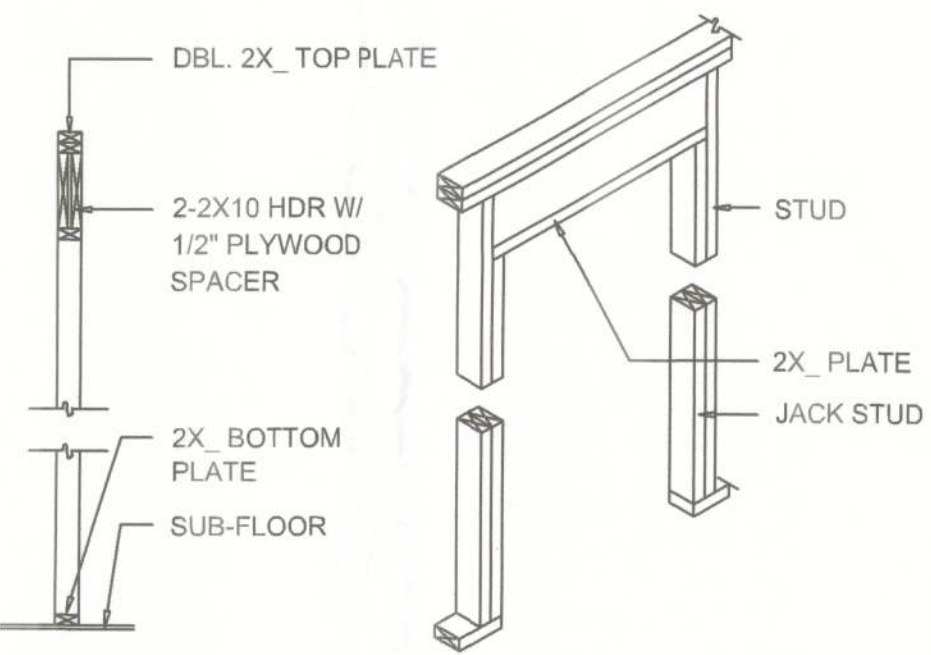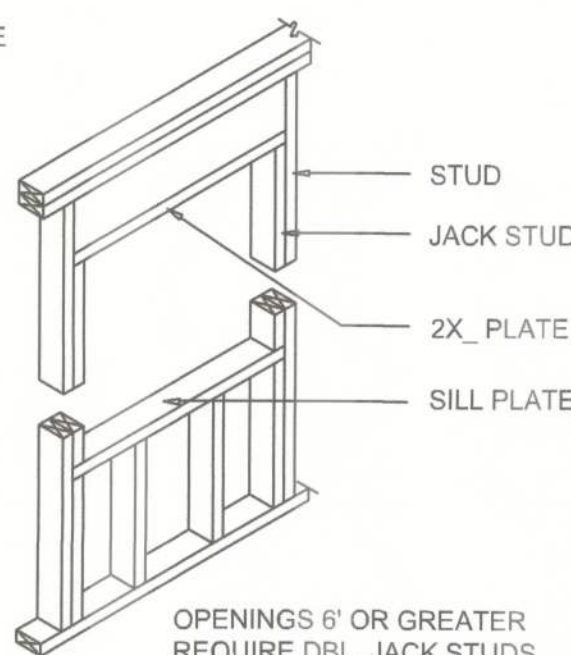


BEARING WALL HEADER

Wall Framing/Header DETAILS

SCALE: NONE

F

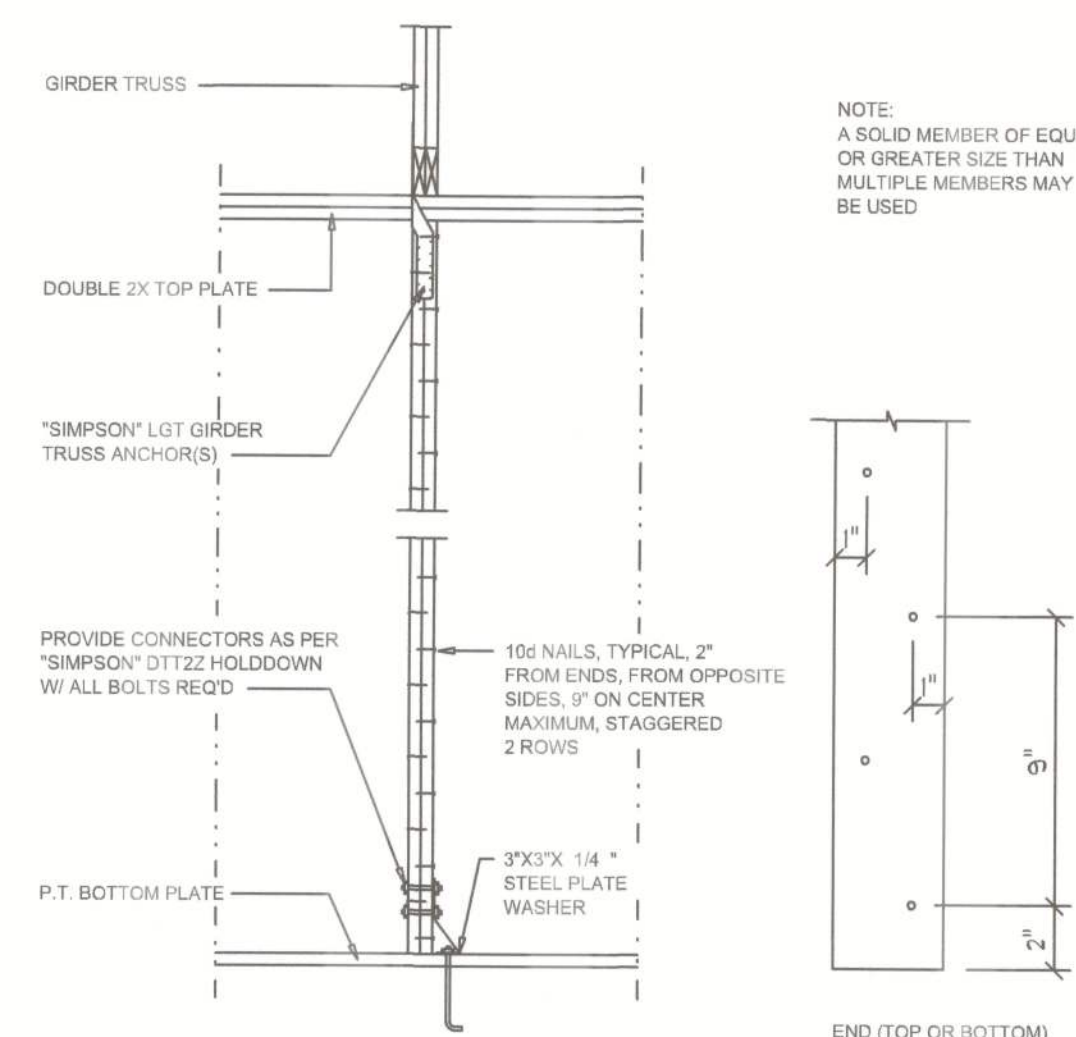


Girder Truss Column DET.

SCALE: 1/2" = 1'-0"

"WindSTORM" ALT. SHEATHING METHOD:
ALTERNATIVE METHOD FOR ANCHORING THE TOP WALL PLATE TO THE FOUNDATION IN LIEU OF THE SP1/SP2 OR SP4 STRAPS INDICATED IN THE CONSTRUCTION DOCUMENTS FOR THIS PROJECT SHALL ALLOWED AS FOLLOWS:
1. APPLY VERTICALLY "WindSTORM" 7/16" O.S.B. 48" X 97" 109" 121" OR 145" SHEATHING FASTENED TO THE TOP PLATE AND THE SILL PLATE WITH EITHER 6d COMMONS @ 3" O.C. OR 8d COMMONS @ 4" O.C. FASTEN TO EACH STUD WITH EITHER 6d COMMONS @ 6" O.C. OR 8d COMMONS @ 8" O.C.

Alternate "Titan" bolt concrete anchor system
ANCHOR SILL PLATE WITH 5/8" TITAN ANCHOR BOLT PLACED AT 48" O.C. AROUND PERIMETER OF SLAB AND ALL INTERIOR BEARING WALLS. (MIN. 4" EMBED)

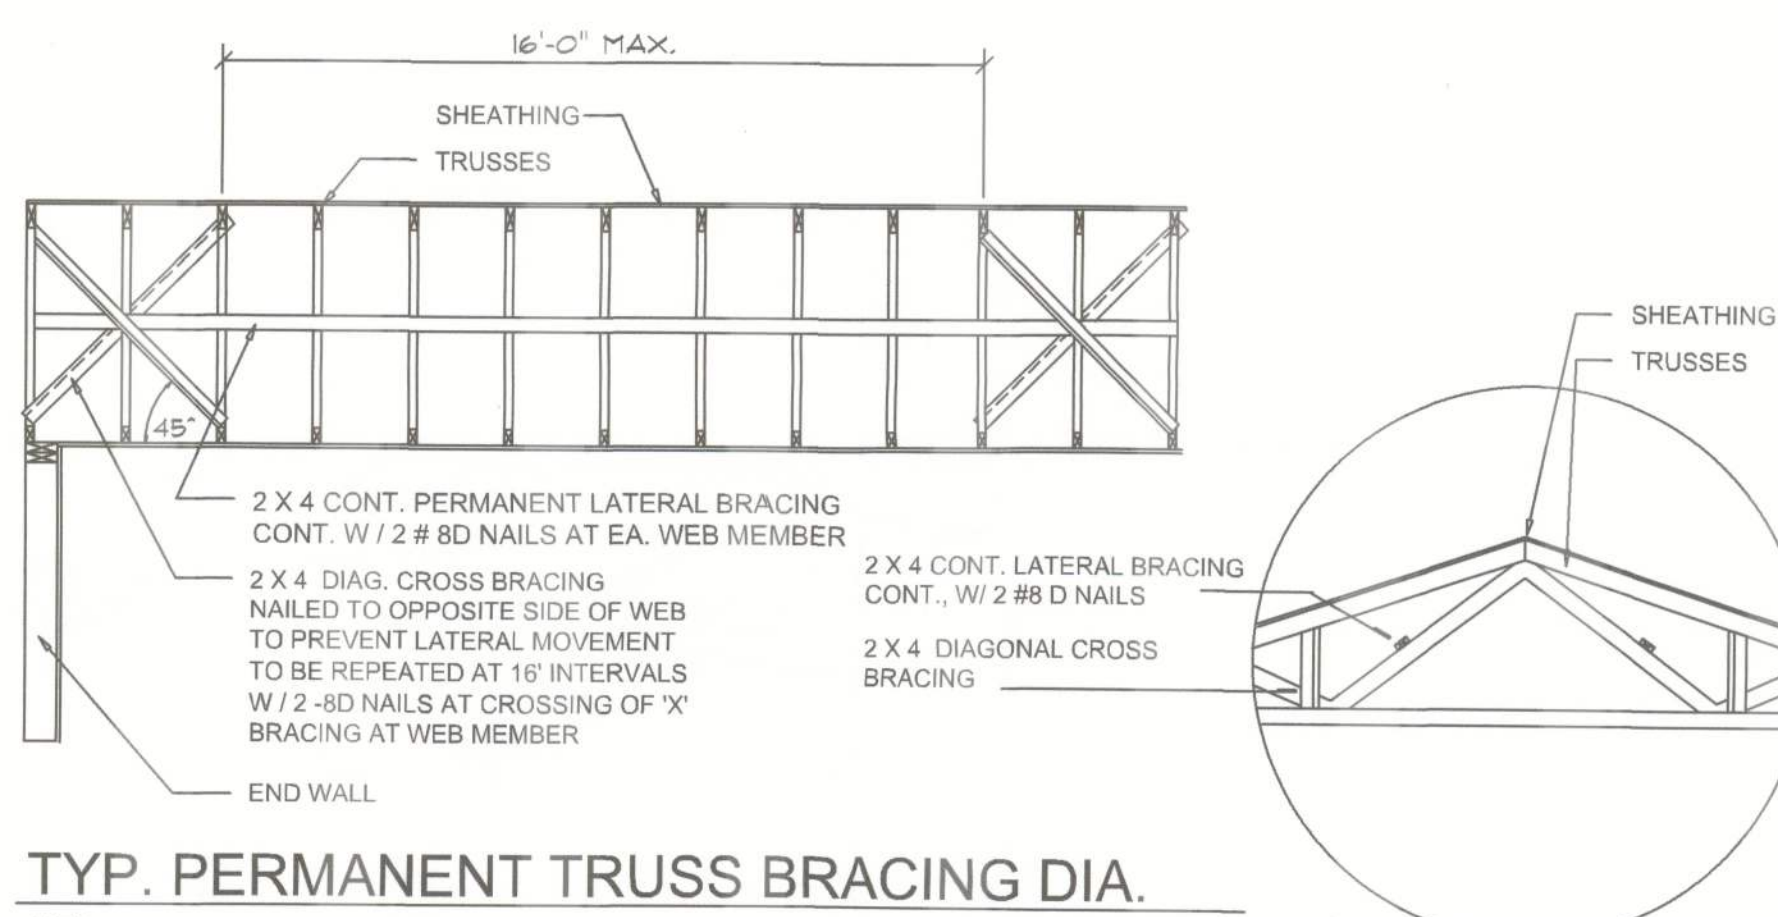

TYP. PERMANENT TRUSS BRACING DIA.


NTS

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

Truss Bracing DETAILS

SCALE: AS NOTED

D

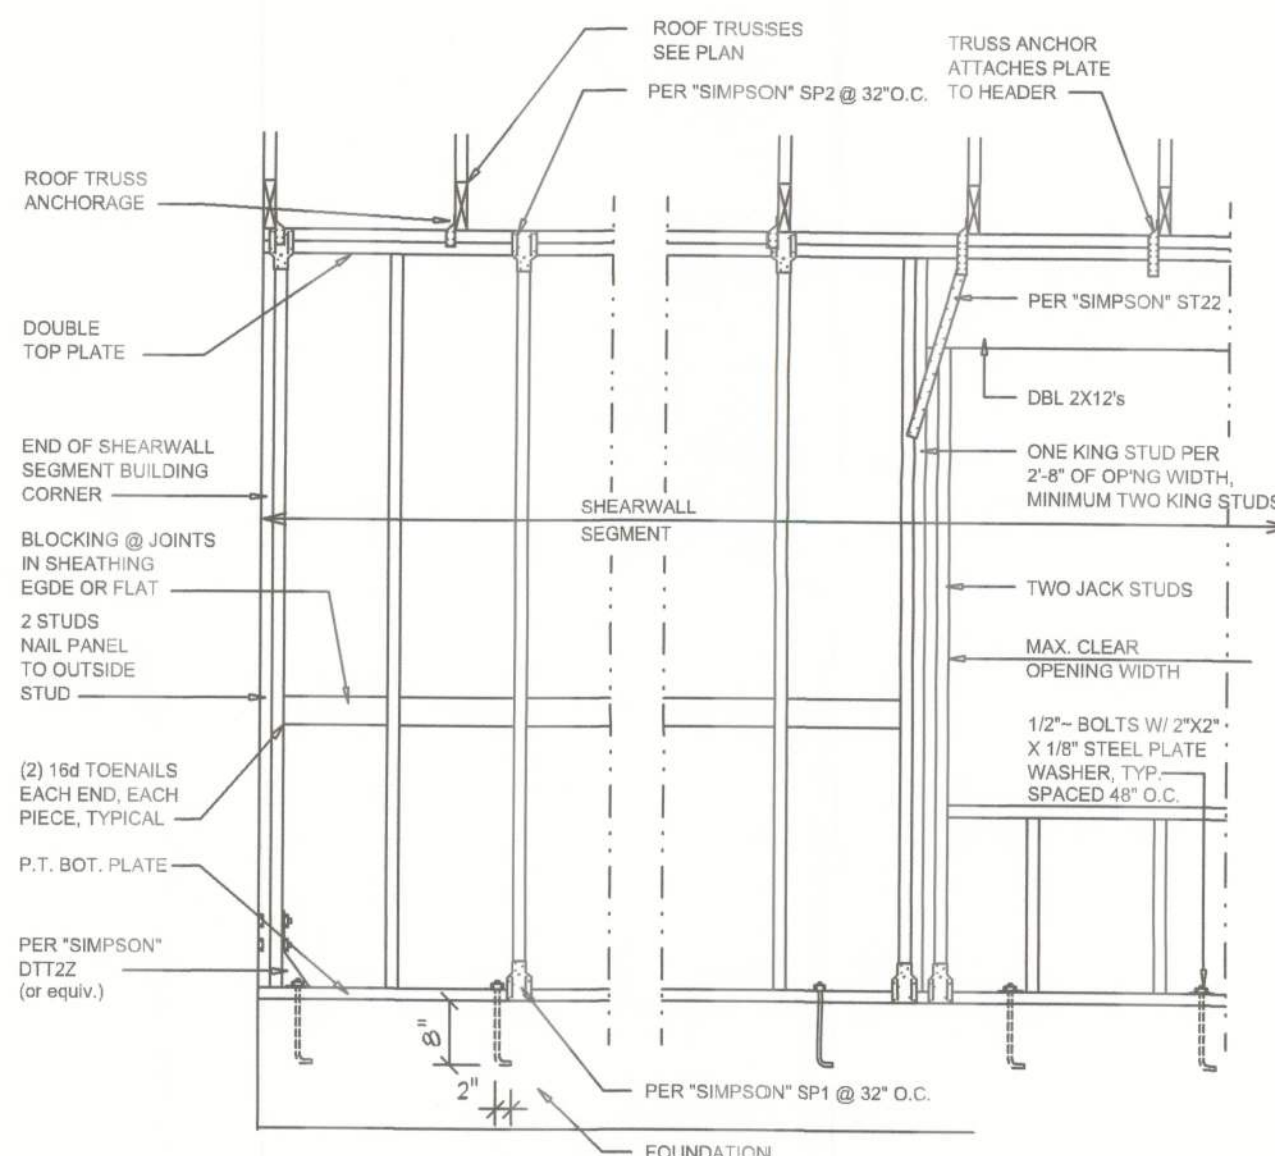

- SHEARWALL NOTES:
- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-97 SBCI 305.4.3.
 - THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
 - ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
 - NAIL SPACING SHALL BE 4" O.C. EDGES AND 8" O.C. IN THE FIELD.
 - TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/8 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3").

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

Shear Wall DETAILS

SCALE: NONE

E

REVISIONS
March 01, 2024

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

DETAILS SHEET
SCALE: 1/4" = 1'-0"

MODEL 1880 left-hand (front entry) FOR:
Steven Winsberg
PROJECT ADDRESS: LOT 14, AMELIA LANDING I, COLUMBIA COUNTY, FLORIDA

AR0007006
01 March 2024

NICHOLAS PAUL GEISLER
ARCHITECT
N.C.A.R.B. Certified
1759 NW Brown Rd.
Lake City, FL 32055
(386) 365-4355

JOB NUMBER
20240226

SHEET NUMBER
S.4
OF 4 SHEETS

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS