


DESIGN NOTE:
THIS BUILDING IS DESIGNED WITH IMPORTANCE FACTORS REQUIRED FOR MINOR STORAGE FACILITIES. MINOR STORAGE FACILITIES ARE THOSE WHICH REPRESENT A LOW HAZARD TO HUMAN LIFE IN THE EVENT OF FAILURE. THIS PROJECT IS STATED TO BE A MINOR STORAGE MINI-WAREHOUSE FACILITY AND CERTAIN STORAGE FACILITIES ARE ACCEPTABLE UNDER THE LOW HAZARD DEFINITION. IT IS THE RESPONSIBILITY OF THE CUSTOMER TO VERIFY THIS IS ACCEPTABLE TO LOCAL CODE AUTHORITIES HAVING JURISDICTION. MANUFACTURER BEARS NO RESPONSIBILITY FOR USE OF REDUCED LOAD IMPORTANCE FACTORS.

WILCOVIN

SCANNED

#6

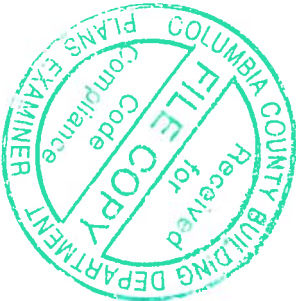

DESIGN LOADS	
BUILDING CODE:	FBC 2017
FRAME SELF WEIGHT:	INCLUDED
ROOF DEAD LOAD:	2.000 psf
COLLATERAL LOAD:	0 psf
ROOF LIVE LOAD:	20.00 psf
WIND:	
BASIC WIND SPEED(3-sec Gusts)	119 mph(vult)
WIND EXPOSURE:	B
CLOSURE "C, O, P" :	Closed
INTERNAL PRESSURE COEFF.: :+/-0.18	
RISK CATEGORY:	NORMAL

SNOW:
FLAT ROOF SNOW LOAD Pt: = 0.0 psf
GROUND SNOW LOAD: Pg = 0.0psf
SNOW LOAD IMP. FACTOR: Is = 1.0
SNOW LOAD EXP. FACTOR: Ce = 1.0
THERMALFACTOR: Ct = 1.0

SEISMIC:
SEISMIC IMPORTANCE FACTOR: Is = 1.0
MAPPED SPECTRAL RESPONSE ACC., SS: 0.256
MAPPED SPECTRAL RESPONSE ACC., S1: 0.103
SPECTRAL RESPONSE COEFF: SDS = 0.272
(2 SEC PERIOD)
SPECTRAL RESPONSE COEFF: SDI = 0.164
(1.0 SEC PERIOD)
SEISMIC DESIGN CAT.: C
SITE CLASS (ASSUMED): D
DESIGN BASE SHEAR: V=Cs*W
BASIC SEISMIC-FORCE RESISTING SYSTEM
SHEAR DIAPHRAGM

BUILDING DESCRIPTION	ACCESSORIES
WIDTH	40
LENGTH	125
EAVE HEIGHT/F/RONT	10
EAVE HEIGHT/BACK	10
ROOF SLOPE/F/RONT	0.5:12
ROOF SLOPE/BACK	0.5:12
BAY / UNIT SIZES:	
BSV	(1) 5 W X 15 D
BSV	(12) 10 W X 15 D
FSV	(12) 10 W X 20 D
	OTHER
	WINDOWS
	WALK DOORS
	WINDOWS

S T O R A G E S Y S T E M S
A division of Vulcan Steel Structures, Inc.
500 Vulcan Parkway Adel, Georgia 31620
CUSTOMER: STEPHEN DOUGLAS
JOB NUMBER: 25486
STREET ADDRESS: 2529 SW STATE RD 47
CITY, STATE, ZIP LAKE CITY FL 32025
PROJECT NAME: MINI STORAGE & RECORD OF LAKE CITY

PANELS, TRIM & ACCESSORIES				FASTENERS				DRAWING INDEX			
DESCRIPTION	QTY	SIZE	DESCRIPTION	SIZE / TYPE	COLOR	APPLICATION	TYPE	LONG LIFE	COLOR	SHEET NO.	DESCRIPTION
ROOF PANELS	(1)	3'-0"W X 7'-0"H	ROOF PANELS	26 GA. PBR	Galvalume	ANCHOR BOLT	1/2" x 3 3/4" KWIK BOLTS	-	N/A	CS-1 & CS-2	COVER SHEET
WALL PANELS	(12)	8'-0"W X 7'-0"H	WALL PANELS	26 GA. PBR	LIGHT STONE	ROOF MEMBER	#12 x 1 1/4" L.L.S.D. w/ WASHER	Y	GALVALUME	F1	CONCRETE PLAN
PARTITION PANELS	(12)	8'-0"W X 7'-0"H	PARTITION PANELS	26 GA. PBR	GALVALUME	ROOF STITCH	#14 x 7/8" L.L.S.D. w/ WASHER	Y	GALVALUME	E1	FLOOR PLAN
MULLION PANELS			MULLION PANELS	26 GA.		WALL MEMBER	#12 x 1 1/4" S.D. w/ WASHER	N	NEED COLOR	E2	ROOF PLAN
RAKE TRIM			RAKE TRIM	26 GA.		WALL STITCH	#14 x 7/8" S.D. w/ WASHER	N	NEED COLOR	E3	FRONT SIDEWALL ELEV.
SIMPLE EAVE TRIM	(1)	3'-0"W X 7'-0"H	SIMPLE EAVE TRIM	26 GA.		TRIM MEMBER	#12 x 1 1/4" S.D. w/ WASHER	N	NEED COLOR	E4	BACK SIDEWALL ELEV.
GUTTER	(24)	8'-0"W X 7'-0"H	GUTTER	26 GA.		TRIM STITCH	#14 x 7/8" S.D. w/ WASHER	N	NEED COLOR	ES&E6	LEFT & RIGHT ENDWALL ELEV.
DOWNSPUTS	(3)	4'-0"W X 7'-0"H	DOWNSPUTS	26 GA.		TRIM MEMBER	#12 x 1 1/4" S.D. w/ WASHER	N	NEED COLOR	E7&E8	HALLWAY FRAMING & SHEETING
CORNER TRIM			CORNER TRIM	26 GA.		TRIM STITCH	#14 x 7/8" S.D. w/ WASHER	N	NEED COLOR	E9&E10	PART. FRAMING
FRAMED OPENINGS			FRAMED OPENINGS	26 GA.	T.B.D.	FRAMING	#12 x 1 1/4" S.D. w/o WASHER	N	PLAIN		
ROLL-UP DOORS			ROLL-UP DOORS	BY OTHERS		PARTITION	#12 x 1 1/4" S.D. w/o WASHER	N	PLAIN		
WALK DOORS			WALK DOORS	--	--	PARTITION STITCH	#14 x 7/8" S.D. w/o WASHER	N	PLAIN		
WINDOWS			WINDOWS	--	--						

APPLICATION OF SEAL IS FOR METAL BUILDING ONLY AND DOES NOT REPRESENT THE PROFESSIONAL OF RECORD.

DATE	5/8/18
SHEET NO.	CS-1 OF 2
DRN. BY	CKD BY
RDP	CR

WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620



FLORIDA PRODUCT APPROVAL NUMBERS

W A L K D O O R S			
3070 W/SUB JAMBS	WIND RATED & KNOCKDOWN OR PRE-ASSEMBLED	FL13889.3	
3070 W/FRAMED OPENING	WIND RATED & KNOCKDOWN OR PRE-ASSEMBLED	FL13889.4	
6070 W/SUB JAMBS	WIND RATED & KNOCKDOWN OR PRE-ASSEMBLED	FL13889.1	
6070 W/FRAMED OPENING	WIND RATED & KNOCKDOWN OR PRE-ASSEMBLED	FL13889.2	
4070 & 8070	WINDMAXX & KNOCKDOWN OR PRE-ASSEMBLED	FL10294.1	
R I D G E V E N T S			
12" THROAT	RIDGE VENT WITH 12" THROAT	FL12805.2	
6-3/4" THROAT	RIDGE VENT WITH 6-3/4" THROAT	FL12805.5	
9" THROAT	RIDGE VENT WITH 9" THROAT	FL12805.1	
L O U V E R S			
FIXED GLASS	LOUVER WITH FLIXED GLASS	FL12256.1	
ADJUST. GLASS	LOUVER WITH ADJUSTABLE GLASS	FL12256.2	
R O L L U P D O O R S			
1100 SERIES	MAX SIZE: 8'-8" X 14'-0"	FL12765.1	
1100 SERIES	MAX SIZE: 10'-0" X 14'-0"	FL12765.2	
3100 SERIES	MAX SIZE: 12'-0" X 20'-0"	FL12765.3	
3100 SERIES	MAX SIZE: 20'-0" X 20'-0"	FL12765.4	
750 SERIES	MAX SIZE: 3'-0" X 12'-0"	FL12675.5	
750 SERIES	MAX SIZE: 6'-0" X 12'-0"	FL12765.6	
750 SERIES	MAX SIZE: 8'-8" X 12'-0"	FL12765.7	
750 SERIES	MAX SIZE: 10'-0" X 12'-0"	FL12765.8	

R O O F P A N E L S	
BATTENLOK	FL11819.1
DOUBLE-LOK	FL11819.2
LOKSEAM	FL11819.3
SUPERLOK	FL11819.4
ULTRA-DEK	FL11819.5
7.2 PANEL	FL1519.1
PBR PANEL	FL5346.1
PBU PANEL	FL11868.2
W A L L P A N E L S	
AVP PANEL	FL11917.3
FW-120 PANEL	FL11917.4
PBR PANEL	FL5335.1
REVERSE PBR	FL5335.1
SHADOWRIB PANEL	FL11917.6


S O F F I T P A N E L S	
ARTISAN L-12	FL11919.1
S K Y L I G H T S	
PBR SKYLIGHT	FL13793
W A L L L I T E S	
PBR	FL13787.1

MIAMI DADE PRODUCT APPROVAL NUMBERS

R O L L U P D O O R S			
850 SERIES MINI	MAX SIZE: 8'-8" X 12'-0"	NOA-13-1203.05	
3400 SERIES	MAX SIZE: 12'-0" X 20'-0"	NOA-13-0124.05	
R O O F P A N E L S			
PBR	22 GAGE & 24 GAGE	NOA-12-0730.02	
SUPERLOK	22 GAGE	NOA-12-0911.02	
SUPERLOK	24 GAGE	NOA-12-0123.07	
DOUBLE-LOK		NOA-13-0425.14	
W A L L P A N E L S			
PBR	24 GAGE	NOA-12-0123.06	
ECO-FICIENT		NOA-14-0306.03	
S K Y L I G H T S			
PBR		NOA-12-0110.04	


DATE 5/8/18	
SHEET NO. CS-2	
DRN. BY RDP	CK'D BY CR

WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620

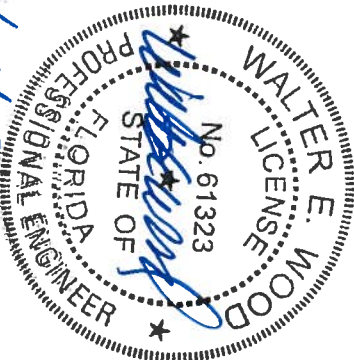

APPLICATION OF SEAL IS FOR
METAL BUILDING ONLY AND DOES
NOT REPRESENT THE PROFESSIONAL
OF RECORD.

5/24/17

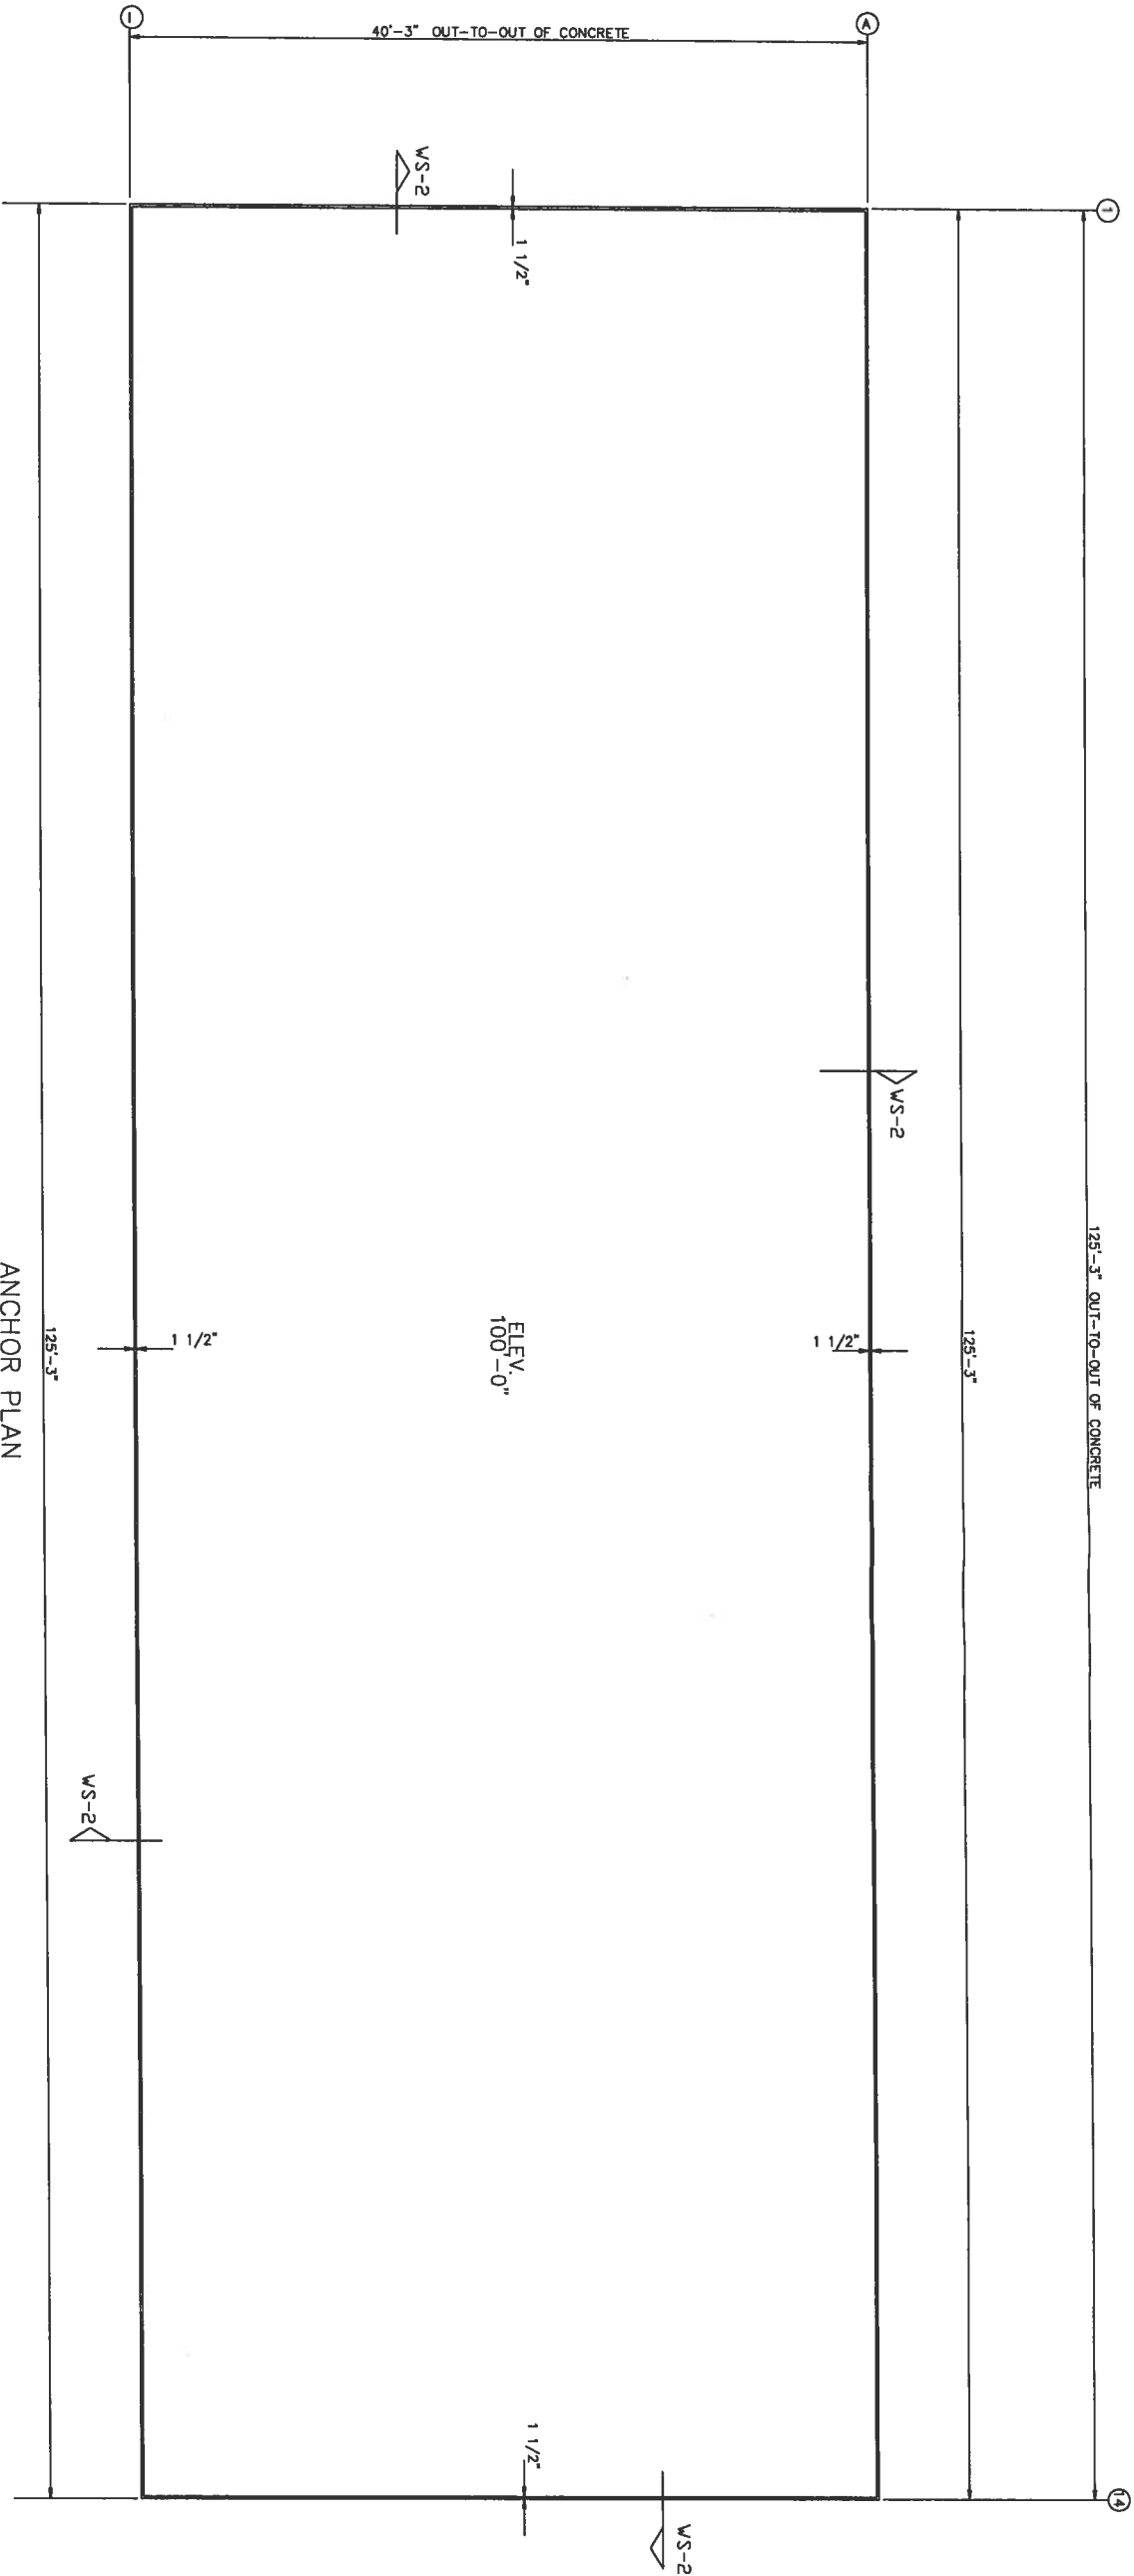

REACTIONS & CONCRETE NOTCH PLAN

NOTES FOR REACTIONS


- All loading conditions are examined and only maximum/minimum H or V and the corresponding H or V are reported.
- Positive reactions are as shown in the sketch. Foundation loads are in opposite directions.
- Bracing reactions are in the plane of the brace with the H pointing away from the braced bay. The vertical reaction is downward.
- Building reactions are based on the following building data:
 - Width (ft) = 40.0
 - Length (ft) = 125.0
 - Eave Height (ft) = 10.0/10.0
 - Roof Slope (rise/12) = 0.5/0.5
 - Dead Load (psf) = 2.0
 - Collateral Load (psf) = 0.0
 - Live Load (psf) = 20.0
 - Wind Speed (mph) = 119.0
 - Wind Code = IBC 12
 - Exposure = B
 - Closed/Open = C
 - Importance Wind = 1.00
 - Importance Seismic = 1.00
 - Seismic Zone = B
 - Seismic Coeff (Fa*Sa) = 0.16

5. Loading conditions are:
- 0.60DL+0.60WR2+0.60WS
 - DL+0.60WP
 - DL+CL+LL
 - 0.60DL+0.60WM1+0.60WS
 - 0.60DL+0.60WS
 - 0.60DL+0.60WM1+0.60WS
 - DL+0.60WL1+0.60WS
 - 0.60DL+0.60WL2+0.60WS

WALL COLUMN:

MAXIMUM REACTIONS

Frm Line		Col Line		Load Id		Column Reactions (k)		V	
Line		Line		Id		Hmax	Vmax	Hmin	Vmin
1	A	1	A	1	3	0.3	-0.1	-0.3	-0.1
1	I	1	I	1	3	0.0	0.3	0.3	-0.2
14	I	1	I	1	3	0.0	-0.1	-0.3	-0.1
14	I	1	I	1	3	0.0	-0.1	-0.3	-0.2
14	A	1	A	1	3	0.0	-0.1	-0.3	-0.2
1	B-H	1	B-H	1	3	0.0	-0.2	-0.3	-0.2
1	I	1	I	1	3	0.0	0.6	0.6	-0.3
2-13	I	1	I	1	3	0.0	-0.1	-0.4	-0.2
14	B-H	1	B-H	1	3	0.0	-0.2	-0.3	-0.3
2-13	A	3	A	3	3	0.0	0.6	0.0	-0.3
2-13	B-H	3	B-H	3	3	0.0	-1.8	-0.3	-1.3

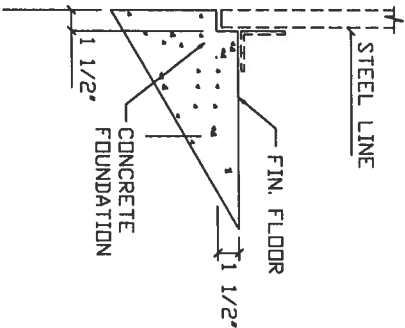

SECTION WS-2

APPLICATION OF SEAL IS FOR METAL BUILDING ONLY AND DOES NOT REPRESENT THE PROFESSIONAL OF RECORD.

REVISIONS

REV.	DESCRIPTION	DATE	DTLR	DATE	CHKR	APPD

DRAWING STATUS

☐ FINAL ERECTION	VULCAN STEEL STRUCTURES, INC
☒ FOR CONSTRUCTION	PROJECT
☐ FOR APPROVAL	MINI STORAGE & RECORD OF LAKE
☐ OTHER, EXPLAIN	25486
	PROJECT
	LAKE CITY FL 32025
	ADDRESS

ORIGINAL SIGNATURE REQUIRED

WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620


WALTER E. WOOD
LICENSE
No. 61323
STATE OF FLORIDA
PROFESSIONAL ENGINEER

5/16/18


MINI STORAGE & RECORD OF LAKE
ANCHOR PLAN
DESIGN ZJM DRAFT RDP CHECK CR
DATE: 5/16/18 SHEET F1

MEMBER TABLE

QUAN	MARK	PART	LENGTH
2	TC-1	4X2CH16	19'-10" 3/8"
4	TC-2	4X2CH16	19'-11" 3/4"
2	TC-3	4X2CH16	19'-11" 1/8"
2	TC-4	4X2CH16	14'-11" 1/8"
2	TC-5	4X2CH16	19'-9" 1/4"
2	TC-6	4X2CH16	10'-0" 7/8"
2	P-1	4X20Z16	20'-5" 3/4"
21	P-2	4X20Z16	21'-0"
7	P-3	4X20Z16	20'-4"
7	P-4	4X20Z16	15'-0"
7	P-5	4X20Z16	10'-5" 3/4"

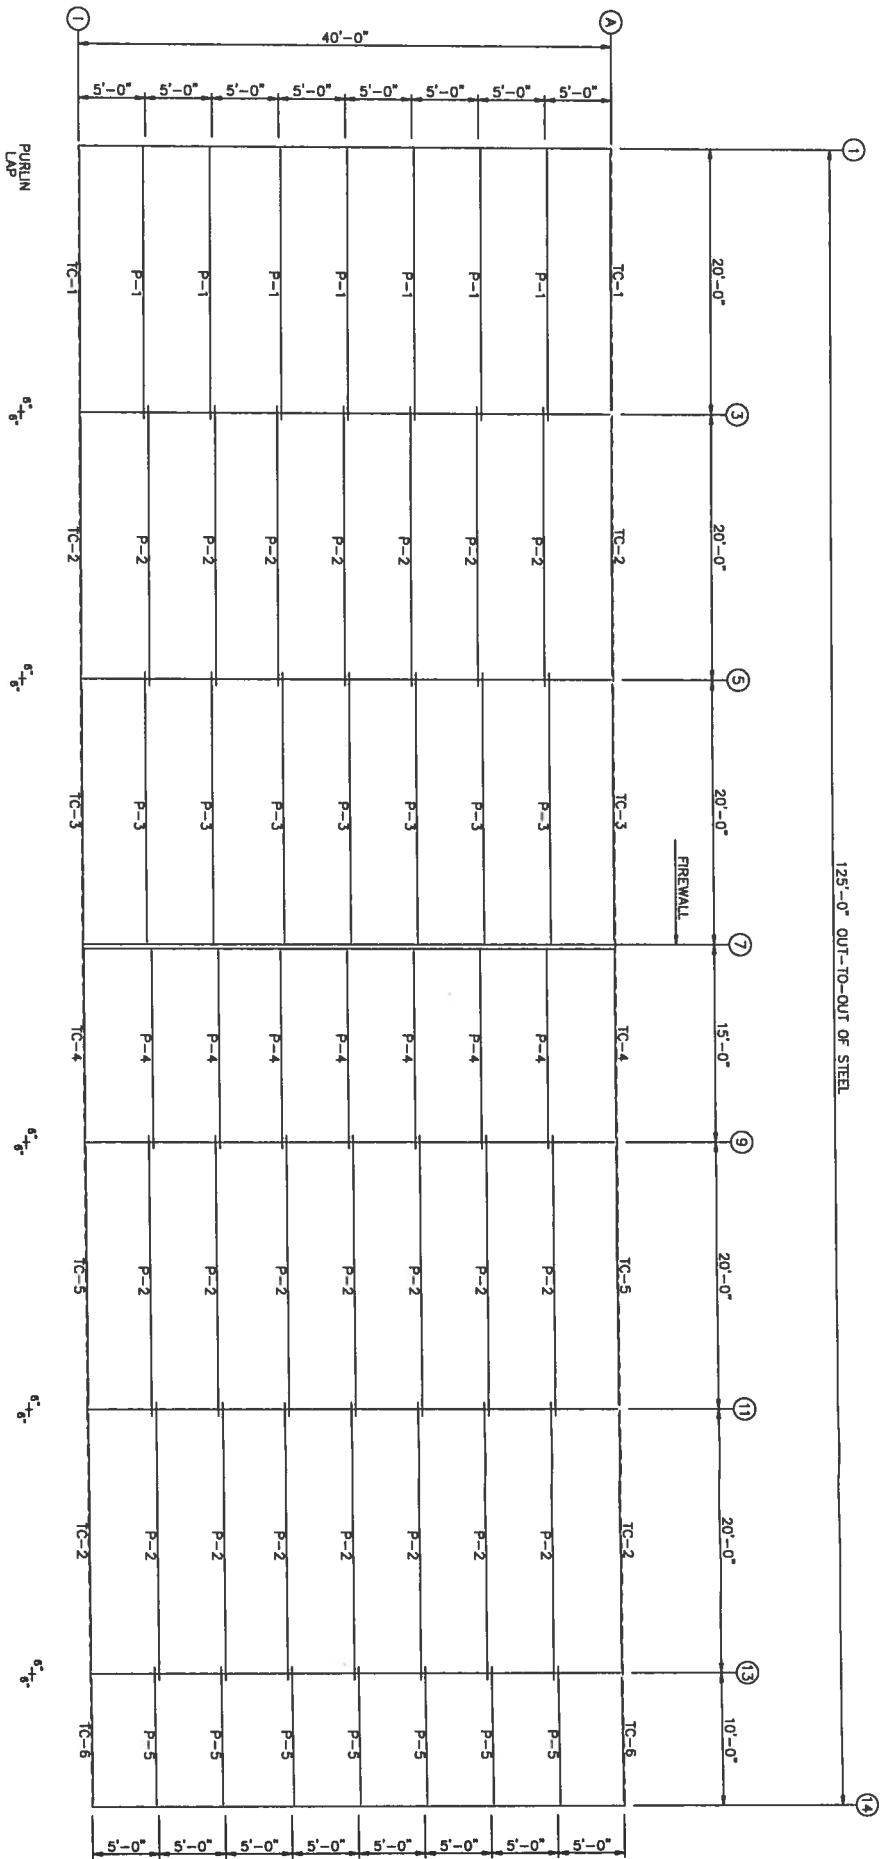

ROOF FRAMING

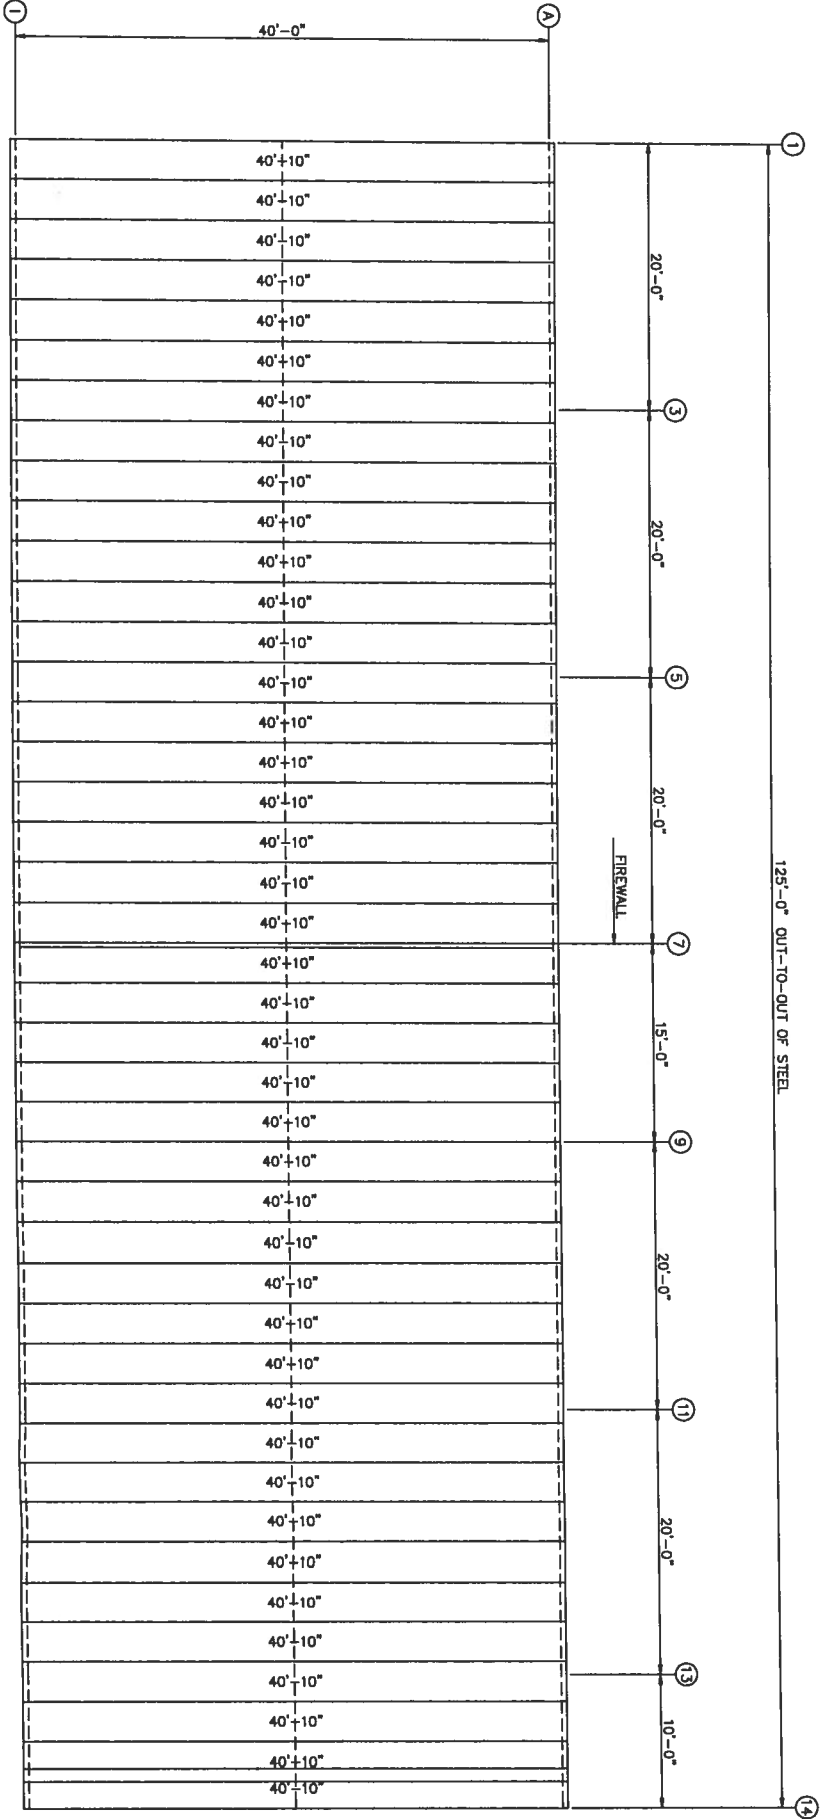

ROOF SHEETING & TRIM
PANELS: 26 Ga. PR - Galvalume

APPLICATION OF SEAL IS FOR
METAL BUILDING ONLY AND DOES
NOT REPRESENT THE PROFESSIONAL
OF RECORD.





ORIGINAL SIGNATURE REQUIRED

REVISIONS						DRAWING STATUS						VULCAN STEEL STRUCTURES, INC		MINI STORAGE & RECORD OF LAKE								
REV.	DESCRIPTION	DATE	DLR	DATE	CHKR	APPD	☐	☐	☐	☐	☐	☐	PROJECT	MINI STORAGE & RECORD OF LAKE	ROOF DRAWING	DESIGN	2JM	DRAFT	RDP	CHECK	CR	
							☐	☐	☐	☐	☐	☐	PROJECT	LAKE CITY FL 32025		DATE	5/16/18					E2

TRIM TABLE			
QID	MARK	LENGTH	DETAIL
1	VRTX20	20'-2"	TRIM_11
2	VPB	1'-4"	TRIM_39

MEMBER TABLE			
MARK	PART	LENGTH	
S-1	4X20C16	10'-2"	
S-2	4X20C16	10'-4 1/2"	
S-3	4X20C16	10'-7"	
S-4	4X20C16	10'-9 1/2"	
G-1	4X20C16	4'-7 1/2"	
G-2	4X20C16	4'-9 1/2"	
G-3	4X20C16	4'-11 1/2"	

CONNECTION PLATES	
DID	MARK/PART
1	BC-1
2	MC-1

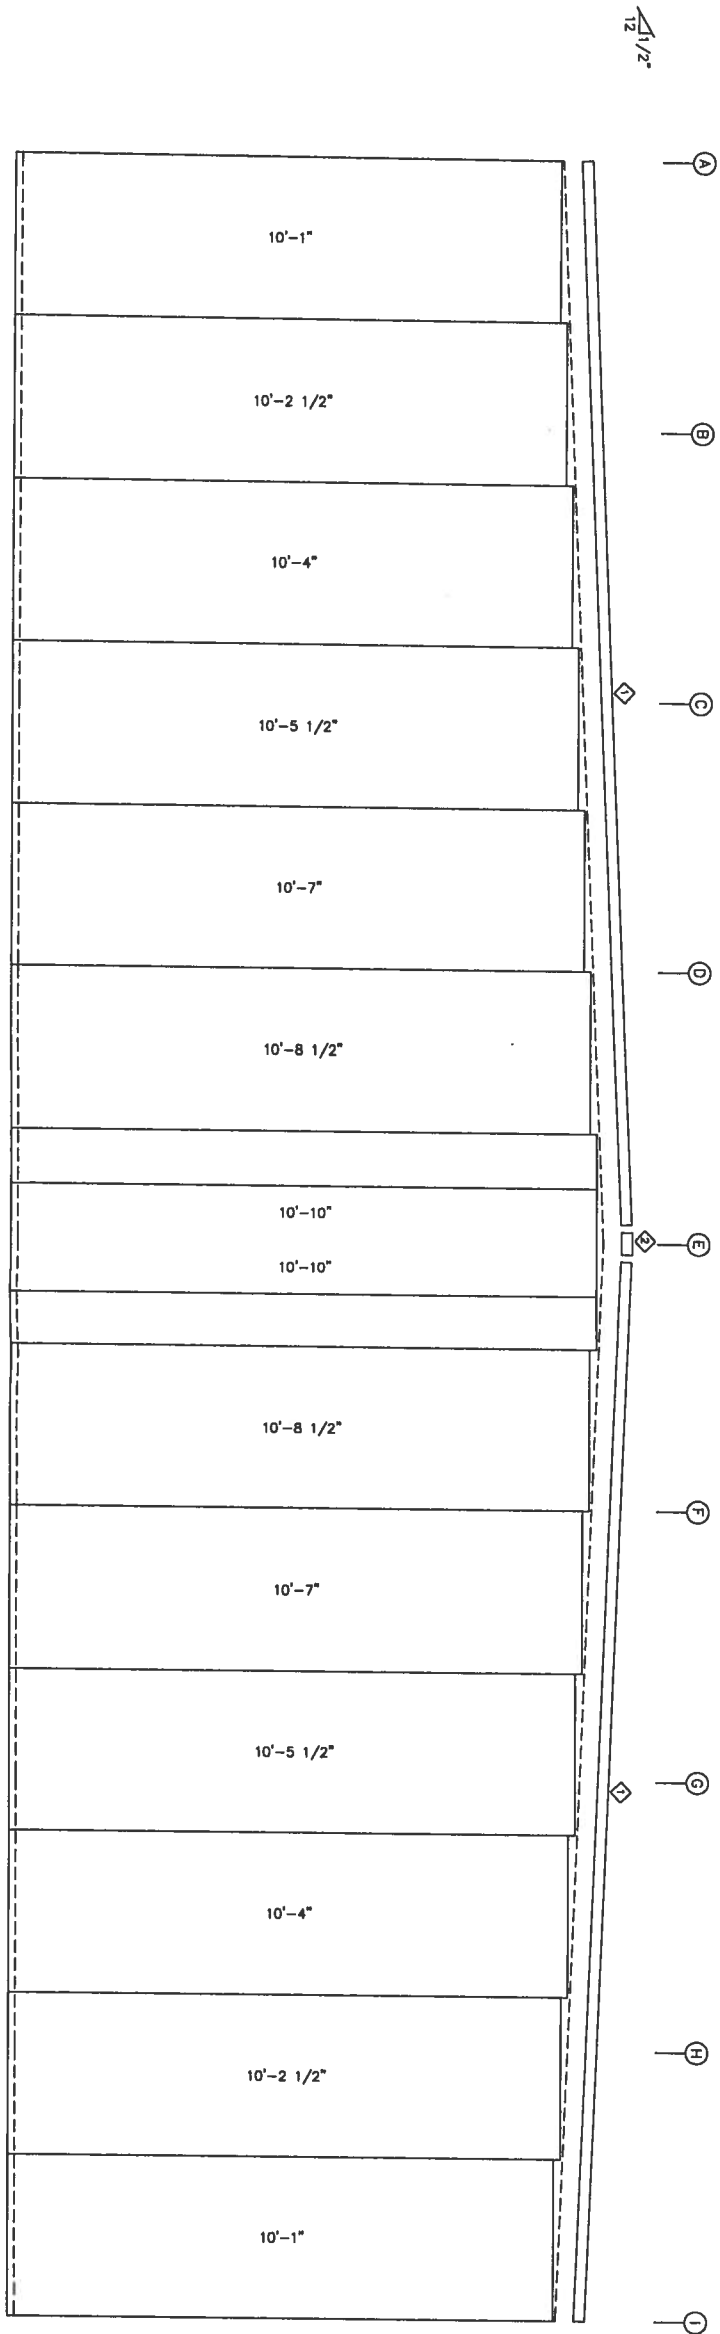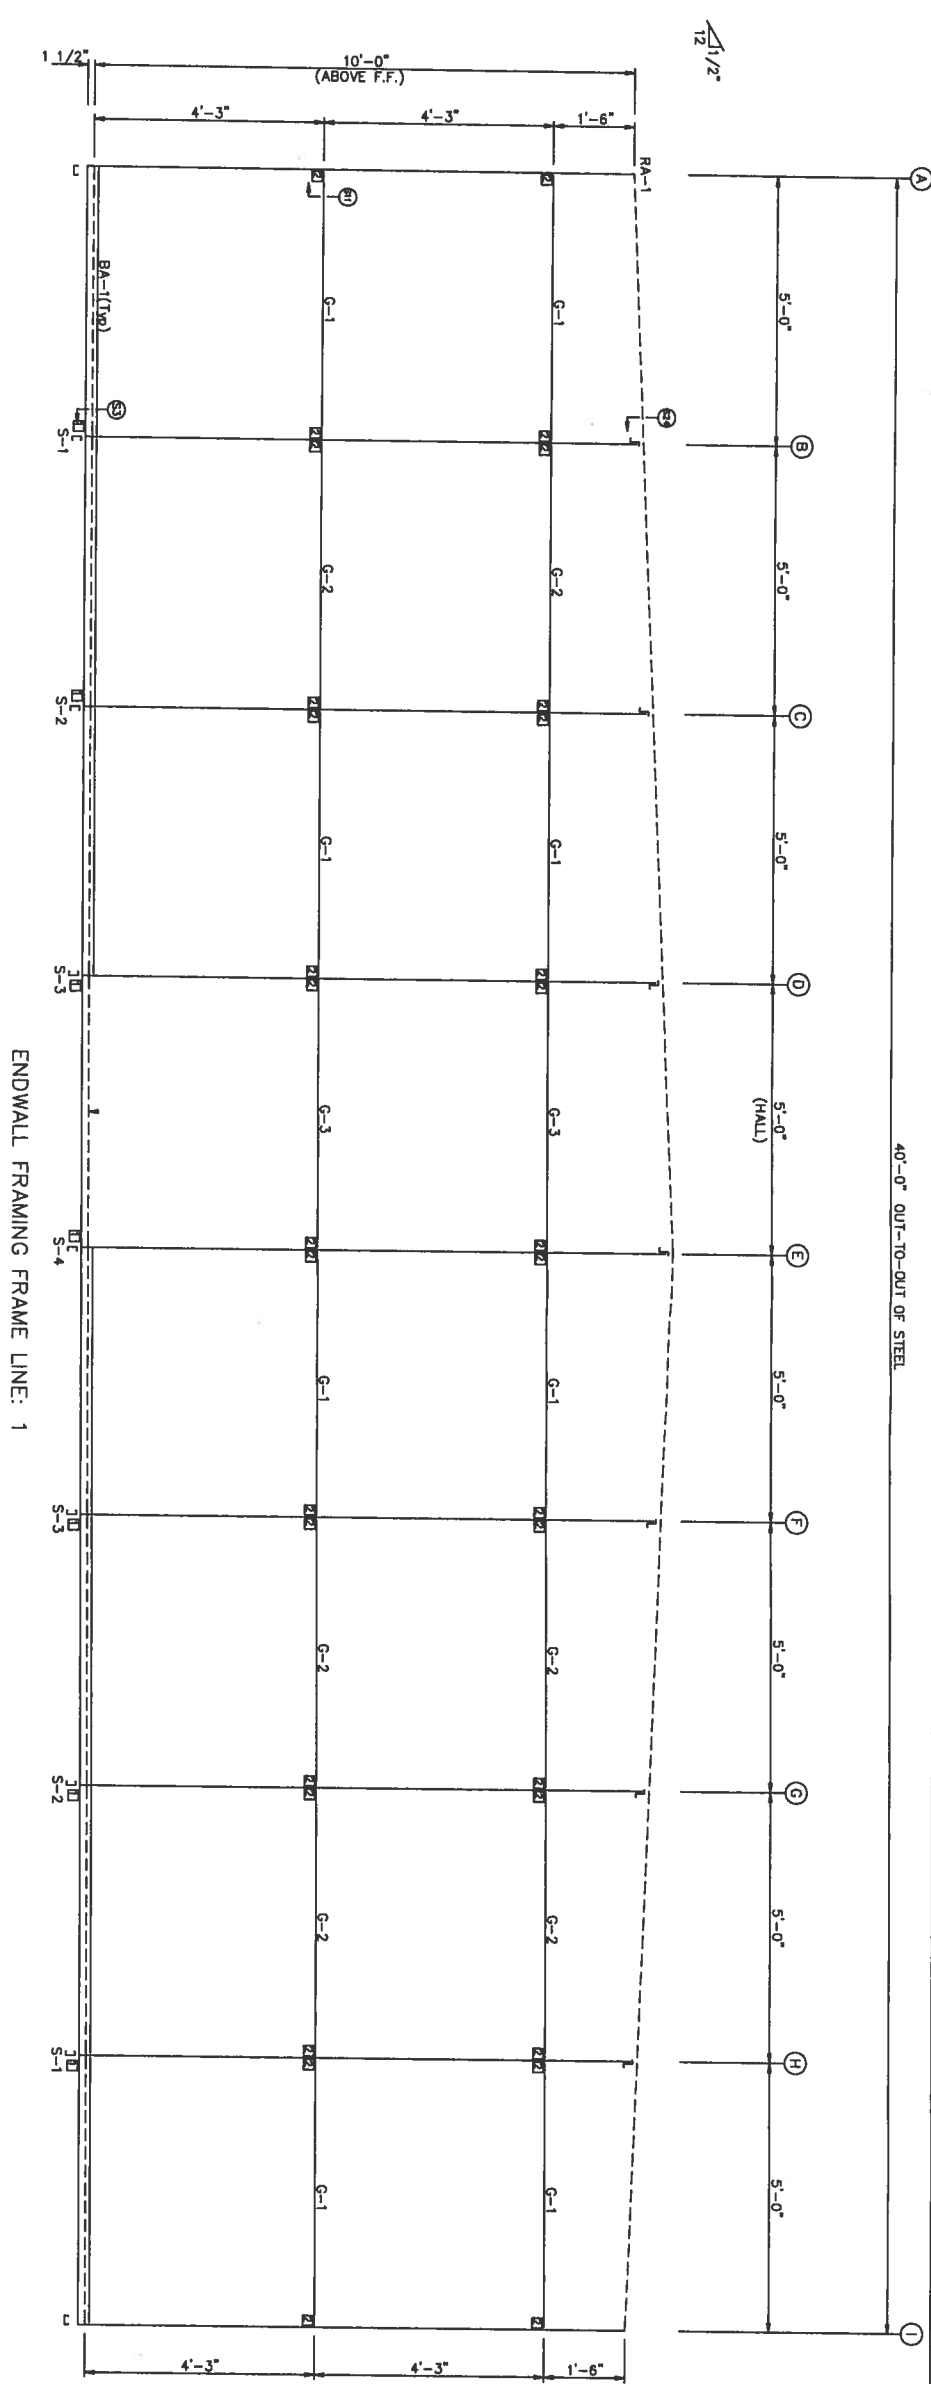

REVISIONS					DRAWING STATUS					VULCAN STEEL STRUCTURES, INC		
REV.	DESCRIPTION	DATE	DLTR	DATE	CHKR	APPD	[]	FINAL	ERECT	PROJECT	MINI STORAGE & RECORD OF LAKE	ENDWALL DRAWING
							[] <td>FOR<td>CONSTRUCTION<td>ID</td><td>25486</td><td>DESIGN: ZJM</td></td></td>	FOR <td>CONSTRUCTION<td>ID</td><td>25486</td><td>DESIGN: ZJM</td></td>	CONSTRUCTION <td>ID</td> <td>25486</td> <td>DESIGN: ZJM</td>	ID	25486	DESIGN: ZJM
							[] <td>FOR<td>APPROVAL<td>PROJECT</td><td>LAKE CITY FL 32025</td><td>DRAFT: RDP</td></td></td>	FOR <td>APPROVAL<td>PROJECT</td><td>LAKE CITY FL 32025</td><td>DRAFT: RDP</td></td>	APPROVAL <td>PROJECT</td> <td>LAKE CITY FL 32025</td> <td>DRAFT: RDP</td>	PROJECT	LAKE CITY FL 32025	DRAFT: RDP
							[] <td>OTHER,</td> <td>EXPLAIN<td>ADDRESS</td><td></td><td>CHECK: CR</td></td>	OTHER,	EXPLAIN <td>ADDRESS</td> <td></td> <td>CHECK: CR</td>	ADDRESS		CHECK: CR
												DATE: 5/16/18
												SHEET
												ES

APPLICATION OF SEAL IS FOR METAL BUILDING ONLY AND DOES NOT REPRESENT THE PROFESSIONAL OF RECORD.



WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620


5/24/18

ORIGINAL SIGNATURE REQUIRED


TRIM TABLE			
OLD MARK	LENGTH	DETAIL	
1 HTX15	195,000	TRIM-33	
2 HTX18	219,000	TRIM-33	
3 HTX14	171,000	TRIM-33	

MEMBER TABLE			
MARK	PART	LENGTH	
S-1	4X20C16	122,000	
S-2	4X20C16	124,500	
S-3	4X20C16	127,000	
S-4	4X20C16	129,500	
DJ-1	4X20C16	127,000	
DJ-2	4X20C16	95,500	
DH-1	4X20C16	35,500	
G-1	4X20C16	57,500	
G-2	4X20C16	55,500	
G-3	4X20C16	36,000	
G-4	4X20C16	36,000	


CONNECTION PLATES	
OLD MARK/PART	
1 BC-1	
2 MC-1	
3 MC-1	

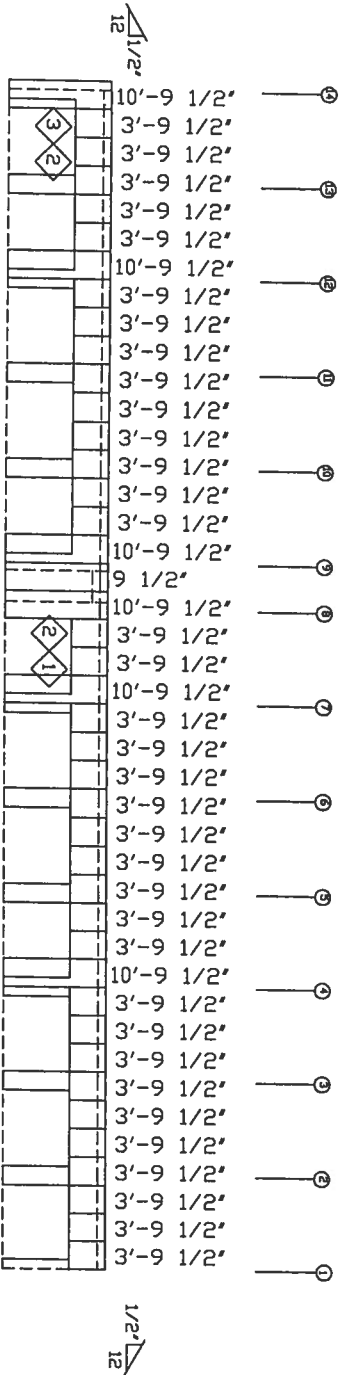


WALL SHEETING & TRIM FRAME LINE: E
PANELS: 26 Ga. PR - NEED COLOR

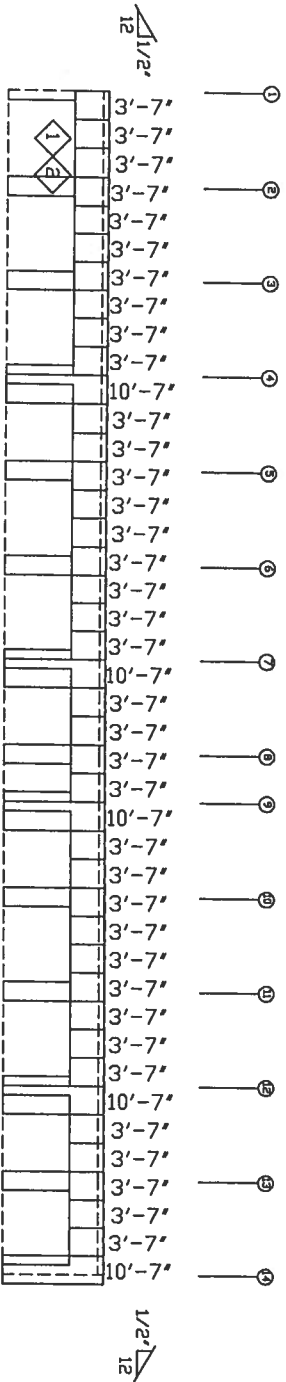

WALL SHEETING & TRIM FRAME LINE: D
PANELS: 26 Ga. PR - NEED COLOR

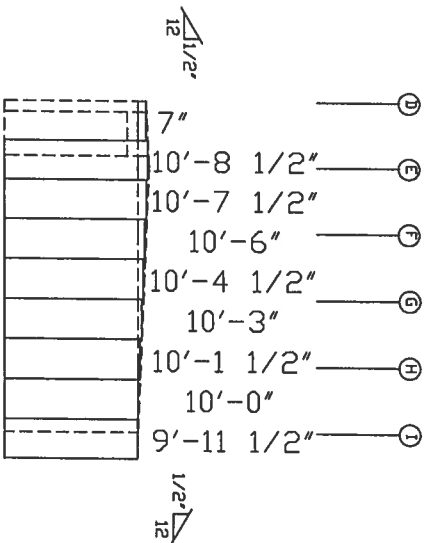


WALL SHEETING & TRIM
FRAME LINE: 9
PANELS: 26 Ga. PR - NEED COLOR

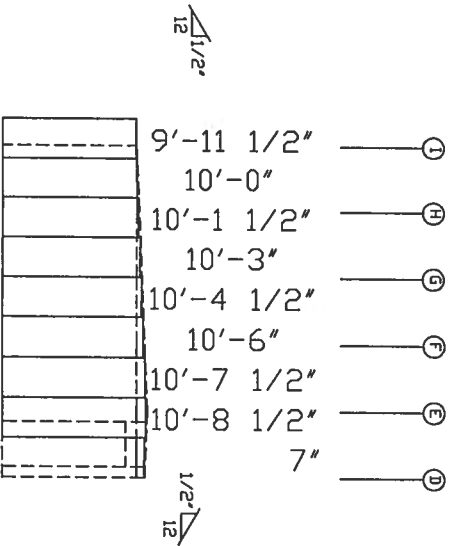

WALL SHEETING & TRIM
FRAME LINE: 8
PANELS: 26 Ga. PR - NEED COLOR

APPLICATION OF SEAL IS FOR
METAL BUILDING ONLY AND DOES
NOT REPRESENT THE PROFESSIONAL
OF RECORD.

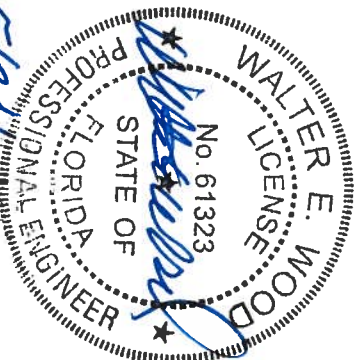

WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620

REVISIONS					
REV.	DESCRIPTION	DATE	DTLR	DATE	CHKR




DRAWING STATUS					

VULCAN STEEL STRUCTURES, INC.			
PROJECT	MINI STORAGE & RECORD OF LAKE		
ID	25486		
PROJECT ADDRESS	LAKE CITY FL 32025		

MINI STORAGE & RECORD OF LAKE			
DESIGN	ZJM	DRAFT	RDP
DATE	5/16/18	SHEET	E8




MEMBER TABLE			
MARK	PART	LENGTH	
S-1	4X20C16	10'-2"	
S-2	4X20C16	10'-4 1/2"	
S-3	4X20C16	10'-7 1/2"	
S-4	4X20C16	9'-11 1/4"	
S-5	4X20C16	10'-4 1/4"	
S-6	4X20C16	10'-6 3/4"	
S-7	4X20C16	10'-9 1/4"	
S-8	4X20C16	10'-9 1/4"	
S-9	4X20C16	10'-9 1/4"	

CONNECTION PLATES	
ID	MARK/PART
1	BC-1

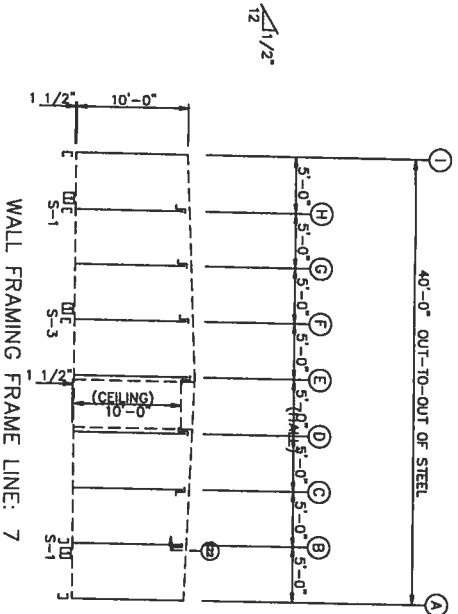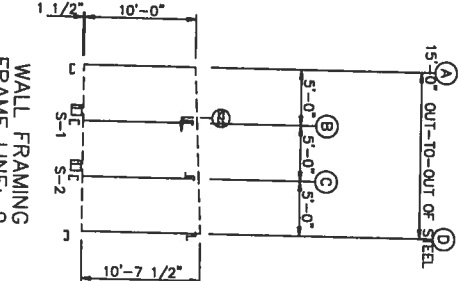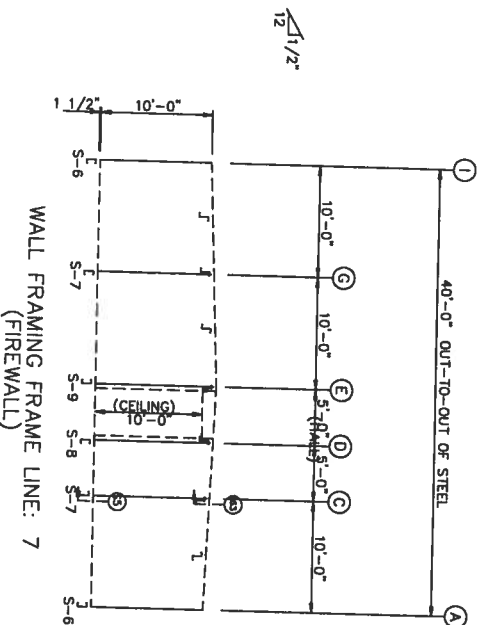

WALL SHEETING & TRIM
FRAME LINE: 9
PANELS: 29 Ga. PR - Galvalume

14'-10"
14'-10"
14'-10"

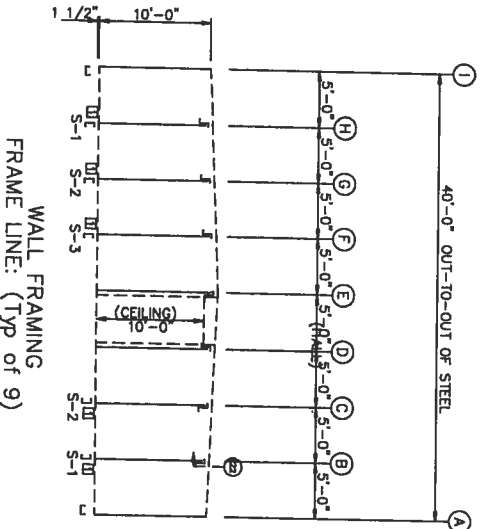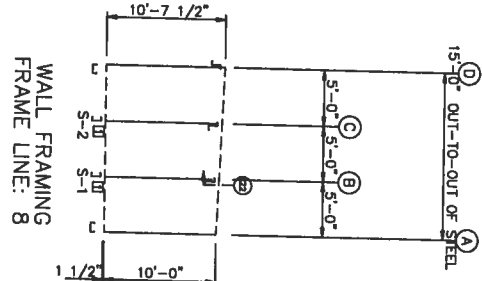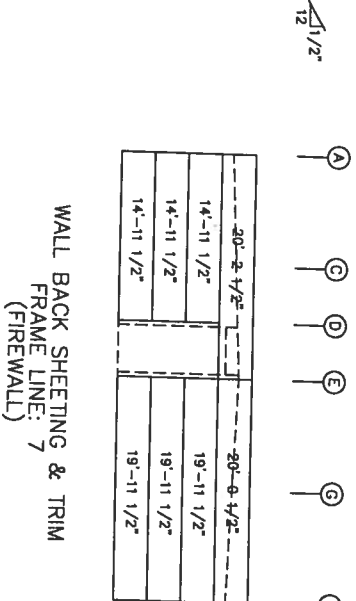

WALL SHEETING & TRIM
FRAME LINE: 8
PANELS: 29 Ga. PR - Galvalume

14'-10"
14'-10"
14'-10"

APPLICATION OF SEAL IS FOR
METAL BUILDING ONLY AND DOES
NOT REPRESENT THE PROFESSIONAL
OF RECORD.




WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620


REVISIONS			
REV.	DESCRIPTION	DATE	BY

DRAWING STATUS			

ORIGINAL SIGNATURE REQUIRED			
PROJECT	MINI STORAGE & RECORD OF LAKE	DESIGN	ZJM
ID	25486	DRAFT	RDP
PRN		CHECK	CR
DATE	5/24/18		

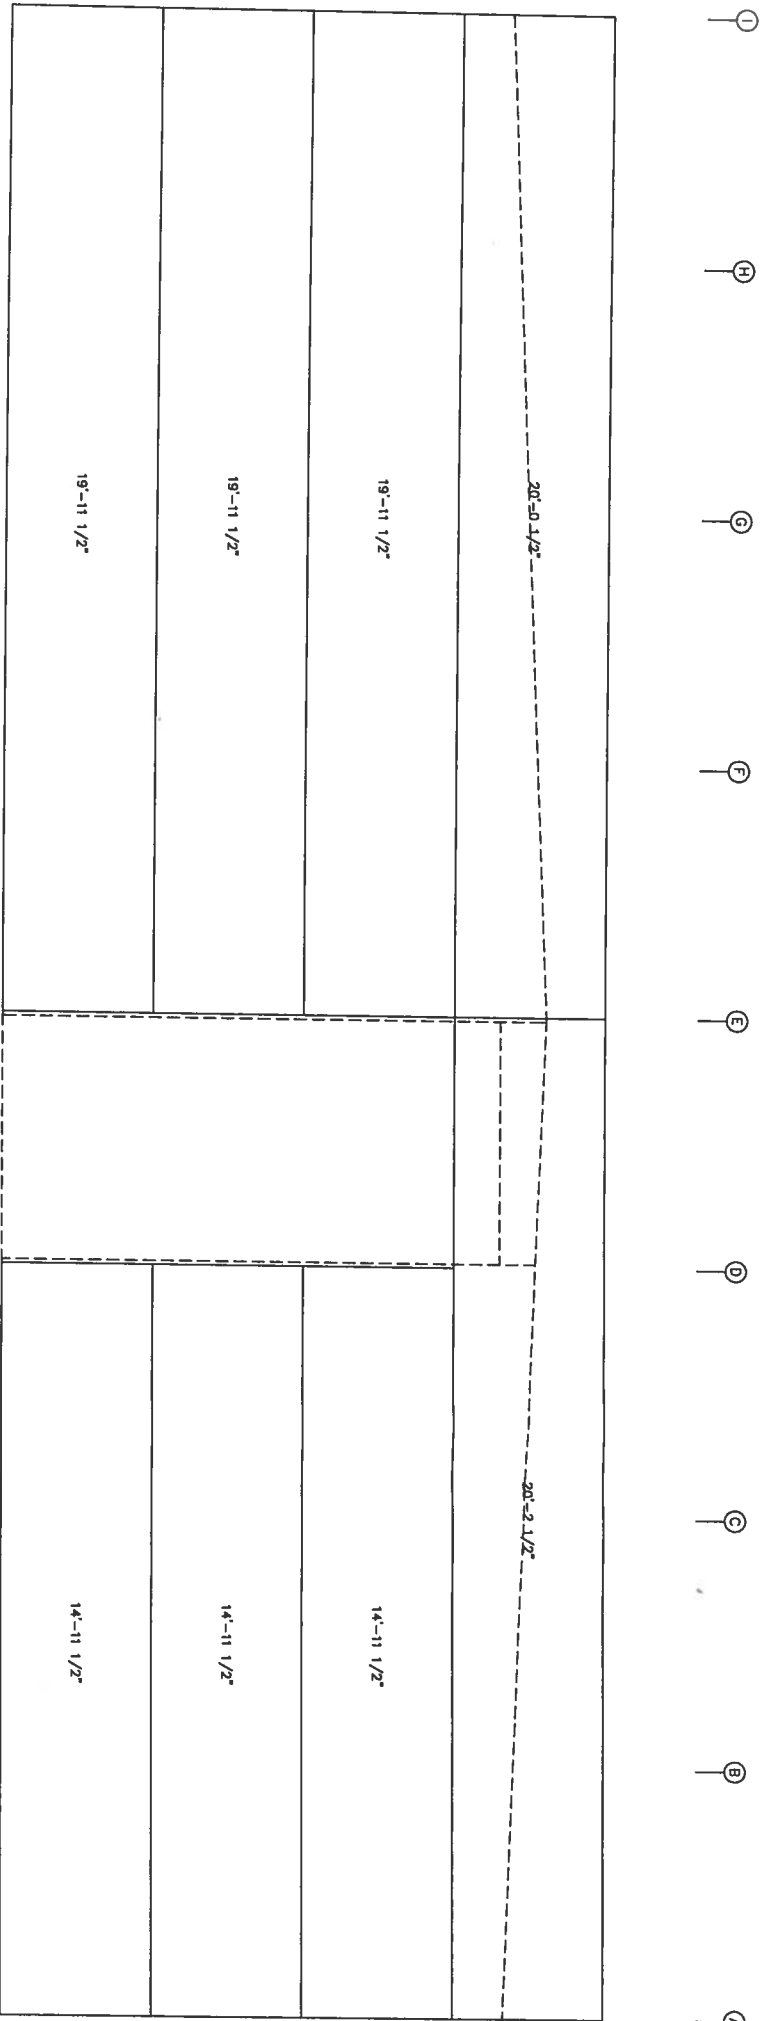

WALL SHEETING & TRIM FRAME LINE: 7
PANELS: 29 Ga. PR - Galvalume

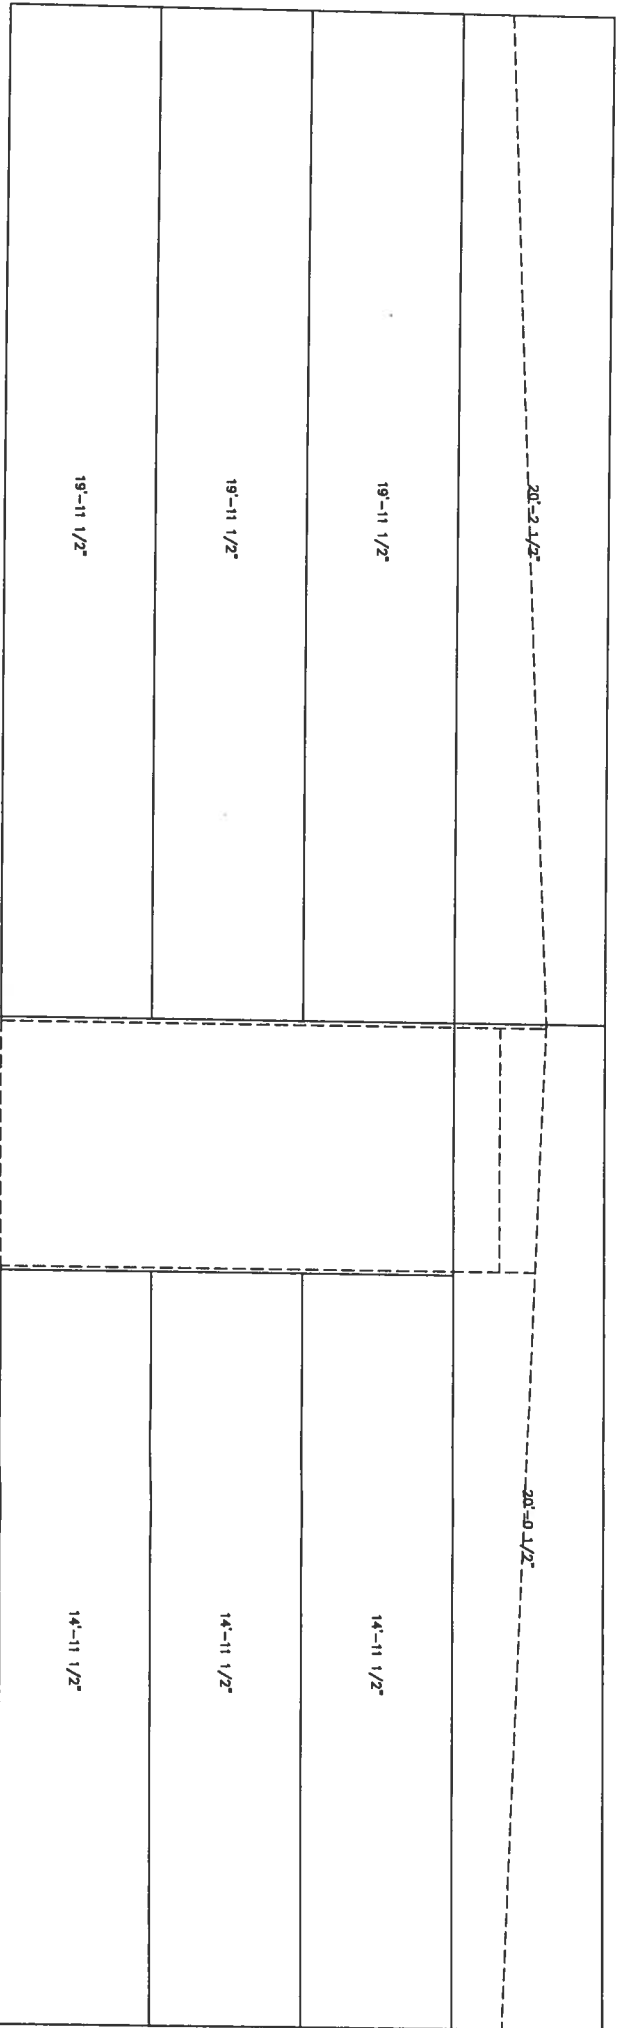

WALL SHEETING & TRIM FRAME LINE: (Typ of 9)
PANELS: 29 Ga. PR - Galvalume

REVISIONS					
REV.	DESCRIPTION	DATE	DLR	DATE	CHKR

DRAWING STATUS
☐ FINAL ERECTION
☒ FOR CONSTRUCTION
☐ FOR APPROVAL
☐ OTHER, EXPLAIN

VULCAN STEEL STRUCTURES, INC	
PROJECT	
ID	25486
PROJECT ADDRESS	LAKE CITY FL 32025

APPLICATION OF SEAL IS FOR METAL BUILDING ONLY AND DOES NOT REPRESENT THE PROFESSIONAL OF RECORD.




WALTER E. WOOD P.E.
FLORIDA P.E.# 61323
500 VULCAN PARKWAY
ADEL, GA 31620

512418

ORIGINAL SIGNATURE REQUIRED

MINI STORAGE & RECORD OF LAKE			
DESIGN	ZJM	DRAFT	RDP
CHECK	CR	DATE	5/16/18
SHEET	E10		

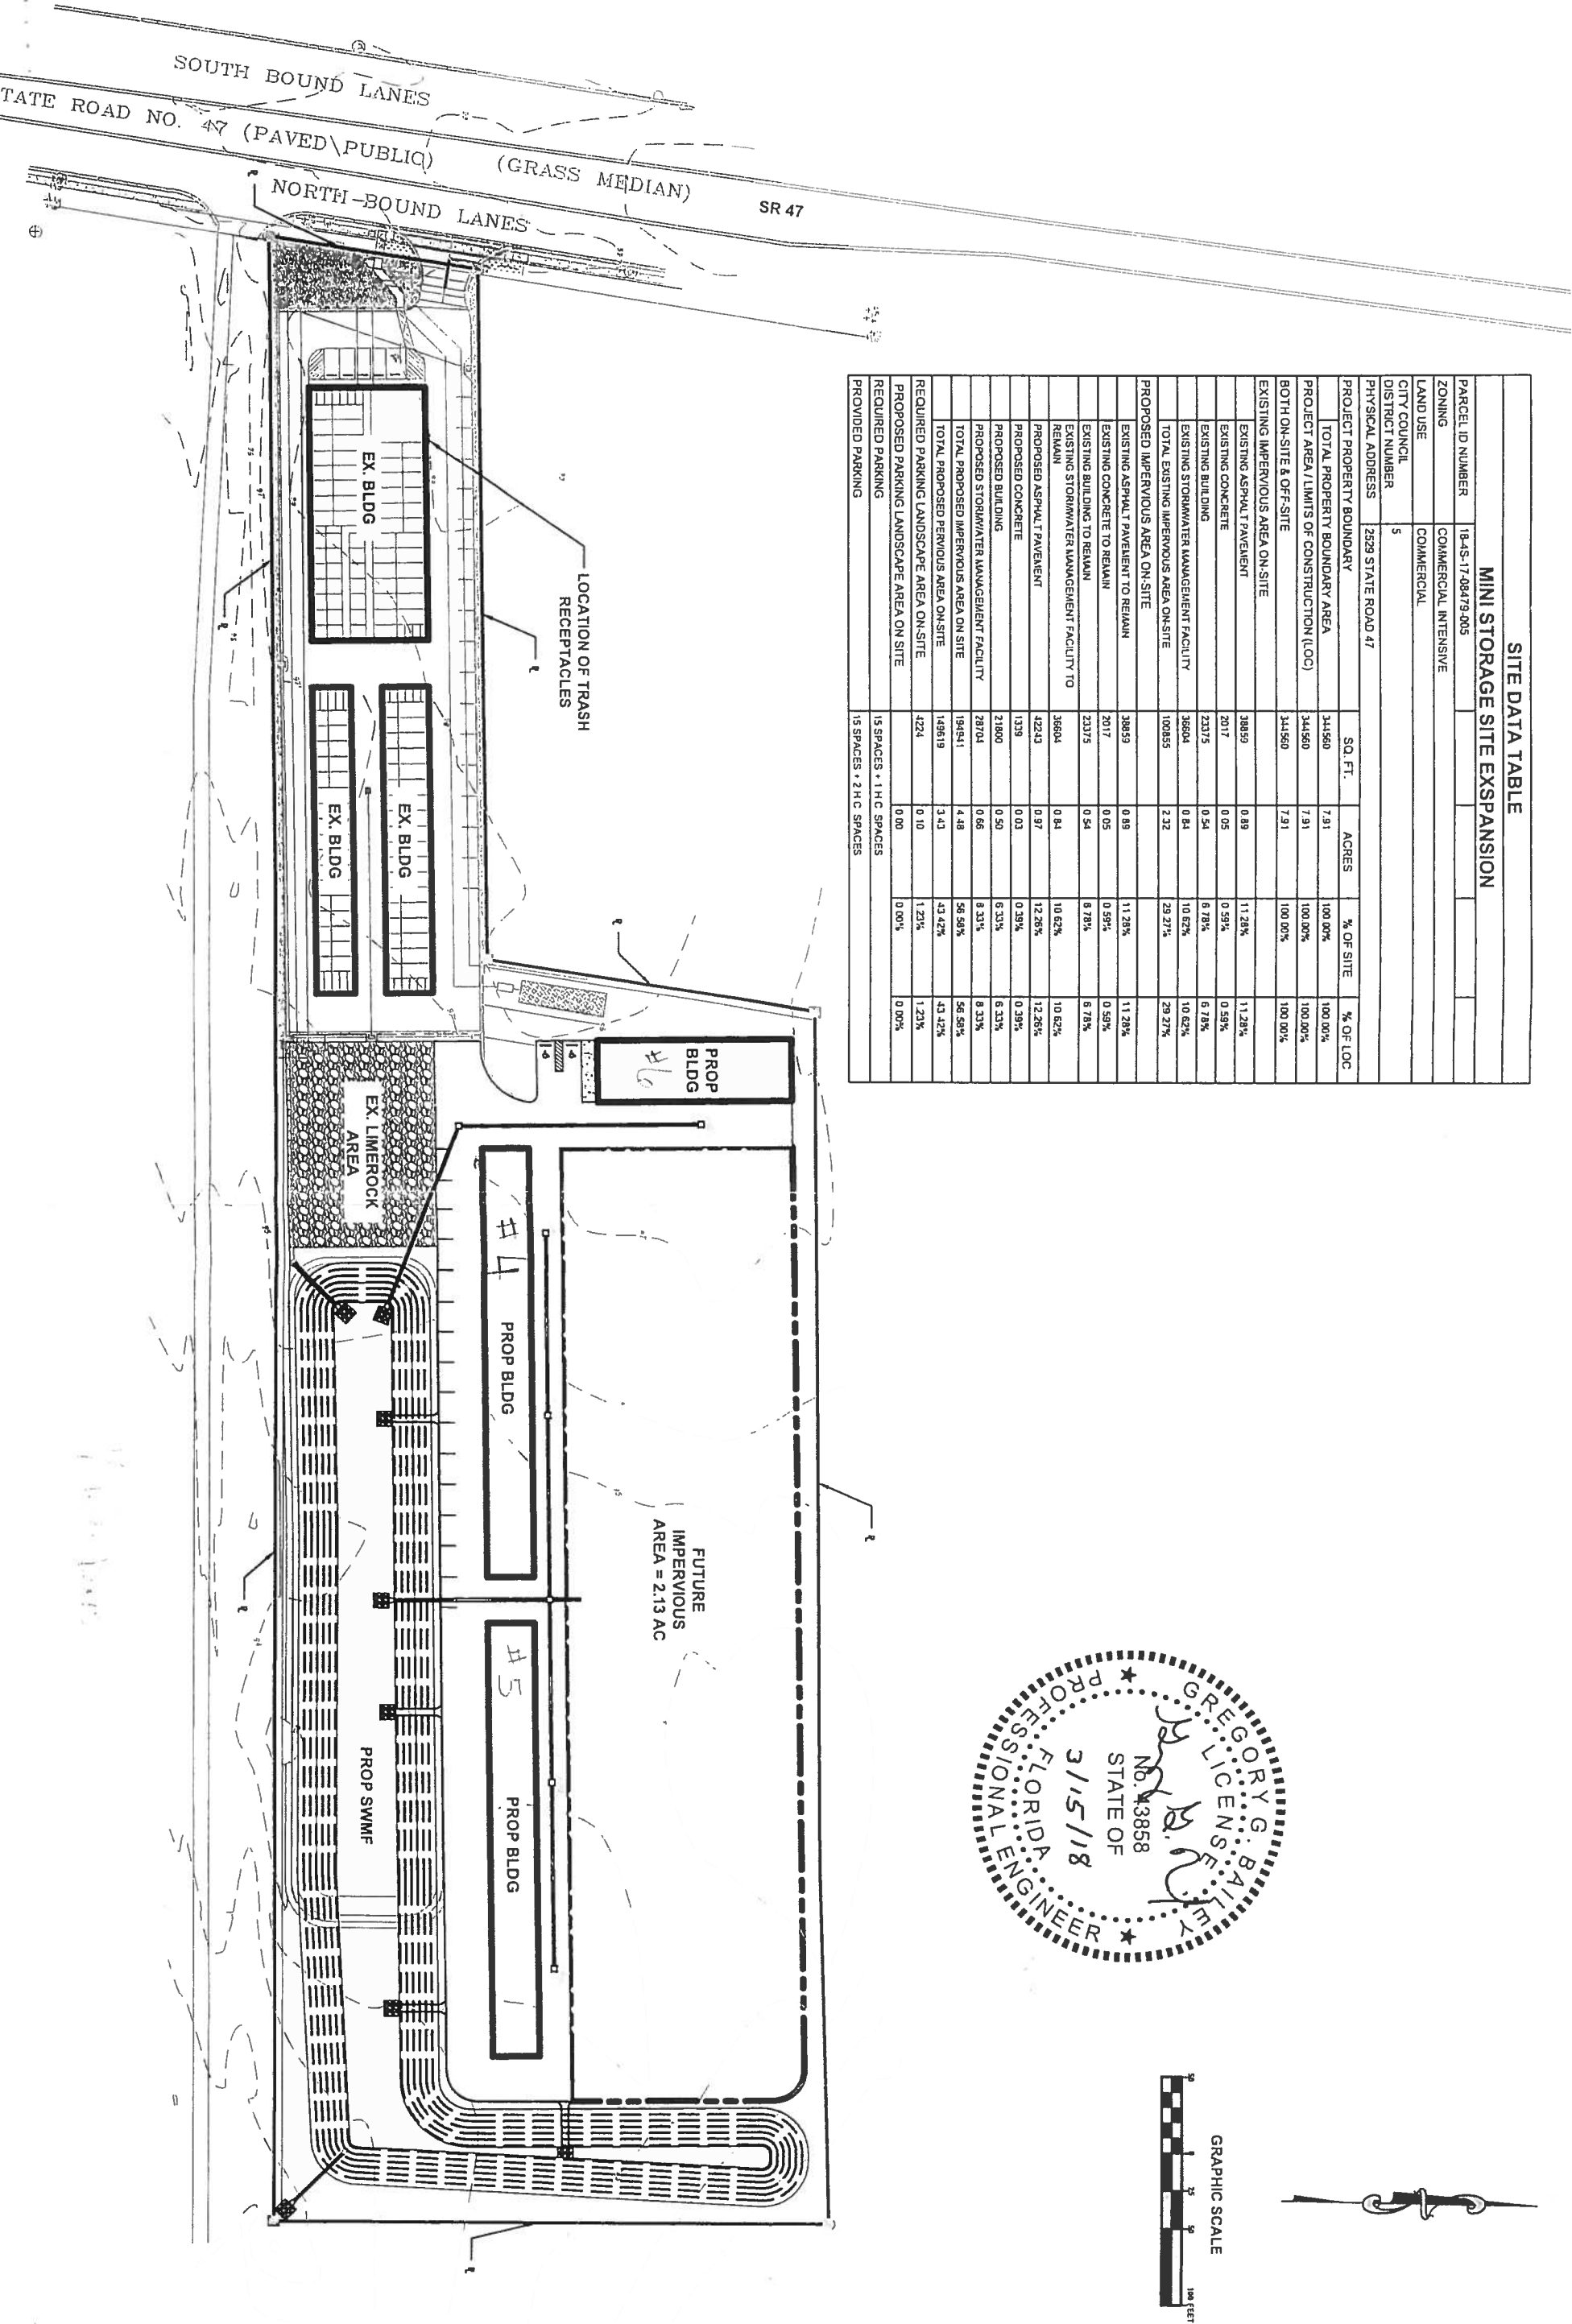

SITE DATA TABLE				
MINI STORAGE SITE EXPANSION				
PARCEL ID NUMBER	18-AS-17-08479-005			
ZONING	COMMERCIAL INTENSIVE			
LAND USE	COMMERCIAL			
CITY COUNCIL DISTRICT NUMBER	5			
PHYSICAL ADDRESS	2529 STATE ROAD 47			
PROJECT PROPERTY BOUNDARY		SQ. FT.	ACRES	% OF SITE
TOTAL PROPERTY BOUNDARY AREA	344560	7.91	100.00%	100.00%
PROJECT AREA / LIMITS OF CONSTRUCTION (LOC)	344560	7.91	100.00%	100.00%
BOTH ON-SITE & OFF-SITE	344560	7.91	100.00%	100.00%
EXISTING IMPERVIOUS AREA ON-SITE				
EXISTING ASPHALT PAVEMENT	38859	0.89	11.28%	11.28%
EXISTING CONCRETE	2017	0.05	0.59%	0.59%
EXISTING BUILDING	23375	0.54	6.78%	6.78%
EXISTING STORMWATER MANAGEMENT FACILITY	36604	0.84	10.62%	10.62%
TOTAL EXISTING IMPERVIOUS AREA ON-SITE	100555	2.32	29.27%	29.27%
PROPOSED IMPERVIOUS AREA ON-SITE				
EXISTING ASPHALT PAVEMENT TO REMAIN	38859	0.89	11.28%	11.28%
EXISTING CONCRETE TO REMAIN	2017	0.05	0.59%	0.59%
EXISTING BUILDING TO REMAIN	23375	0.54	6.78%	6.78%
EXISTING STORMWATER MANAGEMENT FACILITY TO REMAIN	36604	0.84	10.62%	10.62%
PROPOSED ASPHALT PAVEMENT	42243	0.97	12.26%	12.26%
PROPOSED CONCRETE	1339	0.03	0.39%	0.39%
PROPOSED BUILDING	21800	0.50	6.33%	6.33%
PROPOSED STORMWATER MANAGEMENT FACILITY	28704	0.66	8.33%	8.33%
TOTAL PROPOSED IMPERVIOUS AREA ON SITE	194541	4.48	58.58%	58.58%
TOTAL PROPOSED PERVIOUS AREA ON-SITE	149619	3.43	43.42%	43.42%
REQUIRED PARKING LANDSCAPE AREA ON-SITE	4224	0.10	1.23%	1.23%
PROPOSED PARKING				
REQUIRED PARKING	15 SPACES + 1 H.C. SPACES			
PROVIDED PARKING	15 SPACES + 2 H.C. SPACES			

18-01045