


	Revision Schedule	
Revision Number	Revision Description	Revision Date
0	ISSUED FOR PERMITTING	12/8/23
1	ENCLOSED GARAGE	5/30/24

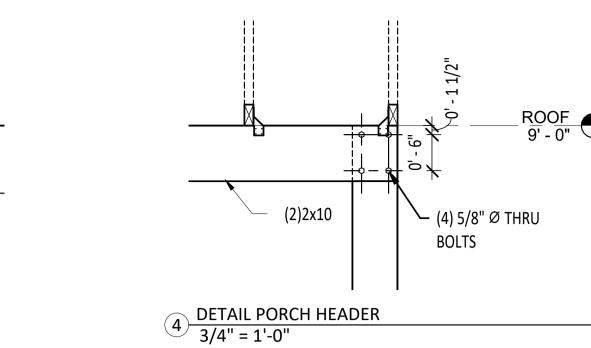

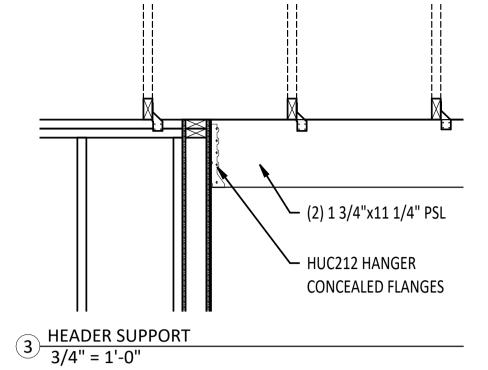

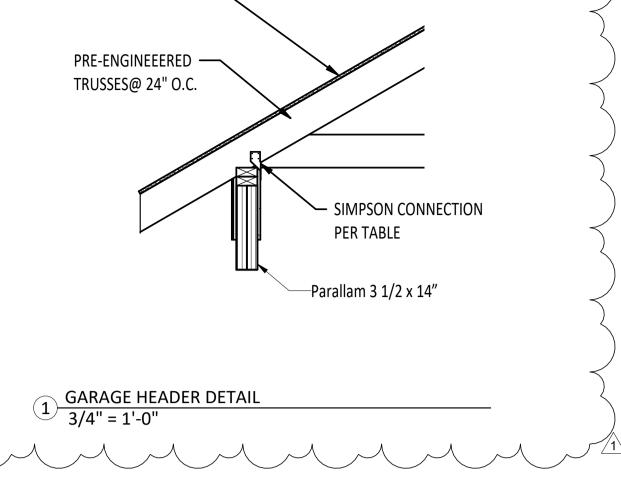

	STUD FASTENERS SCHEDULE							
				SPACING				
			SPACING TOP	BOTTOM				
	TRUSS UPLIFT	STUD UPLIFT	PLATE	PLATE			NAILS REQ'D	
STUD / PLATE	(LB)	(LB)	(STAGGERED)	(STAGGERED)	FASTENER	NAILS REQ'D STUD	PLATE	
2x4	< 549	< 368	2' - 8"	2' - 8"	SP4	(6) 10d X 1 1/2"		
2x6	< 549	< 368	2' - 8"	2' - 8"	SP6	(6) 10d X 1 1/2"		
2x	<743	<445	2' - 8"	2' - 8"	SP2	(6) 10d	(6) 10d	
2x	<1328	<890	1' - 4"	1' - 4"	SP2	(6) 10d	(6) 10d	
2x	<1051	<680	2' - 8"	2' - 8"	SPH4	(12) 10d x 1 1/2"		
2x	<2029	<1360	2' - 8"	2' - 8"	SP4	(12) 10d x 1 1/2"		
2x	<1015	<680	2' - 8"	2' - 8"	SP6	(12) 10d x 1 1/2"		
2x	<2029	<1360	32' - 0"	32' - 0"	SP6	(12) 10d x 1 1/2"		

TRUSS FASTENER SCHEDULE						
NUMBER OF TRUSS PLY	UPLIFT (LBS)	FASTENER QUANT.	FASTENER TYPE	REQ. NAILS IN TRUSS	REQ. NAILS IN PLATE	
1	415	1	H2.5	(5) 8d	(5) 8d	
1	905	1	H10	(8)8dX 1 1/2"	(8) 8dx 1 1/2"	
1	1200	2	H2.5	(10) 8d	(10) 8d	
2	870	1	H10S	(8)8dX 1 1/2"	(8) 8dx 1 1/2"	
2	2150	1	LGT2	(14) 16d	(16) 16d	
				SINKERS	SINKERS	
3	3685	1	LGT3-SDS2.5	(26) 16d	(12) SDS	
				SINKERS	1/4"x2 1/2"	



THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY GARY GILL, PE ON THE DATE AND/OR TIME STAMP SHOWN USING A DIGITAL SIGNATURE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED BY A 3RD PARTY CERTIFICATE AUTHORITY ON ANY ELECTRONIC COPY. FAC 61G15-23.004

> Digitally signed Gary Date: 2024.05.30

O'NEAL RESIDENCE - STRUCTURAL

COLUMBIA COUNTY, FL

GREGORY O'NEAL				GILL ENGINEERING SERVICES, INC		
DRAWN BY:	GG			AUTH # 30824 GARY GILL PE #51942		
CHKD BY:	GG			P.O. BOX 1420		
APPRD BY:	GG			LIVE OAK, FL 32064 386-590-1242		

SECTION VIEWS

4-088 S-005	

ROOF SHEATHING	
PRE-ENGINEEERED TRUSSES@ 24" O.C.	
SIMPSON CONNECTION PER TABLE	
Parallam 3 1/2 x 14"	
GARAGE HEADER DETAIL 3/4" = 1'-0"	