

**FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION**

Florida Department of Business and Professional Regulation - Residential Performance Method

<b>Project Name:</b> Lot 3 Creek Run Plantation <b>Street:</b> <b>City, State, Zip:</b> Lake City, FL, 32025 <b>Owner:</b> Peter & Anna Lev <b>Design Location:</b> FL, Gainesville	<b>Builder Name:</b> <b>Permit Office:</b> Columbia County <b>Permit Number:</b> <b>Jurisdiction:</b> <b>County:</b> Columbia (Florida Climate Zone 2)
---	--


  


<table style="width:100%;"> <tr> <td style="width:30%;">1. New construction or existing</td> <td style="width:30%;">New (From Plans)</td> <td style="width:40%;"></td> </tr> <tr> <td>2. Single family or multiple family</td> <td>Single-family</td> <td></td> </tr> <tr> <td>3. Number of units, if multiple family</td> <td>1</td> <td></td> </tr> <tr> <td>4. Number of Bedrooms</td> <td>3</td> <td></td> </tr> <tr> <td>5. Is this a worst case?</td> <td>No</td> <td></td> </tr> <tr> <td>6. Conditioned floor area above grade (ft²)</td> <td>1683</td> <td></td> </tr> <tr> <td>Conditioned floor area below grade (ft²)</td> <td>0</td> <td></td> </tr> <tr> <td>7. Windows (279.0 sqft.)</td> <td>Description</td> <td>Area</td> </tr> <tr> <td>a. U-Factor:</td> <td>Dbl, U=0.36</td> <td>279.00 ft²</td> </tr> <tr> <td>SHGC:</td> <td>SHGC=0.25</td> <td></td> </tr> <tr> <td>b. U-Factor:</td> <td>N/A</td> <td>ft²</td> </tr> <tr> <td>SHGC:</td> <td></td> <td></td> </tr> <tr> <td>c. U-Factor:</td> <td>N/A</td> <td>ft²</td> </tr> <tr> <td>SHGC:</td> <td></td> <td></td> </tr> <tr> <td>d. U-Factor:</td> <td>N/A</td> <td>ft²</td> </tr> <tr> <td>SHGC:</td> <td></td> <td></td> </tr> <tr> <td>Area Weighted Average Overhang Depth:</td> <td>2.518 ft.</td> <td></td> </tr> <tr> <td>Area Weighted Average SHGC:</td> <td>0.250</td> <td></td> </tr> <tr> <td>8. Floor Types (1683.0 sqft.)</td> <td>Insulation</td> <td>Area</td> </tr> <tr> <td>a. Slab-On-Grade Edge Insulation</td> <td>R=0.0</td> <td>1683.00 ft²</td> </tr> <tr> <td>b. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>c. N/A</td> <td>R=</td> <td>ft²</td> </tr> </table>	1. New construction or existing	New (From Plans)		2. Single family or multiple family	Single-family		3. Number of units, if multiple family	1		4. Number of Bedrooms	3		5. Is this a worst case?	No		6. Conditioned floor area above grade (ft²)	1683		Conditioned floor area below grade (ft²)	0		7. Windows (279.0 sqft.)	Description	Area	a. U-Factor:	Dbl, U=0.36	279.00 ft²	SHGC:	SHGC=0.25		b. U-Factor:	N/A	ft²	SHGC:			c. U-Factor:	N/A	ft²	SHGC:			d. U-Factor:	N/A	ft²	SHGC:			Area Weighted Average Overhang Depth:	2.518 ft.		Area Weighted Average SHGC:	0.250		8. Floor Types (1683.0 sqft.)	Insulation	Area	a. Slab-On-Grade Edge Insulation	R=0.0	1683.00 ft²	b. N/A	R=	ft²	c. N/A	R=	ft²	<table style="width:100%;"> <tr> <td style="width:30%;">9. Wall Types (1723.6 sqft.)</td> <td style="width:30%;">Insulation</td> <td style="width:40%;">Area</td> </tr> <tr> <td>a. Insulated Concrete Form, Exterior</td> <td>R=30.0</td> <td>1437.30 ft²</td> </tr> <tr> <td>b. Frame - Wood, Adjacent</td> <td>R=13.0</td> <td>286.22 ft²</td> </tr> <tr> <td>c. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>d. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>10. Ceiling Types (1767.0 sqft.)</td> <td>Insulation</td> <td>Area</td> </tr> <tr> <td>a. Under Attic (Vented)</td> <td>R=38.0</td> <td>1767.00 ft²</td> </tr> <tr> <td>b. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>c. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>11. Ducts</td> <td>R</td> <td>ft²</td> </tr> <tr> <td>a. Sup: Attic, Ret: Attic, AH: Garage</td> <td>6</td> <td>420.75</td> </tr> <tr> <td>12. Cooling systems</td> <td>kBtu/hr</td> <td>Efficiency</td> </tr> <tr> <td>a. Central Unit</td> <td>18.1</td> <td>SEER:14.00</td> </tr> <tr> <td>13. Heating systems</td> <td>kBtu/hr</td> <td>Efficiency</td> </tr> <tr> <td>a. Electric Heat Pump</td> <td>24.7</td> <td>HSPF:8.20</td> </tr> <tr> <td>14. Hot water systems</td> <td></td> <td></td> </tr> <tr> <td>a. Electric</td> <td>Cap: 50 gallons</td> <td></td> </tr> <tr> <td>b. Conservation features</td> <td>EF: 0.920</td> <td></td> </tr> <tr> <td>None</td> <td></td> <td></td> </tr> <tr> <td>15. Credits</td> <td></td> <td>CV, Pstat</td> </tr> </table>	9. Wall Types (1723.6 sqft.)	Insulation	Area	a. Insulated Concrete Form, Exterior	R=30.0	1437.30 ft²	b. Frame - Wood, Adjacent	R=13.0	286.22 ft²	c. N/A	R=	ft²	d. N/A	R=	ft²	10. Ceiling Types (1767.0 sqft.)	Insulation	Area	a. Under Attic (Vented)	R=38.0	1767.00 ft²	b. N/A	R=	ft²	c. N/A	R=	ft²	11. Ducts	R	ft²	a. Sup: Attic, Ret: Attic, AH: Garage	6	420.75	12. Cooling systems	kBtu/hr	Efficiency	a. Central Unit	18.1	SEER:14.00	13. Heating systems	kBtu/hr	Efficiency	a. Electric Heat Pump	24.7	HSPF:8.20	14. Hot water systems			a. Electric	Cap: 50 gallons		b. Conservation features	EF: 0.920		None			15. Credits		CV, Pstat
1. New construction or existing	New (From Plans)																																																																																																																														
2. Single family or multiple family	Single-family																																																																																																																														
3. Number of units, if multiple family	1																																																																																																																														
4. Number of Bedrooms	3																																																																																																																														
5. Is this a worst case?	No																																																																																																																														
6. Conditioned floor area above grade (ft²)	1683																																																																																																																														
Conditioned floor area below grade (ft²)	0																																																																																																																														
7. Windows (279.0 sqft.)	Description	Area																																																																																																																													
a. U-Factor:	Dbl, U=0.36	279.00 ft²																																																																																																																													
SHGC:	SHGC=0.25																																																																																																																														
b. U-Factor:	N/A	ft²																																																																																																																													
SHGC:																																																																																																																															
c. U-Factor:	N/A	ft²																																																																																																																													
SHGC:																																																																																																																															
d. U-Factor:	N/A	ft²																																																																																																																													
SHGC:																																																																																																																															
Area Weighted Average Overhang Depth:	2.518 ft.																																																																																																																														
Area Weighted Average SHGC:	0.250																																																																																																																														
8. Floor Types (1683.0 sqft.)	Insulation	Area																																																																																																																													
a. Slab-On-Grade Edge Insulation	R=0.0	1683.00 ft²																																																																																																																													
b. N/A	R=	ft²																																																																																																																													
c. N/A	R=	ft²																																																																																																																													
9. Wall Types (1723.6 sqft.)	Insulation	Area																																																																																																																													
a. Insulated Concrete Form, Exterior	R=30.0	1437.30 ft²																																																																																																																													
b. Frame - Wood, Adjacent	R=13.0	286.22 ft²																																																																																																																													
c. N/A	R=	ft²																																																																																																																													
d. N/A	R=	ft²																																																																																																																													
10. Ceiling Types (1767.0 sqft.)	Insulation	Area																																																																																																																													
a. Under Attic (Vented)	R=38.0	1767.00 ft²																																																																																																																													
b. N/A	R=	ft²																																																																																																																													
c. N/A	R=	ft²																																																																																																																													
11. Ducts	R	ft²																																																																																																																													
a. Sup: Attic, Ret: Attic, AH: Garage	6	420.75																																																																																																																													
12. Cooling systems	kBtu/hr	Efficiency																																																																																																																													
a. Central Unit	18.1	SEER:14.00																																																																																																																													
13. Heating systems	kBtu/hr	Efficiency																																																																																																																													
a. Electric Heat Pump	24.7	HSPF:8.20																																																																																																																													
14. Hot water systems																																																																																																																															
a. Electric	Cap: 50 gallons																																																																																																																														
b. Conservation features	EF: 0.920																																																																																																																														
None																																																																																																																															
15. Credits		CV, Pstat																																																																																																																													

Glass/Floor Area: 0.166	Total Proposed Modified Loads: 43.44	<b>PASS</b>
	Total Baseline Loads: 51.15	

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.  <b>PREPARED BY:</b> <u></u> <b>DATE:</b> <u>11/15/2019</u>  I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.  <b>OWNER/AGENT:</b> _____ <b>DATE:</b> _____	Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.  <b>BUILDING OFFICIAL:</b> _____ <b>DATE:</b> _____
---	---



- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with R403.3.2.1.
- Compliance requires an Air Barrier and Insulation Inspection Checklist in accordance with R402.4.1.1 and this project requires an envelope leakage test report with envelope leakage no greater than 5.00 ACH50 (R402.4.1.2).
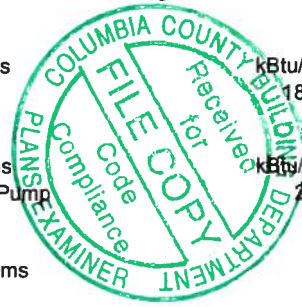
## INPUT SUMMARY CHECKLIST REPORT

## PROJECT

Title:	Lot 3 Creek Run Plantation	Bedrooms:	3	Address Type:	Lot Information
Building Type:	User	Conditioned Area:	1683	Lot #	3
Owner Name:	Peter & Anna Lev	Total Stories:	1	Block/Subdivision:	Creek Run Plant
# of Units:	1	Worst Case:	No	PlatBook:	
Builder Name:		Rotate Angle:	0	Street:	
Permit Office:	Columbia County	Cross Ventilation:	Yes	County:	Columbia
Jurisdiction:		Whole House Fan:	No	City, State, Zip:	Lake City , FL , 32025
Family Type:	Single-family				
New/Existing:	New (From Plans)				
Comment:					

## CLIMATE

✓	Design Location	TMY Site	Design Temp 97.5 %	2.5 %	Int Design Temp Winter	Summer	Heating Degree Days	Design Moisture	Daily Temp Range
_____	FL, Gainesville	FL_GAINESVILLE_REGI	32	92	70	75	1305.5	51	Medium

## BLOCKS

Number	Name	Area	Volume
1	Block1	1683	15702.4

## SPACES

Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Infil ID	Finished	Cooled	Heated
1	Main	1683	15702.4	Yes	6	3	1	Yes	Yes	Yes

## FLOORS

✓	#	Floor Type	Space	Perimeter	R-Value	Area		Tile	Wood	Carpet
_____	1	Slab-On-Grade Edge Insulation	Main	184 ft	0	1683 ft²	----	0	0	1

## ROOF

✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
_____	1	Gable or shed	Metal	2023 ft²	562 ft²	Medium	Y	0.96	No	0.9	No	0	33.7

## ATTIC

✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
_____	1	Full attic	Vented	300	1683 ft²	Y	N

## CEILING

✓	#	Ceiling Type	Space	R-Value	Ins Type	Area	Framing Frac	Truss Type
_____	1	Under Attic (Vented)	Main	38	Double Batt	1767 ft²	0.11	Wood

## INPUT SUMMARY CHECKLIST REPORT

## WALLS

✓ #	Omt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area	Sheathing R-Value	Framing Fraction	Solar Absor.	Below Grade%
1	S	Exterior	Insulated Concrete Form	Main	30	28	8	9	4	267.6 ft²	0	0	0.75	0
2	S	Exterior	Insulated Concrete Form	Main	30	12		9	4	112.0 ft²	0	0	0.75	0
3	E	Exterior	Insulated Concrete Form	Main	30	29	8	9	4	276.9 ft²	0	0	0.75	0
4	N	Exterior	Insulated Concrete Form	Main	30	62	8	9	4	584.9 ft²	0	0	0.75	0
5	W	Exterior	Insulated Concrete Form	Main	30	21		9	4	196.0 ft²	0	0	0.75	0
6	S	Garage	Frame - Wood	Main	13	22		9	4	205.3 ft²		0.23	0.75	0
7	W	Garage	Frame - Wood	Main	13	8	8	9	4	80.9 ft²		0.23	0.75	0

## DOORS

✓ #	Omt	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area
1	W	Insulated	Main	None	.46	3		6	8	20 ft²
2	S	Insulated	Main	None	.46	3		6	8	20 ft²

## WINDOWS

Orientation shown is the entered, Proposed orientation.

✓ #	Omt	Wall ID	Frame	Panes	NFRC	U-Factor	SHGC	Imp	Area	Overhang Depth	Separation	Int Shade	Screening
1	S	1	Vinyl	Low-E Double	Yes	0.36	0.25	N	9.0 ft²	7 ft 6 in	1 ft 0 in	None	None
2	S	1	Vinyl	Low-E Double	Yes	0.36	0.25	N	25.0 ft²	7 ft 6 in	1 ft 0 in	None	None
3	S	1	TIM	Low-E Double	Yes	0.36	0.25	N	13.3 ft²	7 ft 6 in	1 ft 0 in	None	None
4	S	2	Vinyl	Low-E Double	Yes	0.36	0.25	N	30.0 ft²	1 ft 6 in	1 ft 0 in	None	None
5	N	4	Vinyl	Low-E Double	Yes	0.36	0.25	N	60.0 ft²	1 ft 6 in	1 ft 0 in	None	None
6	N	4	Metal	Low-E Double	Yes	0.36	0.25	N	106.7 ft²	1 ft 6 in	1 ft 0 in	None	None
7	N	4	Vinyl	Low-E Double	Yes	0.36	0.25	N	9.0 ft²	1 ft 6 in	1 ft 0 in	None	None
8	N	4	Vinyl	Low-E Double	Yes	0.36	0.25	N	6.0 ft²	1 ft 6 in	1 ft 0 in	None	None
9	W	5	Vinyl	Low-E Double	Yes	0.36	0.25	N	20.0 ft²	1 ft 6 in	1 ft 0 in	None	None

## GARAGE

✓ #	Floor Area	Ceiling Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
1	484 ft²	484 ft²	58.667 ft	9.33 ft	1

## INFILTRATION

#	Scope	Method	SLA	CFM 50	ELA	EqLA	ACH	ACH 50
1	Wholehouse	Proposed ACH(50)	.000296	1308.5	71.84	135.1	.1186	5

## INPUT SUMMARY CHECKLIST REPORT

HEATING SYSTEM										
✓	#	System Type	Subtype	Speed	Efficiency	Capacity	Block	Ducts		
✓	1	Electric Heat Pump/	None		HSPF:8.2	24.73 kBtu/hr	1	sys#1		

COOLING SYSTEM										
✓	#	System Type	Subtype	Subtype	Efficiency	Capacity	Air Flow	SHR	Block	Ducts
✓	1	Central Unit/	None		SEER: 14	18.08 kBtu/hr	540 cfm	0.7	1	sys#1

HOT WATER SYSTEM										
✓	#	System Type	SubType	Location	EF	Cap	Use	SetPnt	Conservation	
✓	1	Electric	None	Garage	0.92	50 gal	40 gal	120 deg	None	

SOLAR HOT WATER SYSTEM										
✓	FSEC Cert #	Company Name	System Model #	Collector Model #	Collector Area	Storage Volume	FEF			
✓	None	None								

DUCTS														
✓	#	--- Supply ---			--- Return ---		Leakage Type	Air Handler	CFM 25 TOT	CFM25 OUT	QN	RLF	HVAC # Heat Cool	
		Location	R-Value	Area	Location	Area								
✓	1	Attic	6	420.75 f	Attic	84.15 ft²	Default Leakage	Garage	(Default)	c(Default)	c		1	1

TEMPERATURES														
Programable Thermostat: Y					Ceiling Fans:									
Cooling	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec		
Heating	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec		
Venting	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec		
Thermostat Schedule: HERS 2006 Reference														
Schedule Type			1	2	3	4	5	6	7	8	9	10	11	12
Cooling (WD)	AM	78	78	78	78	78	78	78	78	78	80	80	80	80
	PM	80	80	78	78	78	78	78	78	78	78	78	78	78
Cooling (WEH)	AM	78	78	78	78	78	78	78	78	78	78	78	78	78
	PM	78	78	78	78	78	78	78	78	78	78	78	78	78
Heating (WD)	AM	66	66	66	66	66	68	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	68	66	66
Heating (WEH)	AM	66	66	66	66	66	68	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	68	66	66

MASS				
Mass Type	Area	Thickness	Furniture Fraction	Space
Default(8 lbs/sq.ft.)	0 ft²	0 ft	0.3	Main

**ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD****ESTIMATED ENERGY PERFORMANCE INDEX\* =85****The lower the Energy Performance Index, the more efficient the home.**

1. New home or, addition	1. <u>New (From Plans)</u>	12. Ducts, location & insulation level	
2. Single-family or multiple-family	2. <u>Single-family</u>	a) Supply ducts	R <u>6.0</u>
3. No. of units (if multiple-family)	3. <u>1</u>	b) Return ducts	R <u>6.0</u>
4. Number of bedrooms	4. <u>3</u>	c) AHU location	<u>Garage</u>
5. Is this a worst case? (yes/no)	5. <u>No</u>	13. Cooling system:	Capacity <u>18.1</u>
6. Conditioned floor area (sq. ft.)	6. <u>1683</u>	a) Split system	SEER <u>        </u>
7. Windows, type and area		b) Single package	SEER <u>        </u>
a) U-factor:(weighted average)	7a. <u>0.360</u>	c) Ground/water source	SEER/COP <u>        </u>
b) Solar Heat Gain Coefficient (SHGC)	7b. <u>0.250</u>	d) Room unit/PTAC	EER <u>        </u>
c) Area	7c. <u>279.0</u>	e) Other	<u>14.0</u>
8. Skylights		14. Heating system:	Capacity <u>24.7</u>
a) U-factor:(weighted average)	8a. <u>NA</u>	a) Split system heat pump	HSPF <u>        </u>
b) Solar Heat Gain Coefficient (SHGC)	8b. <u>NA</u>	b) Single package heat pump	HSPF <u>        </u>
9. Floor type, insulation level:		c) Electric resistance	COP <u>        </u>
a) Slab-on-grade (R-value)	9a. <u>0.0</u>	d) Gas furnace, natural gas	AFUE <u>        </u>
b) Wood, raised (R-value)	9b. <u>        </u>	e) Gas furnace, LPG	AFUE <u>        </u>
c) Concrete, raised (R-value)	9c. <u>        </u>	f) Other	<u>8.20</u>
10. Wall type and insulation:		15. Water heating system	
A. Exterior:		a) Electric resistance	EF <u>0.92</u>
1. Wood frame (Insulation R-value)	10A1. <u>        </u>	b) Gas fired, natural gas	EF <u>        </u>
2. Masonry (Insulation R-value)	10A2. <u>30.0</u>	c) Gas fired, LPG	EF <u>        </u>
B. Adjacent:		d) Solar system with tank	EF <u>        </u>
1. Wood frame (Insulation R-value)	10B1. <u>13.0</u>	e) Dedicated heat pump with tank	EF <u>        </u>
2. Masonry (Insulation R-value)	10B2. <u>        </u>	f) Heat recovery unit	HeatRec% <u>        </u>
11. Ceiling type and insulation level		g) Other	<u>        </u>
a) Under attic	11a. <u>38.0</u>	16. HVAC credits claimed (Performance Method)	
b) Single assembly	11b. <u>        </u>	a) Ceiling fans	<u>        </u>
c) Knee walls/skylight walls	11c. <u>        </u>	b) Cross ventilation	<u>Yes</u>
d) Radiant barrier installed	11d. <u>Yes</u>	c) Whole house fan	<u>No</u>
		d) Multizone cooling credit	<u>        </u>
		e) Multizone heating credit	<u>        </u>
		f) Programmable thermostat	<u>Yes</u>

\*Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.

I certify that this home has complied with the Florida Building Code, Energy Conservation, through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL display card will be completed based on installed code compliant features.

Builder Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Address of New Home: \_\_\_\_\_ City/FL Zip: Lake City, FL 32025

# Envelope Leakage Test Report (Blower Door Test)

## Residential Prescriptive, Performance or ERI Method Compliance

### 2017 Florida Building Code, Energy Conservation, 6th Edition

Jurisdiction:

Permit #:

#### Job Information

Builder:

Community:

Lot: 3

Address:

City: Lake City

State: FL

Zip: 32025

#### Air Leakage Test Results *Passing results must meet either the Performance, Prescriptive, or ERI Method*

☐ **PRESCRIPTIVE METHOD**-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.

☐ **PERFORMANCE or ERI METHOD**-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2017 (Performance) or R406-2017 (ERI), section labeled as infiltration, sub-section ACH50.  
ACH(50) specified on Form R405-2017-Energy Calc (Performance) or R406-2017 (ERI): 5.000

$$\frac{\text{CFM}(50)}{\text{Building Volume}} \times 60 \div \frac{15702}{\text{ACH}(50)} = \text{ACH}(50)$$

☒ **PASS**

☐ When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.

Method for calculating building volume:

- ☐ Retrieved from architectural plans
- ☒ Code software calculated
- ☐ Field measured and calculated

**R402.4.1.2 Testing.** Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7) *Florida Statutes* or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
3. Interior doors, if installed at the time of the test, shall be open.
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
6. Supply and return registers, if installed at the time of the test, shall be fully open.

#### Testing Company

Company Name: \_\_\_\_\_ Phone: \_\_\_\_\_

I hereby verify that the above Air Leakage results are in accordance with the 2017 6th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.

Signature of Tester: \_\_\_\_\_ Date of Test: \_\_\_\_\_

Printed Name of Tester: \_\_\_\_\_

License/Certification #: \_\_\_\_\_ Issuing Authority: \_\_\_\_\_

# Residential System Sizing Calculation

## Summary

Peter & Anna Lev

Project Title:

Lot 3 Creek Run Plantation

Lake City, FL 32025


11/13/2019

Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M)			
Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(51gr.)			
Winter design temperature(TMY3 99%)	30 F	Summer design temperature(TMY3 99%)	94 F
Winter setpoint	70 F	Summer setpoint	75 F
Winter temperature difference	40 F	Summer temperature difference	19 F
<b>Total heating load calculation</b>	<b>24734 Btuh</b>	<b>Total cooling load calculation</b>	<b>18083 Btuh</b>
Submitted heating capacity	% of calc Btuh	Submitted cooling capacity	% of calc Btuh
Total (Electric Heat Pump)	100.0 24734	Sensible (SHR = 0.70)	88.1 12658
Heat Pump + Auxiliary(0.0kW)	100.0 24734	Latent	145.8 5425
		Total (Electric Heat Pump)	100.0 18083

## WINTER CALCULATIONS

Winter Heating Load (for 1683 sqft)


Load component		Load	
Window total	279 sqft	4018 Btuh	
Wall total	1405 sqft	2192 Btuh	
Door total	40 sqft	736 Btuh	
Ceiling total	1767 sqft	1794 Btuh	
Floor total	1683 sqft	8685 Btuh	
Infiltration	50 cfm	2175 Btuh	
Duct loss		5135 Btuh	
<b>Subtotal</b>		<b>24734 Btuh</b>	
Ventilation	0 cfm	0 Btuh	
<b>TOTAL HEAT LOSS</b>		<b>24734 Btuh</b>	

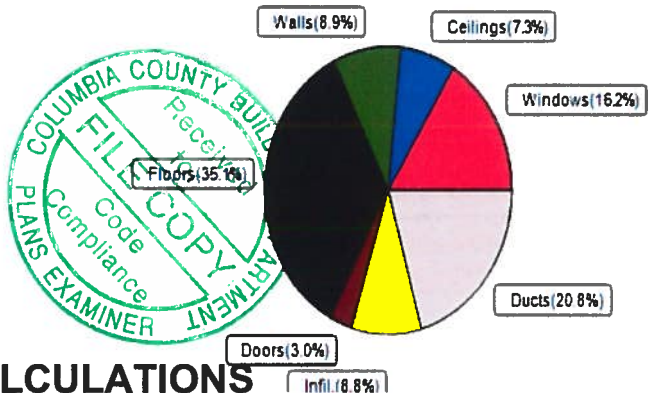

## SUMMER CALCULATIONS

Summer Cooling Load (for 1683 sqft)

Load component		Load	
Window total	279 sqft	3734 Btuh	
Wall total	1405 sqft	904 Btuh	
Door total	40 sqft	552 Btuh	
Ceiling total	1767 sqft	1525 Btuh	
Floor total		0 Btuh	
Infiltration	37 cfm	775 Btuh	
Internal gain		2580 Btuh	
Duct gain		4291 Btuh	
Sens. Ventilation	0 cfm	0 Btuh	
Blower Load		0 Btuh	
<b>Total sensible gain</b>		<b>14361 Btuh</b>	
Latent gain(ducts)		1236 Btuh	
Latent gain(infiltration)		1285 Btuh	
Latent gain(ventilation)		0 Btuh	
Latent gain(internal/occupants/other)		1200 Btuh	
<b>Total latent gain</b>		<b>3722 Btuh</b>	
<b>TOTAL HEAT GAIN</b>		<b>18083 Btuh</b>	

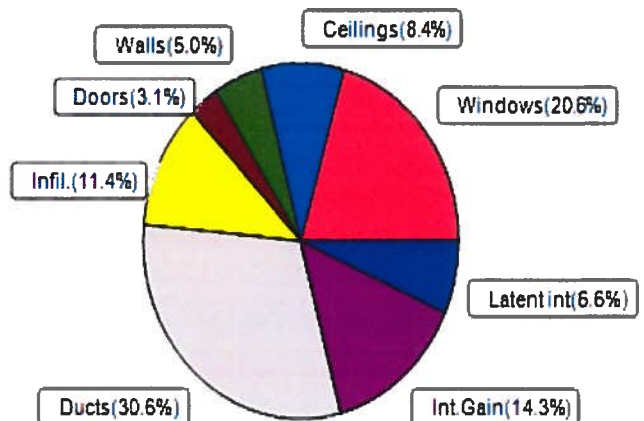

8th Edition

EnergyGauge® System Sizing

PREPARED BY: \_\_\_\_\_

DATE: \_\_\_\_\_

11/13/2019

# System Sizing Calculations - Winter

## Residential Load - Whole House Component Details

Peter & Anna Lev

Project Title:

Lake City, FL 32025

Lot 3 Creek Run Plantation

Building Type: User

11/13/2019

Reference City: Gainesville, FL (Defaults) Winter Temperature Difference: 40.0 F (TMY3 99%)

### Component Loads for Whole House

Window	Panes/Type	Frame	U	Orientation	Area(sqft)	X	HTM=	Load
1	2, NFRC 0.25	Vinyl	0.36	S	9.0		14.4	130 Btuh
2	2, NFRC 0.25	Vinyl	0.36	S	25.0		14.4	360 Btuh
3	2, NFRC 0.25	TIM	0.36	S	13.3		14.4	192 Btuh
4	2, NFRC 0.25	Vinyl	0.36	S	30.0		14.4	432 Btuh
5	2, NFRC 0.25	Vinyl	0.36	N	60.0		14.4	864 Btuh
6	2, NFRC 0.25	Metal	0.36	N	106.7		14.4	1536 Btuh
7	2, NFRC 0.25	Vinyl	0.36	N	9.0		14.4	130 Btuh
8	2, NFRC 0.25	Vinyl	0.36	N	6.0		14.4	86 Btuh
9	2, NFRC 0.25	Vinyl	0.36	W	20.0		14.4	288 Btuh
Window Total					279.0(sqft)			4018 Btuh
Walls	Type	Ornt.	Ueff.	R-Value (Cav/Sh)	Area	X	HTM=	Load
1	Ins. Conc. Form - Ext		(0.027)	30.0/0.0	200		1.10	219 Btuh
2	Ins. Conc. Form - Ext		(0.027)	30.0/0.0	82		1.10	90 Btuh
3	Ins. Conc. Form - Ext		(0.027)	30.0/0.0	277		1.10	303 Btuh
4	Ins. Conc. Form - Ext		(0.027)	30.0/0.0	403		1.10	442 Btuh
5	Ins. Conc. Form - Ext		(0.027)	30.0/0.0	176		1.10	193 Btuh
6	Frame - Wood - Adj		(0.089)	13.0/0.0	205		3.55	729 Btuh
7	Frame - Wood - Adj		(0.089)	13.0/0.0	61		3.55	216 Btuh
Wall Total					1405(sqft)			2192 Btuh
Doors	Type	Storm	Ueff.		Area	X	HTM=	Load
1	Insulated - Garage, n		(0.460)		20		18.4	368 Btuh
2	Insulated - Exterior, n		(0.460)		20		18.4	368 Btuh
Door Total					40(sqft)			736 Btuh
Ceilings	Type/Color/Surface		Ueff.	R-Value	Area	X	HTM=	Load
1	Vented Attic/L/Metal		(0.025)	38.0/0.0	1767		1.0	1794 Btuh
Ceiling Total					1767(sqft)			1794 Btuh
Floors	Type		Ueff.	R-Value	Size	X	HTM=	Load
1	Slab On Grade		(1.180)	0.0	184.0 ft(perim.)		47.2	8685 Btuh
Floor Total					1683 sqft			8685 Btuh
Envelope Subtotal:								17424 Btuh
Infiltration	Type	Wholehouse	ACH	Volume(cuft)	Wall Ratio	CFM=		
	Natural		0.19	15702	1.00	49.7		2175 Btuh
Duct load	Average sealed, R6.0, Supply(Att), Return(Att) (DLM of 0.262)							5135 Btuh
All Zones	Sensible Subtotal All Zones							24734 Btuh



# Manual J Winter Calculations

## Residential Load - Component Details (continued)

Peter & Anna Lev

Lake City, FL 32025

Project Title:  
Lot 3 Creek Run Plantation  
Building Type: User

11/13/2019

### WHOLE HOUSE TOTALS

<b>Totals for Heating</b>	Subtotal Sensible Heat Loss	24734 Btuh
	Ventilation Sensible Heat Loss	0 Btuh
	<b>Total Heat Loss</b>	<b>24734 Btuh</b>

### EQUIPMENT

1. Electric Heat Pump	#	24734 Btuh
-----------------------	---	------------

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)  
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)  
U - (Window U-Factor)  
HTM - (ManualJ Heat Transfer Multiplier)



Version 8

# System Sizing Calculations - Summer

## Residential Load - Whole House Component Details

Peter & Anna Lev

Project Title:

Lot 3 Creek Run Plantation

Lake City, FL 32025

11/13/2019

Reference City: Gainesville, FL

Temperature Difference: 19.0F(TMY3 99%) Humidity difference: 51gr.

### Component Loads for Whole House

Window	Type*						Overhang		Window Area(sqft)			HTM		Load		
	Panes	SHGC	U	InSh	IS	Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded			
1	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	1.0ft.	9.0	9.0	0.0	12	14	109	Btuh	
2	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	1.0ft.	25.0	25.0	0.0	12	14	302	Btuh	
3	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	1.0ft.	13.3	13.3	0.0	12	14	161	Btuh	
4	2 NFRC	0.25, 0.36	No	No	S		1.5ft.	1.0ft.	30.0	30.0	0.0	12	14	363	Btuh	
5	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	60.0	0.0	60.0	12	12	726	Btuh	
6	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	106.7	0.0	106.7	12	12	1291	Btuh	
7	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	9.0	0.0	9.0	12	12	109	Btuh	
8	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	6.0	0.0	6.0	12	12	73	Btuh	
9	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	20.0	1.0	19.0	12	31	600	Btuh	
	Window Total								279 (sqft)					3734 Btuh		
Walls	Type						U-Value		R-Value		Area(sqft)		HTM		Load	
									Cav/Sheath							
1	Insulated Concrete Form- Ext						0.03		30.0/0.0		200.2		0.4		80 Btuh	
2	Insulated Concrete Form- Ext						0.03		30.0/0.0		82.0		0.4		33 Btuh	
3	Insulated Concrete Form- Ext						0.03		30.0/0.0		276.9		0.4		111 Btuh	
4	Insulated Concrete Form- Ext						0.03		30.0/0.0		403.2		0.4		161 Btuh	
5	Insulated Concrete Form- Ext						0.03		30.0/0.0		176.0		0.4		70 Btuh	
6	Frame - Wood - Adj						0.09		13.0/0.0		205.3		1.7		346 Btuh	
7	Frame - Wood - Adj						0.09		13.0/0.0		60.9		1.7		103 Btuh	
	Wall Total								1405 (sqft)					904 Btuh		
Doors	Type										Area (sqft)		HTM		Load	
1	Insulated - Garage										20.0		13.8		276 Btuh	
2	Insulated - Exterior										20.0		13.8		276 Btuh	
	Door Total								40 (sqft)					552 Btuh		
Ceilings	Type/Color/Surface						U-Value		R-Value		Area(sqft)		HTM		Load	
1	Vented Attic/Light/Metal/RB						0.025		38.0/0.0		1767.0		0.86		1525 Btuh	
	Ceiling Total								1767 (sqft)					1525 Btuh		
Floors	Type								R-Value		Size		HTM		Load	
1	Slab On Grade								0.0		1683 (ft-perimeter)		0.0		0 Btuh	
	Floor Total								1683.0 (sqft)					0 Btuh		
	Envelope Subtotal:														6715 Btuh	
Infiltration	Type						Average ACH		Volume(cuft)		Wall Ratio		CFM=		Load	
	Natural						0.14		15702		1		37.2		775 Btuh	
Internal gain							Occupants		Btuh/occupant		Appliance		Load			
							6		X 230		+		1200		2580 Btuh	
	Sensible Envelope Load:														10069 Btuh	
Duct load	Average sealed,Supply(R6.0-Attic), Return(R6.0-Attic)										(DGM of 0.426)		Load			
													4291 Btuh			
	Sensible Load All Zones														14361 Btuh	

# Manual J Summer Calculations

## Residential Load - Component Details (continued)

Peter & Anna Lev

Project Title: Climate:FL\_GAINESVILLE\_REGIONAL\_A  
Lot 3 Creek Run Plantation

Lake City, FL 32025

11/13/2019

### WHOLE HOUSE TOTALS

<b>Whole House Totals for Cooling</b>	<b>Sensible Envelope Load All Zones</b>	<b>10069 Btuh</b>
	Sensible Duct Load	4291 Btuh
	<b>Total Sensible Zone Loads</b>	<b>14361 Btuh</b>
	Sensible ventilation	0 Btuh
	Blower	0 Btuh
	<b>Total sensible gain</b>	<b>14361 Btuh</b>
	Latent infiltration gain (for 51 gr. humidity difference)	1285 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	1236 Btuh
	Latent occupant gain (6.0 people @ 200 Btuh per person)	1200 Btuh
	Latent other gain	0 Btuh
	<b>Latent total gain</b>	<b>3722 Btuh</b>
	<b>TOTAL GAIN</b>	<b>18083 Btuh</b>

### EQUIPMENT

1. Central Unit	#	18083 Btuh
-----------------	---	------------

\*Key: Window types (Panels - Number and type of panes of glass)

(SHGC - Shading coefficient of glass as SHGC numerical value)

(U - Window U-Factor)

(InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))

- For Blinds: Assume medium color, half closed

For Draperies: Assume medium weave, half closed

For Roller shades: Assume translucent, half closed

(IS - Insect screen: none(N), Full(F) or Half(½))

(Ornt - compass orientation)



Version 8